

Comanche Peak Nuclear Power Plant, Units 3 & 4 COL Application Part 2, FSAR

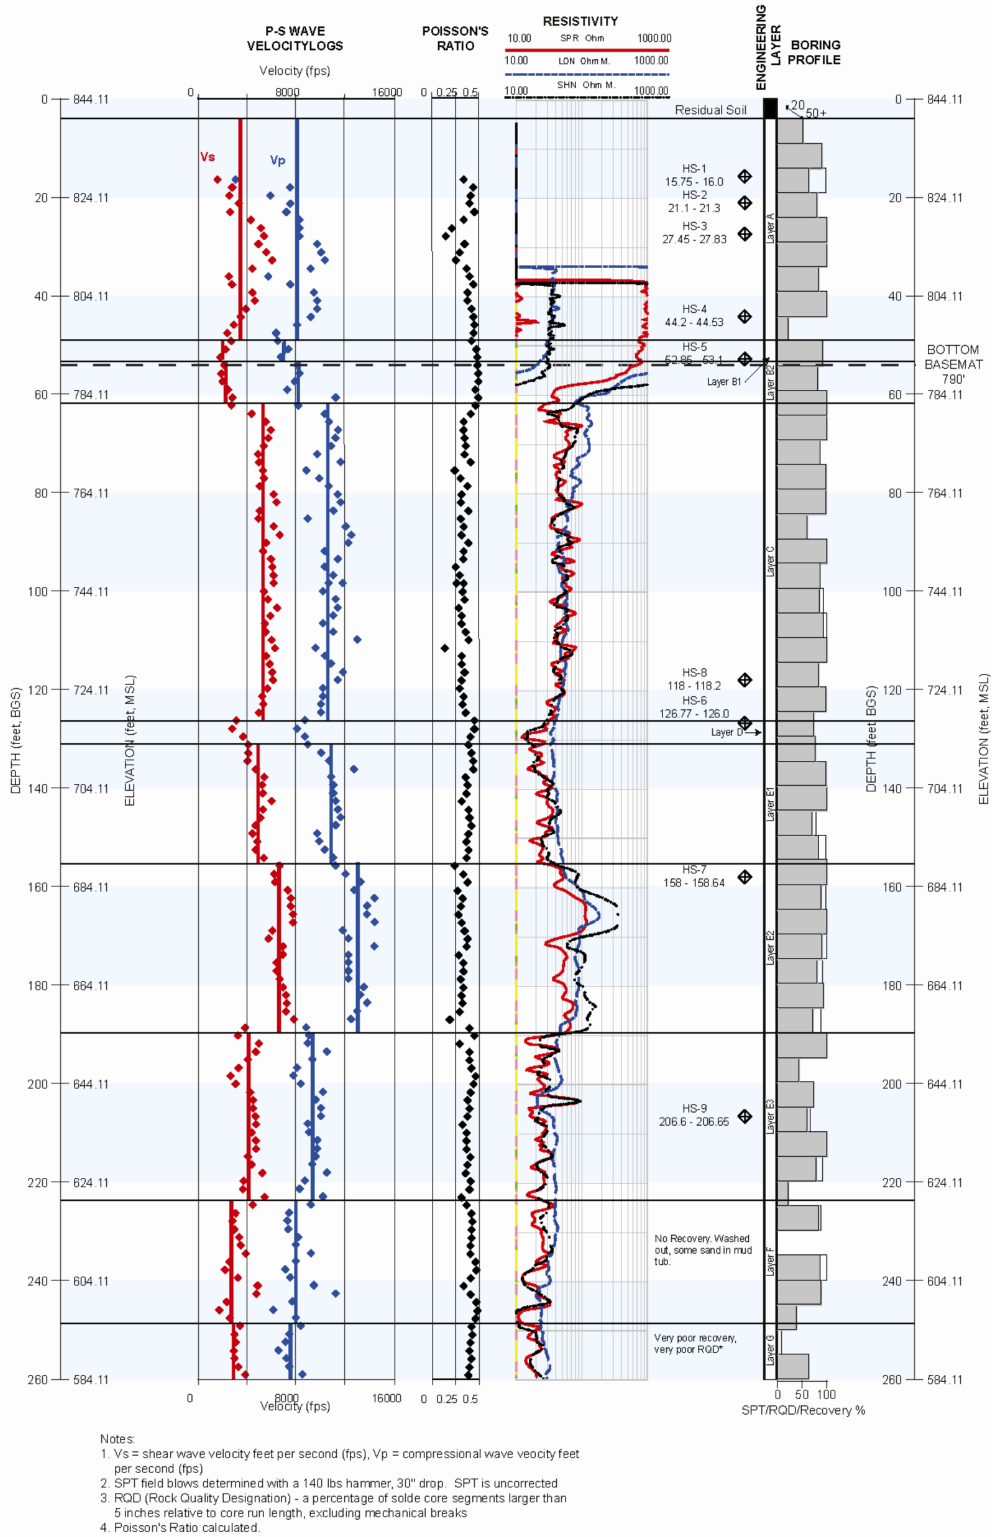


Figure 2.5.4-208 Boring In Situ Test Summary Log, B-1012 (Sheet 1 of 3)

Comanche Peak Nuclear Power Plant, Units 3 & 4 COL Application Part 2, FSAR

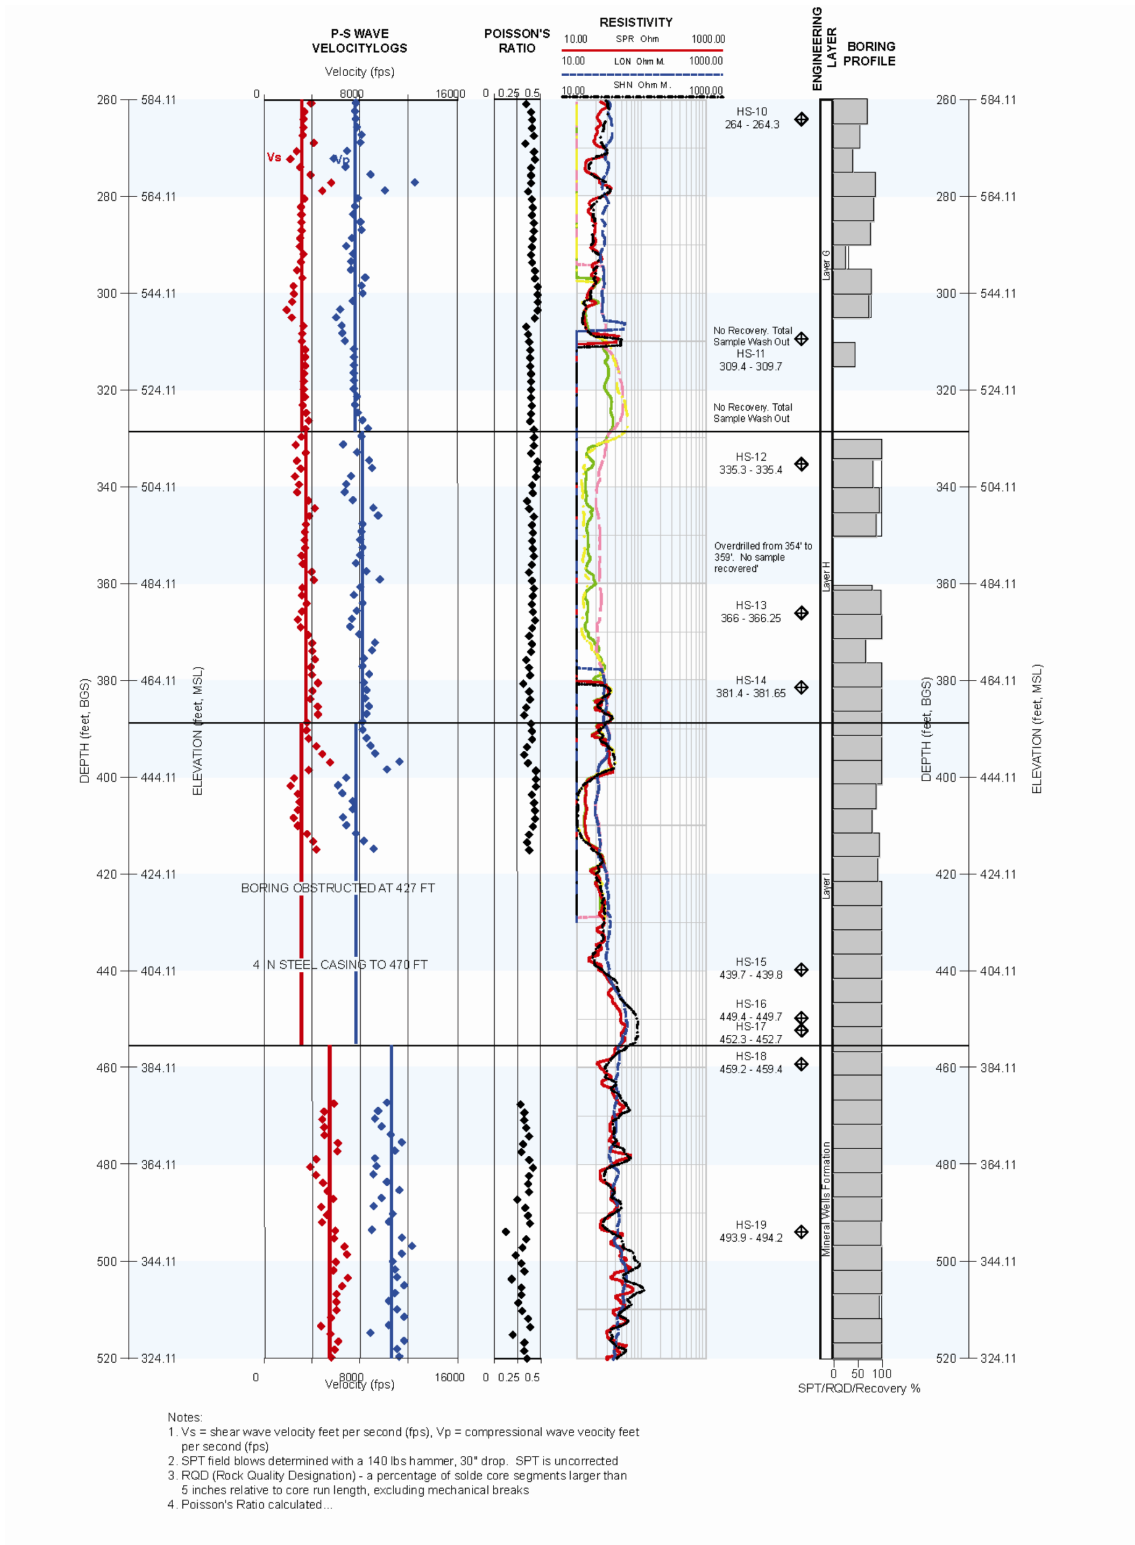


Figure 2.5.4-208 Boring In Situ Test Summary Log, B-1012 (Sheet 2 of 3)

**Comanche Peak Nuclear Power Plant, Units 3 & 4
COL Application
Part 2, FSAR**

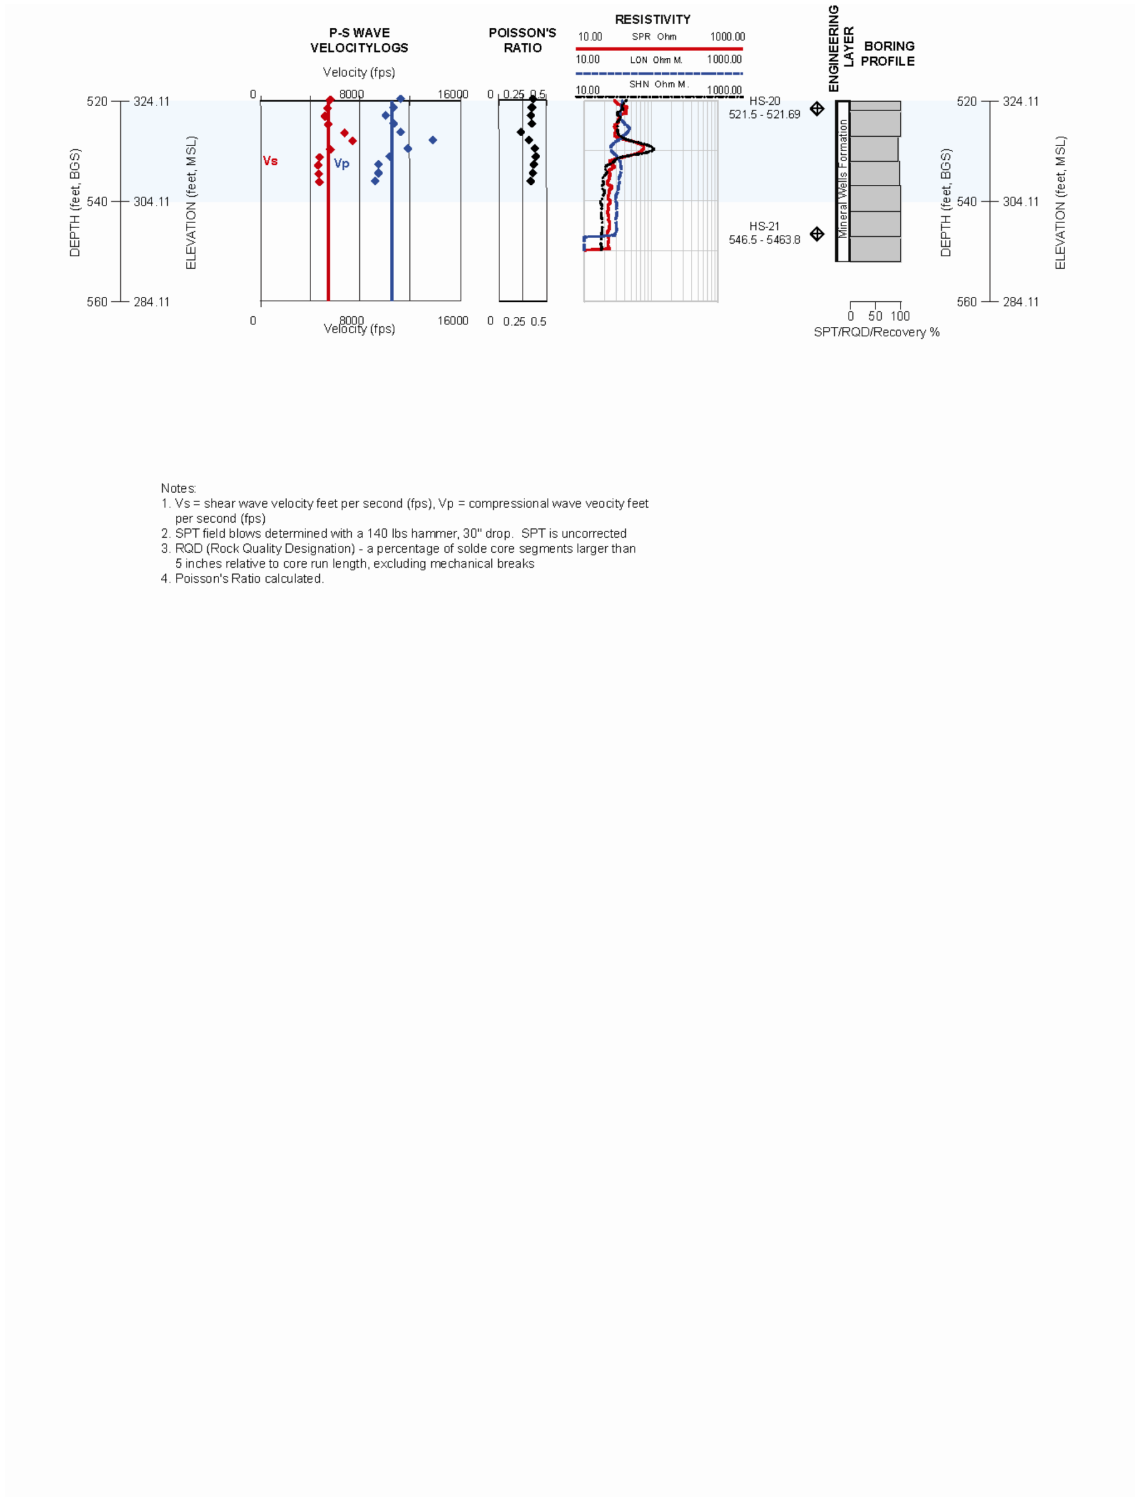


Figure 2.5.4-208 Boring In Situ Test Summary Log, B-1012 (Sheet 3 of 3)