

# Comanche Peak Nuclear Power Plant, Units 3 & 4 COL Application Part 2, FSAR

H-H static (Rapid Drawdown)  
 Method: Spencer  
 Horizontal Seismic Coeff. Value: 0  
 Vertical Seismic Coeff. Value: 0  
 Compacted Fill Strength: C=200 psi, Phi=32 deg  
 Shale Strength: Fully-Softened Lower Bound (Shear-Normal Function)  
 Limestone Strength: Hoek-Brown Lower Bound (Shear-Normal Function)

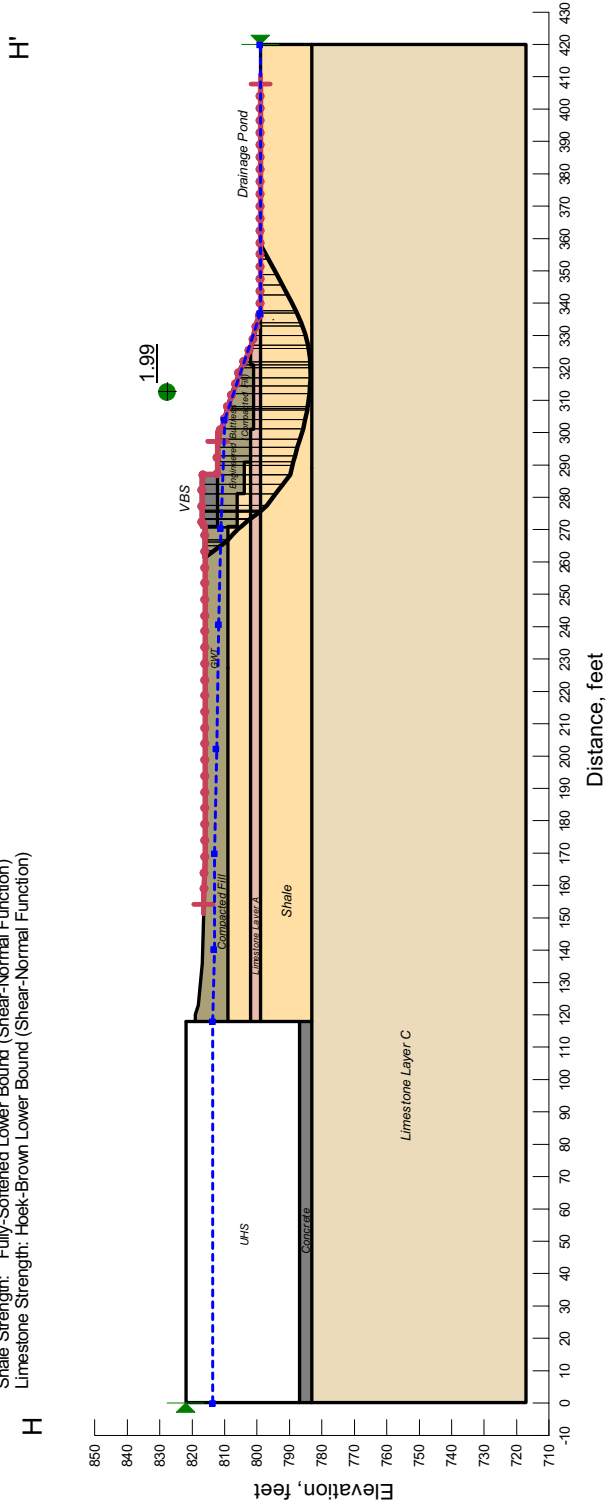


Figure 2.5.5-214 Static Stability Analysis- Cross Section H-H'