




REACTOR BUILDINGS

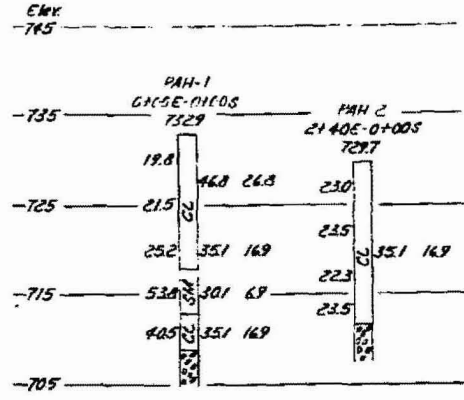


PLANT BUILDINGS

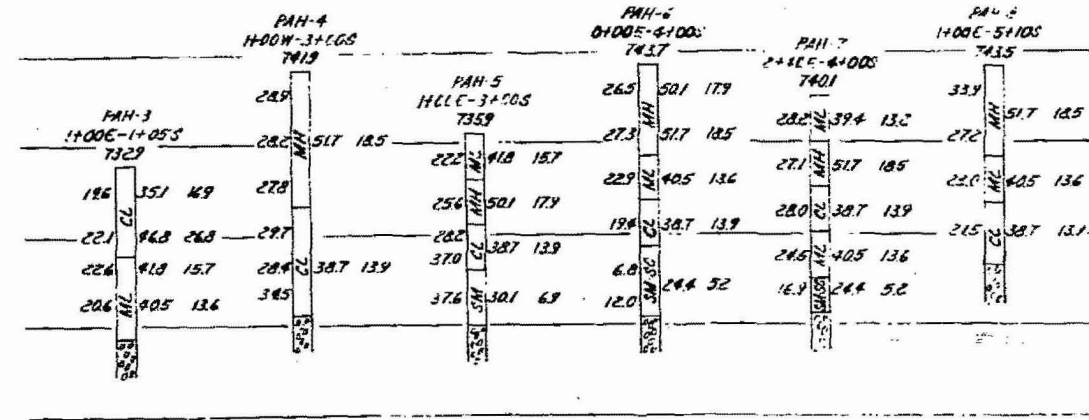


TRANSFORMER YARD & 500 KV SWITCHYARD

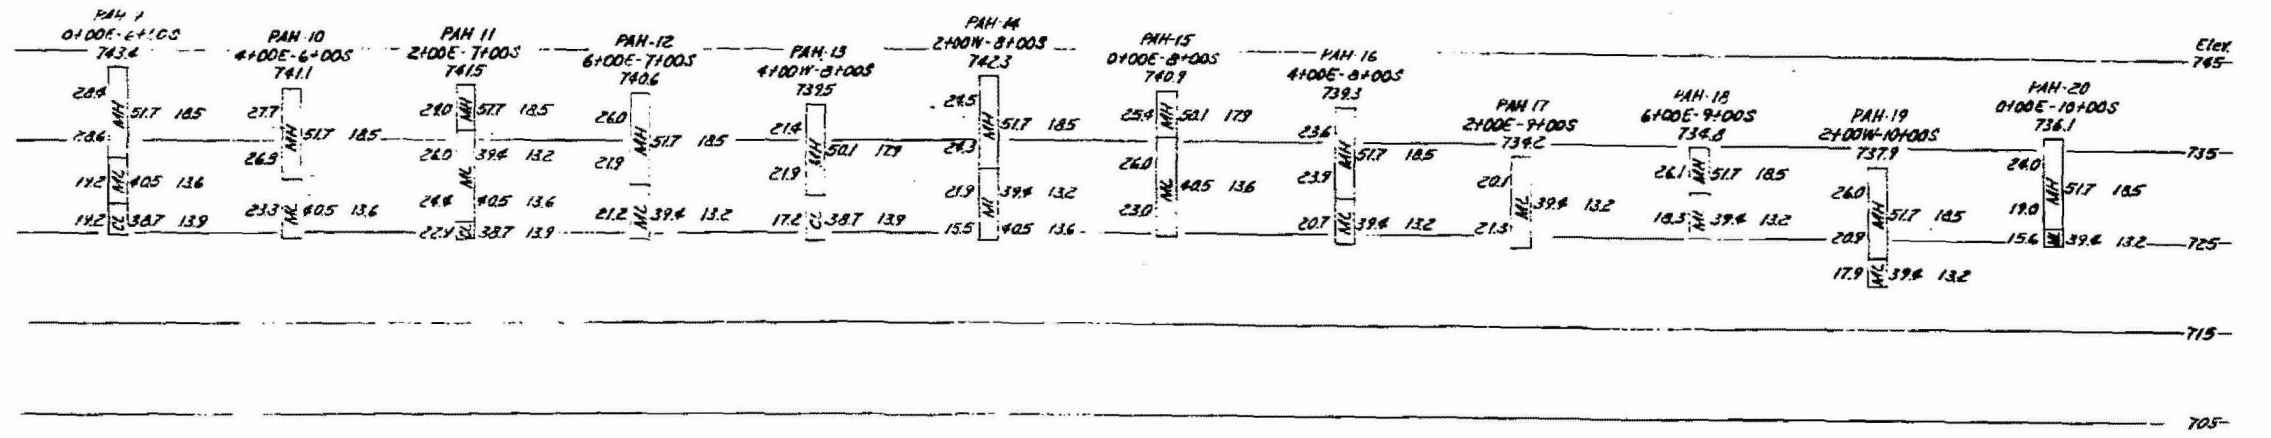

COOLING TOWERS

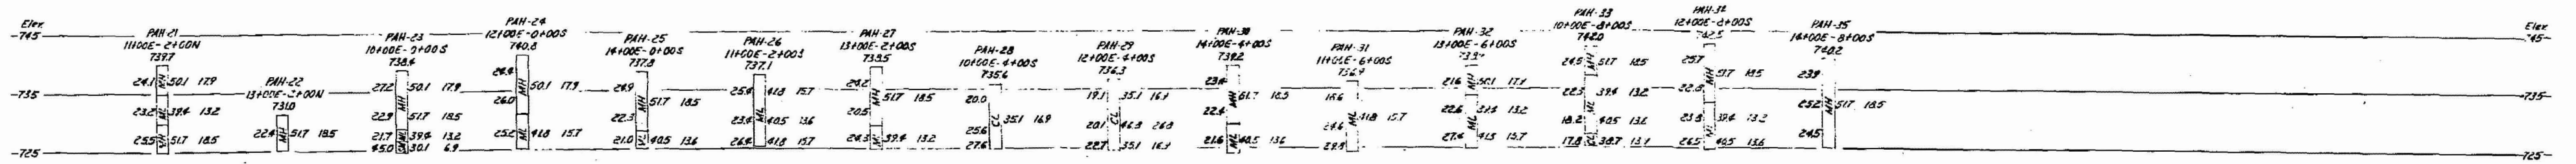

INTAKE CHANNEL

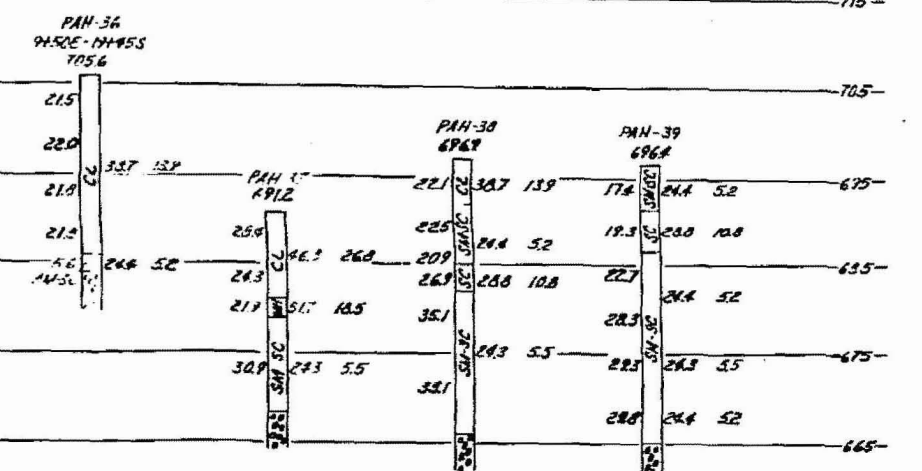

LEGEND
 Map to Location
 Elev. in feet
 Liquid
 Plasticity
 Index

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT
 BORROW INVESTIGATION
 Figure 2.5-222