


NOTES:
 1. ALL MOTOR OPERATED VALVES SHALL HAVE MANUAL OPERATION HANDWHEELS.

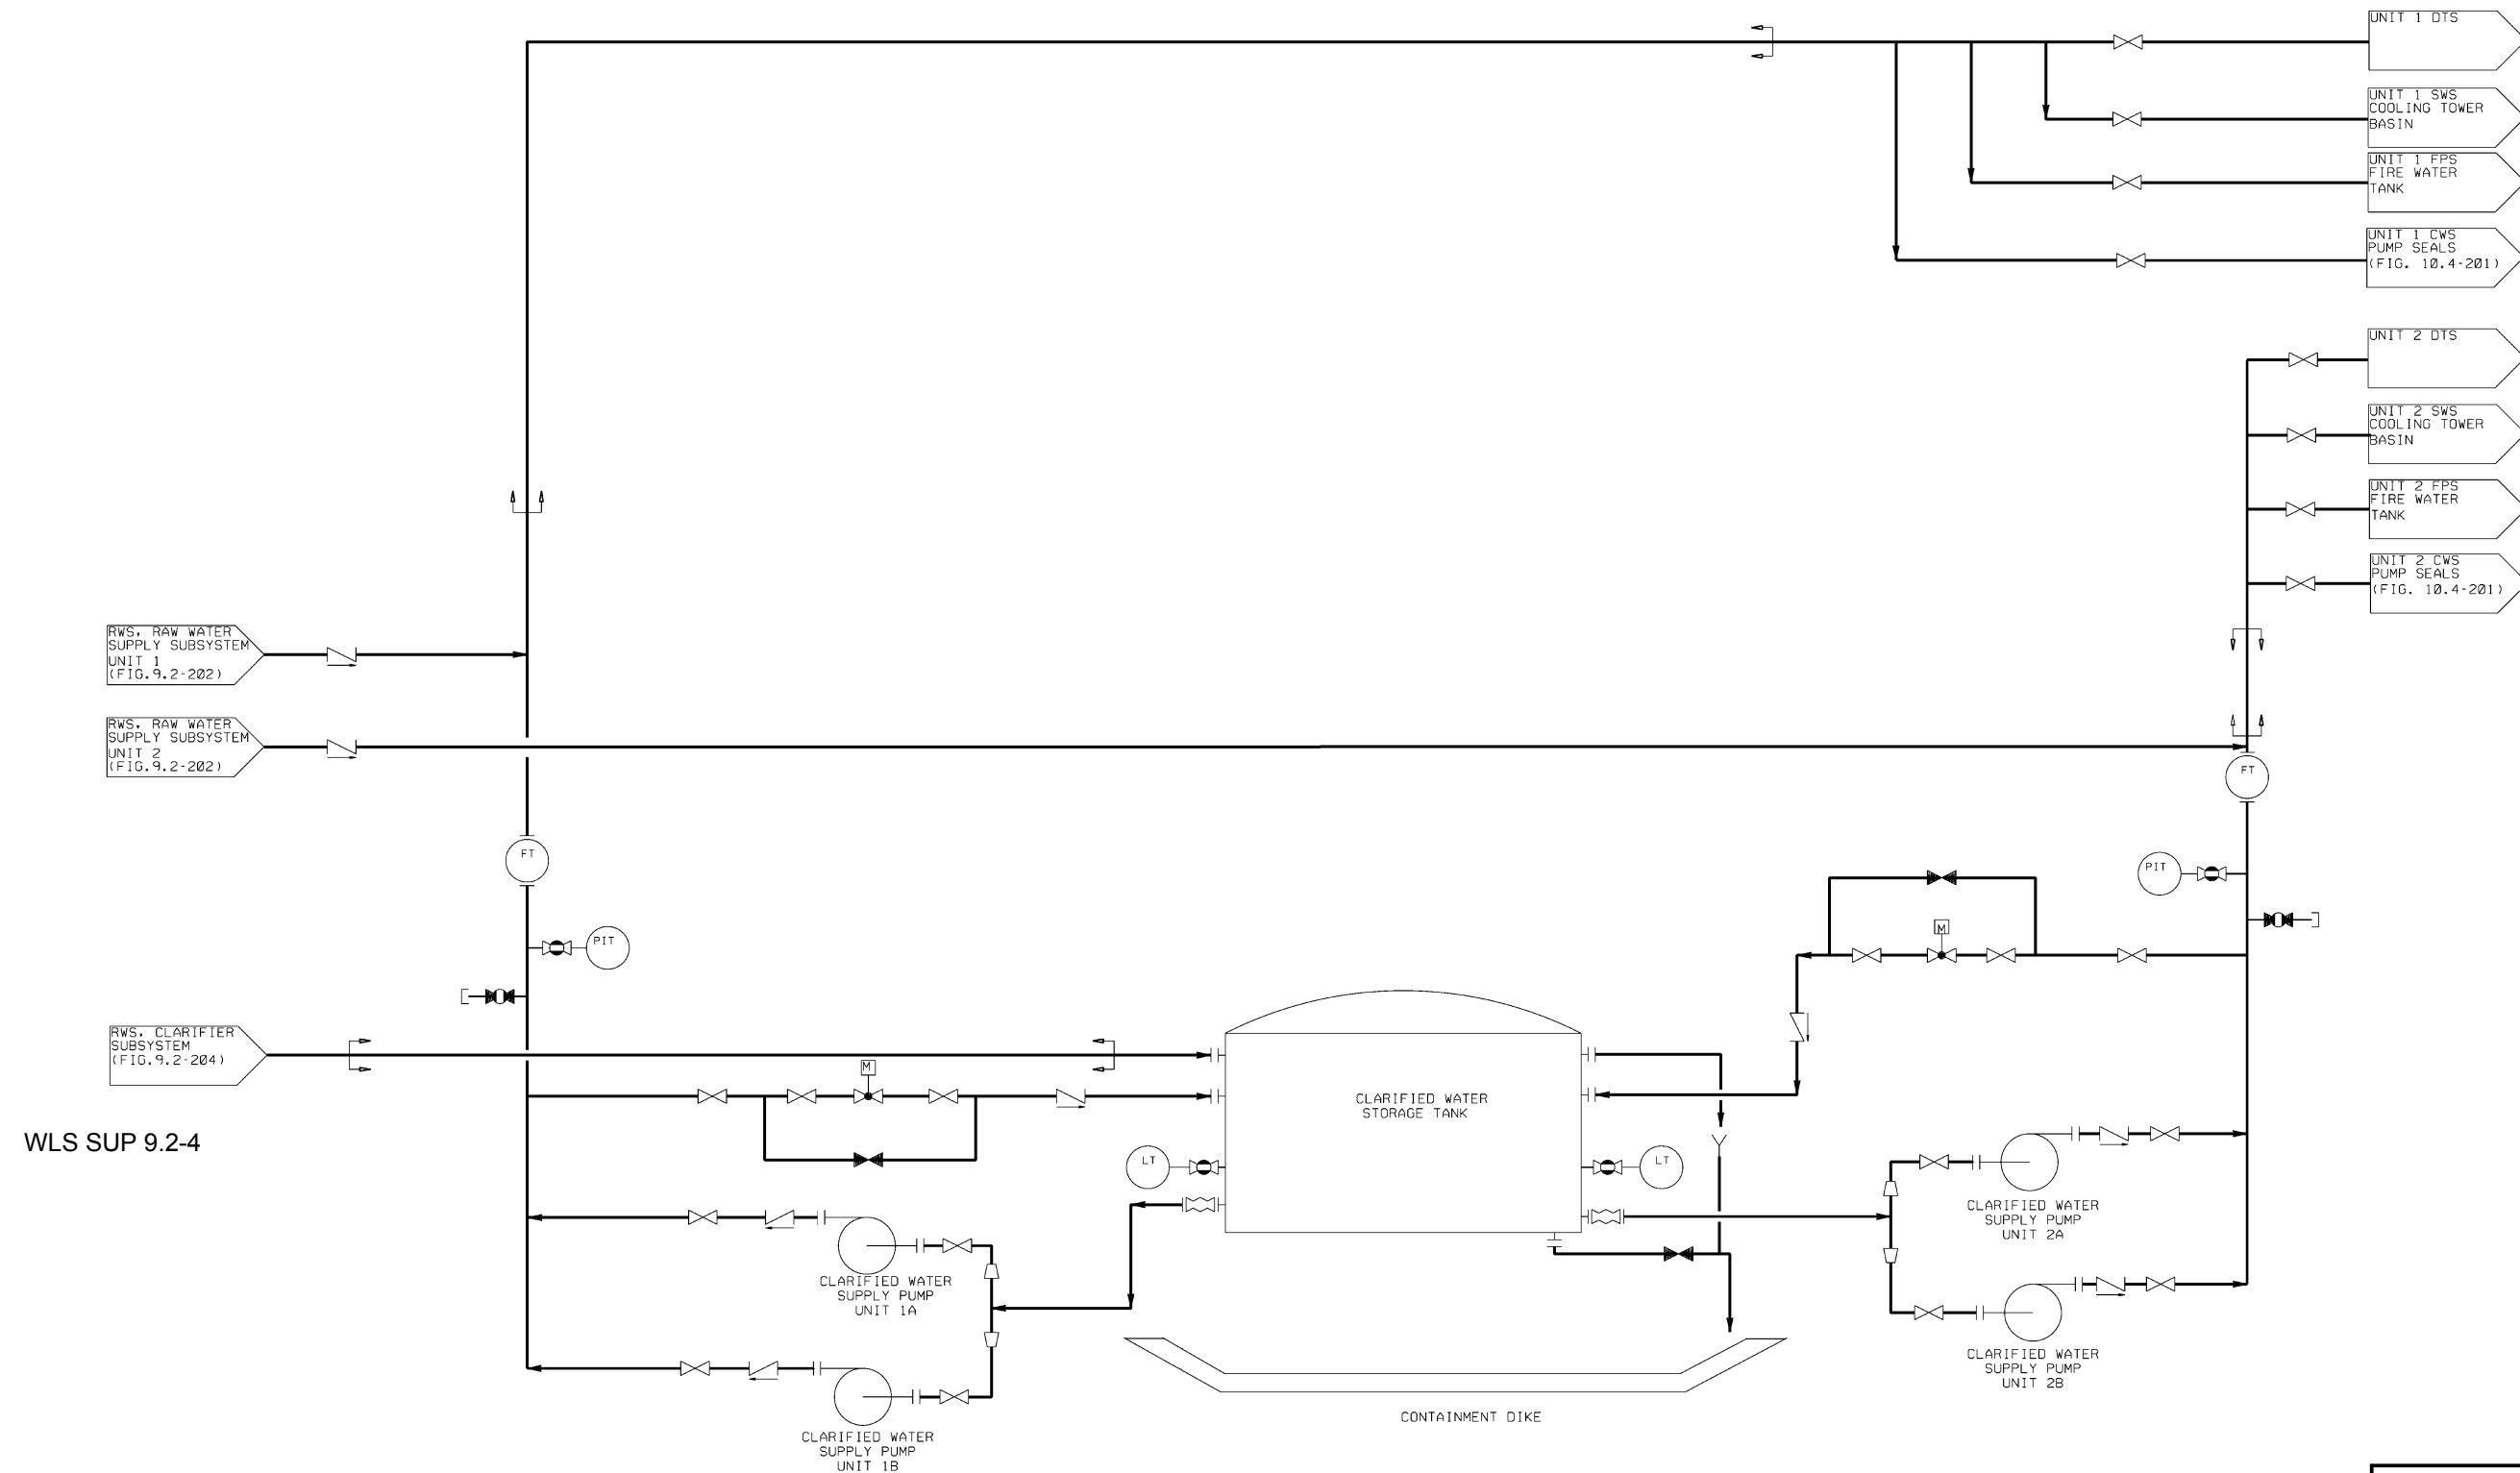

WILLIAM STATES LEE III
 NUCLEAR STATION UNITS 1 & 2

Raw Water System,
 Clarified Water Subsystem