


NOTES:
 1. ALL MOTOR OPERATED VALVES SHALL HAVE
 MANUAL OPERATION HANDWHEELS.

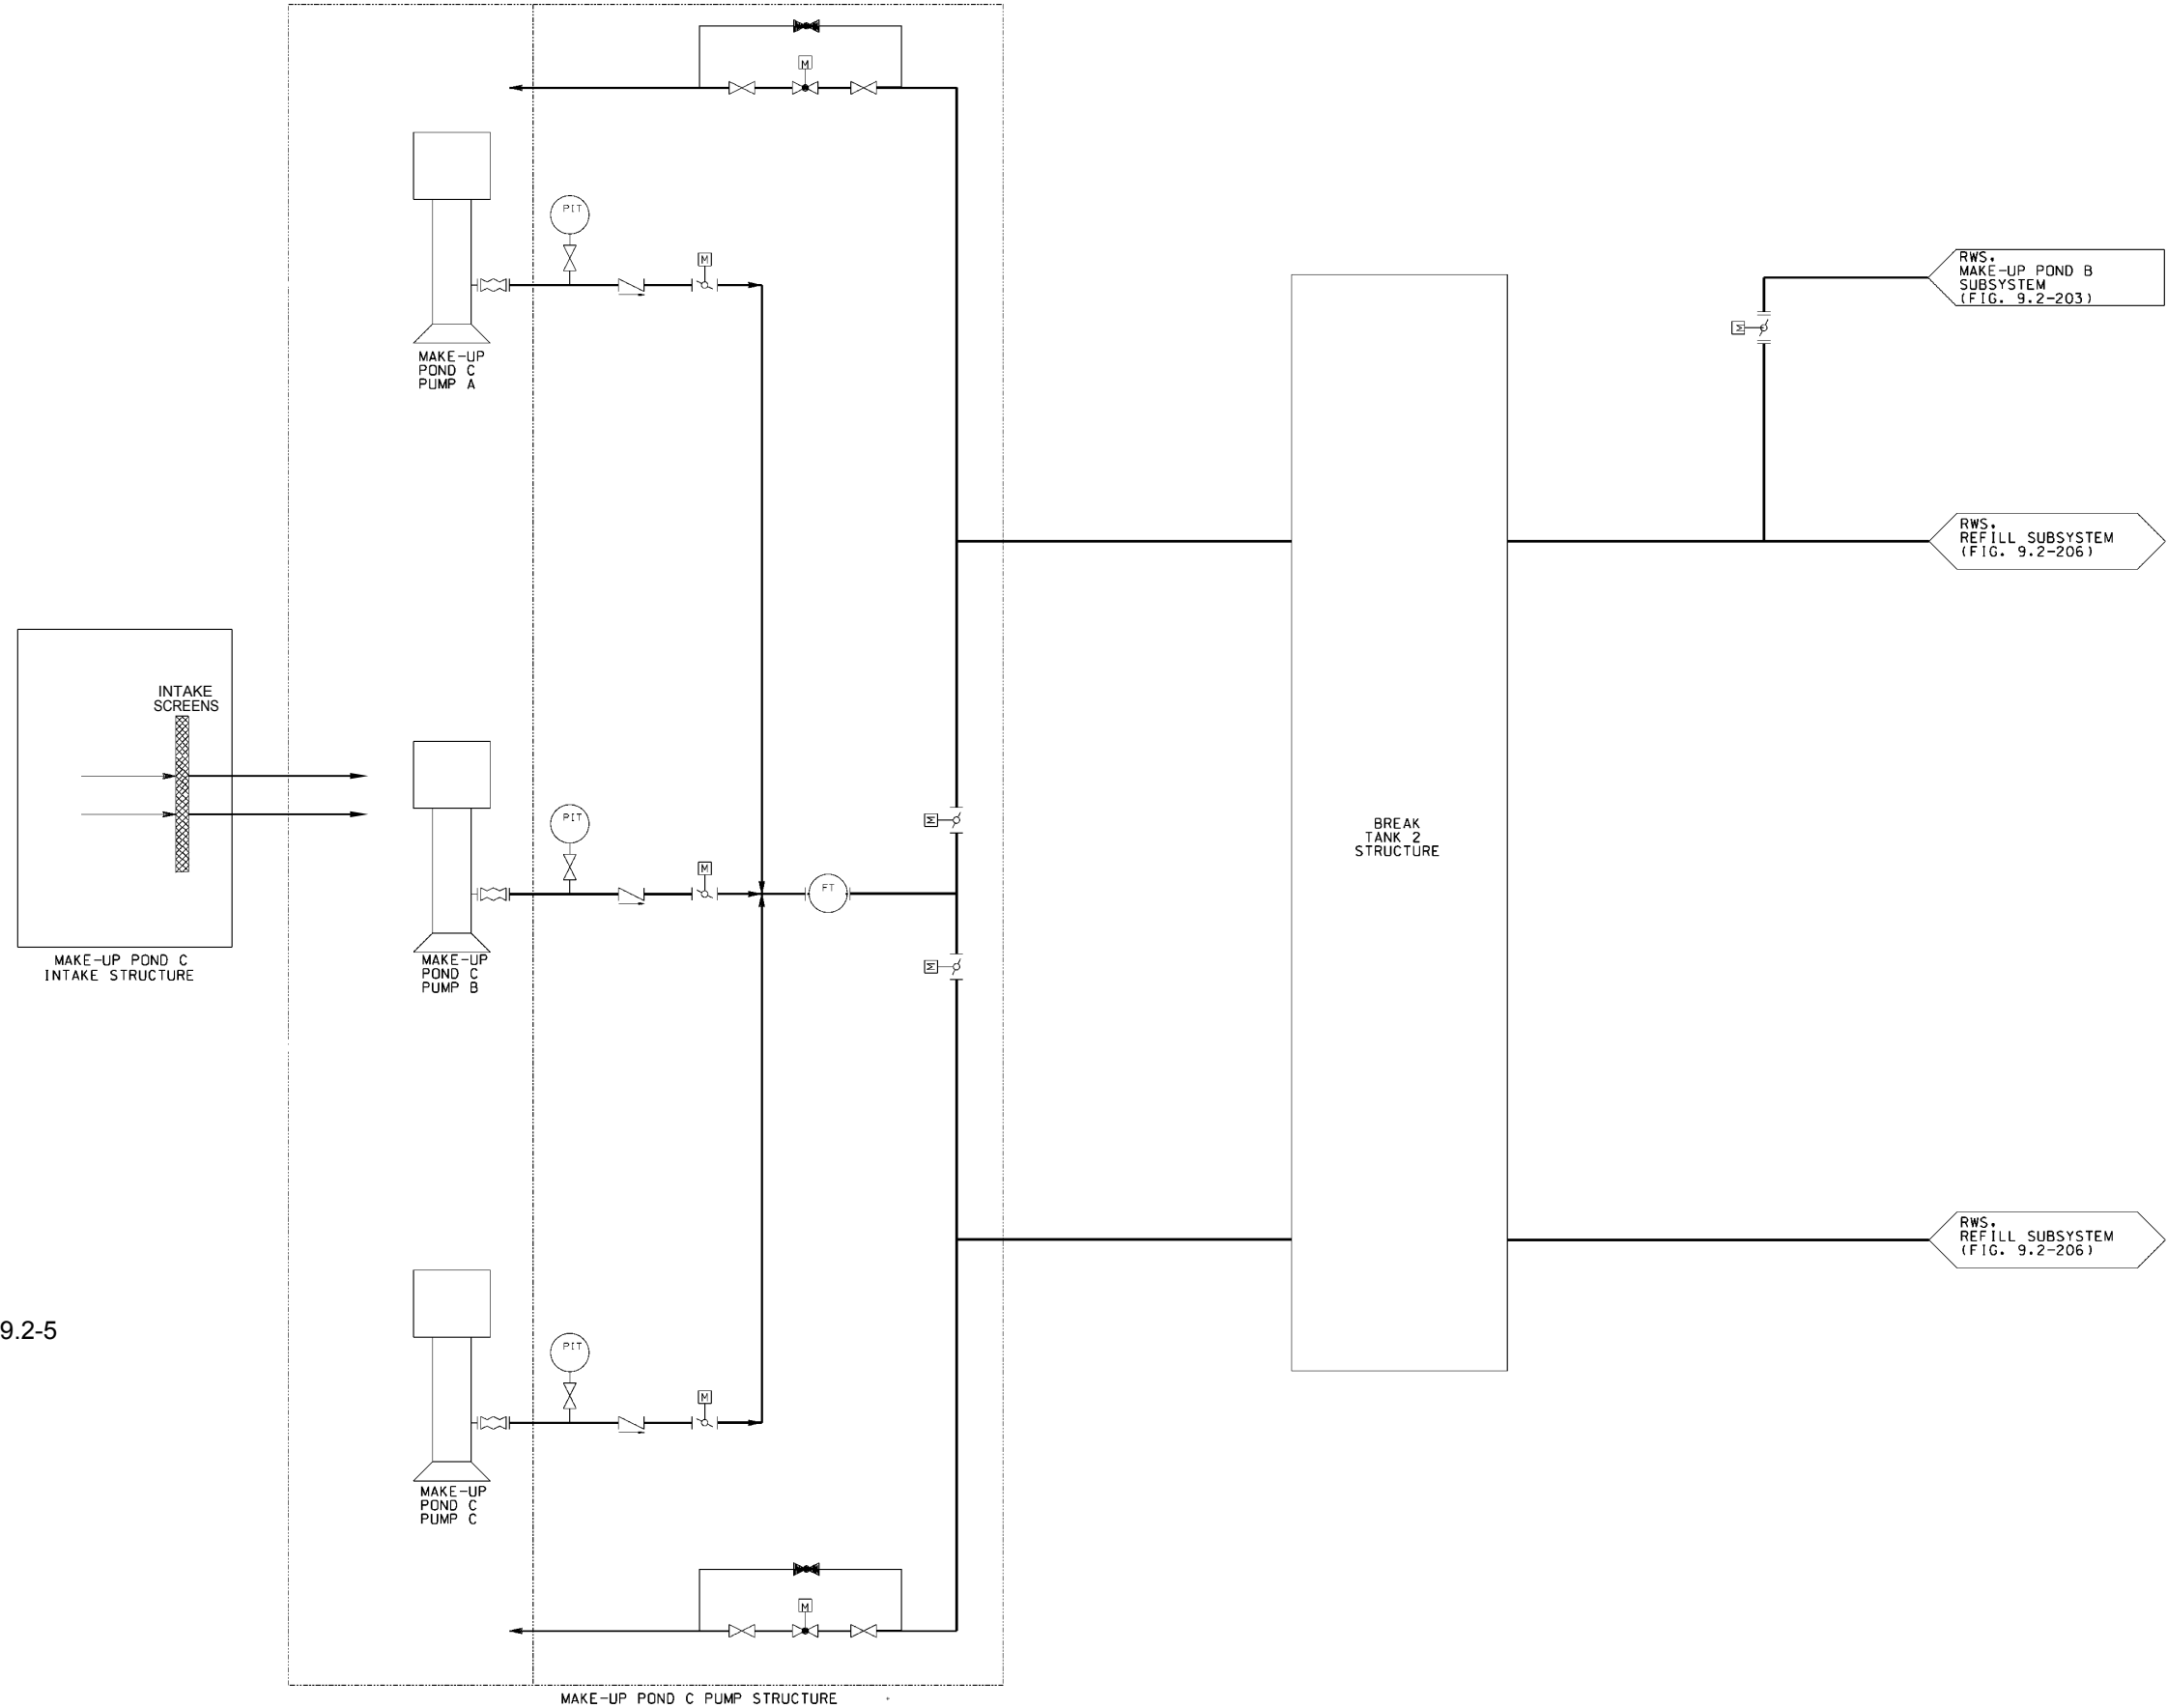

WLS SUP 9.2-5

WILLIAM STATES LEE III
 NUCLEAR STATION UNITS 1 & 2
 Raw Water System,
 Make-Up Pond C Subsystem
 FIGURE 9.2-207 Rev 3