

3.5 Missile Protection

General Design Criterion 4 of Appendix A to 10 CFR 50 requires that structures systems and components important to safety be protected from the effects of missiles. The AP1000 criteria for protection from postulated missiles provide the capability to safely shut down the reactor and maintain it in a safe shutdown condition. The AP1000 criteria also protect the integrity of the reactor coolant system pressure boundary and maintain offsite radiological dose/concentration levels within the limits defined in 10 CFR 50.34.

Missiles may be generated by pressurized components, rotating machinery, and explosions within the plant and by tornadoes or transportation accidents external to the plant. Potential missile hazards are eliminated to the extent practical by minimizing the potential sources of missiles through proper selection of equipment, and by arrangement of structures and equipment in a manner to minimize the potential for damage from missiles. Potential missiles due to failures of nonseismic items are addressed in [Subsection 3.7.3.13](#). Heavy load-drop evaluations are described in [Subsection 9.1.5](#).

The following are definitions for missile protection terminology:

Internally Generated Missile – A mass that may be accelerated by energy sources continuously present on site.

Single Active Failure – Malfunction or loss of a component of electrical or fluid systems. The failure of an active component of a fluid system is considered to be a loss of component function as a result of mechanical, hydraulic, pneumatic, or electrical malfunction, but not the loss of component structural integrity.

High-Energy System – Fluid systems that, during normal plant conditions, are operated or maintained pressurized with a maximum operating temperature greater than 200°F and/or a maximum operating pressure greater than 275 psig, as discussed in [Subsection 3.6.1](#).

The following criteria are applied in the identification of missiles and the protection requirements that must be satisfied:

- A missile must not damage structures, systems, or components to the extent that could prevent achieving or maintaining safe shutdown of the plant or result in a significant release of radioactivity.
- A single active component failure is assumed in systems used to mitigate the consequences of the postulated missile and achieve a safe shutdown condition. The single active component failure is assumed to occur in addition to the postulated missile and any direct consequences of the missile. When the postulated missile is generated in one of two or more redundant trains of a dual-purpose safety-related fluid system, which is designed to seismic Category I standards and is capable of being powered from both onsite and offsite sources, a single active component failure need not be assumed in the remaining train(s), or associated supporting trains.
- Walls, partitions, and other items that enclose safety-related systems, or separate redundant trains of safety related equipment, must be constructed so that a postulated missile cannot damage components required to achieve safe shutdown nor damage components required to prevent a release of radioactivity producing offsite doses in excess of 10 CFR 50.34 limits.
- A postulated missile from the reactor coolant system must not cause loss of integrity of the primary containment, main steam, feedwater, or other loop of the reactor coolant system.

- A postulated missile from any system other than the reactor coolant system must not cause loss of integrity of the containment or the reactor coolant system pressure boundary.
- Other plant accidents or severe natural phenomena are not assumed to occur in conjunction with a postulated missile (except for tornado).
- Offsite power is assumed to be unavailable if a trip of the turbine-generator or reactor protection system is a direct consequence of the postulated missile.
- Safe shutdown is accomplished using only safety-related systems with a coincident single active failure, although nonsafety-related systems not affected by the missile are available to support safe shutdown.
- Missiles are postulated to occur where the single failure of a retention mechanism can result in a missile, unless the missile is not considered credible as discussed later. Missiles created by the independent failures of two retention mechanisms are not postulated.
- The energy of postulated missiles produced by rotating components is based on a 120 percent overspeed condition, unless such an overspeed condition is not possible (such as a synchronous motor).
- Equipment required for safe shutdown is located in plant areas separate from potential missile sources wherever practical.
- Spatial separation may be used to demonstrate protection from missile hazards when it is shown that the range and trajectory of the generated missile is less than the distance to or is directed away from the potential target.

The AP1000 passive design minimizes the number of safety-related structures, systems, and components required for safe shutdown. Systems required for safe shutdown are identified in [Chapter 7](#). Safety class structures, systems and components, their location, seismic category, and quality group classifications are given in [Section 3.2](#). General arrangement drawings showing locations of the structures, systems, and components are given in [Section 1.2](#). The areas required for safe shutdown, and the major systems and components housed therein that are required to be protected from internally and externally generated missiles for safe shutdown, are summarized below:

- The containment vessel, including the reactor coolant loop, and passive core cooling system inside containment
- The shield building, including the passive containment cooling system
- Containment penetration areas, including containment isolation valves and Class IE cables
- The control complex including the main control room, reactor protection system, batteries, and dc switchgear
- The spent fuel pit

The AP1000 relies on safety-related systems and equipment to establish and maintain safe shutdown conditions. There are no nonsafety-related systems or components that require protection from missiles.

Evaluations are performed to demonstrate that the criteria are satisfied in the event a credible missile is produced coincident with a single active component failure. These evaluations include the following:

- For those potential missiles considered to be credible, a realistic assessment is made of the postulated missile size and energy, and its potential trajectories.
- Potentially impacted components associated with systems required to achieve and maintain safe shutdown are identified.
- Loss of these potentially impacted components coincident with an assumed single active component failure is evaluated to determine if sufficient redundancy remains to achieve and maintain a safe shutdown condition. If these criteria are satisfied, no further protection is required for the identified missile. If these conditions are not satisfied, additional protective features are incorporated (for example, plant layout is modified, or barriers are added).

3.5.1 Missile Selection and Description

3.5.1.1 Internally Generated Missiles (Outside Containment)

3.5.1.1.1 Criteria for Missile Prevention

Equipment for the AP1000 is selected to minimize the potential for missiles to be generated. Missiles are postulated as described in [Subsection 3.5.1.1.2](#). The following items are the major equipment selection considerations with regards to missile prevention:

- Safety-related rotating equipment is designed so that the surrounding housings would contain fragments in the event of failure of the rotating parts.
- Valves that have only a threaded connection between the body and the bonnet are not used in high-energy systems. ASME Code, Section III valves with removable bonnets should be of the pressure-seal type or have bolted bonnets.
- Valve stems of valves located in high-energy systems have at least two retention features. In addition to the stem threads, acceptable features include back seats on the stem or a power actuator, such as an air or motor operator.
- Thermowells and other instrument wells, vents, drains, test connections, and other fittings located in high-energy systems are attached to the piping or pressurized equipment by welding. The completed joint should have a greater design strength than the parent metal. Threaded connections in high-energy systems are avoided.
- High-pressure gas cylinders permanently installed in safety-related areas are constructed to the criteria of ASME Code, Section III or Section VIII. Portable and temporary cylinders and cylinders periodically replaced in safety-related areas are constructed and handled in accordance with applicable Department of Transportation requirements for seamless steel cylinders.

3.5.1.1.2 Missile Selection

3.5.1.1.2.1 Missiles not Considered Credible

This subsection describes internally generated missiles (outside of containment) not considered credible. Missiles not considered credible include the following:

- Catastrophic failure of safety-related rotating equipment (such as pumps, fans, and compressors) leading to the generation of missiles is not considered credible. These components are designed to preclude having sufficient energy to move the masses of their rotating parts through the housings in which they are contained. In addition, material characteristics, inspections, quality control during fabrication and erection, and prudent operation as applied to the particular component reduce the likelihood of missile generation.
- Catastrophic failure of nonsafety-related rotating equipment is not considered credible in situations where measures similar to those just described for safety-related rotating equipment are applied to them. Protection from nonsafety-related equipment will normally be provided by separation. In special situations, equipment features may be used to prevent missile formation.
- Provisions to preclude generation of missiles due to failure of the turbine generator are discussed in [Subsection 3.5.1.3](#).
- Missiles originating in non-high-energy fluid systems are not considered credible because these systems have insufficient stored energy.
- The valve bonnets of pressure-seal, bonnet-type valves, constructed in accordance with ASME Code, Section III, are not considered credible missiles. The valve bonnets are prevented from becoming missiles by the retaining ring, which would have to fail in shear, and by the yoke capturing the bonnet or reducing bonnet energy. Because of the conservative design of the retaining ring of these valves, bonnet ejection is unlikely.
- The valves of the bolted bonnet design, constructed in accordance with ASME Code, Section III, are not considered credible missiles. These bolted bonnets are prevented from becoming missiles by limiting stresses in the bonnet-to-body bolting material according to ASME Code, Section III requirements, and by designing flanges in accordance with applicable code requirements. Even if bolt failure would occur, the likelihood of all bolts experiencing simultaneous complete severance failure is not credible. The widespread use of valves with bolted bonnets, and the low historical incidence of complete severance failure of the bonnet, confirm that bolted valve bonnets are not credible missiles. Safety-relief valves in high energy systems use the bolted bonnet design.
- Valve stems are not considered as credible missiles if at least one feature (in addition to the stem threads) is included in their design to prevent ejection. Valve stems with back seats are prevented from becoming missiles by this feature. In addition, the valve stems of valves with power actuators, such as air- or motor-operated valves, are effectively restrained by the valve actuator. Valve stems of rotary motion valves, such as plug valves, ball valves (except single-seat ball valves) and butterfly valves, as well as diaphragm-type valves are not considered as credible missiles. Because these valves do not have a large reservoir of pressurized fluid acting on the valve stem, there is little stored energy available to produce a missile.
- Nuts, bolts, nut and bolt combinations, and nut and stud combinations have only a small amount of stored energy and thus are not considered as credible missiles.
- Thermowells and similar fittings attached to piping or pressurized equipment by welding are not considered as credible missiles where the completed joint has a greater design strength than the parent metal. Such a design makes missile formation not credible. Threaded connections are not used to connect instrumentation to high-energy systems or components.

- Instrumentation such as pressure, level, and flow transmitters and associated piping and tubing are not considered as credible missiles. The quantity of high energy fluid in these instruments is limited and will not result in the generation of missiles. The connecting piping and tubing is made up using welded joints or compression fittings for the tubing. Tubing is small diameter and has only a small amount of stored energy.
- ASME Code, Section III vessel ruptures and ruptures of gas storage vessels constructed without welding using ASME Code, Section VIII criteria are not considered credible due to the conservative design, material characteristics, inspections, quality control during fabrication and erection, and prudent operation.
- Rotating components that operate less than 2 percent of the time are not considered credible sources of missiles. Components that are excluded by this criterion include motors on valve operators and pumps in systems that operate infrequently, such as the chemical and volume control makeup pumps. This exclusion is similar to the exclusion mentioned in [Subsection 3.6.1.1](#), that is, of lines from the high-energy category of lines that have limited operating time in high energy conditions.
- Valves, rotating equipment, vessels, and small fittings not otherwise considered to be credible missiles due to design features or other considerations are not considered to be a potential source of missiles when struck by a falling object.

3.5.1.1.2.2 Explosions

Missiles can potentially be generated by a hydrogen explosion. Missiles that could prevent achieving or maintaining a safe shutdown or result in significant release of radioactivity are precluded by design of the plant systems that use or generate hydrogen.

- The battery compartments are ventilated by a system that is designed to preclude the possibility of hydrogen accumulation. Therefore, a hydrogen explosion in a battery compartment is not postulated.
- Gaseous hydrogen is supplied to the nuclear island from bottles (high-pressure tanks) adjacent to the turbine building and near the nuclear island. The hydrogen supply is not located in an indoor compartment that contains safety-related systems or components. The quantity that could be released in the event of a failure of the hydrogen supply would not lead to an explosion even if the full contents of the connected storage is assumed to remain in the compartment in which it is released. Mixing within a compartment is achieved by normal convection caused by thermal forces from hot surfaces and air movement due to operation of HVAC systems. The hydrogen supply line is not routed through compartments that do not have air movement due to HVAC systems.
- The bulk gas plant storage area for the plant gas system (PGS) stores liquid hydrogen for use in generator cooling. This storage area is located sufficiently far from the nuclear island that an explosion would not result in missiles more energetic than the tornado missiles for which the nuclear island is designed. The liquid hydrogen is converted to gas in the storage area and then piped to the generator in the turbine building. The turbine building includes sufficient ventilation to prevent an explosive concentration of hydrogen in the event of a leak.
- A detonation of a flammable vapor cloud (delayed ignition) due to the accidental release of hydrogen from the PGS bulk gas storage area would not result in missiles more energetic than the tornado missiles for which the nuclear island is designed.

3.5.1.1.2.3 Missiles to be Considered

The following missiles are considered:

- Nonsafety-related rotating equipment, not excluded above,
- Pressurized components, not excluded above, located in high-energy systems
- High pressure gas storage cylinders that may experience a failure of the outlet pipe or valve if accidentally impacted.

3.5.1.1.2.4 Credible Sources of Internally Generated Missiles (Outside Containment)

The consideration of missile sources outside containment that can adversely affect safety-related structures, systems or components is limited to a few rotating components inside the auxiliary building and a few pressurized components in the chemical volume and control system. The safety-related systems and components needed as described in [Section 7.4](#) to bring the plant to a safe shutdown are located inside the containment shield building and auxiliary building, both of which have thick structural concrete exterior walls that provide protection from missiles generated in other portions of the plant. Safety-related systems and components located in the auxiliary building, including the main control room, are protected from missiles generated in other portions of the auxiliary building by the structural concrete interior walls and floors. Protection against potential missiles from the turbine-generator is discussed in [Subsection 3.5.1.3](#).

Rotating components located inside the auxiliary building that are either safety-related or are constructed as canned motor pumps would contain fragments from a postulated fracture of the rotating elements. These are excluded from evaluation as missile sources. Rotating components used less than 2 percent of the time are also excluded from evaluation as missile sources. This exclusion of equipment that is used for a limited time is similar to the approach used for the definition of high-energy systems. Nonsafety-related rotating equipment in compartments surrounded by structural concrete walls with no safety-related systems or components inside the compartment is not considered a missile source. Rotating equipment with a housing or an enclosure that contains the fragments of a postulated impeller failure is not considered a credible source of missiles. For one or more of these reasons the nonsafety-related rotating equipment inside the auxiliary building is not considered to be a credible missile source. Nonsafety-related rotating equipment in compartments with safety-related systems or components that do not provide other separation features have design requirements for a housing or an enclosure to retain fragments from postulated failures of rotating elements.

The high-energy system inside the auxiliary building that includes pressurized components in the high-energy portions that are constructed to standards other than the ASME Code criteria outlined in [Subsection 3.5.1.1.1](#) is the chemical and volume control system. The high-energy portion of this system inside the auxiliary building that is not constructed to ASME Code criteria outlined in [Subsection 3.5.1.1.1](#) is from the makeup pumps to the containment and system isolation valves. The nonsafety-related, high-energy portion of this system is not required to be protected from missiles. The nonsafety-related, high-energy portion of the chemical and volume control system is not to be considered a missile source. It includes the design features that are outlined above to exclude components from consideration as missile sources. These considerations include features such as a pump housing or enclosure that contains fragments of a postulated impeller fracture, valve design requirements, vessel design requirements, or enclosure requirements. See [Table 3.6-1](#) for a list of the high-energy systems.

Falling objects (i.e. gravitational missiles) heavy enough to generate a secondary missile are postulated as a result of movement of a heavy load or from a nonseismically designed structure,

system, or component during a seismic event. Movements of heavy loads are controlled to protect safety-related structures, systems, and components, see [Subsection 9.1.5](#). Safety-related structures, systems, or components are protected from nonseismically designed structures, systems, or components or the interaction is evaluated. See [Subsection 3.7.3.13](#) for additional discussion on the interaction of other systems with Seismic Category I systems. Valves, rotating equipment, vessels, and small fittings not otherwise considered to be credible missiles due to design features or other considerations are not considered to be a potential source of missiles when struck by a falling object. The outlet pipes and valves for the air storage bottles for the main control room are constructed to the ASME Code, Section III, requirements and are designed for seismic loads. The attached pipes and valves are not credible missile sources due to an accidental impact. The air storage bottles are located within a structural steel frame and are in an area with no activity directly above. For the reasons noted above, secondary missiles are not considered credible missiles.

3.5.1.2 Internally Generated Missiles (Inside Containment)

Selection of equipment for the AP1000 considers provisions to minimize the potential for missiles to be generated. The considerations previously discussed in [Subsection 3.5.1.1](#) are also applicable to equipment inside the containment.

3.5.1.2.1 Missile Selection

3.5.1.2.1.1 Missiles not Considered Credible

Potential missiles are not considered credible when sufficient energy is not available to produce the missile, or by design the probability of creating a missile is negligible. The following are not considered credible sources of internally generated missiles:

- Reactor coolant pump design requirements are established so that any failure of the rotating parts would be retained within the casing at specified overspeed conditions. This is discussed in [Subsection 5.4.1.3.6](#).
- Catastrophic failure of rotating equipment such as pumps, fans, and compressors leading to the generation of missiles is not considered credible as described previously in [Subsection 3.5.1.1.2](#).
- Failure of the reactor vessel, steam generators, pressurizer, core makeup tanks, accumulators, reactor coolant pump castings, passive residual heat exchangers, and piping leading to the generation of missiles is not considered credible. This is due to the material characteristics, preservice and inservice inspections, quality control during fabrication, erection and operation, conservative design, and prudent operation as applied to the particular component.
- Gross failure of a control rod drive mechanism housing, sufficient to create a missile from a piece of the housing or to allow a control rod to be ejected rapidly from the core, is not considered credible. This is because of the same reasons listed above for the reactor vessel and other components and is based on the following:
 - The control rod drive mechanisms are shop hydrotested to 125 percent of system design pressure.
 - The housings are hydrotested to 125 percent of system design pressure after they are installed on the reactor vessel to the head adapters. They are checked again during the hydrotest of the completed reactor coolant system.

- The housings are made of Type 304 or 316 stainless steel, which exhibits excellent notch toughness.
 - Stress levels in the mechanism are not affected by system thermal transients at power or by thermal movement of the coolant loops.
 - The welds in the pressure boundary of the control rod drive mechanism meet the same design, procedure, examination, and inspection requirements as the welds on other ASME Code, Section III, Class 1 components.
 - A nonmechanistic control rod ejection is considered in the safety analyses in **Chapter 15** and the design transients in **Subsection 3.9.1.1**. The integrated head package and control rod drive mechanisms are not designed for the dynamic effects of a missile generated by a rupture of the control rod housing.
- Valves, valve stems, nuts and bolts, and thermowells in high-energy fluid systems and missiles originating in non-high-energy fluid systems are not considered credible missiles as discussed previously in **Subsection 3.5.1.1.1**.

3.5.1.2.1.2 Explosions

Missiles can potentially be generated by a hydrogen explosion. Missiles that could prevent achieving or maintaining a safe shutdown or result in significant release of radioactivity are precluded by design of the plant systems that use or generate hydrogen.

- Hydrogen is supplied by the chemical and volume control system inside containment. The quantity that could be released inside containment in the event of a failure of the hydrogen supply line is limited to the contents of a single bottle. One bottle at a time is connected to the hydrogen supply line. This quantity would not lead to an explosion even if the full contents of a single bottle are assumed to remain in the compartment in which it is released. Mixing within a compartment is achieved by normal convection caused by thermal forces from hot surfaces and air movement due to operation of HVAC systems. The hydrogen supply line is not routed through compartments that do not have air movement due to HVAC systems.

3.5.1.2.1.3 Missiles to be Considered

The following missiles are considered:

- Nonsafety related rotating equipment, not excluded above,
- Pressurized components, not excluded above, located in high-energy systems

3.5.1.2.1.4 Evaluation of Internally Generated Missiles (Inside Containment)

The consideration of credible missile sources inside containment that can adversely affect safety-related structures, systems, or components is limited to a few rotating components. The safety-related systems and components needed to bring the plant to a safe shutdown are inside the containment shield building and auxiliary building both of which have thick structural concrete exterior walls that provide protection from missiles generated in other portions of the plant.

Rotating components inside containment that are either safety-related or are constructed as sealless pumps would contain fragments from a postulated fracture of the rotating elements and are excluded from evaluation as missile sources. Rotating components in use less than 2 percent of the time are also excluded from evaluation as missile sources. This exclusion of equipment that is used for a

limited time is similar to the approach used for the definition of high-energy systems. This includes the reactor coolant drain pumps, the containment sump pumps and motors for valve operators, and mechanical handling equipment. Non-safety-related rotating equipment in compartments surrounded by structural concrete walls with no safety-related systems or components inside the compartment is not considered a missile source. Rotating equipment with a housing or an enclosure that contains the fragments of a postulated impeller failure is not considered a credible source of missiles. For one or more of these reasons the nonsafety-related rotating equipment inside containment is considered not to be a credible missile source. Non-safety-related rotating equipment in compartments with safety-related systems or components that do not provide other separation features has design requirements for a housing or an enclosure to retain fragments from postulated failures of rotating elements.

The high-energy portions of high-energy systems inside the containment shield building except for a portion of the chemical and volume control system are constructed to the requirements of the ASME Code, Section III. The nonsafety-related, high-energy portion of the chemical and volume control system between the inside containment isolation valves and the outermost reactor coolant system isolation valves is not required to be protected from missiles and is not to be considered a missile source. It includes design features outlined above to exclude components from consideration as missile sources. In addition most of the nonsafety-related portion of the chemical and volume control system is contained in a compartment located away from safety-related equipment. See [Table 3.6-1](#) for a list of the high-energy systems.

Falling objects heavy enough to generate a secondary missile are postulated as a result of movement of a heavy load or from a nonseismically designed structure, system, or component during a seismic event. Movements of heavy loads are controlled to protect safety-related structures, systems, and components (see [Subsection 9.1.5](#)). Design and operational procedures of the polar crane inside containment precludes dropping a heavy load. Additionally, movements of heavy loads inside containment occur during shutdown periods when most of the high-energy systems are depressurized. Valves, rotating equipment, vessels, and small fittings not otherwise considered to be credible missiles due to design features or other considerations are not considered to be a potential source of missiles when struck by a falling object. Secondary missiles are not considered credible. Striking a component with a falling object will not generate a secondary missile if design of the component precludes generation of missiles due to pressurization of the component. Safety-related structures, systems, or components are protected from nonseismically designed structures, systems, or components or the interaction is evaluated. Nonsafety-related equipment that could fall and damage safety-related equipment during an earthquake is classified as seismic Category II and is designed and supported to preclude such failure. See [Subsection 3.7.3.13](#) for additional discussion on the interaction of other systems with Seismic Category I systems. There are no high-pressure gas storage cylinders inside the containment shield building. For the reasons noted above, secondary missiles are not considered credible missiles.

3.5.1.3 Turbine Missiles

The turbine generator is located north of the nuclear island with its shaft oriented north-south. In this orientation, the potential for damage from turbine missiles is negligible. Safety-related structures, systems and components are located outside the high-velocity, low-trajectory missile strike zone, as defined by Regulatory Guide 1.115. Thus, postulated low-trajectory missiles cannot directly strike safety-related areas.

The turbine and rotor design is described in [Section 10.2](#). Protection is provided by the orientation of the turbine-generator and by the use of robust turbine rotors as described in [Section 10.2](#). The rotor design, manufacturing, and material specification and the inspections recommended for the AP1000 provide an acceptably very low probability (see [Subsection 10.2.2](#)) of missile generation. Turbine

rotor integrity is discussed in [Subsection 10.2.3](#). This discussion includes fatigue and fracture analysis, material selection, and the maintenance program requirements.

The potential for a high-trajectory missile to impact safety-related areas of the AP1000 is less than 10^{-7} . Based on this very low probability, the potential damage from a high-trajectory missile is not evaluated. The probability of an impact in the safety-related areas is the product of the probability of missile generation from the turbine; the probability, assuming a turbine failure, that a high-trajectory missile would land within a few hundred feet from the turbine (10^{-7} per square foot); and the area of the safety-related area. In the AP1000, the safety-related area is contained within the containment shield building and the auxiliary building.

The potential for a turbine missile from another AP1000 plant in close proximity has been considered. As noted in [Subsection 10.2.2](#), the probability of generation of a turbine missile (or P1 as identified in SRP 3.5.1.3) is less than 1×10^{-5} per year. This missile generation probability (P1) combined with an unfavorable orientation P2 x P3 conservative product value of 10^{-2} (from SRP 3.5.1.3) results in a probability of unacceptable damage from turbine missiles (or P4 value) of less than 10^{-7} per year per plant which meets the SRP 3.5.1.3 acceptance criterion and the guidance of Regulatory Guide 1.115. Thus, neither the orientation of the side-by-side AP1000 turbines nor the separation distance is pertinent to meeting the turbine missile generation acceptance criterion. In addition, the shield building and auxiliary building walls, roofs, and floors, provide further conservative, inherent protection of the safety-related SSCs from a turbine missile.

The orientation of the Units 1 and 2 turbines has been evaluated and Vogtle Units 3 and 4 are located outside of the low trajectory strike zones as described in Regulatory Guide 1.115. Therefore, there is no potential for a turbine missile from Units 1 and 2 to impact Units 3 and 4.

The turbine system maintenance and inspection program is discussed in [Subsection 10.2.3.6](#).

3.5.1.4 Missiles Generated by Natural Phenomena

Tornado missiles are defined in accordance with Standard Review Plan, [Subsection 3.5.1.4](#). The velocities are adjusted to the maximum wind velocity defined in [Section 3.3](#). The following missiles are postulated:

- A massive high-kinetic-energy missile, which deforms on impact. It is assumed to be a 4000-pound automobile impacting the structure at normal incidence with a horizontal velocity of 105 mph or a vertical velocity of 74 mph. This missile is considered at all plant elevations up to 30 feet above grade. In addition, to consider automobiles parked within half a mile of the plant at higher elevations than the plant grade elevation, the evaluation of the automobile missile is considered at all plant elevations up to the junction of the outer wall of the passive containment cooling water storage tank with the roof of the shield building. This elevation is approximately 193 feet above grade. This evaluation bounds sites with automobiles parked within half a mile of the shield building and auxiliary building at elevations up to the equivalent of 163 feet above grade.
- A rigid missile of a size sufficient to test penetration resistance. It is assumed to be a 275 pound, eight inch armor-piercing artillery shell impacting the structure at normal incidence with a horizontal velocity of 105 mph or a vertical velocity of 74 mph.
- A small rigid missile of a size sufficient to just pass through any openings in protective barriers. It is assumed to be a one inch diameter solid steel sphere assumed to impinge upon barrier openings in the most damaging direction at a velocity of 105 mph.

In addition to the missile spectrum specified above, the impact of tornado-driven sheet metal siding on the shield building is evaluated. The evaluation considers siding representative of the siding used on the turbine building, radwaste building, diesel generator building, and portions of the annex building. The evaluation considers a flat steel sheet, which bounds the corrugated siding design used on the buildings adjacent to the nuclear island.

3.5.1.5 Missiles Generated by Events Near the Site

As described previously in [Section 2.2](#), the site interface is established to address site specific missiles as discussed in [Subsection 3.5.4](#). The AP1000 missile interface criteria are based on the tornado missiles described in [Subsection 3.5.1.4](#). Additional analyses are required to evaluate other site specific missiles.

The primary access point, administrative building, communications support center, warehouse and shops, engineering and administrative building, maintenance support building and miscellaneous structures are common structures that are located at a nuclear power plant. They are of similar design and construction to those that are typical at nuclear power plants. Therefore, any missiles resulting from a tornado-initiated failure are not more energetic than tornado missiles postulated for design of the AP1000. Additionally, there are no other structures adjacent to the nuclear island other than the turbine building, annex building, radwaste building and passive containment cooling ancillary water storage tank.

In accordance with [Subsection 2.2.3](#), the effects of explosions have been evaluated and it has been determined that the overpressure criteria of Regulatory Guide 1.91 is not exceeded. Consistent with Regulatory Guide 1.91, the effects of blast-generated missiles will be less than those associated with the blast overpressure levels considered; therefore, no further evaluation of blast-generated missiles is required.

3.5.1.6 Aircraft Hazards

As described previously in [Section 2.2](#), the site interface is established to address aircraft hazards as discussed in [Subsection 3.5.4](#). The AP1000 missile interface criteria are based on the tornado missiles described in [Subsection 3.5.1.4](#). Additional analyses are required to evaluate other site specific missiles. Aircraft crash probability, and the effects of this hazard on the plant, is determined as described in [Section 2.2](#).

Airports and airways in the VEGP site vicinity are discussed in [Subsection 2.2.2.6](#). Aircraft hazards related to these airports and airways (shown in [Figure 3.5-201](#)) have been evaluated in accordance with Regulatory Standard 002, *Processing Applications for Early Site Permits*, May 2004 (RS-002), and NUREG-0800, *Standard Review Plan for the Review of Safety Analysis Reports for Nuclear Power Plants*, Draft Revision 3, 1996 (NUREG-0800), [Subsection 3.5.1.6](#).

3.5.1.6.1 Airports

RS-002 acceptance criteria provide a distance threshold for evaluating aircraft hazards due to nearby airports.

All airports in the VEGP site vicinity are greater than 10 mi from the site. The hazard probability for these airports is considered acceptable if the projected annual number of operations is less than $1,000 D^2$, where D is the site-to-airport distance.

Bush Field is the closest (17 mi) and largest commercial airport in the VEGP site vicinity. The Federal Aviation Administration (FAA) ([Reference 201](#)) has projected the number of aircraft that will be in operation at Bush Field for every year up to 2025 for each of the following four types of aircraft:

general aviation, air taxi and commuter, commercial air carrier, and military. The projected flight data (which include landings and takeoffs) are provided in [Table 3.5-201](#). As noted in the table, the total number of projected aircraft operations is substantially less than 1,000 D^2 (289,000).

The other airports in the vicinity are much smaller than Bush Field. Since they are all at least 10 mi from the VEGP site, their aircraft hazard threshold is greater than 100,000 operations, which significantly exceeds their annual traffic.

As discussed in [Subsection 2.2.2.6.1](#), a small unimproved grass airstrip is located immediately north of the VEGP site (north of Hancock Landing Road and west of the Savannah River). This privately owned and operated airstrip has a 1,650-foot turf runway oriented 80° East – 260° West. The airstrip is for personal use and the associated traffic consists only of small single-engine aircraft. In addition, there is a small helicopter landing pad on the VEGP site. This facility exists for corporate use and for use in case of emergency. The traffic associated with either of these facilities may be characterized as sporadic. Due to the small amount and the nature of the traffic, these facilities do not present a safety hazard to the VEGP site.

3.5.1.6.2 Airway V185

The VEGP site is approximately 1.5 mi east of the centerline of Federal Airway V185, which runs between Augusta and Savannah. A more detailed review of aircraft hazards was performed because the VEGP site is within the 2 statute mile limit. This review is summarized below.

Airways are typically used by commercial flights and by general aviation for inclement weather and nighttime operations. In general, military aircraft do not use the federal airways. To be allowed to fly in a federal airway, an aircraft needs to have the proper communication equipment and the pilot needs to have specific qualifications. In addition, most general aviation flights do not use a federal airway in favorable weather conditions. When these factors are considered, along with the fact that there are no regularly scheduled direct commercial flights between Augusta and Savannah, it is expected that the total number of aircraft using Airway V185 is relatively small.

Although the FAA does not maintain records of air traffic in Airway V185, informal communications with air traffic control personnel at the Augusta airport revealed that the southeast quadrant of the air space around the airport (of which Airway V185 is a part) has the least air traffic compared to the other quadrants and that the total traffic in Airway V185 is a fraction of the total operations into and out of the Augusta airport.

Because of the unavailability of traffic data for Airway V185, the following evaluation calculates the maximum number of airway flights per year above which the acceptance guideline probability of 10^{-7} per year contained in RS-002 and NUREG-0800 is exceeded. Regulation 14 CFR 71 provides the criteria for determining the width of the airway. It is 4 nautical miles on either side of the centerline, for a total width of 8 nautical miles (9.2 mi).

$$P_{FA} = C \times N \times A / W$$

where:

$$P_{FA} = \text{probability per year of an aircraft crashing into a VEGP Units 3 and 4 safety-related structure, } 1 \times 10^{-7}$$

$$C = \text{in-flight crash rate per mile for aircraft using airway} = 4 \times 10^{-10} \text{ (RS-002)}$$

$$N = \text{number of flights per year along the airway}$$

A = effective area of plant or site area in square miles, see below

W = airway width, 9.2 mi

By rearranging this equation, the maximum number of flights corresponding to the acceptance guideline probability of 10^{-7} may be calculated.

NUREG-0800 and RS-002 also provide alternate guidance on the acceptable method for calculating area A . RS-002 specifies the use of the site area because, for ESP Applications where the type of power plant has not been selected, the plant cross-sectional area cannot be defined. However, because the Westinghouse AP1000 design has been selected, the effective area of the plant was used in this analysis.

The effective plant area (A) depends on the length, width, and height of the facility, as well as the aircraft's wingspan, skid distance, and impact angle (Reference 203).

The safety-related structures of the AP1000 design include only the containment and the auxiliary building; the remainder of the structures is not safety related. The AP1000 containment height is about 234 ft above grade, and the diameter is about 146 ft (Reference 204).

For traffic in Airway V185, the fractions of the types of aircraft using the airway were assumed to be the same as the fractions of the types of aircraft using Bush Field. Representative values for wingspan, skid distance, and impact angle for each aircraft type follow those suggested in (Reference 203). For military aviation, large aircraft are conservatively used in the estimates. The effective areas for general aviation, air taxi and commuter, commercial air carrier, and military aircraft are 0.025, 0.061, 0.073, and 0.086 sq mi, respectively. Using these effective areas and the fractions of aircraft types (52.9, 29.3, 12.8, and 5 percent for general aviation, air taxi and commuter, commercial air carrier, and military aircraft, respectively), the average of the weighted effective plant area, 0.045 mi^2 , is determined for the calculation.

Among the representative wingspans, the large military aircraft has the longest wingspan of 223 ft (Reference 203). The physical separation of the new reactor buildings is about 650 ft. Since this distance is longer than the largest representative wingspan (223 ft), the estimate of the effective area involves only one unit. In addition, Subsection 3.5.1.6 of NUREG-0800 also suggests the use of an effective area of one unit of the plant.

To reach the permissible crash probability of 1×10^{-7} , the total number of flights traveling along Airway V185 would need to be about 51,100 per year. This value is higher than the total of all projected itinerant flights for 2025 at Bush Field (see Table 3.5-201).

Although the flight data associated with Airway V185 are not available from the FAA, the number of flights in this airway is expected to be only a fraction of the total Bush Field flights. Therefore, the presence of Airway V185 is not a safety concern for the VEGP site.

3.5.2 Protection from Externally Generated Missiles

Systems required for safe shutdown are protected from the effects of missiles. These systems are identified in Section 7.4. Protection from external missiles, including those generated by natural phenomena, is provided by the external walls and roof of the Seismic Category I nuclear island structures. The external walls and roofs are reinforced concrete. The structural design requirements for the shield building and auxiliary building are outlined in Subsection 3.8.4. Openings through these walls are evaluated on a case-by-case basis to provide confidence that a missile passing through the opening would not prevent safe shutdown and would not result in an offsite release exceeding the

limits defined in 10 CFR 50.34. The evaluation of site-specific hazards for external events that may produce missiles more energetic than tornado missiles is discussed in [Subsection 2.2.1](#).

Evaluation of turbine missiles is provided in [Subsection 3.5.1.3](#). Evaluation of tornado missiles is provided in [Subsection 3.5.1.4](#). Conformance with regulatory guide recommendations is provided in [Appendix 1A](#).

3.5.3 Barrier Design Procedures

Missile barriers and protective structures are designed to withstand and absorb missile impact loads to prevent damage to safety-related components.

Formulae used for missile penetration calculations into steel or concrete barriers are the Modified National Defense Research Committee (NDRC) formula for concrete and either the Ballistic Research Laboratory (BRL) or Stanford formulae for steel.

Concrete (Modified NDRC Formula)

$$x = \left[4KNWd \left(\frac{V}{1000d} \right)^{1.8} \right]^{0.5} \quad \text{for } \frac{x}{d} \leq 2.0$$

$$x = KNW \left(\frac{V}{1000d} \right)^{1.8} + d \quad \text{for } \frac{x}{d} > 2.0$$

where

x = penetration depth, inches

W = missile weight, lbs

d = missile diameter, inches

N = missile shape factor = 1.0

V = impact velocity, feet/sec

K = experimentally obtained material coefficient for penetration = $\frac{180}{\sqrt{f'_c}}$

f'_c = concrete compressive strength

Scabbing thickness, t_s , and perforation thickness, t_p is given by:

$$\frac{t_s}{d} = 2.12 + 1.36 \frac{x}{d} \quad \text{for } 0.65 \leq \frac{x}{d} \leq 11.75$$

$$\frac{t_s}{d} = 7.91 \left(\frac{x}{d} \right) - 5.06 \left(\frac{x}{d} \right)^2 \quad \text{for } \frac{x}{d} \leq 0.65$$

$$\frac{t_p}{d} = 1.32 + 1.24 \frac{x}{d} \quad \text{for } 1.35 \leq \frac{x}{d} \leq 13.5$$

$$\frac{t_p}{d} = 3.19 \left(\frac{x}{d}\right) - 0.718 \left(\frac{x}{d}\right)^2 \quad \text{for } \frac{x}{d} \leq 13.5$$

Steel (Stanford Formula)

$$\frac{E}{D} = \frac{S}{46,500} \left(16,000 T^2 + 1,500 \frac{W}{W_s} T \right)$$

Where:

- E = critical kinetic energy required for perforation, foot pounds
- D = effective missile diameter, inches
- S = ultimate tensile strength of the target (steel plate), pounds per square inch
- T = target plate thickness, inches
- W = length of a square side between rigid supports, inches
- Ws = length of a standard window, 4 inches

The ultimate tensile strength is directly reduced by the amount of bilateral tension stress already in the target. The equation is good within the following ranges:

$$0.1 < T/D < 0.8,$$

$$0.002 < T/L < 0.05,$$

$$10 < L/D < 50,$$

$$5 < W/D < 8,$$

$$8 < W/T < 100,$$

$$70 < V < 400$$

Where:

- L = missile length, inches
- V = impact velocity, feet/second

Steel (BRL Formula)

$$t_p = \frac{(E_k)^{2.3}}{672D}$$

Where:

- t_p = steel plate thickness for threshold of perforation, inches
 D = equivalent missile diameter, inches
 E_k = missile kinetic energy, foot pounds
 = $M V^2/2$
 M = mass of the missile, lb-sec²/ft.

In using the Modified NDRC, BRL and Stanford formulae for missile penetration, it is assumed that the missile impacts normal to the plane of the wall on a minimum impact area and, in the case of reinforced concrete, does not strike the reinforcing. Due to the conservative nature of these assumptions, the minimum thickness required for missile shields is taken as the thickness just perforated.

Structural members designed to resist missile impact are designed for flexural, shear, and buckling effects using the equivalent static load obtained from the evaluation of structural response. Stress and strain limits for the equivalent static load comply with applicable codes and Regulatory Guide 1.142, and the limits on ductility of steel structures as given in [Subsection 3.5.3.1](#). The consequences of scabbing are evaluated if the thickness is less than the minimum thickness to preclude scabbing.

The thicknesses of the exterior walls above grade and of the roof of the nuclear island are 24 inches and 15 inches, respectively. The roof is constructed using left-in-place metal deck. These thicknesses exceed the minimum thicknesses for Region II tornado missiles specified in Standard Review Plan 3.5.3.

3.5.3.1 Ductility Factors for Steel Structures

Ductility factors for the design of steel structures are as follows:

- For tension due to flexure, $\mu \leq 10.0$
- For columns with slenderness ratio (L/r) equal to or less than 20, $\mu \leq 1.3$
- For columns with slenderness ratio greater than 20, $\mu \leq 1.0$
 Where: L = effective length of the member
 r = the least radius of gyration
- For members subjected to tension, $\mu \leq .5*(e_u/e_y)$
 Where: e_u = ultimate strain
 e_y = yield strain

3.5.4 Combined License Information

The [evaluation for those external events that produce missiles that are more energetic than the tornado missiles postulated for design of the AP1000](#) is addressed in APP-GW-GLR-020 ([Reference 1](#)).

In addition, the VEGP site satisfies the site interface criteria for wind and tornado (see [Subsections 3.3.1.1, 3.3.2.1 and 3.3.2.3](#)) and will not have a tornado-initiated failure of structures and components within the applicant's scope that compromises the safety of AP1000 safety-related structures and components (see also [Subsection 3.3.3](#)).

[Subsection 1.2.2](#) discusses differences between the plant specific site plan (see [Figure 1.1-202](#)) and the AP1000 typical site plan shown in [Figure 1.2-2](#).

There are no other structures adjacent to the nuclear island other than as described and evaluated in this document.

Missiles caused by external events separate from the tornado are addressed in **Subsections 3.5.1.3, 3.5.1.5, and 3.5.1.6.**

3.5.5 References

1. APP-GW-GLR-020, "Wind and Tornado Site Interface Criteria," Westinghouse Electric Company LLC.
201. **(APO 2006)** *APO Terminal Area Forecast Summary Report*, Federal Aviation Administration, <http://www.apo.data.faa.gov/wtafi/>, issued February 2006, accessed 5/2/2006.
202. **(Atlanta 2005)** *Atlanta Sectional Aeronautical Chart*, 74th Edition, U.S. Department of Transportation, Federal Aviation Administration, March 17, 2005.
203. **(DOE 1996)** *Accident Analysis for Aircraft Crash into Hazardous Facilities*, DOE Standard, DOE-STD-3014-96, US Department of Transportation, October 1996.
204. **(Westinghouse 2001)** *Nuclear Island General Arrangement, AP1000 Advanced Passive Light Water Reactor*, Rev. 0, Section B-B, DCD Number APP 1000 P2 902, Westinghouse Electric Company, 08/06/2001.


**Table 3.5-201
Augusta APO Terminal Area Forecast Summary
Report – Itinerant Operations**

Year	General Aviation	Air Taxi & Commuter	Commercial Air Carrier	Military	Total
1990	22,023	14,941	6,495	4,522	47,981
1991	19,175	9,462	6,576	3,242	38,455
1992	17,872	9,393	7,196	3,221	37,682
1993	16,902	8,821	6,455	4,068	36,246
1994	16,896	5,961	6,473	3,727	33,057
1995	16,597	8,876	5,024	3,511	34,008
1996	17,016	9,325	4,225	2,780	33,346
1997	18,995	8,304	4,599	2,561	34,459
1998	19,611	7,518	5,028	2,271	34,428
1999	22,653	6,954	5,183	2,841	37,631
2000	21,975	6,663	4,969	3,354	36,961
2001	19,961	7,378	4,929	2,954	35,222
2002	20,085	7,164	4,286	3,082	34,617
2003	17,622	9,058	4,393	2,843	33,916
2004	18,658	9,441	4,934	2,528	35,561
2005	13,307	8,226	4,585	1,799	27,917
2006	13,618	8,328	4,585	1,799	28,330
2007	13,937	8,432	4,585	1,799	28,753
2008	14,263	8,537	4,585	1,799	29,184
2009	14,597	8,644	4,585	1,799	29,625
2010	14,939	8,751	4,585	1,799	30,074
2011	15,288	8,860	4,585	1,799	30,532
2012	15,646	8,971	4,585	1,799	31,001
2013	16,012	9,083	4,585	1,799	31,479
2014	16,387	9,196	4,585	1,799	31,967
2015	16,611	9,310	4,585	1,799	32,305
2016	16,837	9,426	4,585	1,799	32,647
2017	17,067	9,544	4,585	1,799	32,995
2018	17,300	9,663	4,585	1,799	33,347
2019	17,536	9,783	4,585	1,799	33,703
2020	17,776	9,905	4,585	1,799	34,065
2021	18,018	10,028	4,585	1,799	34,430
2022	18,264	10,153	4,585	1,799	34,801
2023	18,514	10,280	4,585	1,799	35,178
2024	18,766	10,408	4,585	1,799	35,558
2025	19,023	10,538	4,585	1,799	35,945

Source: Reference 201

Table 3.5-202
Deleted in Revision 2

|

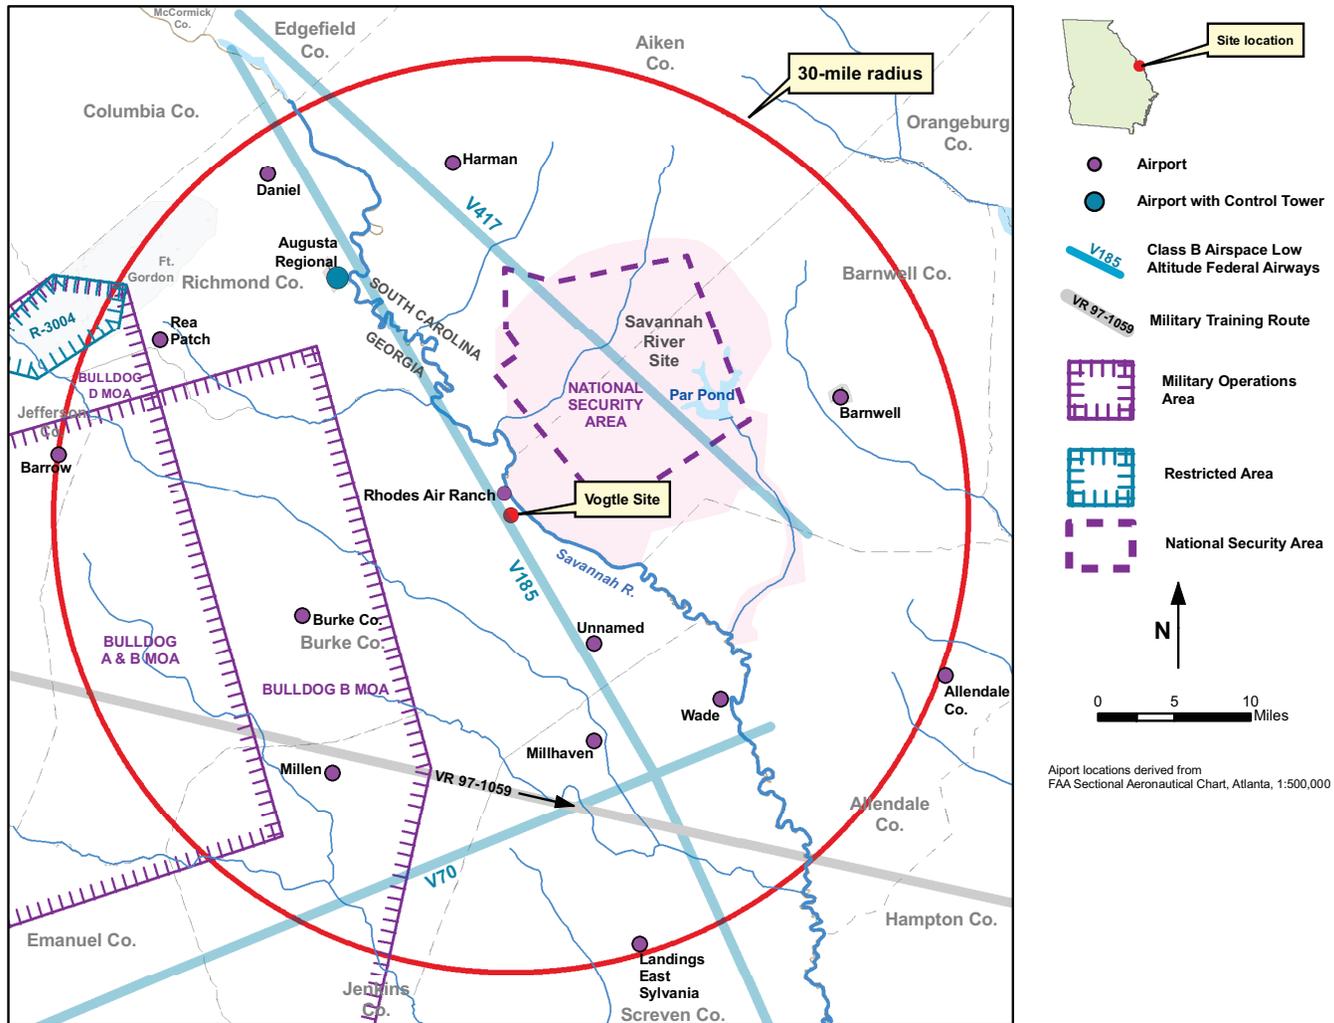

Source: Reference 202

Figure 3.5-201
Airports Within 30 Miles of Vogtle Facility