


LNP COL 2.4-2

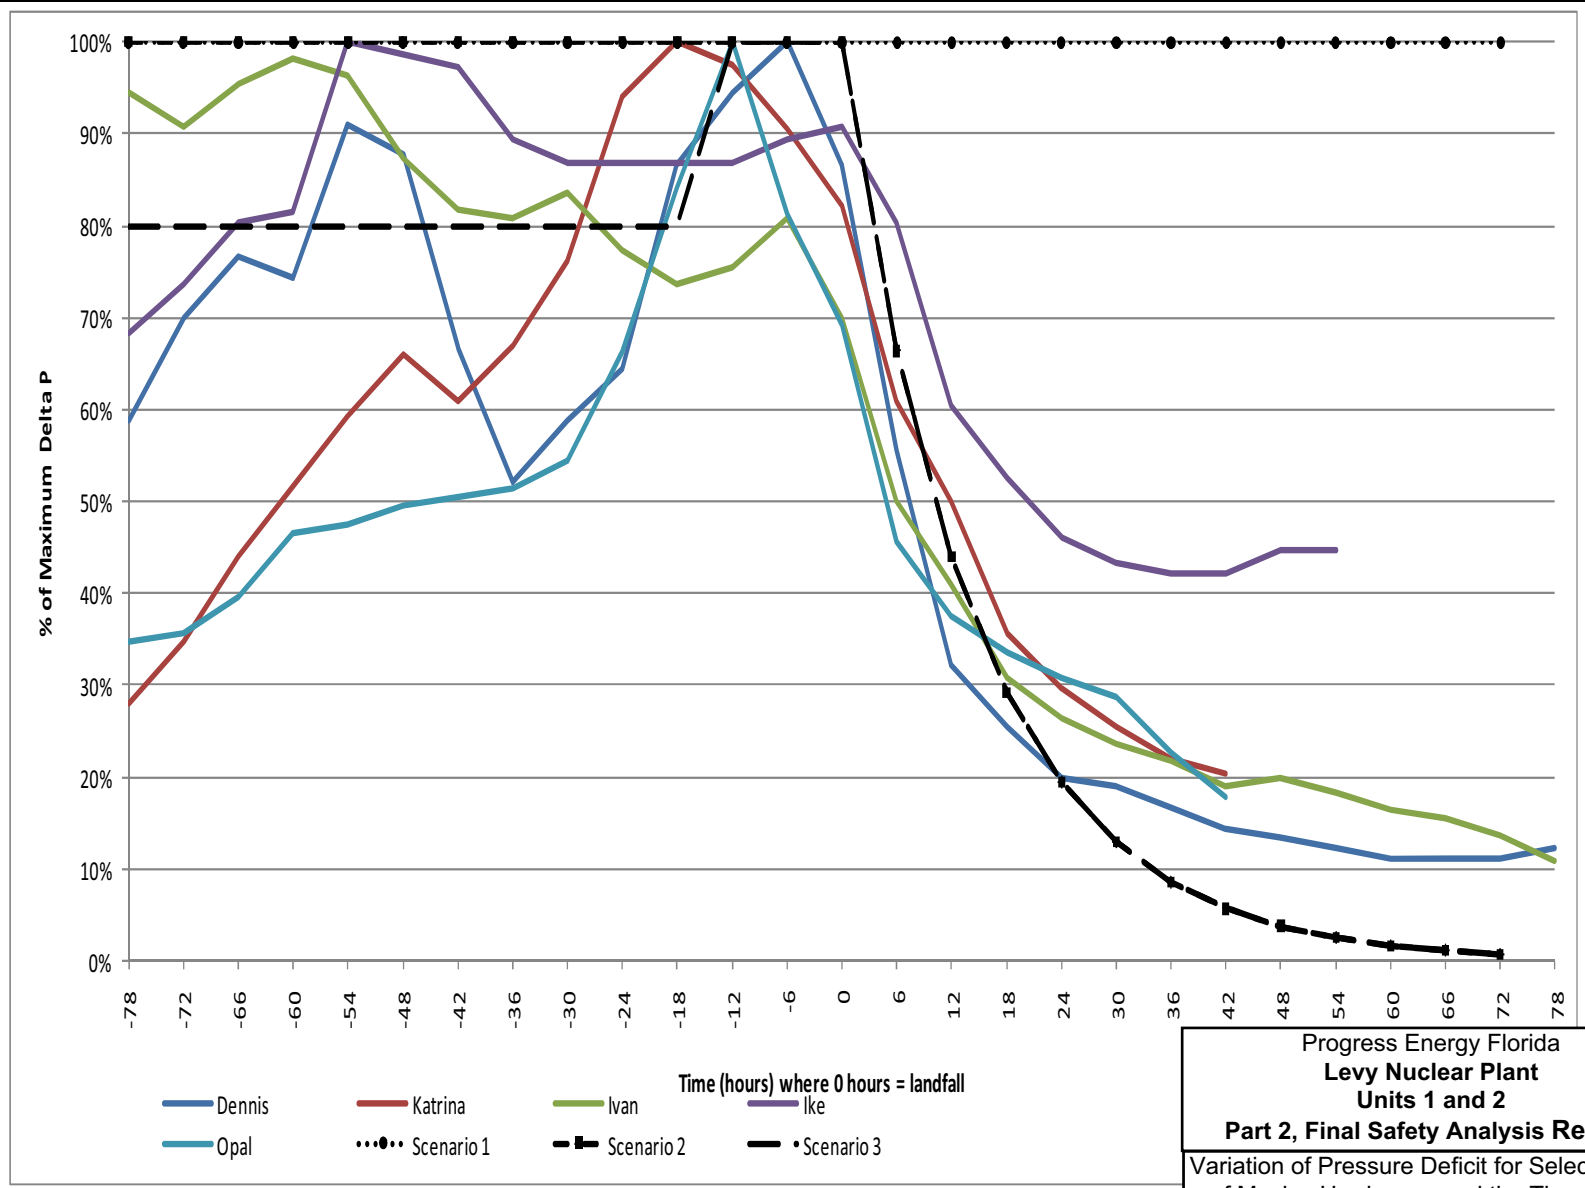

Progress Energy Florida
Levy Nuclear Plant
Units 1 and 2
Part 2, Final Safety Analysis Report
 Variation of Pressure Deficit for Selected Gulf
 of Mexico Hurricanes and the Three PMH
 Scenarios
 FIGURE 2.4.5-237
 Rev 3