

INITIAL TYPE TEST RESULT OF  
CLASS 1E GAS TURBINE GENERATOR SYSTEM

MUAP-10023-NP(R4)

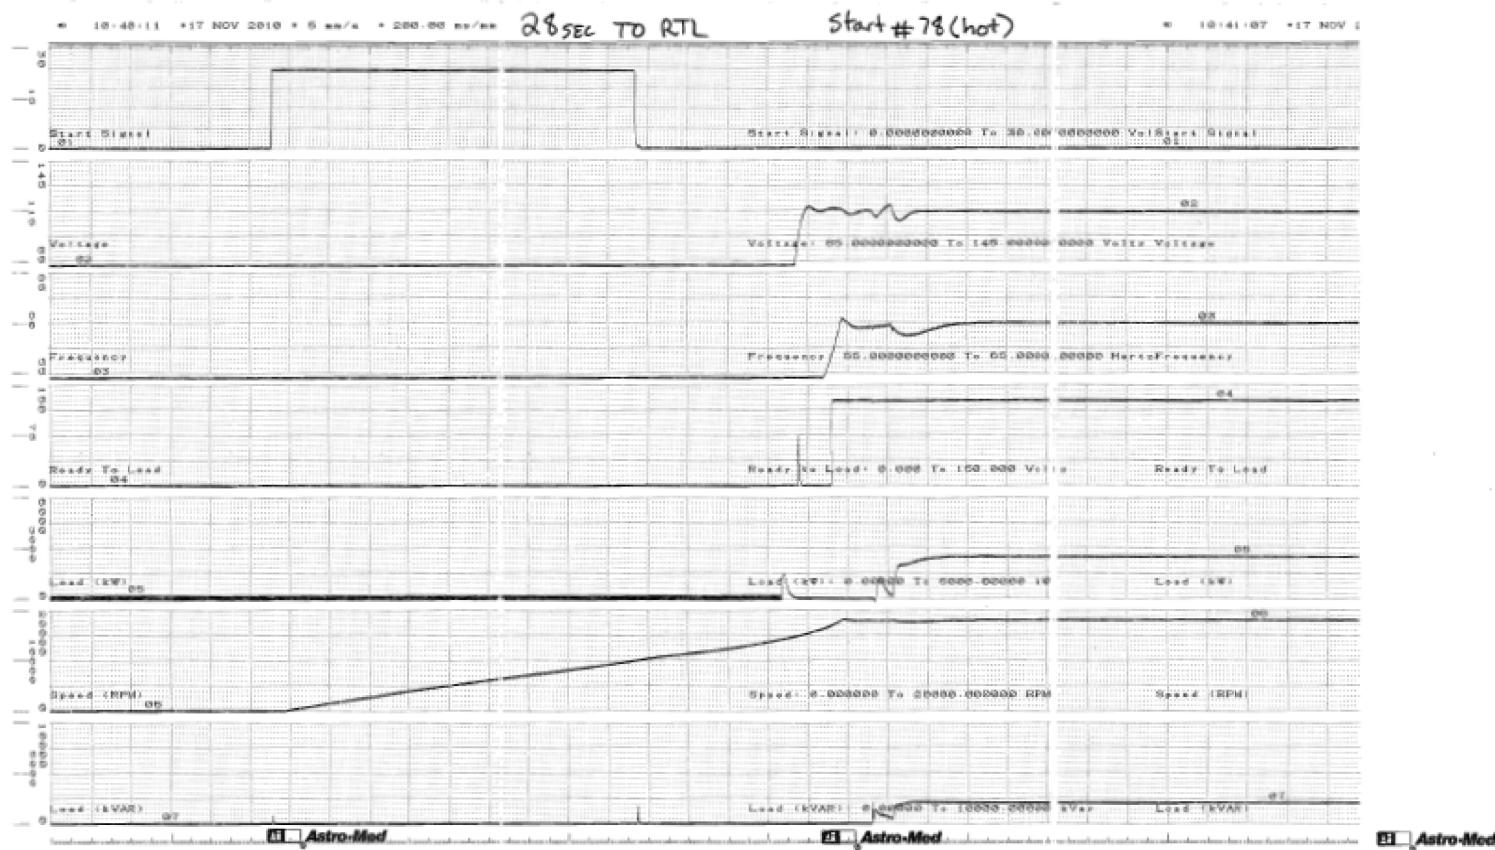


Figure C.1.0-79 Parameter Chart of Start and Load Acceptance Test, No.78, Hot

INITIAL TYPE TEST RESULT OF  
CLASS 1E GAS TURBINE GENERATOR SYSTEM

MUAP-10023-NP(R4)

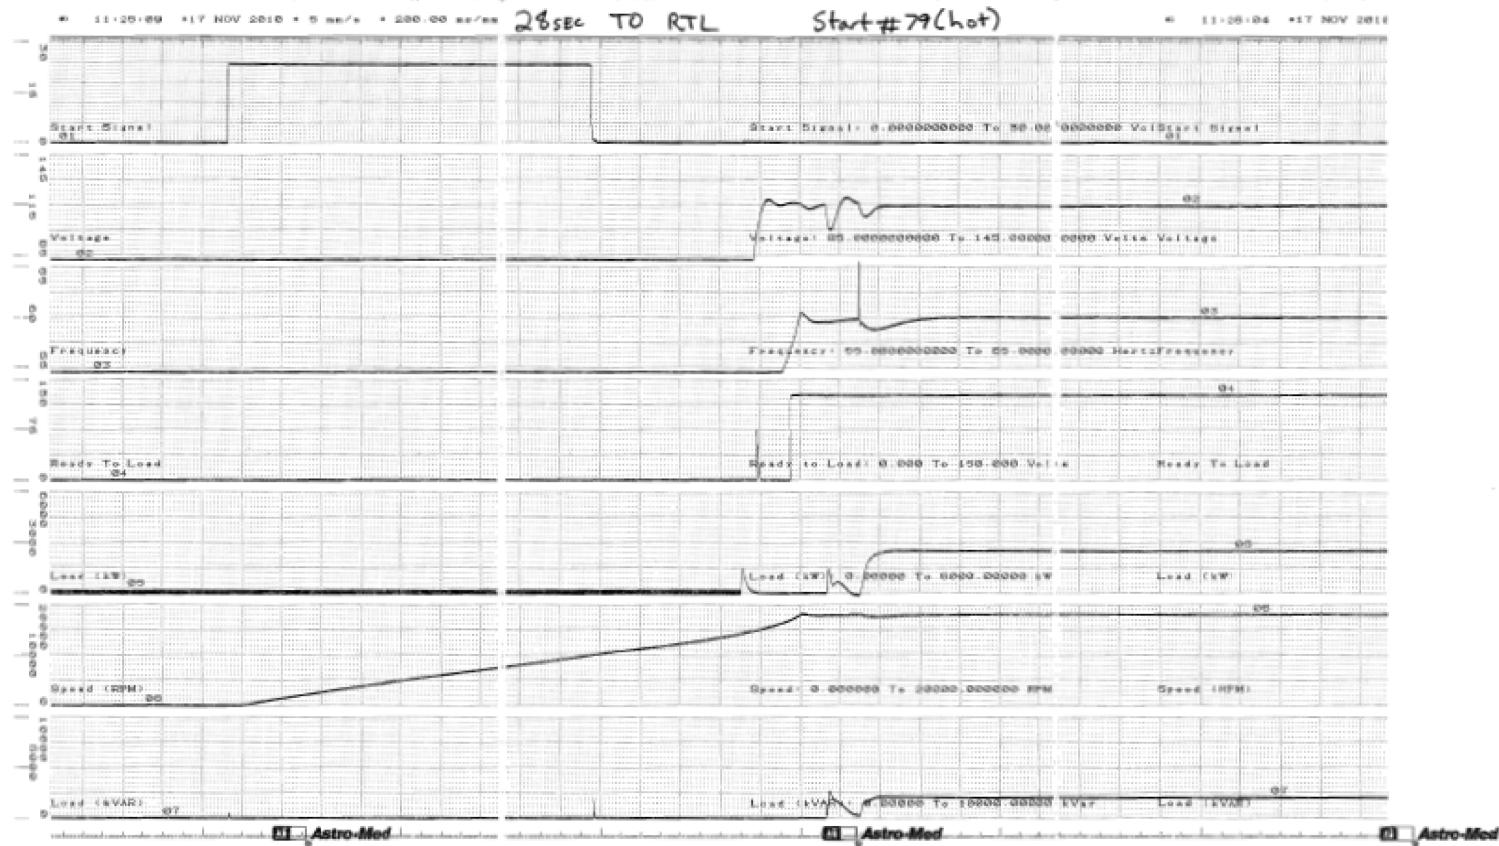


Figure C.1.0-80 Parameter Chart of Start and Load Acceptance Test, No.79, Hot

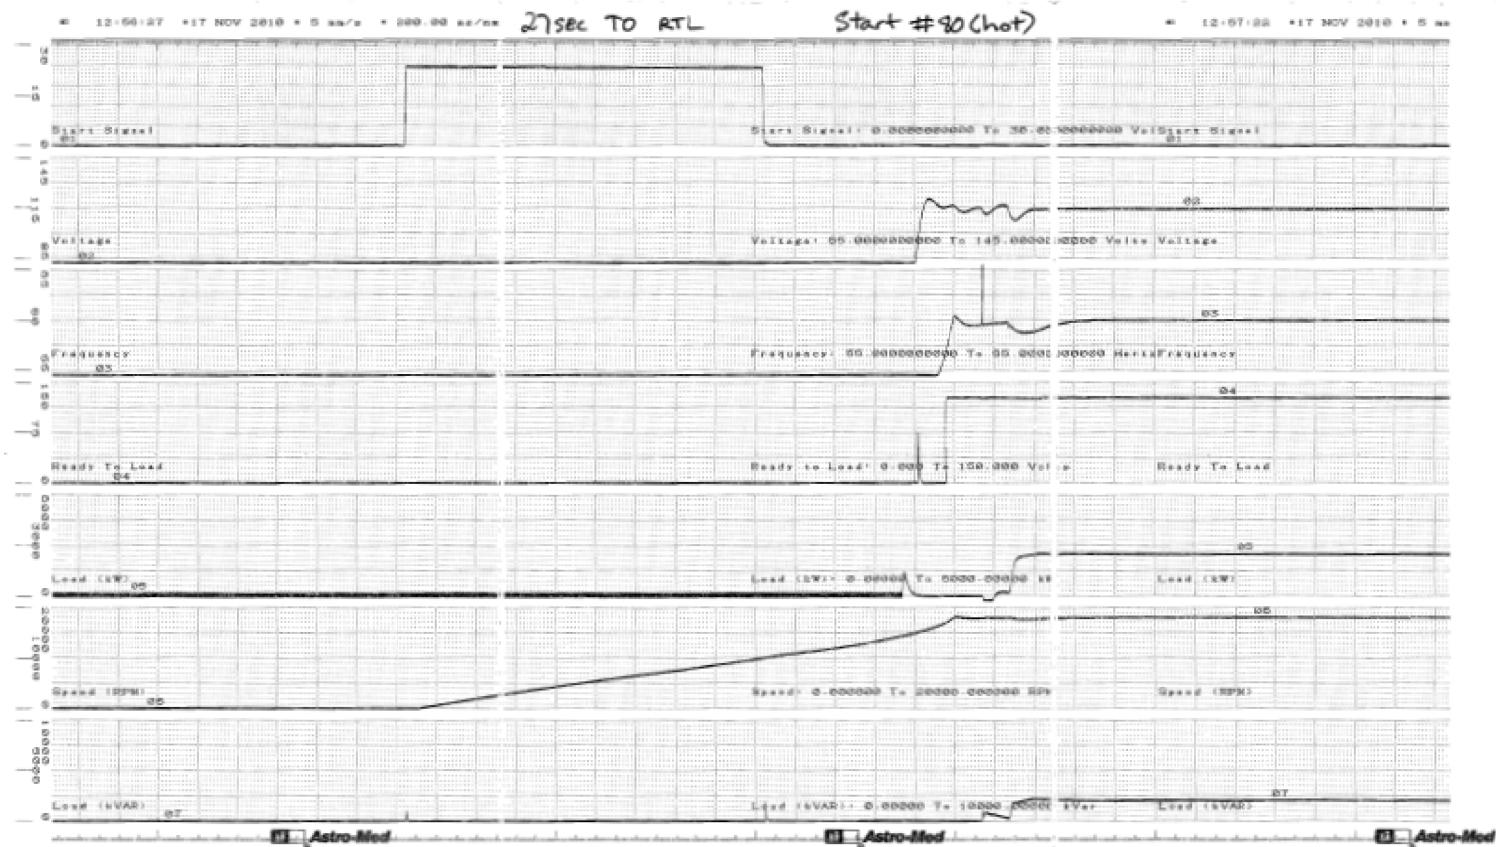


Figure C.1.0-81 Parameter Chart of Start and Load Acceptance Test, No.80, Hot

INITIAL TYPE TEST RESULT OF  
CLASS 1E GAS TURBINE GENERATOR SYSTEM

MUAP-10023-NP(R4)

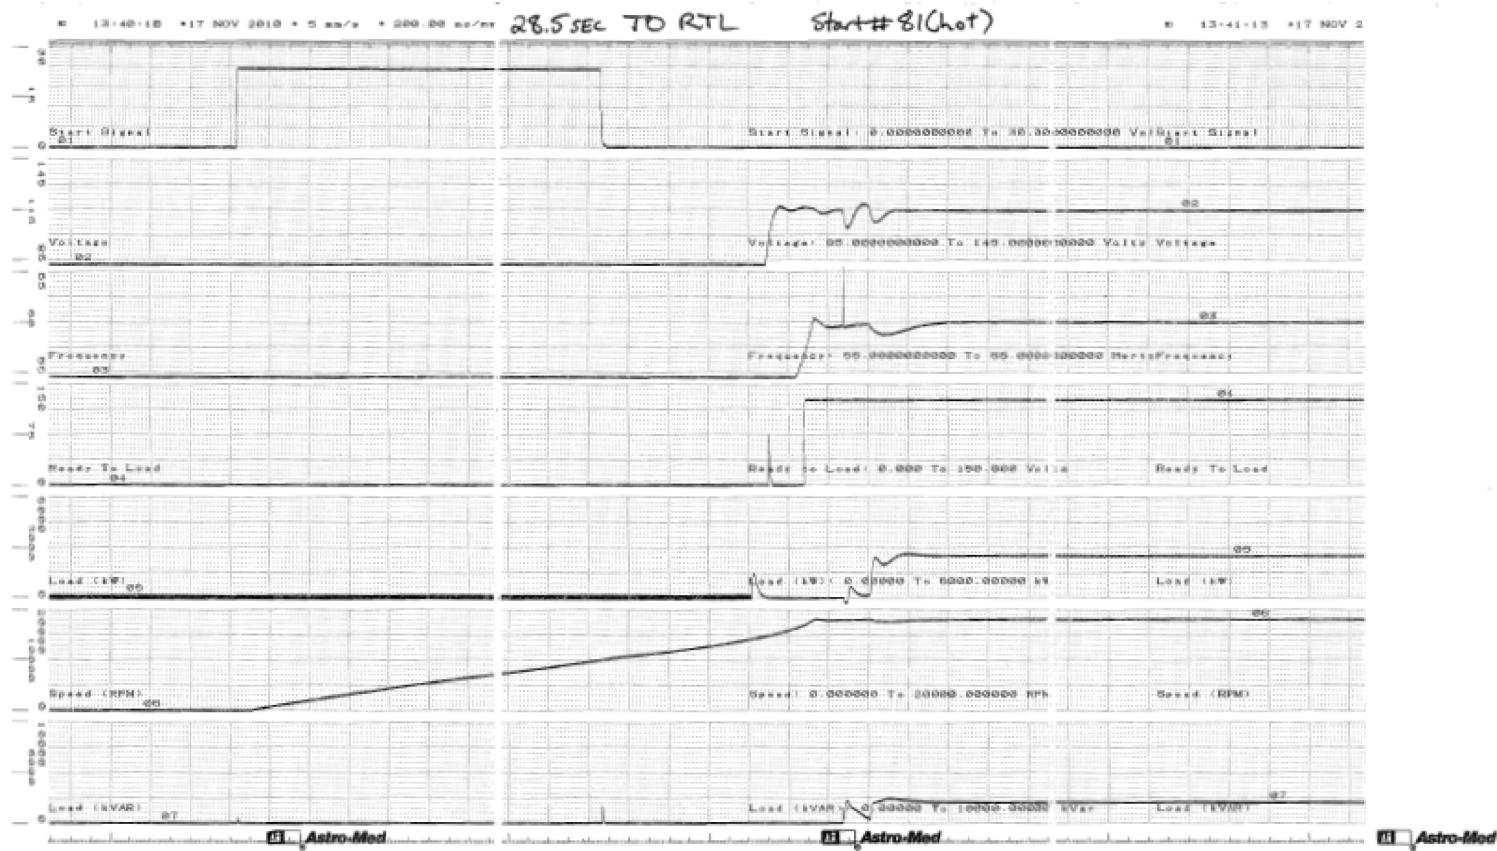


Figure C.1.0-82 Parameter Chart of Start and Load Acceptance Test, No.81, Hot

INITIAL TYPE TEST RESULT OF  
CLASS 1E GAS TURBINE GENERATOR SYSTEM

MUAP-10023-NP(R4)

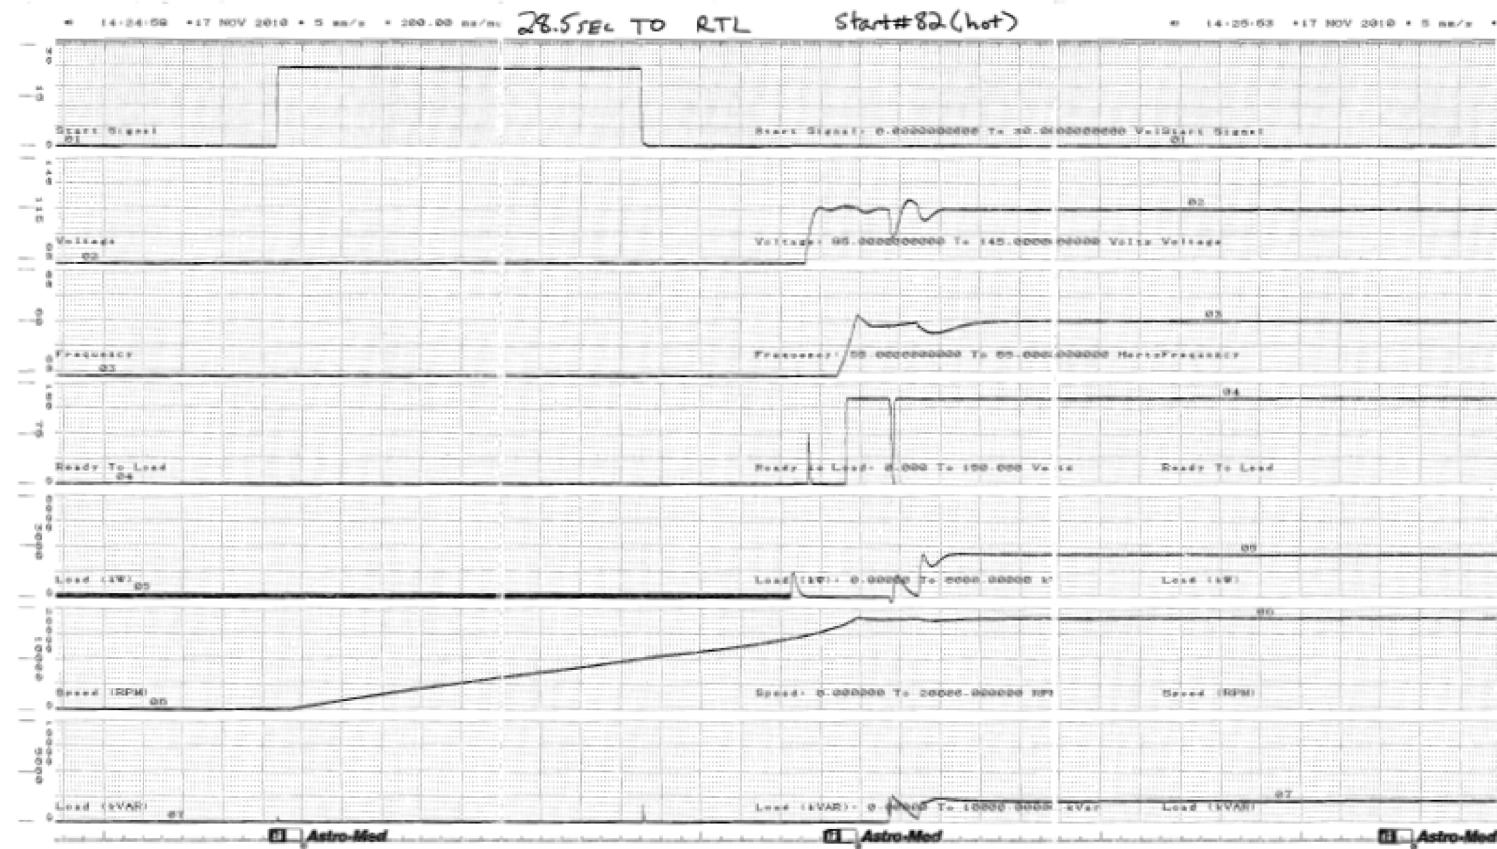


Figure C.1.0-83 Parameter Chart of Start and Load Acceptance Test, No.82, Hot

INITIAL TYPE TEST RESULT OF  
CLASS 1E GAS TURBINE GENERATOR SYSTEM

MUAP-10023-NP(R4)

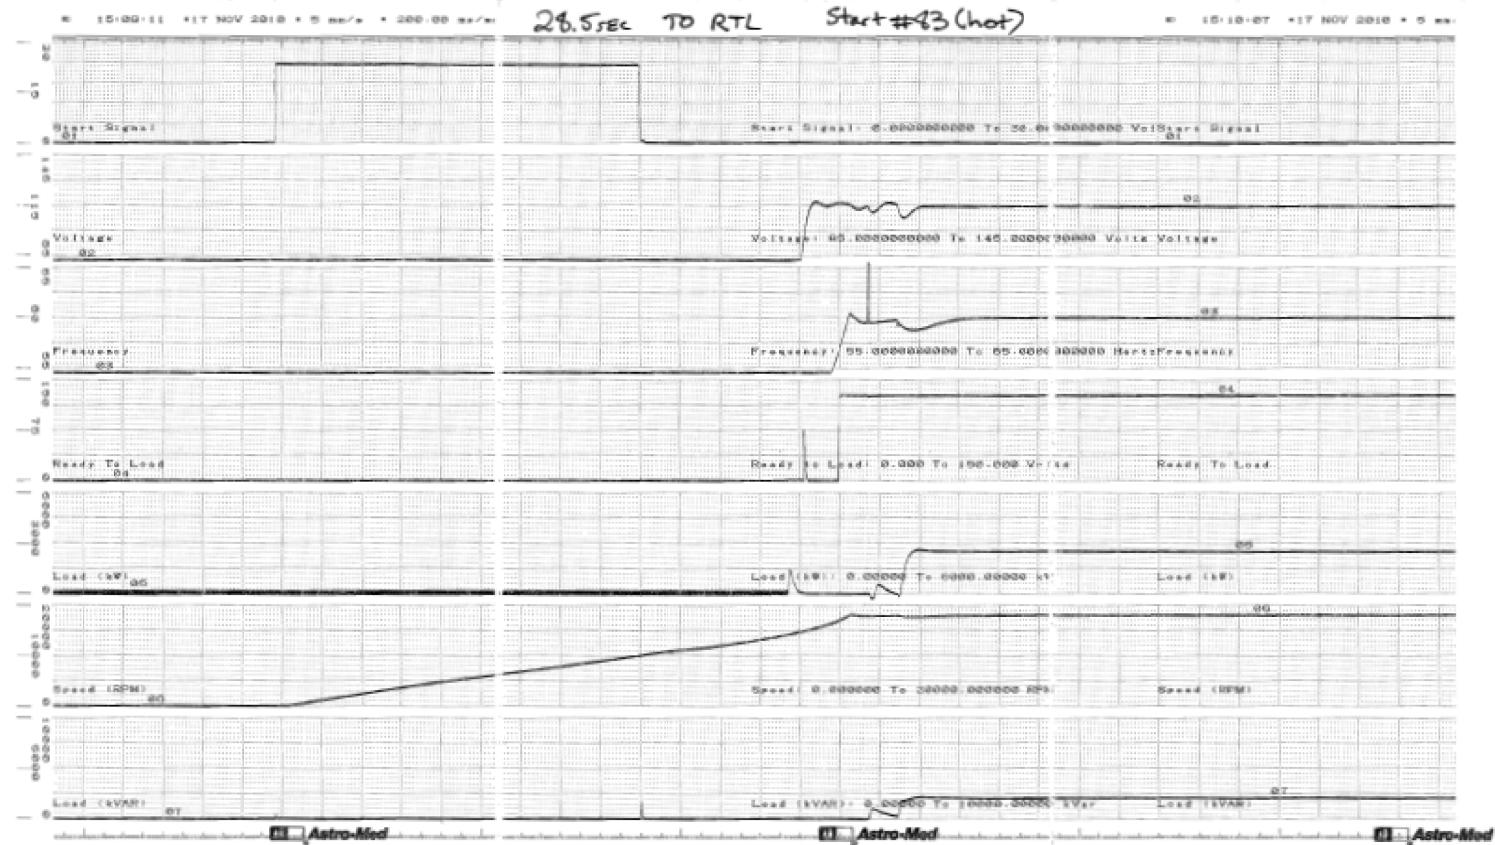


Figure C.1.0-84 Parameter Chart of Start and Load Acceptance Test, No.83, Hot

INITIAL TYPE TEST RESULT OF  
CLASS 1E GAS TURBINE GENERATOR SYSTEM

MUAP-10023-NP(R4)

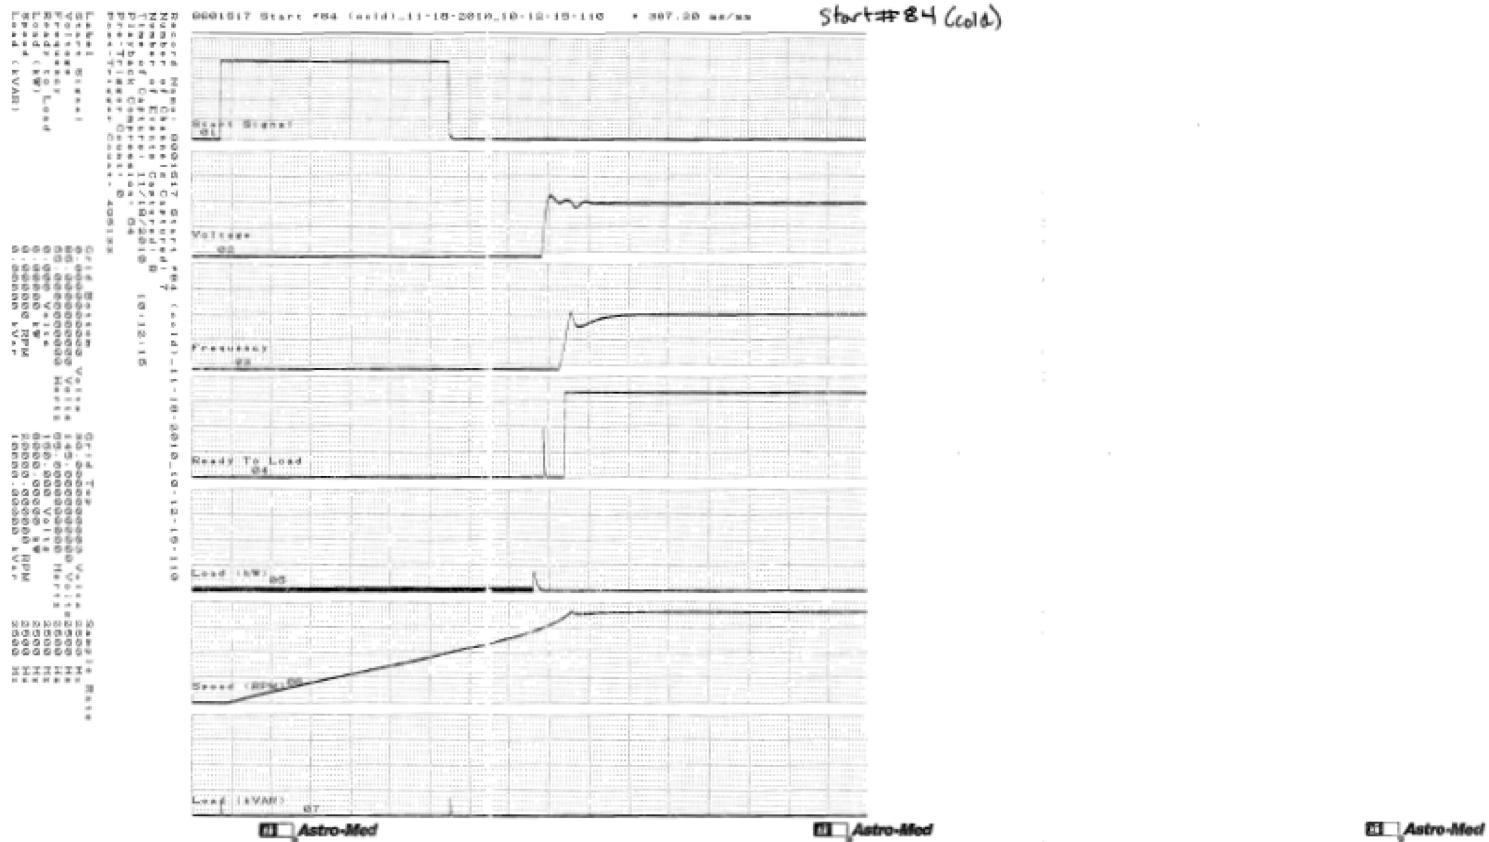


Figure C.1.0-85 Parameter Chart of Start and Load Acceptance Test, No.84, Hot

INITIAL TYPE TEST RESULT OF  
CLASS 1E GAS TURBINE GENERATOR SYSTEM

MUAP-10023-NP(R4)

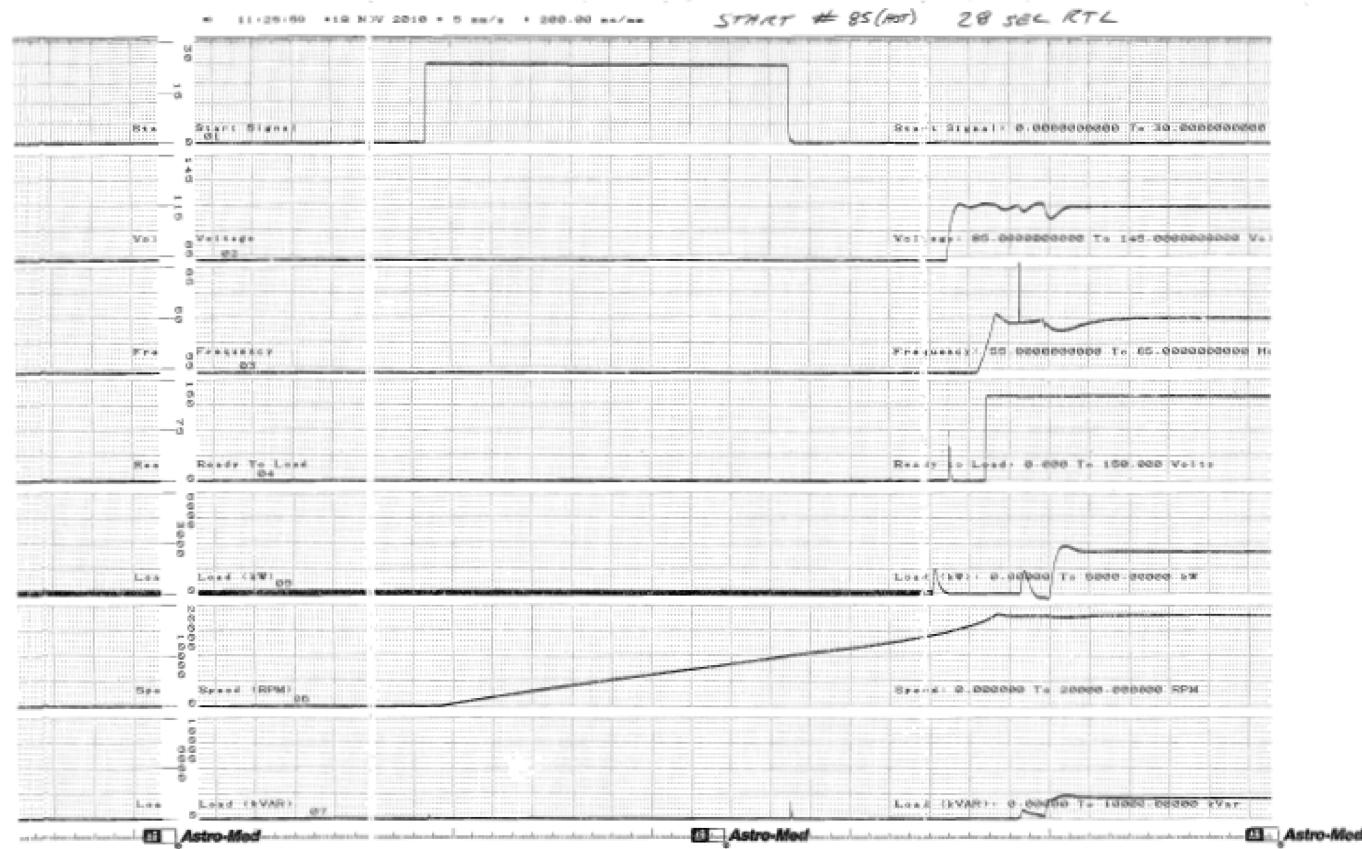


Figure C.1.0-86 Parameter Chart of Start and Load Acceptance Test, No.85, Hot

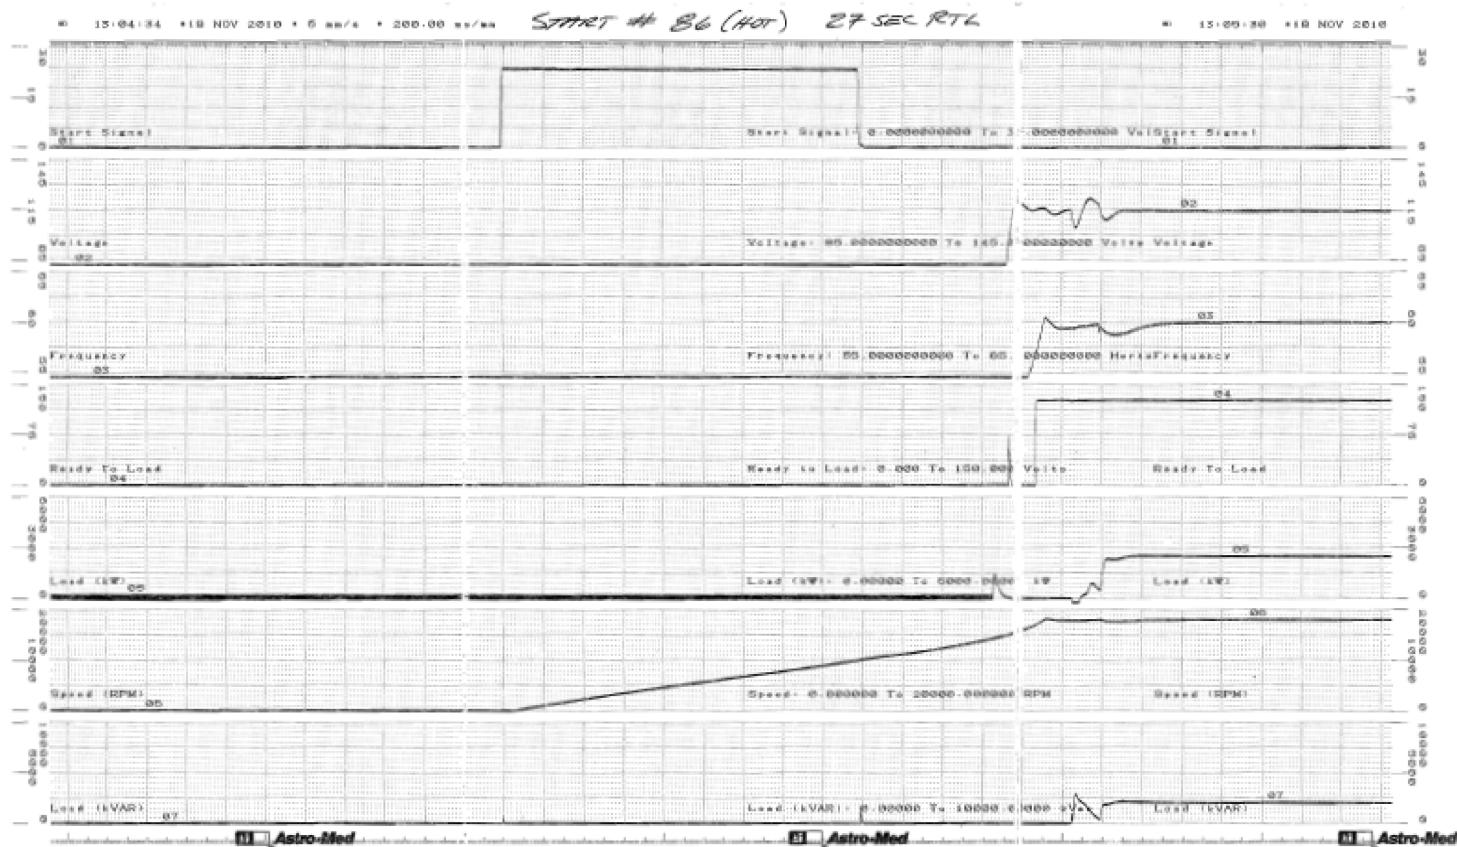


Figure C.1.0-87 Parameter Chart of Start and Load Acceptance Test, No.86, Hot

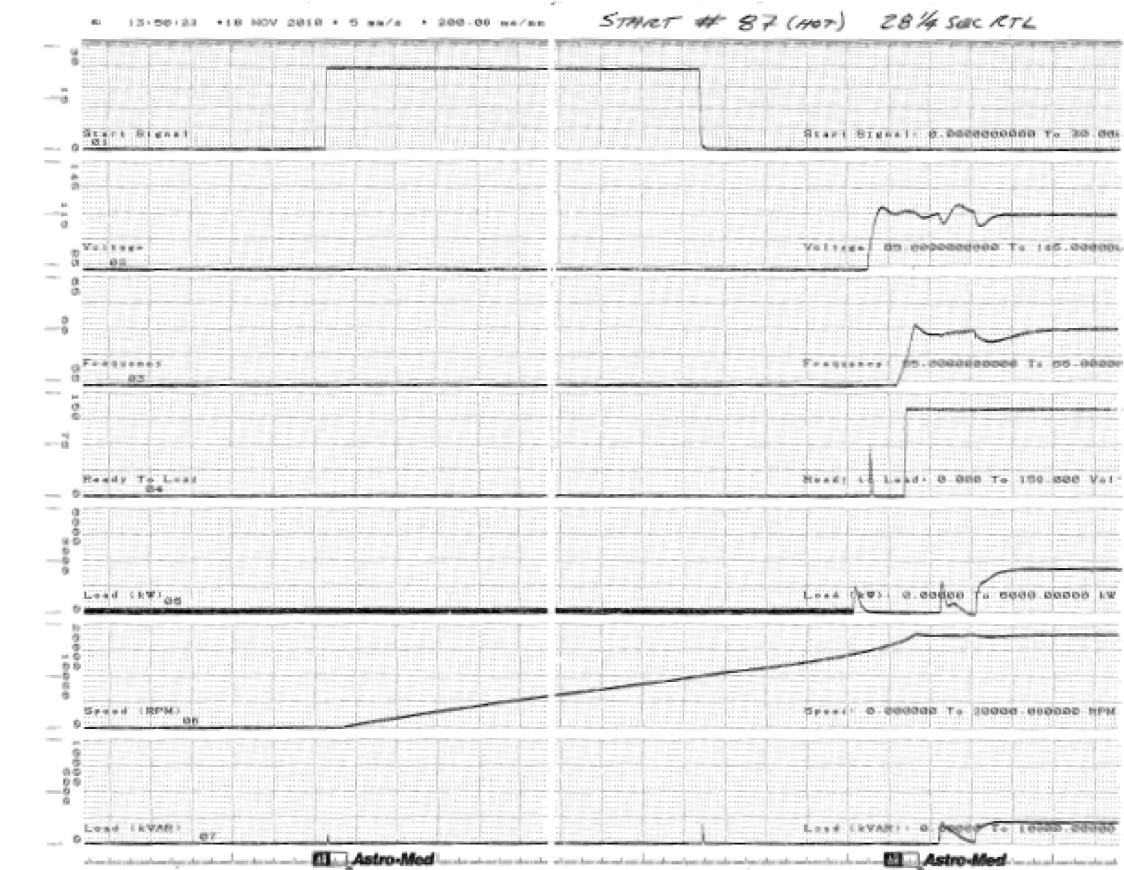


Figure C.1.0-88 Parameter Chart of Start and Load Acceptance Test, No.87, Hot

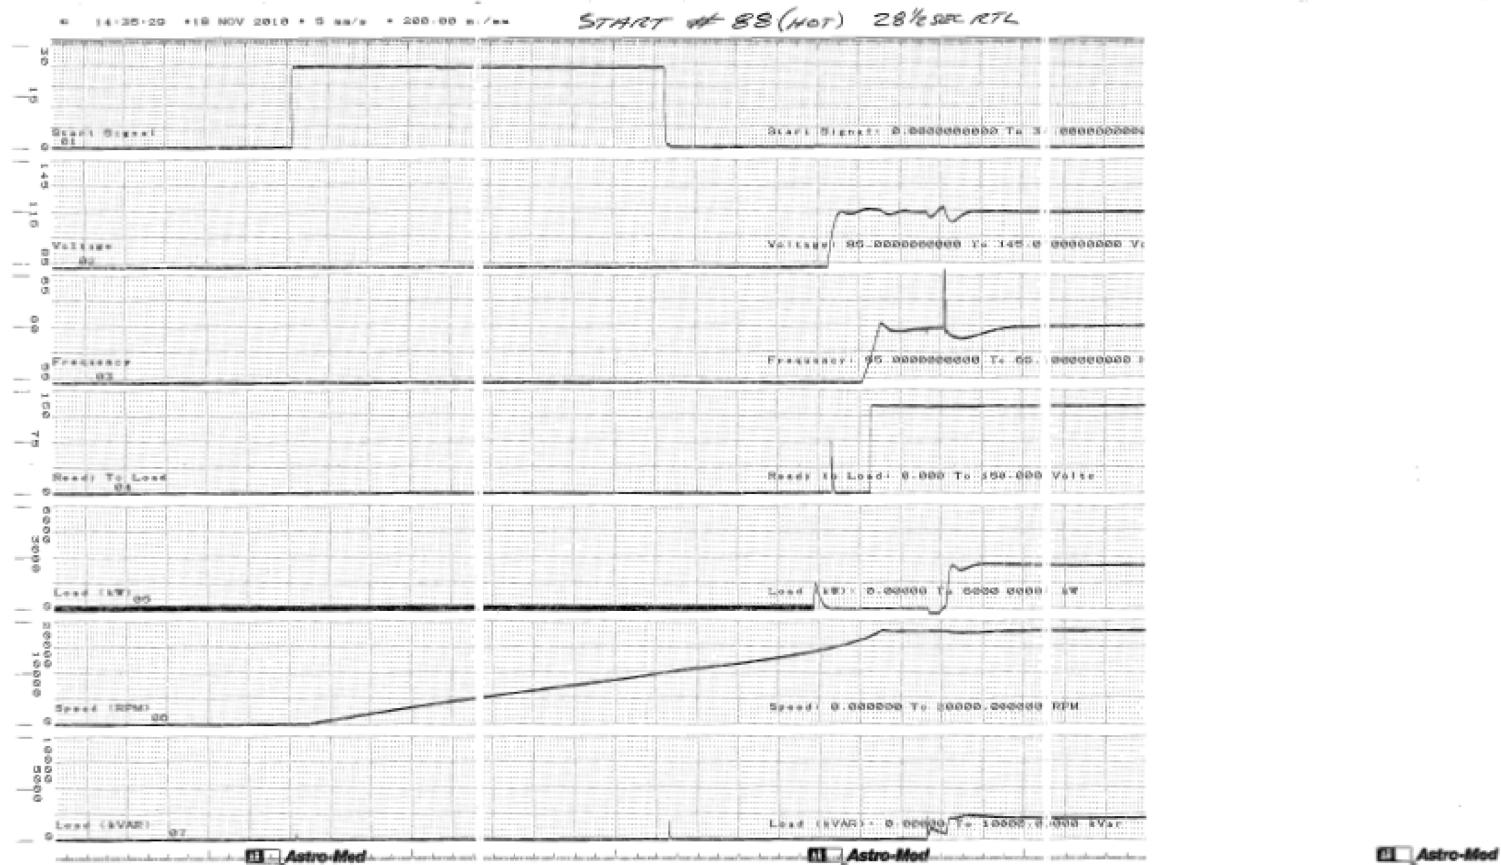


Figure C.1.0-89 Parameter Chart of Start and Load Acceptance Test, No.88, Hot

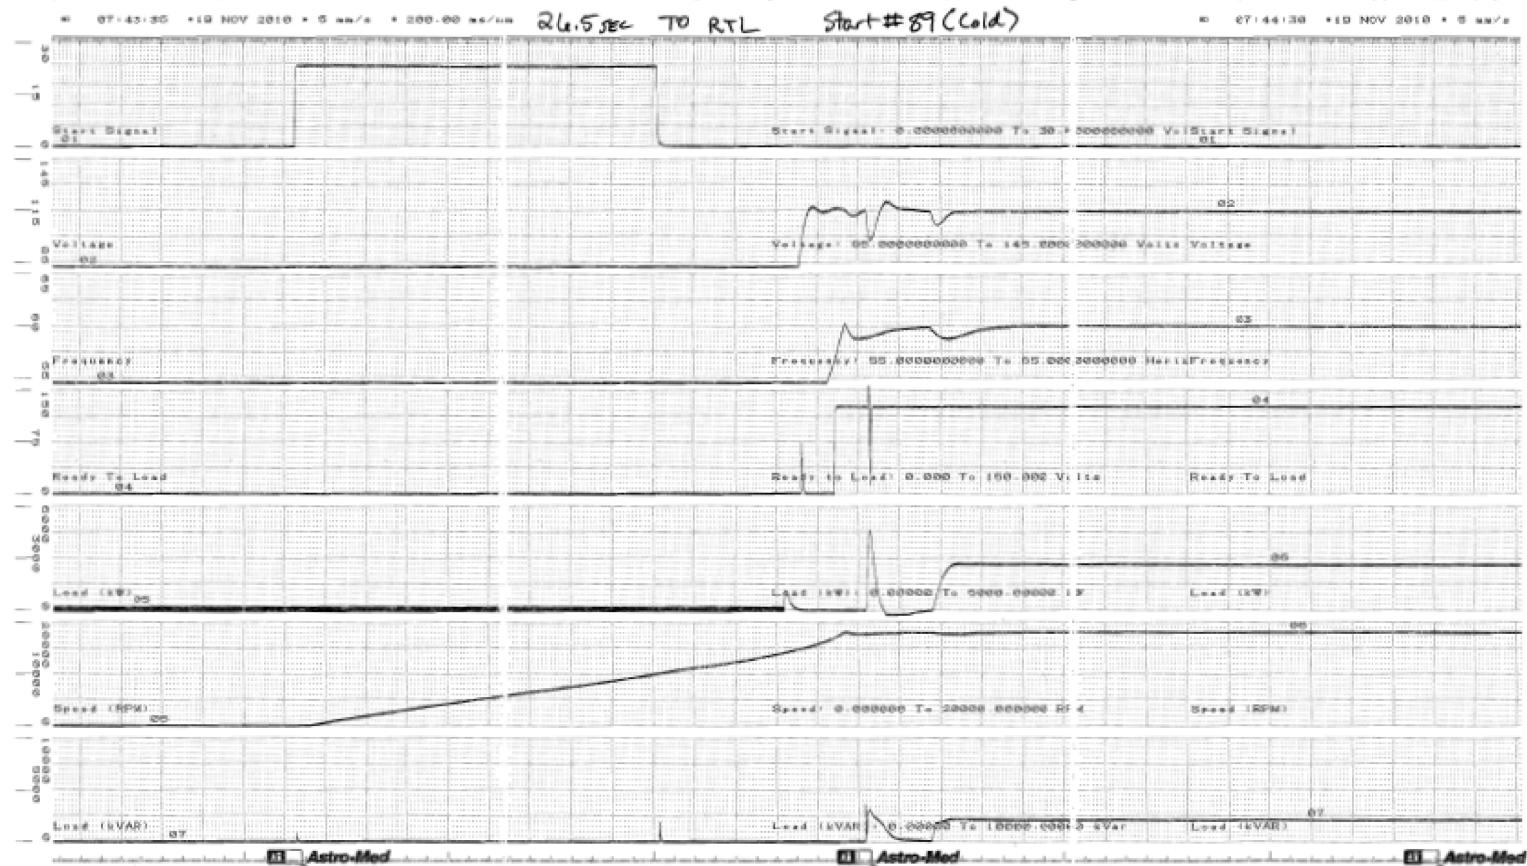


Figure C.1.0-90 Parameter Chart of Start and Load Acceptance Test, No.89, Cold

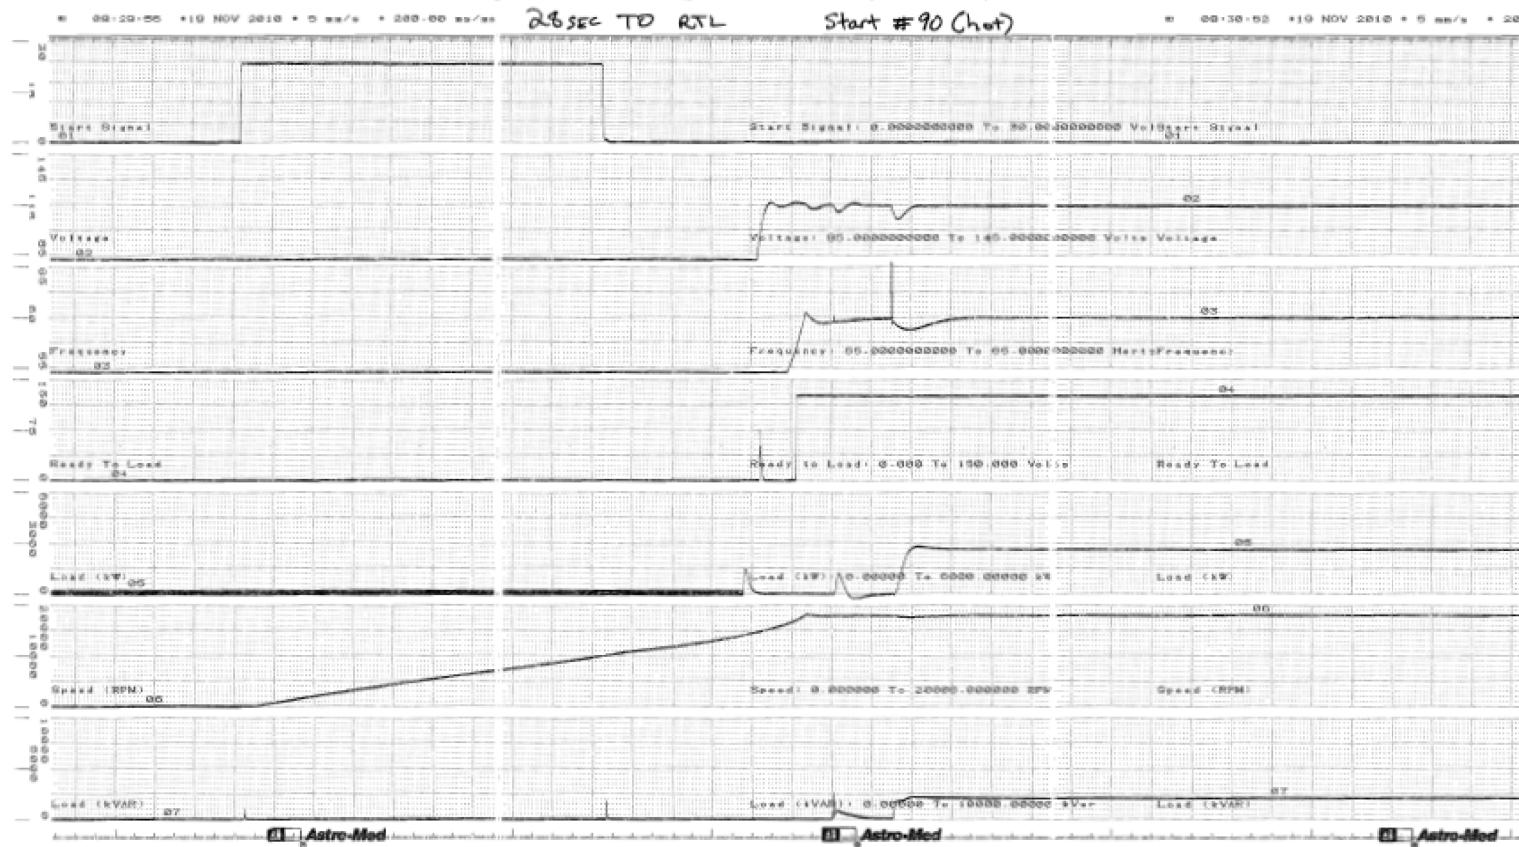


Figure C.1.0-91 Parameter Chart of Start and Load Acceptance Test, No.90, Hot

INITIAL TYPE TEST RESULT OF  
CLASS 1E GAS TURBINE GENERATOR SYSTEM

MUAP-10023-NP(R4)

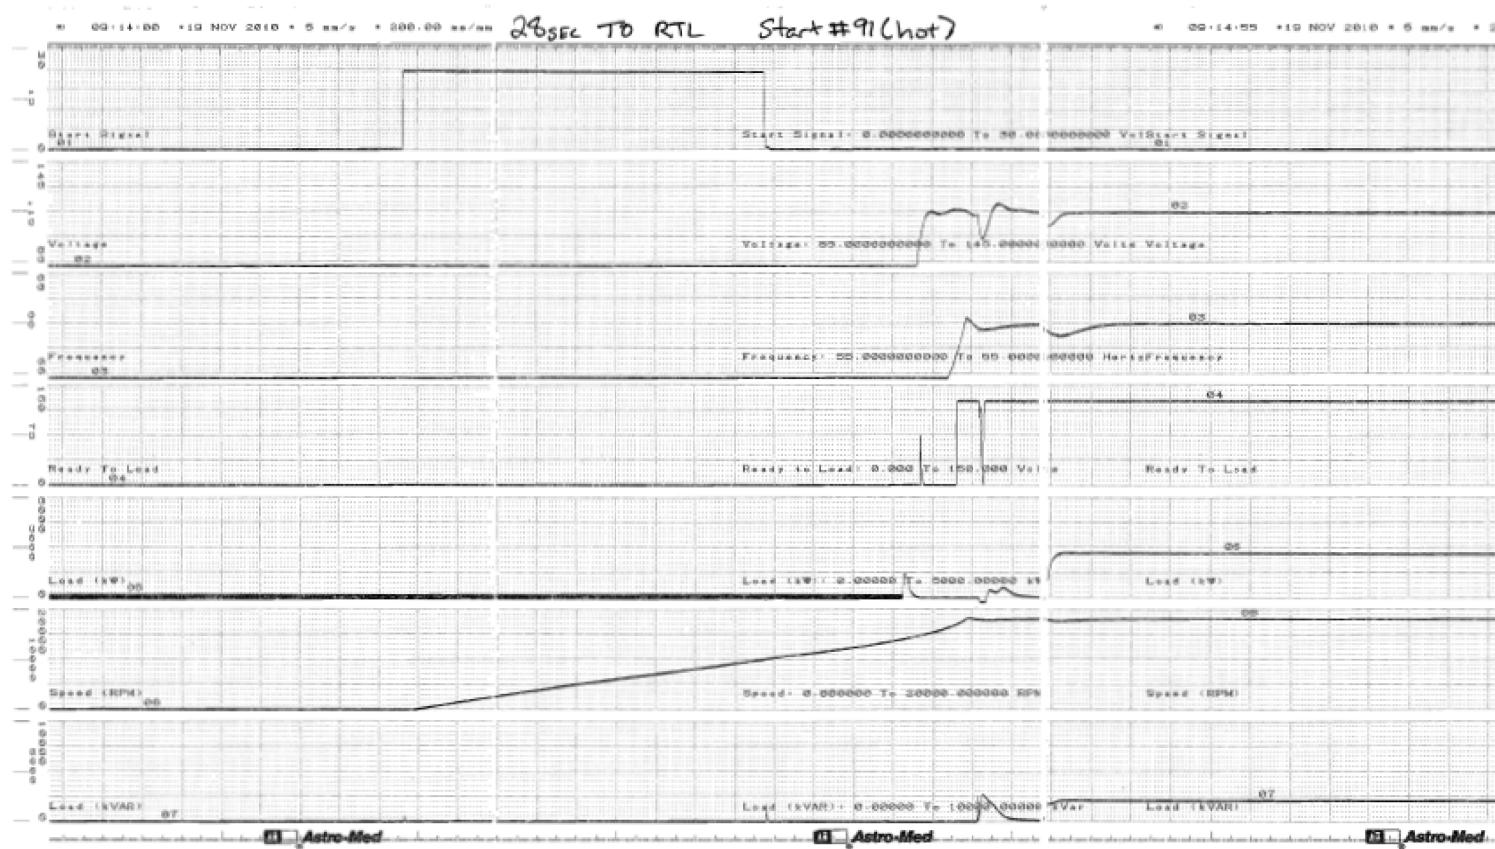


Figure C.1.0-92 Parameter Chart of Start and Load Acceptance Test, No.91, Hot

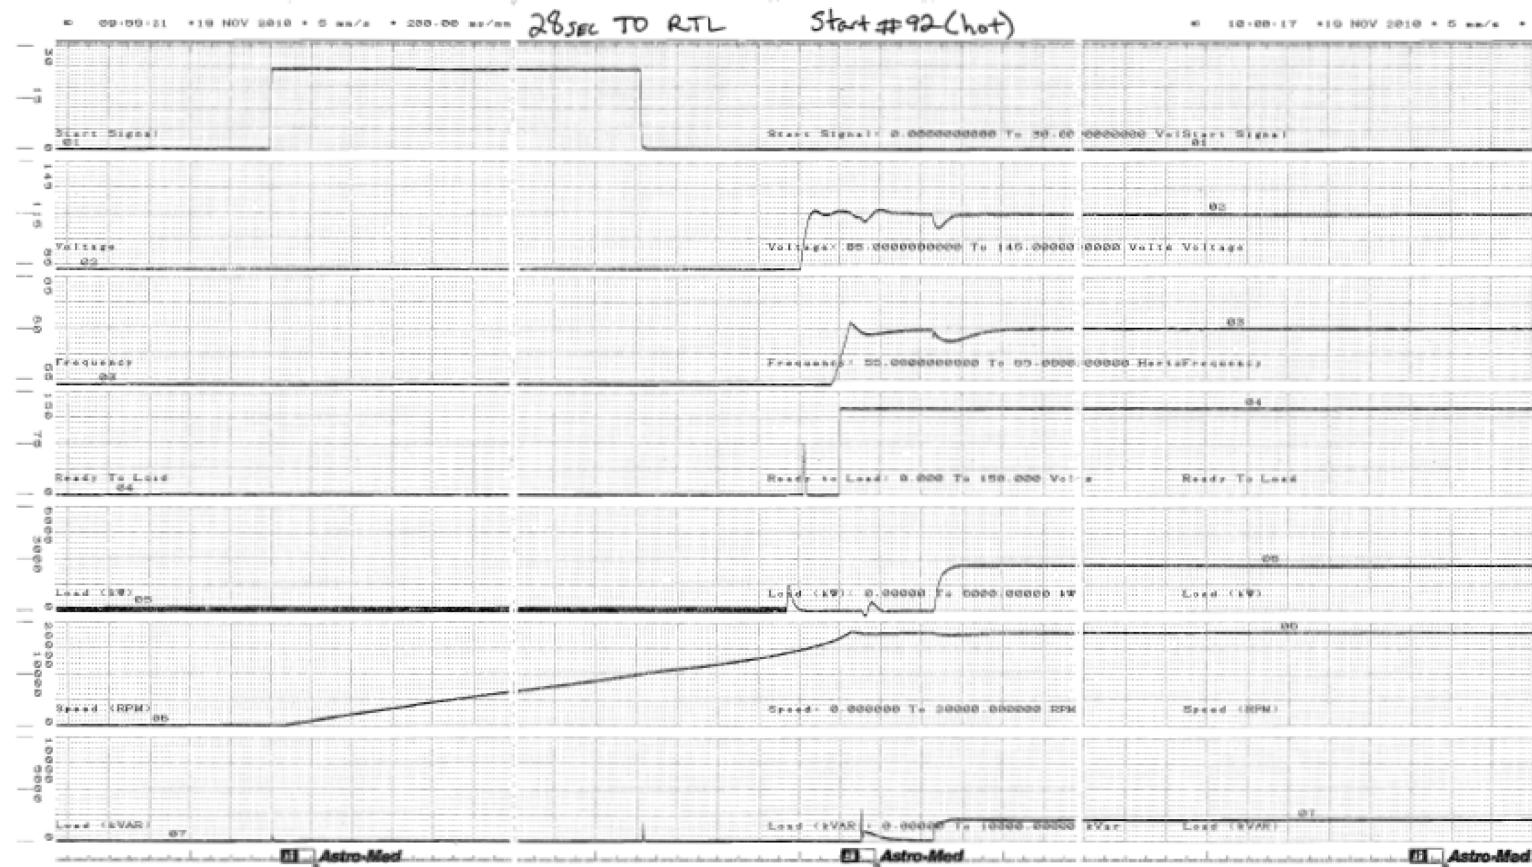


Figure C.1.0-93 Parameter Chart of Start and Load Acceptance Test, No.92, Hot

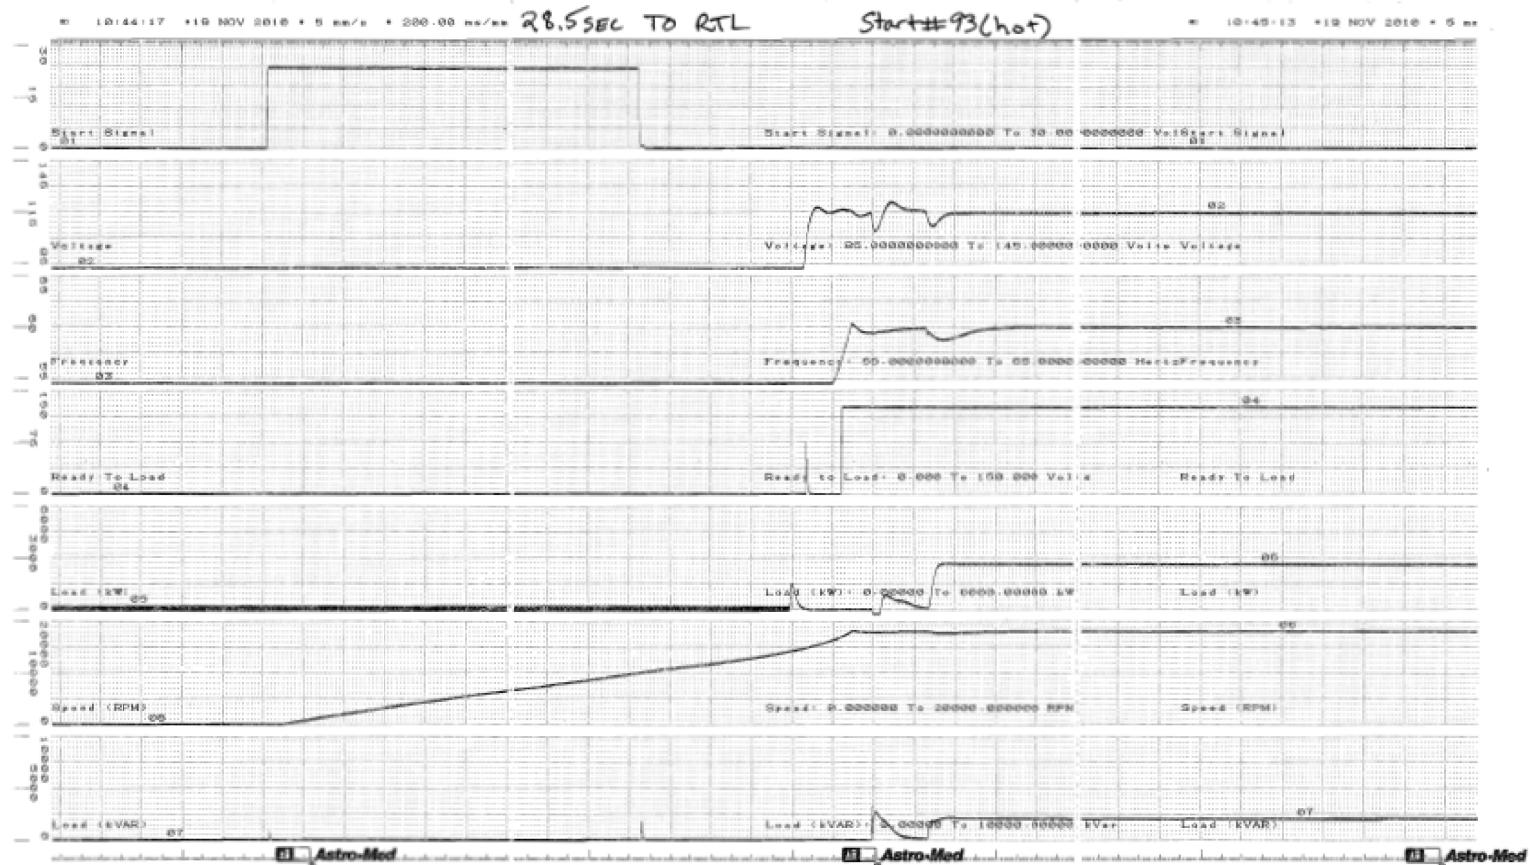


Figure C.1.0-94 Parameter Chart of Start and Load Acceptance Test, No.93, Hot

INITIAL TYPE TEST RESULT OF  
CLASS 1E GAS TURBINE GENERATOR SYSTEM

MUAP-10023-NP(R4)

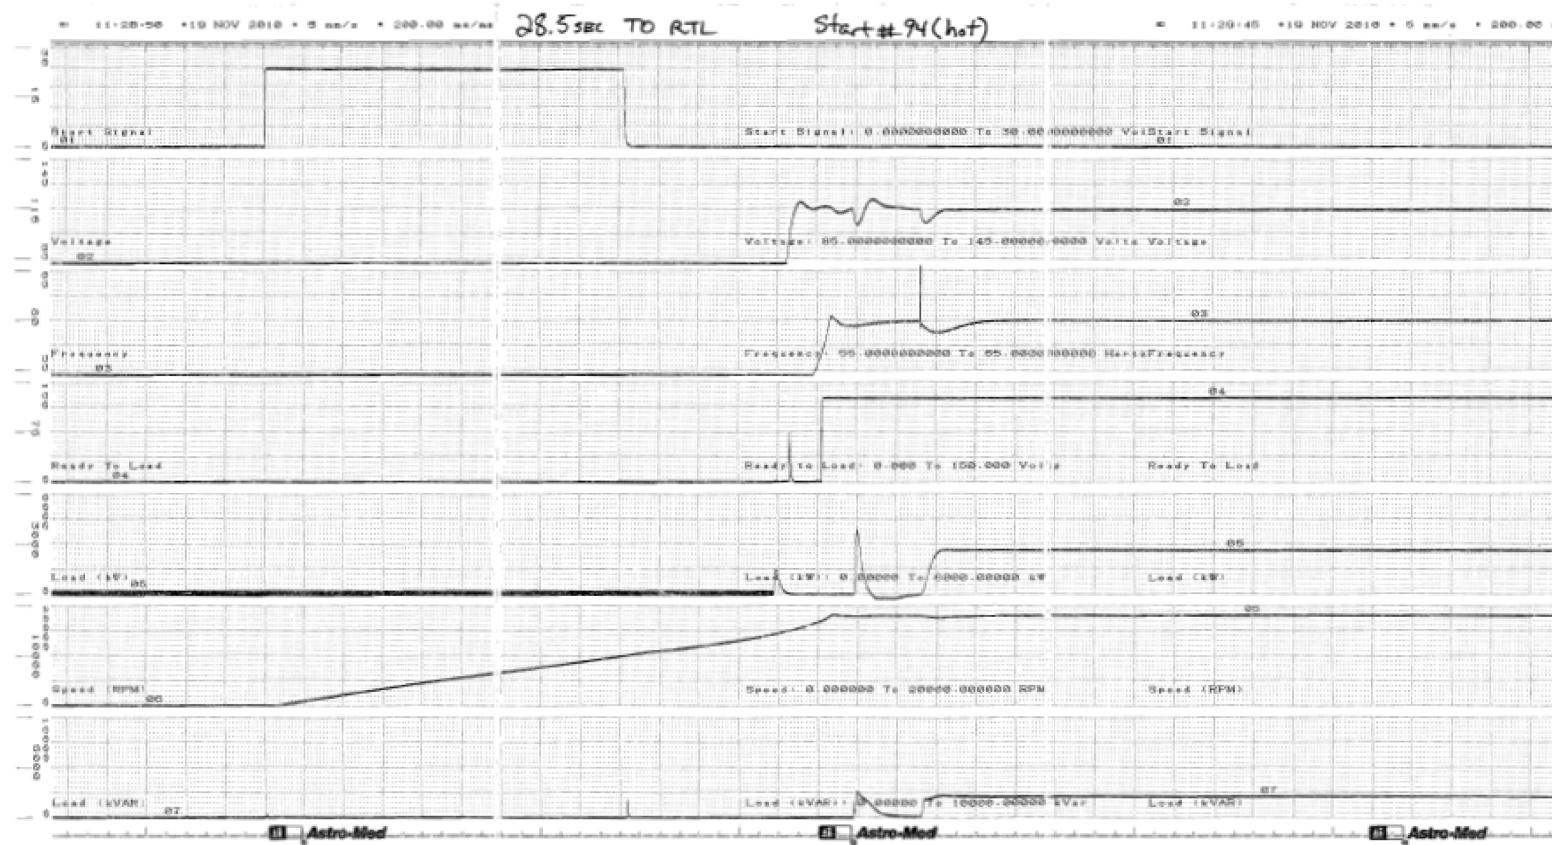


Figure C.1.0-95 Parameter Chart of Start and Load Acceptance Test, No.94, Hot

INITIAL TYPE TEST RESULT OF  
CLASS 1E GAS TURBINE GENERATOR SYSTEM

MUAP-10023-NP(R4)

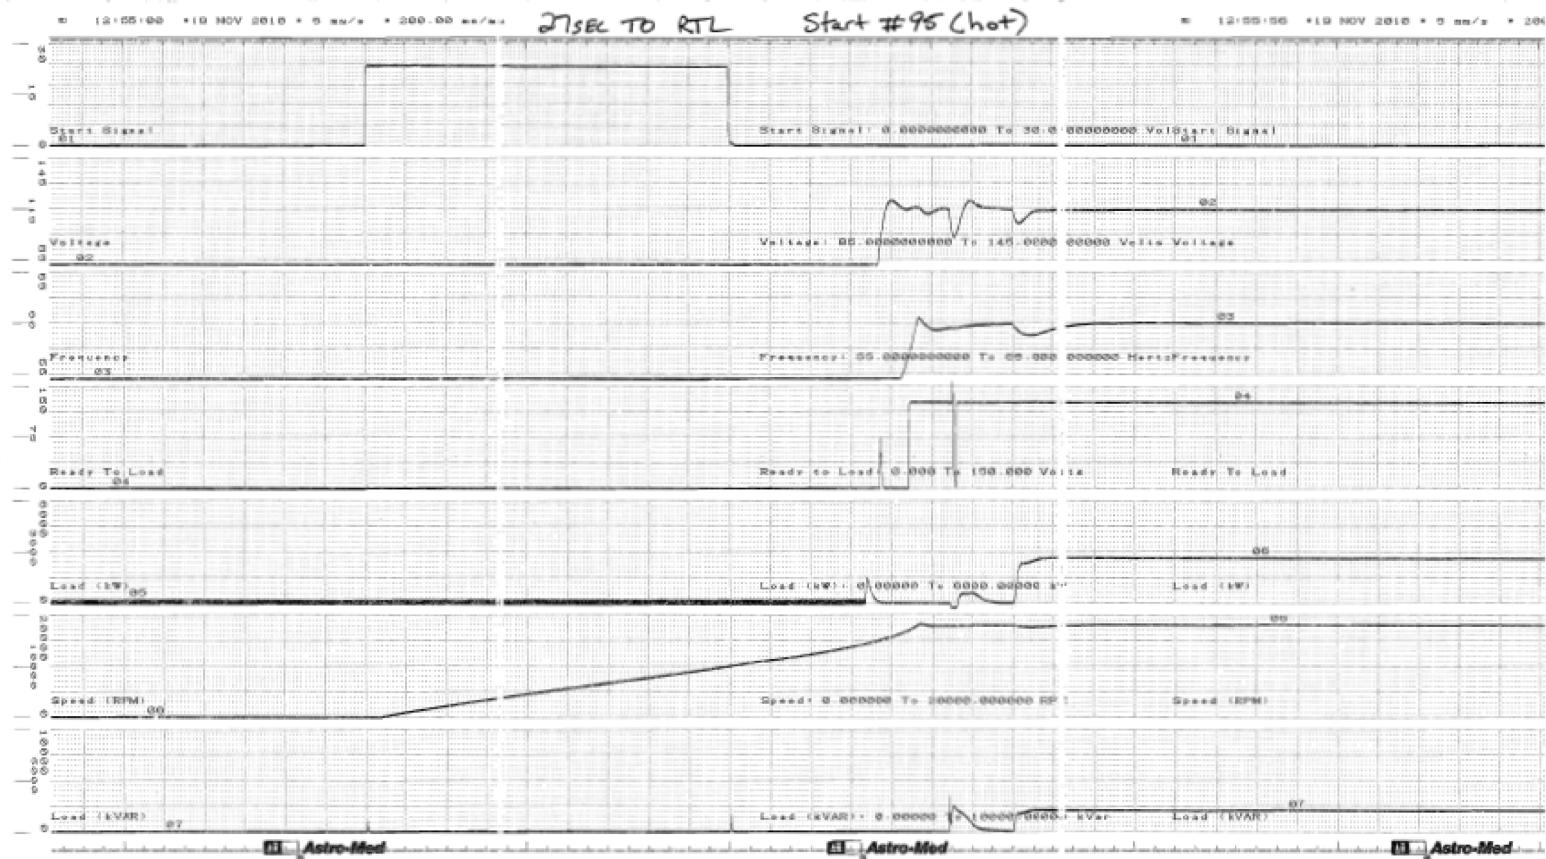


Figure C.1.0-96 Parameter Chart of Start and Load Acceptance Test, No.95, Hot

INITIAL TYPE TEST RESULT OF  
CLASS 1E GAS TURBINE GENERATOR SYSTEM

MUAP-10023-NP(R4)

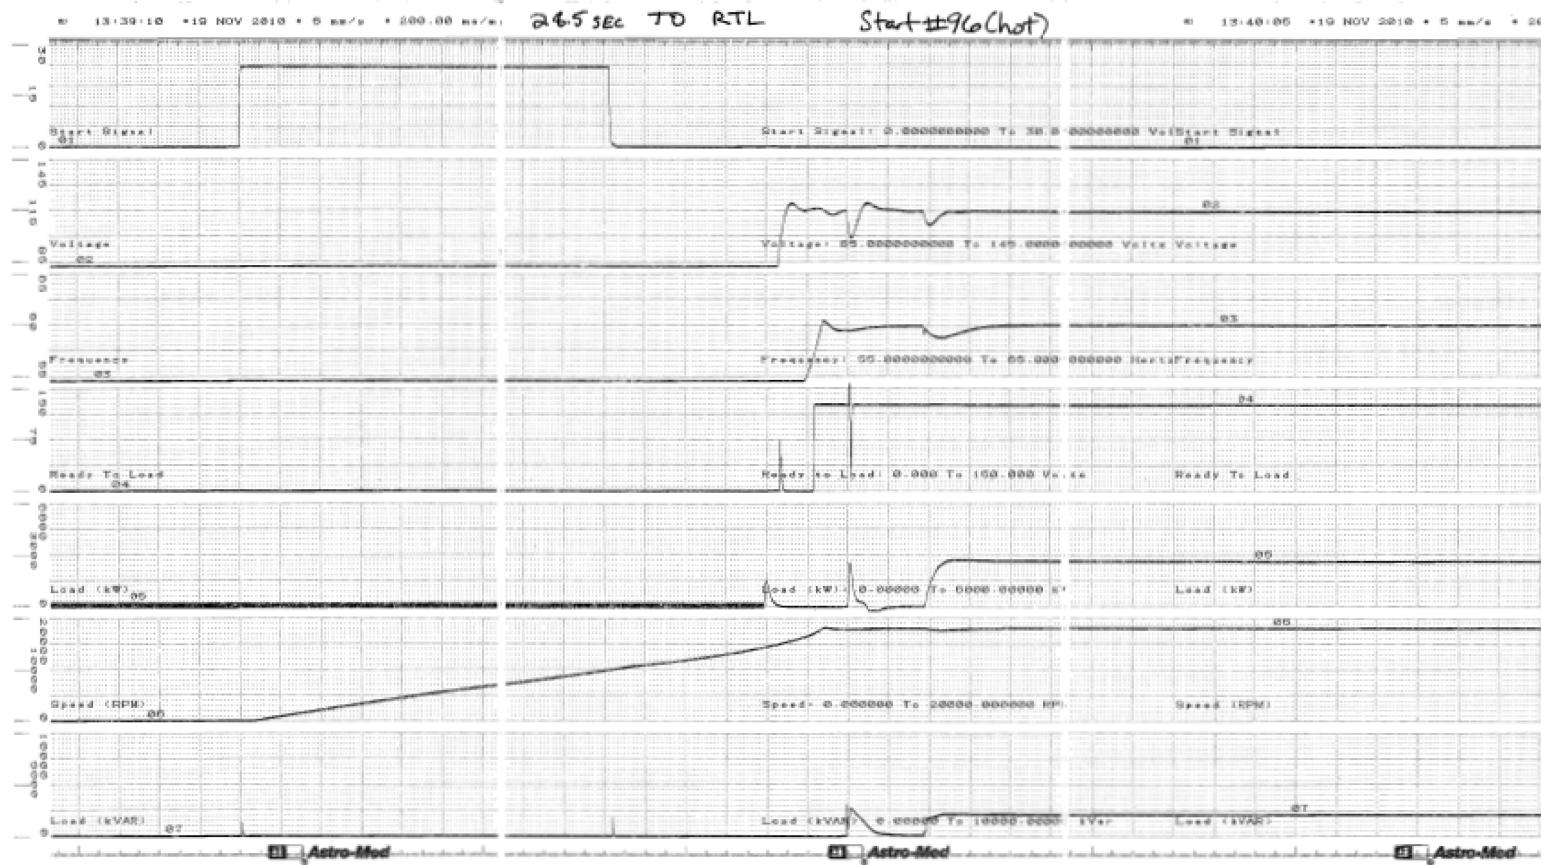


Figure C.1.0-97 Parameter Chart of Start and Load Acceptance Test, No.96, Hot

INITIAL TYPE TEST RESULT OF  
CLASS 1E GAS TURBINE GENERATOR SYSTEM

MUAP-10023-NP(R4)

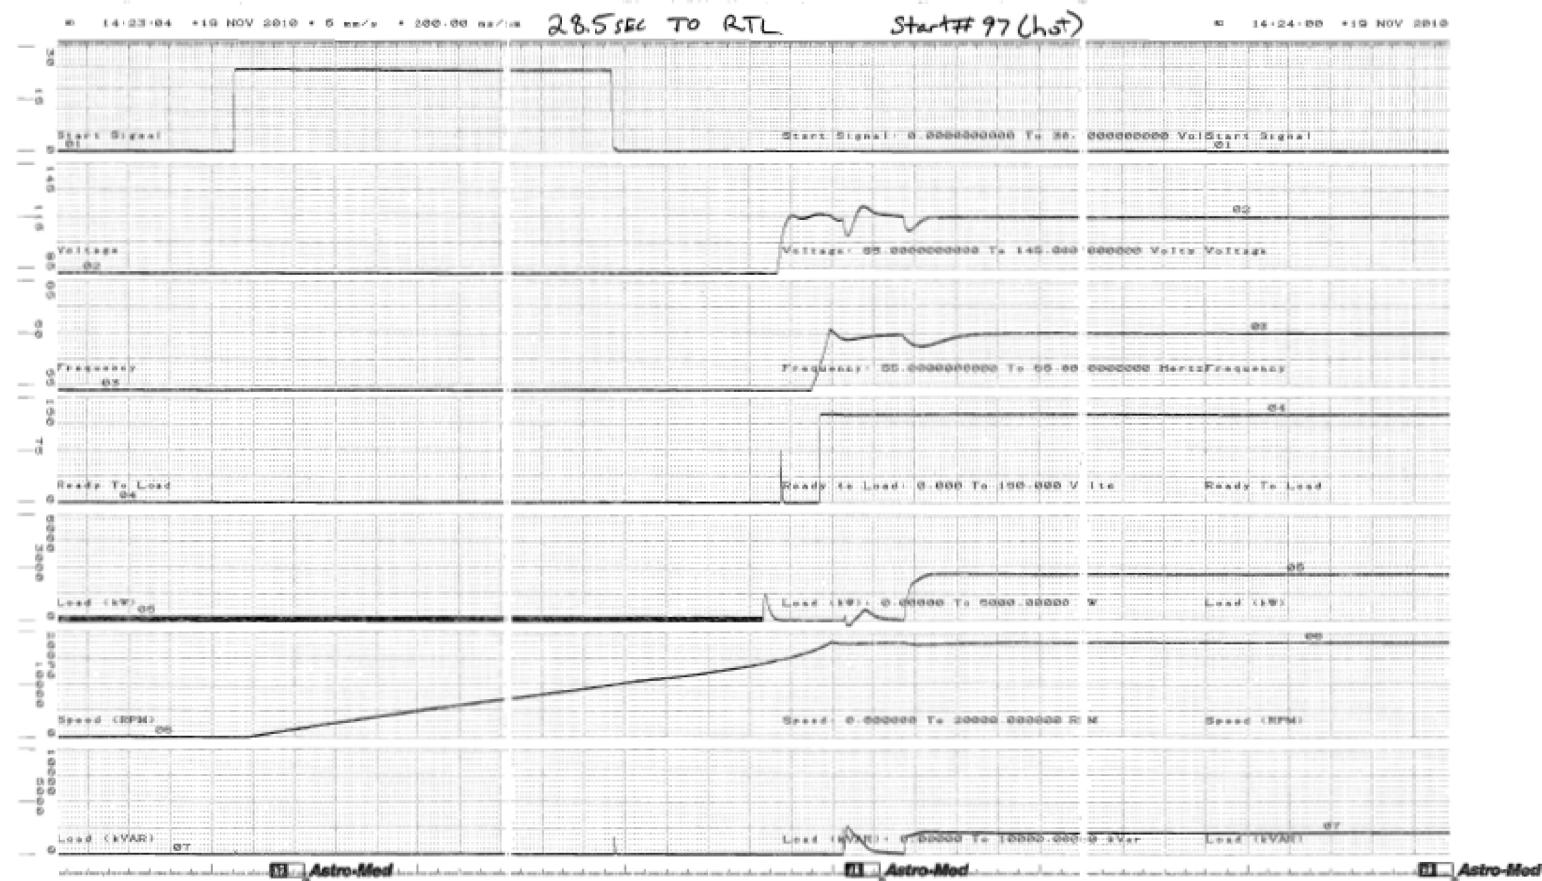


Figure C.1.0-98 Parameter Chart of Start and Load Acceptance Test, No.97, Hot

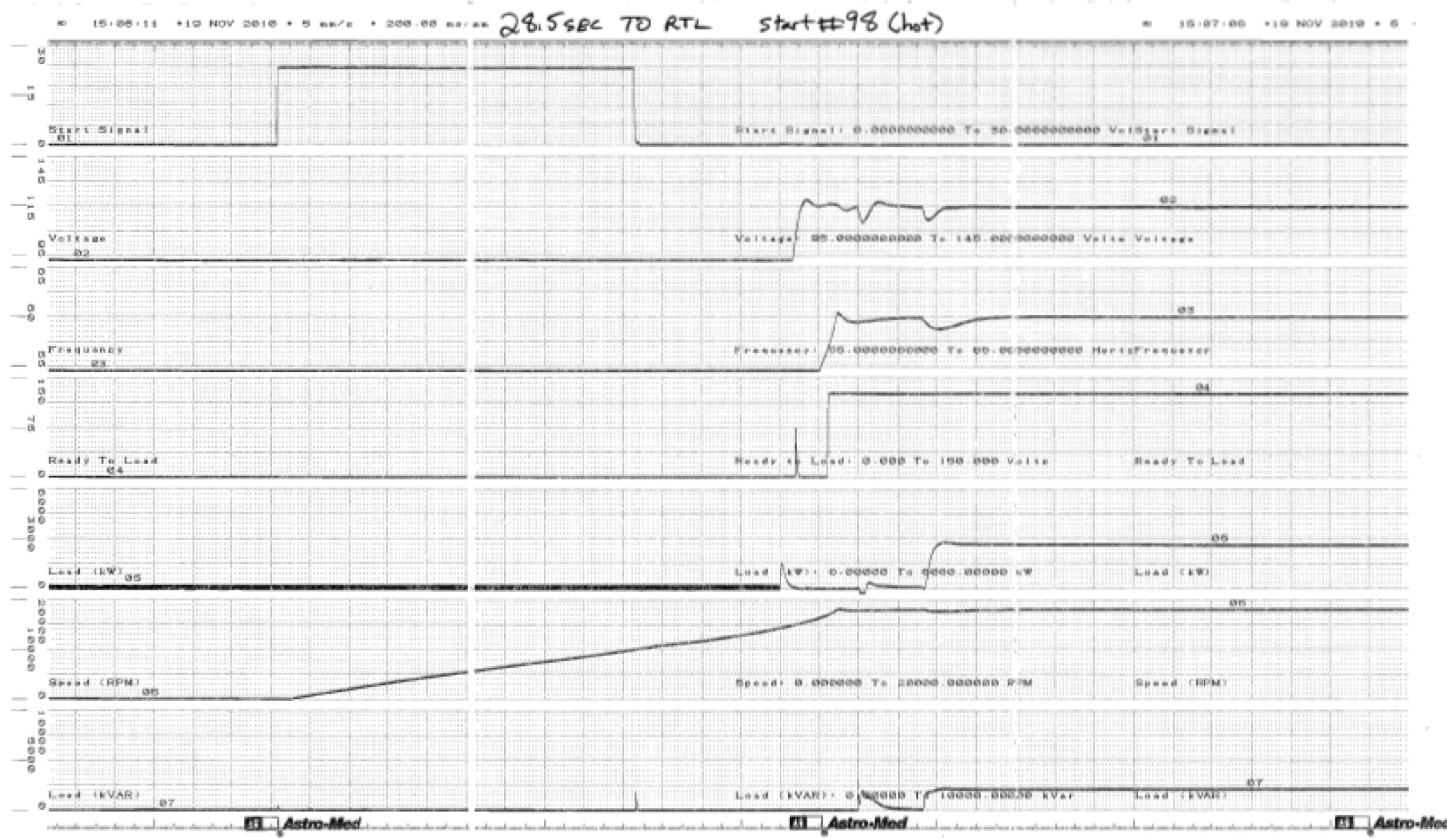


Figure C.1.0-99 Parameter Chart of Start and Load Acceptance Test, No.98, Hot

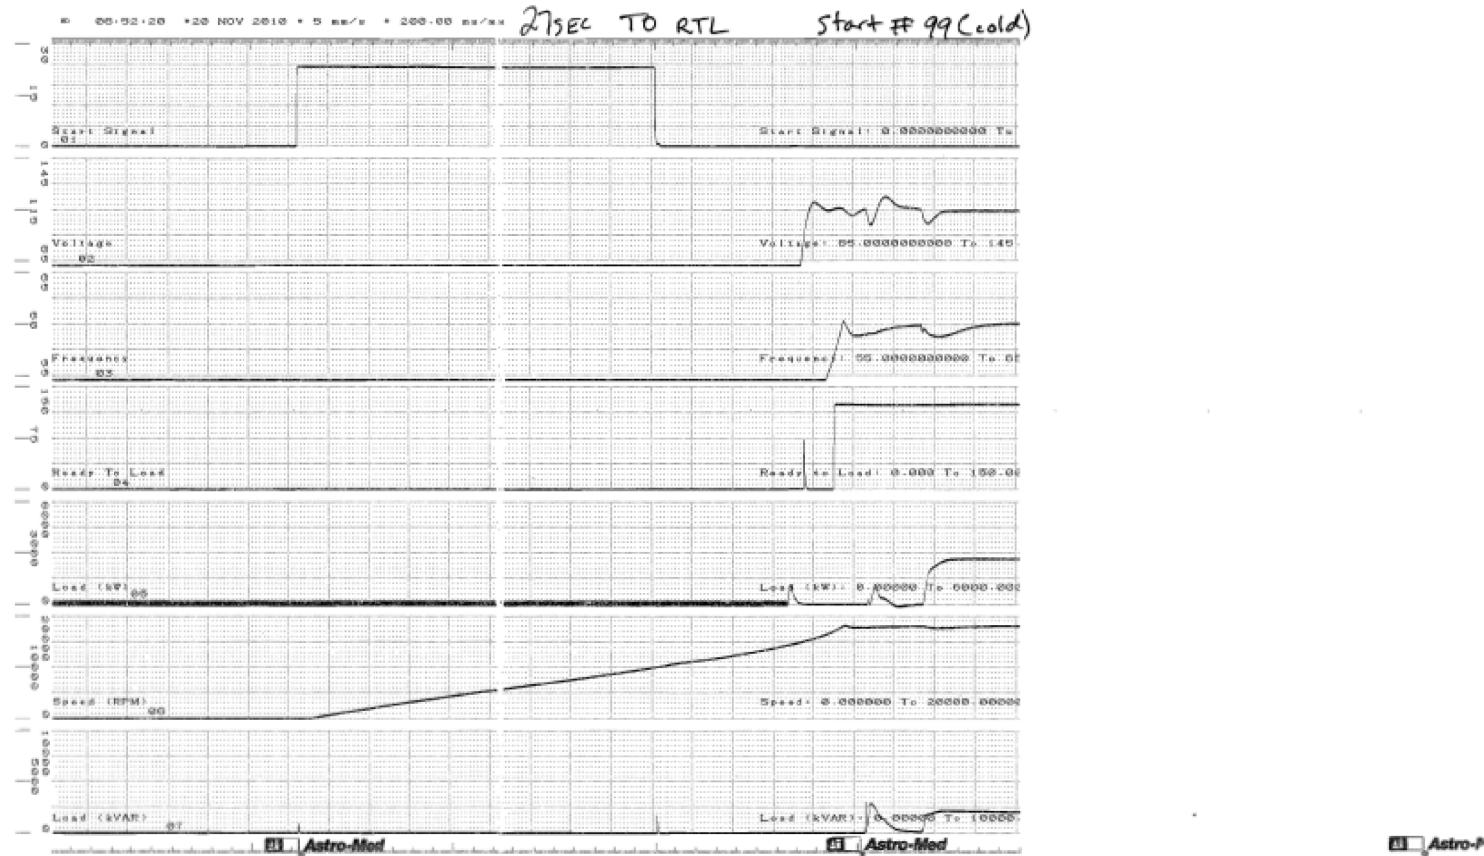


Figure C.1.0-100 Parameter Chart of Start and Load Acceptance Test, No.99, Cold

INITIAL TYPE TEST RESULT OF  
CLASS 1E GAS TURBINE GENERATOR SYSTEM

MUAP-10023-NP(R4)

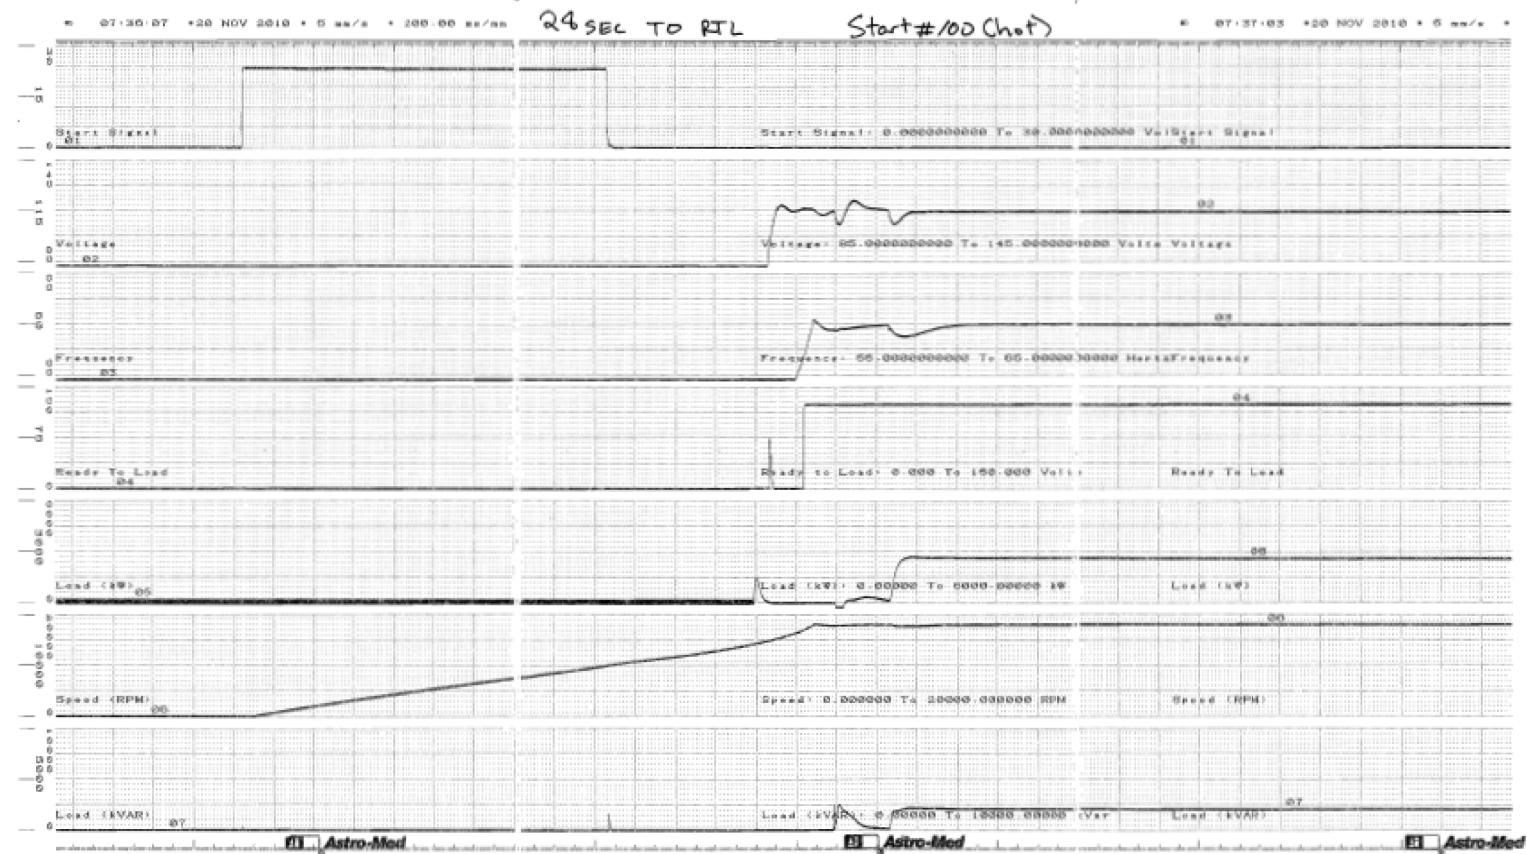


Figure C.1.0-101 Parameter Chart of Start and Load Acceptance Test, No.100, Hot

INITIAL TYPE TEST RESULT OF  
CLASS 1E GAS TURBINE GENERATOR SYSTEM

MUAP-10023-NP(R4)

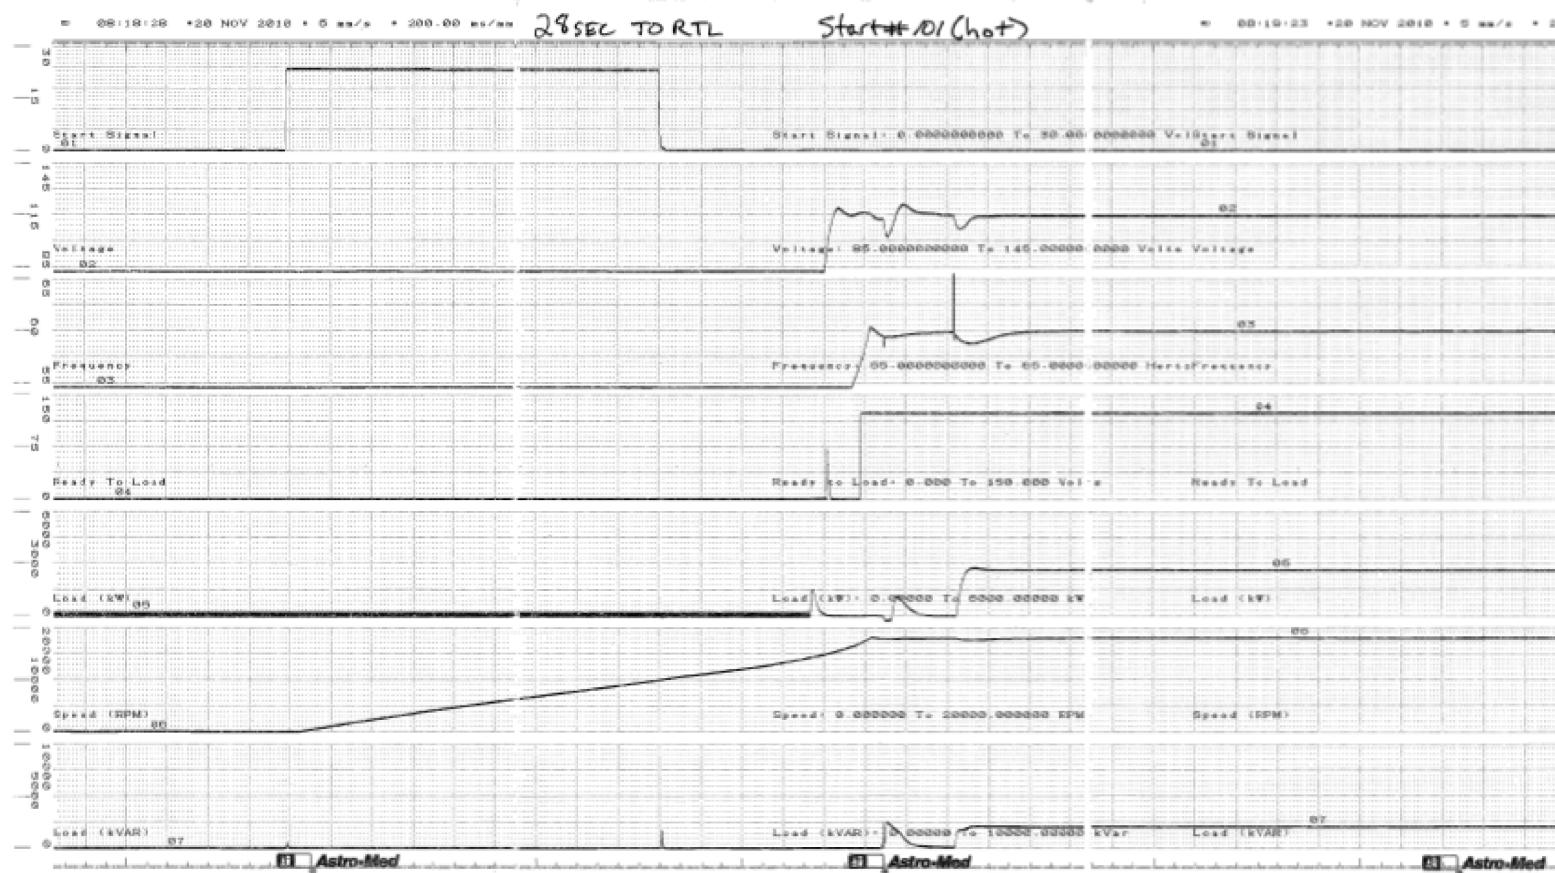


Figure C.1.0-102 Parameter Chart of Start and Load Acceptance Test, No.101, Hot

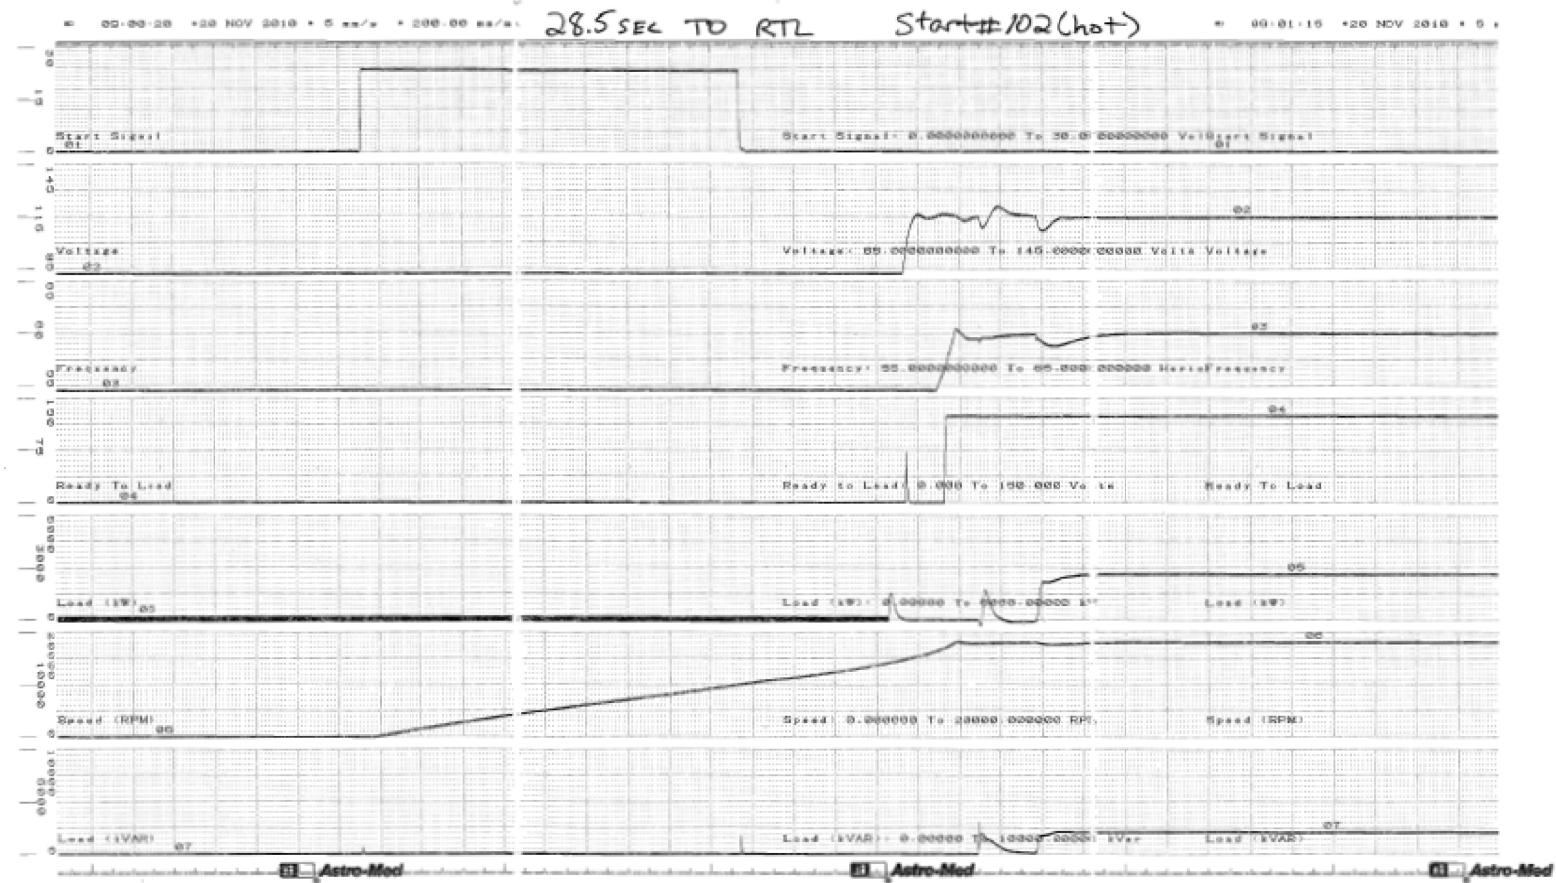


Figure C.1.0-103 Parameter Chart of Start and Load Acceptance Test, No.102, Hot

INITIAL TYPE TEST RESULT OF  
CLASS 1E GAS TURBINE GENERATOR SYSTEM

MUAP-10023-NP(R4)

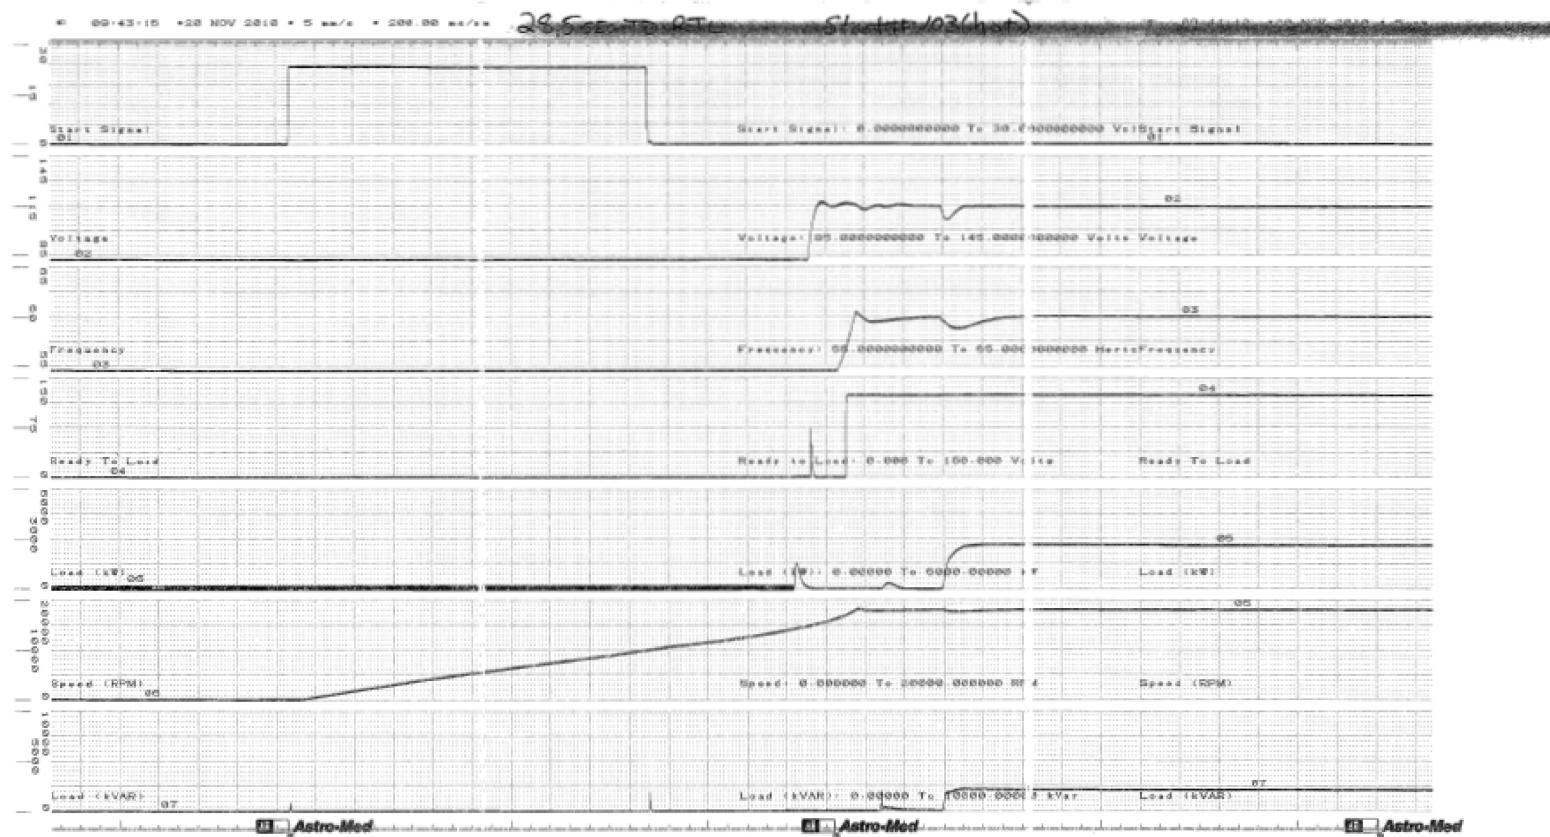


Figure C.1.0-104 Parameter Chart of Start and Load Acceptance Test, No.103, Hot

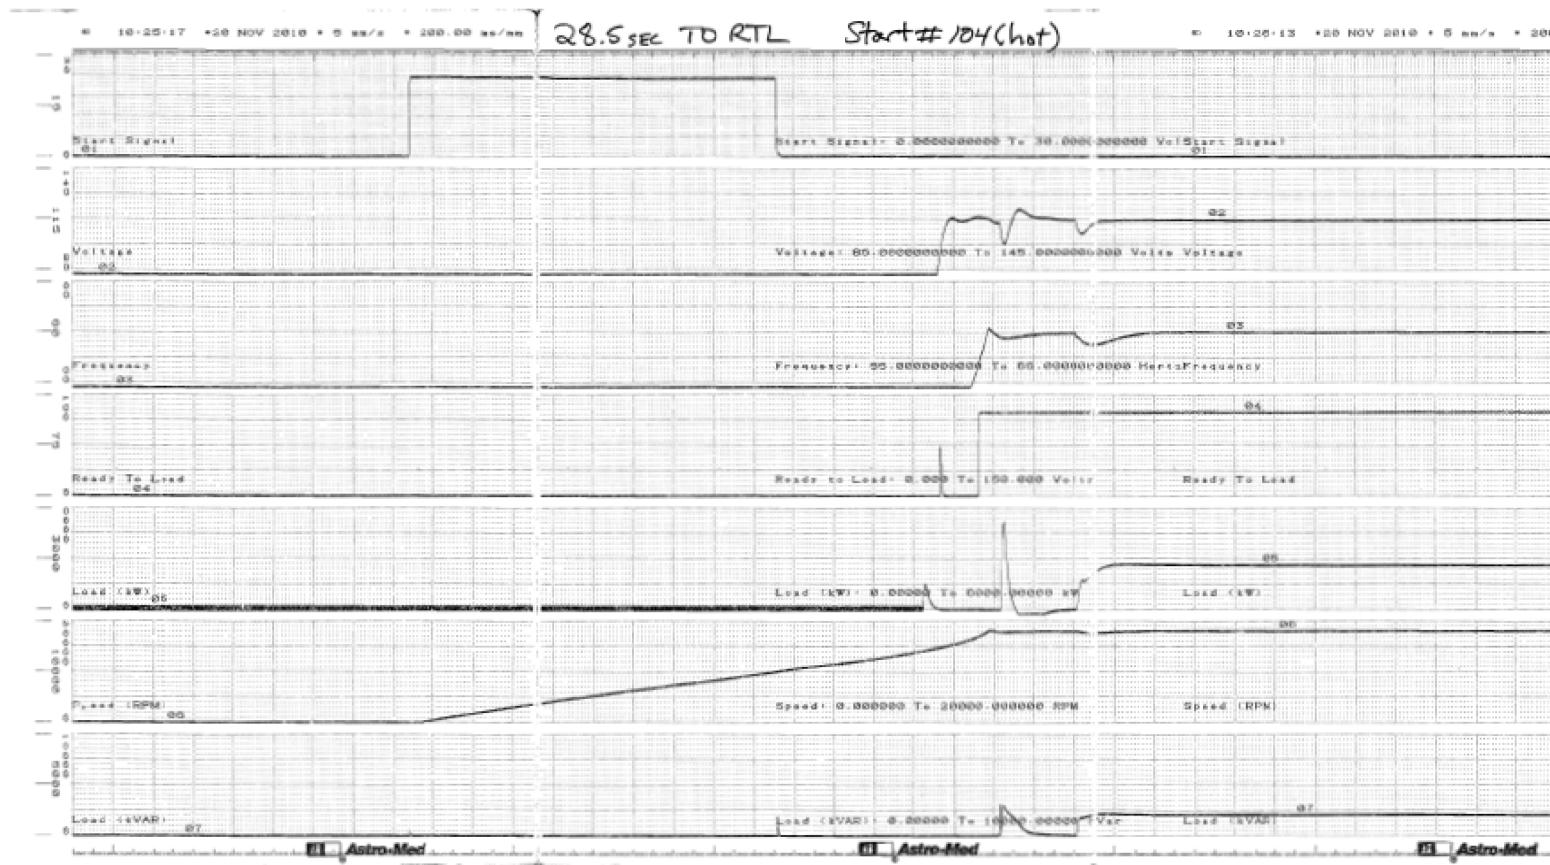


Figure C.1.0-105 Parameter Chart of Start and Load Acceptance Test, No.104, Hot

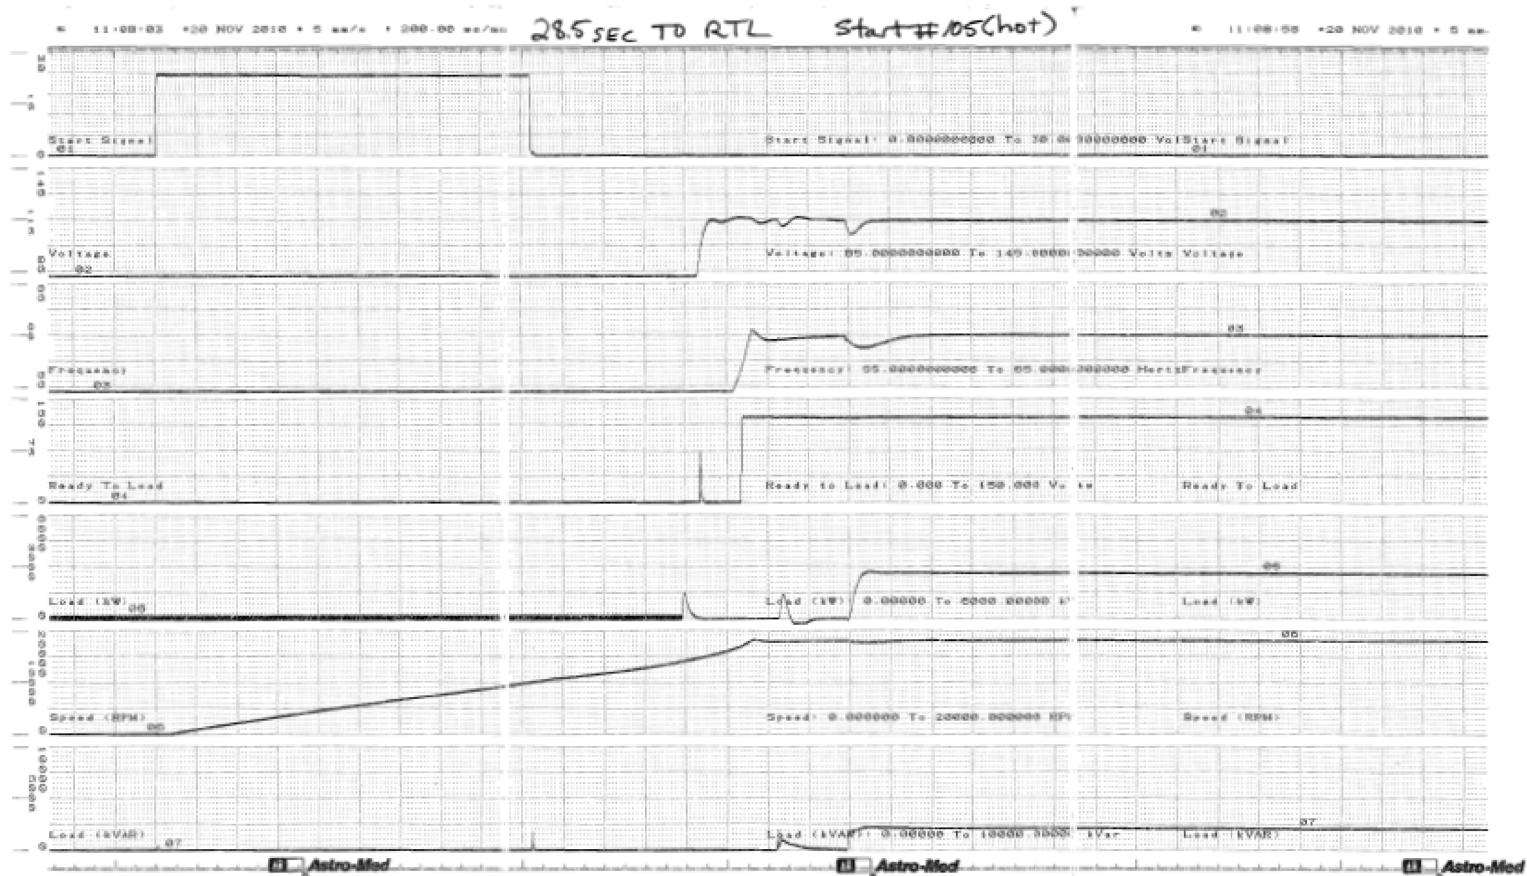


Figure C.1.0-106 Parameter Chart of Start and Load Acceptance Test, No.105, Hot

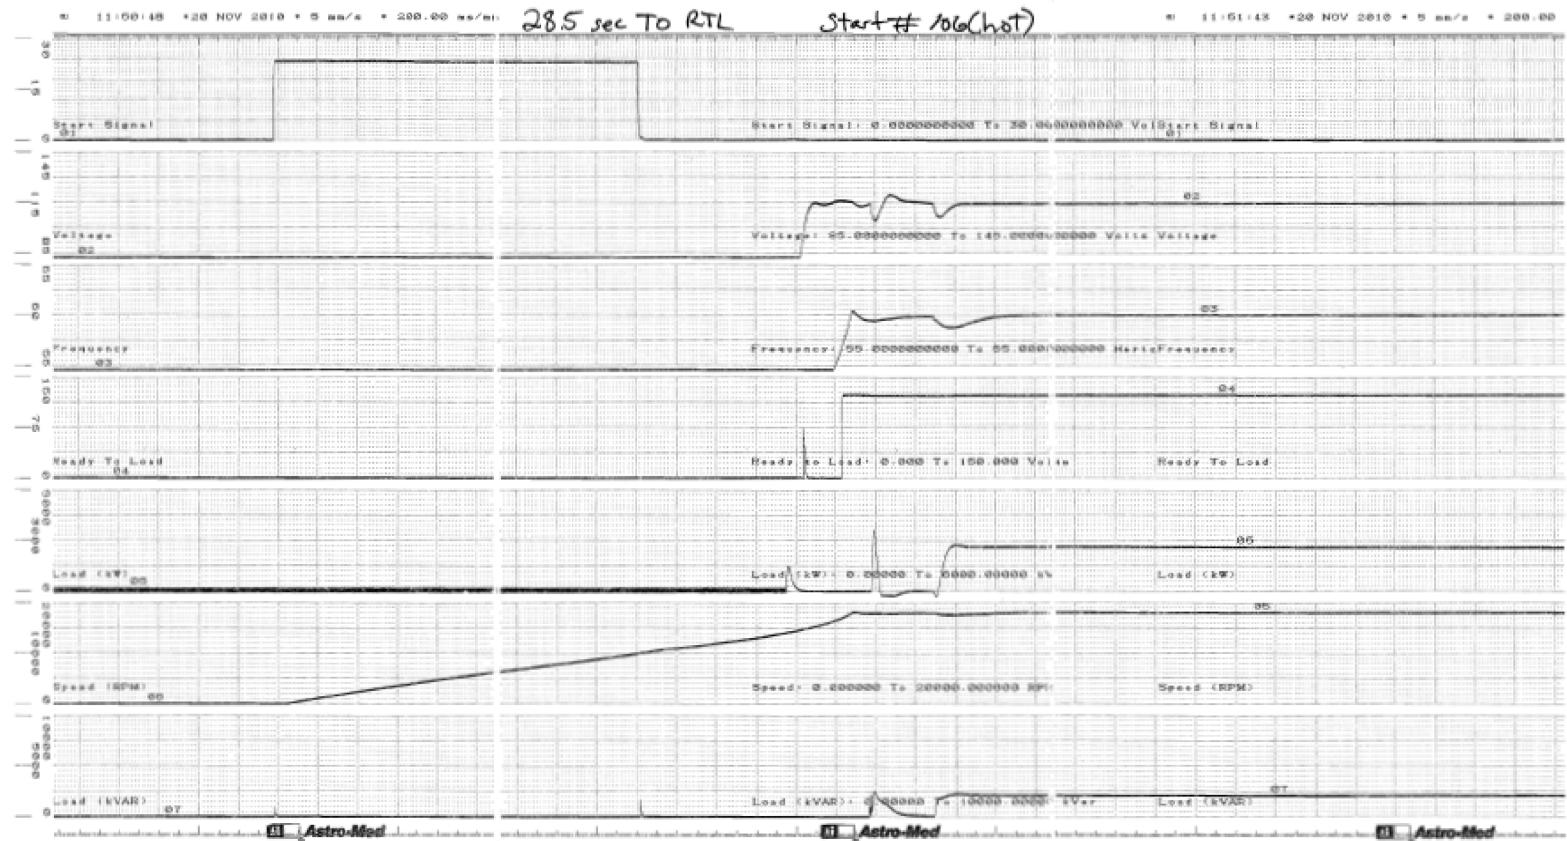


Figure C.1.0-107 Parameter Chart of Start and Load Acceptance Test, No.106, Hot

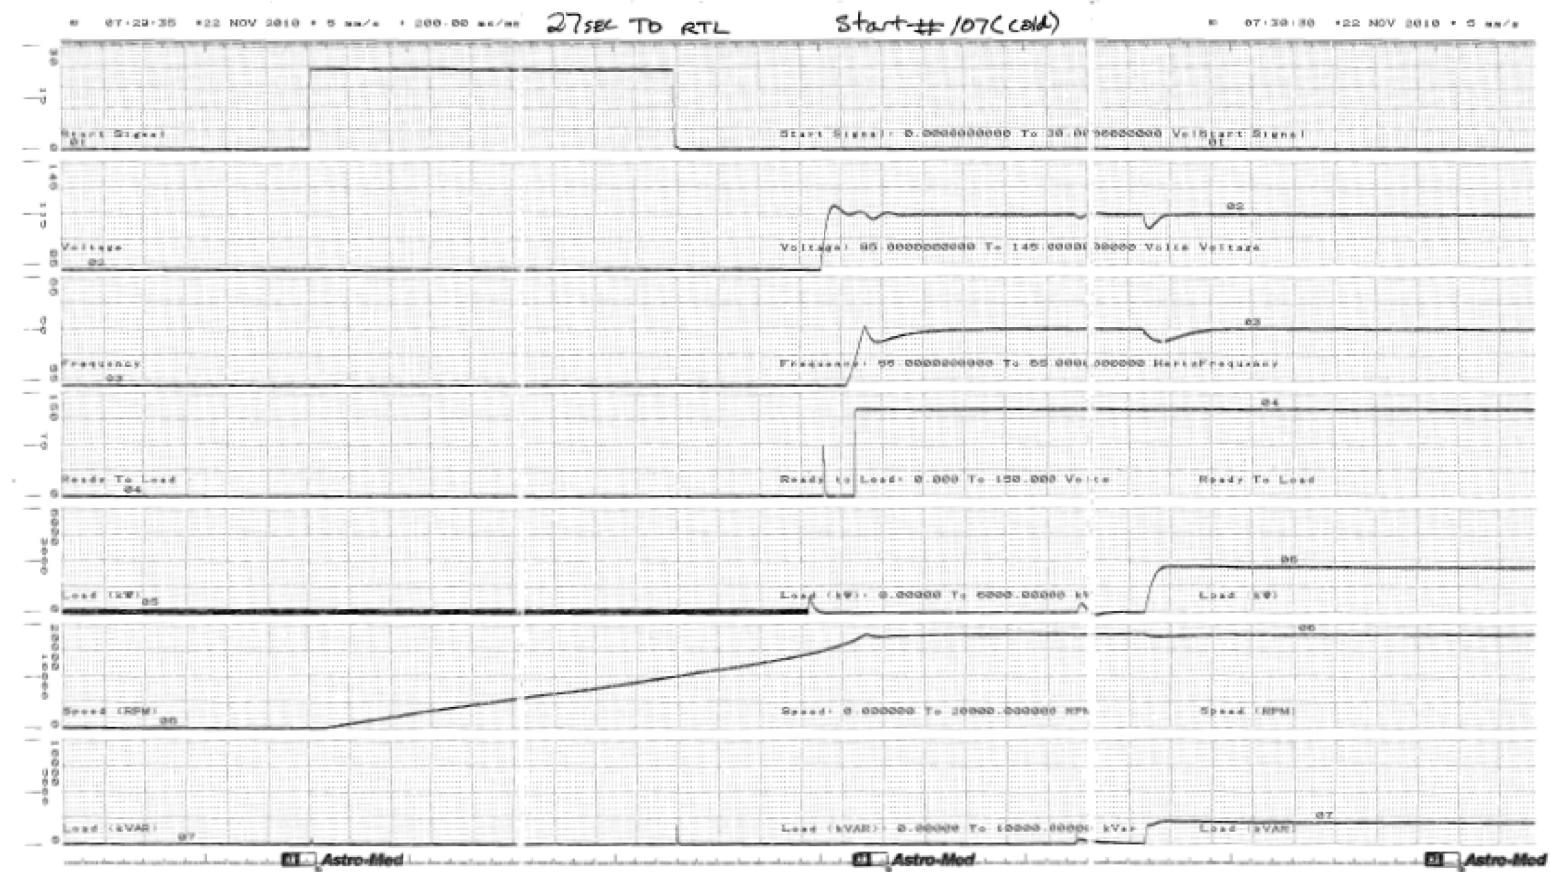


Figure C.1.0-108 Parameter Chart of Start and Load Acceptance Test, No.107, Cold