



Tennessee Valley Authority, 1101 Market Street, Chattanooga, Tennessee 37402

October 22, 2012

10 CFR 50.4

ATTN: Document Control Desk
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555-0001


Browns Ferry Nuclear Plant, Unit 1
Facility Operating License No. DPR-33
NRC Docket No. 50-259

Subject: **Browns Ferry Nuclear Plant, Unit 1 Core Operating Limits Report for Cycle 10 Operation**

In accordance with the requirements of Technical Specification 5.6.5.d, the Tennessee Valley Authority is submitting the Browns Ferry Nuclear Plant, Unit 1 Cycle 10, Core Operating Limits Report (COLR), Revision 0. Revision 0 of the Unit 1, Cycle 10, COLR includes all modes of operation (Modes 1 through 5).

There are no new commitments contained in this letter. If you have any questions please contact Terry Cribbe at (423) 751-3850.

Respectfully,

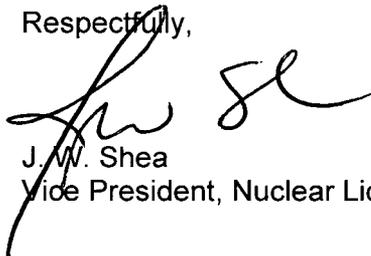

J. W. Shea
Vice President, Nuclear Licensing

Enclosure: Core Operating Limits Report, (105% OLTP), for Cycle 10 Operation TVA-COLR-BF1C10, Revision 0

cc: (w/ Enclosure)

NRC Regional Administrator - Region II
NRC Senior Resident Inspector - Browns Ferry Nuclear Plant

DD3D
NRR

**Enclosure
Tennessee Valley Authority
Browns Ferry Nuclear Plant
Unit 1**

**Core Operating Limits Report, (105% OLTP), for Cycle 10 Operation
TVA-COLR-BF1C10, Revision 0**

(See Attached)




Reactor Engineering and Fuels - BWRFE
1101 Market Street, Chattanooga, TN 37402

Browns Ferry Unit 1 Cycle 10


Core Operating Limits Report, (105% OLTP)


TVA-COLR-BF1C10 Revision 0 (Final)
(Revision Log, Page v)

October 2012

Prepared: 
T. W. Eichenberg, Sr. Specialist Date: 10/3/2012

Verified: 
B. C. Mitchell, Engineer Date: 10/5/12

Approved: 
G. C. Storey, Manager, BWR Fuel Engineering Date: 10/5/12

Reviewed: 
W. R. Hayes, Manager, Reactor Engineering Date: 10-15-12

Approved: 
Chairman, PORC Date: 10-17-12

Approved: 
Plant Manager Date: 10/18/12



Table of Contents

Total Number of Pages = 51 (including review cover sheet)

List of Tables	iii
List of Figures	iv
Revision Log	v
Nomenclature	vi
References	viii
1 Introduction	11
1.1 Purpose	11
1.2 Scope	11
1.3 Fuel Loading	11
1.4 Acceptability	11
2 APLHGR Limits	13
2.1 Rated Power and Flow Limit: $APLHGR_{RATED}$	13
2.2 Off-Rated Power Dependent Limit: $APLHGR_P$	13
2.2.1 Startup without Feedwater Heaters	13
2.3 Off-Rated Flow Dependent Limit: $APLHGR_F$	13
2.4 Single Loop Operation Limit: $APLHGR_{SLO}$	13
2.5 Equipment Out-Of-Service Corrections	16
3 LHGR Limits	17
3.1 Rated Power and Flow Limit: $LHGR_{RATED}$	17
3.2 Off-Rated Power Dependent Limit: $LHGR_P$	17
3.2.1 Startup without Feedwater Heaters	17
3.3 Off-Rated Flow Dependent Limit: $LHGR_F$	18
3.4 Single Loop Operation Limit: $LHGR_{SLO}$	18
3.5 Equipment Out-Of-Service Corrections	18
4 OLMCPR Limits	29
4.1 Flow Dependent MCPR Limit: $MCPR_F$	29
4.2 Power Dependent MCPR Limit: $MCPR_P$	29
4.2.1 Startup without Feedwater Heaters	29
4.2.2 Scram Speed Dependent Limits (TSSS vs. NSS vs. OSS)	30
4.2.3 Exposure Dependent Limits	30
4.2.4 Equipment Out-Of-Service (EOOS) Options	31
4.2.5 Single-Loop-Operation (SLO) Limits	31
4.2.6 Below Pbypass Limits	31
5 Oscillation Power Range Monitor (OPRM) Setpoint	47
6 APRM Flow Biased Rod Block Trip Settings	48
7 Rod Block Monitor (RBM) Trip Setpoints and Operability	49
8 Shutdown Margin Limit	51



List of Tables

Nuclear Fuel Types.....	12
Startup Feedwater Temperature Basis	17
Nominal Scram Time Basis.....	30
MCPR _p Limits for Optimum Scram Time Basis: ATRIUM-10.....	33
MCPR _p Limits for Optimum Scram Time Basis: GE 14	34
MCPR _p Limits for ATRIUM-10: Nominal Scram Time Basis	35
MCPR _p Limits for GE 14: Nominal Scram Time Basis	37
MCPR _p Limits for ATRIUM-10: Technical Specification Scram Time Basis	39
MCPR _p Limits for GE 14: Technical Specification Scram Time Basis	41
Startup Operation MCPR _p Limits for Table 3.1 Temperature Range 1 for ATRIUM-10: Technical Specification Scram Time Basis	43
Startup Operation MCPR _p Limits for Table 3.1 Temperature Range 1 for GE 14: Technical Specification Scram Time Basis	44
Startup Operation MCPR _p Limits for Table 3.1 Temperature Range 2 for ATRIUM-10: Technical Specification Scram Time Basis	45
Startup Operation MCPR _p Limits for Table 3.1 Temperature Range 2 for GE 14: Technical Specification Scram Time Basis	46
OPRM Setpoint Range	47
Analytical RBM Trip Setpoints	49
RBM Setpoint Applicability	49
Control Rod Withdrawal Error Results	50



List of Figures

APLHGR _{RATED} for ATRIUM-10 Fuel	14
APLHGR _{RATED} for GE 14 Fuel	15
LHGR _{RATED} for ATRIUM-10 Fuel	19
LHGR _{RATED} for GE14 UO ₂ Fuel	20
Base Operation LHGRFAC _P for ATRIUM-10 Fuel	21
Base Operation LHGRFAC _P for GE 14 Fuel	22
LHGRFAC _F for ATRIUM-10 Fuel	23
LHGRFAC _F for GE 14 Fuel	24
Startup Operation LHGRFAC _P for ATRIUM-10 Fuel: Table 3.1 Temperature Range 1	25
Startup Operation LHGRFAC _P for ATRIUM-10 Fuel: Table 3.1 Temperature Range 2	26
Startup Operation LHGRFAC _P for GE 14 Fuel: Table 3.1 Temperature Range 1	27
Startup Operation LHGRFAC _P for GE 14 Fuel: Table 3.1 Temperature Range 2	28
MCPR _F for GE 14 and ATRIUM-10 Fuel	32



Revision Log

Number	Page	Description
0-R0	All	New document.



Nomenclature

APLHGR	Average Planar LHGR
APRM	Average Power Range Monitor
AREVA NP	Vendor (Framatome, Siemens)
BOC	Beginning of Cycle
BSP	Backup Stability Protection
BWR	Boiling Water Reactor
CAVEX	Core Average Exposure
CD	Coast Down
CMSS	Core Monitoring System Software
COLR	Core Operating Limits Report
CPR	Critical Power Ratio
CRWE	Control Rod Withdrawal Error
CSDM	Cold SDM
DIVOM	Delta CPR over Initial CPR vs. Oscillation Magnitude
EOC	End of Cycle
EOCLB	End-of-Cycle Licensing Basis
EOOS	Equipment OOS
FFTR	Final Feedwater Temperature Reduction
FFWTR	Final Feedwater Temperature Reduction
FHOOS	Feedwater Heaters OOS
ft	Foot: english unit of measure for length
GNF	Vendor (General Electric, Global Nuclear Fuels)
GWd	Giga Watt Day
HTSP	High TSP
ICA	Interim Corrective Action
ICF	Increased Core Flow (beyond rated)
IS	In-Service
kW	kilo watt: SI unit of measure for power.
LCO	License Condition of Operation
LFWH	Loss of Feedwater Heating
LHGRFAC	LHGR Multiplier (Power or Flow dependent)
LPRM	Low Power Range Monitor
LRNB	Generator Load Reject, No Bypass
MAPFAC	MAPLHGR multiplier (Power or Flow dependent)



M CPR	Minimum CPR
MSRV	Moisture Separator Reheater Valve
MSRVOOS	MSRV OOS
MTU	Metric Ton Uranium
MWd/MTU	Mega Watt Day per Metric Ton Uranium
NEOC	Near EOC
NRC	United States Nuclear Regulatory Commission
NSS	Nominal Scram Speed
NTSP	Nominal TSP
OLMCPR	M CPR Operating Limit
OOS	Out-Of-Service
OPRM	Oscillation Power Range Monitor
OSS	Optimum Scram Speed
PBDA	Period Based Detection Algorithm
Pbypass	Power, below which TSV Position and TCV Fast Closure Scrams are Bypassed
PLU	Power Load Unbalance
PLUOOS	PLU OOS
PRNM	Power Range Neutron Monitor
RBM	Rod Block Monitor
RPS	Reactor Protection System
RPT	Recirculation Pump Trip
RPTOOS	RPT OOS
SDM	Shutdown Margin
SLMCPR	M CPR Safety Limit
SLO	Single Loop Operation
TBV	Turbine Bypass Valve
TBVIS	TBV IS
TBVOOS	Turbine Bypass Valves OOS
TIP	Transversing In-core Probe
TIPOOS	TIP OOS
TLO	Two Loop Operation
TSP	Trip Setpoint
TSSS	Technical Specification Scram Speed
TVA	Tennessee Valley Authority



References

1. ANP-3123, Revision 0, **Browns Ferry Unit 1 Cycle 10 Reload Safety Report**, AREVA NP, Inc., August, 2012.
2. 0000-0113-6833-SRLR, Revision 1, **Supplemental Reload Licensing Report Browns Ferry 1 Reload 8 Cycle 9**, Global Nuclear Fuels, Inc., November 2010.
3. 0000-0113-6833-FBIR, Revision 0, **Fuel Bundle Information Report Browns Ferry 1 Reload 8 Cycle 9**, Global Nuclear Fuels, Inc., September 2010.
4. ANP-2628(P), Rev. 0, **Mechanical Design Report for Browns Ferry Units 1, 2, and 3 ATRIUM-10 Fuel Assemblies**, AREVA NP, Inc., October 2011.
5. ANP-3064(P) Revision 0, **Browns Ferry Unit 1 Cycle 10 Plant Parameters Document**, AREVA NP, Inc., June 2012.
6. BFE-3352, Revision 0, **Browns Ferry Unit 1 Cycle 10 Calculation File: Unit 1 Reload 9 Shuffle**, Tennessee Valley Authority, September 05, 2012.

Methodology References

7. NEDE-24011-P-A-16, **General Electric Standard Application for Reactor Fuel**, October 2007.
8. NEDE-24011-P-A-16-US, **General Electric Standard Application for Reactor Fuel (Supplement for United States)**, October 2007.
9. XN-NF-81-58(P)(A) Revision 2 and Supplements 1 and 2, **RODEX2 Fuel Rod Thermal-Mechanical Response Evaluation Model**, Exxon Nuclear Company, March 1984.
10. XN-NF-85-67(P)(A) Revision 1, **Generic Mechanical Design for Exxon Nuclear Jet Pump BWR Reload Fuel**, Exxon Nuclear Company, September 1986.
11. EMF-85-74(P) Revision 0 Supplement 1(P)(A) and Supplement 2(P)(A), **RODEX2A (BWR) Fuel Rod Thermal-Mechanical Evaluation Model**, Siemens Power Corporation, February 1998.
12. ANF-89-98(P)(A) Revision 1 and Supplement 1, **Generic Mechanical Design Criteria for BWR Fuel Designs**, Advanced Nuclear Fuels Corporation, May 1995.
13. XN-NF-80-19(P)(A) Volume 1 and Supplements 1 and 2, **Exxon Nuclear Methodology for Boiling Water Reactors - Neutronic Methods for Design and Analysis**, Exxon Nuclear Company, March 1983.
14. XN-NF-80-19(P)(A) Volume 4 Revision 1, **Exxon Nuclear Methodology for Boiling Water Reactors: Application of the ENC Methodology to BWR Reloads**, Exxon Nuclear Company, June 1986.
15. EMF-2158(P)(A) Revision 0, **Siemens Power Corporation Methodology for Boiling Water Reactors: Evaluation and Validation of CASMO-4/MICROBURN-B2**, Siemens Power Corporation, October 1999.



-
16. XN-NF-80-19(P)(A) Volume 3 Revision 2, **Exxon Nuclear Methodology for Boiling Water Reactors, THERMEX: Thermal Limits Methodology Summary Description**, Exxon Nuclear Company, January 1987.
 17. XN-NF-84-105(P)(A) Volume 1 and Volume 1 Supplements 1 and 2, **XCOBRA-T: A Computer Code for BWR Transient Thermal-Hydraulic Core Analysis**, Exxon Nuclear Company, February 1987.
 18. ANF-524(P)(A) Revision 2 and Supplements 1 and 2, **ANF Critical Power Methodology for Boiling Water Reactors**, Advanced Nuclear Fuels Corporation, November 1990.
 19. ANF-913(P)(A) Volume 1 Revision 1 and Volume 1 Supplements 2, 3 and 4, **COTRANSA2: A Computer Program for Boiling Water Reactor Transient Analyses**, Advanced Nuclear Fuels Corporation, August 1990.
 20. ANF-1358(P)(A) Revision 3, **The Loss of Feedwater Heating Transient in Boiling Water Reactors**, Advanced Nuclear Fuels Corporation, September 2005.
 21. EMF-2209(P)(A) Revision 3, **SPCB Critical Power Correlation**, AREVA NP Inc., September 2009.
 22. EMF-2245(P)(A) Revision 0 **Application of Siemens Power Corporation's Critical Power Correlations to Co-Resident Fuel**, Siemens Power Corporation, August 2000.
 23. EMF-2361(P)(A) Revision 0, **EXEM BWR-2000 ECCS Evaluation Model**, Framatome ANP Inc., May 2001, as supplemented by the site specific approval in NRC safety evaluation dated April 27, 2012.
 24. EMF-2292(P)(A) Revision 0, **ATRIUM™-10: Appendix K Spray Heat Transfer Coefficients**, Siemens Power Corporation, September 2000.
 25. EMF-CC-074(P)(A), Volume 4, Revision 0, **BWR Stability Analysis: Assessment of STAIF with Input from MICROBURN-B2**, Siemens Power Corporation, August 2000.
 26. BAW-10255(P)(A), Revision 2, **Cycle-Specific DIVOM Methodology Using the RAMONA5-FA Code**, AREVA NP Inc., Inc., May, 2008.

PRNM Setpoint References

27. Filtered Setpoints - EDE-28-0990 Rev. 3 Supplement E, "PRNM (APRM, RBM, and RFM) Setpoint Calculations [ARTS/MELLL (NUMAC) - Power-Uprate Condition] for Tennessee Valley Authority Browns Ferry Nuclear Plant", October 1997.
28. Unfiltered Setpoints - EDE-28-0990 Rev. 2 Supplement E, "PRNM (APRM, RBM, and RFM) Setpoint Calculations [ARTS/MELLL (NUMAC) - Power-Uprate Condition] for Tennessee Valley Authority Browns Ferry Nuclear Plant", October 1997.
29. GE Letter LB#: 262-97-133, Browns Ferry Nuclear Plant Rod Block Monitor Setpoint Clarification - GE Proprietary Information, September 12, 1997.



-
30. **NEDC-32433P, Maximum Extended Load Line Limit and ARTS Improvement Program Analyses for Browns Ferry Nuclear Plant Unit 1, 2, and 3, GE Nuclear Energy, April 1995.**



1 Introduction

In anticipation of cycle startup, it is necessary to describe the expected limits of operation.

1.1 Purpose

The primary purpose of this document is to satisfy requirements identified by unit technical specification section 5.6.5. This document may be provided, upon final approval, to the NRC.

1.2 Scope

This document will discuss the following areas:

- Average Planar Linear Heat Generation Rate (APLHGR) Limit
(Technical Specifications 3.2.1 and 3.7.5)
- Linear Heat Generation Rate (LHGR) Limit
(Technical Specification 3.2.3, 3.3.4.1, and 3.7.5)
- Minimum Critical Power Ratio Operating Limit (OLMCPR)
(Technical Specifications 3.2.2, 3.3.4.1, and 3.7.5)
- Oscillation Power Range Monitor (OPRM) Setpoint
(Technical Specification Table 3.3.1.1)
- Average Power Range Monitor (APRM) Flow Biased Rod Block Trip Setting
(Technical Requirements Manual Section 5.3.1 and Table 3.3.4-1)
- Rod Block Monitor (RBM) Trip Setpoints and Operability
(Technical Specification Table 3.3.2.1-1)
- Shutdown Margin (SDM) Limit
(Technical Specification 3.1.1)

1.3 Fuel Loading

The core will contain previously exposed GNF GE14 fuel, and fresh AREVA NP, Inc., ATRIUM-10 fuel. Nuclear fuel types used in the core loading are shown in Table 1.1. The core shuffle and final loading were explicitly evaluated for BOC cold shutdown margin performance as documented in Reference 6.

1.4 Acceptability

Limits discussed in this document were generated based on NRC approved methodologies per References 7 through 26.



Table 1.1 Nuclear Fuel Types*

Fuel Description	Original Cycle	Number of Assemblies	Nuclear Fuel Type (NFT)	Fuel Names (Range)
GE14-P10DNAB406-16GZ-100T-150-T6-3078	8	40	14	JYE101-JYE148
GE14-P10DNAB400-17GZ-100T-150-T6-3081	8	64	15	JYE149-JYE244
GE14-P10DNAB406-15GZ-100T-150-T6-3079	8	49	16	JYE245-JYE308
GE14-P10DNAB417-16GZ-100T-150-T6-3082	8	32	17	JYE309-JYE356
GE14-P10DNAB418-16GZ-100T-150-T6-3080	8	48	18	JYE357-JYE428
GE14-P10DNAB408-16GZ-100T-150-T6-3363	9	179	1	JYP101-JYP280
GE14-P10DNAB412-16GZ-100T-150-T6-3364	9	40	2	JYP281-JYP320
GE14-P10DNAB404-15GZ-100T-150-T6-3365	9	16	8	JYP321-JYP336
GE14-P10DNAB408-17GZ-100T-150-T6-3366	9	16	19	JYP337-JYP352
ATRIUM-10 A10-3562B-14GV80-FAA	10	168	20	FAA001-FAA168
ATRIUM-10 A10-3676B-10GV80-FAA	10	24	21	FAA169-FAA192
ATRIUM-10 A10-4111B-15GV80-FAA	10	88	22	FAA193-FAA280

* The table identifies the expected fuel type breakdown in anticipation of final core loading. The final composition of the core depends upon uncertainties during the outage such as discovering a failed fuel bundle, or other bundle damage. Minor core loading changes, due to unforeseen events, will conform to the safety and monitoring requirements identified in this document.



2 APLHGR Limits

(Technical Specifications 3.2.1 & 3.7.5)

The APLHGR limit is determined by adjusting the rated power APLHGR limit for off-rated power, off-rated flow, and SLO conditions. The most limiting of these is then used as follows:

$$\text{APLHGR limit} = \text{MIN} (\text{APLHGR}_P , \text{APLHGR}_F, \text{APLHGR}_{\text{SLO}})$$

where:

APLHGR _P	off-rated power APLHGR limit	[APLHGR _{RATED} * MAPFAC _P]
APLHGR _F	off-rated flow APLHGR limit	[APLHGR _{RATED} * MAPFAC _F]
APLHGR _{SLO}	SLO APLHGR limit	[APLHGR _{RATED} * SLO Multiplier]

2.1 Rated Power and Flow Limit: APLHGR_{RATED}

The rated conditions APLHGR for ATRIUM-10 fuel is identified in Reference 1 and shown in Figure 2.1; for GE 14 fuel is identified in Reference 2, and shown in Figure 2.2.

2.2 Off-Rated Power Dependent Limit: APLHGR_P

Reference 1, for both GE14 and ATRIUM-10 fuel, does not specify a power dependent APLHGR. Therefore, MAPFAC_P is set to a value of 1.0.

2.2.1 Startup without Feedwater Heaters


There is a range of operation during startup when the feedwater heaters are not placed into service until after the unit has reached a significant operating power level. No Additional power dependent limitation is required.

2.3 Off-Rated Flow Dependent Limit: APLHGR_F

Reference 1, for GE14 and ATRIUM-10 fuel, does not specify a flow dependent APLHGR. Therefore, MAPFAC_F is set to a value of 1.0.


2.4 Single Loop Operation Limit: APLHGR_{SLO}

The single loop operation multiplier for ATRIUM-10 fuel is 0.85, per Reference 1; for GE 14 fuel the multiplier is 0.93 per Reference 2.

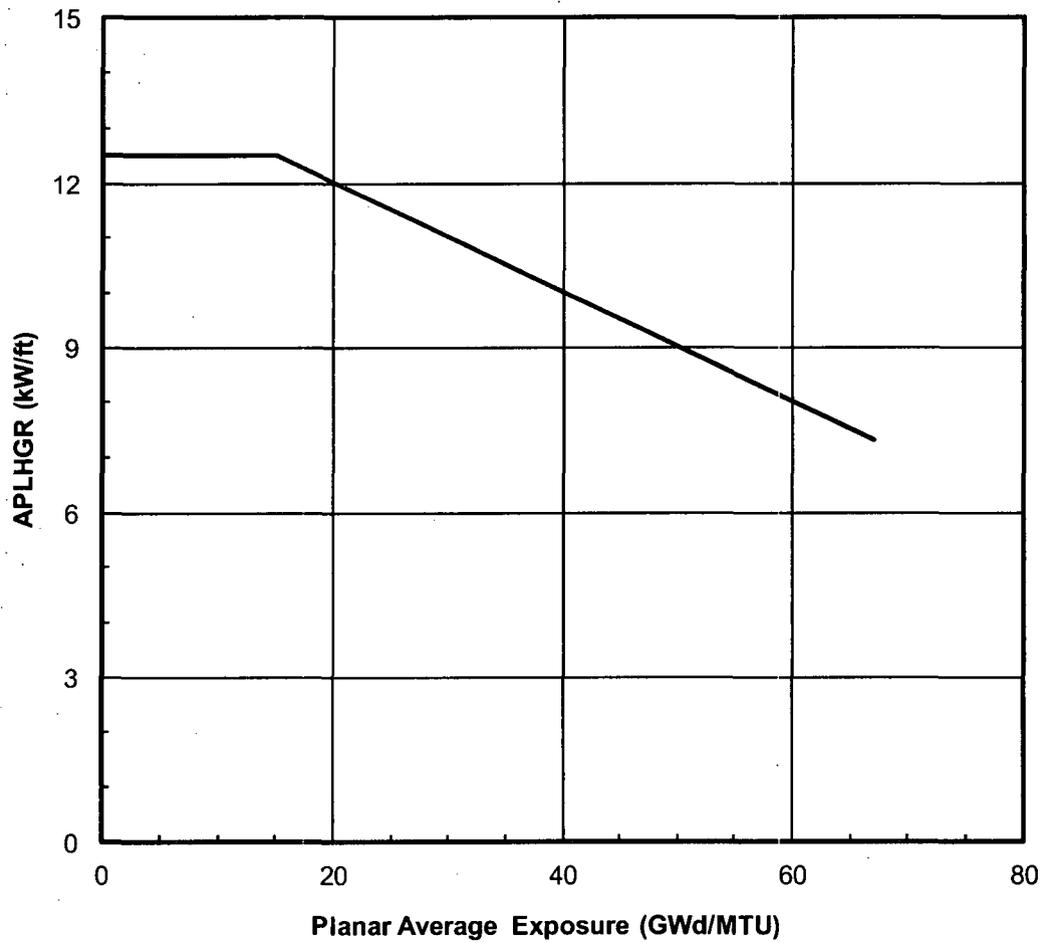

Planar Avg. Exposure (GWd/MTU)	APLHGR Limit (kW/ft)
0.0	12.5
15.0	12.5
67.0	7.3

Figure 2.1 APLHGR_{RATED} for ATRIUM-10 Fuel

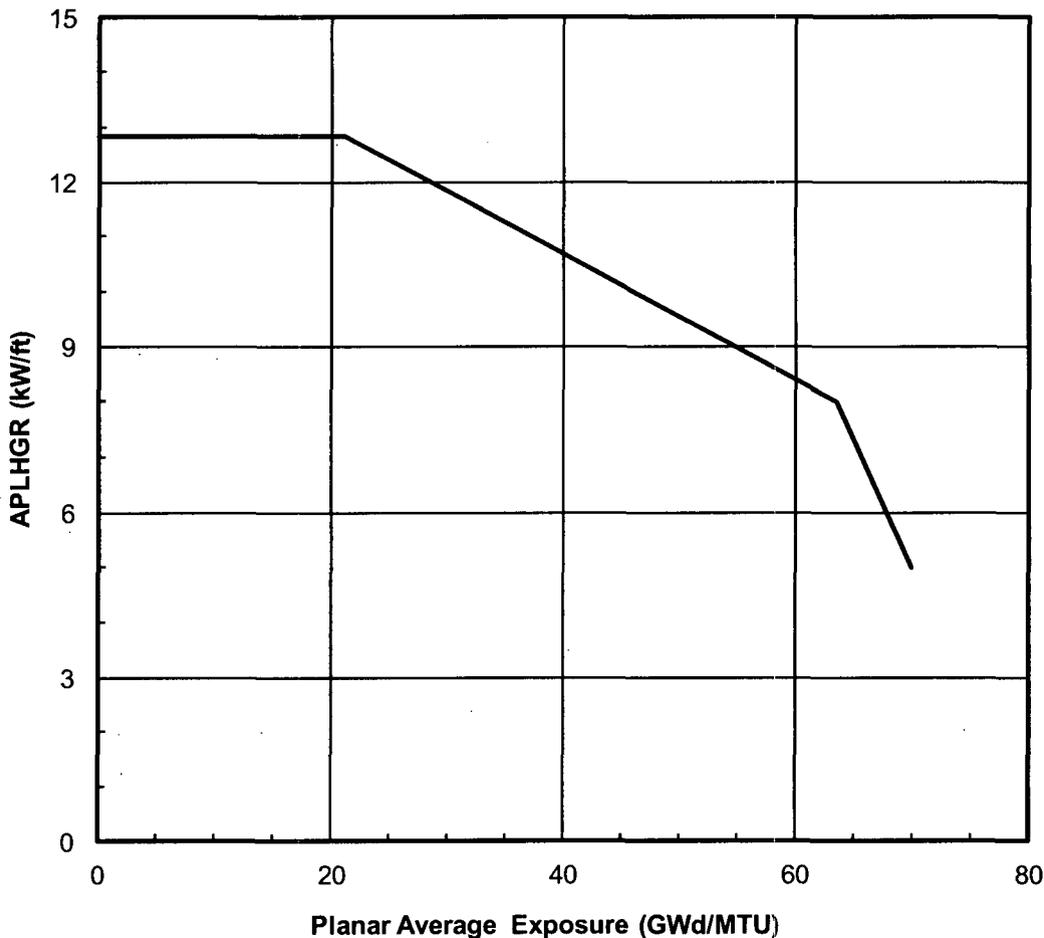

Planar Avg. Exposure (GWd/MTU)	APLHGR Limit (kW/ft)
0.00	12.82
21.09	12.82
63.50	8.00
70.00	5.00

Figure 2.2 APLHGR_{RATED} for GE 14 Fuel



2.5 Equipment Out-Of-Service Corrections

The limits shown in Figure 2.1 and Figure 2.2 are applicable for operation with all equipment In-Service as well as the following Equipment Out-Of-Service (EOOS) options; including combinations of the options.

In-Service	All equipment In-Service*
RPTOOS	EOC-Recirculation Pump Trip Out-Of-Service
TBVOOS	Turbine Bypass Valve(s) Out-Of-Service
PLUOOS	Power Load Unbalance Out-Of-Service
FHOOS (or FFWTR)	Feedwater Heaters Out-Of-Service or Final Feedwater Temperature Reduction

Single Recirculation Loop Operation (SLO) requires the application of the SLO multipliers to the rated APLHGR limits as described previously.

* All equipment service conditions assume 1 SRVOOS.



3 LHGR Limits

(Technical Specification 3.2.3, 3.3.4.1, & 3.7.5)

The LHGR limit is determined by adjusting the rated power LHGR limit for off-rated power and off-rated flow conditions. The most limiting of these is then used as follows:

$$\text{LHGR limit} = \text{MIN} (\text{LHGR}_P , \text{LHGR}_F)$$

where:

LHGR _P	off-rated power LHGR limit	[LHGR _{RATED} * LHGRFAC _P]
LHGR _F	off-rated flow LHGR limit	[LHGR _{RATED} * LHGRFAC _F]
LHGR _{SLO}	SLO LHGR limit	[LHGR _{RATED} * SLO Multiplier]

3.1 Rated Power and Flow Limit: LHGR_{RATED}

The rated conditions LHGR for ATRIUM-10 fuel is identified in Reference 1 and shown in Figure 3.1; for GE 14 fuel, is identified in Reference 3, and shown in Figure 3.2 for UO₂ fuel. Separate, concentration dependent limits apply for rods containing Gadolinium; LHGR limits are provided in Reference 3.

3.2 Off-Rated Power Dependent Limit: LHGR_P

LHGR limits are adjusted for off-rated power conditions using the LHGRFAC_P multiplier provided in Reference 1, for both ATRIUM-10 and GE 14 fuel. The multiplier is split into two sub cases: turbine bypass valves in and out-of-service. The multipliers are shown in Figure 3.3 and Figure 3.4.

3.2.1 Startup without Feedwater Heaters

There is a range of operation during startup when the feedwater heaters are not placed into service until after the unit has reached a significant operating power level. Additional limits are shown in Figure 3.7 and Figure 3.8, based on temperature conditions identified in Table 3.1.

Table 3.1 Startup Feedwater Temperature Basis

Power (% Rated)	Temperature	
	Range 1 (°F)	Range 2 (°F)
25	160.0	155.0
30	165.0	160.0
40	175.0	170.0
50	185.0	180.0



3.3 Off-Rated Flow Dependent Limit: $LHGR_F$

LHGR limits are adjusted for off-rated flow conditions using the $LHGRFAC_F$ multiplier provided in Reference 1, for both ATRIUM-10 and GE 14 fuel. Multiplier are shown in Figure 3.5 and Figure 3.6.

3.4 Single Loop Operation Limit: $LHGR_{SLO}$

The single loop operation multiplier is **0.93**, per Reference 2 for GE 14 fuel. There is no single loop operation restriction for ATRIUM-10; therefore the multiplier is **1.0**.

3.5 Equipment Out-Of-Service Corrections

The limits shown in Figure 3.1 and Figure 3.2 are applicable for operation with all equipment In-Service as well as the following Equipment Out-Of-Service (EOOS) options; including combinations of the options.*


In-Service	All equipment In-Service
RPTOOS	EOC-Recirculation Pump Trip Out-Of-Service
TBVOOS	Turbine Bypass Valve(s) Out-Of-Service
PLUOOS	Power Load Unbalance Out-Of-Service
FHOOS (or FFWTR)	Feedwater Heaters Out-Of-Service or Final Feedwater Temperature Reduction
SLO	Single Loop Operation, One Recirculation Pump Out-Of-Service

Off-rated power corrections shown in Figure 3.3 and Figure 3.4 are dependent on operation of the Turbine Bypass Valve system. For this reason, separate limits are to be applied for TBVIS or TBVOOS operation. The limits have no dependency on RPTOOS, PLUOOS, FHOOS/FFWTR, or SLO.

Off-rated flow corrections shown in Figure 3.5 and Figure 3.6 are bounding for all EOOS conditions.


Off-rated power corrections shown in Figure 3.7 through Figure 3.10 are also dependent on operation of the Turbine Bypass Valve system. In this case, limits support FHOOS operation during startup. These limits have no dependency on RPTOOS, PLUOOS, or SLO.

* All equipment service conditions assume 1 SRVOOS.

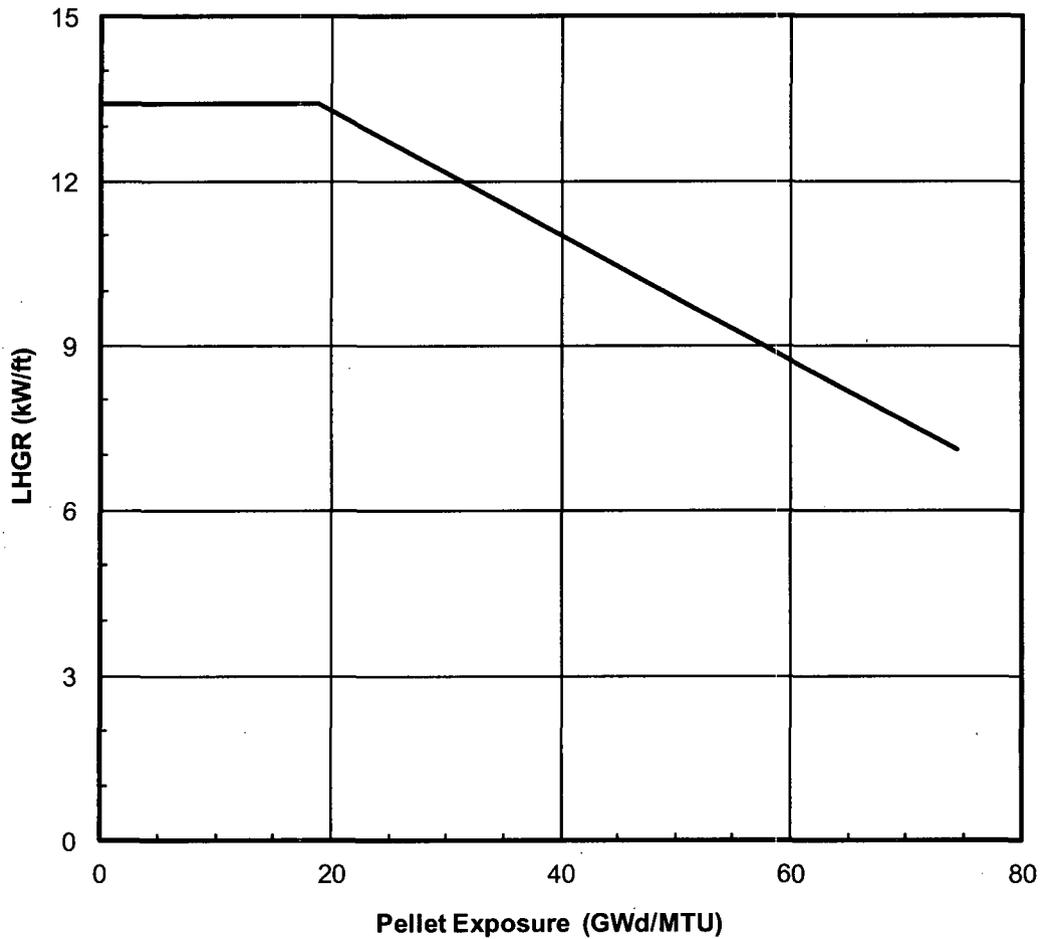


Pellet Exposure (GWd/MTU)	LHGR Limit (kW/ft)
0.0	13.4
18.9	13.4
74.4	7.1

Figure 3.1 LHGR_{RATED} for ATRIUM-10 Fuel

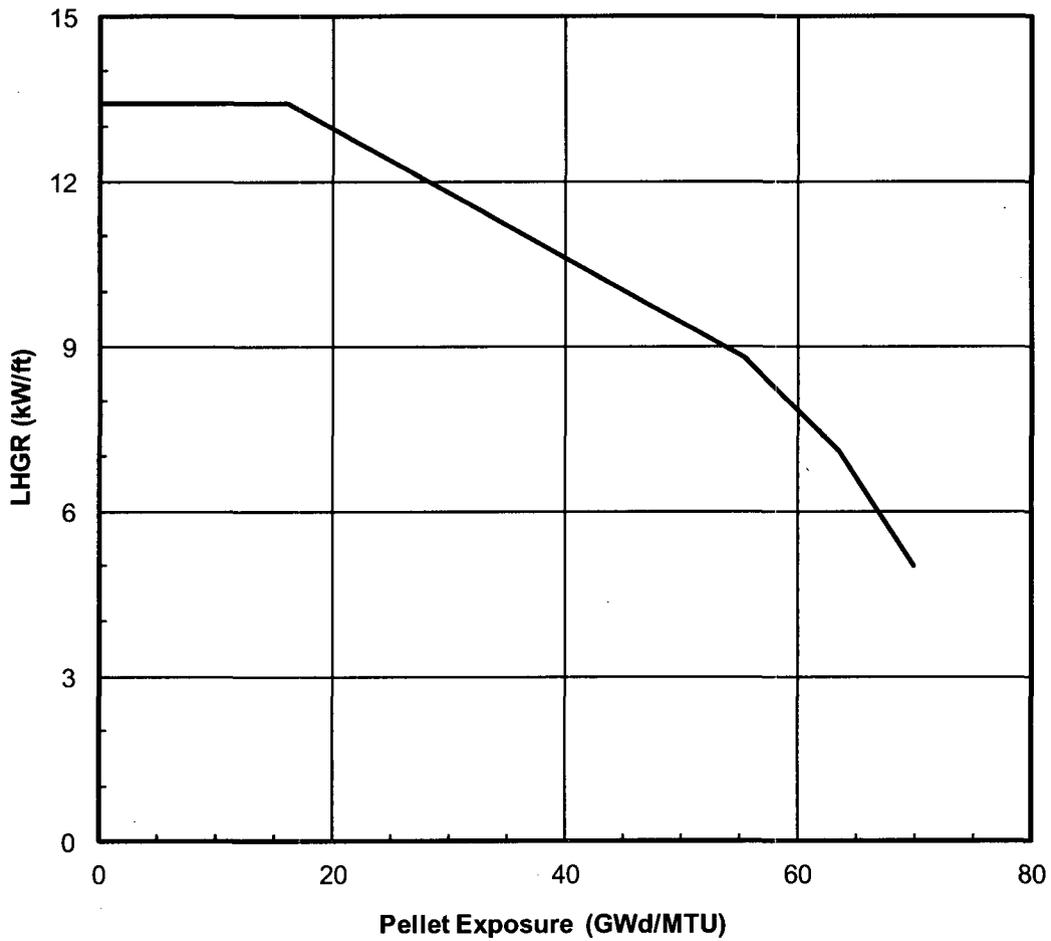


Pellet Exposure (GWd/MTU)	LHGR Limit (kW/ft)
0.00	13.40
16.00	13.40
55.50	8.80
63.50	7.10
70.00	5.00

Figure 3.2 LHGR_{RATED} for GE14 UO₂ Fuel

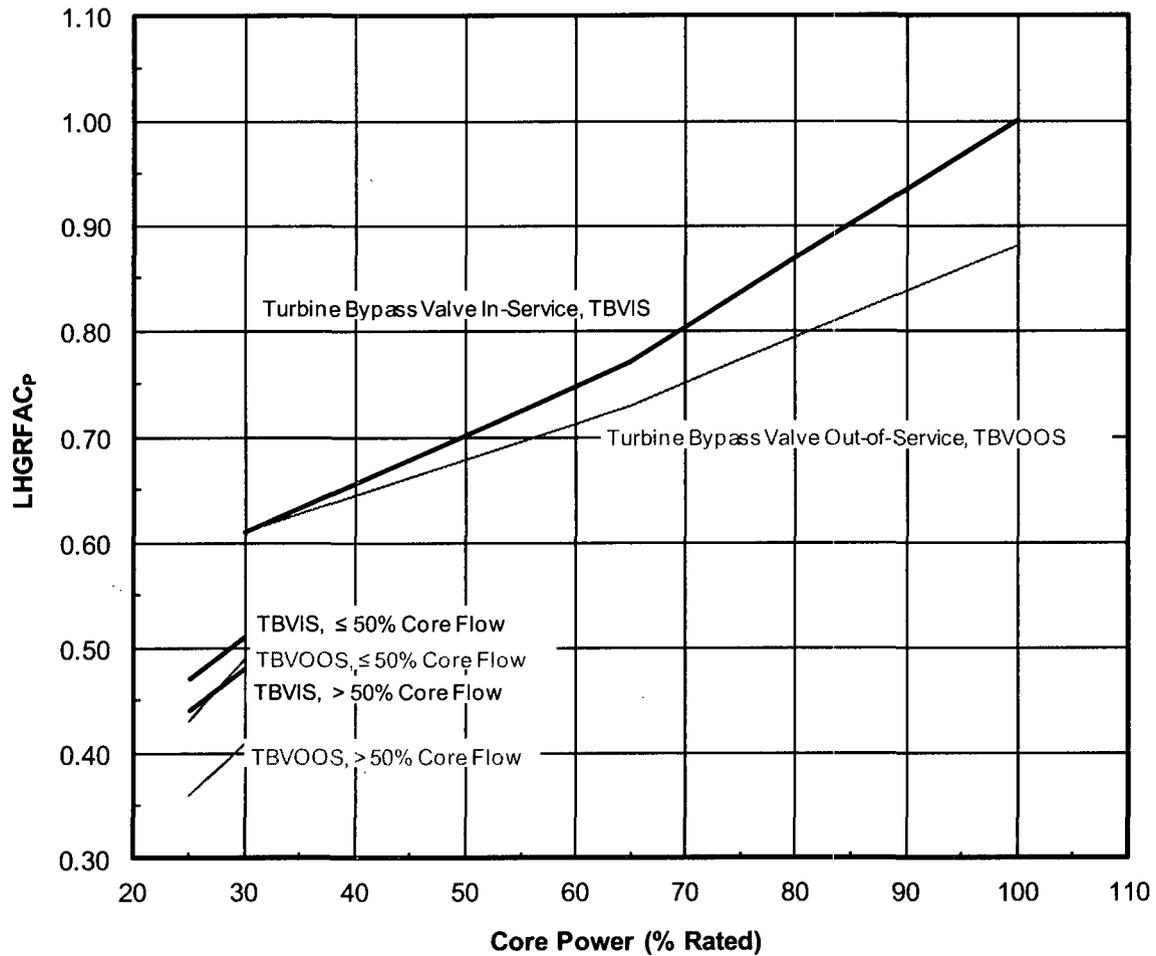


<i>Turbine Bypass In-Service</i>		<i>Turbine Bypass Out-of-Service</i>	
Core Power	LHGRFAC_p	Core Power	LHGRFAC_p
(% Rated)		(% Rated)	
100.0	1.00	100.0	0.88
65.0	0.77	65.0	0.73
30.0	0.61	30.0	0.61
Core Flow > 50% Rated		Core Flow > 50% Rated	
30.0	0.48	30.0	0.41
25.0	0.44	25.0	0.36
Core Flow ≤ 50% Rated		Core Flow ≤ 50% Rated	
30.0	0.51	30.0	0.49
25.0	0.47	25.0	0.43

Figure 3.3 Base Operation LHGRFAC_p for ATRIUM-10 Fuel
(Independent of other EOOS conditions)

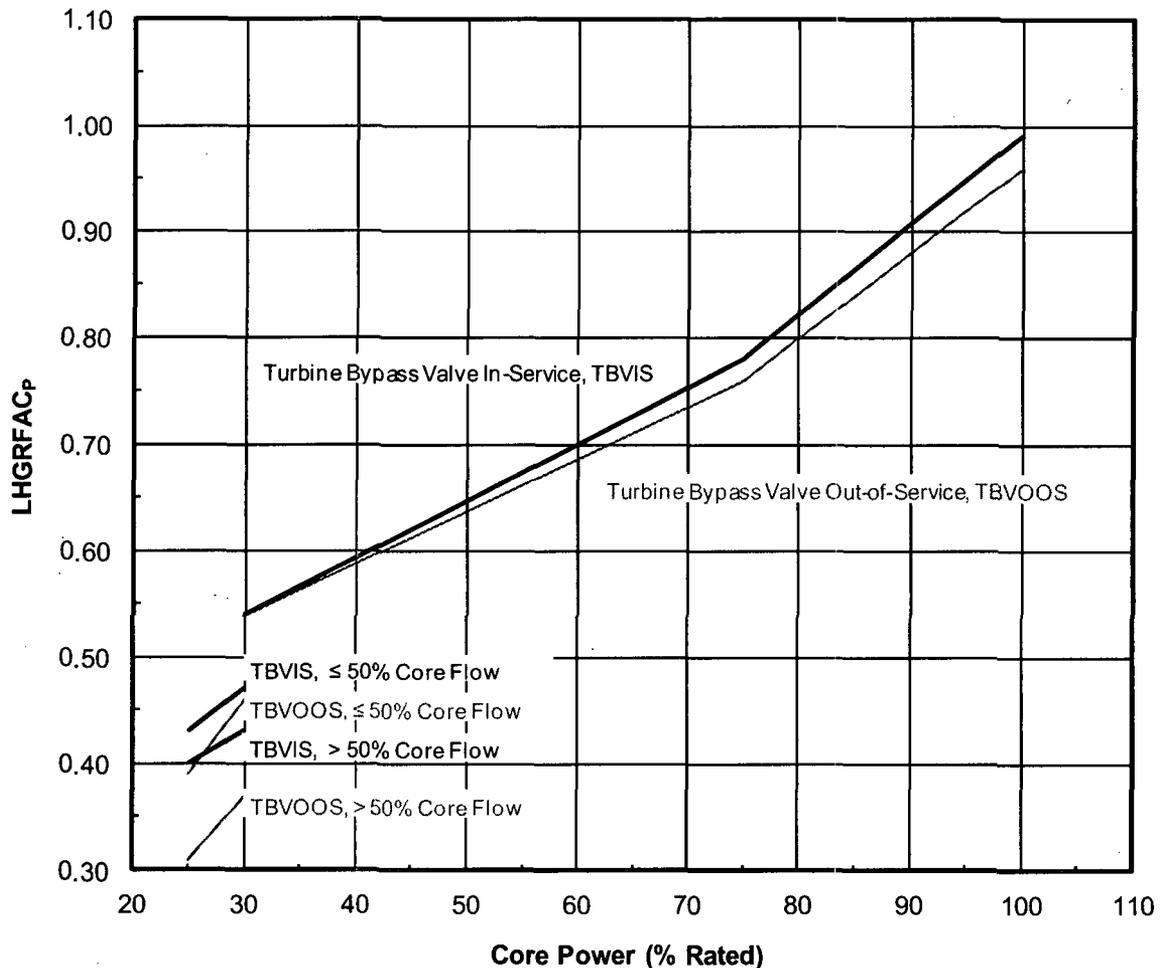

<i>Turbine Bypass In-Service</i>		<i>Turbine Bypass Out-of-Service</i>	
Core Power	LHGRFAC_p	Core Power	LHGRFAC_p
(% Rated)		(% Rated)	
100.0	0.99	100.0	0.96
75.0	0.78	75.0	0.76
30.0	0.54	30.0	0.54
Core Flow > 50% Rated		Core Flow > 50% Rated	
30.0	0.43	30.0	0.37
25.0	0.40	25.0	0.31
Core Flow ≤ 50% Rated		Core Flow ≤ 50% Rated	
30.0	0.47	30.0	0.46
25.0	0.43	25.0	0.39


Figure 3.4 Base Operation LHGRFAC_p for GE 14 Fuel
 (Independent of other EOOS conditions)

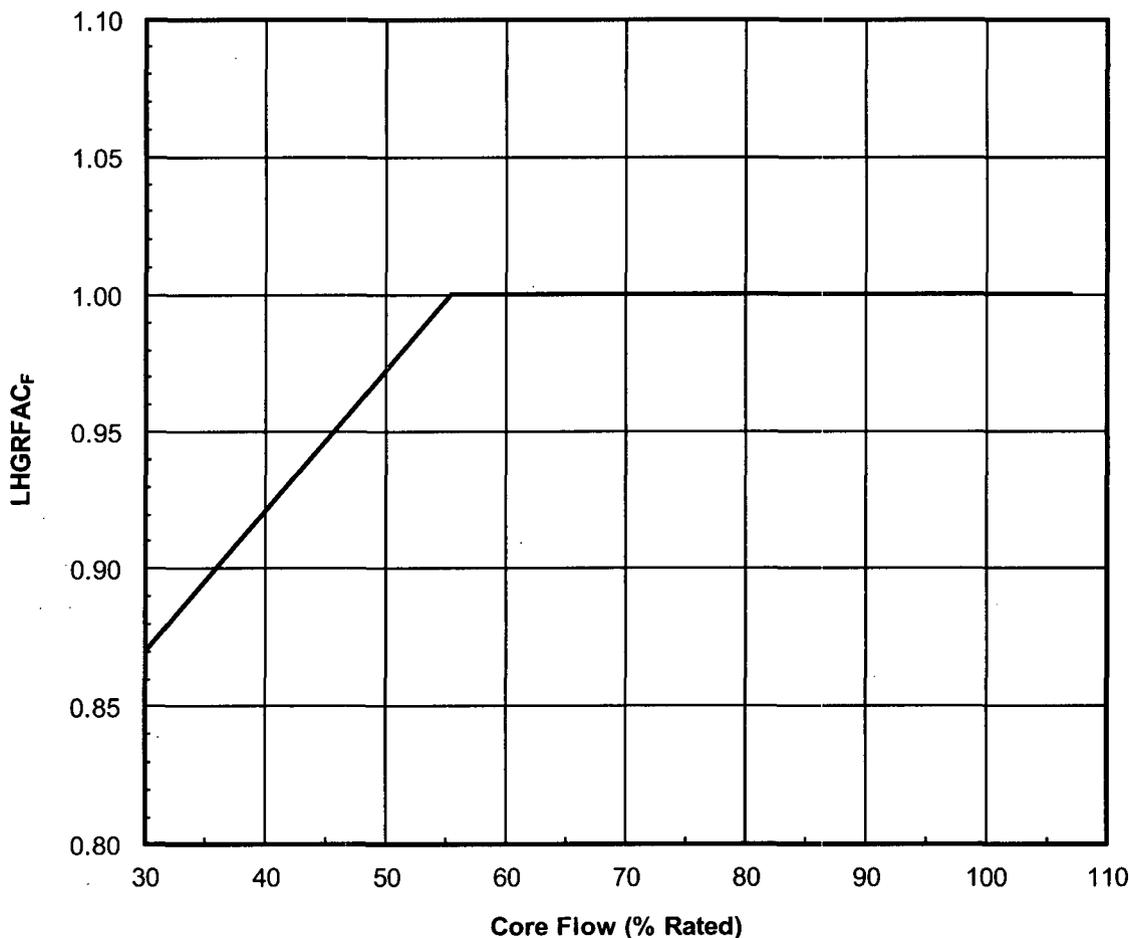

Core Flow (% Rated)	LHGRFAC _F
30.0	0.87
55.4	1
107.0	1

Figure 3.5 LHGRFAC_F for ATRIUM-10 Fuel
(Values bound all EOO conditions)


(107.0% maximum core flow line is used to support 105% rated flow operation, ICF)

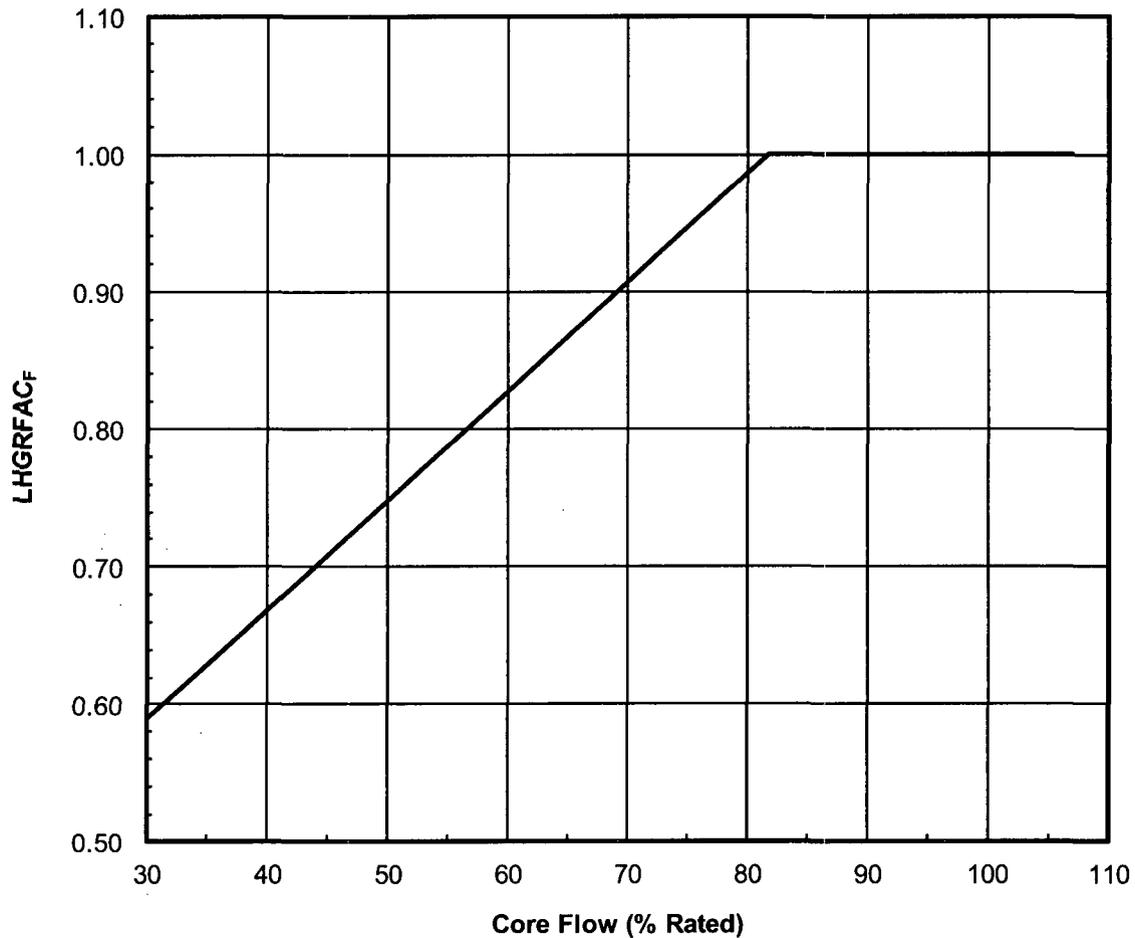

Core Flow (% Rated)	LHGRFAC _F
30.0	0.59
81.8	1
107.0	1


Figure 3.6 LHGRFAC_F for GE 14 Fuel
 (Values bound all EOOS conditions)

(107.0% maximum core flow line is used to support 105% rated flow operation, ICF)

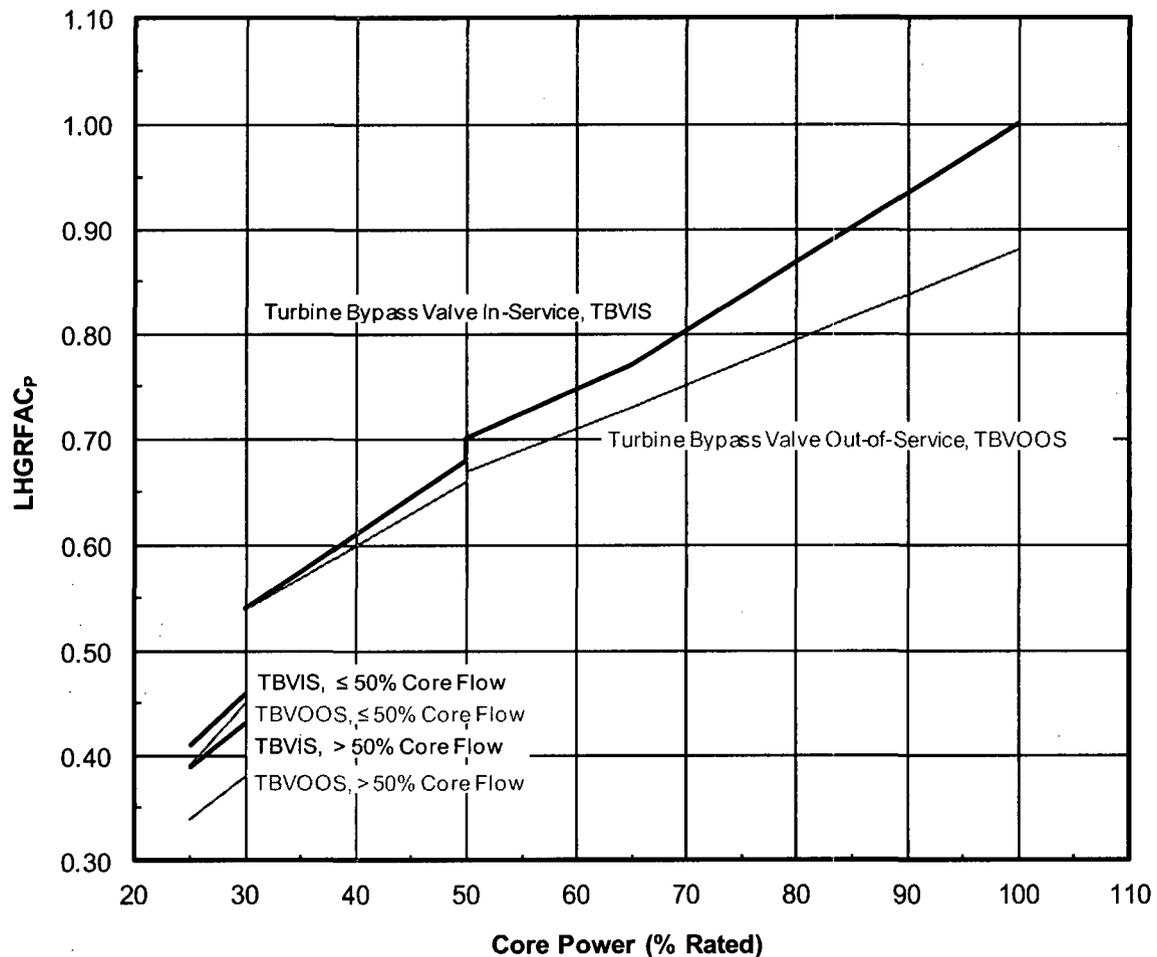

<i>Turbine Bypass In-Service</i>		<i>Turbine Bypass Out-of-Service</i>	
Core		Core	
Power	LHGRFAC_p	Power	LHGRFAC_p
(% Rated)		(% Rated)	
100.0	1.00	100.0	0.88
65.0	0.77	65.0	0.73
50.0	0.70	50.0	0.67
50.0	0.68	50.0	0.66
30.0	0.54	30.0	0.54
Core Flow > 50% Rated		Core Flow > 50% Rated	
30.0	0.43	30.0	0.38
25.0	0.39	25.0	0.34
Core Flow ≤ 50% Rated		Core Flow ≤ 50% Rated	
30.0	0.46	30.0	0.45
25.0	0.41	25.0	0.39


Figure 3.7 Startup Operation LHGRFAC_p for ATRIUM-10 Fuel:
 Table 3.1 Temperature Range 1
 (no Feedwater heating during startup)

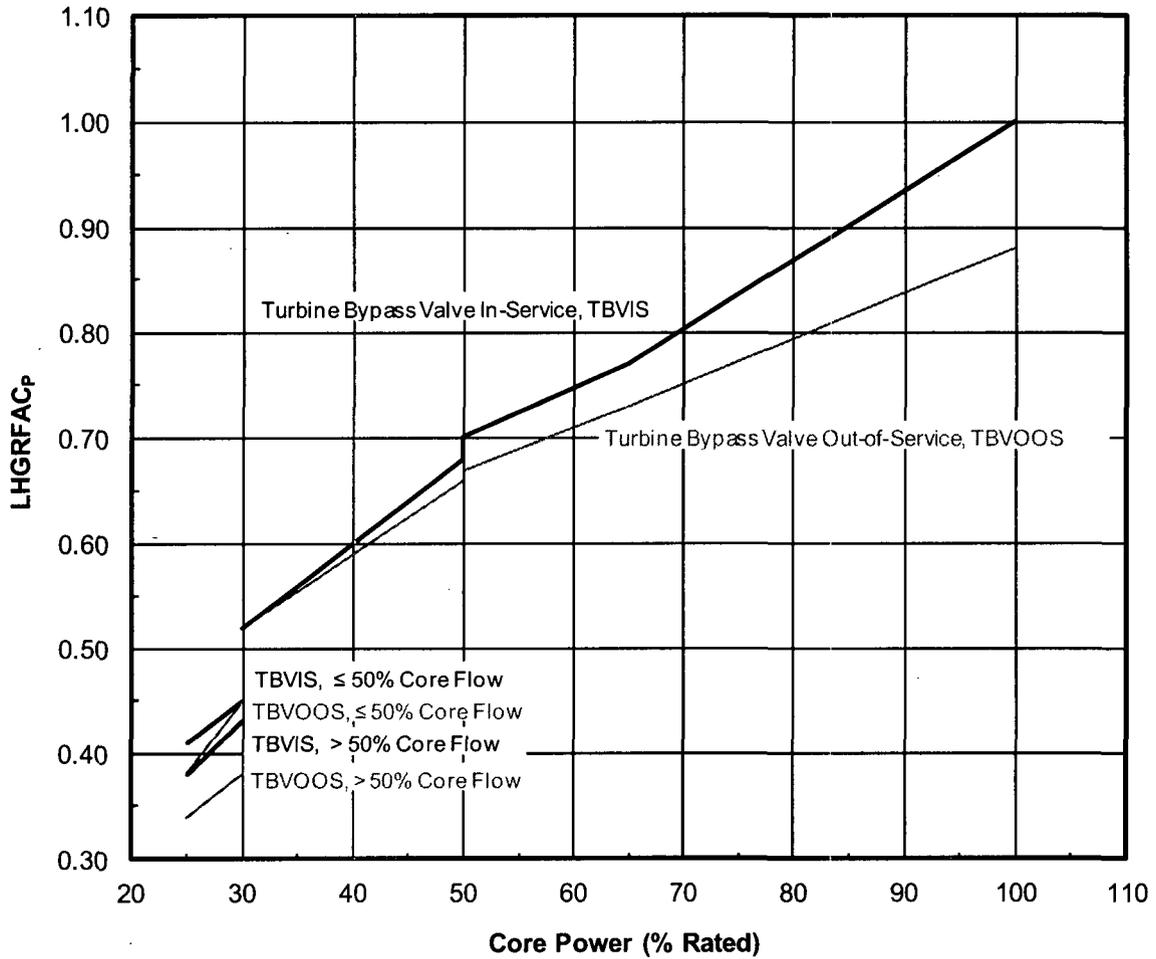

<i>Turbine Bypass In-Service</i>	
Core Power	LHGRFAC _p
(% Rated)	
100.0	1.00
65.0	0.77
50.0	0.70
50.0	0.68
30.0	0.52
Core Flow > 50% Rated	
30.0	0.43
25.0	0.38
Core Flow ≤ 50% Rated	
30.0	0.45
25.0	0.41

<i>Turbine Bypass Out-of-Service</i>	
Core Power	LHGRFAC _p
(% Rated)	
100.0	0.88
65.0	0.73
50.0	0.67
50.0	0.66
30.0	0.52
Core Flow > 50% Rated	
30.0	0.38
25.0	0.34
Core Flow ≤ 50% Rated	
30.0	0.45
25.0	0.38


Figure 3.8 Startup Operation LHGRFAC_p for ATRIUM-10 Fuel:
Table 3.1 Temperature Range 2
(no Feedwater heating during startup)

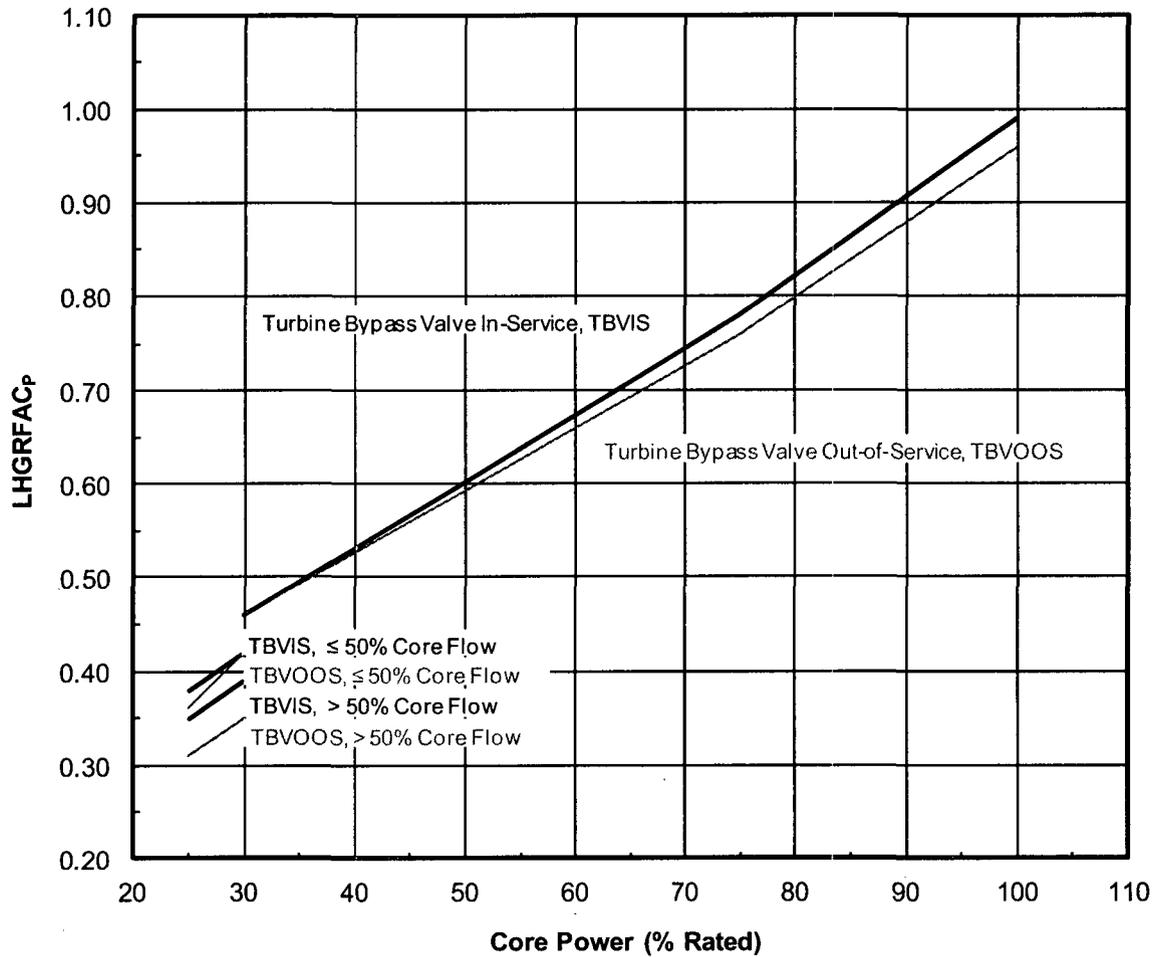

<i>Turbine Bypass In-Service</i>	
Core Power	LHGRFAC _p
(% Rated)	
100.0	0.99
75.0	0.78
30.0	0.46
<i>Core Flow > 50% Rated</i>	
30.0	0.39
25.0	0.35
<i>Core Flow ≤ 50% Rated</i>	
30.0	0.42
25.0	0.38

<i>Turbine Bypass Out-of-Service</i>	
Core Power	LHGRFAC _p
(% Rated)	
100.0	0.96
75.0	0.76
30.0	0.46
<i>Core Flow > 50% Rated</i>	
30.0	0.35
25.0	0.31
<i>Core Flow ≤ 50% Rated</i>	
30.0	0.42
25.0	0.36

Figure 3.9 Startup Operation LHGRFAC_p for GE 14 Fuel:
Table 3.1 Temperature Range 1
(no Feedwater heating during startup)

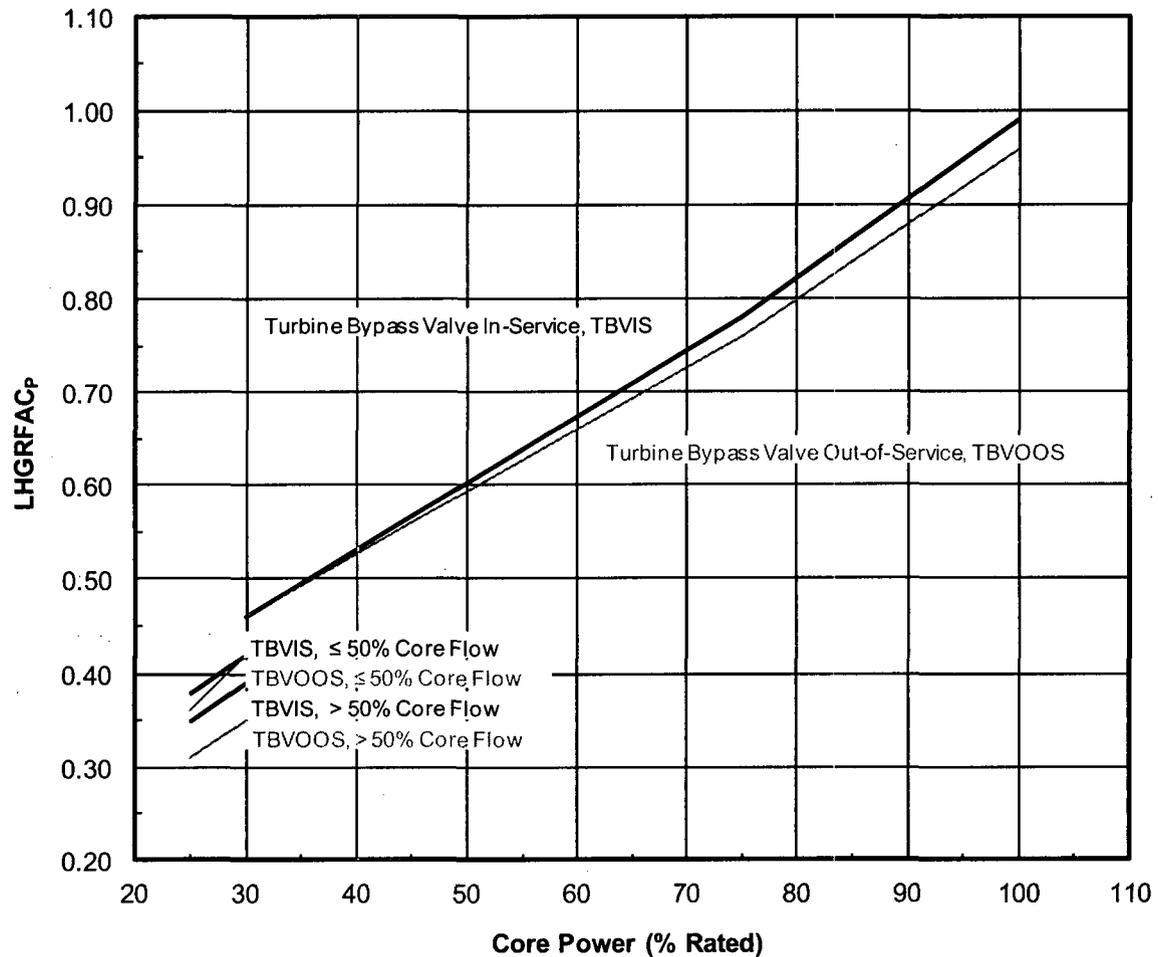

<i>Turbine Bypass In-Service</i>		<i>Turbine Bypass Out-of-Service</i>	
Core Power	LHGRFAC_p	Core Power	LHGRFAC_p
(% Rated)		(% Rated)	
100.0	0.99	100.0	0.96
75.0	0.78	75.0	0.76
30.0	0.46	30.0	0.46
Core Flow > 50% Rated		Core Flow > 50% Rated	
30.0	0.39	30.0	0.35
25.0	0.35	25.0	0.31
Core Flow ≤ 50% Rated		Core Flow ≤ 50% Rated	
30.0	0.42	30.0	0.42
25.0	0.38	25.0	0.36

Figure 3.10 Startup Operation LHGRFAC_p for GE 14 Fuel:
 Table 3.1 Temperature Range 2
 (no Feedwater heating during startup)



4 OLMCPR Limits

(Technical Specification 3.2.2, 3.3.4.1, & 3.7.5)

OLMCPR is calculated to be the most limiting of the flow or power dependent values

$$\text{OLMCPR limit} = \text{MAX} (\text{MCPR}_F , \text{MCPR}_P)$$

where:

MCPR_F	core flow-dependent MCPR limit
MCPR_P	power-dependent MCPR limit

4.1 Flow Dependent MCPR Limit: MCPR_F

MCPR_F limits are dependent upon core flow (% of Rated), and the max core flow limit, (Rated or Increased Core Flow, ICF). MCPR_F limits are shown in Figure 4.1, per Reference 1. Limits are valid for all EOOS combinations. No adjustment is required for SLO conditions.

4.2 Power Dependent MCPR Limit: MCPR_P

MCPR_P limits are dependent upon:

- Core Power Level (% of Rated)
- Technical Specification Scram Speed (TSSS), Nominal Scram Speed (NSS), or Optimum Scram Speed (OSS)
- Cycle Operating Exposure (NEOC, EOC, and CD - as defined in this section)
- Equipment Out-Of-Service Options
- Two or Single recirculation Loop Operation (TLO vs. SLO)

The MCPR_P limits are provided in the following tables, where each table contains the limits for all fuel types and EOOS options (for a specified scram speed and exposure range). The CMSS determines MCPR_P limits, from these tables, based on linear interpolation between the specified powers.

4.2.1 Startup without Feedwater Heaters

There is a range of operation during startup when the feedwater heaters are not placed into service until after the unit has reached a significant operating power level. Additional power dependent limits are shown in Table 4.8, Table 4.9, Table 4.10, and Table 4.11, based on temperature conditions identified in Table 3.1.



4.2.2 Scram Speed Dependent Limits (TSSS vs. NSS vs. OSS)

MCPRP limits are provided for three different sets of assumed scram speeds. The Technical Specification Scram Speed (TSSS) MCPRP limits are applicable at all times, as long as the scram time surveillance demonstrates the times in Technical Specification Table 3.1.4-1 are met. Both Nominal Scram Speeds (NSS) and/or Optimum Scram Speeds (OSS) may be used, as long as the scram time surveillance demonstrates Table 4.1 times are applicable.[†]

Table 4.1 Nominal Scram Time Basis

Notch Position (index)	Nominal Scram Timing (seconds)	Optimum Scram Timing (seconds)
46	0.420	0.380
36	0.980	0.875
26	1.600	1.465
6	2.900	2.900

In demonstrating compliance with the NSS and/or OSS scram time basis, surveillance requirements from Technical Specification 3.1.4 apply; accepting the definition of SLOW rods should conform to scram speeds shown in Table 4.1. If conformance is not demonstrated, TSSS based MCPRP limits are applied.

On initial cycle startup, TSSS limits are used until the successful completion of scram timing confirms NSS and/or OSS based limits are applicable.

4.2.3 Exposure Dependent Limits

Exposures are tracked on a Core Average Exposure basis (CAVEX, not Cycle Exposure). Higher exposure MCPRP limits are always more limiting and may be used for any Core Average Exposure up to the ending exposure. Per Reference 1, MCPRP limits are provided for the following exposure ranges:

BOC to NEOC	NEOC corresponds to	29,932.4 MWd / MTU
BOC to EOCLB	EOCLB corresponds to	32,824.7 MWd / MTU
BOC to End of Coast	End of Coast	34,132.4 MWd / MTU

NEOC refers to a Near EOC exposure point.

* Reference 1 analysis results are based on information identified in Reference 5.

† Drop out times consistent with method used to perform actual timing measurements (i.e., including pickup/dropout effects).



The EOCLB exposure point is not the true End-Of-Cycle exposure. Instead it corresponds to a licensing exposure window exceeding expected end-of-full-power-life.

The End of Coast exposure point represents a licensing exposure point exceeding the expected end-of-cycle exposure including cycle extension options.

4.2.4 Equipment Out-Of-Service (EOOS) Options

EOOS options* covered by $MCPR_p$ limits are given by the following:

In-Service	All equipment In-Service
RPTOOS	EOC-Recirculation Pump Trip Out-Of-Service
TBVOOS	Turbine Bypass Valve(s) Out-Of-Service
RPTOOS+TBVOOS	Combined RPTOOS and TBVOOS
PLUOOS	Power Load Unbalance Out-Of-Service
PLUOOS+RPTOOS	Combined PLUOOS and RPTOOS
PLUOOS+TBVOOS	Combined PLUOOS and TBVOOS
PLUOOS+TBVOOS+RPTOOS	Combined PLUOOS, RPTOOS, and TBVOOS
FHOOS (or FFWTR)	Feedwater Heaters Out-Of-Service (or Final Feedwater Temperature Reduction)

For exposure ranges up to NEOC and EOCLB, additional combinations of $MCPR_p$ limits are also provided including FHOOS. The coast down exposure range assumes application of FFWTR. FHOOS based $MCPR_p$ limits for the coast down exposure are redundant because the temperature setdown assumption is identical with FFWTR.


4.2.5 Single-Loop-Operation (SLO) Limits

$MCPR_p$ limits, for both ATRIUM-10 and GE 14, are increased by 0.02 to support SLO, per Reference 1.

4.2.6 Below Pbyypass Limits

Below Pbyypass (30% rated power), $MCPR_p$ limits depend upon core flow. One set of $MCPR_p$ limits applies for core flow above 50% of rated; a second set applies if the core flow is less than or equal to 50% rated.

* All equipment service conditions assume 1 SRVOOS.

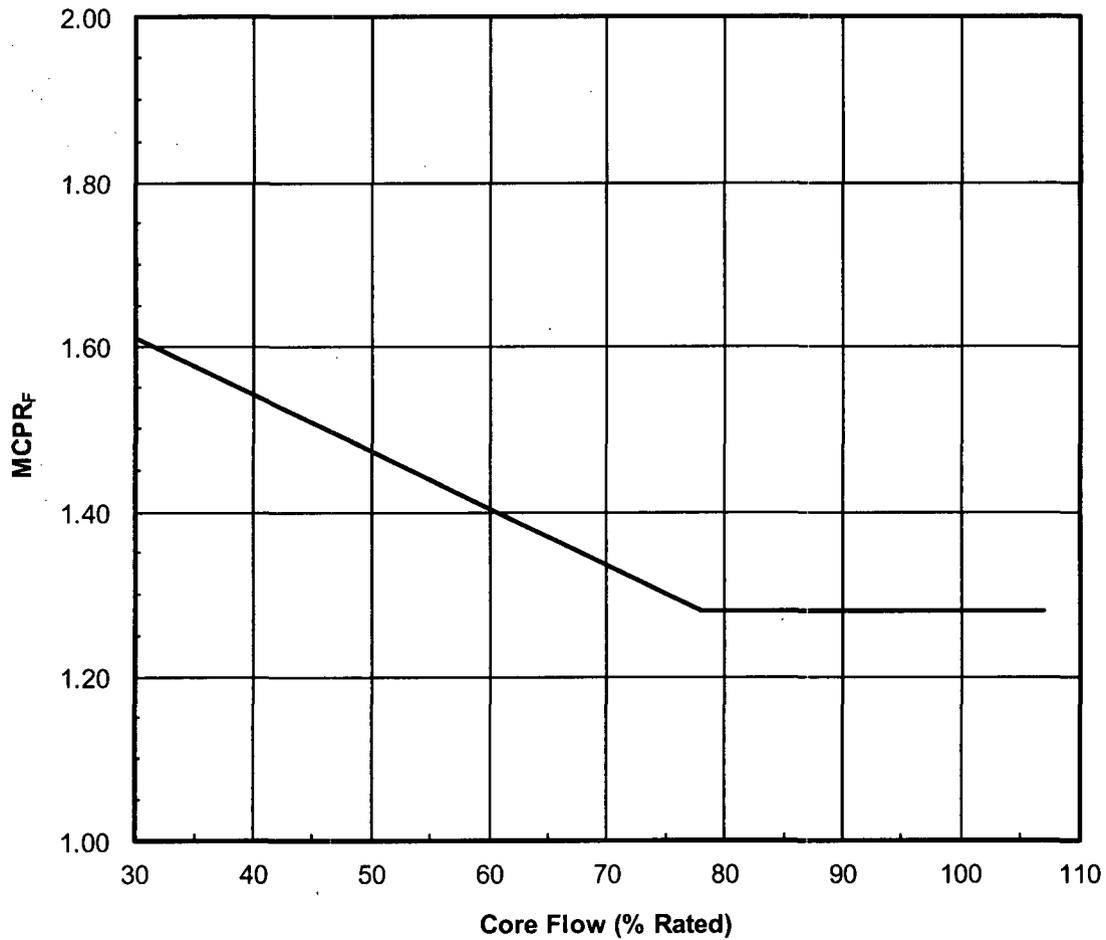

Core Flow (% Rated)	MCPR _F
30.0	1.61
78.0	1.28
107.0	1.28

Figure 4.1 MCPR_F for GE 14 and ATRIUM-10 Fuel
 (Values bound all EOOS conditions)

(107.0% maximum core flow line is used to support 105% rated flow operation, ICF)

Table 4.2 MCPR_p Limits for Optimum Scram Time Basis: ATRIUM-10*

Operating Condition	Power (% of rated)	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
Base Case	100	1.44	1.46	1.48
	75	1.57	1.57	1.60
	65	1.67	1.67	1.71
	50	1.79	1.79	1.84
	50	1.89	1.90	1.91
	40	1.98	1.98	2.04
	30	2.21	2.21	2.32
	30 at > 50%F	2.70	2.70	2.80
	25 at > 50%F	2.96	2.96	3.09
	30 at ≤ 50%F	2.56	2.56	2.65
	25 at ≤ 50%F	2.81	2.81	2.93
FHOOS	100	1.47	1.48	—
	75	1.59	1.60	—
	65	1.71	1.71	—
	50	1.84	1.84	—
	50	1.89	1.91	—
	40	2.04	2.04	—
	30	2.32	2.32	—
	30 at > 50%F	2.80	2.80	—
	25 at > 50%F	3.09	3.09	—
	30 at ≤ 50%F	2.65	2.65	—
	25 at ≤ 50%F	2.93	2.93	—

* All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service. For single-loop operation, MCPR_p limits will be 0.02 higher.

FFWTR/FHOOS is supported for the BOC to End of Coast limits.

Table 4.3 MCPR_p Limits for Optimum Scram Time Basis: GE 14*

Operating Condition	Power (% of rated)	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
Base Case	100	1.45	1.47	1.49
	75	1.58	1.58	1.61
	65	1.68	1.68	1.72
	50	1.84	1.84	—
	50	1.90	1.90	1.92
	40	2.05	2.05	2.15
	30	2.36	2.36	2.48
	30 at > 50%F	2.89	2.89	3.02
	25 at > 50%F	3.21	3.21	3.37
	30 at ≤ 50%F	2.83	2.83	2.94
	25 at ≤ 50%F	3.11	3.11	3.26
FHOOS	100	1.48	1.49	—
	75	1.61	1.61	—
	65	1.72	1.72	—
	50	—	—	—
	50	1.92	1.92	—
	40	2.15	2.15	—
	30	2.48	2.48	—
	30 at > 50%F	3.02	3.02	—
	25 at > 50%F	3.37	3.37	—
	30 at ≤ 50%F	2.94	2.94	—
	25 at ≤ 50%F	3.26	3.26	—

* All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service. For single-loop operation, MCPR_p limits will be 0.02 higher.

FFWTR/FHOOS is supported for the BOC to End of Coast limits.

Table 4.4 MCPR_p Limits for ATRIUM-10: Nominal Scram Time Basis*

Operating Condition	Power (% of rated)	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
Base Case	100	1.46	1.48	1.49
	75	1.61	1.61	1.64
	65	1.69	1.69	1.73
	50	1.80	1.80	1.86
	50	1.90	1.92	1.92
	40	1.98	1.99	2.06
	30	2.23	2.23	2.35
	30 at > 50%F	2.70	2.70	2.80
	25 at > 50%F	2.96	2.96	3.09
	30 at ≤ 50%F	2.56	2.56	2.65
	25 at ≤ 50%F	2.81	2.81	2.93
TBVOOS	100	1.50	1.52	1.53
	75	1.65	1.65	1.66
	65	1.74	1.74	1.77
	50	1.85	1.85	1.90
	50	1.90	1.92	1.92
	40	1.99	1.99	2.07
	30	2.24	2.24	2.35
	30 at > 50%F	3.25	3.25	3.39
	25 at > 50%F	3.68	3.68	3.82
	30 at ≤ 50%F	2.75	2.75	2.88
	25 at ≤ 50%F	3.16	3.16	3.32
FHOOS	100	1.49	1.49	—
	75	1.62	1.64	—
	65	1.73	1.73	—
	50	1.86	1.86	—
	50	1.90	1.92	—
	40	2.06	2.06	—
	30	2.35	2.35	—
	30 at > 50%F	2.80	2.80	—
	25 at > 50%F	3.09	3.09	—
	30 at ≤ 50%F	2.65	2.65	—
	25 at ≤ 50%F	2.93	2.93	—
PLUOOS	100	1.46	1.48	1.49
	75	1.61	1.61	1.64
	65	1.81	1.84	1.84
	50	—	—	—
	50	1.90	1.92	1.92
	40	1.98	1.99	2.06
	30	2.23	2.23	2.35
	30 at > 50%F	2.70	2.70	2.80
	25 at > 50%F	2.96	2.96	3.09
	30 at ≤ 50%F	2.56	2.56	2.65
	25 at ≤ 50%F	2.81	2.81	2.93

* All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service. For single-loop operation, MCPR_p limits will be 0.02 higher.

FFWTR and FHOOS assume the same value of temperature drop. Consequently, FHOOS limits are not provided for BOC to End of COAST due to redundancy. Thermal limits for the "BOC to End of COAST" exposure applicability window are developed to conservatively bound FHOOS limits for earlier exposure applicability windows.

A 50% power step change for PLUOOS limits is not supported. When core power is ≤ 50%, the LRNB event is the same with, or without PLUOOS.

Table 4.4 MCPR_p Limits for ATRIUM-10: Nominal Scram Time Basis (*continued*)^{*}

Operating Condition	Power (% of rated)	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
TBVOOS FHOOS	100	1.52	1.53	—
	75	1.65	1.66	—
	65	1.77	1.77	—
	50	—	1.90	—
	50	1.90	1.92	—
	40	2.07	2.07	—
	30	2.35	2.35	—
	30 at > 50%F	3.39	3.39	—
	25 at > 50%F	3.82	3.82	—
	30 at ≤ 50%F	2.88	2.88	—
	25 at ≤ 50%F	3.32	3.32	—
TBVOOS PLUOOS	100	1.50	1.52	1.53
	75	1.65	1.65	1.66
	65	1.81	1.84	1.84
	50	—	—	—
	50	1.90	1.92	1.92
	40	1.99	1.99	2.07
	30	2.24	2.24	2.35
	30 at > 50%F	3.25	3.25	3.39
	25 at > 50%F	3.68	3.68	3.82
	30 at ≤ 50%F	2.75	2.75	2.88
	25 at ≤ 50%F	3.16	3.16	3.32
FHOOS PLUOOS	100	1.49	1.49	—
	75	1.62	1.64	—
	65	1.81	1.84	—
	50	—	—	—
	50	1.90	1.92	—
	40	2.06	2.06	—
	30	2.35	2.35	—
	30 at > 50%F	2.80	2.80	—
	25 at > 50%F	3.09	3.09	—
	30 at ≤ 50%F	2.65	2.65	—
	25 at ≤ 50%F	2.93	2.93	—
TBVOOS FHOOS PLUOOS	100	1.52	1.53	—
	75	1.65	1.66	—
	65	1.81	1.84	—
	50	—	—	—
	50	1.90	1.92	—
	40	2.07	2.07	—
	30	2.35	2.35	—
	30 at > 50%F	3.39	3.39	—
	25 at > 50%F	3.82	3.82	—
	30 at ≤ 50%F	2.88	2.88	—
	25 at ≤ 50%F	3.32	3.32	—

* All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service. For single-loop operation, MCPR_p limits will be 0.02 higher.

FWTR and FHOOS assume the same value of temperature drop. Consequently, FHOOS limits are not provided for BOC to End of COAST due to redundancy. Thermal limits for the "BOC to End of COAST" exposure applicability window are developed to conservatively bound FHOOS limits for earlier exposure applicability windows.

A 50% power step change for PLUOOS limits is not supported. When core power is ≤ 50%, the LRNB event is the same with, or without PLUOOS.

Table 4.5 MCPR_P Limits for GE 14: Nominal Scram Time Basis*

Operating Condition	Power (% of rated)	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
Base Case	100	1.48	1.48	1.51
	75	1.61	1.61	1.64
	65	1.71	1.71	1.75
	50	1.87	1.87	—
	50	1.91	1.91	1.95
	40	2.08	2.08	2.18
	30	2.39	2.39	2.51
	30 at > 50%F	2.89	2.89	3.02
	25 at > 50%F	3.21	3.21	3.37
	30 at ≤ 50%F	2.83	2.83	2.94
25 at ≤ 50%F	3.11	3.11	3.26	
TBVOOS	100	1.52	1.52	1.54
	75	1.65	1.65	1.67
	65	1.76	1.76	1.79
	50	1.88	1.88	—
	50	1.91	1.91	1.96
	40	2.09	2.09	2.18
	30	2.39	2.39	2.51
	30 at > 50%F	3.31	3.31	3.47
	25 at > 50%F	3.76	3.76	3.91
	30 at ≤ 50%F	2.98	2.98	3.15
25 at ≤ 50%F	3.45	3.45	3.64	
FHOOS	100	1.51	1.51	—
	75	1.64	1.64	—
	65	1.75	1.75	—
	50	—	—	—
	50	1.95	1.95	—
	40	2.18	2.18	—
	30	2.51	2.51	—
	30 at > 50%F	3.02	3.02	—
	25 at > 50%F	3.37	3.37	—
	30 at ≤ 50%F	2.94	2.94	—
25 at ≤ 50%F	3.26	3.26	—	
PLUOOS	100	1.48	1.48	1.51
	75	1.61	1.61	1.64
	65	1.82	1.83	1.83
	50	—	—	—
	50	1.91	1.91	1.95
	40	2.08	2.08	2.18
	30	2.39	2.39	2.51
	30 at > 50%F	2.89	2.89	3.02
	25 at > 50%F	3.21	3.21	3.37
	30 at ≤ 50%F	2.83	2.83	2.94
25 at ≤ 50%F	3.11	3.11	3.26	

* All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service. For single-loop operation, MCPR_P limits will be 0.02 higher.

FWTR and FHOOS assume the same value of temperature drop. Consequently, FHOOS limits are not provided for BOC to End of COAST due to redundancy. Thermal limits for the "BOC to End of COAST" exposure applicability window are developed to conservatively bound FHOOS limits for earlier exposure applicability windows.

A 50% power step change for PLUOOS limits is not supported. When core power is ≤ 50%, the LRNB event is the same with, or without PLUOOS.

Table 4.5 MCPR_P Limits for GE 14: Nominal Scram Time Basis (continued)^{*}

Operating Condition	Power (% of rated)	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
TBVOOS FHOOS	100	1.54	1.54	—
	75	1.67	1.67	—
	65	1.79	1.79	—
	50	—	—	—
	50	1.96	1.96	—
	40	2.18	2.18	—
	30	2.51	2.51	—
	30 at > 50%F	3.47	3.47	—
	25 at > 50%F	3.91	3.91	—
	30 at ≤ 50%F	3.15	3.15	—
25 at ≤ 50%F	3.64	3.64	—	
TBVOOS PLUOOS	100	1.52	1.52	1.54
	75	1.65	1.65	1.67
	65	1.82	1.83	1.83
	50	—	—	—
	50	1.91	1.91	1.96
	40	2.09	2.09	2.18
	30	2.39	2.39	2.51
	30 at > 50%F	3.31	3.31	3.47
	25 at > 50%F	3.76	3.76	3.91
	30 at ≤ 50%F	2.98	2.98	3.15
25 at ≤ 50%F	3.45	3.45	3.64	
FHOOS PLUOOS	100	1.51	1.51	—
	75	1.64	1.64	—
	65	1.82	1.83	—
	50	—	—	—
	50	1.95	1.95	—
	40	2.18	2.18	—
	30	2.51	2.51	—
	30 at > 50%F	3.02	3.02	—
	25 at > 50%F	3.37	3.37	—
	30 at ≤ 50%F	2.94	2.94	—
25 at ≤ 50%F	3.26	3.26	—	
TBVOOS FHOOS PLUOOS	100	1.54	1.54	—
	75	1.67	1.67	—
	65	1.82	1.83	—
	50	—	—	—
	50	1.96	1.96	—
	40	2.18	2.18	—
	30	2.51	2.51	—
	30 at > 50%F	3.47	3.47	—
	25 at > 50%F	3.91	3.91	—
	30 at ≤ 50%F	3.15	3.15	—
25 at ≤ 50%F	3.64	3.64	—	

* All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service. For single-loop operation, MCPR_P limits will be 0.02 higher.

FFWTR and FHOOS assume the same value of temperature drop. Consequently, FHOOS limits are not provided for BOC to End of COAST due to redundancy. Thermal limits for the "BOC to End of COAST" exposure applicability window are developed to conservatively bound FHOOS limits for earlier exposure applicability windows.

A 50% power step change for PLUOOS limits is not supported. When core power is ≤ 50%, the LRNB event is the same with, or without PLUOOS.

Table 4.6 MCPR_p Limits for ATRIUM-10: Technical Specification Scram Time Basis*

Operating Condition	Power (% of rated)	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
Base Case	100	1.49	1.50	1.52
	75	1.62	1.63	1.65
	65	1.71	1.71	1.75
	50	1.82	1.82	1.87
	50	1.91	1.93	1.93
	40	1.99	2.00	2.08
	30	2.26	2.26	2.37
	30 at > 50%F	2.70	2.70	2.80
	25 at > 50%F	2.96	2.96	3.09
	30 at ≤ 50%F	2.56	2.56	2.65
	25 at ≤ 50%F	2.81	2.81	2.93
TBVOOS	100	1.53	1.54	1.56
	75	1.66	1.67	1.69
	65	1.76	1.76	1.79
	50	1.87	1.87	1.92
	50	1.91	1.93	1.93
	40	2.01	2.01	2.10
	30	2.27	2.27	2.38
	30 at > 50%F	3.25	3.25	3.39
	25 at > 50%F	3.68	3.68	3.82
	30 at ≤ 50%F	2.75	2.75	2.88
	25 at ≤ 50%F	3.16	3.16	3.32
FHOOS	100	1.52	1.52	—
	75	1.65	1.65	—
	65	1.75	1.75	—
	50	1.87	1.87	—
	50	1.91	1.93	—
	40	2.08	2.08	—
	30	2.37	2.37	—
	30 at > 50%F	2.80	2.80	—
	25 at > 50%F	3.09	3.09	—
	30 at ≤ 50%F	2.65	2.65	—
	25 at ≤ 50%F	2.93	2.93	—
PLUOOS	100	1.49	1.50	1.52
	75	1.62	1.63	1.65
	65	1.82	1.86	1.86
	50	—	—	—
	50	1.91	1.93	1.93
	40	1.99	2.00	2.08
	30	2.26	2.26	2.37
	30 at > 50%F	2.70	2.70	2.80
	25 at > 50%F	2.96	2.96	3.09
	30 at ≤ 50%F	2.56	2.56	2.65
	25 at ≤ 50%F	2.81	2.81	2.93

* All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service. For single-loop operation, MCPR_p limits will be 0.02 higher.

FWTR and FHOOS assume the same value of temperature drop. Consequently, FHOOS limits are not provided for BOC to End of COAST due to redundancy. Thermal limits for the "BOC to End of COAST" exposure applicability window are developed to conservatively bound FHOOS limits for earlier exposure applicability windows.

A 50% power step change for PLUOOS limits is not supported. When core power is ≤ 50%, the LRNB event is the same with, or without PLUOOS.

Table 4.6 MCPR_p Limits for ATRIUM-10: Technical Specification Scram Time Basis (*continued*)

Operating Condition	Power (% of rated)	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
TBVOOS FHOOS	100	1.55	1.56	—
	75	1.68	1.69	—
	65	1.79	1.79	—
	50	—	1.92	—
	50	1.92	1.93	—
	40	2.10	2.10	—
	30	2.38	2.38	—
	30 at > 50°F	3.39	3.39	—
	25 at > 50°F	3.82	3.82	—
	30 at ≤ 50°F	2.88	2.88	—
	25 at ≤ 50°F	3.32	3.32	—
TBVOOS PLUOOS	100	1.53	1.54	1.56
	75	1.66	1.67	1.69
	65	1.82	1.86	1.86
	50	—	—	—
	50	1.91	1.93	1.93
	40	2.01	2.01	2.10
	30	2.27	2.27	2.38
	30 at > 50°F	3.25	3.25	3.39
	25 at > 50°F	3.68	3.68	3.82
	30 at ≤ 50°F	2.75	2.75	2.88
	25 at ≤ 50°F	3.16	3.16	3.32
FHOOS PLUOOS	100	1.52	1.52	—
	75	1.65	1.65	—
	65	1.82	1.86	—
	50	—	—	—
	50	1.91	1.93	—
	40	2.08	2.08	—
	30	2.37	2.37	—
	30 at > 50°F	2.80	2.80	—
	25 at > 50°F	3.09	3.09	—
	30 at ≤ 50°F	2.65	2.65	—
	25 at ≤ 50°F	2.93	2.93	—
TBVOOS FHOOS PLUOOS	100	1.55	1.56	—
	75	1.68	1.69	—
	65	1.82	1.86	—
	50	—	—	—
	50	1.92	1.93	—
	40	2.10	2.10	—
	30	2.38	2.38	—
	30 at > 50°F	3.39	3.39	—
	25 at > 50°F	3.82	3.82	—
	30 at ≤ 50°F	2.88	2.88	—
	25 at ≤ 50°F	3.32	3.32	—

All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service. For single-loop operation, MCPR_p limits will be 0.02 higher.

FWTR and FHOOS assume the same value of temperature drop. Consequently, FHOOS limits are not provided for BOC to End of COAST due to redundancy. Thermal limits for the "BOC to End of COAST" exposure applicability window are developed to conservatively bound FHOOS limits for earlier exposure applicability windows.

A 50% power step change for PLUOOS limits is not supported. When core power is ≤ 50%, the LRNB event is the same with, or without PLUOOS.

Table 4.7 MCPR_P Limits for GE 14: Technical Specification Scram Time Basis*

Operating Condition	Power (% of rated)	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
Base Case	100	1.50	1.50	1.54
	75	1.65	1.65	1.67
	65	1.73	1.73	1.76
	50	1.89	1.89	—
	50	1.92	1.92	1.97
	40	2.11	2.11	2.20
	30	2.41	2.41	2.54
	30 at > 50°F	2.89	2.89	3.02
	25 at > 50°F	3.21	3.21	3.37
	30 at ≤ 50°F	2.83	2.83	2.94
25 at ≤ 50°F	3.11	3.11	3.26	
TBVOOS	100	1.54	1.55	1.57
	75	1.69	1.69	1.70
	65	1.78	1.78	1.81
	50	1.91	1.91	—
	50	1.92	1.92	1.99
	40	2.12	2.12	2.21
	30	2.41	2.41	2.54
	30 at > 50°F	3.31	3.31	3.47
	25 at > 50°F	3.76	3.76	3.91
	30 at ≤ 50°F	2.98	2.98	3.15
25 at ≤ 50°F	3.45	3.45	3.64	
FHOOS	100	1.54	1.54	—
	75	1.67	1.67	—
	65	1.76	1.76	—
	50	—	—	—
	50	1.97	1.97	—
	40	2.20	2.20	—
	30	2.54	2.54	—
	30 at > 50°F	3.02	3.02	—
	25 at > 50°F	3.37	3.37	—
	30 at ≤ 50°F	2.94	2.94	—
25 at ≤ 50°F	3.26	3.26	—	
PLUOOS	100	1.50	1.50	1.54
	75	1.65	1.65	1.67
	65	1.83	1.85	1.85
	50	—	—	—
	50	1.92	1.92	1.97
	40	2.11	2.11	2.20
	30	2.41	2.41	2.54
	30 at > 50°F	2.89	2.89	3.02
	25 at > 50°F	3.21	3.21	3.37
	30 at ≤ 50°F	2.83	2.83	2.94
25 at ≤ 50°F	3.11	3.11	3.26	

* All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service. For single-loop operation, MCPR_P limits will be 0.02 higher.

FFWTR and FHOOS assume the same value of temperature drop. Consequently, FHOOS limits are not provided for BOC to End of COAST due to redundancy. Thermal limits for the "BOC to End of COAST" exposure applicability window are developed to conservatively bound FHOOS limits for earlier exposure applicability windows.

A 50% power step change for PLUOOS limits is not supported. When core power is ≤ 50%, the LRNB event is the same with, or without PLUOOS.

Table 4.7 MCPR_p Limits for GE 14: Technical Specification Scram Time Basis (*continued*)^{*}

Operating Condition	Power (% of rated)	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
TBVOOS FHOOS	100	1.57	1.57	—
	75	1.70	1.70	—
	65	1.81	1.81	—
	50	—	—	—
	50	1.99	1.99	—
	40	2.21	2.21	—
	30	2.54	2.54	—
	30 at > 50%F	3.47	3.47	—
	25 at > 50%F	3.91	3.91	—
	30 at ≤ 50%F	3.15	3.15	—
	25 at ≤ 50%F	3.64	3.64	—
TBVOOS PLUOOS	100	1.54	1.55	1.57
	75	1.69	1.69	1.70
	65	1.83	1.85	1.85
	50	—	—	—
	50	1.92	1.92	1.99
	40	2.12	2.12	2.21
	30	2.41	2.41	2.54
	30 at > 50%F	3.31	3.31	3.47
	25 at > 50%F	3.76	3.76	3.91
	30 at ≤ 50%F	2.98	2.98	3.15
	25 at ≤ 50%F	3.45	3.45	3.64
FHOOS PLUOOS	100	1.54	1.54	—
	75	1.67	1.67	—
	65	1.83	1.85	—
	50	—	—	—
	50	1.97	1.97	—
	40	2.20	2.20	—
	30	2.54	2.54	—
	30 at > 50%F	3.02	3.02	—
	25 at > 50%F	3.37	3.37	—
	30 at ≤ 50%F	2.94	2.94	—
	25 at ≤ 50%F	3.26	3.26	—
TBVOOS FHOOS PLUOOS	100	1.57	1.57	—
	75	1.70	1.70	—
	65	1.83	1.85	—
	50	—	—	—
	50	1.99	1.99	—
	40	2.21	2.21	—
	30	2.54	2.54	—
	30 at > 50%F	3.47	3.47	—
	25 at > 50%F	3.91	3.91	—
	30 at ≤ 50%F	3.15	3.15	—
	25 at ≤ 50%F	3.64	3.64	—

* All limits, including "Base Case," support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service. For single-loop operation, MCPR_p limits will be 0.02 higher.

FFWTR and FHOOS assume the same value of temperature drop. Consequently, FHOOS limits are not provided for BOC to End of COAST due to redundancy. Thermal limits for the "BOC to End of COAST" exposure applicability window are developed to conservatively bound FHOOS limits for earlier exposure applicability windows.

A 50% power step change for PLUOOS limits is not supported. When core power is ≤ 50%, the LRNB event is the same with, or without PLUOOS.


 Table 4.8 Startup Operation MCPR_p Limits for Table 3.1 Temperature Range 1
 for ATRIUM-10: Technical Specification Scram Time Basis*

Operating Condition	Power (% of rated)	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
TBVIS	100	1.52	1.52	1.52
	75	1.65	1.65	1.65
	65	1.82	1.86	1.86
	50	—	—	—
	50	2.02	2.02	2.02
	40	2.30	2.30	2.30
	30	2.64	2.64	2.64
	30 at > 50°F	3.07	3.07	3.07
	25 at > 50°F	3.42	3.42	3.42
	30 at ≤ 50°F	2.88	2.88	2.88
	25 at ≤ 50°F	3.23	3.23	3.23
	TBVOOS	100	1.55	1.56
75		1.68	1.69	1.69
65		1.82	1.86	1.86
50		—	—	—
50		2.03	2.03	2.03
40		2.31	2.31	2.31
30		2.63	2.63	2.63
30 at > 50°F		3.61	3.61	3.61
25 at > 50°F		4.06	4.06	4.06
30 at ≤ 50°F		3.07	3.07	3.07
25 at ≤ 50°F		3.57	3.57	3.57

* Limits support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service. For single-loop operation, MCPR_p limits will be 0.02 higher.

Limits are applicable for all other EOOS scenarios, apart from TBV.


 Table 4.9 Startup Operation MCPR_P Limits for Table 3.1 Temperature Range 1
 for GE 14: Technical Specification Scram Time Basis*

Operating Condition	Power (% of rated)	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
TBVIS	100	1.54	1.54	1.54
	75	1.67	1.67	1.67
	65	1.83	1.85	1.85
	50	—	—	—
	50	2.16	2.16	2.16
	40	2.44	2.44	2.44
	30	2.83	2.83	2.83
	30 at > 50°F	3.32	3.32	3.32
	25 at > 50°F	3.75	3.75	3.75
	30 at ≤ 50°F	3.21	3.21	3.21
	25 at ≤ 50°F	3.61	3.61	3.61
	TBVOOS	100	1.57	1.57
75		1.70	1.70	1.70
65		1.83	1.85	1.85
50		—	—	—
50		2.17	2.17	2.17
40		2.44	2.44	2.44
30		2.80	2.80	2.80
30 at > 50°F		3.72	3.72	3.72
25 at > 50°F		4.21	4.21	4.21
30 at ≤ 50°F		3.37	3.37	3.37
25 at ≤ 50°F		3.94	3.94	3.94

* Limits support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service. For single-loop operation, MCPR_P limits will be 0.02 higher.

Limits are applicable for all other EOOS scenarios, apart from TBV.


 Table 4.10 Startup Operation MCPR_p Limits for Table 3.1 Temperature Range 2
 for ATRIUM-10: Technical Specification Scram Time Basis*

Operating Condition	Power (% of rated)	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
TBVIS	100	1.52	1.52	1.52
	75	1.65	1.65	1.65
	65	1.82	1.86	1.86
	50	—	—	—
	50	2.03	2.03	2.03
	40	2.31	2.31	2.31
	30	2.66	2.66	2.66
	30 at > 50°F	3.09	3.09	3.09
	25 at > 50°F	3.44	3.44	3.44
	30 at ≤ 50°F	2.91	2.91	2.91
	25 at ≤ 50°F	3.25	3.25	3.25
TBVOOS	100	1.55	1.56	1.56
	75	1.68	1.69	1.69
	65	1.82	1.86	1.86
	50	—	—	—
	50	2.04	2.04	2.04
	40	2.32	2.32	2.32
	30	2.65	2.65	2.65
	30 at > 50°F	3.62	3.62	3.62
	25 at > 50°F	4.08	4.08	4.08
	30 at ≤ 50°F	3.09	3.09	3.09
	25 at ≤ 50°F	3.58	3.58	3.58

* Limits support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service. For single-loop operation, MCPR_p limits will be 0.02 higher.

Limits are applicable for all other EOOS scenarios, apart from TBV.


 Table 4.11 Startup Operation MCPR_P Limits for Table 3.1 Temperature Range 2
 for GE 14: Technical Specification Scram Time Basis*

Operating Condition	Power (% of rated)	BOC to NEOC	BOC to EOCLB	BOC to End of Coast
TBVIS	100	1.54	1.54	1.54
	75	1.67	1.67	1.67
	65	1.83	1.85	1.85
	50	—	—	—
	50	2.17	2.17	2.17
	40	2.46	2.46	2.46
	30	2.85	2.85	2.85
	30 at > 50°F	3.34	3.34	3.34
	25 at > 50°F	3.77	3.77	3.77
	30 at ≤ 50°F	3.23	3.23	3.23
	25 at ≤ 50°F	3.63	3.63	3.63
TBVOOS	100	1.57	1.57	1.57
	75	1.70	1.70	1.70
	65	1.83	1.85	1.85
	50	—	—	—
	50	2.18	2.18	2.18
	40	2.45	2.45	2.45
	30	2.82	2.82	2.82
	30 at > 50°F	3.73	3.73	3.73
	25 at > 50°F	4.23	4.23	4.23
	30 at ≤ 50°F	3.39	3.39	3.39
	25 at ≤ 50°F	3.96	3.96	3.96

* Limits support RPTOOS operation; operation is supported for any combination of 1 MSRVOOS, up to 2 TIPOOS (or the equivalent number of TIP channels), and up to 50% of the LPRMs out-of-service. For single-loop operation, MCPR_P limits will be 0.02 higher.

Limits are applicable for all other EOOS scenarios, apart from TBV.



5 Oscillation Power Range Monitor (OPRM) Setpoint

(Technical Specification 3.3.1.1)

Technical Specification Table 3.3.1.1-1, Function 2f, identifies the OPRM upscale function.

Instrument setpoints are established, such that the reactor will be tripped before an oscillation can grow to the point where the SLMCPR is exceeded. An Option III stability analysis is performed for each reload core to determine allowable OLMCPR's as a function of OPRM setpoint. Analyses consider both steady state startup operation, and the case of a two recirculation pump trip from rated power.

The resulting stability based OLMCPR's are reported in Reference 1. The OPRM setpoint (*sometimes referred to as the Amplitude Trip, S_p*) is selected, such that required margin to the SLMCPR is provided without stability being a limiting event. Analyses are based on cycle specific DIVOM analyses performed per Reference 26. The calculated OLMCPR's are shown in Table 5.1. Review of results shown in COLR Table 4.2 and Table 4.3 indicates an OPRM setpoint of **1.15** may be used.

Table 5.1 OPRM Setpoint Range*

OPRM Setpoint	OLMCPR (SS)	OLMCPR (2PT)
1.05	1.18	1.14
1.06	1.20	1.16
1.07	1.22	1.17
1.08	1.24	1.19
1.09	1.26	1.21
1.10	1.28	1.23
1.11	1.30	1.25
1.12	1.32	1.27
1.13	1.34	1.29
1.14	1.36	1.31
1.15	1.39	1.34

* Extrapolation beyond a setpoint of 1.15 is not allowed



6 APRM Flow Biased Rod Block Trip Settings

(Technical Requirements Manual Section 5.3.1 and Table 3.3.4-1)

The APRM rod block trip setting is based upon References 27 & 28, and is defined by the following:

$$\text{SRB} \leq (0.66(W-\Delta W) + 61\%) \quad \text{Allowable Value}$$

$$\text{SRB} \leq (0.66(W-\Delta W) + 59\%) \quad \text{Nominal Trip Setpoint (NTSP)}$$

where:

- SRB = Rod Block setting in percent of rated thermal power (3458 MW_t)
- W = Loop recirculation flow rate in percent of rated
- ΔW = Difference between two-loop and single-loop effective recirculation flow at the same core flow ($\Delta W=0.0$ for two-loop operation)

The APRM rod block trip setting is clamped at a maximum allowable value of 115% (corresponding to a NTSP of 113%).



7 Rod Block Monitor (RBM) Trip Setpoints and Operability

(Technical Specification Table 3.3.2.1-1)

The RBM trip setpoints and applicable power ranges, based on References 27 & 28, are shown in Table 7.1. Setpoints are based on an HTSP, unfiltered analytical limit of 117%. Unfiltered setpoints are consistent with a nominal RBM filter setting of 0.0 seconds; filtered setpoints are consistent with a nominal RBM filter setting less than 0.5 seconds. Cycle specific CRWE analyses of OLMCPR are documented in Reference 1, superseding values reported in References 27, 28, and 30.

Table 7.1 Analytical RBM Trip Setpoints*

RBM Trip Setpoint	Allowable Value (AV)	Nominal Trip Setpoint (NTSP)
LPSP	27%	25%
IPSP	62%	60%
HPSP	82%	80%
LTSP - unfiltered	124.7%	123.0%
- filtered	123.5%	121.8%
ITSP - unfiltered	119.7%	118.0%
- filtered	118.7%	117.0%
HTSP - unfiltered	114.7%	113.0%
- filtered	113.7%	112.0%
DTSP	90%	92%

As a result of cycle specific CRWE analyses, RBM setpoints in Technical Specification Table 3.3.2.1-1 are applicable as shown in Table 7.2. Cycle specific setpoint analysis results are shown in Table 7.3, per Reference 1.

Table 7.2 RBM Setpoint Applicability

Thermal Power (% Rated)	Applicable MCPR [†]	Notes from Table 3.3.2.1-1	Comment
> 27% and < 90%	< 1.70	(a), (b), (f), (h)	two loop operation
	< 1.74	(a), (b), (f), (h)	single loop operation
≥ 90%	< 1.43	(g)	two loop operation [‡]

* Values are considered maximums. Using lower values, due to RBM system hardware/software limitations, is conservative, and acceptable.

† MCPR values shown correspond with, (support), SLMPCR values identified in Reference 1.

‡ Greater than 90% rated power is not attainable in single loop operation.



Table 7.3 Control Rod Withdrawal Error Results

RBM HTSP Analytical Limit	CRWE OLMCPR
Unfiltered	
107	1.30
111	1.34
114	1.38
117	1.40

Results, compared against the base case OLMCPR results of Table 4.2, indicate SLMCPR remains protected for RBM inoperable conditions (i.e., 117% unblocked).



8 Shutdown Margin Limit

(Technical Specification 3.1.1)

Assuming the strongest OPERABLE control blade is fully withdrawn, and all other OPERABLE control blades are fully inserted, the core shall be sub-critical and meet the following minimum shutdown margin:

$$\text{SDM} > 0.38\% \text{ dk/k}$$