


**NOTES**

1. THE FOLLOWING PROCEDURES SHALL BE USED TO REMOVE WALL & ROOF JOINT DETAILS BEYOND THE EXISTING CONTAINMENT VESSEL AND REINSTATE THE WALLS AND ROOFS AS SHOWN IN THE FOLLOWING DETAILS. ALL WORK SHALL BE IN ACCORDANCE WITH THE SPECIFICATIONS AND STANDARDS LISTED IN THE FOLLOWING NOTES. ALL WORK SHALL BE IN ACCORDANCE WITH THE SPECIFICATIONS AND STANDARDS LISTED IN THE FOLLOWING NOTES. ALL WORK SHALL BE IN ACCORDANCE WITH THE SPECIFICATIONS AND STANDARDS LISTED IN THE FOLLOWING NOTES.

2. REMOVE ALL EXISTING JOINT FILLERS TO INSTALL NEW SHR. RATED FIRE RESISTIVE JOINT SYSTEM.

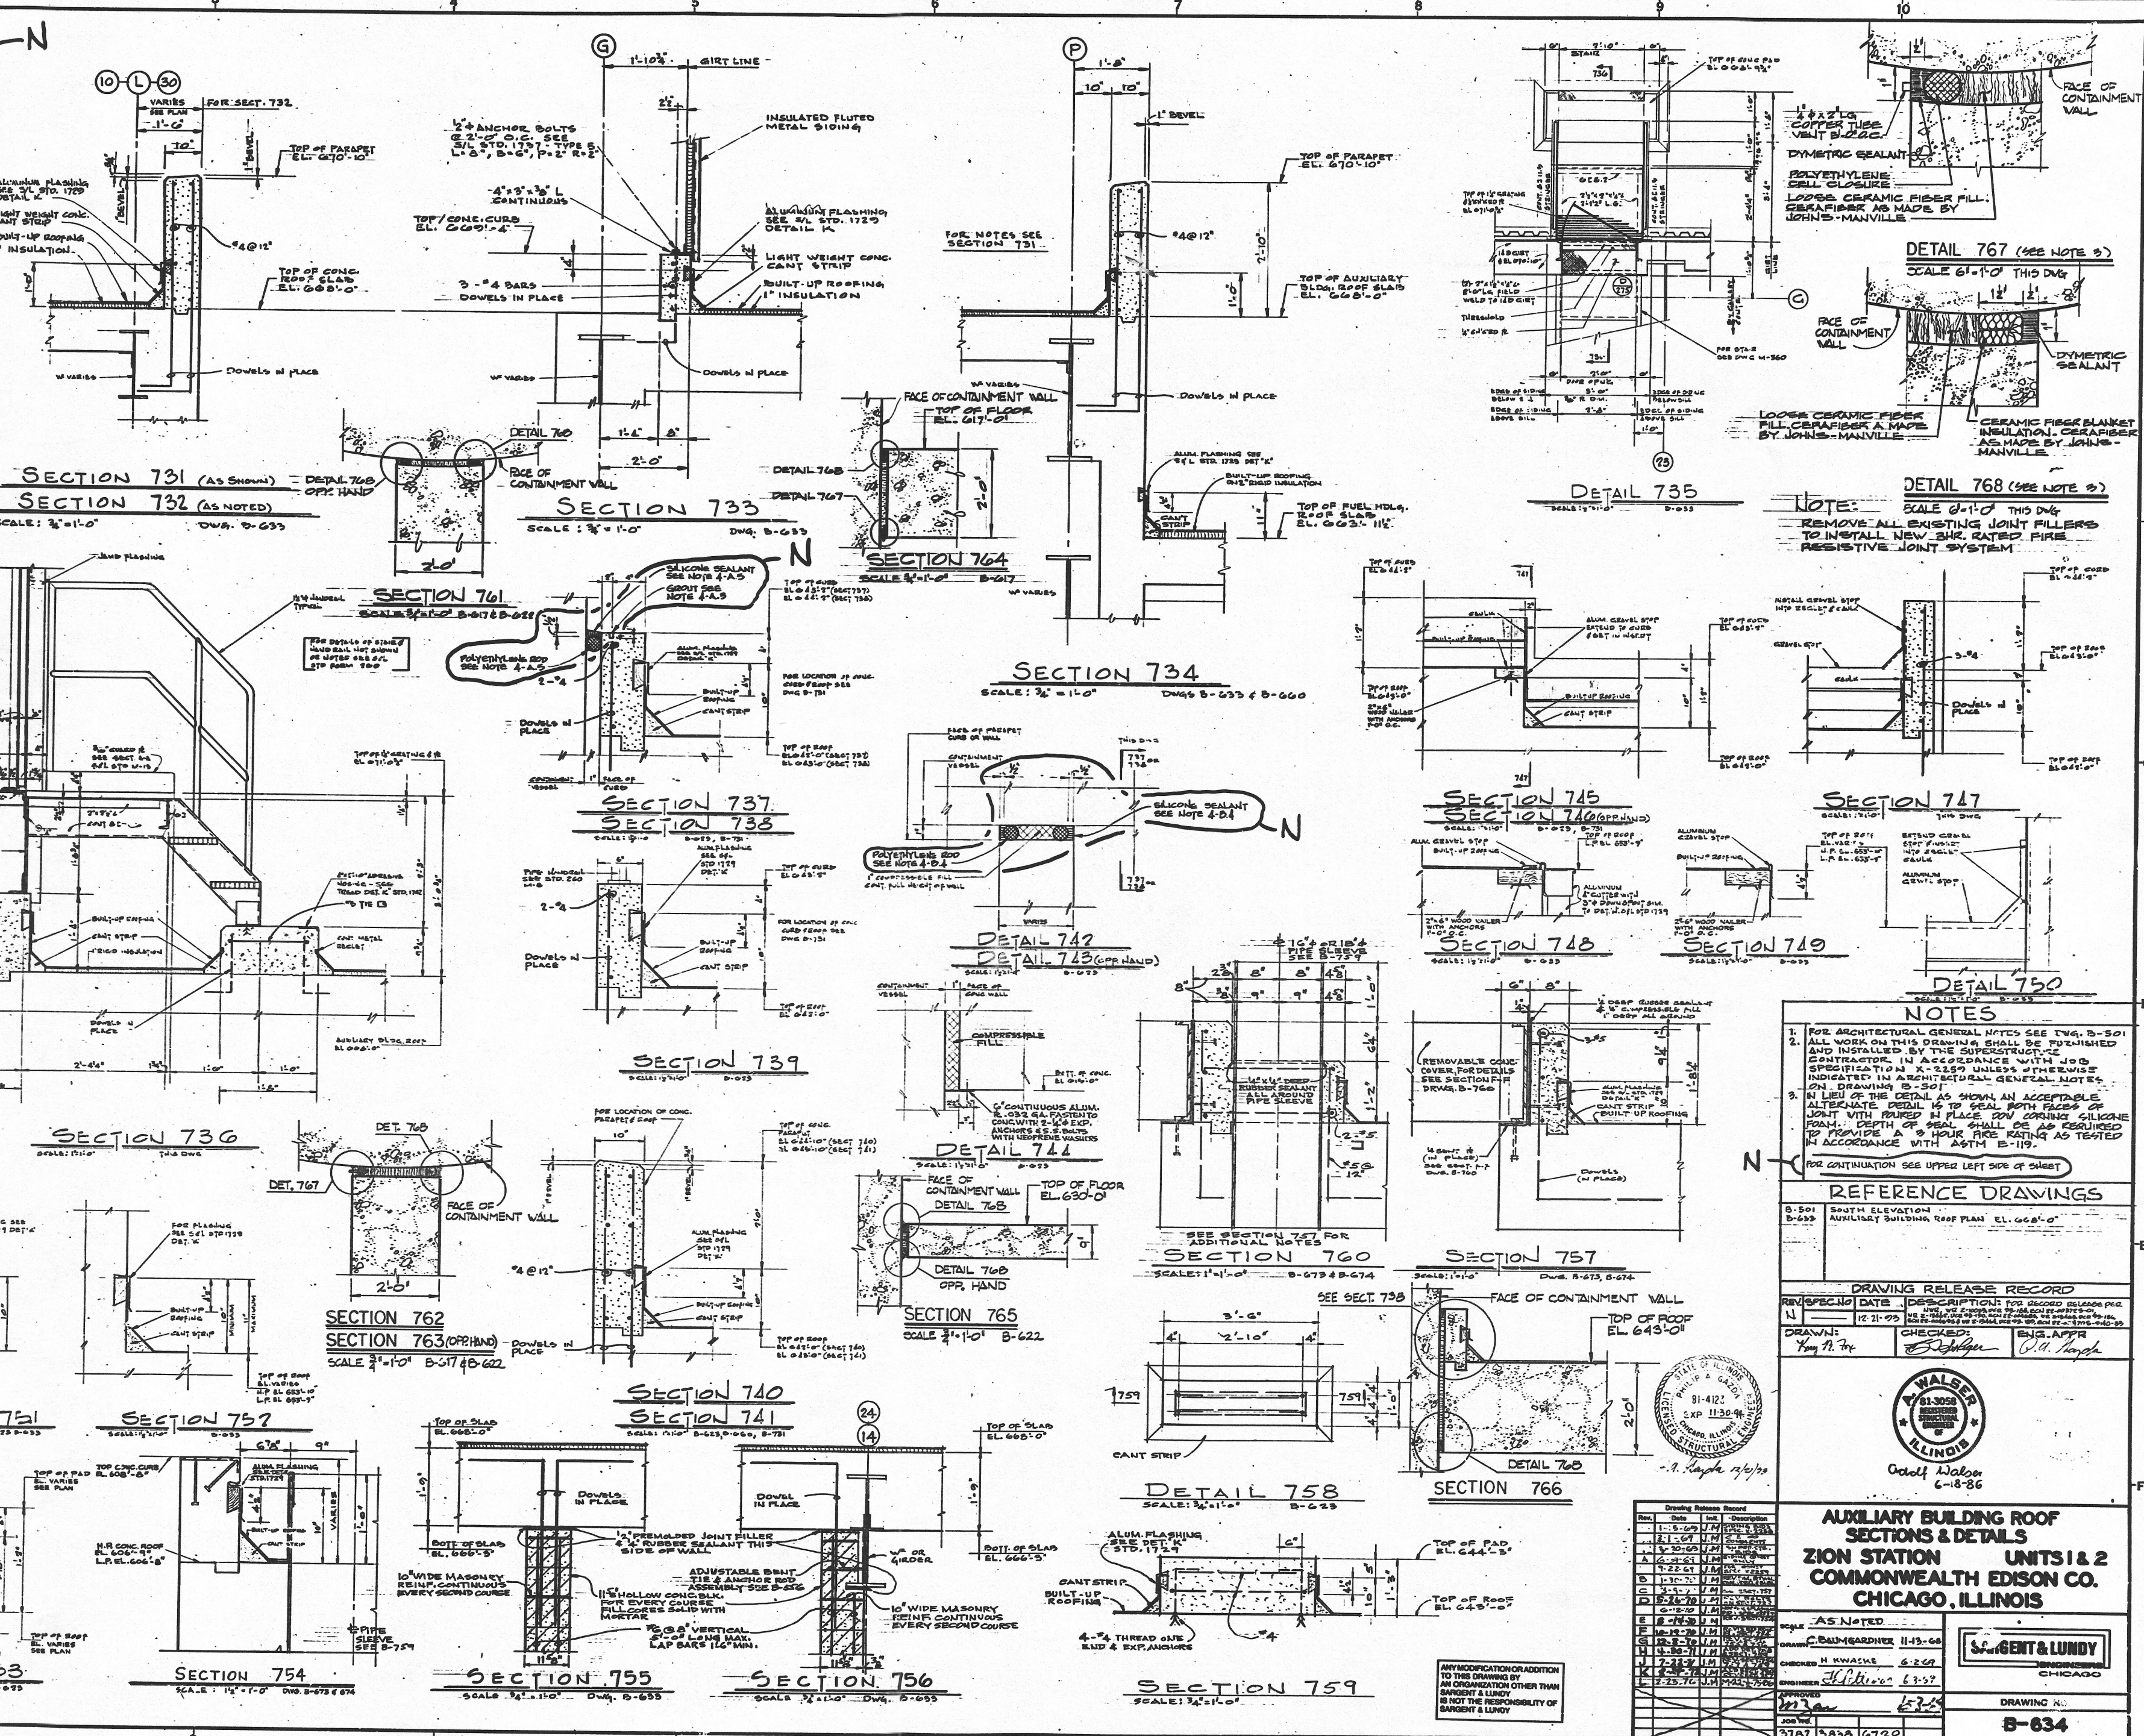

- NOTES**
- FOR ARCHITECTURAL GENERAL NOTES SEE DWG. B-501
  - ALL WORK ON THIS DRAWING SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR.
  - CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS.
  - IN LIEU OF THE DETAIL AS SHOWN, AN ACCEPTABLE ALTERNATE DETAIL IS TO SEAL BOTH ROOFS OF LIGHT WITH FURRED IN PLACE 2"X4" GULCHES FROM: DEPTH OF SEAL SHALL BE AS REQUIRED TO PROVIDE 3 HOUR FIRE RATING AS TESTED IN ACCORDANCE WITH ASTM E-119.
  - FOR CONTINUATION SEE UPPER LEFT SIDE OF SHEET

**REFERENCE DRAWINGS**

- B-501 SOUTH ELEVATION
- B-502 AUXILIARY BUILDING ROOF PLAN EL. 666'-0"

**DRAWING RELEASE RECORD**

REVISION	DATE	DESCRIPTION	FOR RECORD	RELEASED BY
11	12-21-05	ISSUED FOR CONSTRUCTION		W. J. WALSH

**WALSH & COMPANY**  
 91-4122  
 EXP. 11-30-06  
 CHICAGO, ILLINOIS  
 Octell Walsh  
 6-18-86


**AUXILIARY BUILDING ROOF SECTIONS & DETAILS**  
**ZION STATION UNITS 1 & 2**  
**COMMONWEALTH EDISON CO.**  
**CHICAGO, ILLINOIS**

Scale: AS NOTED

DESIGNED BY: C. D. HARRISON 11-13-04  
 CHECKED BY: H. W. WATKINS 6-22-05  
 DRAWN BY: J. H. HARRISON 6-22-05

DATE: 6-22-05

DRAWING NO.: **B-634**



**Drawing Release Record**

Rev.	Date	Description
1	11-13-04	ISSUED FOR CONSTRUCTION
2	12-21-05	ISSUED FOR CONSTRUCTION

ANY MODIFICATION OR ADDITION TO THIS DRAWING BY AN ORGANIZATION OTHER THAN WALSH & COMPANY IS NOT THE RESPONSIBILITY OF WALSH & COMPANY