
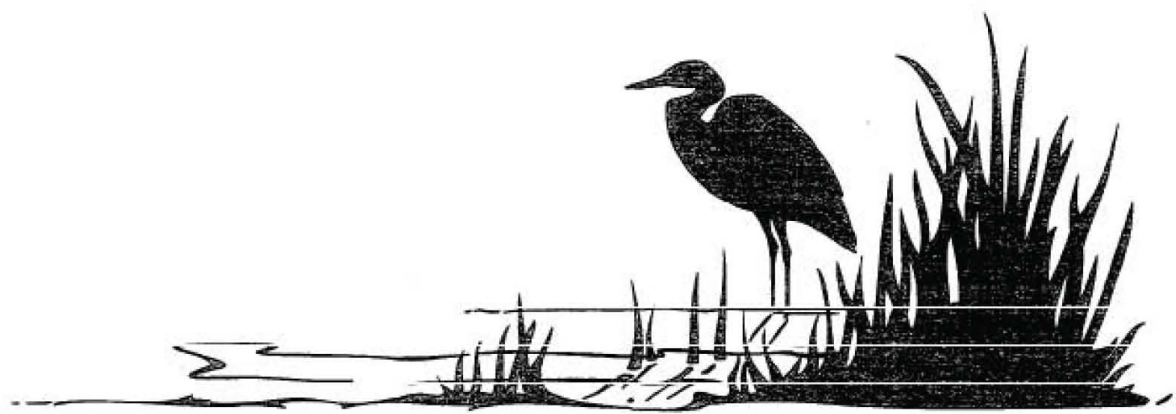


<b>United States Nuclear Regulatory Commission Official Hearing Exhibit</b>	
<b>In the Matter of:</b>	Progress Energy Florida, Inc. (Levy County Nuclear Power Plant, Units 1 and 2)
	<b>ASLBP #:</b> 09-879-04-COL-BD01
	<b>Docket #:</b> 05200029   05200030
	<b>Exhibit #:</b> NRC024-00-BD01
	<b>Admitted:</b> 10/31/2012
	<b>Rejected:</b>
<b>Other:</b>	<b>Identified:</b> 10/31/2012 <b>Withdrawn:</b> <b>Stricken:</b>

**Southwest Florida Water Management District**

**PART D  
PROJECT DESIGN AIDS**

**ENVIRONMENTAL RESOURCE PERMITTING  
INFORMATION MANUAL**



**MANAGEMENT AND STORAGE OF SURFACE WATERS**

*JULY 1996*

**TABLE OF CONTENTS**  
**PART D - PROJECT DESIGN AIDS**

---

	<b>PAGE</b>
TABLE OF CONTENTS (PART D) .....	D-2
1. INTRODUCTION .....	D-3
2. RAINFALL .....	D-4
<b>FIGURE D-1 - 24-HOUR, 2-YEAR RETURN PERIOD RAINFALL MAP</b> . . . .	D-5
<b>FIGURE D-2 - 24-HOUR, 2.33 (MAF) RETURN PERIOD RAINFALL MAP</b> . .	D-6
<b>FIGURE D-3 - 24-HOUR, 5-YEAR RETURN PERIOD RAINFALL MAP</b> . . . .	D-7
<b>FIGURE D-4 - 24-HOUR, 10-YEAR RETURN PERIOD RAINFALL MAP</b> . . .	D-8
<b>FIGURE D-5 - 24-HOUR, 25-YEAR RETURN PERIOD RAINFALL MAP</b> . . .	D-9
<b>FIGURE D-6 - 24-HOUR, 50-YEAR RETURN PERIOD RAINFALL MAP</b> . .	D-10
<b>FIGURE D-7 - 24-HOUR, 100-YEAR RETURN PERIOD RAINFALL MAP</b> .	D-11
<b>RAINFALL DISTRIBUTION</b> .....	D-12
<b>TABLE D-1 - RAINFALL RATIOS (ACCUMULATED 24-HOUR TOTAL)</b>	D-13

## 1. INTRODUCTION

The Southwest Florida Water Management District has developed "Part D, Project Design Aids" to provide consistency in the parameters used by District Staff in their review for environmental resource permitting of surface water management systems.

The design aids were selected solely on their ability to support the intent of the requirements in the environmental resource permitting rules for management and storage of surface waters and to identify some common and useful techniques for evaluating regulatory aspects of surface water management systems. The use of these design aids for purposes other than those stated in this manual may not be within the realm of their intended use and could result in a sub-standard design in some circumstances. It is therefore, incumbent upon the individual designer to exercise sound engineering judgement in the utilization of the information presented to ensure the overall integrity of the system and regulatory compliance.

## 2. Rainfall

### A. Rainfall Duration

The Southwest Florida Water Management District is utilizing a 24-hour storm event as the standard storm duration for design and analysis purposes for water quantity permitting evaluation of surface water management systems.

### B. Determination of Rainfall Depths

The Southwest Florida Water Management District has developed rainfall maps for a 24-hour storm duration for the 2-year, 2.33-year, 5-year, 10-year, 25-year, 50-year, and 100-year return periods, as shown in **FIGURES D-1 through D-7**. These rainfall maps will be utilized to determine a depth of rainfall in inches for a specific return period. This depth will be used for design and analysis purposes for evaluation of surface water and stormwater management systems.

### C. Procedure for Determination of the Appropriate Rainfall Amount

1. The approximate location of the project site is to be located on the appropriate rainfall frequency map.
2. For projects located on an isohyet use the rainfall amount for that line.
3. For projects east of the most eastern isohyet use that eastern most isohyet as the rainfall amount.
4. For projects between two isohyet the rainfall amount is a straight line interpolation between the two isohyet. The next higher isohyet line may be used rather than interpolating.
5. For projects west of the most western isohyet use that western most isohyet as the rainfall amount.

# SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT

TWENTY FOUR HOUR  
TWO YEAR  
RETURN PERIOD  
RAINFALL MAP



## LEGEND

- RAINFALL CONTOUR IN INCHES.
- BOUNDARY OF THE SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT
- - - COUNTY BOUNDARY

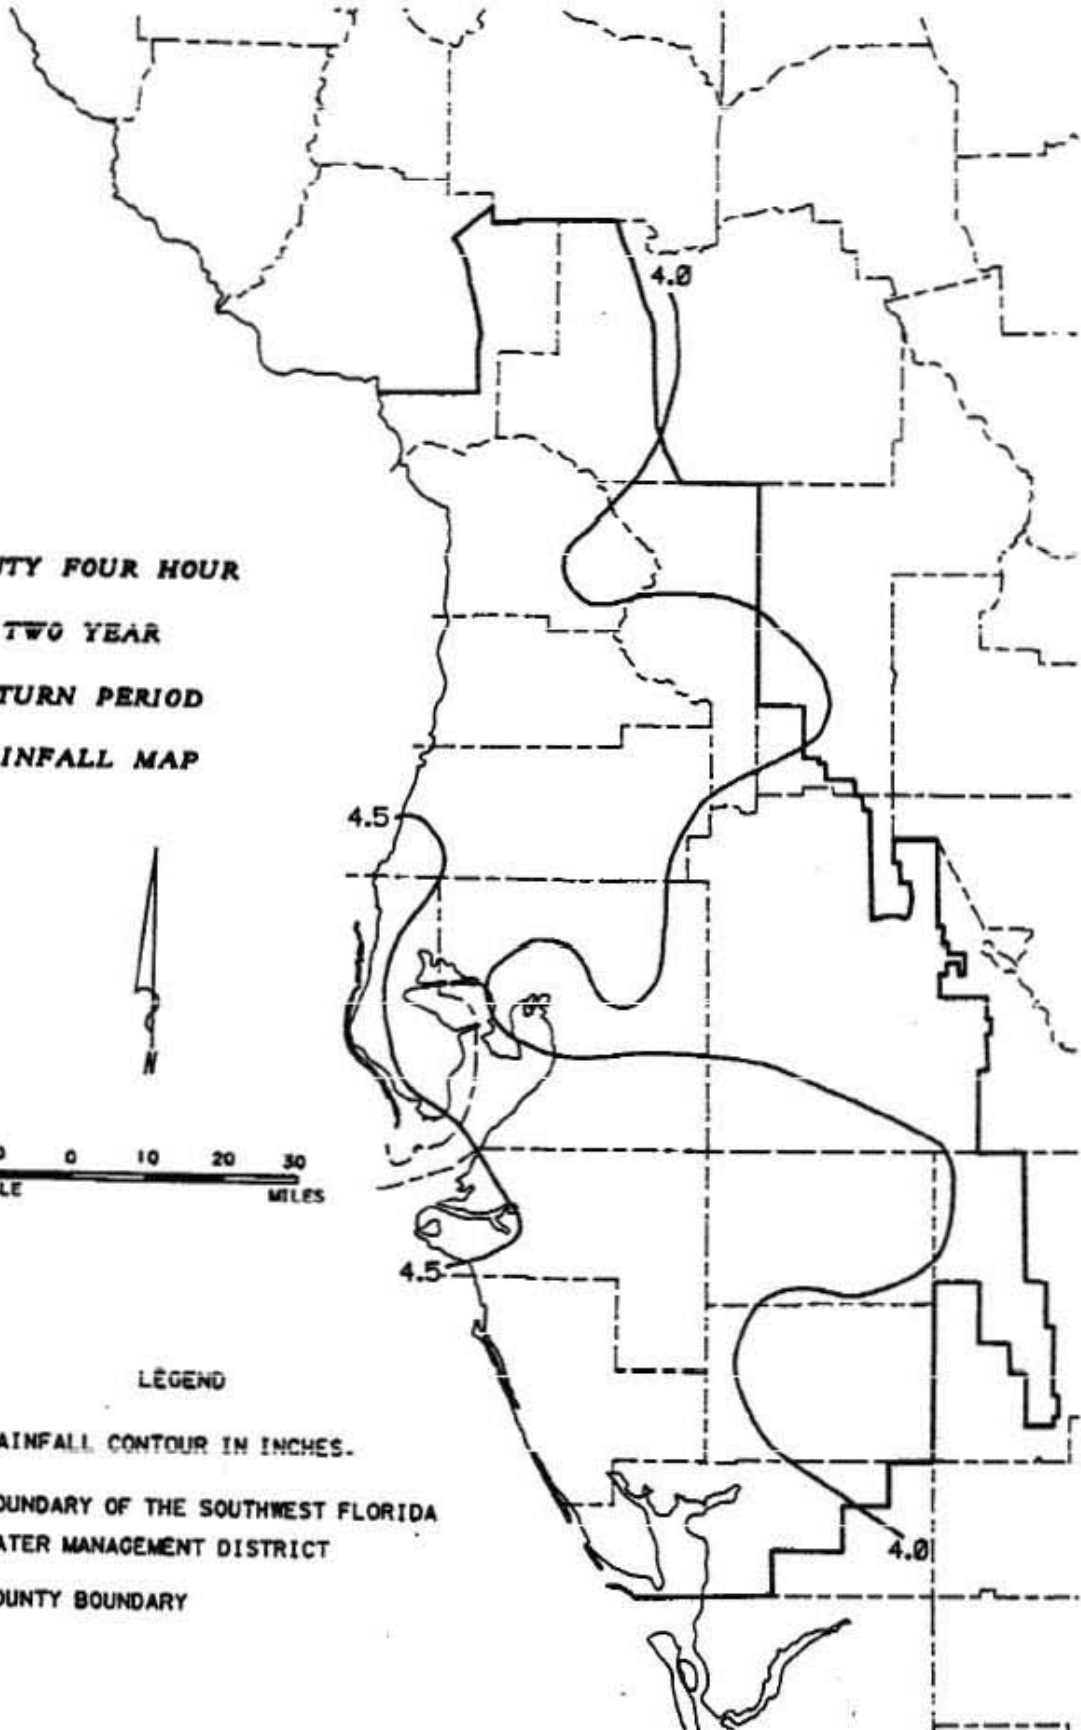


FIGURE D-1




# SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT

**TWENTY FOUR HOUR  
MEAN ANNUAL (2.33-YEARS)  
RETURN PERIOD  
RAINFALL MAP**



10 0 10 20 30  
SCALE MILES

## LEGEND

-  RAINFALL CONTOUR IN INCHES.
-  BOUNDARY OF THE SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT
-  COUNTY BOUNDARY

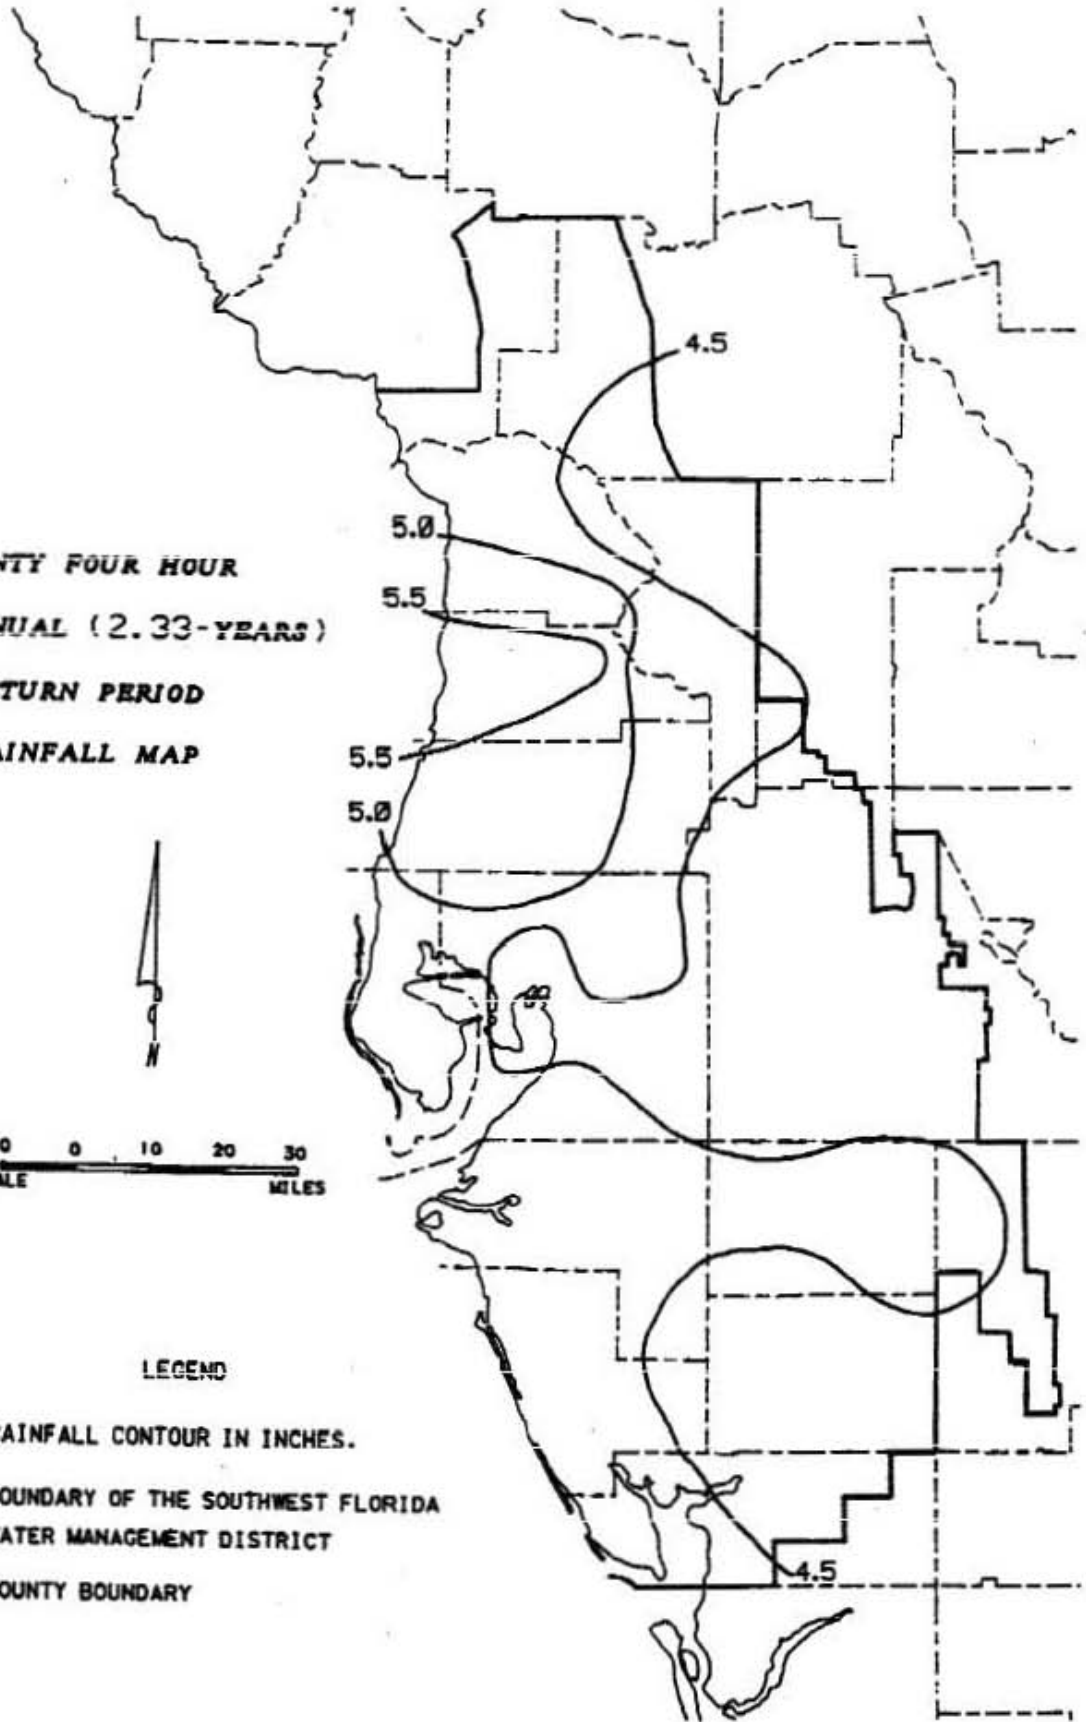


FIGURE D-2

# SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT

TWENTY FOUR HOUR  
FIVE YEAR  
RETURN PERIOD  
RAINFALL MAP








FIGURE D-3


**SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT**

**TWENTY FOUR HOUR  
TEN YEAR  
RETURN PERIOD  
RAINFALL MAP**

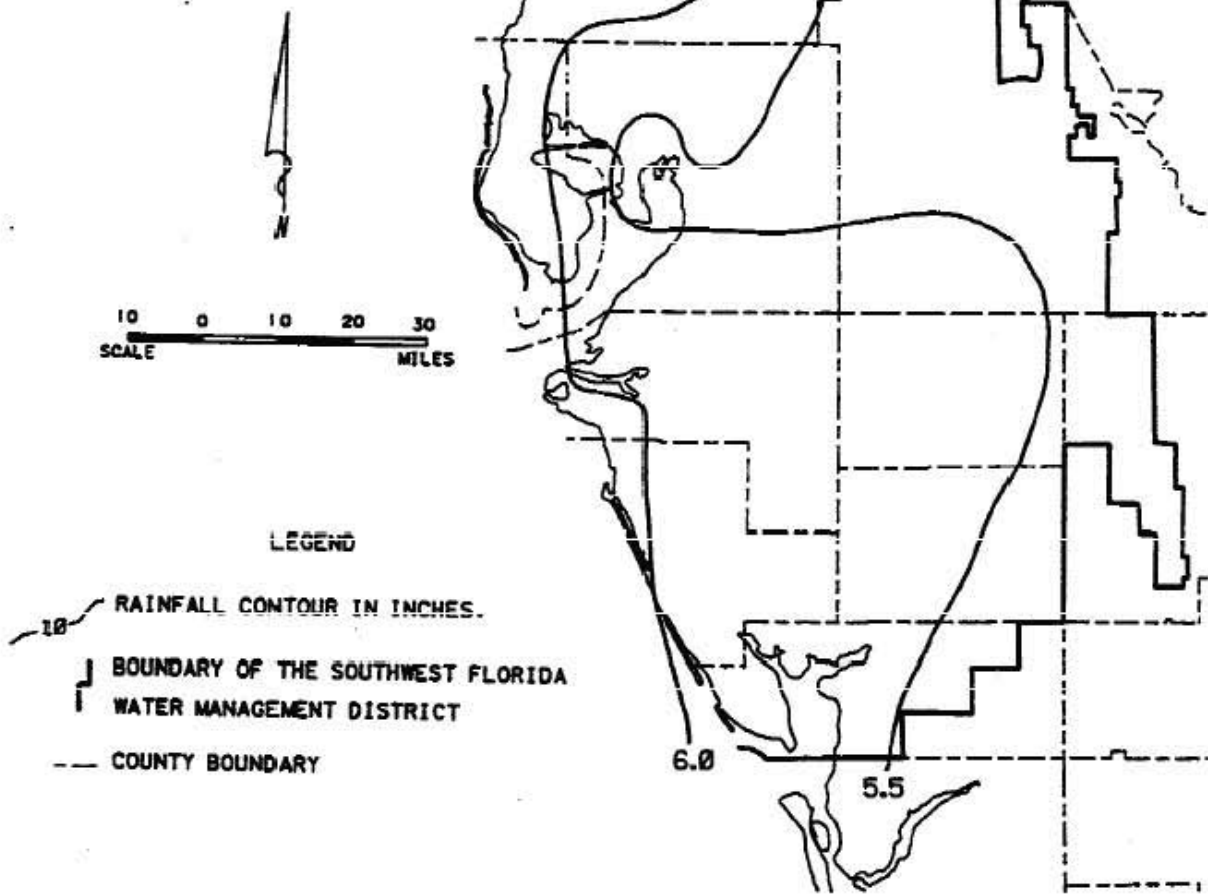

**LEGEND**


-  RAINFALL CONTOUR IN INCHES.
-  BOUNDARY OF THE SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT
-  COUNTY BOUNDARY

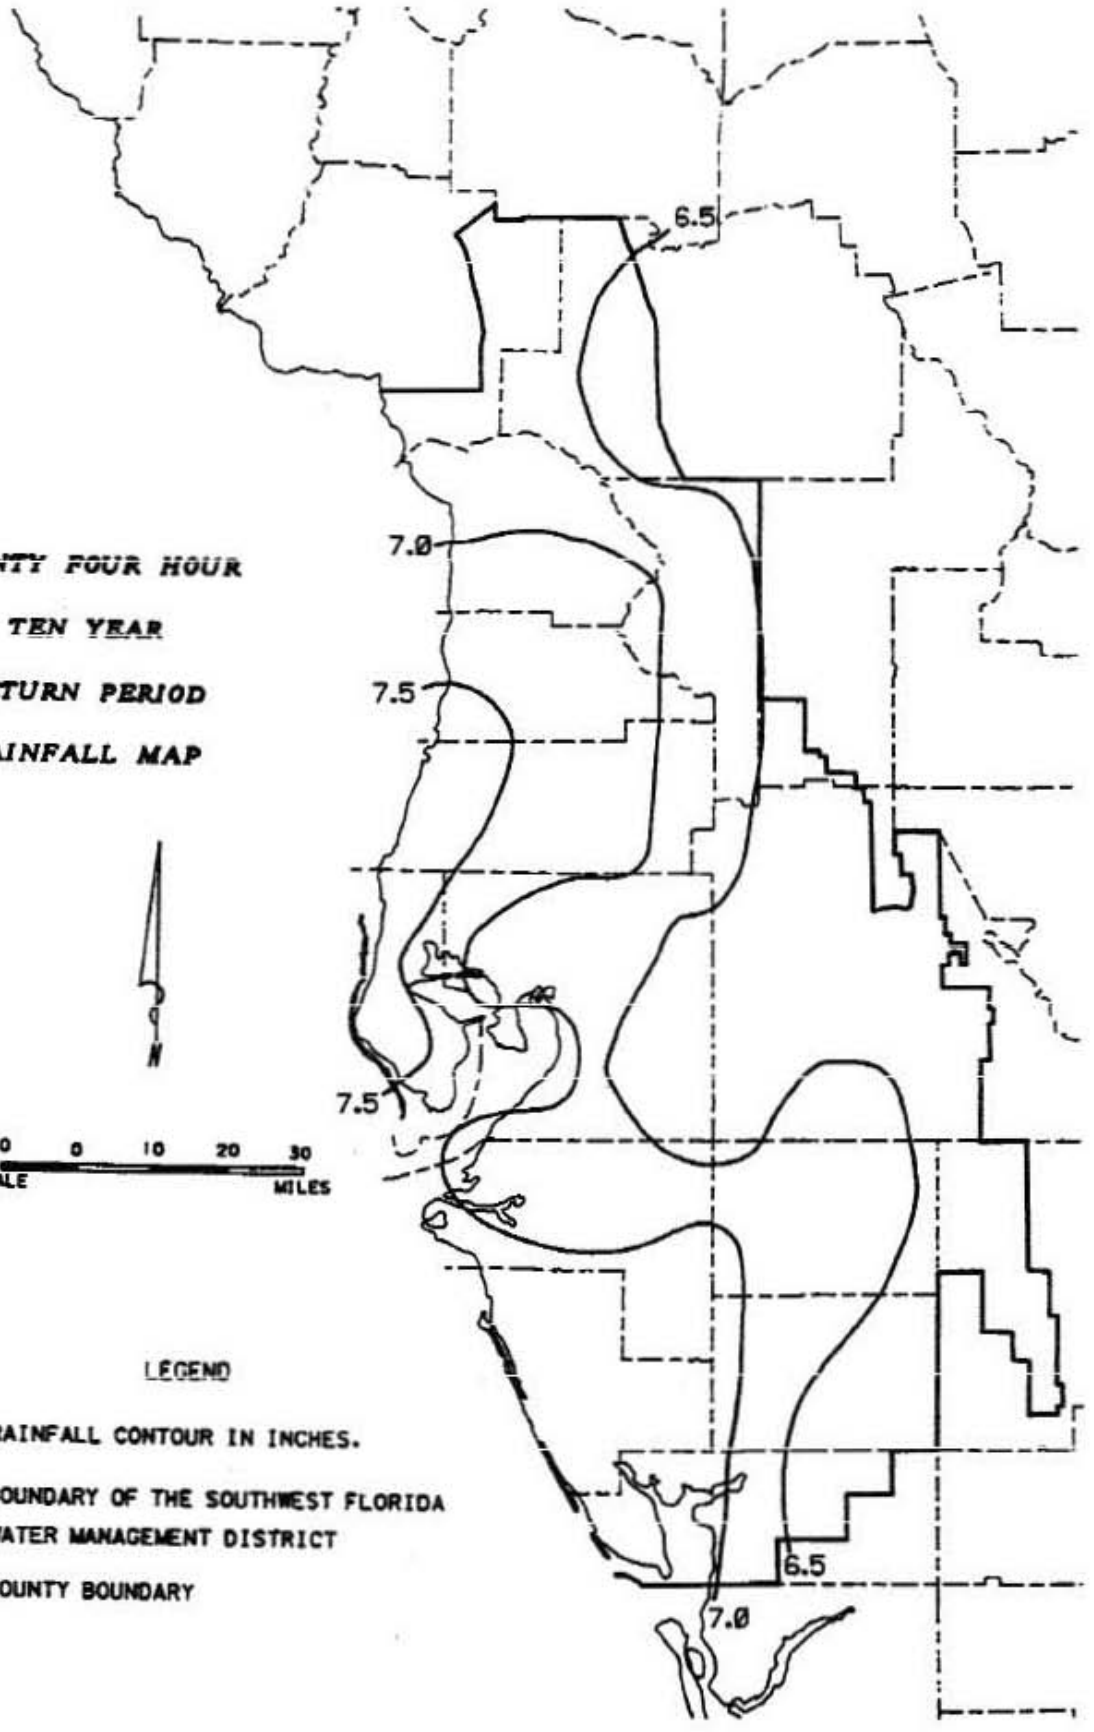

**FIGURE D-4**

# SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT

**TWENTY FOUR HOUR  
TWENTY FIVE YEAR  
RETURN PERIOD  
RAINFALL MAP**

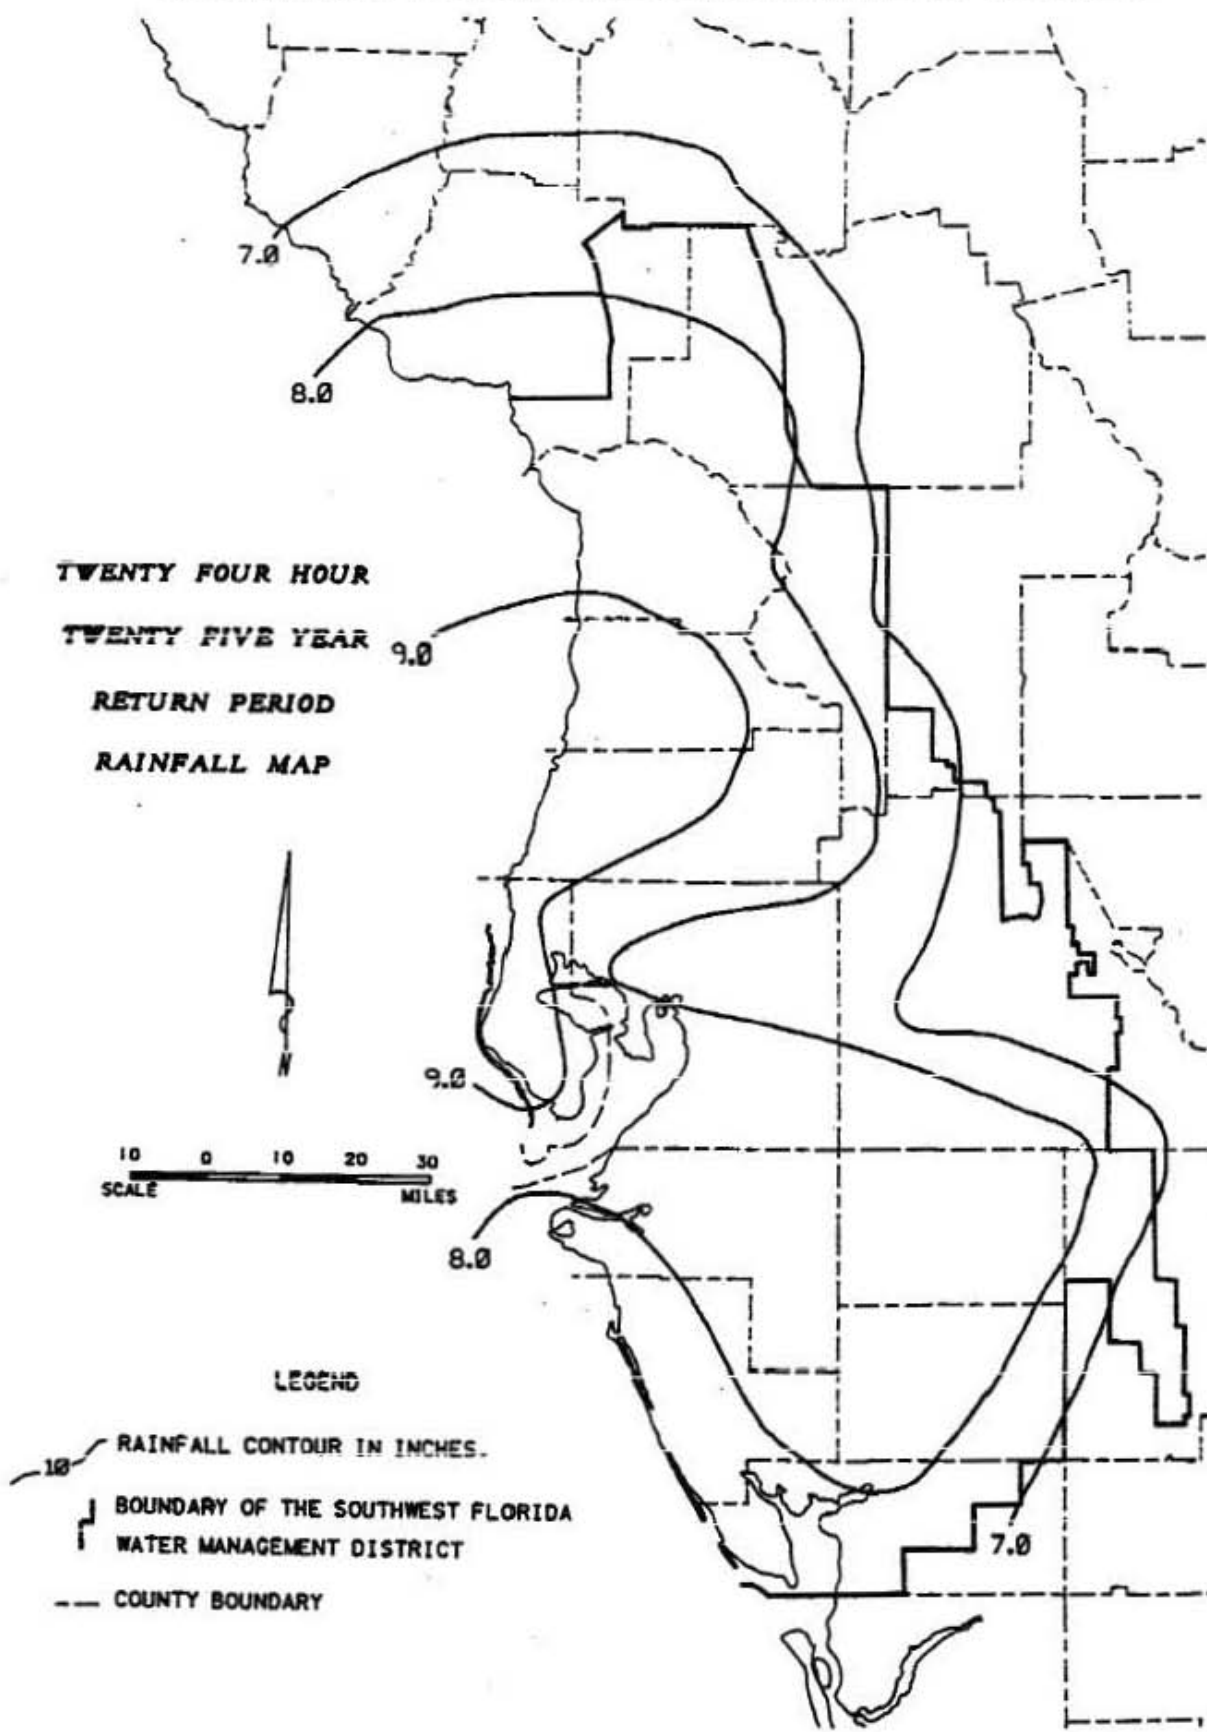

### LEGEND





-  RAINFALL CONTOUR IN INCHES.
-  BOUNDARY OF THE SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT
-  COUNTY BOUNDARY

FIGURE D-5

# SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT

TWENTY FOUR HOUR  
FIFTY YEAR  
RETURN PERIOD  
RAINFALL MAP



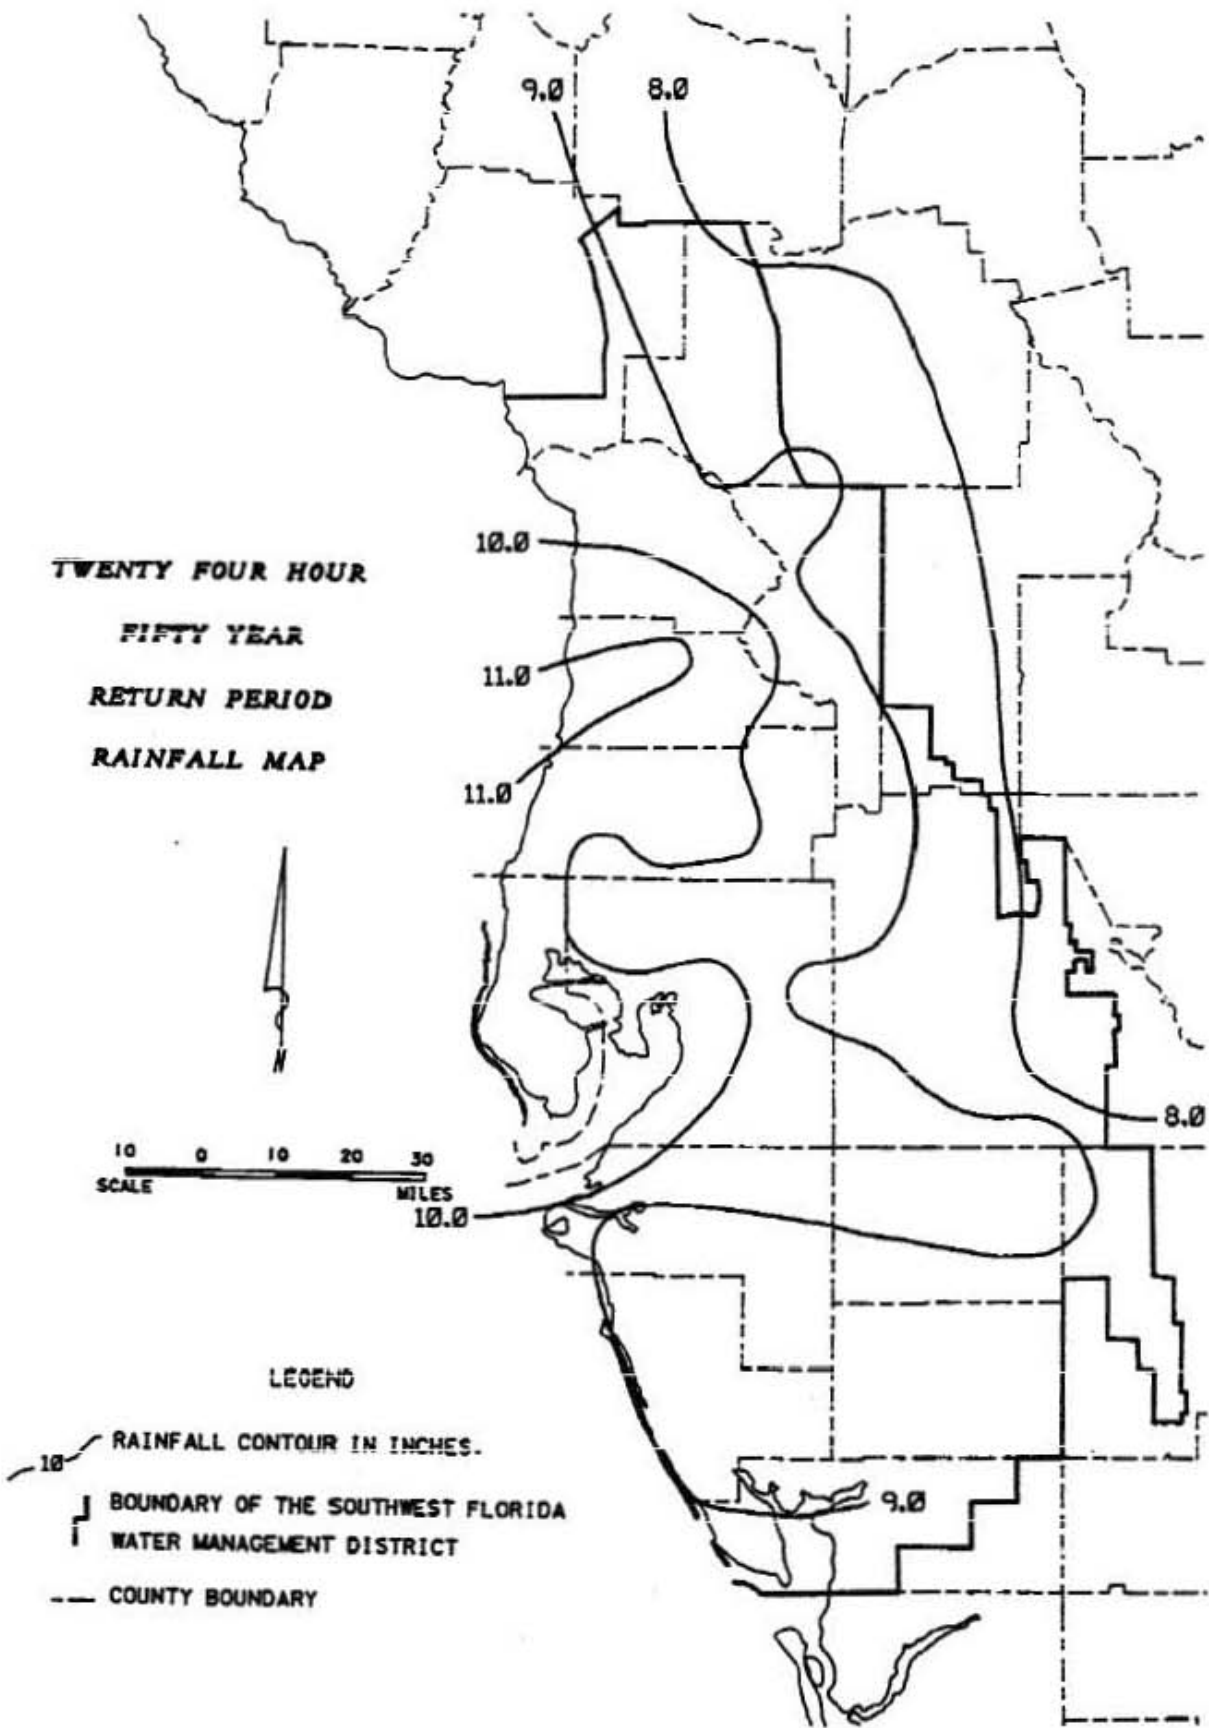
## LEGEND

- 10- RAINFALL CONTOUR IN INCHES.
- ┌ BOUNDARY OF THE SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT
- - - COUNTY BOUNDARY




FIGURE D-6

# SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT

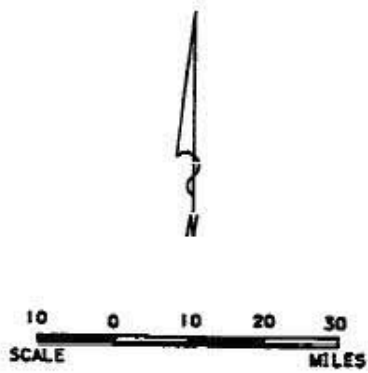**TWENTY FOUR HOUR  
ONE HUNDRED YEAR  
RETURN PERIOD  
RAINFALL MAP**



## LEGEND

-  RAINFALL CONTOUR IN INCHES.
-  BOUNDARY OF THE SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT
-  COUNTY BOUNDARY

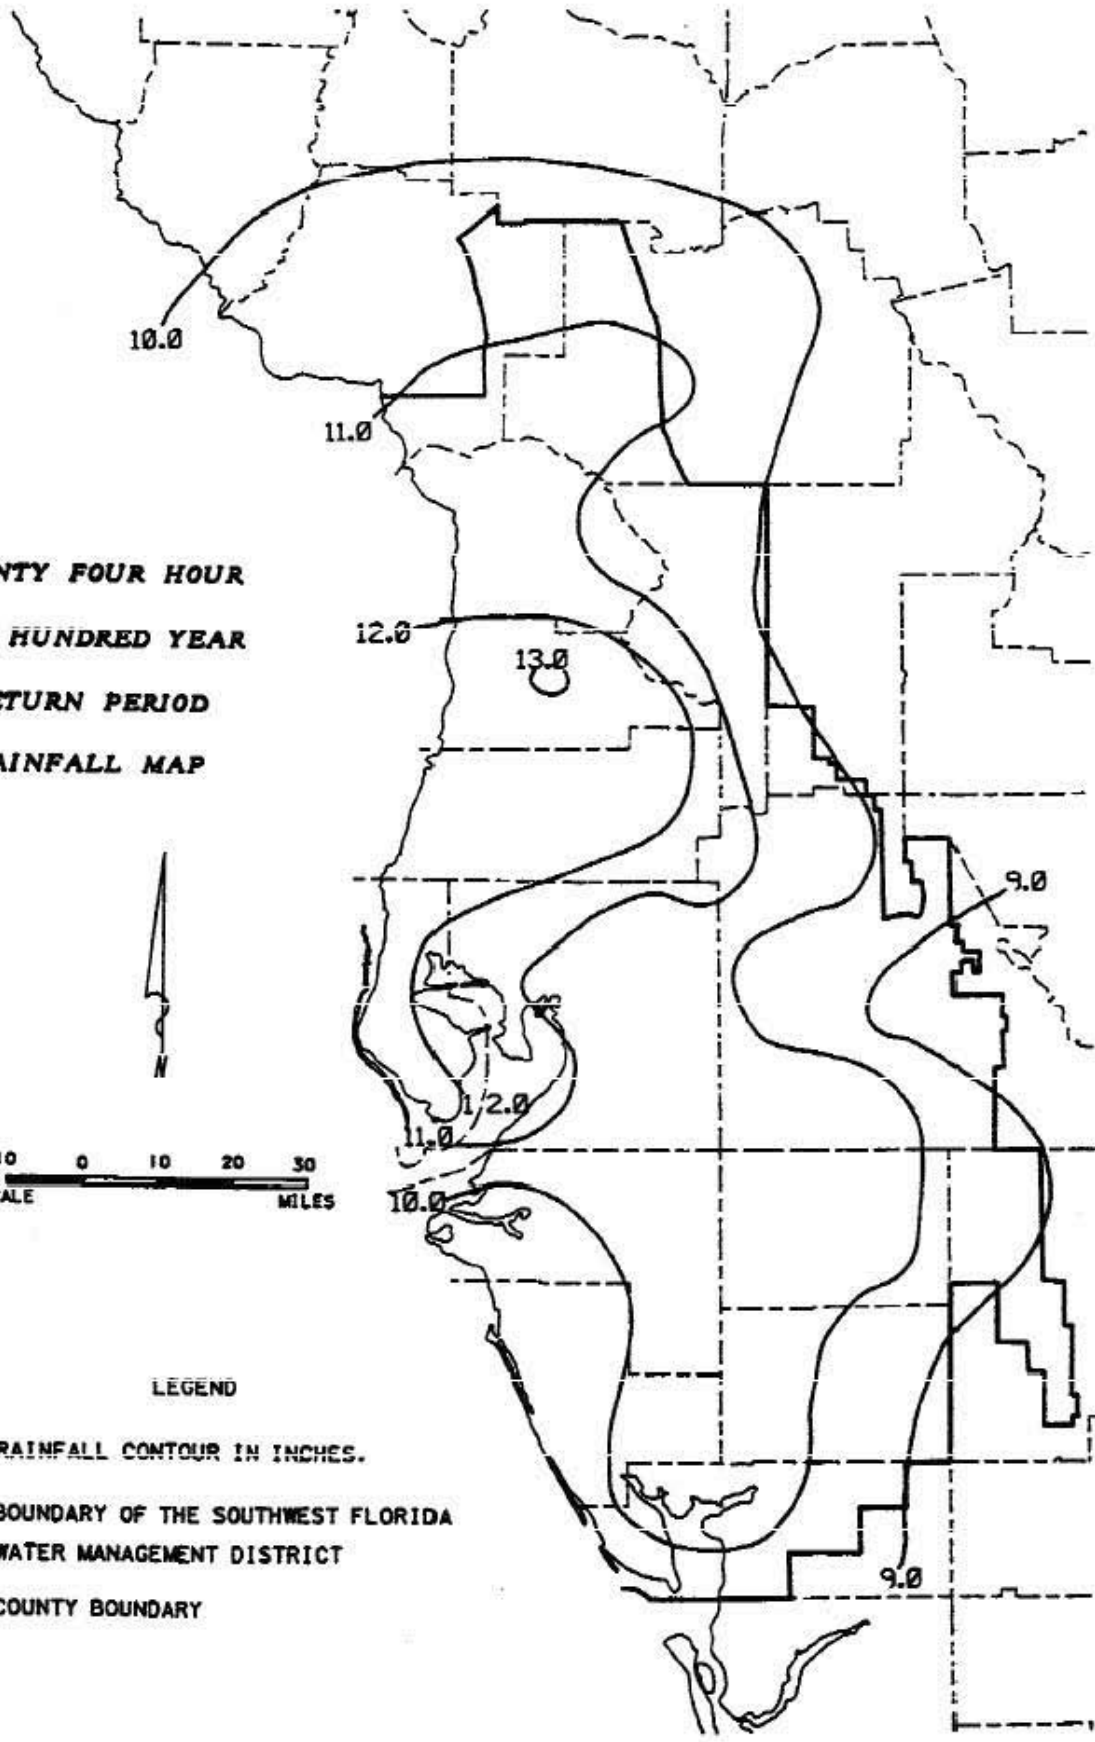


FIGURE D-7

#### D. Rainfall Distribution

The USDA-Natural Resources Conservation Service [formerly Soil Conservation Service (SCS)] Type II Florida Modified Rainfall distribution shown in **TABLE D-1** is recommended for use in the analysis of the water quantity portion of the rule. Other distributions which produce similar results may also be used if appropriate.

**TABLE D-1**  
**RAINFALL RATIOS (ACCUMULATED 24-HOUR TOTAL)**

<u>TIME (HR.)</u>	<u>SCS TYPE II FL. MODIFIED</u>
0.0	.000
0.5	.006
1.0	.012
1.5	.019
2.0	.025
2.5	.032
3.0	.039
3.5	.047
4.0	.054
4.5	.062
5.0	.071
5.5	.080
6.0	.089
6.5	.099
7.0	.110
7.5	.122
8.0	.134
8.5	.148
9.0	.164
9.5	.181
10.0	.201
10.5	.226
11.0	.258
11.5	.308
12.0	.607
12.5	.719
13.0	.757
13.5	.785
14.0	.807
14.5	.826
15.0	.842
15.5	.857
16.0	.870
16.5	.882
17.0	.893
17.5	.904
18.0	.913
18.5	.923
19.0	.931
19.5	.940
20.0	.948
20.5	.955
21.0	.962
21.5	.969
22.0	.976
22.5	.983
23.0	.989
23.5	.995
24.0	1.000