




LRA Service Water Unit 2

ENT000420
Submitted: March 30, 2012

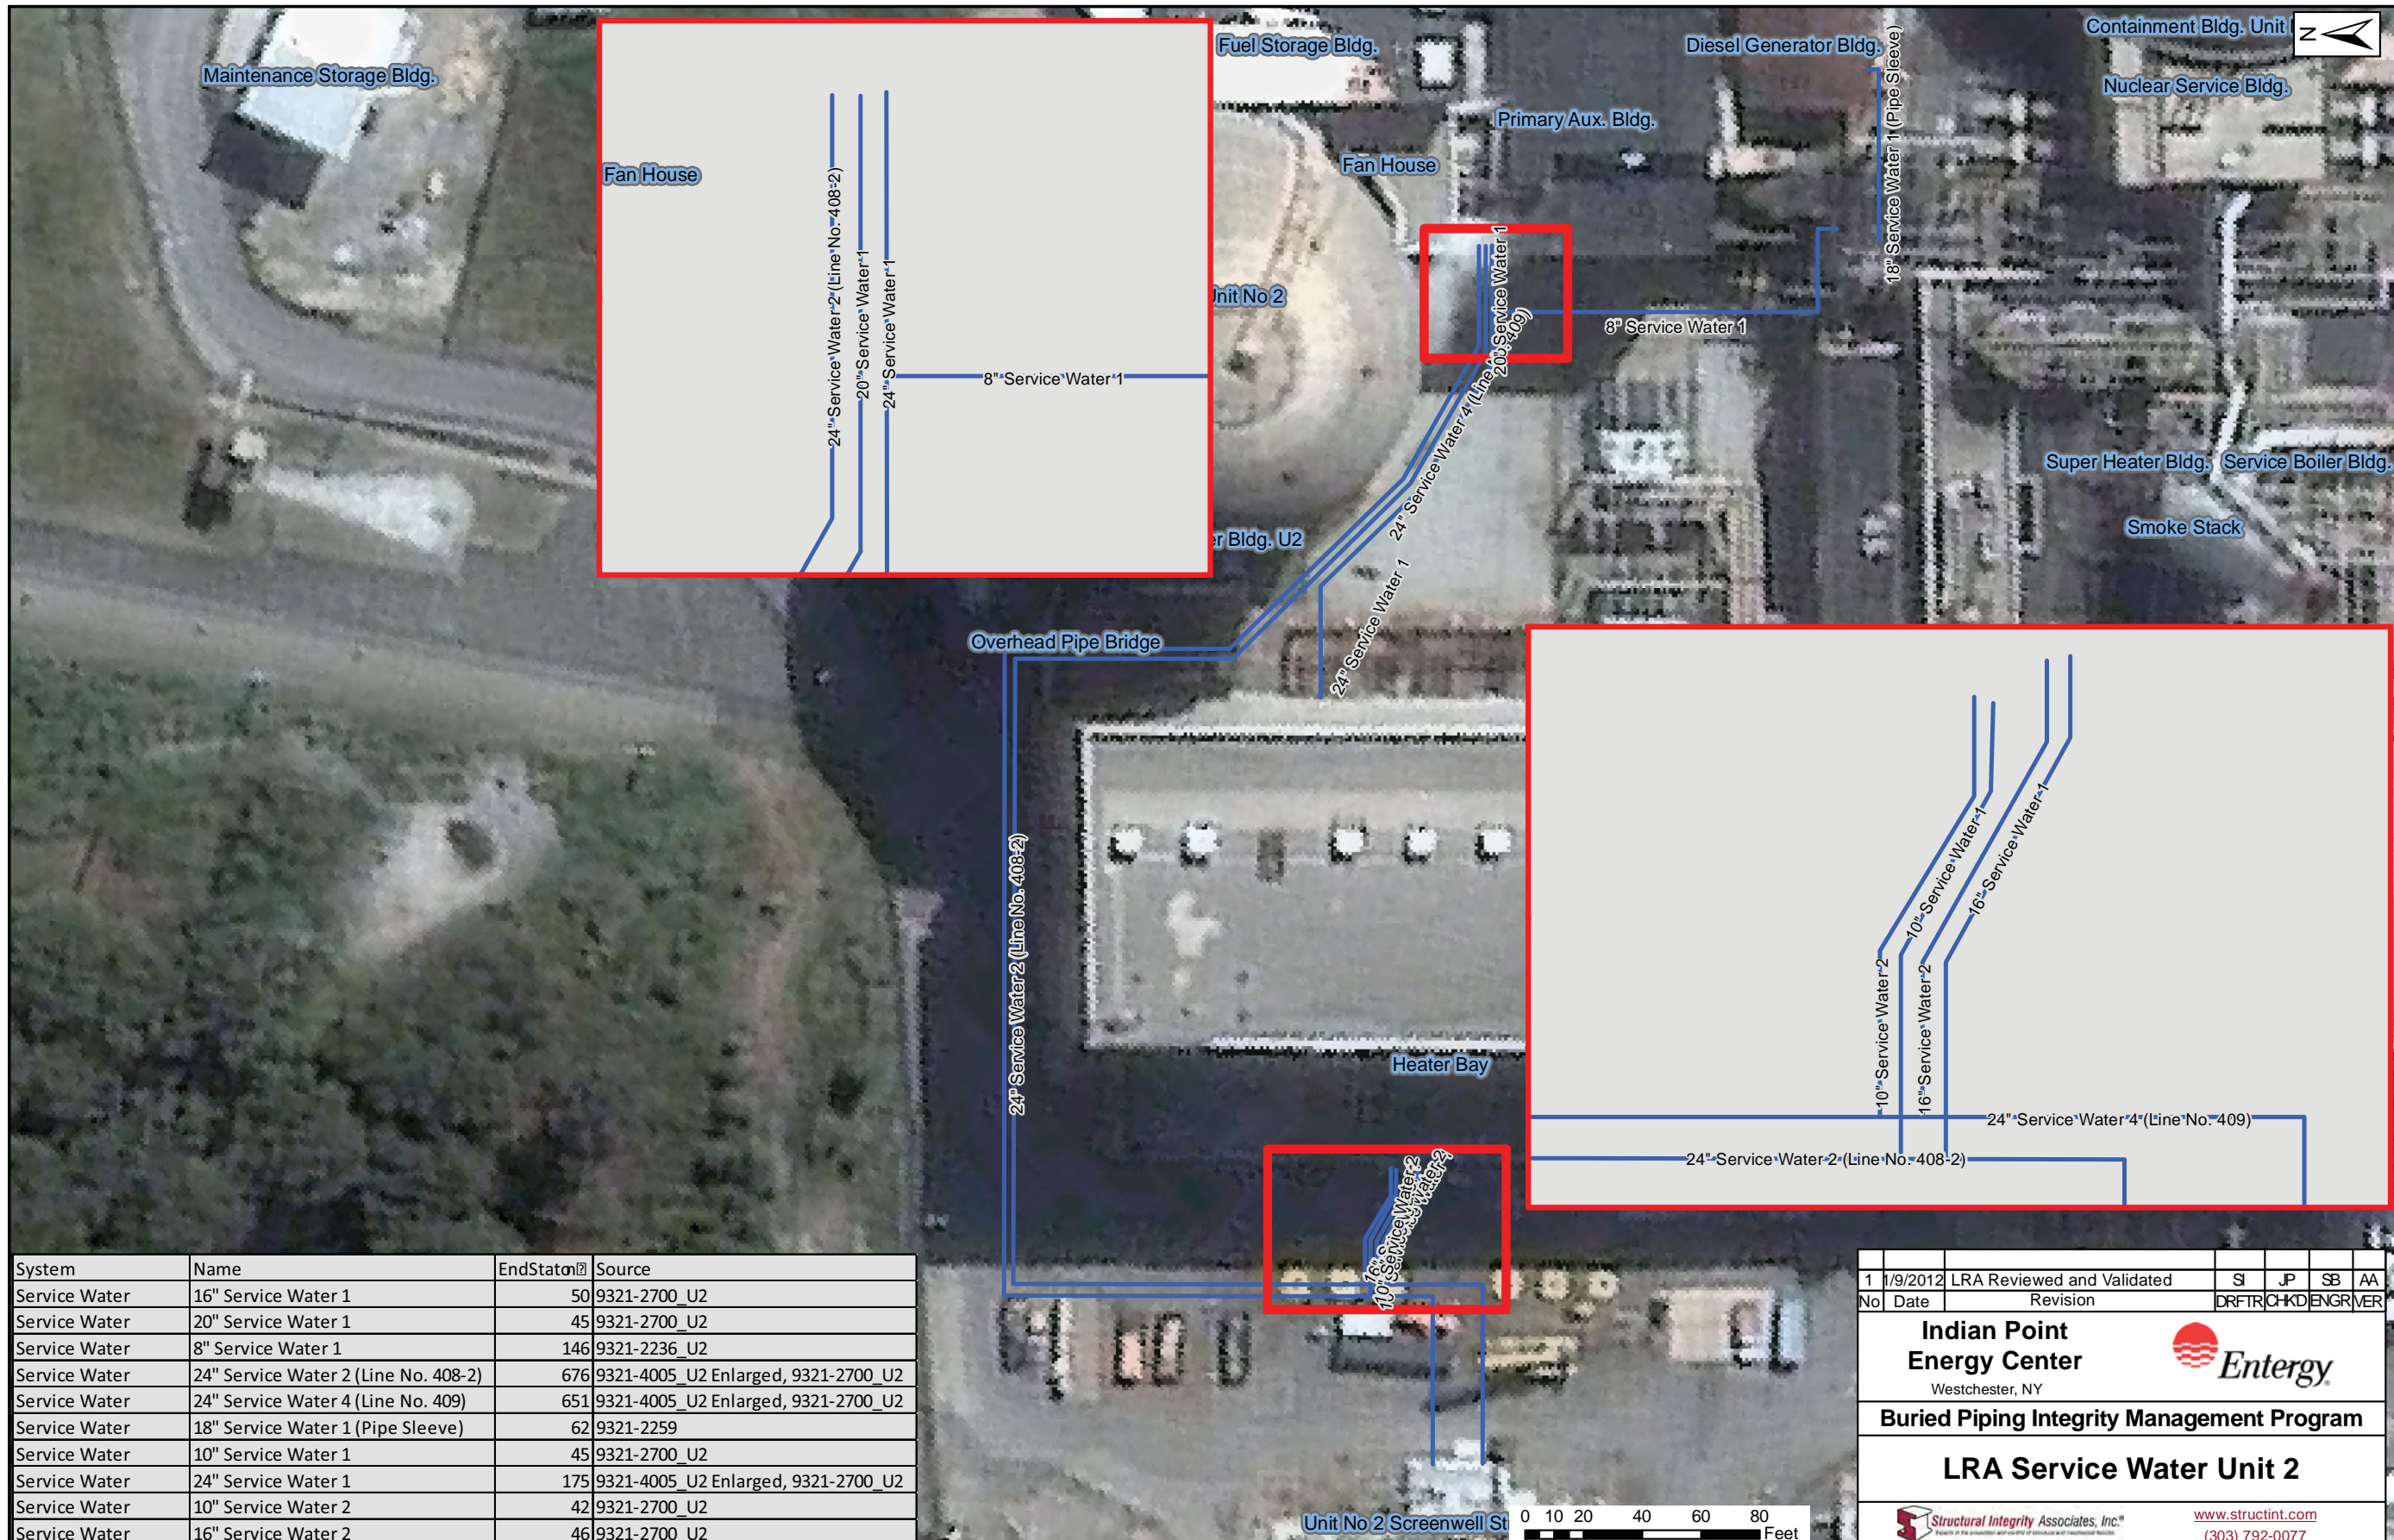

System	Name	EndStation	Source
Service Water	16" Service Water 1	50	9321-2700_U2
Service Water	20" Service Water 1	45	9321-2700_U2
Service Water	8" Service Water 1	146	9321-2236_U2
Service Water	24" Service Water 2 (Line No. 408-2)	676	9321-4005_U2 Enlarged, 9321-2700_U2
Service Water	24" Service Water 4 (Line No. 409)	651	9321-4005_U2 Enlarged, 9321-2700_U2
Service Water	18" Service Water 1 (Pipe Sleeve)	62	9321-2259
Service Water	10" Service Water 1	45	9321-2700_U2
Service Water	24" Service Water 1	175	9321-4005_U2 Enlarged, 9321-2700_U2
Service Water	10" Service Water 2	42	9321-2700_U2
Service Water	16" Service Water 2	46	9321-2700_U2

1	10/9/2012	LRA Reviewed and Validated	SI	JP	SB	AA
No	Date	Revision	DR	TR	CH	ENGR

Indian Point Energy Center
Westchester, NY

Buried Piping Integrity Management Program

LRA Service Water Unit 2

Structural Integrity Associates, Inc.®
www.structint.com
(303) 792-0077