

U.S. ATOMIC ENERGY COMMISSION

Revision 1
12/28/72

REGULATORY GUIDE

DIRECTORATE OF REGULATORY STANDARDS

REGULATORY GUIDE 1.18

STRUCTURAL ACCEPTANCE TEST FOR CONCRETE PRIMARY REACTOR CONTAINMENTS¹

A. INTRODUCTION

General Design Criterion 1, "Quality Standards and Records," of Appendix A to 10 CFR Part 50, "General Design Criteria for Nuclear Power Plants," requires that structures, systems, and components of nuclear power plants important to safety be tested to quality standards commensurate with the importance of the safety function to be performed. This guide describes an acceptable method of implementing this requirement with regard to the initial structural acceptance test, which demonstrates the capability of a concrete primary reactor containment to withstand postulated pressure loads. The tests demonstrating that the leakage through the containment is within acceptable limits are not covered by this guide. The Advisory Committee on Reactor Safeguards has been consulted concerning this guide and has concurred in the regulatory position.

B. DISCUSSION

"Primary reactor containment" for a water-cooled nuclear power plant is the structure or vessel that encloses the components of the reactor coolant pressure boundary as defined in § 50.2(v) of 10 CFR Part 50, and serves as a leakage-limiting barrier to radioactive materials released from the reactor coolant pressure boundary. The energy in the reactor coolant that might be discharged from the reactor coolant system into the primary reactor containment during a loss of coolant accident would cause a significant pressure load on the containment. An acceptance test is commonly used to confirm that the design and configuration of the containment are adequate to withstand such pressure loading. The test demonstrates that when the containment is pressurized the deflections of the

containment's structural elements and the cracks of its surface concrete are within acceptable limits.

During the test the containment is pressurized in increments up to the maximum test pressure. This allows an evaluation of its deflections as a function of internal pressure as the test proceeds, and provides a means of depressurizing the containment if its response deviates significantly from the expected response. The number of pressure increments is chosen to provide sufficient data points for the evaluation of the containment's response. The maximum test pressure adopted follows the practice employed for steel pressure vessels.

The radial and vertical deflections of the pressurized containment are measured at several locations around its circumference to determine the increase in tensile stresses including those due to possible initial out-of-roundness of the nominally cylindrical containment. Strain and crack widths are measured, and crack patterns are recorded at locations of predicted high stress to confirm the designer's stress analysis. Because the strain measurements can be correlated to deflection measurements obtained in previous tests on prototype² containments, strain measurements are not taken during subsequent acceptance tests of nonprototype containments.

Appropriate reports are prepared to confirm the design. These reports can be used at some future date to evaluate any significant deterioration of the structure.

¹ This guide is a revision of former Safety Guide 18. As such, it is applicable to water-cooled nuclear power reactors.

² A prototype containment is one that incorporates a new or unusual design feature not yet confirmed by tests, as discussed in Appendix A of this guide.

USAEC REGULATORY GUIDES

Regulatory Guides are issued to describe and make available to the public methods acceptable to the AEC Regulatory staff of implementing specific parts of the Commission's regulations, to delineate techniques used by the staff in evaluating specific problems or postulated accidents, or to provide guidance to applicants. Regulatory Guides are not substitutes for regulations and compliance with them is not required. Methods and solutions different from those set out in the guides will be acceptable if they provide a basis for the findings requisite to the issuance or continuance of a permit or license by the Commission.

Published guides will be revised periodically, as appropriate, to accommodate comments and to reflect new information or experience.

Copies of published guides may be obtained by request indicating the divisions desired to the U.S. Atomic Energy Commission, Washington, D.C. 20545, Attention: Director of Regulatory Standards. Comments and suggestions for improvements in these guides are encouraged and should be sent to the Secretary of the Commission, U.S. Atomic Energy Commission, Washington, D.C. 20545, Attention: Chief, Public Proceedings Staff.

The guides are issued in the following ten broad divisions:

- | | |
|-----------------------------------|------------------------|
| 1. Power Reactors | 6. Products |
| 2. Research and Test Reactors | 7. Transportation |
| 3. Fuels and Materials Facilities | 8. Occupational Health |
| 4. Environmental and Siting | 9. Antitrust Review |
| 5. Materials and Plant Protection | 10. General |

C. REGULATORY POSITION

1. Concrete primary reactor containments should be subjected to an acceptance test that increases the containment's internal pressure in four or more approximately equal pressure increments from atmospheric pressure to at least 1.15 times the containment design pressure. The containment should be depressurized in the same number of increments. Measurements should be recorded at atmospheric pressures and at each pressure level of the pressurization and depressurization cycles. At each level, the pressure should be held constant for at least one hour before the deflections and strains are recorded. Crack patterns should be recorded at atmospheric pressure both before and immediately after the test and at the maximum pressure level achieved during the test.

2. So that a complete picture of the containment's overall deflection pattern can be determined, the radial deflections of the containment should be measured at several points along six meridians spaced around the containment, including locations with varying stiffness characteristics such as buttress, wall, large opening, and connections with other structures.

Vertical deflections of the containment should be measured at the apex and the springline of the dome. For cylindrical containments, these points should be located as shown on Figure A. For cone-cylinder containments, these points should be located as shown on Figure B.

3. The radial and tangential deflections of the containment wall adjacent to the largest opening should be measured at twelve points as shown on Figure C. If the second largest opening is structurally loaded in a different manner from the largest opening, similar measurements should be made. The measurement points can be varied or relocated for openings with different configurations, taking into account the distribution of stresses and deformations anticipated in the particular designs.

4. The pattern of cracks that exceed 0.01 inch in width before, during, or after the test should be mapped near the base-wall intersection, at midheight of the wall, at the springline of the dome, around the largest opening, and around the second largest opening if structurally loaded in a different manner from the largest opening. In prestressed containments, the crack pattern should also be mapped at the intersection between a buttress and the wall, at the intersection between the top ring girder and the wall, and on the top shelf of the ring girder. At each location an area of at least 40 square feet should be mapped.

5. In prototype containments only, strain measurements in the concrete sufficient to permit a complete evaluation of strain distribution should be determined at the following locations in the wall:

- a. at the top of the base mat on one meridian;

- b. at the largest opening, approximately 0.5t from the edge of the opening, (t being the wall thickness at the edge of the opening); and

- c. at the level of the springline of the dome on one meridian.

These measurements should be made at three positions within the wall, i.e., near the inside face, at the midpoint, and near the outside face. In a prototype prestressed containment the vertical, horizontal, and shear strains in the concrete should be measured under one prestressing anchor of a vertical tendon. This measurement should be made at a distance below the base plate of one-half the width of the base plate and at a distance measured normal to the wall from the centerline of the tendon of approximately one and one-half tendon duct diameters.

6. In nonprototype containments strain measurements need not be made if strain levels have been correlated with deflection measurements during the acceptance test of a prototype containment.

7. Any reliable system of displacement meters, optical devices, strain gauges, or other suitable apparatus may be used for the measurements.

8. The environmental conditions during the test should be measured in such a manner and to such an extent that will permit the evaluation of their contributions to the response of the containment. Inside and outside of the containment, atmospheric temperature, pressure, and humidity should be monitored continuously during the test. In addition, the temperatures inside and outside the containment should be measured for sufficiently long periods of time prior to the test to establish an average temperature of the wall to be used in evaluating the effects of temperature changes on the deflection and strain measurements.

9. The environmental conditions under which the test may be conducted should be specified. The test should not be conducted under extreme weather conditions, such as snow, heavy rain, or strong wind.

10. If the test pressure drops due to unexpected conditions to or below the next lower pressure level, the entire test sequence should be repeated. Significant deviations from the previous test should be recorded and evaluated.

11. If any significant modifications or repairs are made to the containment following the test, the test should be repeated.

12. The following information should be included in the Preliminary Safety Analysis Report:

- a. a description of the proposed acceptance test;
- b. the numerical values of the predicted response of the structure which will be measured;
- c. the tolerances to be permitted on the predicted response in the acceptance test; and
- d. the bases on which the predicted response and the tolerances were established.

13. The following information should be included in the final test report:


a. a description of the test procedure and the instrumentation;

b. a comparison of the test measurements with the allowable limits (predicted response plus tolerance) for deflections, strains, and crack width;

c. an evaluation of the estimated accuracy of the measurements;

d. an evaluation of any deviations (i.e., test results that exceed the allowable limits), the disposition of the deviations, and the need for corrective measures; and

e. a discussion of the calculated safety margin provided by the structure as deduced from the test results.

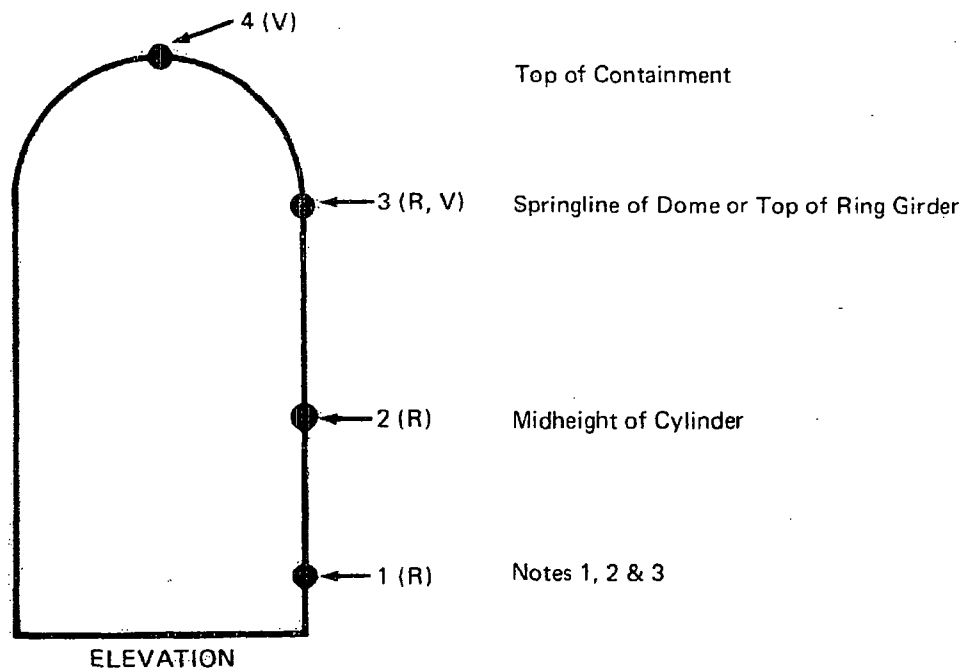


NOTES:

1. Radial (R) and Vertical (V) deflections should be measured at the points indicated by (R) and (V).
2. Where a rigid base/wall joint is used, Point 1 should be above the base of the wall at a distance equal to three times the thickness of the wall at the location where the deflection is measured.
3. Where a non-rigid base/wall joint is used, Point 1 should be at the base of the wall.

CYLINDRICAL CONTAINMENTS

FIGURE A

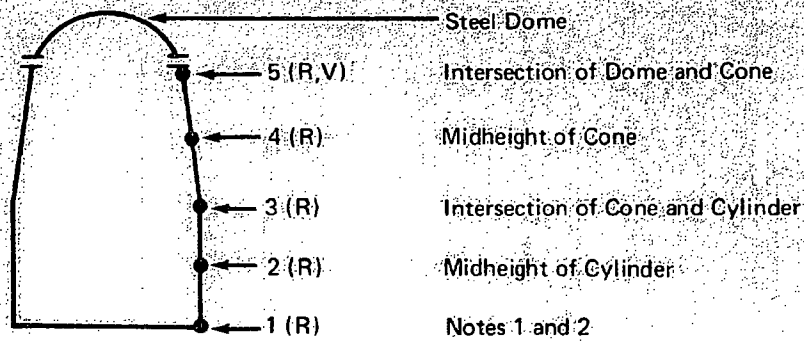


NOTES:

1. Radial (R) and Vertical (V) deflections should be measured at the points indicated by (R) and (V).
2. Point 1 should be above the base of the wall a distance equal to three times the thickness of the wall at the location where the deflection is measured.
3. Test Points 2 and 4 may be adjusted to fall midway between floor locations.

CONE-CYLINDER CONTAINMENTS

FIGURE B

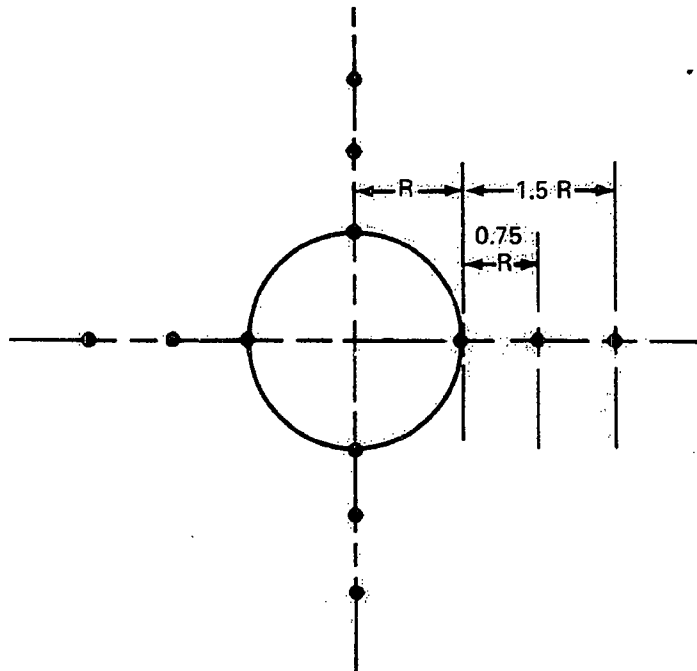

NOTES:

1. All points should be located symmetrically about the opening.
2. Deflections radial and tangential to the containment wall should be measured at each of the twelve points indicated.
3. See paragraph C.3.

LARGEST OPENING IN CONTAINMENT

FIGURE C

APPENDIX A

PROTOTYPE CONCRETE PRIMARY REACTOR CONTAINMENTS

The initial primary reactor containment that incorporates a new or unusual design feature is considered to be a prototype containment. Specific examples of design features that at this date would be considered to be indicative of a prototype containment are given below.

1. Conventional Reinforced Concrete Containment

A concrete primary reactor containment is considered a prototype if it is the first design to incorporate any of the following features:

- a. A dome with a shape other than hemispherical;
- b. An opening larger than $0.2D$ ³;
- c. Two openings with a diameter greater than $0.15D$ that are separated by a distance less than $0.2D$;
- d. A connection of the cylindrical wall to the bottom slab or to the dome by a sliding joint, a hinge, or a combination of hinge and sliding joint;
- e. A pattern of main reinforcing other than vertical straight bars and horizontal hoops;
- f. An intermediate interior floor connected to the wall or
- g. Any other structural design feature that may decrease the safety margins from those of a containment confirmed by an acceptance test.

³ D = internal diameter of the cylindrical part of the containment.

2. Prestressed Concrete Containment

A prestressed concrete primary reactor containment with grouted or ungrouted tendons is considered a prototype if it is the first design to incorporate any of the features below:

- a. A number of buttresses other than six;
- b. Any buttresses in the dome;
- c. A pattern of tendons other than vertical tendons and hoop tendons in the wall, and three groups of tendons oriented at 60° in the dome;
- d. A prestressed dome with a shape other than ellipsoidal on top;
- e. A base other than a conventionally reinforced flat slab;
- f. A general containment shape different than a vertical cylinder;
- g. Individual tendons with ultimate strength greater than 500 tons;
- h. An opening larger than $0.2D$ ³;
- i. Two openings with a diameter greater than $0.15D$ separated by a distance less than $0.2D$;
- j. A connection of the cylindrical wall to the bottom slab or to the top dome by a sliding joint, a hinge, or a combination of hinge and sliding joint;
- k. An intermediate interior floor connected to the wall or
- l. Any other structural design feature that may decrease the safety margins from that of a containment confirmed by an acceptance test.