
Figure 2.5.7-1—Non-Class 1E Uninterruptible Power Supply System Functional Arrangement

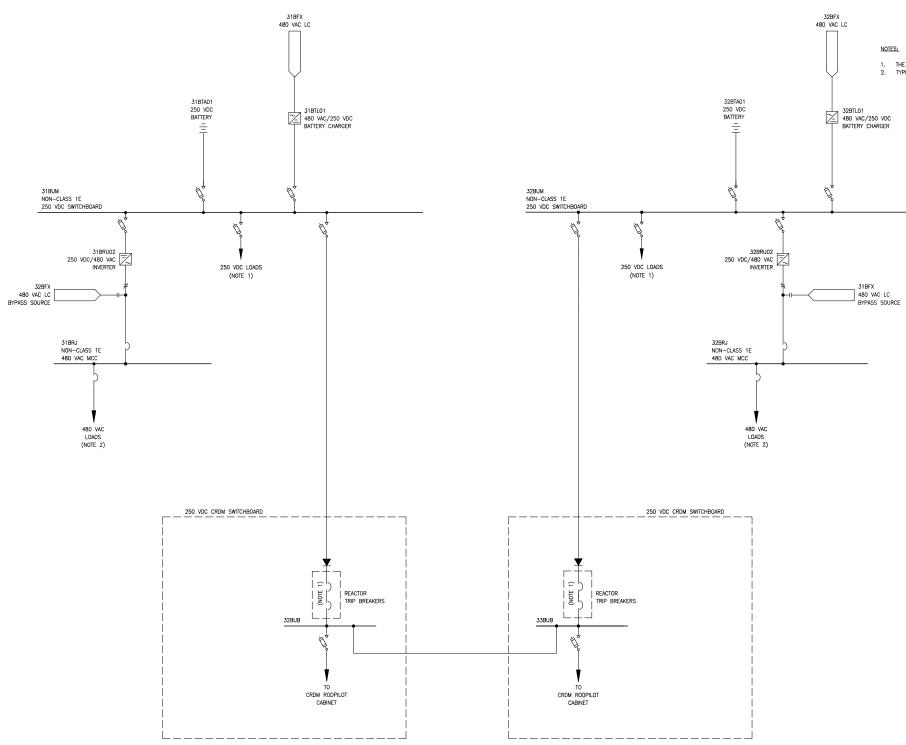

NOTES:

THE REACTOR TRIP BREAKERS ARE CLASS 1E.
TYPICAL OF ONE OR MORE.

REV 002 NUPS01 T1