



Well Identification	Surficial Water Level Elevation (feet NGVD29)
MWA-1S	255.09
MWA-2S	254.11
MWA-3S	258.03
MWA-4S	254.85
MWA-5S	252.11
MWA-6S	237.95
MWA-7S	271.13
MWA-8S	257.06
MWA-9S	243.51
MWA-10S	258.99
MWA-11S	231.46

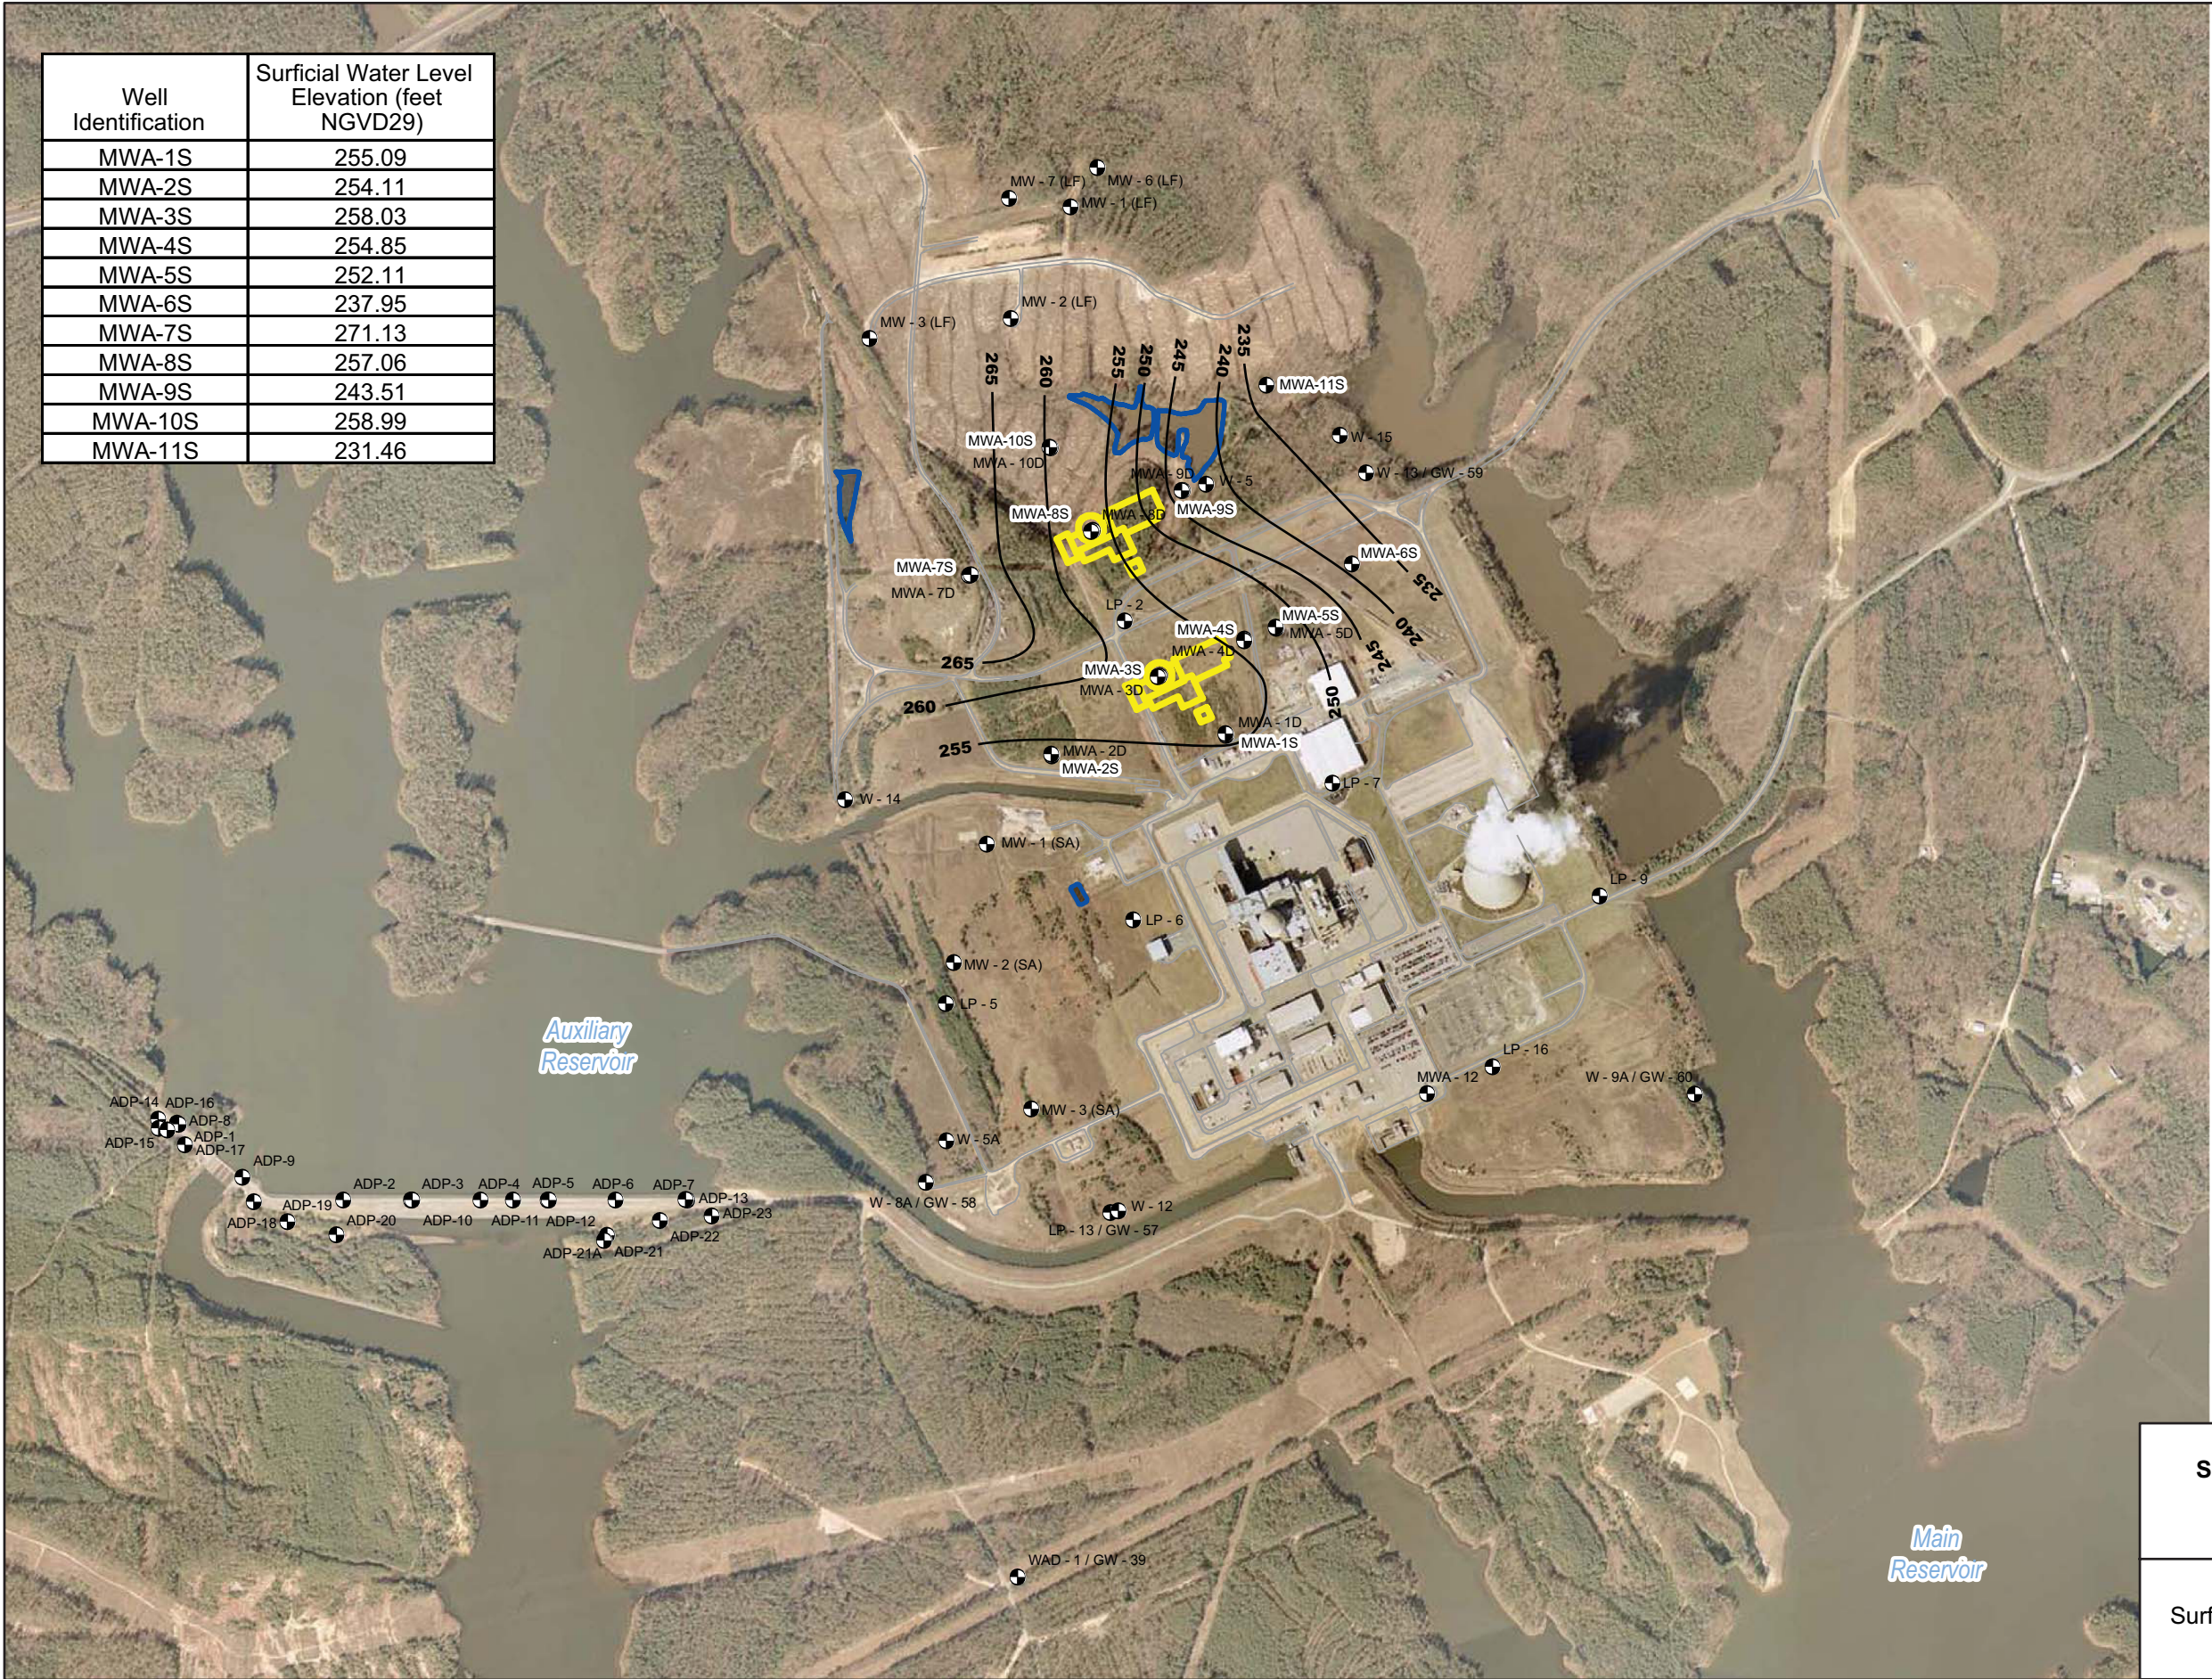

- LEGEND**
- Plant Site Monitoring Wells and Piezometers
 - Proposed Safety-Related Structures
 - Ponds

- Note:**
- 1) Main Reservoir also known as Harris Reservoir.
 - 2) Auxiliary Reservoir normal pool elevation is 252 ft NGVD29.
 - 3) Main Reservoir normal pool elevation is 220 ft NGVD29.

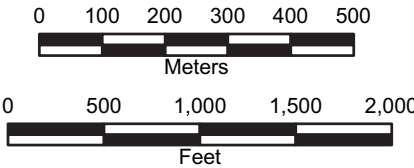

Progress Energy Carolinas

**Shearon Harris Nuclear Power Plant
Units 2 and 3
Part 3, Environmental Report**
New Hill, North Carolina

Potentiometric Surface Map of the
Surficial/Overburden Aquifer: May 29, 2007
FIGURE 2.3-27

Rev 0