


FIGURE A14.1 RHODES HALL ROOM 301 FLOORS

Survey Location: Rhodes Halls SU-139 Room 301 Class 2 Floor Measurement Locations

Legend: (Fill in blank) 1 = Smear Location 1 = Fixed Point Readings

Show numbering of all survey surfaces on the map.

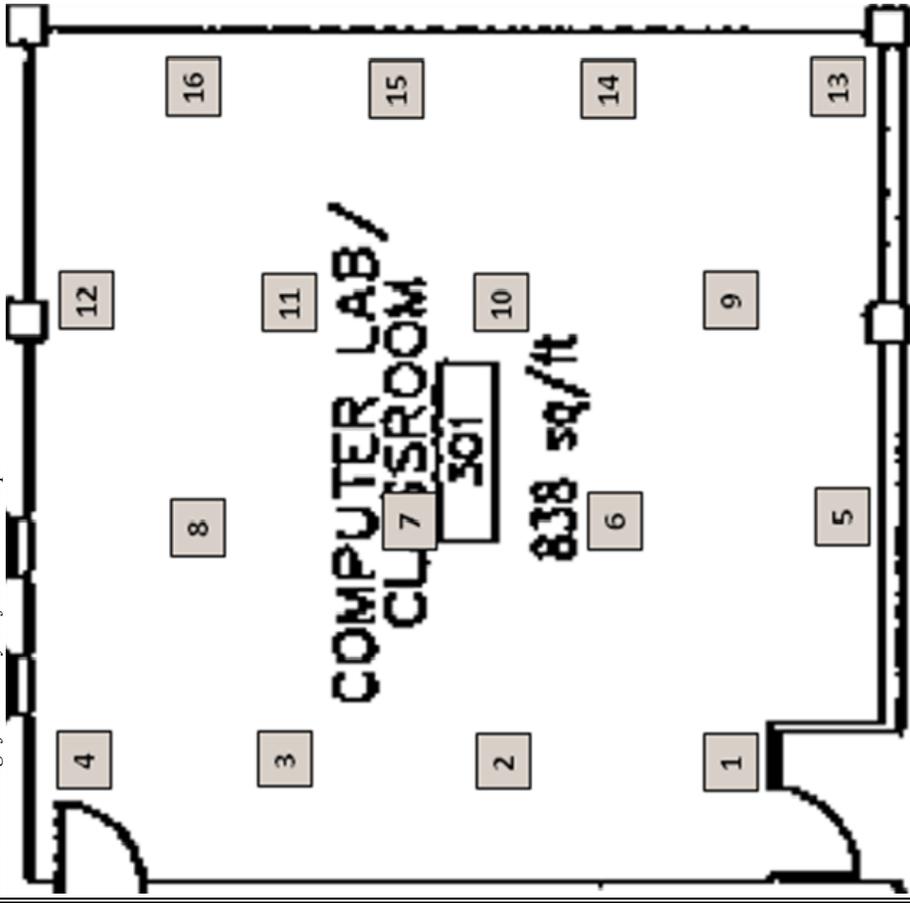


REMARKS: Systematic Floor Survey Random Start Point was determined by random sample generator. Location 8 is the random start at 11.5' S and 8.5' E. The NW corner was the 0/0 location. The grid was marked out on a 6.75' N-S separation and a 8' E-W separation to acquire a triangular grid pattern. Direct reading locations are the same as the smear locations.

FIGURE A14.2 RHODES HALL ROOM 303 FLOORS

Survey Location: Rhodes Halls SU-140 Room 303 Class 2 Floor Measurement Locations

Legend: (Fill in blank) 1 = Smear Location 1 = Fixed Point Readings

Show numbering of all survey surfaces on the map.

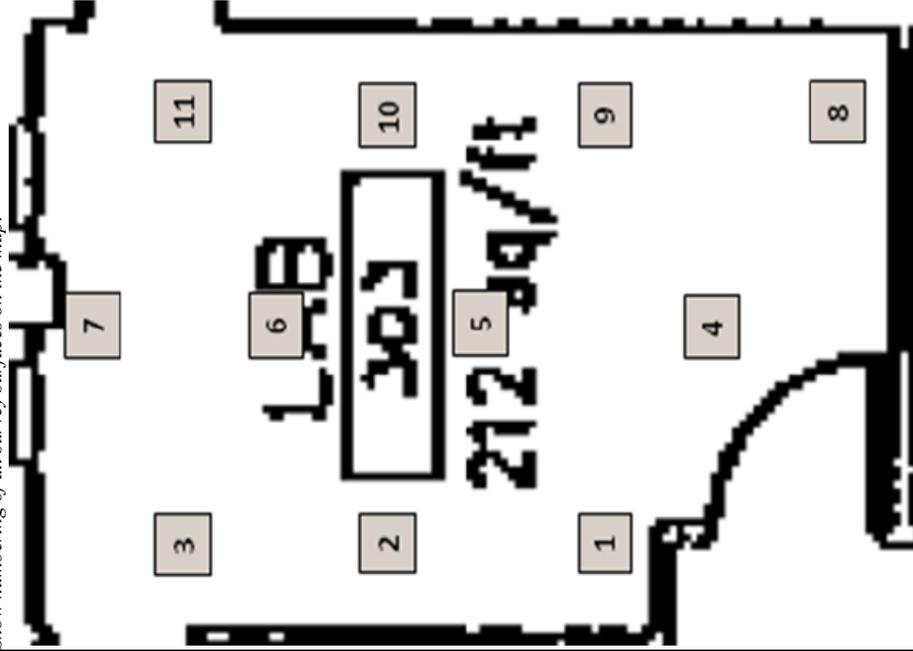


REMARKS: Systematic Floor Survey Random Start Point was determined by random sample generator. Location 6 is the random start at 5' S and 5.5' W. The NE corner was the 0/0 location. The grid was marked out on a 4' N-S separation and a 5' E-W separation to acquire a triangular grid pattern. Direct reading locations are the same as the smear locations.

FIGURE A14.3 RHODES HALL ROOM 304 FLOORS

Survey Location: Rhodes Halls SU-141 Room 304 Class 2 Floor Measurement Locations

Legend: (Fill in blank) 1 = Smear Location 1 = Fixed Point Readings

Show numbering of all survey surfaces on the map.

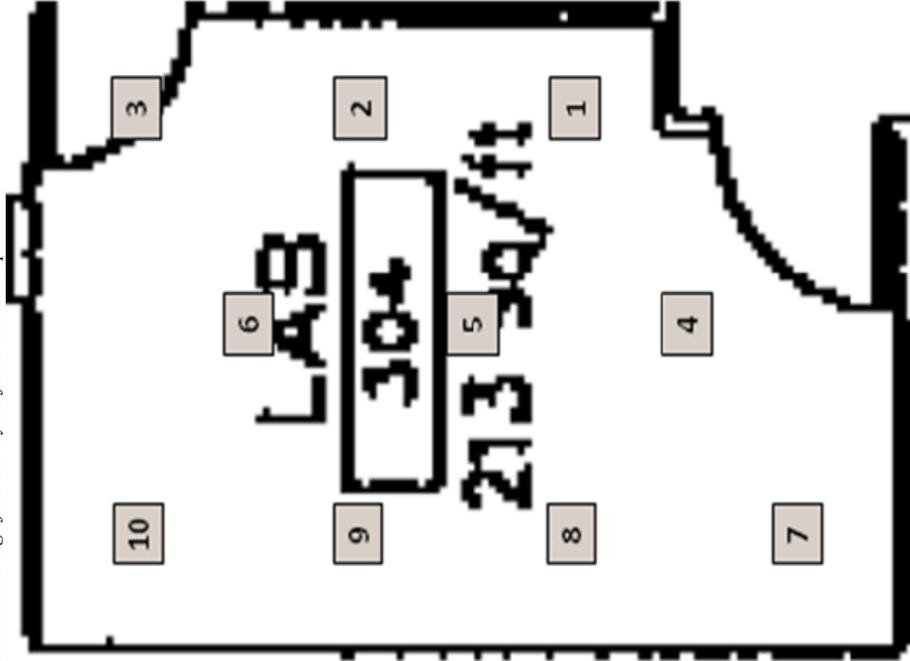


REMARKS: Systematic Floor Survey Random Start Point was determined by random sample generator. Location 7 is the random start at 2' E and 2.5' S. The NW corner was the 0/0 location. The grid was marked out on a 4' N-S separation and a 5' E-W separation to acquire a triangular grid pattern. Direct reading locations are the same as the smear locations.

FIGURE A14.4 RHODES HALL ROOM 306C FLOORS

Survey Location: Rhodes Halls SU-142 Room 306C Class 2 Floor Measurement Locations

Legend: (Fill in blank) 1 = Smear Location 1 = Fixed Point Readings

Show numbering of all survey surfaces on the map.

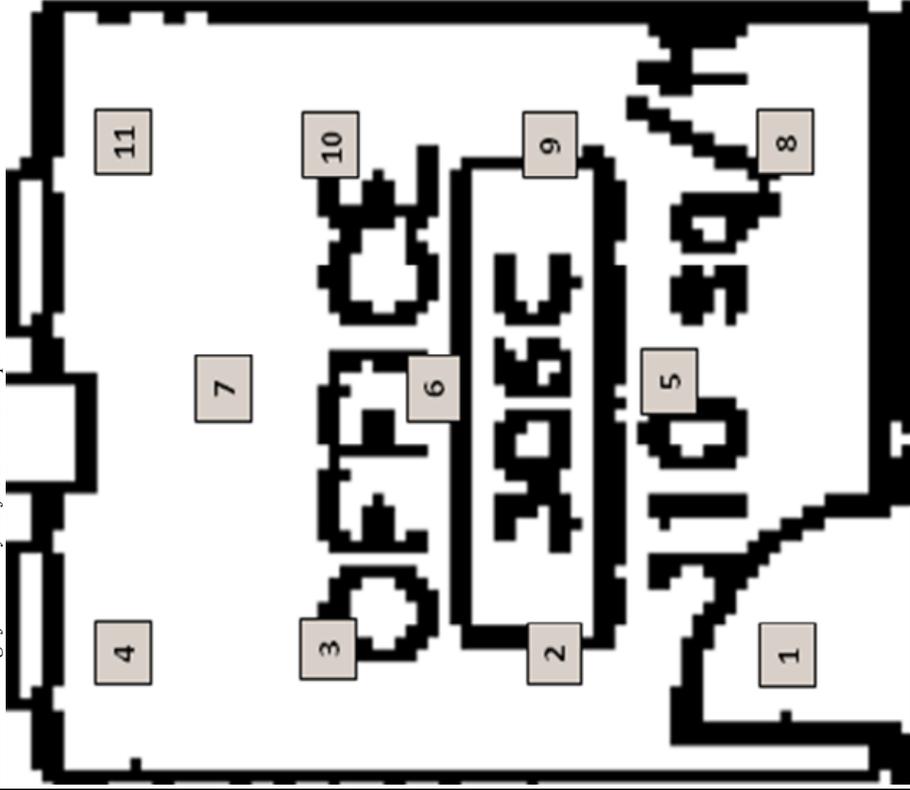


REMARKS: Systematic Floor Survey Random Start Point was determined by random sample generator. Location 2 is the random start at 2.5' S and 4.75' E. The NW corner was the 0/0 location. The grid was marked out on a 3' N-S separation and a 3.5' E-W separation to acquire a triangular grid pattern. Direct reading locations are the same as the smear locations.

FIGURE A14.5 RHODES HALL ROOM 312 FLOORS

Survey Location: Rhodes Halls SU-143 Room 312 Class 2 Floor Measurement Locations

Legend: (Fill in blank) 1 = Smear Location 1 = Fixed Point Readings

Show numbering of all survey surfaces on the map.

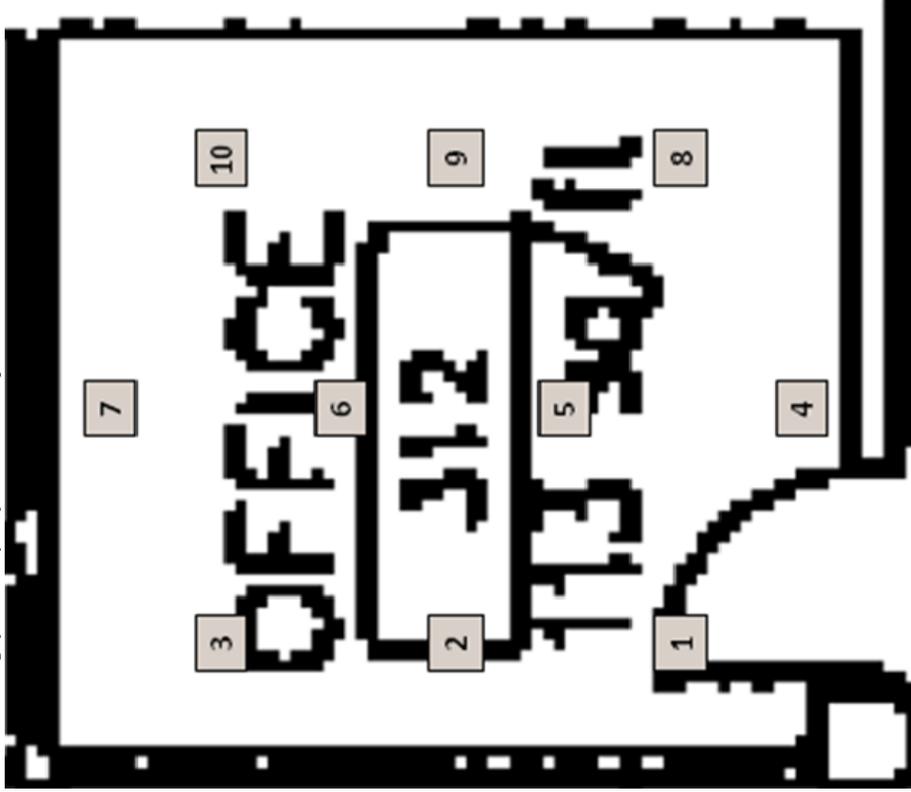


REMARKS: Systematic Floor Survey Random Start Point was determined by random sample generator. Location 6 is the random start at 7.5' E and 5' S. The NW corner was the 0/0 location. The grid was marked out on a 3' N-S separation and a 3.5' E-W separation to acquire a triangular grid pattern. Direct reading locations are the same as the smear locations.

FIGURE A14.6 RHODES HALL ROOM 319 FLOORS

Survey Location: Rhodes Halls SU-144 Room 319 Class 2 Floor Measurement Locations

Legend: (Fill in blank) 1 = Smear Location 1 = Fixed Point Readings

Show numbering of all survey surfaces on the map.

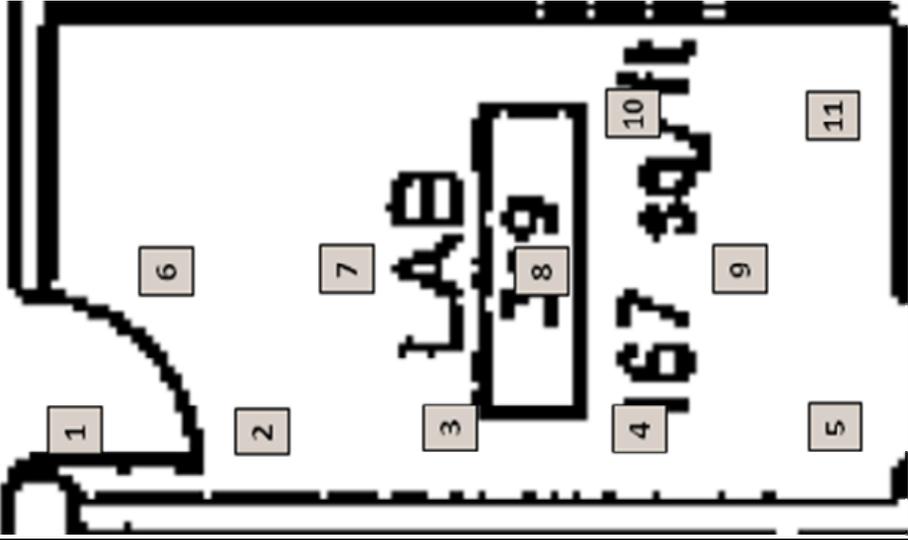


REMARKS: Systematic Floor Survey Random Start Point was determined by random sample generator. Location 9 is the random start at 2.75' E and 5' S. The NW corner was the 0/0 location. The grid was marked out on a 3.36' N-S separation and a 4' E-W separation to acquire a triangular grid pattern. Direct reading locations are the same as the smear locations.

FIGURE A14.7 RHODES HALL ROOM 319A FLOORS

Survey Location: Rhodes Halls SU-145 Room 319a Class 2 Floor Measurement Locations

Legend: (Fill in blank) 1 = Smear Location 1 = Fixed Point Readings

Show numbering of all survey surfaces on the map.

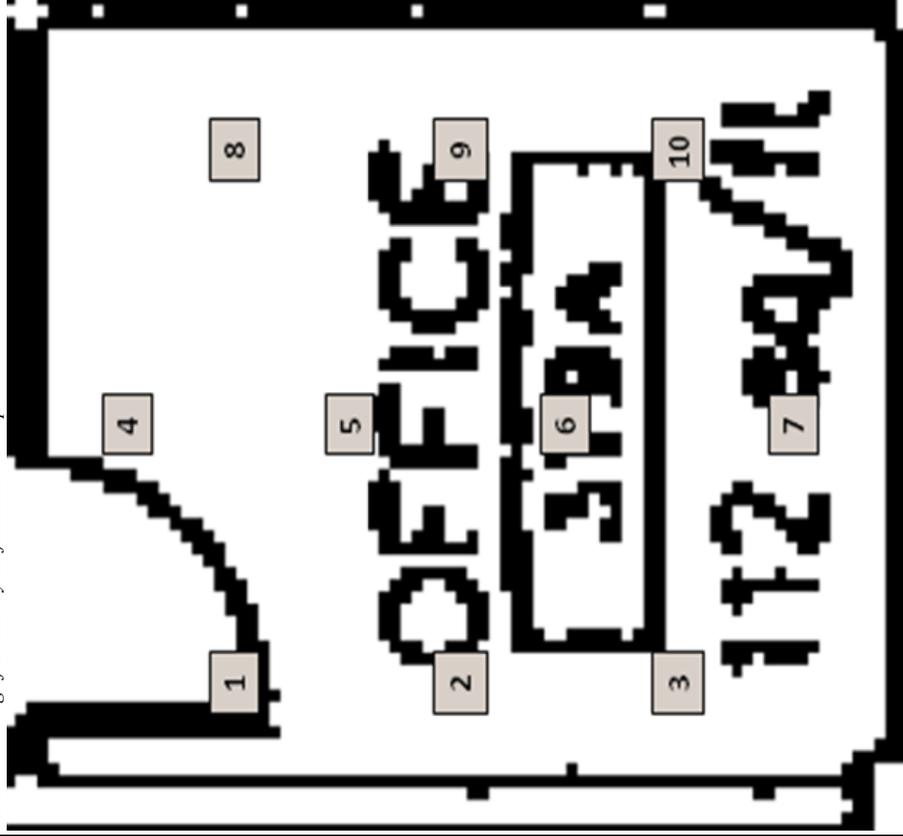


REMARKS: **Systematic Floor Survey** Random Start Point was determined by random sample generator. Location 9 is the random start at 5.5' W and 1.75' N. The SE corner was the 0/0 location. The grid was marked out on a 3' N-S separation and a 3.5' E-W separation to acquire a triangular grid pattern. Direct reading locations are the same as the smear locations.

FIGURE A14.8 RHODES HALL ROOM 323 FLOORS

Survey Location: Rhodes Halls SU-146 Room 323 Class 2 Floor Measurement Locations

Legend: (Fill in blank) 1 = Smear Location 1 = Fixed Point Readings

Show numbering of all survey surfaces on the map.

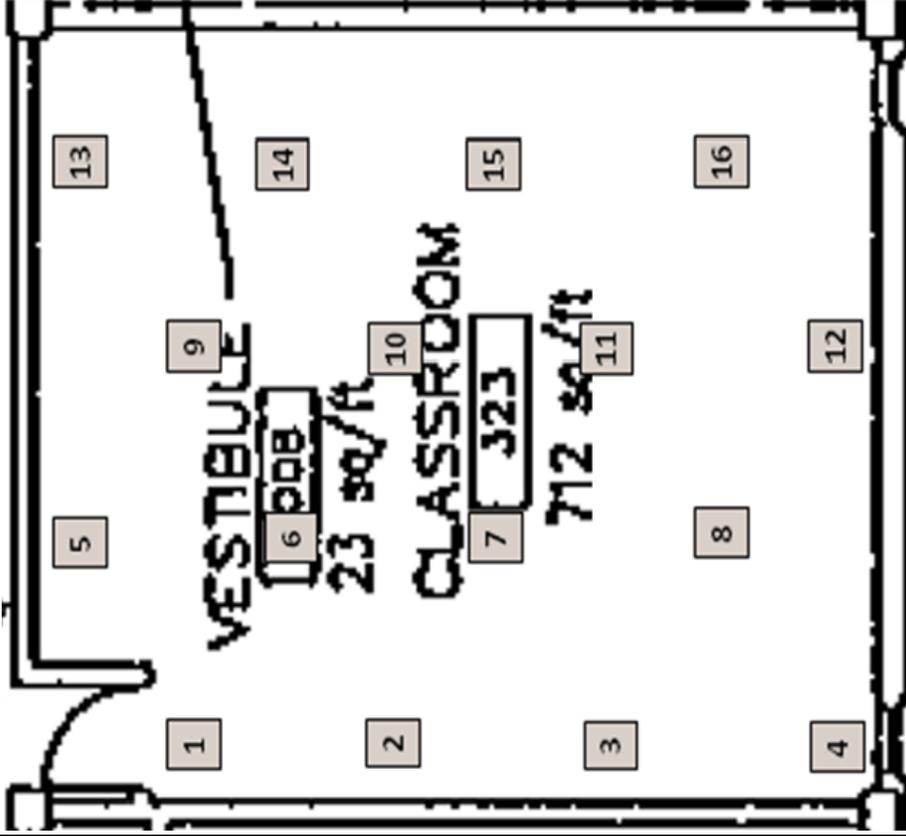


REMARKS: Systematic Floor Survey Random Start Point was determined by random sample generator. Location 8 is the random start at 7.5' S and 4.5' E. The NW corner was the 0/0 location. The grid was marked out on a 6.75' N-S separation and a 8' E-W separation to acquire a triangular grid pattern. Direct reading locations are the same as the smear locations.

FIGURE A14.9 THIRD FLOOR RHODES HALL FLOORS

Survey Location: Rhodes Hall SU-147 Rooms 300, 324, 302, 305, 306, 321, 321a, 307, 307.311, 318b, 318c, 314, 315, 316, 317 Class 3
Floor Measurement Locations

Legend: (Fill in blank) 1 = Smear Location 1 = Fixed Point Readings

Show numbering of all survey surfaces on the map.

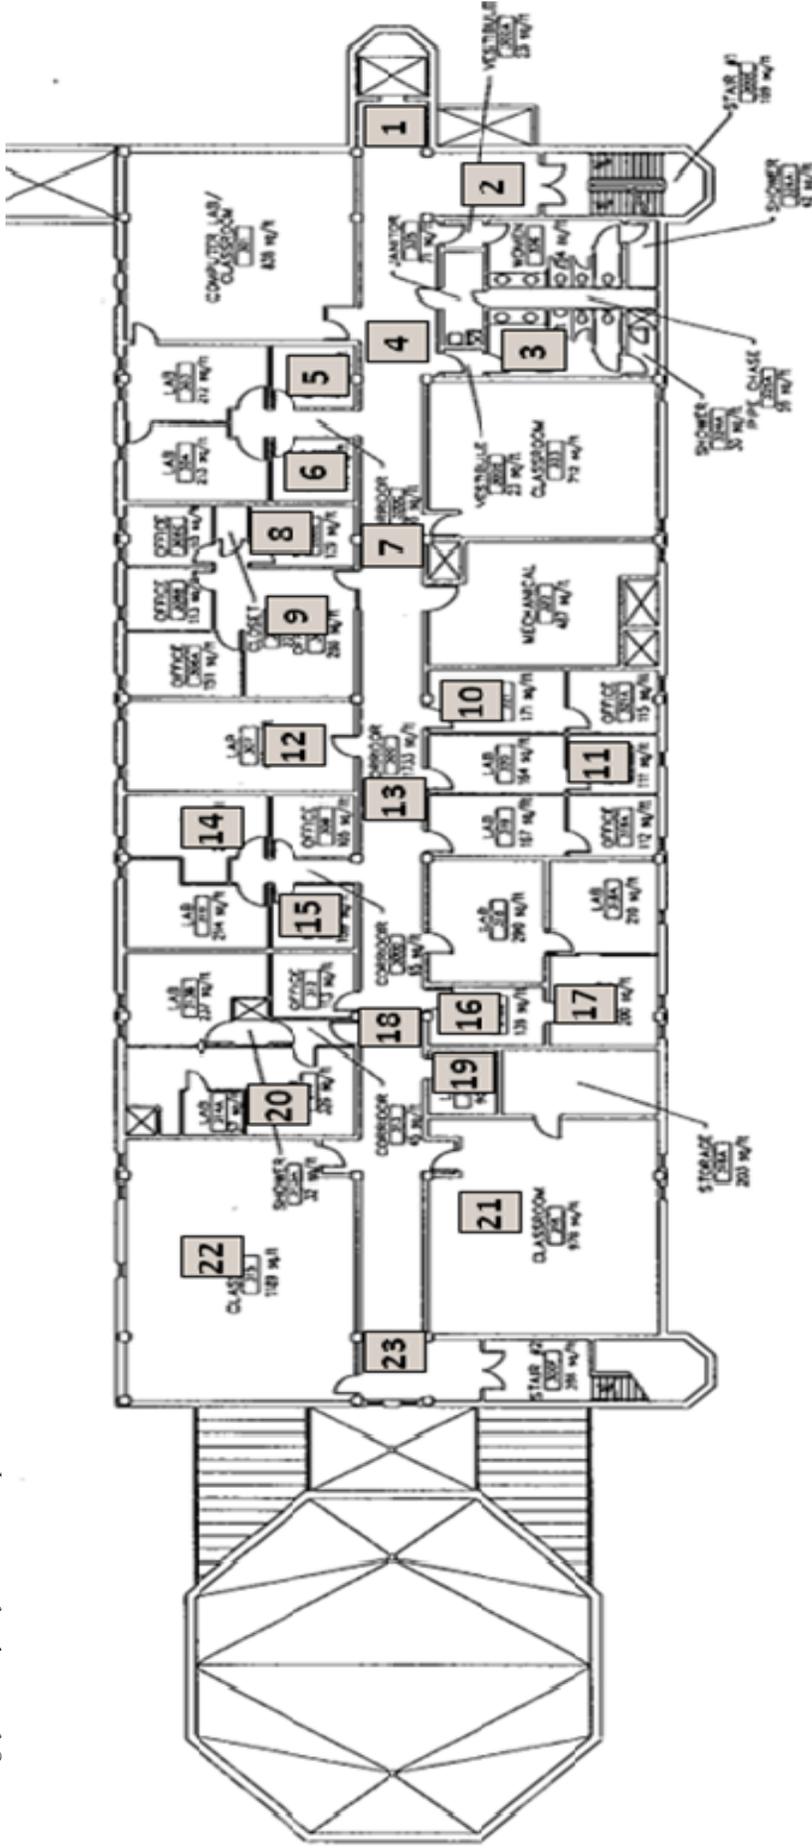

REMARKS: Random Floor Survey

