

FAQ Number 13-0006 FAQ Revision 0

FAQ Title Modeling Junction Box Scenarios in a Fire PRA

Plant: Various Date: May 6 2013

Contact: F. Joglar, Hughes Assoc. Phone: 703 344 8478

Email: fjoglar@haifire.com

Distribution: *(NEI Internal Use)*

FPRA TF  BWROG  PWROG

---

**Purpose of FAQ:**

The purpose of this FAQ is twofold: 1) provide a definition for junction boxes that allow the characterization and quantification of junction box fire scenarios in plant locations requiring detailed Fire PRA/Fire Modeling analysis and 2) describe a process for quantifying the risk associated with junction box fire scenarios.

It should be noted that the junction box scenario selection and definition guidance described in this section applies to those fire zones requiring detailed fire modeling analysis only. The fire zones in the Fire PRA modeled as full compartment burn should already include the fire ignition frequency contribution of junction boxes that has been apportioned to the fire zone.

---

**Relevant NRC document(s):**

R.G. 1.200, Rev. 2; NUREG/CR-6850

---

**Details:**

**NRC document needing interpretation (include document number and title, section, paragraph, and line numbers as applicable):**

Chapter 6 of NUREG/CR-6850

**Circumstances requiring interpretation or new guidance:**

Chapter 6 of NUREG/CR-6850 includes a generic fire ignition frequency for junction boxes. This classification of junction boxes as an individual ignition source was also previously included in the EPRI Fire PRA Implementation Guide (EPRI, TR-105928, 1995.) because selected fire events data listed junction boxes as the point of fire origin. The identification of junction boxes as ignition sources suggest that the Fire PRA should include the contribution of junction box fires in the risk quantification. However, there is no guidance in NUREG/CR-6850 for characterization, analysis and quantification of junction box fires. Guidance is only available in Chapter 6 of NUREG/CR-6850 for apportioning the generic fire ignition frequency to the plant partitioning elements within the scope of the Fire PRA.

FAQ Number 13-0006 FAQ Revision 0

FAQ Title Modeling Junction Box Scenarios in a Fire PRA

Specifically, Chapter 6 of NUREG/CR-6850 recommends in page 6-17 that “The number of junction boxes in an area may be difficult to determine. The frequency can be apportioned based on ratio of cable in the area to the total cable in the plant. Therefore, the ignition source-weighting factor of the cables may be used for this bin, as well.” This guidance is very similar if not identical to the apportioning guidance provided earlier by EPRI in the Fire PRA Implementation Guide (EPRI, TR-105928, 1995.). Notice that the guidance suggests that explicit count junction boxes is not necessary because the number of junction boxes can be estimated based on cable load.

Since NUREG/CR 6850 provides no guidance on how to represent the risk of junction box fire scenarios in fire zones receiving detailed fire modeling analysis, this FAQ provides an alternative to incorporate the risk contribution of such scenarios into the Fire PRA.

**Detail contentious points if licensee and NRC have not reached consensus on the facts and circumstances:**

None

**Potentially relevant existing FAQ numbers:**

None.

---

**Response Section:**

**Proposed resolution of FAQ and the basis for the proposal:**

**1.0 The Definition of Junction Box for Fire PRA Applications**

Generally, a junction box is defined as a fully enclosed metal box containing terminals for joining or splicing cables. However, for the purpose of a Fire PRA, this definition must be expanded to clearly differentiate junction boxes from other electrical enclosures. The following characterization for junction boxes is therefore provided:

- The box must be fully enclosed with metal panels bolted or welded together but not necessarily well sealed per the definition for well sealed panels in Chapter 8 of Supplement 1 to NUREG/CR-6850.
- Cables entering or exiting the junction box should be in metal conduits and have mechanical connections to the metal box.
- The junction box should include only terminals for joining and splicing cables.
- Junction boxes may include some items excluded from the count of electrical cabinets if the excluded items meet the above criteria. In particular, the electrical cabinet counting guidance in NUREG/CR-6850 and Supplement 1 to NUREG/CR-6850 states that “simple wall-mounted panels housing less than four switches may be excluded from the counting process” and that “well-sealed electrical cabinets that have robustly secured doors (and/or access panels)... should be excluded from the

FAQ Number 13-0006

FAQ Revision 0

FAQ Title Modeling Junction Box Scenarios in a Fire PRA

counting process.” Most junction boxes will meet one or both of these exclusionary criteria. However, exclusion from counting as electrical cabinets does not automatically exclude an item from consideration as a junction box. **Since the guidance in this FAQ limits damage to an individual junction box, junction boxes routing Fire PRA cables should not be excluded from counting as ignition sources as a fire starting in a Fire PRA junction box may be risk significant.**

The above definition of junction boxes specifically excludes:

- Boxes containing electrical components other than terminal point or splice such as electronic equipment, relays, switches, breakers, etc should not be considered junction boxes.
- Metal enclosures with indication lights, display panels, switches, buttons, etc on the surface are not considered junction boxes.
- Simple wall-mounted panels housing less than four switches, cited previously, that do not meet the inclusionary criteria above are not junction boxes. Such items are small local alarm panels, intercom boxes, radio repeater boxes, emergency light boxes, and other similar small component enclosure boxes. These items are neither junction boxes nor electrical cabinets.
- Junction boxes containing high voltage circuits above 1000V that have cable splices, voltage connections or elbow style connections. These boxes should be only found in limited Fire PRA physical analysis units in the plant and should be treated as electrical cabinets.
- Electrical enclosures used only to route cables and have no connections, termination point or splices should not be treated as junction boxes for the purpose of the guidance provided in this analysis.
- Relatively large termination panels on the floor with high cable loading intended for joining and splicing cables. Specifically,
  - Similar to the “Electrical Cabinet” ignition source (i.e., Bin 15 in Chapter 6 of NUREG/CR-6850), these termination panels are easy to count and do not present the challenge of counting small junction boxes. Although it is recognized that the ability to count an ignition source is not part of its definition, it is included as a consideration because the classification of junction boxes intended to capture the risk of electrical enclosures that may not be visible to walkdown analysts are difficult to count. Consistently, the fire events classified as junction box for the calculation of generic frequencies do not include relatively large floor based termination panels. That is, the fire events data associated with relatively

FAQ Number 13-0006 FAQ Revision 0

FAQ Title Modeling Junction Box Scenarios in a Fire PRA

large floor based termination panels are classified as “electrical cabinets” in the generic ignition frequency model and should not be considered junction boxes.

- Termination panels are typically characterized by high cable loading. Due to the relatively high cable loading, the cables are not routed in or out of the panels with conduits. Instead, cables drop into the panels from cable trays. This configuration is not consistent with the definition of a junction box described earlier.
- Relatively large Junction boxes or termination panels with doors, or openings, making the content of the panel easily accessible to plant personnel. The intent is to exclude from the junction box fires those events that would be initiated by plant personnel doing routine maintenance or inspection on them during power operation.

In summary, the definition above is intended to clearly differentiate junction boxes from electrical cabinets so that the process of identifying ignition sources in a physical analysis unit results in each electrical enclosure being categorized as belonging to one of three groups:

- Electrical cabinets that are included as Bin 15 in the Fire PRA model per the guidance in Chapter 6 of NUREG/CR-6850,
- Electrical cabinets that are excluded from the Fire PRA model per the guidance in Chapter 6 of NUREG/CR-6850, and Chapter 8 of Supplement 1 of NUREG/CR-6850. Examples of these include well sealed cabinets, and small wall mounted panels with less than 4 switches in the cover.
- Junction boxes as defined above are counted per the guidance in Chapter 6 of NUREG/CR-6850.

Note that some enclosures do not constitute electrical cabinets or junction boxes

## 2.0 Apportioning or Counting Junction Boxes

As mentioned earlier in this FAQ, Chapter 6 of NUREG/CR-6850 describes a process for apportioning the generic junction box frequency based on [a consistent indicator for](#) the amount of cable (e.g. cable loading, number of cables, cable lengths, etc) in the different physical analysis units within the scope of the Fire PRA.

This section describes another alternative for counting junction boxes for plants that have junction boxes as individual route points in the cable and raceway database system. For such situations, the cable and raceway database system can be “queried” for identifying and counting the junction boxes in each physical analysis unit. Notice that the terms “pull box”, “terminal box”, etc are often used in cable and raceway database systems for identifying junction boxes. This count can be used to apportion the generic frequency of junction boxes. Under this approach, the analyst should ensure that the database is current and that the definition of junction boxes counted

from the cable and raceway database system is consistent with the one described earlier in this FAQ.

Two practical approaches for ensuring that the junction boxes meet the definition described in the previous section include:

1. Review plant specification documents describing the requirements for constructing and installing junction boxes if available, and/or
2. Conduct walkdowns in selected fire zones to sample junction boxes that are readily accessible (i.e. visible) and document the characteristics of the electrical enclosures that will be treated as junction boxes (i.e., these electrical enclosures that are not screened out as ignition sources, and not counted as part of other ignition frequency bins). The walkdowns should be conducted in some of the fire zones that are receiving detailed fire modeling analysis and junction box scenarios will be ~~explicitly~~ explicitly postulated.

**Comment [J1]:** I don't understand what is meant here by establishing junction box scenarios through the walkdown process. The CCDP is from all the cables in conduits entering the junction box which is determined from drawings or the database, not a walkdown, so how does the walkdown contribute? Or are we saying that some junction boxes are installed in the field, and we need to capture them as well?

### 3.0 Background and Basis

Fire events in the EPRI Fire Events Database (FEDB) [1] were examined for historical experience and actual severity data in order to develop an improved methodology for handling these types of fires.

#### 3.1 EPRI Fire Events Database / Industry Experience

The junction box events in EPRI's fire events database listed as challenging or undetermined are incident numbers 665, 745, and 1369. These events have the following descriptions:

- Incident No 665: A bad splice in junction box 529 caused an electric fire. A CO2 extinguisher was discharge and the power was removed from the cabling in the junction box. Cable splice (480 volt) failed in junction box. Electric arc burned hole in cover. De-energized electrical equipment.
- Incident No 745: Early warning detection alarmed in the control room in the auxiliary building, 752 level. This detection is below the fire area containing the fire source: Smoke travelled down a 4 inch conduit into the control room to set off the detector. Fire discovered inside junction box to fan motor. Aluminum cable connected to copper with single lug. Fan de-energized at breaker.
- Incident No 1369: Crimp in insulation on power cables at lug connection. Power cables/insulation burned. Confined to junction box on motor.

It is unclear if these events listed above happened in electrical enclosures matching the definition for junction boxes described earlier in this FAQ. Nevertheless, these event descriptions suggest that junction box fires can generate immediate damage to the content of the box (e.g. those events associated with electric arcs in junction boxes

routing power circuits 480 V or higher); however, the damage was contained to the junction box itself.

### **3.2 Fire Experiments**

A review of previous fire testing was conducted to identify information gained respective to junction box fires. No tests were found that investigated fires initiated in junction boxes specifically. However, one test series was identified which tested flame spread through conduits in fire barriers where junction boxes were used as termination points. This is applicable since one path for fire propagation from a junction box is through cable in conduit emanating from the junction box.

The Internal Conduit Seal Fire Test of One-Hundred One Electrical Conduit Penetrations was performed to determine minimum internal seal requirements for conduits to prevent spread of fire from one side of a rated fire barrier to the other. A test slab incorporated 101 conduit penetrations and was exposed to the ASTM E-119 standard fire exposure for 3 hours. Of the 101 tests performed 18 were conducted using junction boxes as termination points for the conduits on the unexposed side of the rated fire barrier. During the test, no flames propagated through the conduits and no cables were ignited on the unexposed side of the slab. The testing also illustrated the effect cable fill has on the performance of open conduits. The cables restricted the flow of hot gases and smoke and also acted as a heat sink. High Cable loadings (40%) acted as an effective internal penetration seal to the propagation of hot fire and hot gases. Based on the testing, guidelines were developed to address the propagation of fire through conduits. This testing concluded that conduits that terminate in junction boxes or other non-combustible closures need no additional internal sealing. This testing provides further evidence of the difficulty to propagate fires in a limited oxygen environment with metal conduits which have mechanical connections. The testing demonstrated the performance of junction boxes and cable filled conduits in limiting hot gas and flame propagation.

Given these test results, it is reasonable to assume that a fire initiating in a junction box would not spread via the cables in conduits. These tests support treatment of junction box-initiated fires as not spreading beyond the point of origin, as outlined in the following methodology.

### **4.0 Selection and Definition of Junction Box Fire Scenarios**

Junction box fires generally begin as relatively small fire or arc within the electrical enclosure. In most cases these fires do not generate enough heat to be self-sustaining and will self-extinguish prior to spreading outside. This is mostly due to the enclosed configuration of the box and in the cases of those scenarios where the integrity of the box is breached due to relatively low combustible content. In effect, this approach assumes that the zone of influence for these fires is equal to the junction box only. Consequently, the proposed approach provides a method for screening and analysis of such fires without the need for detailed fire growth, damage and suppression modeling.

Fire frequencies for a physical analysis unit are estimated using the methods described earlier in this FAQ. It should be noted that junction box frequencies, should be included

FAQ Title Modeling Junction Box Scenarios in a Fire PRA

for both thermoplastic and thermoset cables as the event experience suggests that these fires start due to small arcs generated by bad connections, which is not influenced by the cable insulation or jacket type. Once these frequencies are calculated for a given physical analysis unit, perform a screening process as follows.

## Step 1: Preliminary Analysis:

1. For junction boxes that are Fire PRA targets, calculate the conditional core damage probability (CCDP) values assuming the loss (failure) of one junction box at a time in the physical analysis unit (i.e., never more than one junction is involved, and there is no sequential fire propagation from the initiating junction box to other intervening combustibles). Junction boxes explicitly listed in the cable and raceway database system should be associated with all the cables in the junction box. If junction boxes are not explicitly listed as route points in the cable and raceway database system, the analyst should calculate the CCDP for each route point (e.g., cable tray, conduits, etc) in the physical analysis unit.
2. Repeat the calculation for every junction box located in the physical analysis unit that contains at least one Fire PRA target cable and compile and sort the values in a table. (Note that some junction boxes may not contain Fire PRA target cables.)

## Step 2: First Screening Analysis:

1. Identify the junction box with the largest CCDP value ( $CCDP_{max,J}$ ) and estimate the CDF for the physical analysis unit as the product of the physical analysis unit fire frequency ( $\lambda_{S,J}$ ) and  $CCPD_{max,J}$ .
  - a. Check if the junction box is used to route cables only and has no connection, termination point or splices. Boxes with no connections, termination points or splices can be screened.
2. If this first screening level estimated CDF is low enough to meet PRA objectives, add this value to the physical analysis unit's total CDF and repeat this process for other physical analysis units.
3. If the value is too large to meet PRA objective, conduct subsequent screenings as needed.

## Step 3 Subsequent Screenings (optional)

1. Consistent with the counting and apportioning guidance in Section 2 of this FAQ, there are two methods that can be used to [calculate the frequency of an individual junction box within a PAU](#) ~~apportion the frequency of junction boxes to specific scenarios within a fire zone~~. These methods are:
  - a. [In the case the junction box frequency is apportioned at the fire zone level](#) as described in Chapter 6 of NUREG/CR-6850 based on a consistent indicator for the amount of cable (e.g. cable loading, number of cables, cable lengths, etc), the specific count of junction boxes in the fire zone

Formatted: Subscript

Formatted: Subscript

Formatted: Subscript

**Comment [J2]:** The first discussion should be how to calculate the individual junction box frequency when we can count all the junction boxes.

I think one way to do that is to ratio the cable associated with an individual junction box with all the cables associated with all junction boxes in the PAU. This accounts for junction boxes having different levels of loading.

For the second case where we don't know the exact count of junction boxes, it may be just as good to assume that each is loaded comparably, and as a result, simply take 1 over the number of junction boxes in a PAU, given that we can come up with some way to estimate that. Industry took the action to develop an approach to estimate the number of junction boxes per PAU in some fashion, even conservatively if appropriate, or address this second way more broadly.

**Comment [J3]:** Per our discussions, the approach where junction boxes are aligned with transients is problematic. As a result, I would expect a. to be rewritten.

FAQ Title Modeling Junction Box Scenarios in a Fire PRA

may not be available. It is then practical to apportion the junction box frequency to the same locations where transient fires are located within the fire zone. Under this approach, the apportioning factor will be based on the same floor area ratio used for the transient fires **provided transient fires have been postulated throughout the entire PAU**. This approach requires rigorous mapping of junction boxes that are identified as Fire PRA targets to individual scenarios. The analyst maps the target junction boxes (those junction boxes that are Fire PRA targets within the fire zone) based on their location to the different transient fire scenarios in the Fire Zone following the same process used to map cable trays or conduits to fire scenarios. All the Fire PRA target junction boxes should be accounted for. **In addition, ALL the Fire PRA cables in the junction box must be considered (i.e., cables are necessary to determine the CCDP for each box)**. The junction box fires are then assigned the same floor area ratio as the transient fires where they are mapped to. In practice, this approach suggests that every transient fire location in a Fire Zone will also include the risk contribution of junction box fires, which is calculated using the junction box with the highest CCDP mapped to the scenario. It should be noted that the ignition source screening techniques for transient fires will not apply for junction boxes. That is, even if a transient fire can be screened based on zone of influence considerations, junction box fires within that portion of the fire zone would still need to be considered **by failing the cables inside the junction box with the highest CCDP within the transient fire location**.

- b. In the case that the junction box frequency is apportioned at the fire zone level using the count of junction boxes in a cable and raceway database (i.e., the apportioning factor for the junction box frequency in a fire zone is the number of boxes in the fire zone over the total number of boxes in the plant), the approach is similar to the one described in item “a” in terms of mapping junction boxes to fire scenarios. The only difference is that the weighting factor for the frequency of an individual junction box scenario is the number of Fire PRA target junction boxes mapped to the transient fire scenario over the number of Fire PRA junction boxes in the fire zone.

2. Re-estimate a CDF value for the previously identified junction box (with the largest CCDP) as the product of the junction box-specific fire frequency ( $\lambda_{JB1,J}$ ) and  $CCDP_{max,J}$ .
3. Identify the junction box with the second largest CCDP value ( $CCDP_{JB2,J}$ ), and calculate the CDF for the remainder of the physical analysis unit by assigning the

**Comment [J4]:** The term “fire zone” keeps getting added in the FAQ, in many places. Need to focus on PAUs, consistent with the PRA Standard.

**Comment [J5]:** See earlier comment regarding aligning junction boxes and transient scenarios.

**Comment [J6]:** See comment above on ways to estimate an individual junction box frequency.

**Formatted:** Subscript

**Formatted:** Subscript

**Formatted:** Subscript



**FAQ Title Modeling Junction Box Scenarios in a Fire PRA**

remainder of the room frequency to that CCDP ( $CDF = ((\lambda_{S,J} - \lambda_{JB1,J}) \times CCDP_{ext,J})$ ). Notice that the fire frequency should be apportioned based on the guidance provided earlier in this section.

Formatted: Subscript

Formatted: Subscript

Formatted: Subscript

4. The modified physical analysis unit CDF is then the sum of the scenario involving the junction box with the highest CCDP (steps 3 items 1 & 2 above), and the scenario involving all other junction boxes, which is characterize by the junction box with the second highest CCDP (Step 3, item 3)
5. Repeat the subsequent screening techniques as needed, working junction box by junction box down through the CCDP list, until PRA objectives are met or until the refinement of the risk for these fires reaches the point of diminishing returns.

Note: As an alternative, junction boxes may be grouped based on similar CCDP values and treated in groups rather than as individuals. That is, the CDF for a group of junction boxes can be estimated as the group’s combined fire frequency times the highest individual CCDP value among the group (but do not compound the CCDPs).

The detailed process recommended in this FAQ is intended to drill down only until very small numbers are calculated and the analysis can stop. In the end, the estimated CDF is simply the sum of those cases split out in detail plus the balance applied to the next worst junction box in CCDP ranking table. Note that since the entire junction box is assumed damaged upon initiation of the fire, no credit for suppression to prevent overall junction box damage is allowed in this process.

**Conceptual Example for Apportioning Junction Box Frequency:**

Consider a physical analysis unit with a floor area of 15 ft by 20 ft requiring detailed fire modeling analysis (physical analysis unit in the bottom left corner of Figure 1). The detailed analysis consists of identifying and quantifying fixed and transient ignition source fire scenarios in the Area. Treatment of the fixed ignition sources are outside of the scope of the material in the FAQ and are not discussed in the example. Two transient fires are identified: Zone 1 (260 ft<sup>2</sup>), and Zone 2 (40 ft<sup>2</sup>). The practical implications of the guidance in this FAQ can be summarized with the following options, which must be applied consistently throughout the physical analysis units requiring detailed fire scenario analysis the Fire PRA.

Formatted: Font: Not Bold

Comment [J7]: Ditto with earlier remarks on using the transient approach.

Formatted: Superscript

Formatted: Superscript

**Option 1:** Let’s assume that there are 6 junction boxes in this physical analysis unit that are Fire PRA targets. By inspection of conduit drawings, cable routing drawings and walkdowns, four of the junction boxes are assigned to Zone 1 and the remaining two are mapped to Zone 2. Since only one junction box is assumed failed by fire based on the guidance in the FAQ, the CCDP for each of the six junction boxes need to be calculated. Once the CCDP values are available, the risk contribution from junction box fires in the area is:

Formatted: Font: Bold

$$\lambda_{gJB-jb} W_{g-1} CCDP_1 + \lambda_{gJB-jb} W_{g-2} CCDP_2$$

Formatted: Centered

The above equation is the sum of the junction box contribution from the two transient zones identified in the Fire PRA. Each term in the sum consists of the multiplication of the generic junction box frequency times the floor area ratio (geometric weighting factor  $W_g$ ) and the CCDP associated with the junction box with the highest conditional core damage probability for those mapped to the transient zone. The values of  $W_g$  are calculated using the floor area ratio as follows:  $W_{g-1} = 260/300$  and  $W_{g-2} = 40/300$ . Notice that under this option:

- A rigorous mapping of junction boxes, raceways and conduits to each transient zone is necessary. By mapping these targets to the transient zones, the applicable cables are considered using a raceway to cable correlation. The transient zones must cover the entire floor area of the physical analysis unit.
- If it can be confirmed by visual inspection that there are NO cable trays or conduits within the transient zone, the risk contribution of junction boxes for that transient zone can be set to zero.
- The total count of junction boxes in the physical analysis unit does not need to be known. The generic junction box frequency can be apportioned using for example the amount of cable in the area.
- The identified transient fires, provided they are postulated throughout the entire floor area of the physical analysis unit can be used for apportioning the frequency of the junction boxes. This is a practical approach as it provides a conservative apportioning factor given the uncertainty associated with the exact location of the junction box. Recall the ignition source screening techniques for transient fires will not apply for junction boxes. That is, even if a transient fire can be screened based on zone of influence considerations, junction box fires within that portion of the fire zone would still need to be considered by failing the cables inside the junction box with the highest CCDP within the transient fire location. If for example transient scenarios have been screened from a portion of the floor area in the physical analysis unit, that portion of the floor will still need to be considered for junction box scenarios using the highest CCDP from the junction boxes mapped to that portion of the floor.
- The CCDP is the maximum CCDP of the junction boxes mapped to the transient zone.
- For cases where the junction boxes are not known (i.e., not explicitly identified in the cable and raceway database), the CCDP of the highest individual target (e.g., cable tray or conduit) in the transient zone can be selected as a surrogate of a junction box. Since this approach requires a detailed mapping process of targets to the transient floor areas, the analyst should ensure that conduits ending in a common junction box are grouped together as a target set so that all the cables entering the junction box are accounted for.

**Option 2:** The risk contribution from junction box fires in the physical analysis unit is calculated as:

$$\lambda_g W_{jb} CCDP_{max}$$

Formatted: Subscript

Formatted: Subscript

Formatted: Subscript

Formatted: Subscript

**Comment [J8]:** Many of this is related to the transient zone and needs to be changed. Transient zone is not a general term in PRA, and is not generally applied in PRAs.

Formatted: List Paragraph, Bulleted + Level: 1 + Aligned at: 0.25" + Indent at: 0.5"

**Comment [J9]:** Correct, No risk contribution if not cable trays or conduits

Formatted: Font: Arial

Formatted: Font: Bold

FAQ Title Modeling Junction Box Scenarios in a Fire PRA

Under this approach, the generic frequency for junction boxes,  $\lambda_g$ , is apportioned to the physical analysis unit using the factor  $W_{jb}$  and multiplied by the highest CCDP from the junction boxes present in the area. Under this approach:

- The generic frequency weighting factor can be based on:
  - If the junction boxes can be reliably counted using the cable and raceway database system, use the number of junction boxes in the Fire Area physical analysis unit divided by the total number of junction boxes in the plant ~~VS the number of junction boxes in the Fire Area~~
  - If the junction boxes can't be counted, apportion the frequency using an index for ~~amount~~ amount of cable as suggested in Chapter 6 of NUREG/CR-6850.
- The CCDP for the junction box can be based on:
  - If the junction boxes are identified using the cable and raceway database system, calculate the CCDP for each junction box that is a Fire PRA target in the Fire Area and select the highest.
  - If the junction boxes are not counted or identified from the cable and raceway database system, select the highest CCDP from all the raceways and conduits (i.e., Fire PRA targets) assigned to the physical analysis unit. By inspecting conduit routings in the physical analysis unit, the analyst should ensure that conduits ending in a common junction box are grouped together as a target set so that all the cables entering the junction box are accounted for.
- Under this approach, the screening guidance described in this FAQ applies. That is, more than one junction box may need to be included if the CCDP's are relatively high.

**Formatted:** List Paragraph, Bulleted + Level: 1 + Aligned at: 0.25" + Indent at: 0.5"

**Formatted:** List Paragraph, Bulleted + Level: 2 + Aligned at: 0.75" + Indent at: 1"


**Comment [J10]:** Should be identified more clearly that we are introducing an alternate approach to calculating a junction box frequency for a PAU, already established by 6850.

**Formatted:** List Paragraph, Bulleted + Level: 1 + Aligned at: 0.25" + Indent at: 0.5"

**Formatted**

**Comment [J11]:** Is this saying that we may need to damage multiple junction boxes per scenario? It's not clear what is being said here.

**Formatted:** Font: Arial

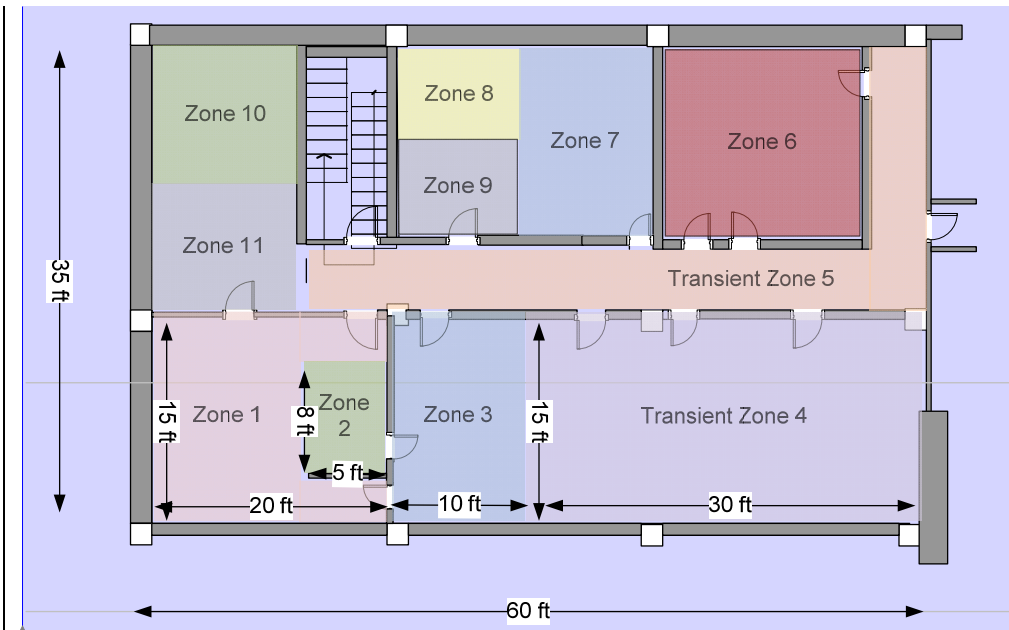

**Figure 14:** Layout of physical analysis units used in the conceptual example

**Comment [J12]:** Figure no longer appropriate since not using transient zones.

**Field Code Changed**

**Formatted:** Font: (Default) Arial

**Formatted:** Caption, Centered, Space Before: 0 pt, After: 0 pt, Don't keep with next, Adjust space between Latin and Asian text, Adjust space between Asian text and numbers

**Formatted:** Font: (Default) Arial

**References**

1. Fire Event Database and Generic Ignition Frequency Model for U.S. Nuclear Power Plants. EPRI, 2001. TR-1003111.
2. EPRI Fire PRA Implementation Guide (EPRI, TR-105928, 1995.)
3. NUREG/CR 6850 (2005), "EPRI/NRC-RES Fire PRA Methodology for Nuclear Power Facilities Volume 2 Detailed Methodology," EPRI 1011989 Final Report, NUREG/CR-6850, Nuclear Regulatory Commission, Rockville, MD, September, 2005.
4. NUREG/CR 6850 Supplement 1 (2010), "Fire Probabilistic Risk Assessment Methods Enhancements Supplement 1 to NUREG/CR-6850 and EPRI 1011989," EPRI 1019259 Technical Report, NUREG/CR-6850 Supplement 1, Nuclear Regulatory Commission, Rockville, MD, September, 2010.

**If appropriate, provide proposed rewording of guidance for inclusion in the next Revision:**

Not applicable. This is no current guidance beyond RG 1.200