

CENGSM

a joint venture of



Constellation
Energy



P.O. Box 63
Lycoming, NY 13093

NINE MILE POINT
NUCLEAR STATION

June 21, 2013

U.S. Nuclear Regulatory Commission
Washington, DC 20555-0001

ATTENTION: Document Control Desk

SUBJECT: Nine Mile Point Nuclear Station
Unit No. 2; Docket No. 50-410
Core Operating Limits Report

Enclosed is a copy of the Core Operating Limits Report, COLR2-14, Revision 1 for Nine Mile Point Unit 2 (NMP2). This report is being submitted pursuant to NMP2 Technical Specification 5.6.5.d.

Should you have any questions regarding the information in this submittal, please contact John J. Dosa, Licensing Director, at (315) 349-5219.

Very truly yours,

Paul M. Swift
Manager, Engineering Services

PMS/MHS

Enclosure: Nine Mile Point Unit 2 Core Operating Limits Report

cc: NRC Regional Administrator, Region I
NRC Project Manager
NRC Senior Resident Inspector

A001
MRR





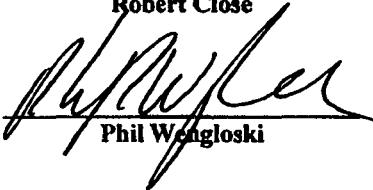
ENCLOSURE

**Nine Mile Point Unit 2
Core Operating Limits Report**

**Nine Mile Point Nuclear Station, LLC
June 21, 2013**

**NINE MILE POINT UNIT 2
CORE OPERATING LIMITS REPORT**

**COLR2-14
Revision 1, Cycle 14**

	<u>Name</u>	<u>Title</u>	<u>Date</u>
Prepared by:	 Tae Wook Ahn	Fuels Engineer	6/4/2013
Reviewed by:	 Melisa Krick	Fuels Engineer	6/4/2013
Approved by:	 John Darweesh	Supervisor, Reactor Engineer	6/4/13
Approved by:	 Robert Close	Supervisor, Fuels	6/4/2013
Approved by:	 Phil Wengloski	General Supervisor, Fuels	6/4/13

This controlled document provides cycle specific core operating limits for use in conjunction with the Nine Mile Point Unit 2 Technical Specifications. Document pages may only be changed through a reissue of the entire document.

TABLE OF CONTENTS

	<u>page</u>
1.0 AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR)	1
1.1 Limits for Technical Specification 3.2.1	1
2.0 MINIMUM CRITICAL POWER RATIO (ODYN OPTION B)	3
2.1 Limits for Technical Specification 3.2.2	3
3.0 LINEAR HEAT GENERATION RATE (LHGR)	10
3.1 Limits for Technical Specifications 3.2.3	10
4.0 AVERAGE POWER RANGE MONITOR SETPOINTS	15
4.1 Limits for Technical Specification Table 3.3.1.1-1 (OPRM Upscale)	15
5.0 CONTROL ROD BLOCK INSTRUMENTATION	16
5.1 Allowable Value for Technical Specification Table 3.3.2.1-1	16
6.0 REFERENCES FOR TECHNICAL SPECIFICATIONS	17
7.0 REFERENCES FOR TECHNICAL SPECIFICATION BASES	18
8.0 SOURCE DOCUMENTS	19

1.0 AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR)1.1 Limits for Technical Specification 3.2.1

The APLHGR(s) for each fuel type as a function of Average Planar Exposure shall not exceed the limits shown in Table 1.

The limits of Table 1 shall be reduced to a value of 0.78 times the two recirculation loop operation limit when in single recirculation loop operation.

Table 1
MAPLHGR versus Average Planar

Average Planar Exposure (GWD/ST)	MAPLHGR Limits (KW/ft)
0.00	12.82
14.51	12.82
19.13	12.82
57.61	8.00
63.50	5.00

NOTES:

1. APLHGR(s) are interpolated between exposure points for which explicit values are given

2.0 MINIMUM CRITICAL POWER RATIO (ODYN OPTION B)

2.1 Limits for Technical Specification 3.2.2

For 2-Pump Operation, the Minimum Critical Power Ratio (MCPR) shall be equal to or greater than the maximum of the appropriate MCPR(P) from Figures 2c, 2d and 2e or the MCPR(F) from Figure 2f.

For Single Loop Operation, the Minimum Critical Power Ratio (MCPR) shall be equal to or greater than the Minimum Critical Power Ratio for 2-Pump Operation plus 0.02.

NOTES:

1. For Figures 2a and 2b tau (τ) defined as follows:

$$\tau = \frac{\tau_{ae} - \tau_B}{\tau_A - \tau_B}$$

where:

$\tau_A = 0.866$ seconds, control rod average scram insertion time limit to notch 39 per Technical Specification 3.1.4.

$$\tau_B = 0.672 + 1.65 \sqrt{\frac{N_1}{\sum_{i=1}^n N_i}} \times (0.016)$$

$$\tau_{ae} = \frac{\sum_{i=1}^n N_i \tau_i}{\sum_{i=1}^n N_i}$$

n = number of surveillance tests performed in cycle

N_i = number of active control rods measured in the i^{th} surveillance test

τ_i = average scram time to notch 39 of all rods measured in the i^{th} surveillance test

N_1 = total number of active rods measured in Specification 3.1.4.1

$\tau = 1.0$ prior to performance of the initial scram time measurements for the cycle

2. ARTS provides for power- and flow-dependent thermal limit adjustments and multipliers, which allow for a more reliable administration of the MCPR thermal limit. The MCPR(P) curves are independent of EOC-RPT and scram time option, but are determined for other EOOS. The MCPR(P) limits for PROOS were converted to a K(P) consistent with the ARTS offrated limits. MCPR(F) is independent of Scram Time Option and all EOOS.

3. The Operating Limit MCPR values for Turbine Bypass Out of Service and EOC-RPT Out of Service are higher (more limiting) than for the standard normal operation case, and are therefore specifically identified where appropriate. The OLMCPR values for all other analyzed EOOS transient events are bounded by the Normal Operation limits.

4. EOR is the End of Rated exposure as defined in the Cycle Management Report.

5. The K(P) multiplier at P-bypass (26% power) for PROOS has been adjusted to match the EIS condition in order to add conservatism under the PROOS condition.

Figure 2a
MCPR Operating Limits
(BOC to EOR-1611 MWd/ST)

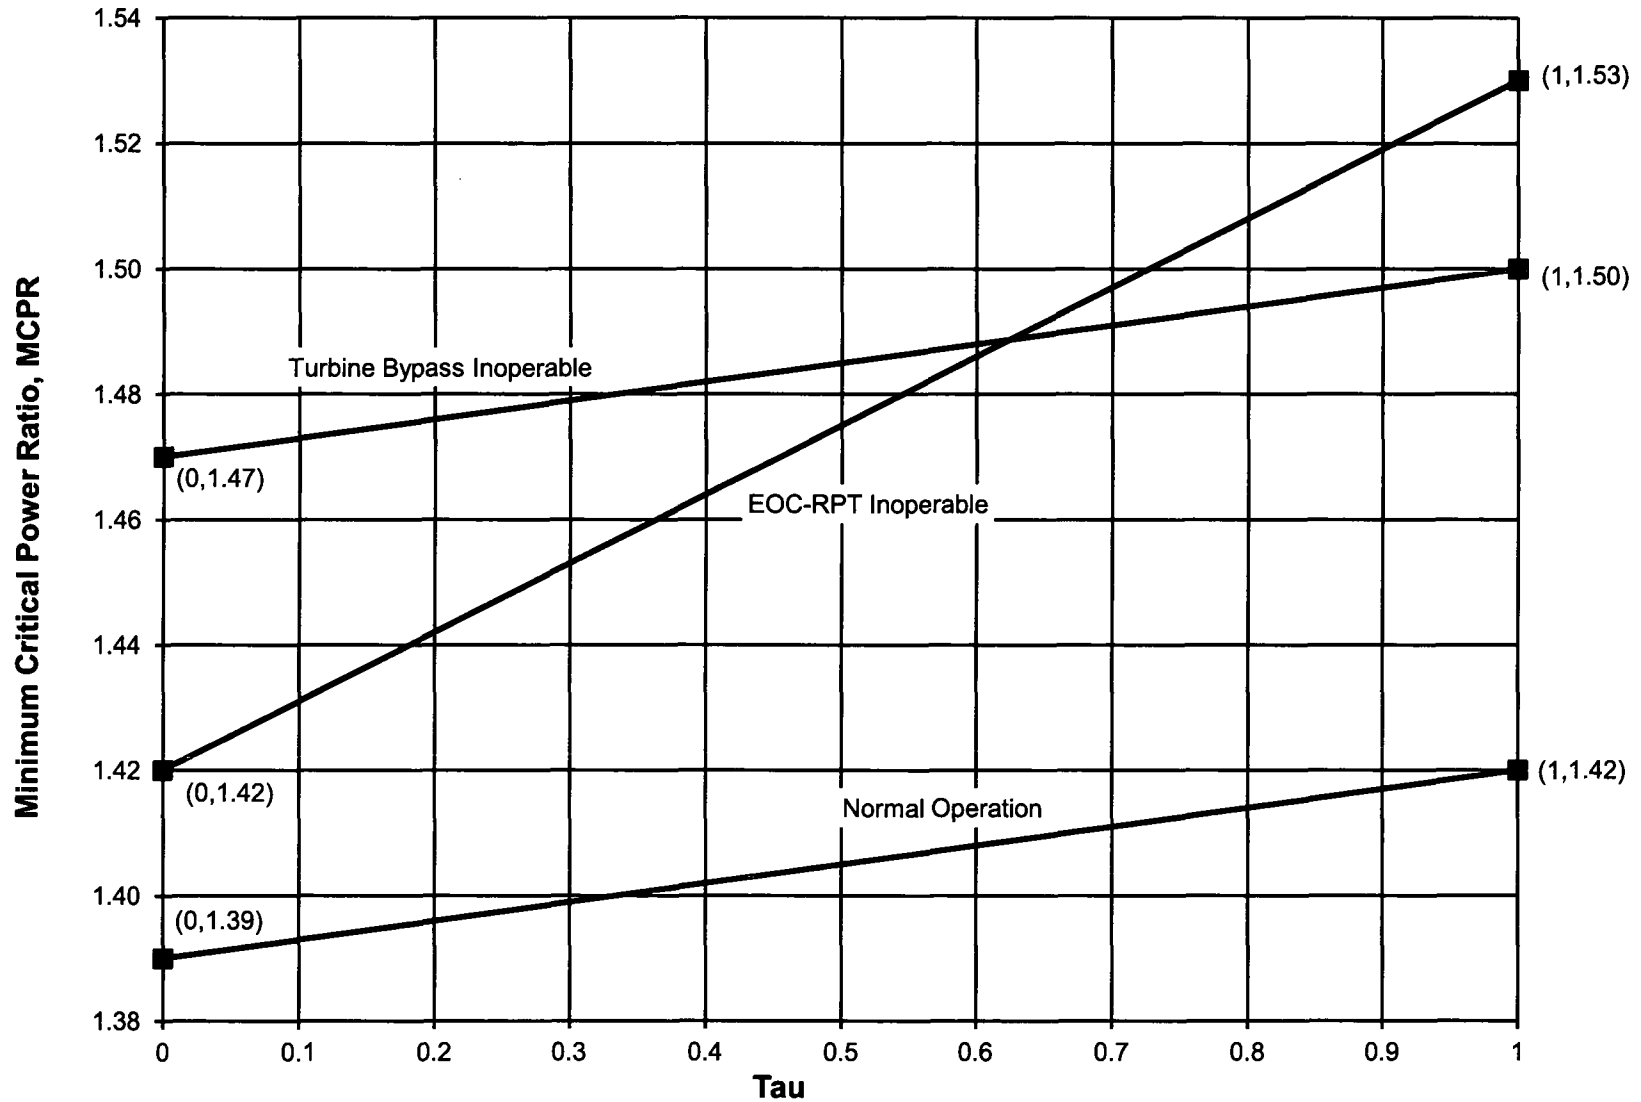


Figure 2b
MCPR Operating Limits
(EOR-1611 MWd/ST to EOC)

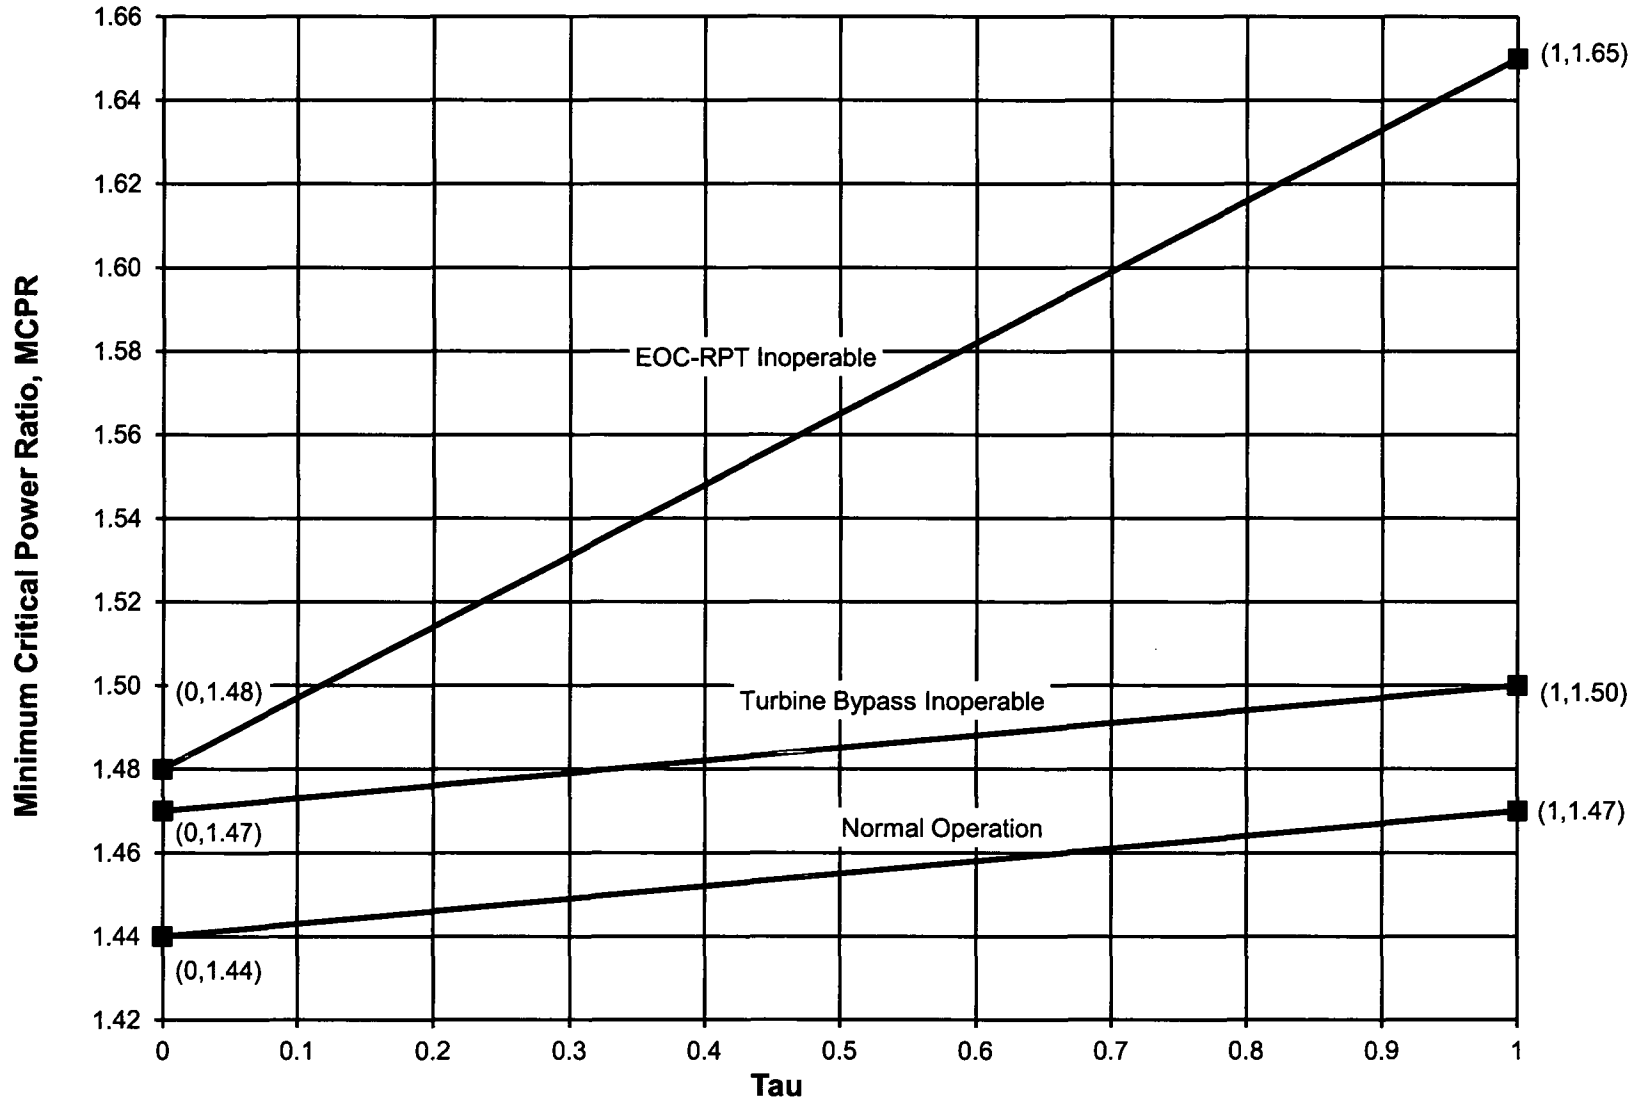


Figure 2c
MCPR(P) for <26%Power, ≤75%Flow
K(P) for ≥26% Power
for Equipment In Service and Recirculation Pump Trip Out of Service

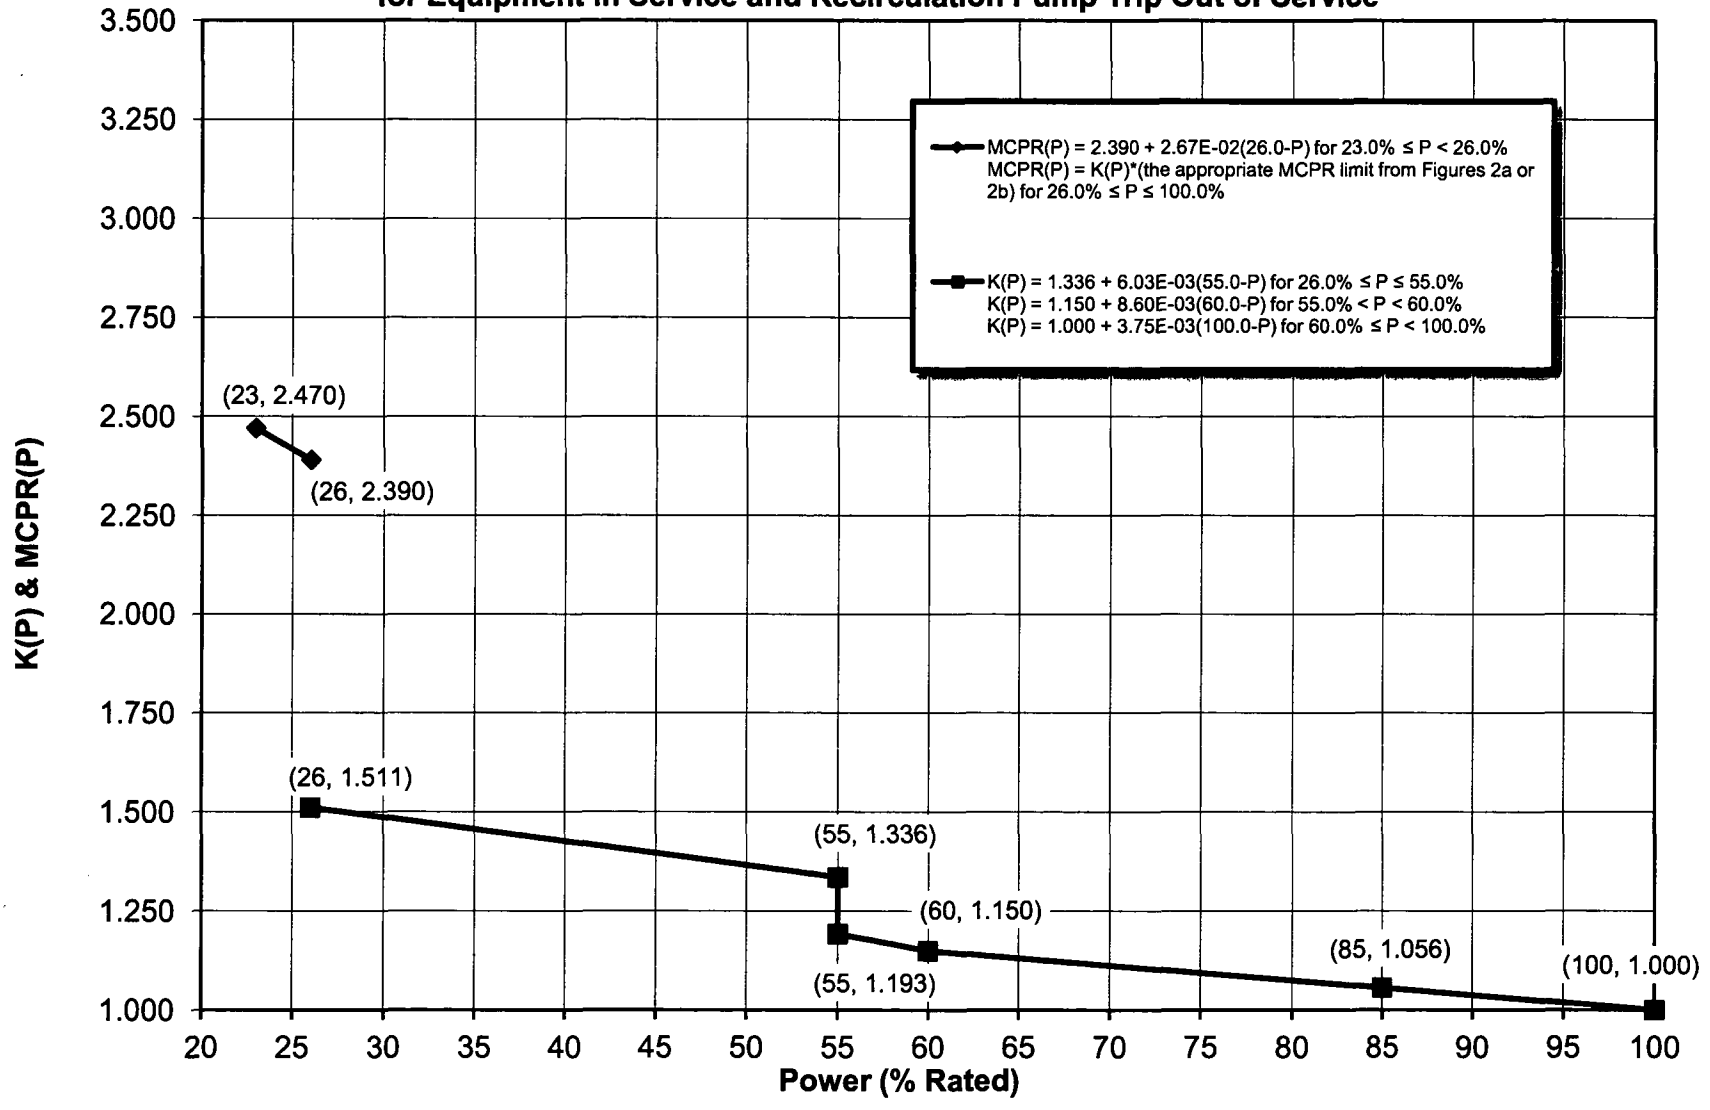


Figure 2d
MCPR(P) for <26%Power, ≤75%Flow
K(P) for ≥26% Power
for Turbine Bypass Out of Service

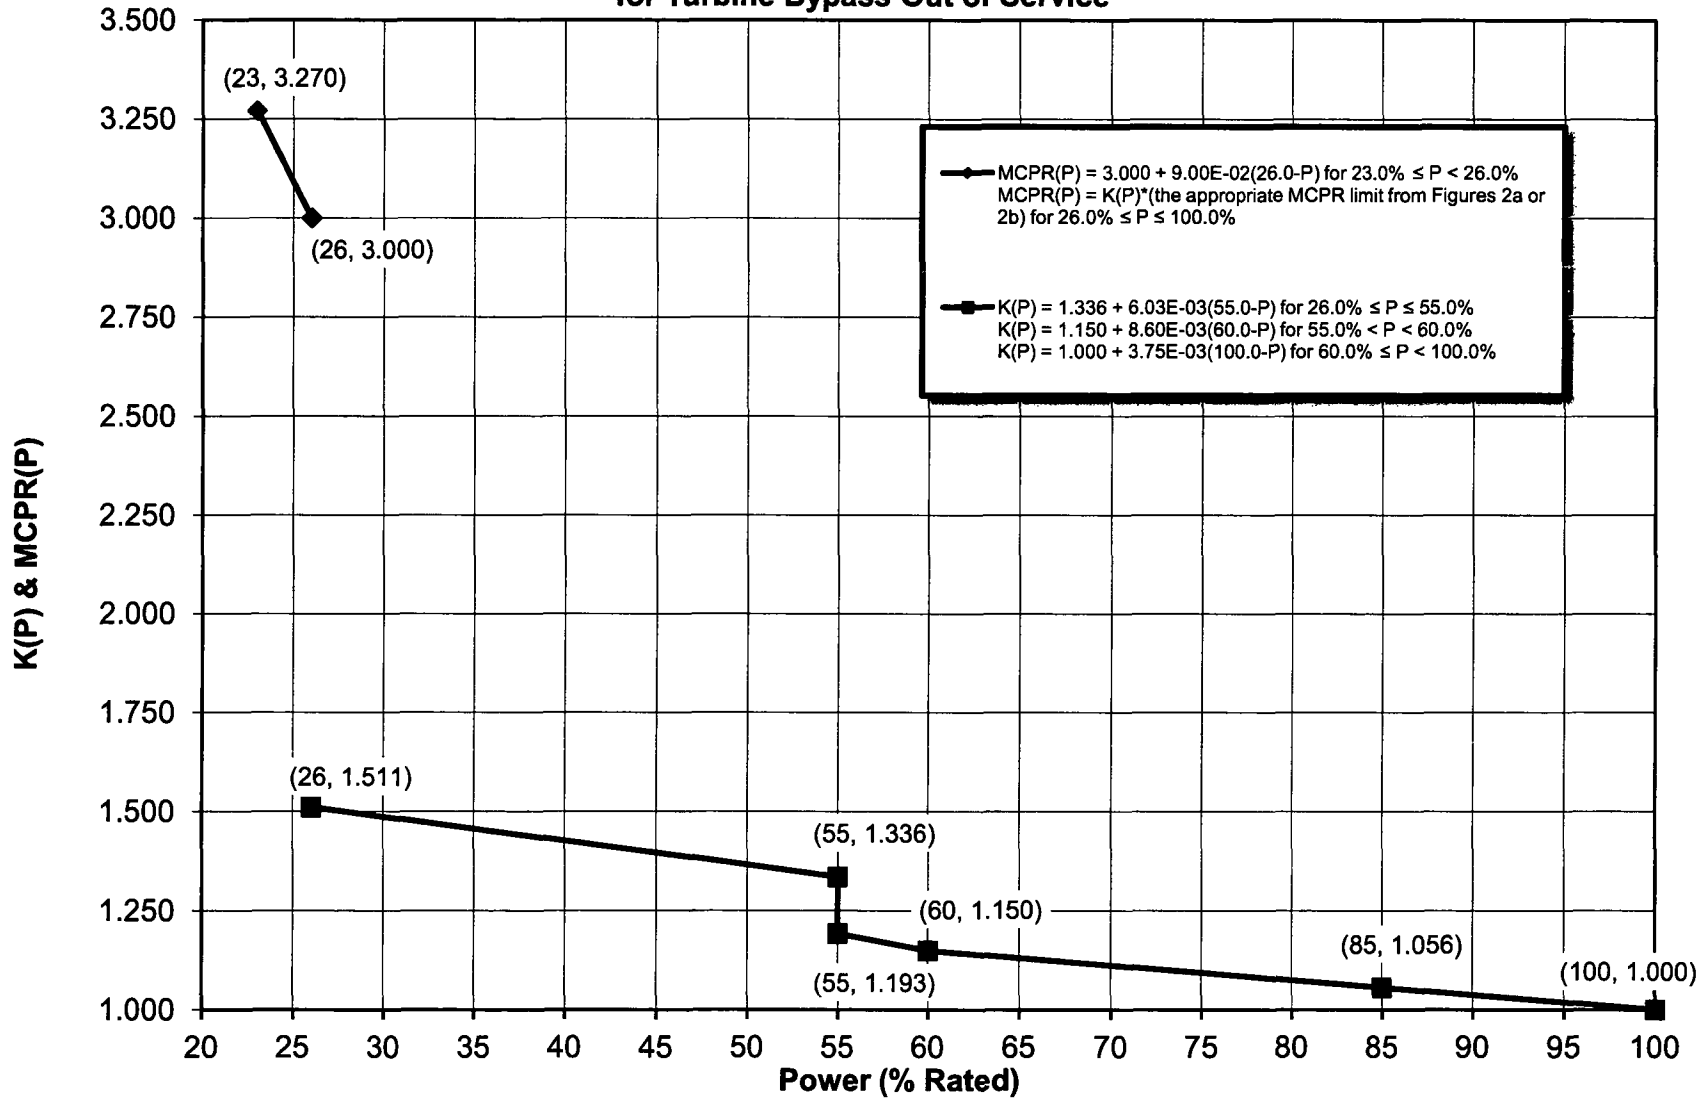


Figure 2e
MCPR(P) for <26%Power, ≤75%Flow
K(P) for ≥26% Power
for Operation without a Backup Pressure Regulator


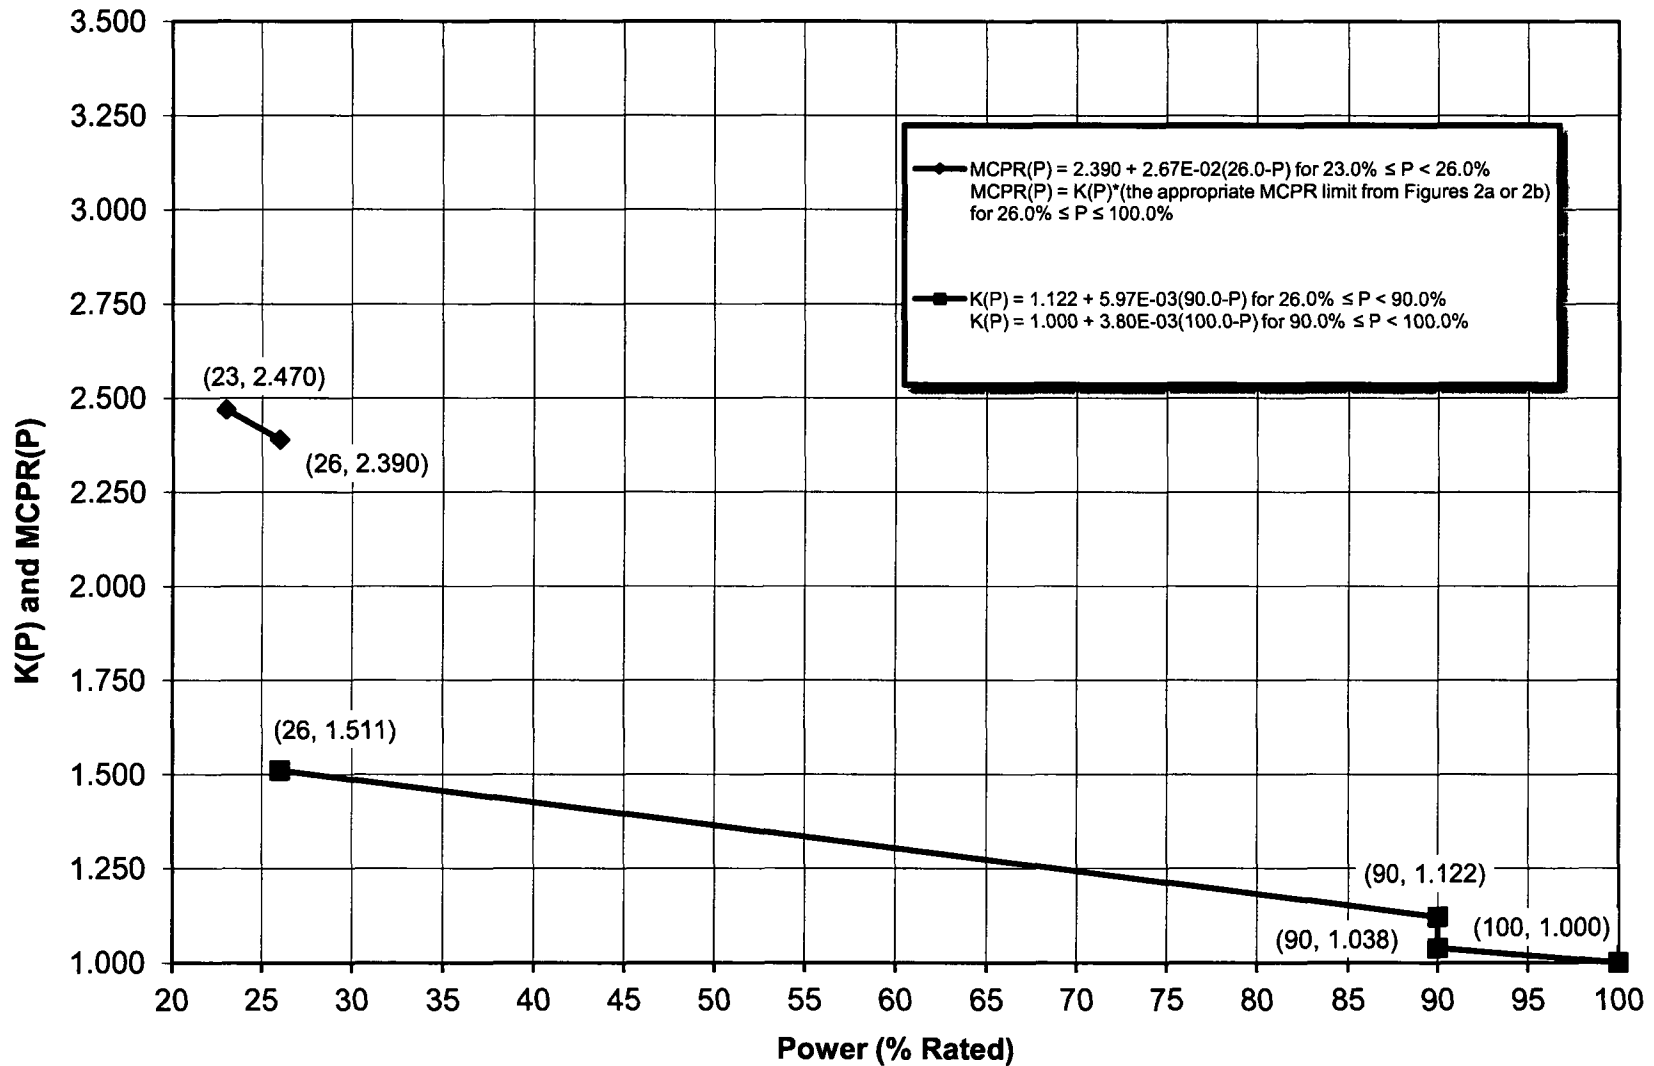


Figure 2f
Flow-Dependent MCPR Limits
MCPR(F)

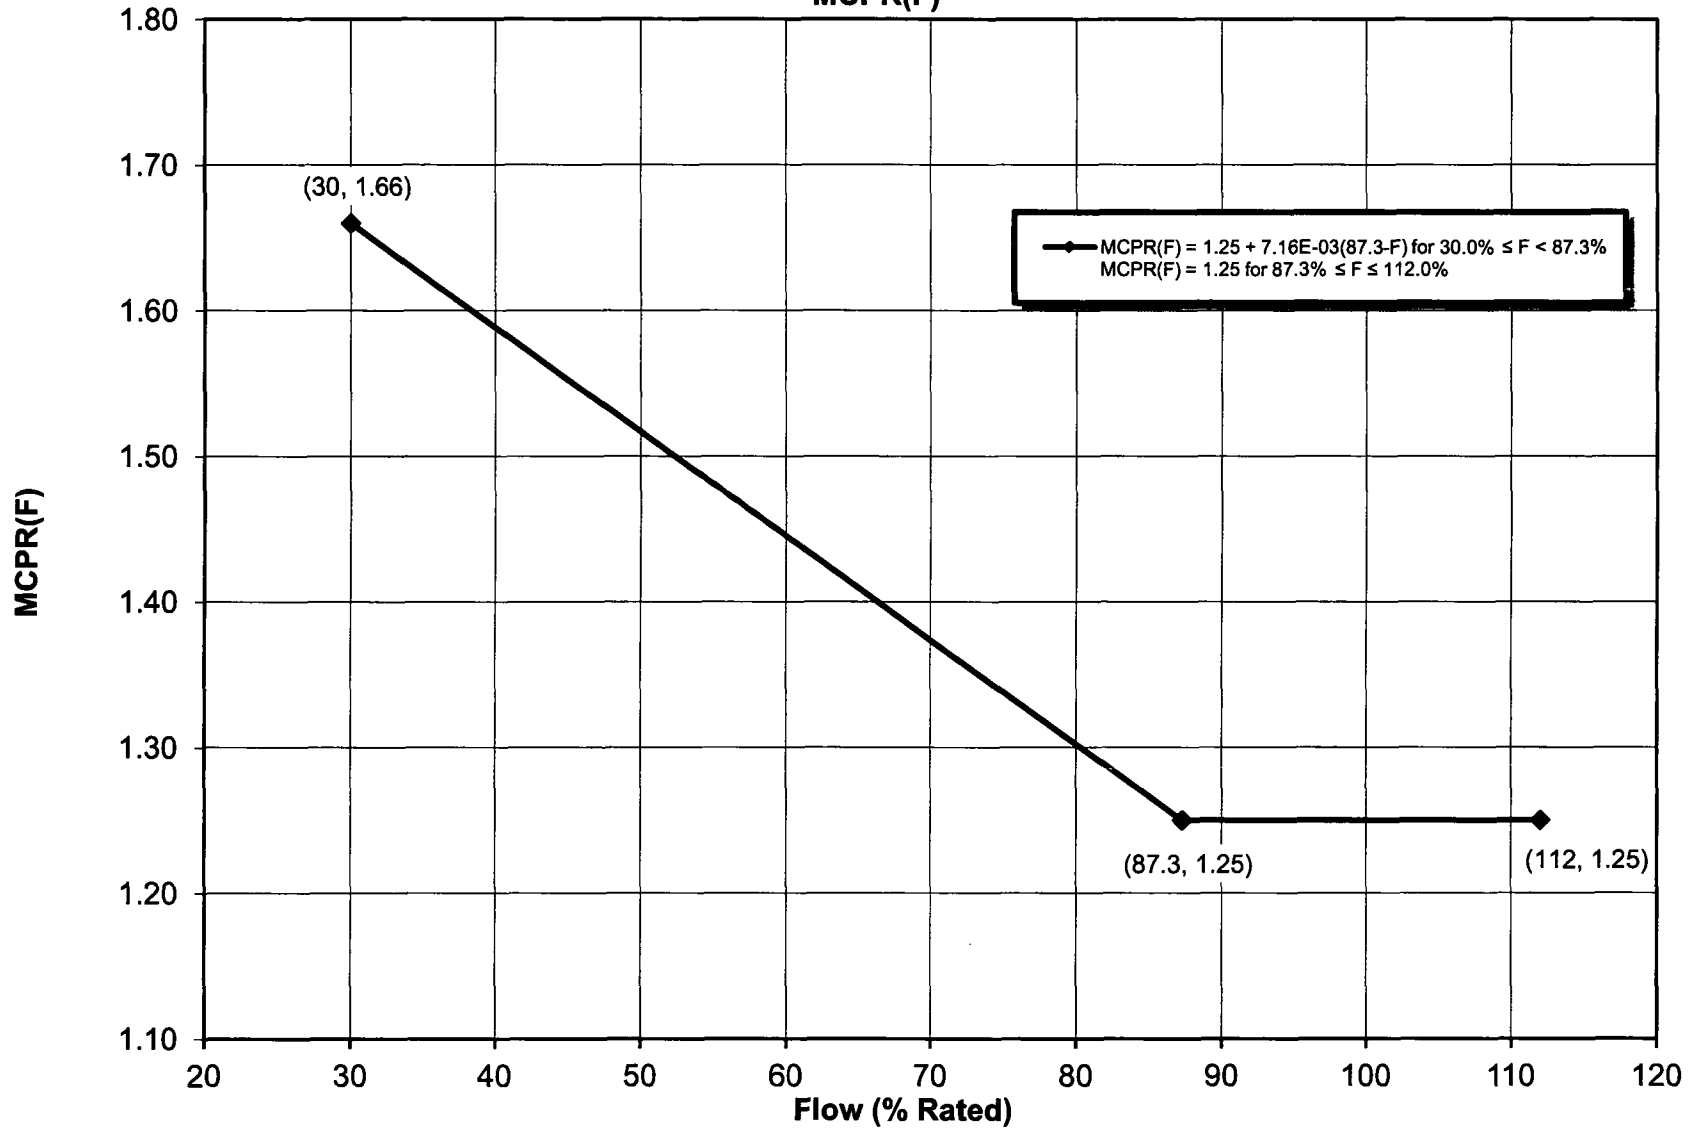

3.0 LINEAR HEAT GENERATION RATE (LHGR)

3.1 Limits for Technical Specification 3.2.3

During power operation, the Linear Heat Generation Rate (LHGR) of any rod in any fuel assembly at any axial location shall not exceed the minimum of: 1) the limiting values shown in FBIR2-14, Rev 00, "Nine Mile Point Unit 2 Fuel Bundle Information Report" times the LHGRFAC(F) from Figure 3d; and 2) the limiting values shown in FBIR2-14, Rev 00, "Nine Mile Point Unit 2 Fuel Bundle Information Report" times the appropriate LHGRFAC(P) from Figures 3a or 3b or 3c. FBIR2-14, Rev 00, "Nine Mile Point Unit 2 Fuel Bundle Information Report" contains the LHGR limits for both UO₂ rods (which contain no gadolinium) and the most limiting gadolinium-bearing rods. Other gadolinium-bearing rods have LHGR limits which lie between these two curves. Compliance with these limits will be monitored by the plant's process computer.

NOTES:

ARTS provides for power- and flow-dependent thermal limit multipliers, which allow for a more reliable administration of the LHGR thermal limits. The LHGRFAC(P) curves are independent of recirculation pump trip operability, but are determined for other EOOS. The LHGRFAC (P) limits for PROOS are also presented in a manner more consistent with the ARTS offrated limits. LHGRFAC(F) is identical for all EOOS.

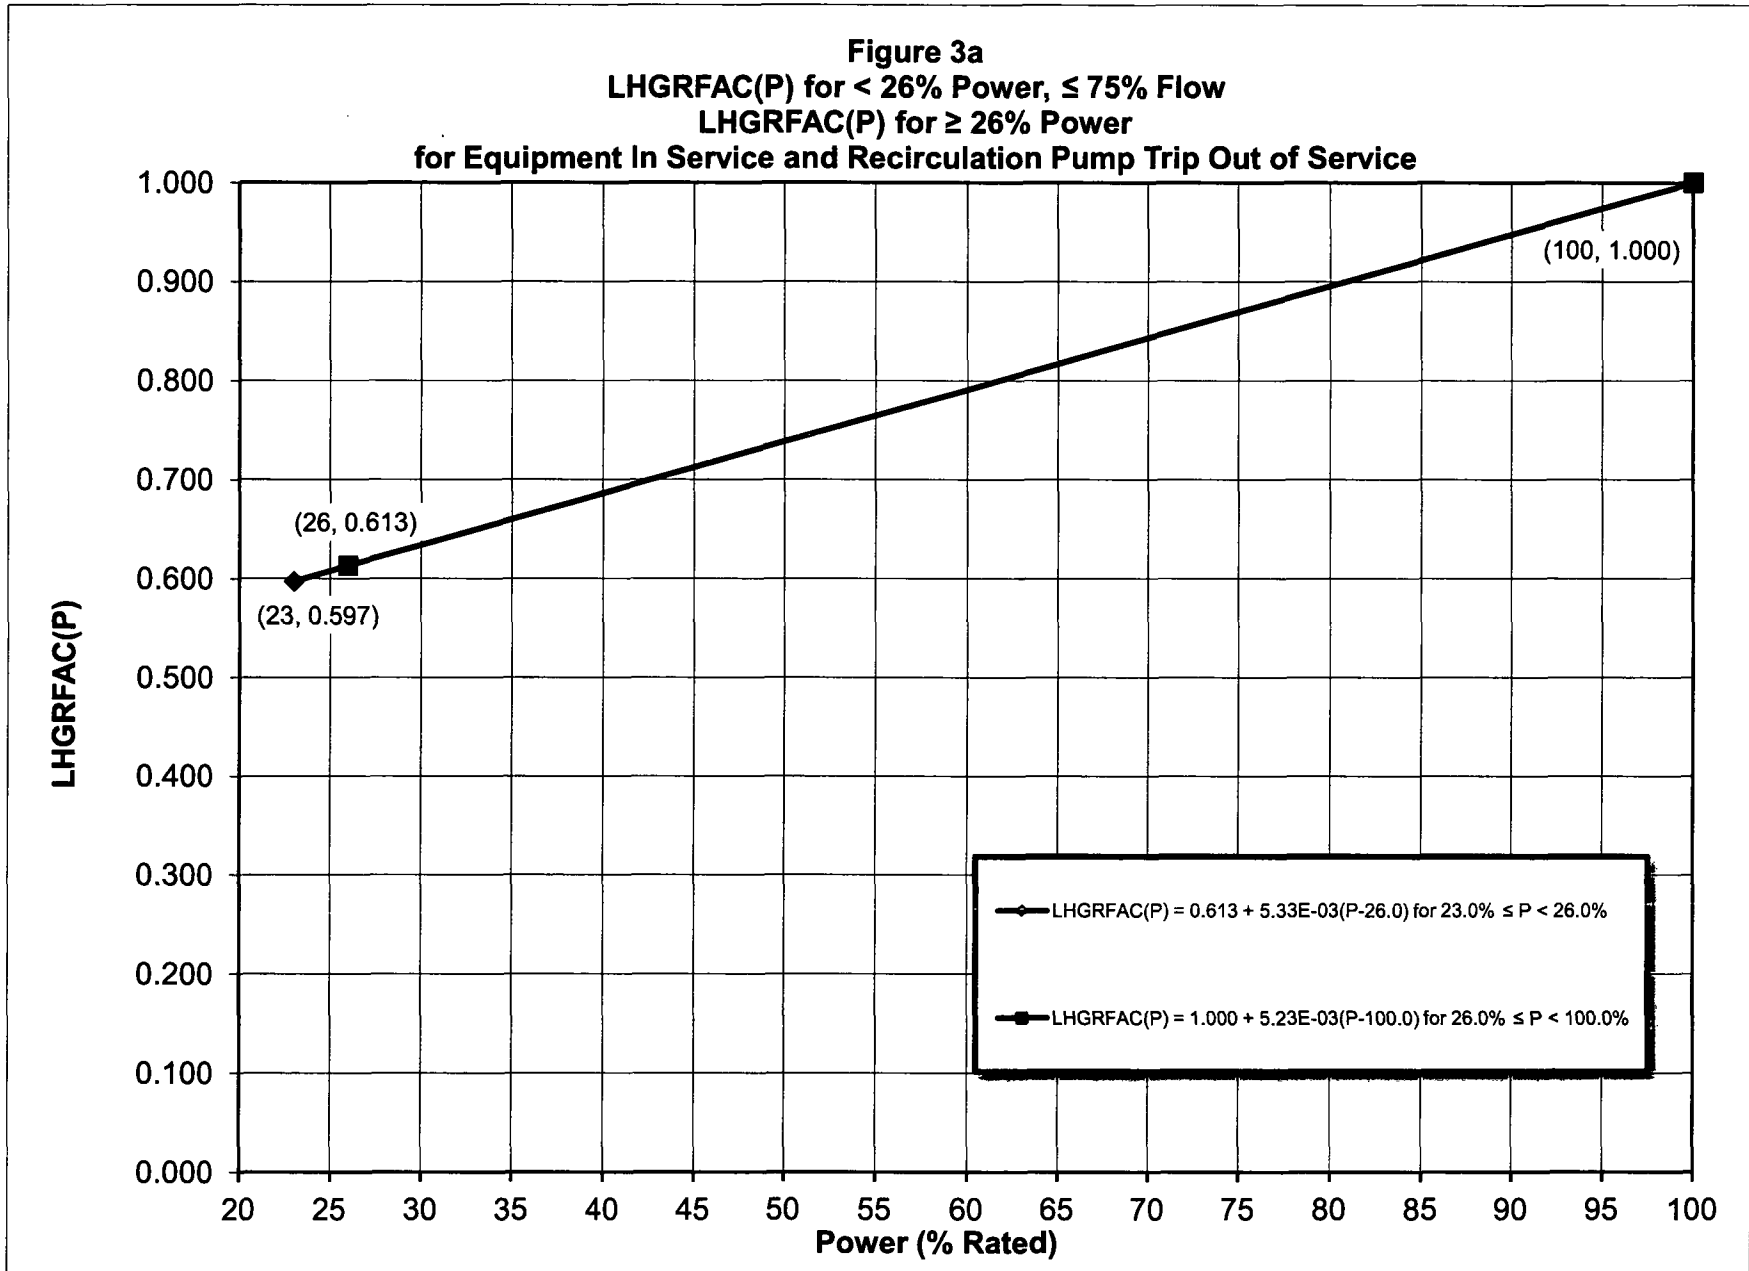


Figure 3b
LHGRFAC(P) for < 26% Power, ≤ 75% Flow
LHGRFAC(P) for ≥ 26% Power
for Turbine Bypass Out of Service

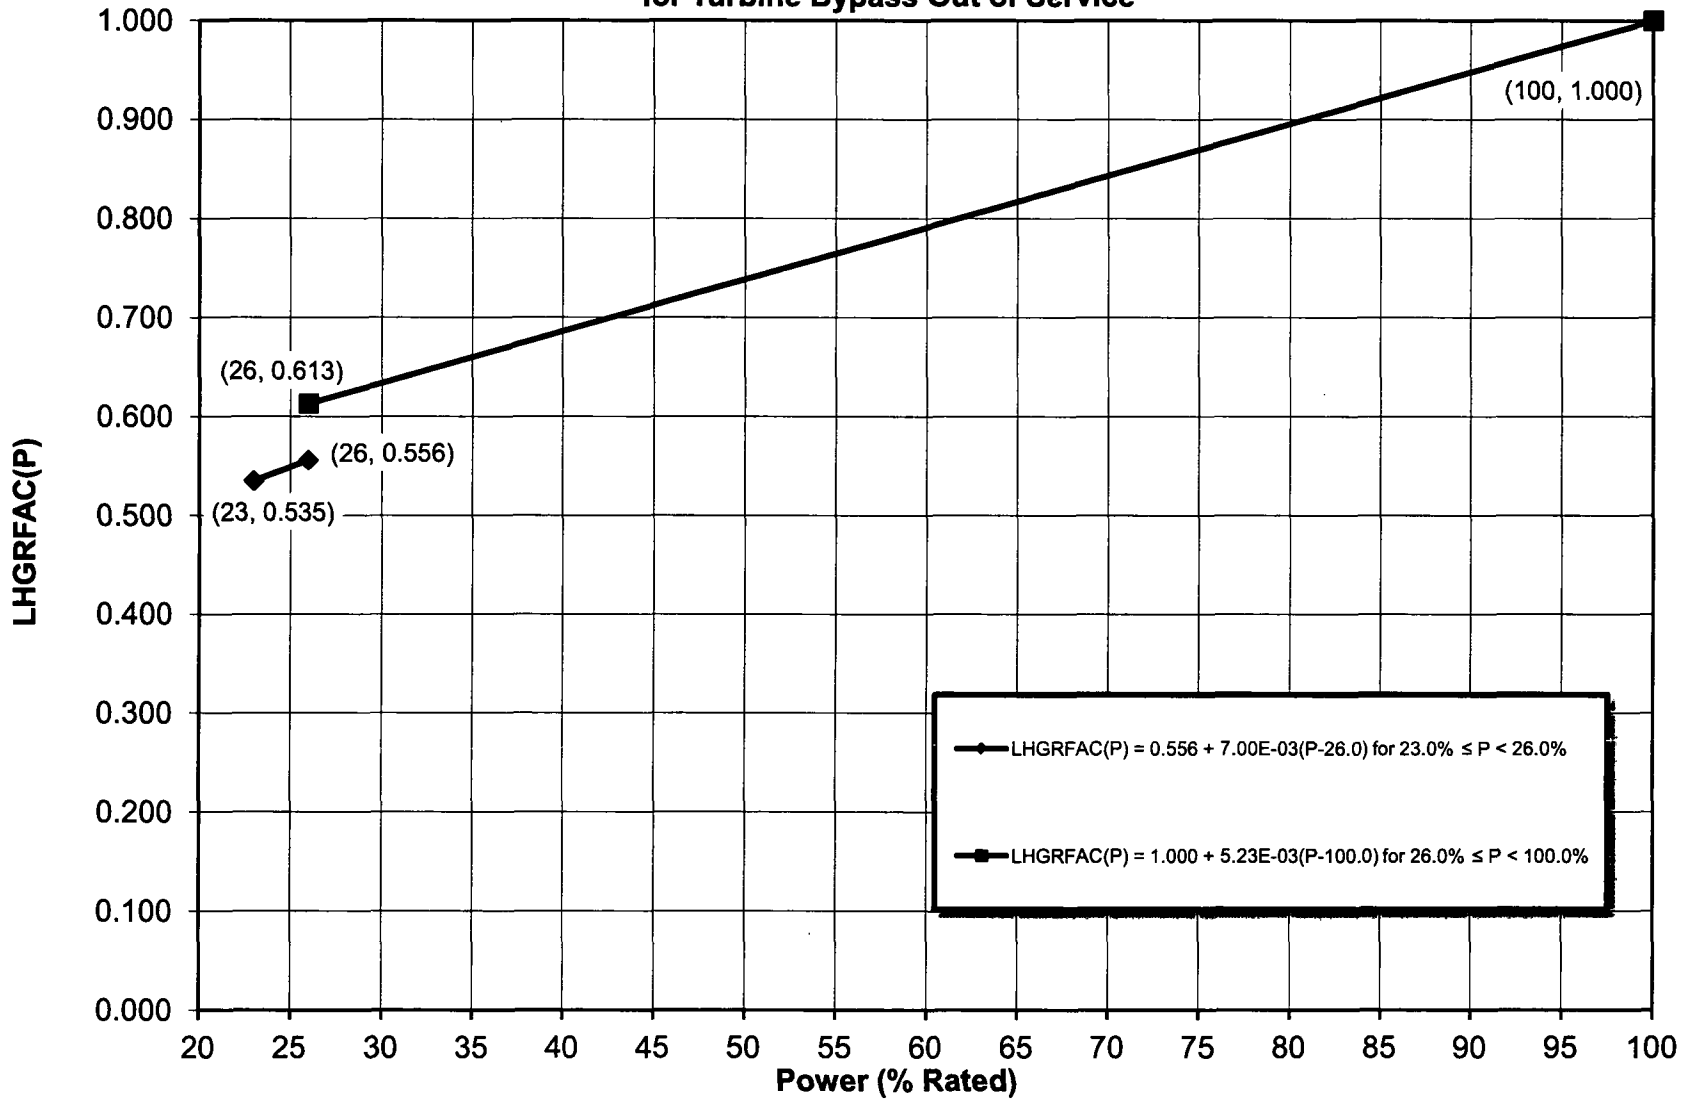


Figure 3c
LHGRFAC(P) for < 26% Power, ≤ 75% Flow
LHGRFAC(P) for ≥ 26% Power
for Operation without a Backup Pressure Regulator


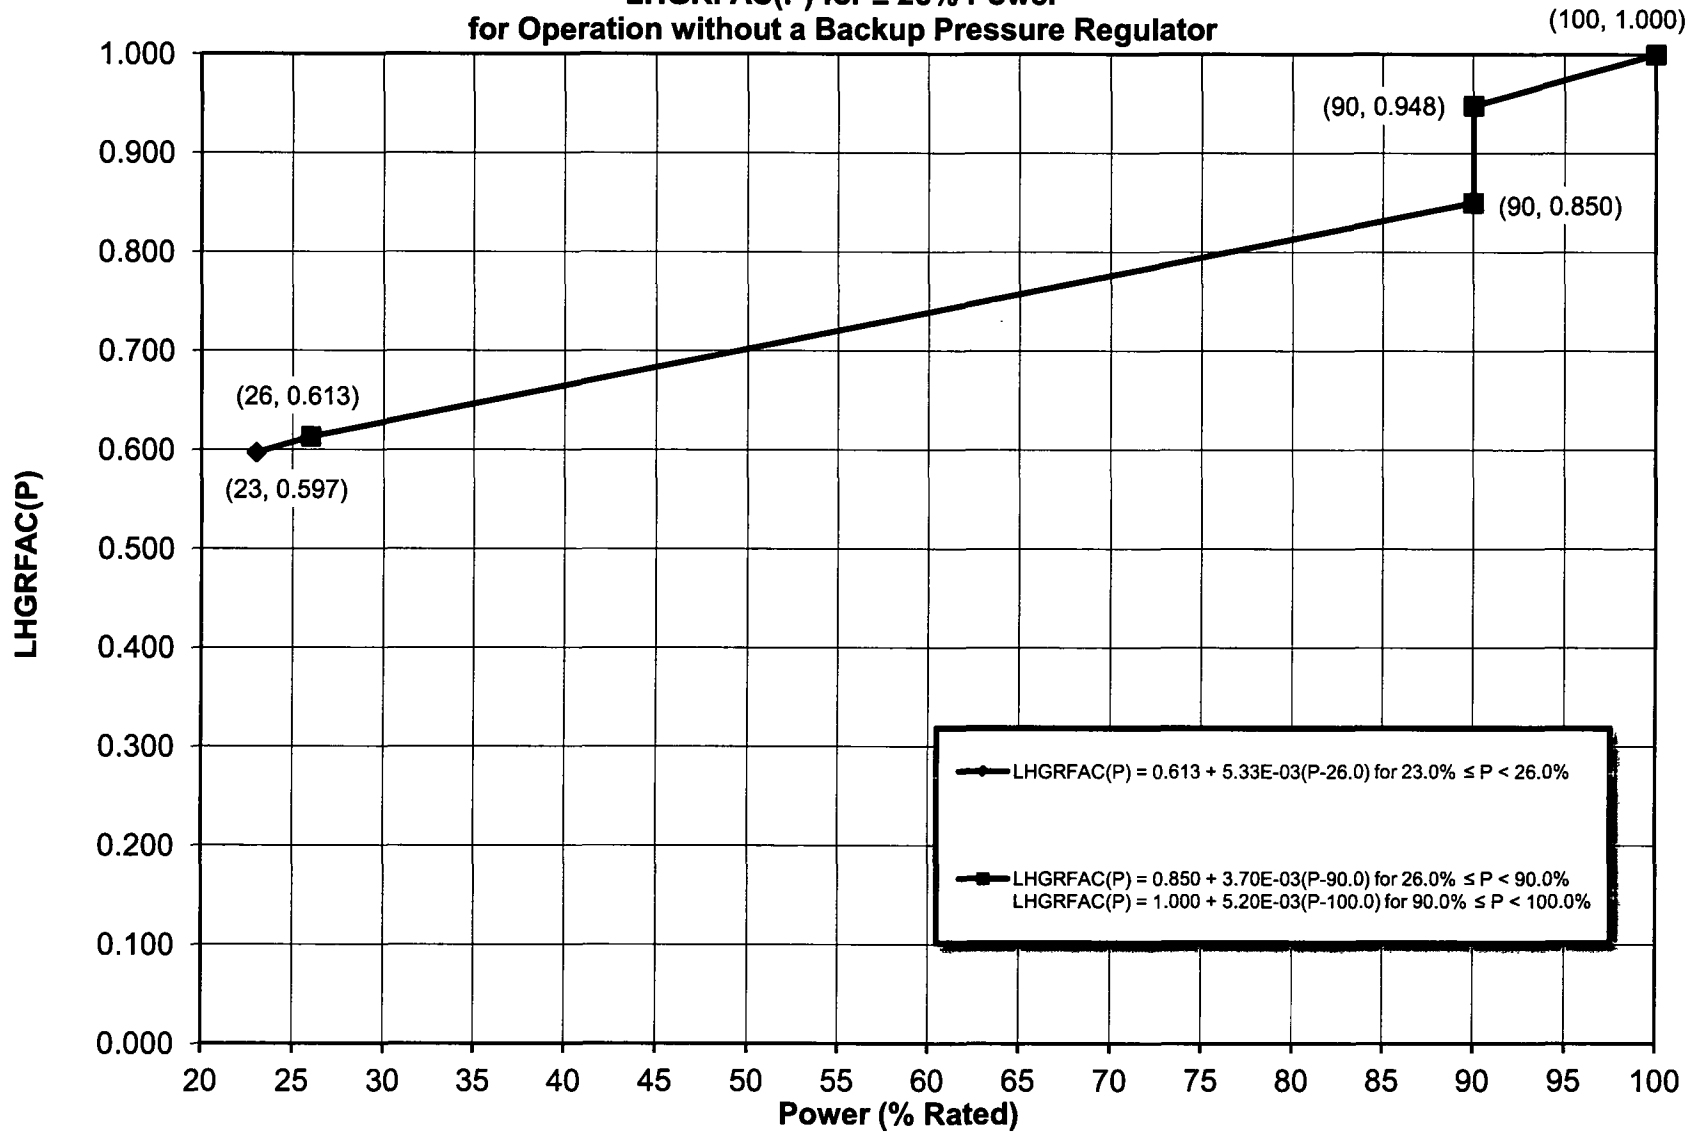


Figure 3d
Flow-Dependent LGHR Multiplier
LHGRFAC(F)

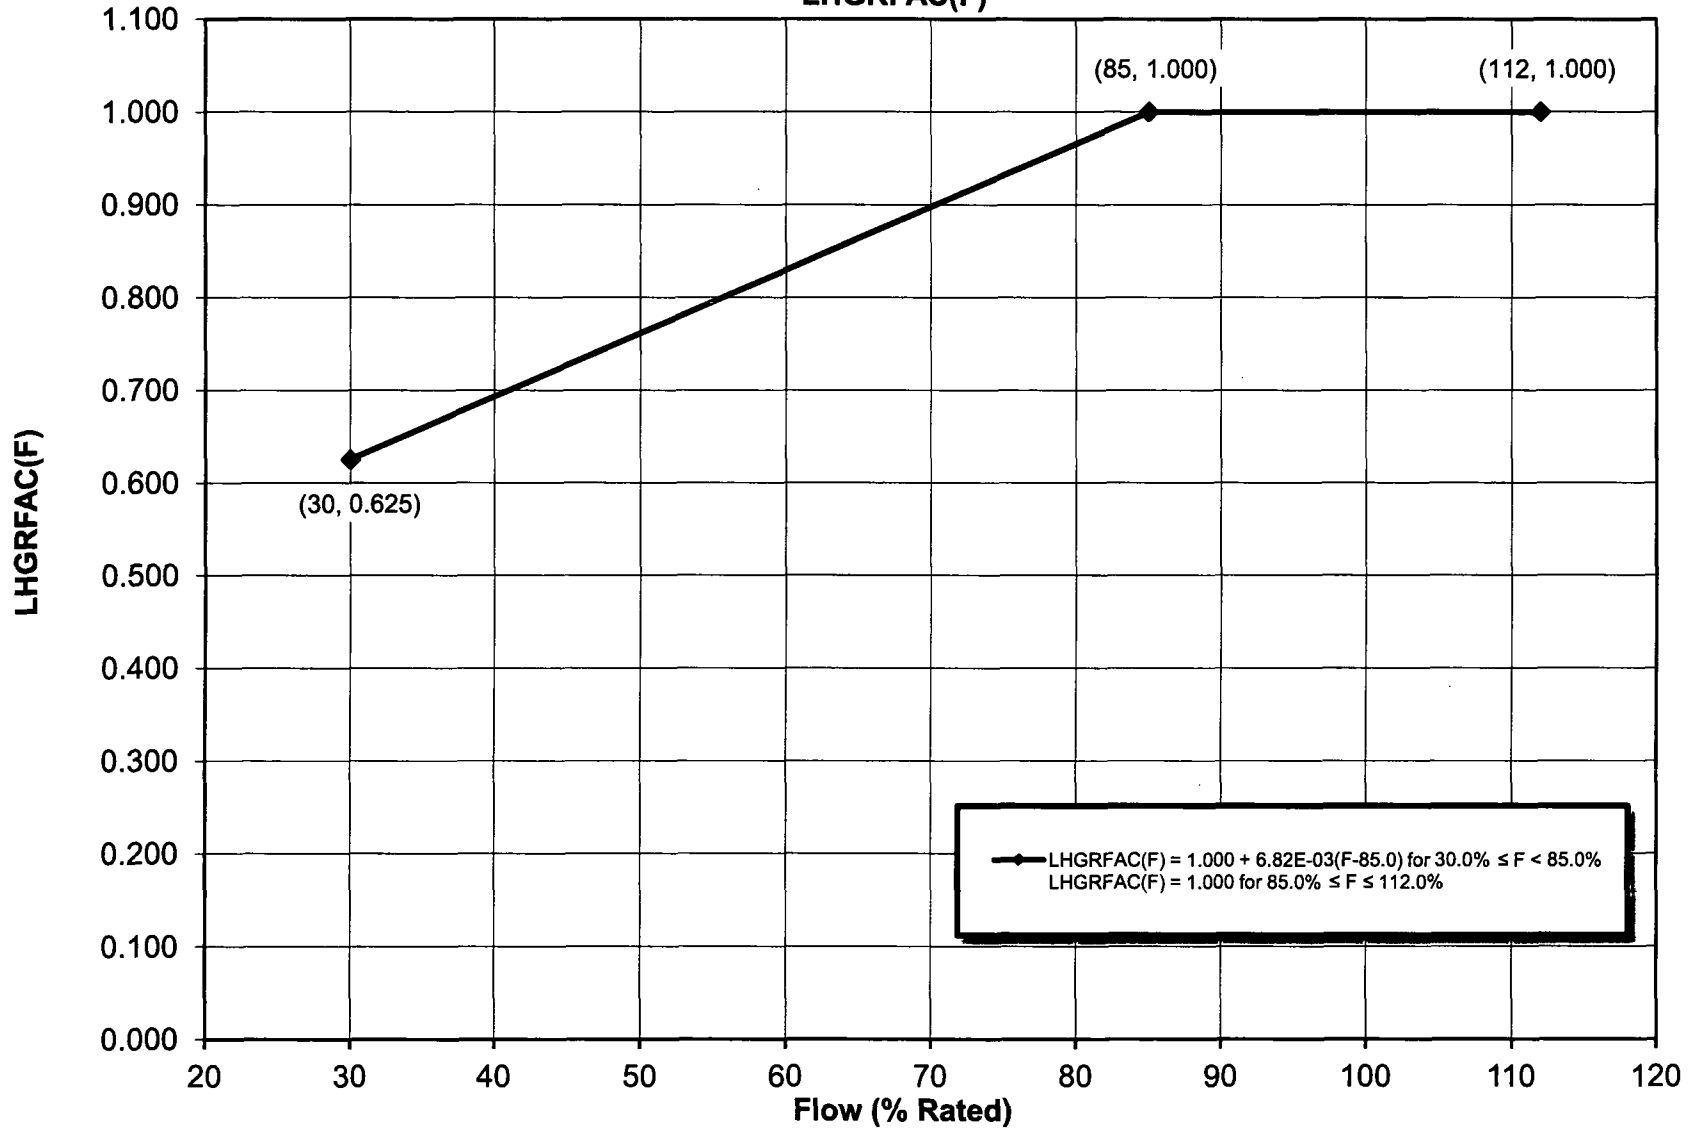

4.0 AVERAGE POWER RANGE MONITOR SETPOINTS

4.1 Limits for Technical Specification Table 3.3.1.1-1 (OPRM Upscale)

Allowable value < 1.13

5.0 CONTROL ROD BLOCK INSTRUMENTATION

5.1 Footnote Values for Technical Specification Table 3.3.2.1-1

(a) MCPR <	1.70
(b) MCPR <	1.70
(c) MCPR <	1.70
(d) MCPR <	1.40
(e) MCPR <	1.70
(h) Allowable Value:	
Low Power Range - Upscale	124.6
Intermediate Power Range - Upscale	119.6
High Power Range - Upscale	114.6
(i) NTSP:	
Low Power Range - Upscale	124.2
Intermediate Power Range - Upscale	119.2
High Power Range - Upscale	114.2

6.0 REFERENCES FOR TECHNICAL SPECIFICATION

6.1 Technical Specification 5.6.5.b.1:

General Electric Standard Application for Reactor Fuel, NEDE 204011-P-A-18 and NEDE 204011-P-A-18-US, April 2011.

7.0 REFERENCES FOR TECHNICAL SPECIFICATION BASES

- 2.1.1 Bases Reference 3:
General Electric Standard Application for Reactor Fuel, NEDE 24011-P-A-18 and NEDE 24011-P-A-18-US, April 2011.
- 2.1.1 Bases Reference 4:
Supplemental Reload Licensing Report for Nine Mile Point 2 Cycle 14, 0000-0129-4873-SRLR, Rev. 1, April 2012.
- 3.1.1 Bases Reference 7:
General Electric Standard Application for Reactor Fuel, NEDE 24011-P-A-18 and NEDE 24011-P-A-18-US, April 2011.
- 3.1.6 Bases Reference 1:
Supplemental Reload Licensing Report for Nine Mile Point 2 Cycle 14, 0000-0129-4873-SRLR, Rev. 1, April 2012.
- 3.2.1 Bases Reference 1:
General Electric Standard Application for Reactor Fuel, NEDE 24011-P-A-18 and NEDE 24011-P-A-18-US, April 2011.
- 3.2.2 Bases Reference 2:
General Electric Standard Application for Reactor Fuel, NEDE 24011-P-A-18 and NEDE 24011-P-A-18-US, April 2011.
- 3.2.2 Bases Reference 3:
Supplemental Reload Licensing Report for Nine Mile Point 2 Cycle 14, 0000-0129-4873-SRLR, Rev. 1, April 2012.
- 3.2.3 Bases Reference 1:
General Electric Standard Application for Reactor Fuel, NEDE 24011-P-A-18 and NEDE 24011-P-A-18-US, April 2011.
- 3.2.3 Bases Reference 2:
Supplemental Reload Licensing Report for Nine Mile Point 2 Cycle 14, 0000-0129-4873-SRLR, Rev. 1, April 2012.

8.0 SOURCE DOCUMENTS

The Core Operating Limits contained in this report were obtained from the following documents:

Section 1.0 - APLHGR Limits

Supplemental Reload Licensing Report for Nine Mile Point 2 Cycle 14, 0000-0129-4873-SRLR, Rev. 1, April 2012.

Section 2.0 - MCPR Limits

Supplemental Reload Licensing Report for Nine Mile Point 2 Cycle 14, 0000-0129-4873-SRLR, Rev. 1, April 2012.

Nine Mile Point Station Unit 2 - APRM/RBM/Technical Specifications/Maximum Extended Load Line Limit Analysis (ARTS/MELLLA), NEDC-33286P, Rev. 0, March 2007 (NER-2E-037)

Nine Mile Point Nuclear Station Unit 2 ARTS/MELLLA, Task T0900, GE-NE-0000-0055-2373-R0, Rev. 0, February 2007 (NER-2E-037).

Engineering Report for Nine Mile Point Nuclear Station Unit 2, Reload 11, Cycle 12, 0000-0067-1271-ER, Rev 0, March 2008.

Evaluation of Loss of Stator Water Cooling for Nine Mile Point Units 1 and 2, 0000-0158-1307-R0, Rev 0, March 2013.

Section 3.0 - LHGR Limits

Supplemental Reload Licensing Report for Nine Mile Point 2 Cycle 14, 0000-0129-4873-SRLR, Rev. 1, April 2012.

Nine Mile Point Station Unit 2 - APRM/RBM/Technical Specifications/Maximum Extended Load Line Limit Analysis (ARTS/MELLLA), NEDC-33286P, Rev. 0, March 2007 (NER-2E-037).

Nine Mile Point Nuclear Station Unit 2 ARTS/MELLLA, Task T0900, GE-NE-0000-0055-2373-R0, Rev. 0, February 2007 (NER-2E-037).

Section 4.0 - APRM Setpoints

Supplemental Reload Licensing Report for Nine Mile Point 2 Cycle 14, 0000-0129-4873-SRLR, Rev. 1, April 2012.

Design Specification Data Sheet 22A2843AM (NMPCNO NSSS161405000), Neutron Monitoring System.

Section 5.0 - Control Rod Block Instrumentation

Supplemental Reload Licensing Report for Nine Mile Point 2 Cycle 14, 0000-0129-4873-SRLR, Rev. 1, April 2012.

Nine Mile Point Station Unit 2 - APRM/RBM/Technical Specifications/Maximum Extended Load Line Limit Analysis (ARTS/MELLLA), NEDC-33286P, Rev. 0, March 2007.

Instrument Limits Calculation Constellation Generation Group Nine Mile Point Nuclear Station Unit 2 Rod Block Monitor (NUMAC ARTS-MELLLA), 0000-0053-1006 NMP2 A-M-T506-RBM-Calc-2006, Rev. 1, March 2008 (Found within NMP document NSSS168805002).