


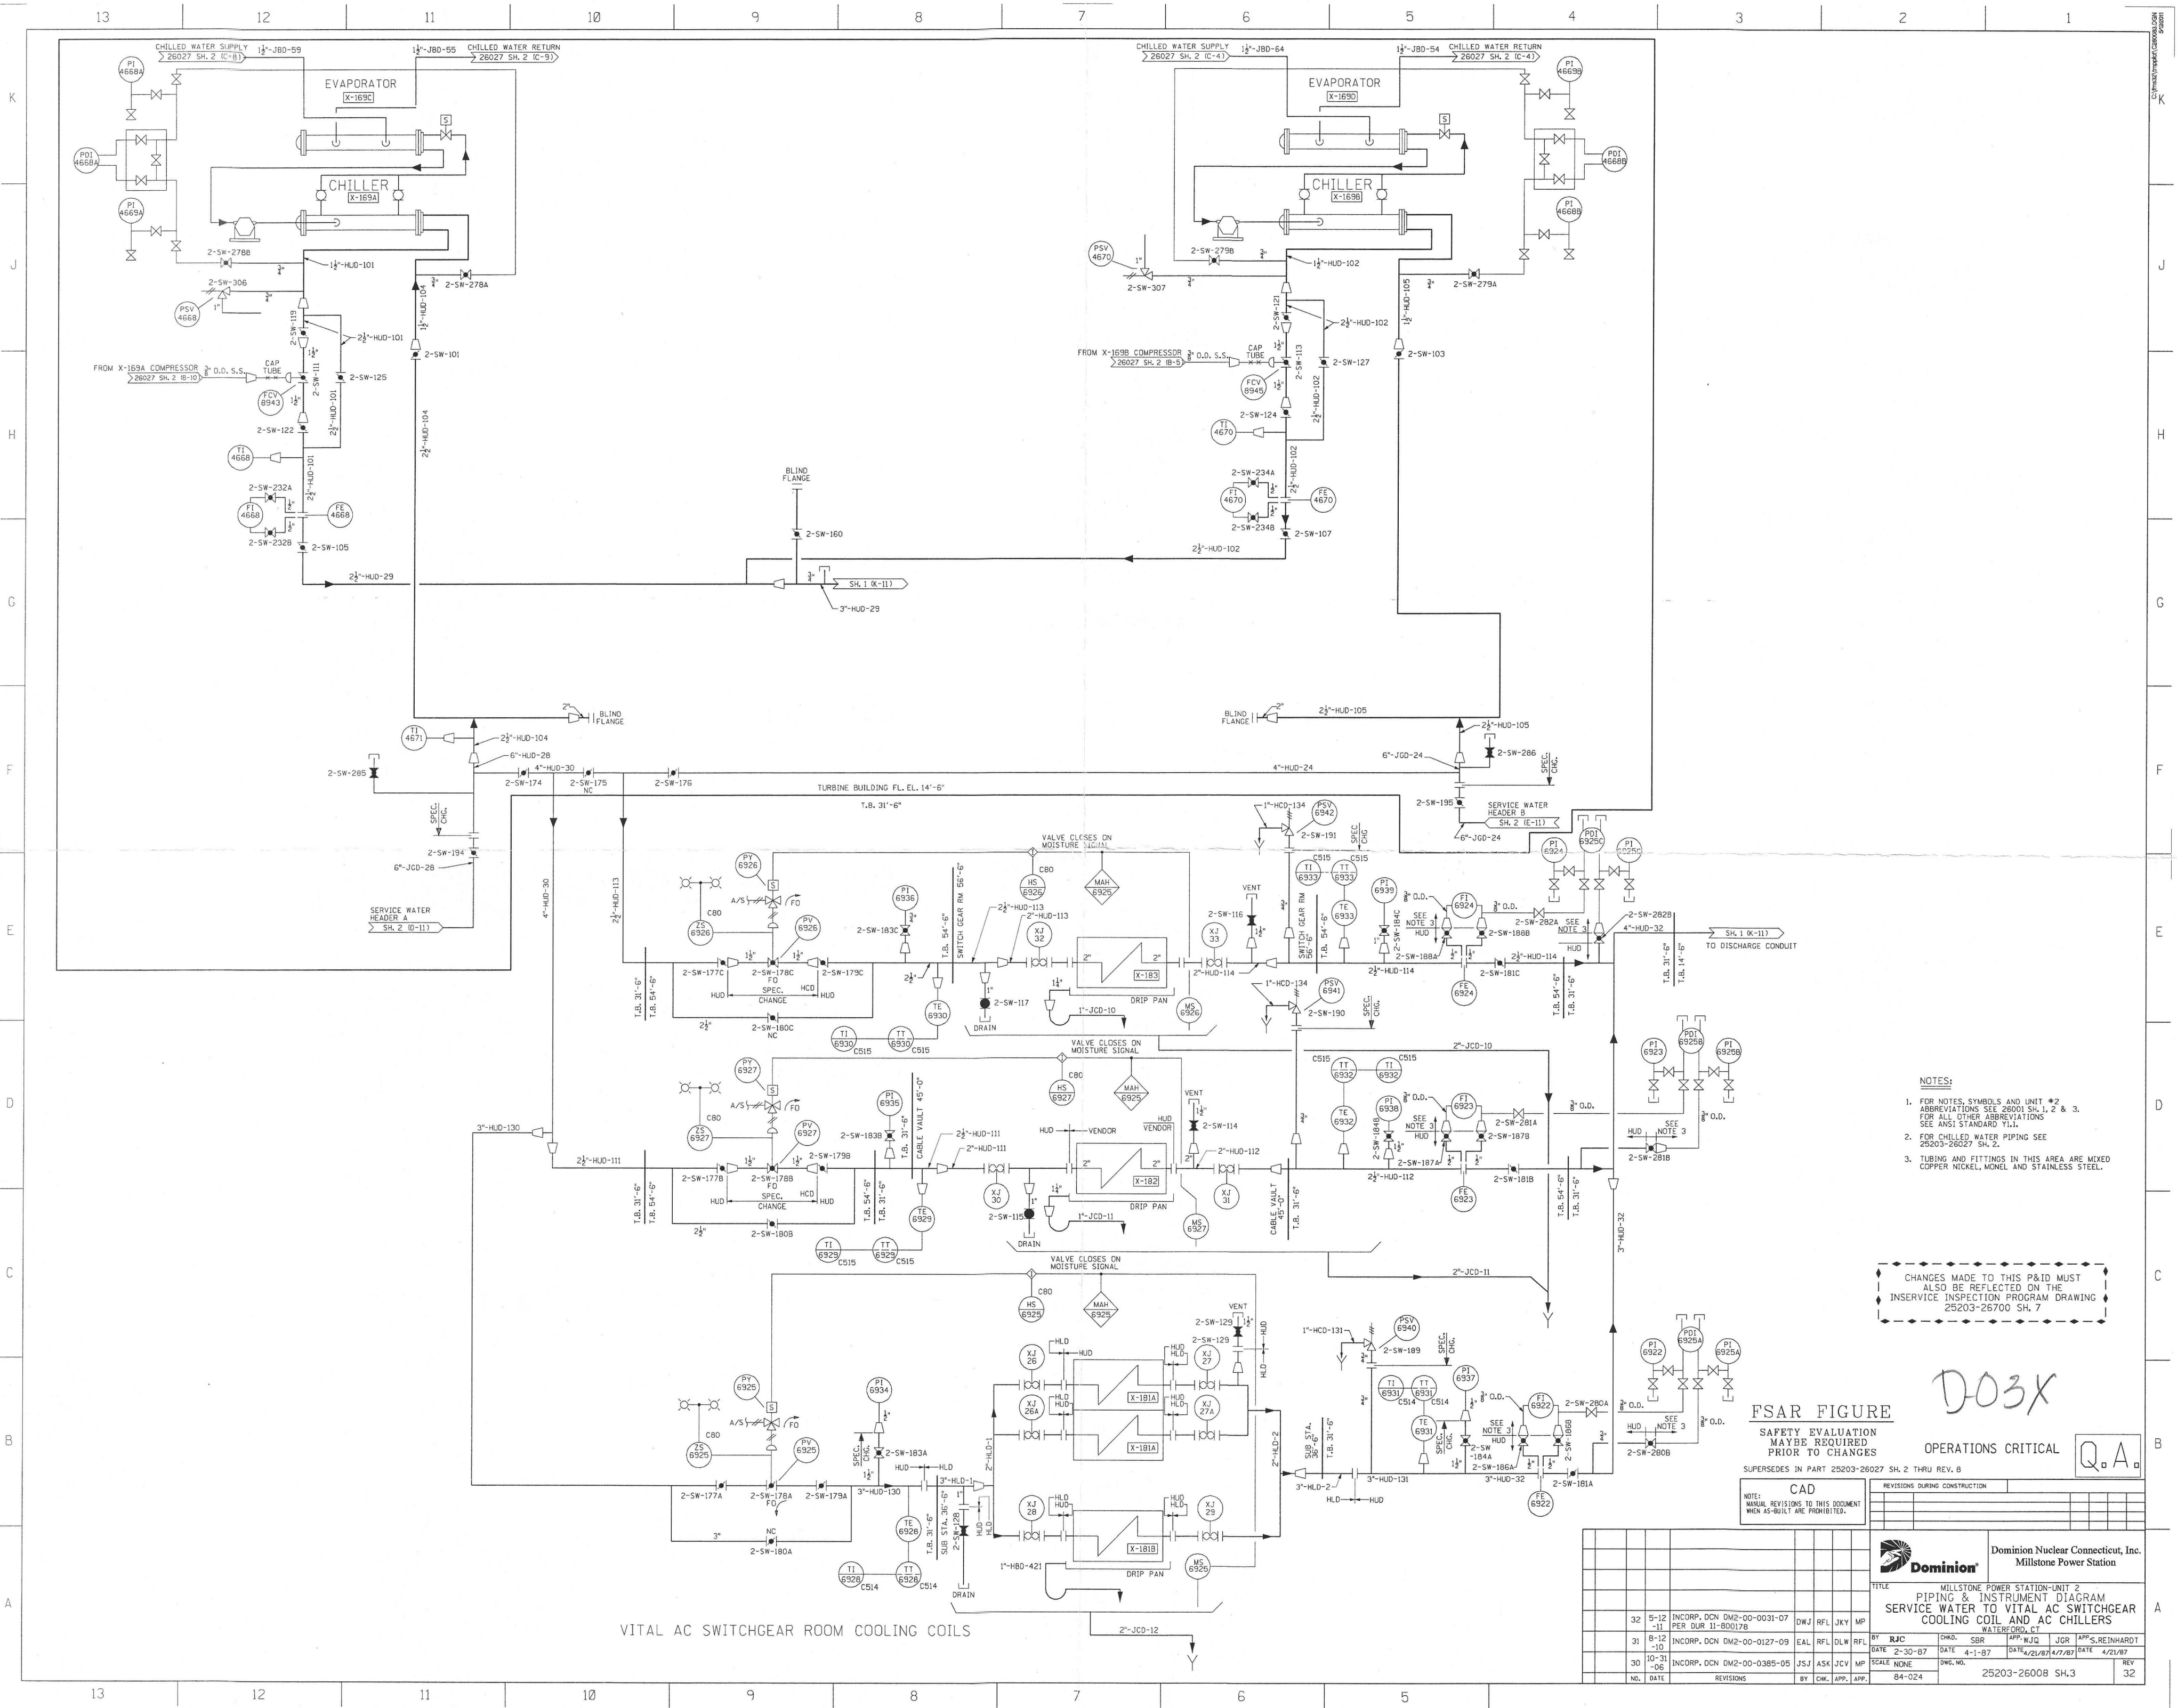

- NOTES:
- 1. FOR NOTES, SYMBOLS AND UNIT #2 ABBREVIATIONS SEE 26001 SH. 1, 2 & 3. FOR ALL OTHER ABBREVIATIONS SEE ANSI STANDARD Y11.1.
 - 2. FOR CHILLED WATER PIPING SEE 25203-26027 SH. 2.
 - 3. TUBING AND FITTINGS IN THIS AREA ARE MIXED COPPER NICKEL, MONEL AND STAINLESS STEEL.

CHANGES MADE TO THIS P&ID MUST ALSO BE REFLECTED ON THE INSERVICE INSPECTION PROGRAM DRAWING 25203-26700 SH. 7

FSAR FIGURE
SAFETY EVALUATION
MAYBE REQUIRED
PRIOR TO CHANGES

OPERATIONS CRITICAL

CAD		REVISIONS DURING CONSTRUCTION	
NOTE: MANUAL REVISIONS TO THIS DOCUMENT MUST BE BUILT AND PROHIBITED.			
Dominion Nuclear Connecticut, Inc. Millstone Power Station		TITLE MILLSTONE POWER STATION-UNIT 2 PIPING & INSTRUMENT DIAGRAM SERVICE WATER TO VITAL AC SWITCHGEAR COOLING COIL AND AC CHILLERS	
DATE 2-30-87		BY RJC	
DATE 4-1-87		DATE 4/21/87	
DATE 10-31-06		DATE 10/31/06	
NO. DATE		REV	
32		32	