

PMComanchePeakPEm Resource

From: Woodlan, Don [Donald.Woodlan@luminant.com]
Sent: Tuesday, July 16, 2013 10:18 PM
To: Monarque, Stephen; ComanchePeakCOL Resource; Galvin, Dennis; Goetz, Sujata; Otto, Ngola; Reyes, Ruth; Roy, Tarun; Takacs, Michael; Ward, William
Cc: Bird, Bobby; Conly, John; Evans, Todd; Reible, Robert; nicholas_kellenberger@mnes-us.com; Michael_Melton@mnes-us.com; sean_ton@mnes-us.com
Subject: 2013-07-14 Woodlan - Talking Points for COLA Call
Attachments: 2013-07-15 Talking Points.pdf

See attached.

Donald R. Woodlan

Manager, Nuclear Regulatory Affairs

Luminant Power

O- 254-897-6887 C- 214-542-7761

Confidentiality Notice: This email message, including any attachments, contains or may contain confidential information intended only for the addressee. If you are not an intended recipient of this message, be advised that any reading, dissemination, forwarding, printing, copying or other use of this message or its attachments is strictly prohibited. If you have received this message in error, please notify the sender immediately by reply message and delete this email message and any attachments from your system.

Hearing Identifier: ComanchePeak_COL_Public
Email Number: 1854

Mail Envelope Properties (3B7030EBF542CC4090D45E1758E23EA603FB528C0A)

Subject: 2013-07-14 Woodlan - Talking Points for COLA Call
Sent Date: 7/16/2013 10:18:06 PM
Received Date: 7/16/2013 10:18:32 PM
From: Woodlan, Don

Created By: Donald.Woodlan@luminant.com

Recipients:

"Bird, Bobby" <Robert.Bird@energyfutureholdings.com>
Tracking Status: None
"Conly, John" <John.Conly@luminant.com>
Tracking Status: None
"Evans, Todd" <Eric.Evans@luminant.com>
Tracking Status: None
"Reible, Robert" <Robert.Reible@luminant.com>
Tracking Status: None
"nicholas_kellenberger@mnes-us.com" <nicholas_kellenberger@mnes-us.com>
Tracking Status: None
"Michael_Melton@mnes-us.com" <Michael_Melton@mnes-us.com>
Tracking Status: None
"sean_ton@mnes-us.com" <sean_ton@mnes-us.com>
Tracking Status: None
"Monarque, Stephen" <Stephen.Monarque@nrc.gov>
Tracking Status: None
"ComanchePeakCOL Resource" <ComanchePeakCOL.Resource@nrc.gov>
Tracking Status: None
"Galvin, Dennis" <Dennis.Galvin@nrc.gov>
Tracking Status: None
"Goetz, Sujata" <Sujata.Goetz@nrc.gov>
Tracking Status: None
"Otto, Ngola" <Ngola.Otto@nrc.gov>
Tracking Status: None
"Reyes, Ruth" <Ruth.Reyes@nrc.gov>
Tracking Status: None
"Roy, Tarun" <Tarun.Roy@nrc.gov>
Tracking Status: None
"Takacs, Michael" <Michael.Takacs@nrc.gov>
Tracking Status: None
"Ward, William" <William.Ward@nrc.gov>
Tracking Status: None


Post Office: MDCEXMB02.tceh.net

Files	Size	Date & Time
MESSAGE	657	7/16/2013 10:18:32 PM
2013-07-15 Talking Points.pdf	360638	

Options
Priority: Standard

Return Notification: No
Reply Requested: No
Sensitivity: Normal
Expiration Date:
Recipients Received:

eRAI Question & SER Open Item Status Trends Since July 2012

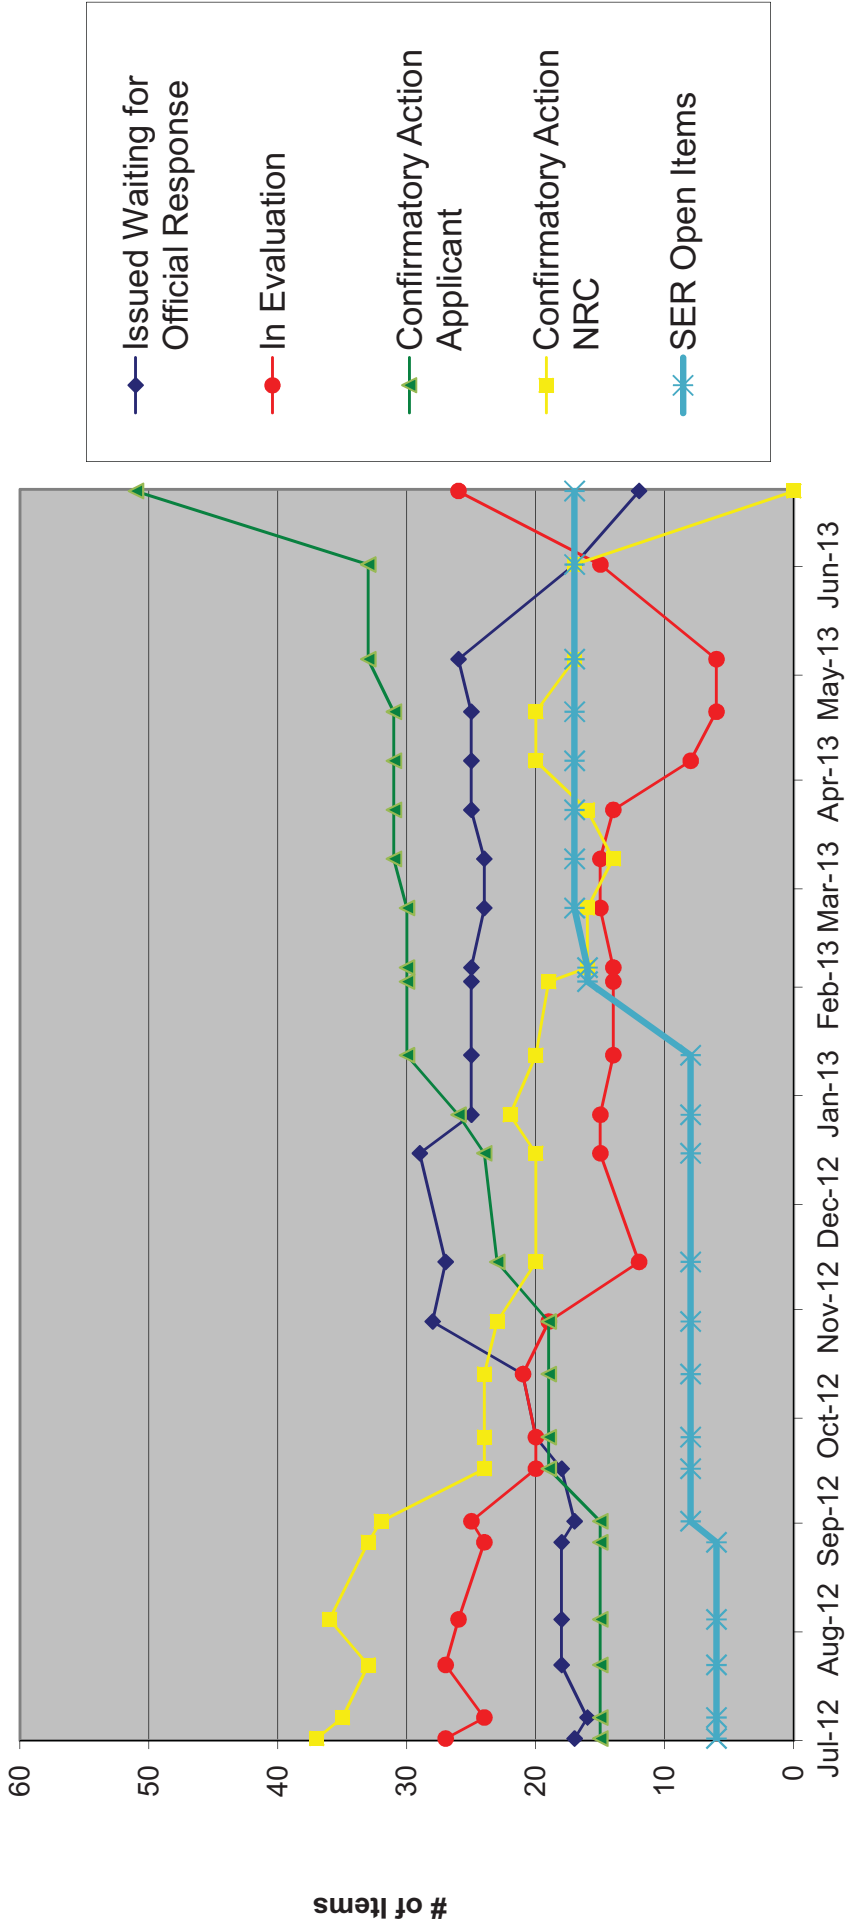

Licensing Conference Calls

Cancel Filter

	Title	Description	PM Status Update	Action Required	Date
<p>00 Misc (5)</p> <p>010 Logistics (2)</p>					
	Proposed Contention re Waste Confidence Rule	Our former interveners have file a petition with a proposed contention based on the court's rejection of the Waste Confidence Rule. Luminant needs to respond in 25 days.	Commission directed staff to resolve waste confidence and temporary waste storage issues within 24 months.	Luminant and NRC staff responded to petition. NRC staff to address based on direction from Commission.	9/28/2014
	WCR Petition	A petition has been filed in 19 proceedings to hold in abeyance decisions in all pending reactor licensing proceedings based upon the recent court decision which vacated the waste confidence rule, 10 CFR 51.23.	In SECY-12-0132, NRC staff proposed that, if not resolved prior, COLAs will address in staff testimony for mandatory hearings. Commission charged staff to resolve within 24 months. 2013-06-24 update - staff expected to release draft resolution products to public soon.	Luminant and NRC staff answered petition within 10 days. NRC staff resolve within 24 months.	9/28/2014
<p>090 Action CPNPP (2)</p>					
	Regulatory Commitments List	Periodically confirm with NRO the list of reg commitments. A report re closed commitments provided Quarterly. Luminant had no update in July 2012.	4/20/2010 (TXNB-10033), 7/28/2010 (TXNB-10054), 1/31/2001 (TXNB-11007), 4/25/11 (TXNB-11028), 7/29/11 (TXNB-11051), 10/25/11 (TXNB-11070), 1/30/12 (TXNB-12004), 4/23/12 (TXNB-12011), 10/30/12 (Conly email), 1/28/13 (Conly email), 4/29/13 (Conly email)	Luminant provide July 2013 update.	7/31/2013
	FSAR R4 - TXNB-13002 Exemption Request	Exemption request to reschedule next FSAR revision to November 2013	2013-02-27 update - NRC is finalizing response and sending it out or internal review. Hope to issue by end of March. 2013-04-12 NRC report that EA sent to Fed Register. Letter to Luminant is ready to go. 2013-05-01 update - waiting for Fed. Reg. number to insert into letter. Exemption approved and will be issued to Luminant soon. 2013-05-20 Approval published in Fed Reg.	Exemption approved and approval letter issued. Luminant issue FSAR R4.	11/30/2013
<p>120 ACRS (1)</p>					

* Chap 5 (1/2 day), May 27 - COMPLETE.

<p>ACRS Subcommittee Meeting Schedule</p>	<p>* DCD Chap 6 and TR 7001 Adv Acc ; RCOLA Ch 6 (9/17-18/13)</p> <p>* DCD Ch 3 (less 3.7 & 3.8); COLA Chap 3 (less 3.7 & 3.8), and Ch 9 (10/15-16/13)</p> <p>* DCD Ch 1 & 14 (except 14.3.2 HF and 14.3.9 Structural) - RCOLA Ch 1 & 14 (except 14.3.2 HF and 14.3.9 Structural) 11/5/13</p> <p>* ACRS Full Committee (12/5/13) tentatively RCOLA p2, p3, 6, 7, and 9</p>	<p>* Chap 8, 10 Aug 17-18 - COMPLETE</p> <p>* Chap 11, 12, & PRA Briefing (NRC), Oct 20 - COMPLETE</p> <p>* Chap 15 (DCD, COLA and 2 Topicals) [July 9-10], 2012 - COMPLETE</p> <p>* Full Committee for Ch 5, 8, 10, 11 and 12 September 6, 2012 - COMPLETE</p> <p>* Chap 13 COLA, September 20, 2012, in the morning - COMPLETE</p> <p>* DCD Chap 15 Non-LOCA Topical, October 18, 2012 - COMPLETE</p> <p>* Chap 4 COLA, DCD, Fuel Topical - October 18 & 19, 2012 - COMPLETE</p> <p>* COLA Chap16, 17 & 19 (except two DCD Chap 17 & 19 (except two sections) - Feb 21-22,2013 - COMPLETE</p> <p>* ACRS Full Committee RCOLA Chs 4, 13, 15, 16, 17 and 19 (except SMA); DCD Chs 4, 15, 17 and 19 (except two sections) and 5 TeRs(4/11/13) - COMPLETE</p> <p>* COLA & DCD - Chap 7; COLA - 2.0 to 2.3 (4/25 & 26/13) - COMPLETE</p> <p>*COLA 14.3.9 and 18 re HFE (TBD)</p> <p>*COLA 3.7, 3.8, 14.3.2, 19.1.5.1.1 reSMA and 19.2.4 (est. July 2014)</p> <p>*COLA 2.4 and 2.5 (TBD)</p>	<p>NRC - continue to provide updated schedules.</p> <p>9/19/2013</p>
<p>E 01 (9)</p>			
<p>026 Overall Chapter Status (1)</p>			
<p>1 - INTRODUCTION AND GENERAL DESCRIPTION OF THE PLANT</p>	<p>IN PHASE 2</p> <p>SER W/ OIs - TBD (ECD Sept 2013)</p> <p>ACRS Subc - 10/16-17/13</p> <p>ACRS Full - TBD</p> <p>ACRS W/O OIs - TBD</p> <p>Phase 4 (ASER W/O OIs) - TBD</p>	<p>NRC has noted that all of COLA Part 1 is review complete with no additional questions except for Negation Action Plan. One open item (1-1) re adoption of certified DCD.</p>	<p>NRC provide schedule for SE. NRC complete SER W/ OIs</p> <p>10/10/2012</p>
<p>030 IW - Issued/Waiting for Response RAIs (1)</p>			
<p>01.05 RAI-261(6527) Post-Fukushima Questions</p>	<p>Three questions re actions to be taken Post-Fukushima.</p> <p>01.05-1 Seismic Hazard Evaluation (Recommendation 2.1)</p> <p>01.05-2 Spent Fuel Instrumentation (Recommendation 7.1)</p> <p>01.05-3 Emergency Planning (Recommendation 9.3)</p> <p>Luminant provided schedules for these three recommendations re TXNB-12027 dated 7/24/12.</p> <p>Supplemental response to 01.05-1 provided by TXNB-13020 on 6/19/13.</p>	<p>Luminant provided a schedule to develop and submit complete responses to address the recommendations. These activities are being tracked by commitments.</p> <p>Question 01.05-1 - Issued, Waiting for response</p> <p>Question 01.05-2 - Issued, Waiting for response</p> <p>Question 01.05-3 - Issued, Waiting for response</p> <p>2031-04-15 eRAI update - Q3 fm IE to IW</p>	<p>NRC review responses and update question status as appropriate.</p> <p>Luminant provide supplemental responses to questions 2 and 3 per commitments.</p> <p>8/9/2012</p>
<p>035 IE - In Evaluation RAIs (1)</p>			

<p>01.05 RAI-269 (6929) Rec 4.2</p>	<p>COL item re NTTF Recommendation 4.2 for mitigating strategies. Luminant responded via TXNB-13001 on 1/17/2013.</p>	<p>Question 01.05-4 - In Evaluation 2013-01-09 - Luminant informed NRC that the response will be modeled after the approach taken for programs in Chapter 13. An FSAR update will include a table which lists post-COL Fukushima actions and a licensing condition to control the completion of those actions. NRC confirmed that a response of this nature is acceptable for review.</p>	<p>NRC to review and update eRAI Table.</p>	<p>1/17/2013</p>
<p>041 OI - SER Open Item (1)</p>				
<p>01-03 RAI-154 (4494) DCD Reference Open Item</p>	<p>Question 01.01-3 Update COLA to reference DCD as approved by rulemaking. Luminant to address final DCD as adopted by rulemaking - 2011. Open Item 1-1 Referenced in several other SEs (e.g., chapet 8)</p>	<p>SER Open Item: Question 01-3. No update in 10/26/2011 eRAI Report. Question status is "Waiting for Official Response" Question 01.03-3 - Issued Waiting for Response</p>	<p>PLAN AGREED UPON - Luminant to reference Part 52 appendix and approved DCD. Luminant respond after US-APWR certification is complete.</p>	<p>6/30/2014</p>
<p>070 Site Visits/Audits (1)</p>				
<p>ISG 22, Impact on operating units</p>	<p>Potential audit on site to assess Luminant's plans to address potential impacts on operating units, including emergency plans.</p>	<p>Time frame is 2013. Will be based on ISG-22. Luminant updated the FSAR re construction impacts on operations via TXNB-11090, FSAR R2 UTR R0, dated 12/20/11.</p>	<p>NRC propose dates for visit.</p>	
<p>090 Action CPNPP (4)</p>				
<p>01 RAI-260(6493) Part 30 and 40</p>	<p>Two questions (01-12 and 13) concerning decommissioning re 10 CFR Parts 30 and 40. Luminant provided responses in TXNB-12027 dated 7/24/12.</p>	<p>Luminant does not need a clarifying conference call. 7/31/12 update - questions changed from Issued to Resolved - Closed.</p>	<p>NRC change status to responded and review responses. Luminant issue supplement to address Cf and Np as byproduct material. (schedule being developed).</p>	<p>7/31/2013</p>
<p>01.05-2 Supplement Response re Procedures and Training for Spent Fuel Pool Inst</p>	<p>In the response to RAI 261-6527, Question 01.05-2, Luminant committed to provide a supplement to the response and include necessary changes to the COLA describing implementation of the procedure and training provisions of Recommendation 7.1 regarding new spent fuel pool instrumentation. Committed date changed to 8/9/13 via TXNB-13008 on 3/18/13.</p>	<p>90 days after MHI submittal of US-APWR DCD revisions. <i>Submittal date being reconsidered based on an integrated update to the FSAR to address DCD Fukushima updates and the specific R-COLA RAIs.</i> 2013-03-05 update - luminant changed submittal date for supplemental response from 5/29/13 to 7/31/13.</p>	<p>Luminant submit supplement.</p>	<p>8/9/2013</p>
<p>Question 01.05-3, Luminant committed to provide the results of an evaluation of the offsite communication equipment</p>	<p>In the response to RAI 261-6527, Question 01.05-3, Luminant committed to provide the results of an evaluation of the offsite communication equipment</p>	<p>90 days after MHI submittal of US-APWR DCD revisions. <i>Submittal date being reconsidered based</i></p>		

<p>01.05-3 Supplemental Response re Offsite Communications</p>	<p>provisions in accordance with NEI 12-01, Revision 0 in a supplement to the response and include necessary changes to the COLA. Changed committed date to 8/9/13 via TXNB-13008 dated 3/18/13.</p>	<p>on an integrated update to the FSAR to address DCD Fukushima updates and the specific R-COLA RAIs. 2013-03-05 update - Luminant changed submittal date for supplemental response from 5/29/13 to 7/31/13. 2013-03-19 Update - submittal date changed to 8/9/13 to be consistent with RAI-261 commitments.</p>	<p>Luminant submit supplement.</p>	<p>8/9/2013</p>
<p>COLA update re Fukushima</p>	<p>Luminant to update the FSAR and other appropriate parts of the COLA to reflect Fukushima recommended actions.</p>		<p>Luminant submit COLA updates.</p>	<p>8/9/2013</p>
<p>02 (16)</p>				
<p>026 Overall Chapter Status (3)</p>				
<p>2.4 - Hydrology</p>	<p>Phase 2 2.4 Hydrology SER W/ OIs - TBD ACRS Subc - TBD ACRS Full - TBD ACRS W/O OIs - TBD</p>	<p>2013-03-26, Red-line strike-out update of IHCP and ISCP provided to NRC. 2013-04-18 NRC requested a clean update to the IHCP. Update 2 to IHCP provided 5/1/13 via TXNB-13014. A time frame for 2.4 and 2.5 should be proposed (after IHCP submittals/reviews). 2013-03-26, Red-line strike-out update of IHCP and ISCP provided to NRC. 2013-04-03 update - NRC reviewed revised closure plan dates. The new date for RAI-233 does not have an impact on the overall review schedule. Update 2 to IHCP provided 5/1/13 via TXNB-13014.</p>	<p>Luminant provide IHCP Products. NRC complete reviews and SER.</p>	<p>5/3/2013</p>
<p>2.5 - Geotechnical</p>	<p>Phase 2 2.5 Geology SER W/ OIs - TBD ACRS Subc - TBD ACRS Full - TBD ACRS W/O OIs - TBD</p>		<p>Luminant provide IHCP products. NRC complete reviews and tech input for SER W/OI.</p>	<p>5/3/2013</p>
<p>2.0 to 2.3 - Geo/Demo/Local Facil/Meteor</p>	<p>Phase 3 2.0-2.3 SER W/ OIs - March 11, 2013 Complete ACRS Subc - April 25 & 26, 2013 Complete ACRS Full - 12/5/2013 ACRS W/O OIs - TBD</p>	<p>One section 2.0-2.3 open item: Open Item 2.3.4 - MCR and TSC X/Q values. (Values provided in FSAR R3 UTR R0 submitted via TXNB-13003 dated 2/28/13) 2013-03-22 update - Luminant confirmed SE contains no material to be withheld from public. Some minor suggested corrections identified.</p>	<p>NRC review FSAR R3 UTR R0 to close open item. NRC address Luminant suggestions re SE.</p>	<p>11/7/2013</p>
<p>041 OI - SER Open Item (1)</p>				
<p>02.3.4 Atmo Dispersion Open Item</p>	<p>Provide MCR and TSC X/Q values. Values provided in FSAR R3 UTR R0 via TXNB-13003 dated 2/28/13)</p>		<p>NRC review UTR to close Open Item and prepare ASER.</p>	<p>2/28/2013</p>
<p>094 Complete Closure Plan Activity (10)</p>				
<p>Questions 02.04.12-10, 13, 14, 15 and</p>				

<p>02.04.12 RAI-147 (4314) Groundwater</p>	<p>RAI-147 Q 2.4.12-8 to 17 Response = meeting +60days. Luminant submitted draft meeting materials (TXNB-10039 6/1). Public meeting held 6-28-2010. See TXNB-10060 of 8/26/10. Supplement provided in TXNB-11057 dated 8/29/2011. Supp 03 provided in TXNB-11082 on 11/28/11. Included fill properties and extent of above ground fill. S04 provided via TXNB-13013 on 4/29/13.</p>	<p>16 - In Evaluation Questions 02.04.12- 8, 9, 11, 12 and 17 - In Evaluation</p> <p>NRC issued white paper 10/12/11. Conf call held 10/26/11. White paper provided which included many of the basic parameters needed to address hydrology, groundwater and leakage paths. Public meeting held 3/27/12. To be revised/supplemented as part of IHCP.</p> <p>4 of 5 CNs in COLA R2. Q02.04.12-8 not in COLA R2 6/28/2012 update - Changed 5 questions from Confirmatory to Issued pending implementation of IHCP. Per Update 1, the planned submittal for RAI-147 related topics is changed from 3/29/13 to 1/31/13.</p> <p>2013-07-15 update - all questions changed to In Evaluation.</p>	<p>NRC review responses as supplemented by S04.</p>	<p>4/29/2013</p>
<p>02.04.12-1 Groundwater Open Item</p>	<p>RAI-147 related. Luminant, prepared and submitted an overarching description. Luminant supplemented RAI-147 (S02), Q 02.04.12-8 re ground water flow in Glen Rose Formation. Response to RAI-22 Q 02.04.05-11 revised to properly reflect groundwater level. See TXNB-11057 dated 8/29/2011. Supp 03 provided by TXNB-11082 on 11/28/11 and included fill properties and extent of above ground fill. S04 provided via TXNB-13013 dated 4/29/13.</p>	<p>NRC issued a white paper 10/12/11. Conf call held 10/26/11.</p> <p>2/14/12 Update. Questions 02.04.12-10, 13, 14, 15, 16 are Resolved/Closed. Questions 02.04.12-11, 12, 17, 8, and 9 are confirmatory.</p> <p>4/17/12 Update - Discussed during 3/27/12 Public Meeting on hydrology. See updates re submittal for RAI-147.</p> <p>Per Update 1, the planned submittal for RAI-147 related topics is changed from 3/29/13 to 1/31/13.</p> <p>2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 3/29/13 to 4/30/13.</p>	<p>NRC review supplement.</p>	<p>4/29/2013</p>
<p>RAI-147 related Groundwater in existing soil structure Need: Address different interpretations re</p>	<p>NRC issued a white paper 10/12/11. Conf call planned for 10/26/11. In lieu of a conference call, a public meeting is planned for 3/20/12.</p> <p>2/14/12 Update: Questions 02.04.12-10, 13, 14, 15, 16 are Resolved/Closed. Questions 02.04.12-11, 12, 17, 8, and 9 are confirmatory.</p>	<p>NRC issued a white paper 10/12/11. Conf call planned for 10/26/11. In lieu of a conference call, a public meeting is planned for 3/20/12.</p> <p>2/14/12 Update: Questions 02.04.12-10, 13, 14, 15, 16 are Resolved/Closed. Questions 02.04.12-11, 12, 17, 8, and 9 are confirmatory.</p>		

<p>02.04.12-3 Groundwater Open Item</p>	<p>groundwater in existing soil based on slow rise of level in some monitoring wells. Luminant, incorporate alternate interpretations re groundwater in overarching description. Luminant supplement RAI-147 (S02), Q 02.04.12-9 re shallow ground water. See TXNB-11057 dated 8/29/2011. S04 provided via TXNB-13013 dated 4/29/13.</p>	<p>4/17/12 Update - Discussed during 3/27/12 Public Meeting on hydrology. 4/26/12 update. Luminant provided an updated white paper to NRC and asked for a conference call. Per Update 1, the planned submittal for RAI-147 related topics is changed from 3/29/13 to 1/31/13. See updates re submittal for RAI-147.</p> <p>2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 3/29/13 to 4/30/13.</p> <p>Question 02.04.02-2 - In Evaluation</p> <p>NRC issued white paper on 11/12/11. Conference call held on 12/1/11. Several items identified for clarification by Luminant. All but one are impacted by the changes in the DCD Layout. Luminant to update 12/31/12 as part of IHCP. 6/28/2012 update - Changed from Confirmatory to Issued pending implementation of IHCP. Per Update 1, the planned submittal for RAI-139 related topics is changed from 12/31/12 to 4/30/13. 2013-06-24 update - question changed from IW to IE</p> <p>2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 4/30/13 to 5/17/13.</p> <p>NRC issued a white paper 10/12/11. Conf call held on 12/1/11. Calculations are impacted by standard plant layout changes and will need to be updated.</p> <p>2/14/12 Update - RAI-139 is now confirmatory in eRAI Table. 4/17/12 Update - Discussed during 3/27/12 Public Meeting on hydrology.</p> <p>Per Update 1, the planned submittal for RAI-139 related topics is changed from 12/31/12 to 4/30/13.</p> <p>2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 4/30/13 to 5/17/13.</p>	<p>NRC review supplement.</p>	<p>4/29/2013</p>
<p>02.04.02 RAI-139 (4309) Flood Calc</p>	<p>Q. 2.4.2-2. Will develop responses by modifying current calculations and conclusion that SBR is not a proposed feature. See TXNB-10052 dated 7/16/10. RAI-139 Supplement issued 10/21/11 via TXNB-11066. Supplemental response to RAI-139 provided via TXNB-13016 on 5/13/13. Revised disc sent 6/19/13 to remove incorrect proprietary label.</p>	<p>Updates planned as part of IHCP on 4/30/2013 5/17/2013.</p> <p>NRC continue review with supplemental response.</p>	<p>5/13/2013</p>	
<p>02.04.02-1 Surface Flooding Open Item</p>	<p>Onsite Flooding from potential Intense Precipitation. Need: Weakness in surface flooding calc need to be addressed. Luminant submitted an updated response via TXNB-11066 on 10/21/11. RAI-139 S01 (Q 02.04.02-2). Supplemental response to RAI 139 provided via TXNB-13016 on 5/13/13.</p>	<p>Luminant to address/update as part of IHCP in a 4/30/2013 5/17/2013 supplement to RAI-139.</p> <p>NRC continue review with supplemental information.</p>	<p>5/13/2013</p>	

<p>02.04.10-1 Surface Flooding Open Item</p>	<p>Surface Flooding Need: Discussion re erosion due to onsite flooding and drainage, the impact of 3 & 4 drainage on 1 & 2 (boundary), and ongoing actions to ensure design drainage remains available (e.g., surveillances, operation observations, housekeeping) RAI-139 S01 (Q 02.04.02-2). RAI-139 supplement issued 10/21/11 via TXNB-11066. RAI 139 supplemental response provided via TXNB-13016 on 5/13/13.</p>	<p>NRC issued a white paper 10/12/11. Conf call held 12/1/11. Calculations are impacted by standard plant layout changes and will need to be updated. 2/14/12 Update - RAI-139 is now confirmatory in eRAI Table. 4/17/12 Update - Discussed during 3/27/12 Public Meeting on hydrology. Per Update 1, the planned submittal for RAI-139 related topics is changed from 12/31/12 to 4/30/13. 2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 4/30/13 to 5/17/13.</p>	<p>Luminant to address/update as part of HGP on 4/30/2013 5/17/2013. NRC consider supplemental response during review.</p>	<p>5/13/2013</p>
<p>02.04.12-4 Leakage Paths Open Item</p>	<p>Potential error in calculation Luminant has provided a clarification which was included in COLA Rev. 2 dated 6/28/11. Response to RAI-145 Supplement 2 provided by TXNB-13018 on 5/28/13.</p>	<p>NRC issued a white paper 10/12/11. Conf call planned for 10/26/11. In lieu of conference call, public meeting planned for 3/20/12. 2/14/12 Update: All RAI-145 questions are now Confirmatory. 4/17/12 Update - Discussed during 3/27/12 Public Meeting on hydrology. Per Update 1, the planned submittal for RAI-145 related topics is unchanged. 2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 3/29/13 to 4/30/13. 2013-04-22 update - per conference call between Luminant and NRC staff, it is preferable that Luminant submit a response with the corrected DCD source term in July or August of 2013. 2013-05-15 update - Luminant has determined that DCD update will not impact RAI 145 response. New submittal date is projected to be late May 2013. Q 02.04.13-5, 6, and 7. Based on eRAI dated 8/31/2011 were statused as confirmatory. Supp response submitted 8/29/11. 9/28/11 eRAI Report, changed from Confirmatory to Responded. NRC issued white paper 10/12/11. Conf call held 10/26/11. Public meeting cancelled. Public</p>	<p>Luminant to address/update as part of HGP including a supplement to RAI-145. Luminant to provide input/output files for RESRAD model. Update FSAR 2.3-13 3/29/2013-4/30/2013 July or August 2013. NRC review response supplement 2.</p>	<p>5/28/2013</p>
	<p>Assumptions, inputs being used, and calc methods were discussed in a public</p>			

<p>02.04.13, RAI-145 (4315) Rad Liq Release</p>	<p>meeting 6-28-2010. Q 2.4.13-5, 6, 7 Response in 90 days after the meeting depending on results. Luminant submitted draft meeting materials (TXNB-10039 6/1). Luminant response submitted via TXNB-10063 on 9/16/10. Supplemental responses submitted via TXNB-11057 on 8/29/11. Response to RAI-145 Supplement 2 provided by TXNB-13018 on 5/28/13.</p>	<p>conference call planned for week of December 12, 2011. 2/7/12 Changed from Responded to Confirmatory. Response to be revised/supplemented as part of IHCP. 6/28/2012 update - Changed from Confirmatory to issued pending implementation of IHCP. Per Update 1, the planned submittal for RAI-145 related topics is unchanged. Questions 02.04.13-5, 6 and 7 - In Evaluation</p> <p>2013-06-24 update. Question 5 and 6 moved to In Evaluation. 2013-07-15 update - question 7 moved to in evaluation.</p> <p>NRC issued a white paper 10/12/11. Conf call held 10/26/11. In lieu of conference call, a public meeting is scheduled for 3/20/12.</p> <p>2/14/12 Update: All RAI-145 questions are now Confirmatory.</p> <p>4/17/12 Update - Discussed during 3/27/12 Public Meeting on hydrology.</p> <p>Per Update 1, the planned submittal for RAI-145 related topics is unchanged.</p> <p>2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 3/29/13 to 4/30/13.</p> <p>2013-04-22 update - per conference call between Luminant and NRC staff, it is preferable that Luminant submit a response with the corrected DCD source term in July or August of 2013.</p> <p>NRC preparing detailed comments to be followed by a conference call (10/26). In lieu of a conference call, a public meeting is scheduled for 3/20/12.</p> <p>2/14/12 Update: eRAI table shows the status for Question 02.04.13-3 as Resolved/Closed. Questions 5, 6, and 7 are shown as Confirmatory.</p> <p>4/17/12 Update - Discussed during 3/27/12 Public Meeting on hydrology.</p> <p>Per Update 1, the planned submittal for</p>	<p>Revised response to be provided 3/29/2013 4/30/2013 July or August in late May 2013 as part of IHCP.</p> <p>NRC review RAI-145 S02</p>	<p>5/28/2013</p>
<p>02.04.12-5 and 02.04.13-2 Vertical Flow Paths Open Item</p>	<p>Potential vertical leakage path Need: Quantitative assessment of a vertical leakage path to groundwater below. Luminant, pursue options to provide quantitative assessment. RAI-145, Q 2.4.13-5, 6, and 7. See TXNB-11057 dated 8/29/2011. Response to RAI-145 Supplement 2 provided by TXNB-13018 on 5/28/13.</p>	<p>2/14/12 Update: All RAI-145 questions are now Confirmatory.</p> <p>4/17/12 Update - Discussed during 3/27/12 Public Meeting on hydrology.</p> <p>Per Update 1, the planned submittal for RAI-145 related topics is unchanged.</p> <p>2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 3/29/13 to 4/30/13.</p> <p>2013-04-22 update - per conference call between Luminant and NRC staff, it is preferable that Luminant submit a response with the corrected DCD source term in July or August of 2013.</p> <p>NRC preparing detailed comments to be followed by a conference call (10/26). In lieu of a conference call, a public meeting is scheduled for 3/20/12.</p> <p>2/14/12 Update: eRAI table shows the status for Question 02.04.13-3 as Resolved/Closed. Questions 5, 6, and 7 are shown as Confirmatory.</p> <p>4/17/12 Update - Discussed during 3/27/12 Public Meeting on hydrology.</p> <p>Per Update 1, the planned submittal for</p>	<p>Luminant to address/update as part of IHCP and as part of the supplement to RAI-145 3/29/2013 4/30/2013 July or August in late May 2013.</p> <p>NRC review RAI-145 S02.</p>	<p>5/31/2013</p>
<p>02.04.13-3 RAI-145</p>	<p>Horizontal Leakage Path for Tank Failure Need: Overarching description of leakage path and basis for assumptions used in the analysis. A description of the physics involved in assessing the leakage path. Areas of interest include groundwater dilution assumptions, SCR dilution assumptions, and effects of any installed drainage systems. Luminant prepared</p>	<p>2/14/12 Update: eRAI table shows the status for Question 02.04.13-3 as Resolved/Closed. Questions 5, 6, and 7 are shown as Confirmatory.</p> <p>4/17/12 Update - Discussed during 3/27/12 Public Meeting on hydrology.</p> <p>Per Update 1, the planned submittal for</p>	<p>Luminant to address/update as part of IHCP and as part of supplement to RAI-145</p>	<p>5/31/2013</p>

<p>Open Item</p>	<p>and provided an overarching description of the horizontal leakage path, to discuss the physics involved and to identify and justify assumptions used. RAI-145 S01, Q2.4.13-5, 6 & 7. See TXNB-11057 dated 8/29/2011. Response to RAI-145 Supplement 4 provided by TXNB-13018 on 5/28/13.</p>	<p>RAI-145 related topics is unchanged. 2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 3/29/13 to 4/30/13. 2013-04-22 update - per conference call between Luminant and NRC staff, it is preferable that Luminant submit a response with the corrected DCD source term in July or August of 2013.</p>	<p>3/29/2013 4/30/2013 July or August in late May 2013. NRC review RAI-145 S02.</p>
<p>095 Close Plan Activity (2)</p>			
<p>02.05.04 RAI-233 (61.15) Groundwater impact on seismic</p>	<p>Question 02.05.04-26. Followup information regarding the impact of changing groundwater level on slopes and sliding. On 11/18, the NRC staff approved a new due date of 12/2/11. Luminant responded in TXNB-11081 on 12/1/11.</p>	<p>2/1/12 Update - NRC asked that Luminant resend the RAI response. 2/7/12 Luminant provided response and eRAI table changed Q 02.05.04-26 to Responded. Project status report says RAI-233 is confirmatory. 4/17/12 Update - Discussed during 3/27/12 Public Meeting on hydrology. 4/27/2012 updated. Included in IHCP and response scheduled for 2/28/2012. 2012-06-20 update - NRC may change question status to "Issued" for this RAI and other RAIs related to the IHCP. 6/28/2012 update - Changed from Responded to Issued pending implementation of IHCP. Per Update 1, the planned submittal for RAI-233 related topics is changed from 2/28/13 to 5/31/13. Question 02.05.04-26 - Issued/Waiting for Response 2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations and the need to complete the SSI evaluations before resolving these issues, the submittal date has been moved from 5/31/13 to 9/30/13.</p>	<p>Luminant to address/update as part of IHCP and scheduled date for supplemental response is 5/31/2013 9/30/2013.</p> <p>9/30/2013</p>
<p>RAI-233 Stability</p>	<p>Supplement response to RAI-233, revise FSAR 2.5.4 and 2.5.5, and update settlement and bearing capacity, stability of sloper and laterla earth pressure analysis.</p>	<p>Per Update 1, the planned submittal for RAI-233 related topics is changed from 2/28/13 to 5/31/13. 2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations and the need to complete the SSI evaluations before resolving these issues, the submittal date has been moved from 5/31/13 to 9/30/13.</p>	<p>Luminant submit revised response to RAI-233 and address other stability and structural issues on 5/31/2013 9/30/2013.</p> <p>9/30/2013</p>
<p>03 (17)</p>			
<p>026 Overall Chapter Status (2)</p>			

<p>3 - DESIGN OF STRUCTURES, SYSTEMS, COMPONENTS, AND EQUIPMENT (less 3.7 and 3.8)</p>	<p>Phase 2 Ch 3 less 3.7 and 3.8 SER W/ OIs - TBD (ECD Sept 2013) ACRS Subc - 10/16-17/13 ACRS Full - 12/5/2013 ACRS W/O OIs - TBD</p>	<p>2012-09-26 update - this chapter is a candidate for a split SER. Luminant recommended that one SE cover 3.1-3.6 and 3.9-3.13 and that an ACRS date be set for this portion (June 2013).</p>	<p>Complete reviews and tech input for SER W/OI.</p>	<p>10/10/2012</p>
<p>3.7 & 3.8 Seismic</p>	<p>Phase 2 3.7 and 3.8 SER W/ OIs - TBD ACRS Subc - TBD ACRS Full - TBD ACRS W/O OIs - TBD</p>	<p>A time frame should be set for 3.7-3.8 ACRS after ISCP submittals and reviews. 2013-03-26, Red-line strike-out update of IHCP and ISCP provided to NRC. 2013-04-18 NRC requested updated version of ISCP. Update 2 to ISCP provide 5/1/13 via TXNB-13014. 2013-06-25 Update - Luminant is reassessing ISCP schedule and products based upon resources and status of DCD products.</p>	<p>Luminant provide ISCP products. NRC complete technical reviews and issue SER.</p>	<p>5/3/2013</p>
<p>030 IW - Issued/Waiting for Response RAIs (1)</p>				
<p>03.09.06 RAI-244 (6222) IST</p>	<p>Questions 03.09.06-21, 22, and 23. Relate to IST and procurement specifications. Will be answered along with RAI-239. Due date extended to 1/31/2012 to be consistent with RAI-239. Clarifying conference call held. Response submitted via TXNB-12006 on 2/27/12 for questions 21 and 23. Response to question 22 submitted via TXNB-12007 dated 3/9/12. TXNB-12021 dated 6/13/12 provided a supplemental response to question 22 (to correct the revision level of NUREG-1482).</p>	<p>Question 03.09.06-21 - Issued waiting for response 9/24/12 update- chg from IE to IW 1/23/13 update - to be changed to an open item to be closed in Phase 4. 2013-04-03 update - Resolution linked to DCD PSC audit which will include sample procurement specs. (see aslo RAI-239 (6159) question 03.11-18 Question 03.09.06-22 - Confirmatory Action Applicant Response provided by TXNB-12007 on 3/9/12 and supplemented by TXNB-12021 on 6/13/12 (to correct a NUREG reference). IST program for pumps, valves and restraints. Question 03.09.06-23 - Resolved-Closed</p>	<p>NRC review responses. Question 21 to be changed to an open item for closure in Phase 4. US-APWR DCWG work with NRC to develop products as part of DCD PSC plan and for DCD PSC audit.</p>	<p>12/31/2012</p>
<p>035 IE - In Evaluation RAIs (2)</p>				
<p>Q 03.11-18 followup to Q 03.11-1. The NRC is preparing a followup question to</p>	<p>The information to resolve this question is linked to the DCD PSC plan. The procurement specs and other material to be audited during the PSC audit will resolve most if not all of this question although RCOLA followup may be needed. (see also RAI-244, question 03.09.06-21)</p>			

<p>03.09.06-13 which is very similar to this question. Q 03.11-19 followup to Q 03.11-20. Describe the transition from the initial EQ program to the EQ program to be implemented during plant operation. Q 03.11-20 followup to Q 03.11-11. License condition for program implementation. 12/15, NRC granted extension to 1/31/2012. Response submitted via TXNB-12006 on 2/27/12.</p>	<p>03.09.06-13 which is very similar to this question. Q 03.11-19 followup to Q 03.11-20. Describe the transition from the initial EQ program to the EQ program to be implemented during plant operation. Q 03.11-20 followup to Q 03.11-11. License condition for program implementation. 12/15, NRC granted extension to 1/31/2012. Response submitted via TXNB-12006 on 2/27/12.</p>	<p>Question 03.11-19 - In Evaluation Resolution of this questioned is tied to DCD questions re MUAP-08015, US-APWR Equipment Qualification Program. Once the DCD issues are resolved, this RCOLA question may be resolved as well or followup may be necessary. Question 03.11-20 - Resolved-Closed DCD submitted EQ Program update 11/1/2012. 2013-01-09 - Staff reviewing DCD now and RCOLA next. ECD two to three weeks (about 1/30/13). 2013-02-27 update - still working DCD. No ECD for RCOLA.</p>	<p>NRC review response. US-APWR DCD effort needed to resolve via PSC and MUAP-08015 reviews.</p>	<p>2/29/2012</p>
<p>03.04.01 RAI-275 (7099) re CST Failure</p>	<p>One question re capability to handle a CST failure and an error in a left-hand-margin entry. Response provided via TXNB-13019 on 6/19/13.</p>	<p>Question 03.04.01-1 - In Evaluation 2013-05-28 Update - added to eRAI as IW 2013-06-24 update - changed from IW to IE.</p>	<p>NRC review response.</p>	<p>6/19/2013</p>
<p>090 Action CPNPP (1)</p>				
<p>Permitted Aircraft Operations</p>	<p>In FSAR R3 UTR R0, the number of permitted aircraft operations in subsection 3.5.1.6 changed from 19,300 to 35,300. This appears to be a math error.</p>	<p>2013-06-04 update - Luminant agrees that this appears to be a math error and continues to evaluate what action should be taken, if any. 2013-06-07 update - there was an error of a factor of 2. The correct value is 17,700. The area used in the formula was for each unit instead of both. Luminant plans to correct in FSAR R3 UTR R3 in August 2013.</p>	<p>Luminant correct in upcoming UTR.</p>	<p>8/16/2013</p>
<p>094 Complete Closure Plan Activity (5)</p>				
<p>3.7-3.8-10 Evaluation of R/B Complex SSI</p>	<p>Evaluation of the NI Complex which shows that the site-specific SSI analysis results of NI Complex are enveloped by DCD SSI analysis results. Evaluation submitted by TXNB-12039 on 11/29/2012.</p>	<p>Site specific seismic may be impacted by standard plant layout changes or seismic design issues. Update 1 to ISCP changed the submittal date from 9/12 to 11/12. 2013-03-20 update - Dennis to check with reviewers to see if there is any feedback.</p>	<p>NRC use evaluation as appropriate in reviewing CPNPP seismic design.</p>	<p>11/29/2012</p>
<p>3.7-3.8-20 FSAR R3 UTR R0</p>	<p>FSAR R3 UTR R0 to include: Updates to the plot plan (1.2 and 2.1, 2.3 and Appendix 3K); Atmospheric dispersion (2.0 and 2.3); Aircraft hazards (3.5); Main control room habitability (6.4); Unit Switchyard layout (8.2); Grounding and lightning protection and HVAC electric load changes (8.3); ESW system re load layout (9.2); HVAC (9.4); radiation protection (12.3); and PRA (19.1).</p>	<p>Update 1 to ISCP changed the submittal date from 10/12 to 2/13. There are some minor adjustments in Chapter 9, 12 and 8 to be clarified in RO transmittal letter.</p>	<p>NRC review material.</p>	<p>2/28/2013</p>

		[Update 1 changes shown in bold above] Submitted via TXNB-13003 dated 2/28/2013.			
3.7-3.8-40 ER R3 UTR R0		UTR will contain the updates based on seismic closure plan including: text, table and figure updates to reflect common foundation and new plant layout (F2.1-1, F2.3-26, F2.3-27, F3.1-1, F3.4-3, F4.1-1, and F6.3-1); table update due to source or receptor location if needed (T5.4-1 and T5.4-3) ER R3 UTR R0 submitted 3/28/13 via TXNB-13009.	Update 1 to ISCP changed the submittal date from 11/12 to 3/13.	NRC consider in reviews.	3/28/2013
3.7-3.8-50 FSAR R3 UTR R1		UTR to include: updates to reflect EPRI guidance for earthquake sources in the CEUS (2.5); Fire protection updates (9.5 and 9.A) Submitted via FSAR R3 UTR R1, TXNB-130015 dated 5/13/13.	Investigate and use latest CAV filter procedure. Update 1 to ISCP changed the submittal date from 2/13 to 4/13. 2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 4/30/13 to 5/17/13.	Submitted for NRC review.	5/13/2013
3.7-3.8-30 Physical Security Plan and High Assurance Evaluation		Via separate letter, updates to the Physical Security Plan and High Assurance Evaluation will be developed to include plant layout changes. TXNB-13021 submitted the PSP R3 and adopted the HAE submitted by MHI via UAP-HF-13164 on 6/26/2013.	Update 1 to ISCP changed the submittal date from 10/12 to 6/13. 2013-05-06 update - No changes appear to be needed to PSP or FSAR. HAE will be submitted by MHI for the standard plant and the DCD (reference 13.6-7) will be updated. The RCOL already adopts the standard plant HAE (via reference 13.6-7). Need to confirm PSP reference to HAE.	Luminant prepare and submit PSP updates- Luminant work with MHI re submittal of HAE update- NRC review HAE (Chapter 13 activity).	6/27/2013
095 Close Plan Activity (6)					
03.07.02 RAI-247 (6266) Seismic Follow-up		Follow-up to RAI-226 questions: 03.07.02-26 is follow-up for 23 (items 2,5,6,7,9,10, and 13) 03.07.02-27 is follow-up for 24 (items 1,3,4,6,7,8 and 9)	Questions 03.07.02-26 and 27 - Issued/Waiting for Response 4/16/12 Update - Luminant has rolled the response to this RAI into the ISCP. 2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 6/28/13 to 8/16/13. 2013-07-15 update - Submittal date moved to 9/30/13, consistent with ISCP UTR.	Luminant prepare and submit responses 6/28/2013 8/16/2013 9/30/2013.	9/30/2013
03.07.02, RAI-221 (5798) SASST and DCD Seismic		Questions 03.07.02-21 (SASST issue) and 22 (impact of DCD seismic reviews on COL). Luminant responded via TXNB 11054 dated 9/4/2011. Luminant submitted a supplemental response via	Questions 03.07.02-21 and 22 - Confirmatory Action NRC Response to be revised/updated as part of ISCP.	Luminant to complete actions in commitments included in Response.	9/30/2013

	<p>TXNB-11064 dated 10/10/2011.</p>	<p>2013-07-15 update - Submittal date moved to 9/30/13, consistent with ISCP UTR.</p> <p>3/17/12 Update - Currently Luminant believes that Appendices 3H, 3I, and 3J do not require update.</p> <p>Update 1 to ISCP changed the submittal date from 4/13 to 6/13.</p> <p>Response to RAI-254 (6403) (TXNB-12038) noted that F 9.2.5-1R will be revised when F 3.8-206 is completed.</p> <p>2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 6/28/13 to 8/16/13.</p> <p>2013-06-04 update - Due to the addition of a Fukushima LL UTR (now R2), UTR R2 is changed to R3 and UTR R3 is changed to UTR R4.</p> <p>2013-07-15 update - this UTR cancelled. All changes (except 3.4) are relocated to UTR R3.</p>	<p>Luminant prepare and submit UTR 6/28/2013 relocate changes to UTR R2 and UTR R3.</p> <p>9/30/2013</p>	
<p>3.7-3.8-60 FSAR R3 UTR - cancelled</p>	<p>Updates to site-specific seismic analyses in 3.7, 3.8 and Appendices 3H, 3I, 3J, 3KK, 3LL, and 3MM).</p> <p>Update 1 of ISCP expanded scope of UTR to include updates to FSAR 1.8 (re DCD updates), 3.4 (re ESWPC), 3.6 (re ESWPC), 9.2 (re ESW interface), and 13.6 (re HAE).</p>	<p>Update 1 to ISCP changed the submittal date from 4/13 to 6/13.</p> <p>2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 6/28/13 to 8/16/13.</p> <p>2013-07-15 update - Submittal date moved to 9/30/13, consistent with ISCP UTR.</p>	<p>Luminant prepare and submit supplement 6/28/2013 8/16/2013 9/30/2013.</p> <p>9/30/2013</p>	
<p>3.7-3.8-63 RAI-221 Supplement</p>	<p>Supplement response to RAI-221 to reflect updated site-specific seismic analysis.</p>	<p>Update 1 to ISCP changed the submittal date from 4/13 to 6/13.</p> <p>2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 6/28/13 to 8/16/13.</p> <p>2013-07-15 update - Submittal date moved to 9/30/13, consistent with ISCP UTR.</p>	<p>Luminant prepare and submit supplement 6/28/2013 8/16/2013 9/30/2013.</p> <p>9/30/2013</p>	
<p>3.7-3.8-66 RAI-226 Supplement</p>	<p>Supplement response to RAI-226 to reflect updated site-specific seismic analysis.</p>	<p>Update 1 to ISCP changed the submittal date from 4/13 to 6/13.</p> <p>2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 6/28/13 to 8/16/13.</p> <p>2013-07-15 update - Submittal date moved to 9/30/13, consistent with ISCP UTR.</p>	<p>Luminant prepare and submit supplement 6/28/2013 8/16/2013 9/30/2013.</p> <p>9/30/2013</p>	
<p>3.7-3.8-80 FSAR R3 UTR R3</p>	<p>UTR to include site-specific analysis of NI complex 3.7, 3.8 and Appendix 3NN).</p> <p>Originally designated UTR R3; changed to UTR R4 when UTR R2 was added to address Fukushima updates; and changed back to UTR R3 when old UTR R3 (3.7 and 3.8 updates) was rolled into this UTR.</p>	<p>Update 1 - submittal will also address FSAR 19.1, PRA. Submittal date changed from 6/13 to 8/13.</p> <p>2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 8/30/13 to 9/30/13.</p> <p>2013-06-04 update - Due to the addition of a Fukushima LL UTR (now R2), UTR R2 is changed to R3 and UTR R3 is changed to UTR R4.</p> <p>2013-07-15 update - changes previously designated for the 3.7-3.8 UTR (except</p>	<p>Luminant prepare and submit UTR August 2013 9/30/2013.</p> <p>9/30/2013</p>	

			3.4) moved to this UTR. Schedule is tight and a two to three week delay is possible.		
04 (1)					
026 Overall Chapter Status (1)					
	Phase 6	SER W/ OIs - Complete 9/11/2012 ACRS Subc - Complete October 2012 ACRS Full - Complete 4/11/13 ACRS W/O OIs - TBD Phase 4 - July 2013	0 Ch 4 Open Items ASER Constraints: DCD Topical Reviews DCD ASER There will be no phase 5 (ACRS review of ASER) for this chapter.	Prepare ASER.	11/21/2012
05 (2)					
026 Overall Chapter Status (1)					
	Phase 4	SER W/ OIs - Completed 4/29/11 ACRS Subc - Completed 5/27/11 ACRS Full - Completed 9/6/12 ASER W/O OIs - TBD (ECD April 2013) Phase 4 - March 2013	1 Ch 5 Open Item Open Item 05.02.03.01-1 (215-5363) ASER constraints: Confirmatory Items - None FSAR Revision - NA DCD ASER - ECD March 2013	NRC issue ASER. Provide ECD.	10/10/2012
042 OI - Resolved SER Open Item (1)					
		Commit to EPRI Guidance in effect at time of application for primary chemistry control (see RAI 215-5683). Luminant responded via TXNB-11030 on 5/2/11. Open Item 05.02.03.01-1	Open Item 05.02.03.01-1	NRC review response. NRC spreadsheet of 5/18 changed to confirmatory. NRC close in SE without OIs.	5/9/2011
06 (1)					
026 Overall Chapter Status (1)					
	Phase 2	SER W/ OIs - August 17, 2013 ACRS Subc - 9/17-18/13 ACRS Full - 12/5/2013 ASER W/O OIs - TBD		Complete reviews and tech input or SER W/OI. Confirm date for SE.	10/10/2012
07 (1)					
026 Overall Chapter Status (1)					
	Phase 3	SER W/ OIs - 3/27/13 COMPLETE ACRS Subc - April 25-26, 2013 COMPLETE ACRS Full - 12/5/2013 ASER W/O OIs - TBD	0 Chapter 7 Open Items	Brief ACRS Full Committee.	11/7/2013
08 (5)					
026 Overall Chapter Status (1)					
	Phase 4	SER W/ OIs - Complete July 2011	2 Ch 8 Open Items:		

8 - ELECTRIC POWER	ACRS Subc - Complete August 17, 2011 ACRS Full - Complete 9/6/12 ASER W/O OIs - TBD	08.01-1 (2576 question 08.01-2) 08.02-1 (5116 question 08.02-30)	Resolve open items.	1/28/2013
035 IE - In Evaluation RAIs (1)				
8.2-31 RAI-263 (6884) NRCB re Loss of one phase offsite power	One question (8.2-31) with three parts. Concerns the Byron event where a problem on one phase of offsite power resulted in unit trip. Response submitted via TXNB-12040 on 11/29/2012.	Question 8.2-31 - In Evaluation 2012-11-01 - Clarifying conference call held. 2012-11-07 update - Luminant and Mitsubishi working on the response to address various challenges as identified by operating plants. 2012-11-12 Luminant requested an extension to 12/3/12. 2012-11-21 extension granted. 2013-01-09 - NRC staff may request a conference call to discuss the Luminant response.	NRC review response. NRC staff, Luminant and MHI/MNES to continue to investigate and progress by the nuclear industry. Industry public meeting expected in February 2013.	11/29/2012
041 OI - SER Open Item (1)				
08.01 RAI-249 (6316) Shared Offsite Elec	NRC is asking questions re GDC-5. One question, 08.01-3, with four parts. Response provided via TXNB-12013 dated 5/16/2012. Open Item 08.01-1 (previously associated with question 08.01-2 from RAI 009-2576) Luminant provided revised position in TXNB-13007 dated 3/4/2013 as a supplemental response to RAI-009(2576).	3/29/12 Update - Clarifying conference call held. Luminant asked for more time to respond re GDC 5 concerns. NRC to reassess their position. Extension granted to 5/17/12. 4/26/12 - Clarifying call held with branch chief. NRC to provide position on GDC 5. 2012-08-27 Conference call with branch chief. NRC staff maintains that GDC 5 applies. Luminant disagrees. 9/13/12 update - discussed at DCWG meeting. NRC projected a position paper in October 2012. (Confirmed 9/26/12) 2012-11-07 update - NRC is discussing a final draft and it may be available soon. 2013-02-06 update - conference call held in which Luminant agreed to provide a supplemental response to reflect current position Question 08.01-3 - Unresolved-Closed (changed from IE on 12/10/12) - no follow-up identified	NRC identify follow-up activity if any.	3/4/2013
042 OI - Resolved SER Open Item (1)				
08.02 RAI-182 (5116) Offsite Power	Question 08.02-30 is Open Item 08-02-1. Question 08.02-29 regarding inaccessible cable monitoring program and 08.02-30 regarding anti-motoring protective relay for main generator output breaker. Clarifying conference call held on 11/12, new due date 12/10. On 12/2, an extension was granted for one week to 12/17. Response submitted in TXNB-	Question 08.02-29 and 30 - Resolved-Closed Confirmatory: 29 and 30. Q29 in COLA R2. Q08.02-30 not in COLA R2. 4/24 Changed from CN-A to CN-N 4/27/12 Question 29 changed from Confirmatory NRC to Resolved/Closed. 2012-09-28 update - Steve stated that question 30 is being re-statused as	PLAN AGREED UPON. NRC updated status of review. NRC close Open Item in SER without OIs.	12/17/2010

	10087 dated 12/16/10. S01 issued 9/16/11 via TXNB-11060.	Resolved-Close. 2012-10-09 status of 30 changed to RC.	
100 Action NRO (1)			
08.01 RAI-009(2576) GDC 5 Sharing SCCs	<p>Questions 08.01-1 and 2. RAI No. 2576 (CP RAI #9) responded in TXNB-09030 (8/11/2009) "we don't share." NRC is looking for a statement that sharing won't impair the ability to perform.</p> <p>Listed as OI 8.1-2 (the question number) on 7/5/2011 project status list. Luminant provided a supplemental response via TXNB-11055 dated 8/9/2011. Supplemental response S02 issued via TXNB-11065 on 11/17/11. Luminant's revised position provided in TXNB-13007 of 3/4/2013.</p>	<p>Resulted in Open Item 08.01-2. eRAI Table 2/7/12 removed Open Item. (Question 08.01-2 is closed/unresolved.) Question 08.01-1 is resolved/closed.</p> <p>CU-Q FU-Q 08.01-2 RAI-249 Question 08.01-3 2013-04-03 update - NRC is preparing a position paper. 2013-04-17 update - NRC is now considering a letter in lieu of a position paper. Luminant requested that the letter not force application of GDC 2 and 4 to OPS. 2013-05-01 - NRC projects issuing a letter before 5/23 DCWG meeting. 2013-05-29 update - NRC estimates that position paper will be available in about two weeks. 2013-06-27 update - Steve Monarque issued a staff position.</p>	<p>NRC assess Luminant's revised position re GDC 5 and OPS. Prepare position paper letter if appropriate.</p> <p>Luminant assess Monarque's 6/27/13 position and determine how to respond and update FSAR.</p> <p>7/31/2013</p>
09 (2)			
026 Overall Chapter Status (1)			
9 - AUXILIARY SYSTEMS	<p>Phase 2</p> <p>SER W/ OIs - July 26, 2013 ACRS Subc - 10/16-17/13 ACRS Full - 12/5/2013 ASER W/O OIs - TBD</p>	<p>Seismic closure plan may impact the chapter review. Luminant suggested that the NRC consider issuing the SE based on the current reviews and make the ISCP updates an open item. NRC to consider suggestion. This approach may work of other chapters as well.</p> <p>2013-04-03 update - Steve Monarque is now PM for this chapter. 2013-04-17 update - NRC is adding part 70 fire protection to this SE.</p>	<p>Complete reviews and tech input for SER W/OI. Working on DCD SE. COL SE to follow shortly thereafter.</p> <p>10/10/2012</p> <p>NRC confirm dates for SE.</p>
090 Action CPNPP (1)			
Correct typo in 9.5.9	9.5.9 incorrectly lists 9.2.1.2.1 as one of the sections that addresses COL 9.5(2). This is incorrect.		Correct FSAR in COLA R4. 11/30/2013
10 (2)			
026 Overall Chapter Status (1)			
10 - STEAM AND POWER CONVERSION SYSTEM	<p>Phase 4</p> <p>SER W/ OIs - Complete July 2011 ACRS Subc - Complete 8/17/11 ACRS Full - Complete 9/6/12 ASER W/O OIs - TBD (ECD Jan 2014)</p>	<p>0 Ch 10 Open Items:</p>	<p>NRC resolve open items and issue ASER. Provide ECD for ASER.</p> <p>10/10/2012</p>

090 Action CPNPP (1)			
10.04.08 RAI-237 (6166) SGBD	Q 10.04.08-3 asks for additional details. TXNB-11084 dated 12/8/11 provides the Luminant response.	Question 10.04.08-3 - Confirmatory Action Applicant 2/28/12 Update - Linked to a DCD issue. Staff needs resolution on DCD issue first. NRC has requested a conference for clarification of response. A good date has not yet been confirmed. 2012-08-20 update - Clarifying call held. NRC reviewers questions were addressed with no follow-up action required. 2012-08-27 update - NRC identified a change in a figure not incorporated into FSAR R3. 2012-09-18 Update - status changed from IE to CA-A	11/30/2013 NRC review response. Luminant to include corrected figure in FSAR R4.
11 (3)			
026 Overall Chapter Status (1)			
11 - RADIOACTIVE WASTE MANAGEMENT SYSTEM	Phase 4 SER W/ OIs - Complete August 2011 ACRS Subc - Complete October 2011 ACRS Full - Complete 9/6/12 ASER W/O OIs - TBD Phase 4 - april 2013	2 Ch 11 Open Items: 11.02-1 (see RAI 224-5854, question 11.02-18 re Evap Pond sampling) 11.04-1 (see RAI-039-3401, question 11.04-4 re Interim Rad Waste Storage Bldg.)	10/10/2012 Resolve OIs and Issue SER Without OI. Provide ECD for ASER.
042 OI - Resolved SER Open Item (2)			
11.04 RAI-039 (3401) LWMS	RAI 39, 1.1.4-3 and 4, LWMS, 2 ques. Answers submitted via TXNB-09055 dated 10/19/09. Open Item 11.04-1 (question 11.04-4) - Resolved-Closed	CU-Q FU-Q 11.04-3 RAI-200 11.03-3 2/1/12 Update - status to be changed to Confirmatory in upcoming eRAI report. 2/7/12 eRAI Table changed q 11.04-4 from Responded - SER Open Item to Confirmatory with no SER Open Item designation. 3/13/12, Q3 changed to Resolved/Closed. 2012-07-24 Question 4 Changed to RC.	10/19/2009 NRC close open item in SER without open items.
11.02-18 RAI-224 (5854) Evap Pond Sampling	Q 11.02-18. Concerns how we will sample the Evap Pond. Response submitted via TXNB-11061 dated 9/29/11. Conference call held 10/5/11. Luminant to supplement response base upon the call. TXNB-11076 (11/7/11) provided supplemental information (S01) regarding sampling guidance considered. Open Item 11.02-1	2/7/12 eRAI Table changed from Responded - SER Open Item to Confirmatory with no SER Open Item designation. 2012-07-24 Changed to Resolved-Closed	11/7/2011 NRC close out in SER without open items.
12 (2)			
026 Overall Chapter Status (1)			
	Phase 4	1 Ch 12 Open Item: 12.02-1 (see RAI-198)	

12 - RADIATION PROTECTION	SER W/ OIs - Complete August 2011 ACRS Subc - Complete October 2011 ACRS Full - Complete 9/6/12 ASER W/O OIs - TBD (ECD Jan 2014)	FSAR R3 UTR R0 may include updates due to ISCP. FSAR R4 scheduled for November 2013.	Resolve OIs and Issue SER without OIs. Provide schedule for ASER.	10/10/2012
042 OI - Resolved SER Open Item (1)				
12 Open Item	Open Item 12.02-1 - license condition(s) re Parts 30, 40 and 70. NRC projects an OI based on RAI-198, 30, 40 and 70 compliance. May need an updated of T13.4-201 to indicate when Rad Prot Manager will be in place. Clarification re rad protection supervisor provided via TXNB-11080 dtd 11/14/11.	Included in SER but not in eRAI report as of 10/5/11. No update in 10/18/11 eRAI Report. Clarification received from reviewer on 10/20/11. 2012-01-04 update - being changed to confirmatory. 2012-09-18 Update - All RAI-198 questions statused as Resolved-Closed.	NRC close open item in SER without open items.	11/14/2011
13 (6)				
026 Overall Chapter Status (1)				
13 - CONDUCT OF OPERATIONS	Phase 4 SER W/ OIs - Complete August 2012 ACRS Subc - Complete September 2012 ACRS Full - Complete April 11, 2013 ASER W/O OIs - TBD	2 Ch 13 Open Items: Non-security portions - None Open Item 13.6-1 - Security review - (HAE report update) Open Item 13.7-1 - FFD program review 2012-03-15 Luminant provided comments on the SE with OIs. Multiple items had been tracked as OIs during the review but were either found acceptable or confirmatory in SE and are no longer considered OIs.	Address Luminant comments on SE with Open Items. Provide schedule for ASER.	10/10/2012
035 IE - In Evaluation RAIs (1)				
13.06.01 RAI-270 (6963)	2013-03-28 RAI received by Luminant. Clarifying conference call held 4/30/13. It may take two letters to respond - one would be safeguards. Response submitted via TXNB-13017 dated 5/28/13.	Question 13.06.01-59 - In Evaluation Question 13.06.01-60 - In Evaluation Question 13.06.01-61 - In Evaluation Question 13.06.01-62 - In Evaluation Question 13.06.01-63 - In Evaluation 2013-04-03 update - agreed upon a 5/31/13 response submittal date. 2013-06-24 updated - All questions changed from IW to IE.	Luminant-submit-responses- NRC review responses.	5/28/2013
041 OI - SER Open Item (1)				
	Open Item: See Chapter 13 SE with OIs. Questions 13.06.01-57 and 58. Followup questions concerning target sets and defense. Clarifying conference call held 11/2/11. Luminant to perform a table top.	Open Item 13.6-1 - Security 2/15/12 Update - Discussed need to updated HAE one more time to address all layout changes and new scenarios based		

<p>13.06.01 RAI-234 (6068) Security Followup</p>	<p>TXNB-11085 dated 12/8/11 provides the Luminant response. Final resolution of the issues is tied to the HAE report which will be issued by Mitsubishi on the DCD docket after the standard plant layout is finalized. TXNB-12005 of 2/20/12 provided a submittal date of 10/31/12. HAE and PSP R3 provided by TXNB-13021 on 6/27/2013 which also references MHI HAE submittal via UAP-HF-13164 on 6/26/2013.</p>	<p>on this RAI response. Proposed date has been changed by Standard Plant layout changes. New date June 2013. Question 13.06.01-57 - Issued waiting for response Question 13.06.01-58 - Issued waiting for response The PSP will also be updated to reflect plant layout changes resulting from seismic design reviews.</p>	<p>NRC Review response. Luminant provide HAE revision.</p>	<p>6/27/2013</p>
<p>042 OI - Resolved SER Open Item (1)</p>				
<p>13.07 RAI-199 (5400) FFD</p>	<p>Q 13.07-4 and 5. No clarifying call needed. See TXNB-11011 dated 2/28/2011.</p>	<p>Open Item 13.7-1 - FFD Questions are statused as Resolved-Closed. 2013-06-27 update - FFD will have a stand alone SE and will go to ACRS during phase 5.</p>	<p>NRC complete review of FFD.</p>	<p>3/1/2011</p>
<p>045 Recent Letters (1)</p>				
<p>TXNB-13021 HAE and PSP R3</p>	<p>Revision 3 to Physical Security Plan and identifies the MHI letter that submits the HAE. Includes update to address layout changes and minor editorial items.</p>		<p>Available for NRC use.</p>	<p>6/27/2013</p>
<p>100 Action NRO (1)</p>				
<p>EP R3 UTR R0 - Revised Regulations Update</p>	<p>Provide an update to the EP for CPNPP Units 3 and 4 based on the recent revision to the regulations. EP R3 UTR R0 and ITAAC R3 UTR R2 submitted via TXNB-13010 and TXNB-13011 respectively on 3/28/2013.</p>	<p>Luminant intends to implement the changes on Units 1 and 2 first and then the same or similar changes will be made to the EP for Units 3 and 4. Current estimate for the UTR is early 2013.</p>	<p>NRC staff review EP and ITAAC UTRs. NRC staff projects performing review from April to September 2013.</p>	<p>3/28/2013</p>
<p>14 (2)</p>				
<p>026 Overall Chapter Status (2)</p>				
<p>14 - VERIFICATION PROGRAMS (except HF and Structural)</p>	<p>Phase 2 SER W/ OIs - October 2013 ACRS Subc - November 5, 2013 ACRS Full - TBD ACRS W/O OIs - TBD</p>	<p>2012-09-26 update - this chapter is a candidate to have a split SER W/ OIs.</p>	<p>Complete reviews and tech input for SER W/OI. Provide schedule for SE.</p>	<p>10/10/2012</p>
<p>14 - ITAAC for HF and Structural</p>	<p>Subsections 14.3.9 re HF and 14.3.2 re structural Phase 2 SER W/ OIs - TBD ACRS Subc - TBD ACRS Full - TBD ACRS W/O OIs - TBD</p>		<p>NRC schedule SE and ACRS meetings.</p>	<p>7/15/2014</p>
<p>15 (1)</p>				

026 Overall Chapter Status (1)			
	Phase 4	SER W/ OIs - Complete June 2012 ACRS Subc - Complete July 2012 ACRS Full - Complete April 11, 2013 ASER W/O OIs - TBD Phase 4 - March 2013	
15 - TRANSIENT AND ACCIDENT ANALYSES			Provide schedule for ASER.
			10/10/2012
16 (2)			
026 Overall Chapter Status (1)			
	Phase 4	SER W/ OIs - Completed January 2013 ACRS Subc - Completed February 21 & 22, 2013 ACRS Full - Complete April 11, 2013 ACRS W/O OIs - TBD	
16 - TECHNICAL SPECIFICATIONS			Issue ASER.
		2012-09-26 update - this chapter is a candidate to be issued with the pending DCD items as Open Items. 2013-01-09 - SE projects for about 1/25/13.	4/11/2013
042 OI - Resolved SER Open Item (1)			
		RAI-090, 16-1 to 10 - TS, Part 4 PTS and Bases With 7 day extension of 11/2, new date for RAIs 90, 91, and 93 is 11/11/09. (Answers for 90, 91 and 93 submitted via TXNB-09064 on 11/11/09)	
16 RAI-090 (3113) PTS and Bases		2013-03-04 - Luminant provided (in FSAR) location of deterministic values for SFCP and revision level for RITS methodology for TS (see TXNB-13006 of 3/4/2013).	
		Resolved/Closed: 1, 2, 3, 4, 5, 6, 7, 8, 9 Closed/Unresolved: none Question 16-10 - Confirmatory Action Applicant 6Y-9 16-07 RAI-149-16-10 16-10 RAI-149-16-10	NRC review COLA R4 and close.
		2/4/13 question 16-7 changed to Resolved-Closed. 2013-04-01 update - Q 16-10 changed from CU to CAA	3/4/2013
17 (1)			
026 Overall Chapter Status (1)			
	Phase 4	SER W/ OIs - Complete January 2013 ACRS Subc - Complete February 21 & 22, 2013 ACRS Full - Complete April 11, 2013 ACRS W/O OIs - TBD	
17 - QUALITY ASSURANCE AND RELIABILITY ASSURANCE			Issue ASER.
		2012-09-26 update - SER W/ OIs written but not issued pending issuance of DCD SE. 2013-01-04 Luminant provided comments on draft SE with OIs. 2013-04-03 update - Tarun Roy is arranging a conference call to address SE comments from Luminant. Conference call held and comments to be resolved in ASER w/o Open Items.	10/10/2012
18 (1)			
026 Overall Chapter Status (1)			
	Phase 2	2012-09-26 update - RCOLA SER W/ OIs written but not issued pending issuance of DCD SE.	
			Complete tech input for SER W/OI. Steve has written

<p>18 - HUMAN FACTORS ENGINEERING</p>	<p>SER W/ OIs - TBD ACRS Subc - TBD ACRS Full - TBD ACRS W/O OIs - TBD</p>	<p>DCD closure plan may have impact on RCOLA. COL Actions may get written which require updates to multiple RCOLA chapters (e.g., 13, 18). 2013-06-27 update - Luminant expects minor FSAR changes in the fall of 2013.</p>	<p>the draft SER for this IBR'ed chapter. Confirm schedule for SE and ACRS SC briefing.</p>	<p>10/10/2012</p>
<p>19 (9)</p>				
<p>026 Overall Chapter Status (2)</p>				
<p>19 - PROBABILISTIC RISK ASSESSMENT AND SEVERE ACCIDENT EVALUATION (except SMA)</p>	<p>Phase 4 SER W/ OIs - Complete January 2013 ACRS Subc - Complete February 21 & 22, 2013 ACRS Full - Complete April 11, 2013 ACRS W/O OIs - TBD</p>	<p>7 Ch 19 Open Items: 19-1 - Question 19-24 - IE 19-2 - Question 19-25 - CAN 19-3 - Question 19-26 - CAN 19-4 - Question External Hazards Risk Eval based on Chap 2 and 3 updates - Luminant Submittal needed 19-5 - Question 19-21 - UC w/o FU 19-6 - Question 19-22 - UC w/o FU 19-7 - Question 19-23 (->19-27) - UC/IW</p>	<p>Issue ASER.</p>	<p>10/10/2012</p>
<p>19 - SIESMIC MARGIN ANALYSIS (19.1.5.1.1)</p>	<p>Phase 2 SER W/ OIs - TBD ACRS Subc - TBD ACRS Full - TBD ACRS W/O OIs - TBD</p>		<p>Schedule Phase 3 ACRS subcommittee and full committee meetings (ECD July 2014).</p>	<p>7/15/2014</p>
<p>030 IW - Issued/Waiting for Response RAIs (1)</p>				
<p>19. RAI-276 (7116) Averted Cost and SAMA</p>	<p>Two questions. 19-27 re Averted Cost and 19-28 re SAMA. Question 19-27 is a follow-up to 19-23 (OI 19-7)</p>	<p>Question 19-27 - Issued/Waiting for Response. Question 19-28 - Issued/Waiting for Resoonse. 2013-07-15 update - added to eRAI.</p>	<p>Luminant determine if clarifying call is needed and if more time is needed.</p>	<p>8/1/2013</p>
<p>035 IE - In Evaluation RAIs (1)</p>				
<p>19.02 RAI-274(7059) H2 Burns</p>	<p>Re Severe Accident Survivability Studies: Explain why information is not available prior to COL, provide conditions (pressure, temperature and time) for each component, identify ITAAC, Propose license condition. Response submitted via TXNB-13023 on 6/27/2013.</p>	<p>The multiple parts in this question are not understood by the licensee and the regulatory basis for the options is not clear. A clarifying conference call will probably be needed. The question seems to result from ongoing DCD reviews, questions and responses. It may not be appropriate to respond until this issue is fully vetted in the DCD review. 2013-05-01 update - based on complexity of question, Golden Week and potential need for clarifications, Luminant proposed a due date of 6/30/13. NRC concurred. 2013-05-13 update - currently Luminant believes a clarifying call will not be needed. Question 19.02-1 - In Evaluation 2013-07-15 - changed from IW to IE</p>	<p>Luminant submit response. NRC review response.</p>	<p>6/27/2013</p>
<p>041 OI - SER Open Item (4)</p>				
<p>Question 19-21 - Unresolved-Closed</p>				

<p>19 RAI-264 (6877) Ext Winds and Hazards - OI 19-5 and 19-6</p>	<p>Two questions, 19-21 re extreme winds and 19-22 re screening of external hazards. 19-21 is a follow-up to 19-19. Response provided in TXNB-12043 dated 12/18/2012.</p>	<p>without followup. (Open Item 19-5) Question 19-22 - Unresolved-Closed without followup. (Open Item 19-6) A clarifying call was held on 11/15. Luminant requested an extension to 12/19 (via email on 11/20) due to hurricane, and the need for clarificaiton - extension was granted. 2013-05-13 update - Changed for IE to UC without followup. 2013-05-15 update - NRC to issue follow-up RAI re questions 21 and 22. No ECD.</p>	<p>NRC complete review of question responses and identify follow-up for each question.</p>	<p>12/19/2012</p>
<p>19-23 RAI-267 (6907) Averted Cost - OI 19-7</p>	<p>One question about averted cost as presented in the environmental report. Response provided in TXNB-12043 dated 12/18/2012.</p>	<p>Question 19-23 - Unresolved-Closed. (Open Item 19-7) Follow-up is 19-27 (RAI 276) Luminant requested a one week extension due to the Thanksgiving holiday to 12/19/12. Granted 11/19. 2012-11-20 Added to eRAI Table. 2012-04-29 update - changed from IE to CAN 2013-07-15 - changed from CA to UC</p>	<p>NRC review response to follow-up question.</p>	<p>12/19/2012</p>
<p>19 RAI-268 (6913) 19-24,25,26 COL Items, RI, Tech Adeq - OI 19-1, 19-2 and 19-3</p>	<p>Three PRA related questions. 19-24 - COL action items 19-25 - Use of PRA and Ried applications 19-26 - Plant-specific PRA technical adequacy Response provided in TXNB-12043 dated 12/18/2012.</p>	<p>Question 19-24 - In Evaluation (Open Item 19-1) Question 19-25 - Confirmatory Action NRC (Open Item 19-2) Question 19-26 - Confirmatory Action NRC (Open Item 19-3) 2012-11-20 Added to eRAI Table. 2013-04-17 update - questions 25 and 26 are being made confirmatory. 2013-04-29 update - Change questions 25 and 26 from IE to CAN 2013-05-23 Update - NRC reported that question 24 to be UC with followup RAI. 2013-03-07 update - no revisions to chapter 19 are expected. The final FSAR revision which will confirm the impacts is FSAR R3 UTR R3 scheduled for 8/30/13 9/30/13 which will incorporate the last set of FSAR updates based upon the ISCP.</p>	<p>NRC review question 19-24 response. Confirm content FSAR R4 and update SE re 19-25 and 19-26.</p>	<p>12/21/2012</p>
<p>19-4 External Hazards Risk Evaluation Open Item</p>	<p>Identify revised external hazards in FSAR chapter 2 and update, as necessary, related changes to external hazards assessment (screening or evaluation) in Chapter 19.</p>	<p>2013-06-04 update - Due to the addition of a Fukushima LL UTR (now R2), UTR R2 is changed to R3 and UTR R3 is changed to UTR R4. 2013-03-07 update - no revisions to chapter 19 are expected. The final FSAR revision which will confirm the impacts is FSAR R3 UTR R3 scheduled for 8/30/13 9/30/13 which will incorporate the last set of FSAR updates based upon the ISCP.</p>	<p>Luminant submit updated based on updated information in FSAR Chapter 2 per ISCP (FSAR R3 UTR R3). NRC review Chapter 19 updates, if any, and update Open Item.</p>	<p>9/30/2013</p>
<p>045 Recent Letters (1)</p>				
<p>TXNB-13023 RAI-274 (7059) H2 Burn</p>	<p>Provides RAI response.</p>		<p>NRC review response.</p>	<p>6/27/2013</p>

Part 01 Fin (2)		090 Action CPNPP (2)		
	EFH Financial Status and Gas Prices	Open discussion regarding potential impacts, if any, on the financial status of EFH and the cost of natural gas on the information in Part 1 of the COLA. EFH filed 8K discussing negotiation with debt holders (April 2013).	2013-04-03 update - this discussion is projected to occur in concert with FOCD discussions. The FOCD discussion is tied to the Phase 4 review of the COLA which is projected to move to 2015. As such, the NRC concurred with moving the action date for these issues and Luminant is proposing the last quarter of 2014 to initiate followup discussions. 2013-07-11 update - Luminant intends to update part 1 (in an upcoming UTR and COLA R4) per the EFH Corporate Structure changes as approved per order to CPNPP 1 and 2. Other updates to be provided prior to FOCD discussions.	12/31/2014 Propose a date and time for a conference call.
	Negotiation Action Plan	Discuss the potential for foreign influence. Call held on Thursday, 1/20, at 10am EST. Luminant assess NRC feedback and develop a plan to resolve. Luminant is standing by its submittal for now. Luminant is standing by the submitted plan at this time. May become an Open Item. Need to resolve before phase 6. Luminant submitted request to track as a Phase 2 Open Item on 7/28/11 (TXNB-1.1052).	2013-04-03 update - The FOCD discussion is tied to the Phase 4 review of the COLA which is project to move to 2015. As such, the NRC concurred with moving the action date for these issues and Luminant is proposing the last quarter of 2014 to initiate followup discussions. This also allows additional time to consider other industry activity in this area.	12/31/2014 Luminant to re-initiate review (approximately fourth quarter 2014).
Part 03 ER (3)		026 Overall Chapter Status (1)		
	Environmental Report	Sections complete - All DEIS - Issued Final EIS - Issued		None. Supplement later if new and significant changes occur. Luminant keep ER correct via UTRs and ER revisions (as part of COLA revisions).
090 Action CPNPP (2)		090 Action CPNPP (2)		
	Potential alternate pipeline route	Luminant is exploring an alternate pipeline route based upon ability to obtain right-of-ways. The FSAR and ER have not been revised and may not be but Luminant wants to have alternatives identified and available. 5/19: Michael Willingham noted that any changes to the ER could affect the environmental review schedule.		9/30/2013 Luminant determine if update required and inform NRC.
		In March of 2010, Luminant informed the NRC that, due to actions by ERCOT, the studies (or at least portions of the studies) regarding off-site power may need to be		Luminant keep NRC

Update NRO re Transmission Lines	redone by Oncor. Some of the transmission lines or their routes may change. Some information may be available in the fall of 2010 but some final information may not be available until the spring of 2011.		informed of update status. Subject of future drop in discussion with NRC.	9/30/2013
Part 10 ITAAC (1)				
100 Action NRO (1)				
License Conditions	Generic discussions are ongoing between the NRC Staff (Jerry Wilson) and the industry (NEI COL TF) re standard/typical license conditions. NRC staff is also looking at plant specific license conditions for CPNPP Units 3 and 4. A partial update was included in response to RAI-198 for 10 CFR 30, 40, and 70.		NRC, when time is appropriate, initiate discussion of license conditions for CPNPP Units 3 and 4.	12/31/2013

Total: **94**

CPNPP Units 3 and 4

Print

Licensing Conference Calls

Cancel Filter

	Title	CA R2	CA R3	CA R4	Responded
	02 (2)				
	02.05.05 RAI-019 (2930) Stability of Slopes	1			10/28/2009
	02.05.04 RAI-223 (5716) ITAAC Concrete Fill		1		7/28/2011
	03 (6)				
	03.07.02 RAI-060 (2879) Seismic	4			11/24/2009
	03.07.02 RAI-192(5255) Concrete	2			1/27/2011
	03.07.02, RAI-221 (5798) SASSI and DCD Seismic		2		8/4/2011
	03.09.06 RAI-244 (6222) IST			1	6/13/2012
	03.06.01 RAI-262 Pipe Hazards			1	9/26/2012
	03.03.02 RAI-250(6342) Hurricane Missiles			1	5/13/2013
	06 (3)				
	06.04 RAI-240 (6158) CRH Habit			1	6/13/2012
	06.02.02 RAI-271 (6965) COL 6.2(6)			1	1/17/2013
	06.02.02 RAI-272 (6997) Cntrmt Cleanliness			2	6/19/2013
	09 (6)				
	09.01.05 RAI-052 (3294) Heavy Loads			1	6/13/2012
	09.02.05 RAI-252 (6358) UHS			8	9/10/2012
	09.02.01 RAI-251 (6348) ESWS			5	12/3/2012
	09.05.04 RAI-265 (6775) Vault and Tunnel HVAC			1	12/18/2012
	09.04.05 RAI-266 (6898) Room and Duct Heaters			2	12/18/2012
	09.04.05 RAI-243 (6124) UHS Vent			1	3/4/2013
	10 (1)				
	10.04.08 RAI-237 (6166) SGBD			1	12/8/2011
	12 (1)				
	12.3-12.4, RAI-135(4206), Contam Minimization			1	7/28/2011
	13 (2)				
	13.04 RAI-255 (6447) Table Error			1	5/16/2012
	13.03 RAI-258 (6449) EALS			3	7/16/2012
	14 (5)				
	14.03.07 RAI-273 (7006) UHS Pmp Hs ITAAC			1	
	14.02 RAI-098 (3790) IST			1	6/7/2012
	14.02 RAI-257 (6457) UHS Testing			1	11/12/2012
	14.03.07 RAI-254 (6403) Testing for UHS Components			1	11/26/2012



14.03 RAI-056 (2583) ASME ITAAC				2	3/4/2013
16 (1)					
16 RAI-090 (3113) PTS and Bases			1		3/4/2013
19 (2)					
19-20 RAI-259 (6441) RITS External Events			1		6/21/2012
19 RAI-268 (6913) 19-24,25,26 COL Items, RI, Tech Adeq - OI 19-1, 19-2 and 19-3			2		12/18/2012

Totals:

Total: **29**

Licensing Conference Calls



Title	Description	IE	PM Status Update	Action Required	Responded
Awaiting DCD Action (2)					
03.11 RAI-239 (6159) EQ Followup - Questions 03.11-18, 19 and 20	<p>Q 03.11-18 followup to Q 03.11-1. The NRC is preparing a followup question to 03.09.06-13 which is very similar to this question.</p> <p>Q 03.11-19 followup to Q 03.11-2. Describe the transition from the initial EQ program to the EQ program to be implemented during plant operation.</p> <p>Q 03.11-20 followup to Q 03.11-11. License condition for program implementation. 12/15, NRC granted extension to 1/31/2012.</p> <p>Response submitted via TXNB-12006 on 2/27/12.</p>	2	<p>Question 03.11-18 - In Evaluation</p> <p>The information to resolve this question is linked to the DCD PSC plan. The procurement specs and other material to be audited during the PSC audit will resolve most if not all of this question although RCOLA followup may be needed. (see also RAI-244, question 03.09.06-21)</p> <p>Question 03.11-19 - In Evaluation</p> <p>Resolution of this questioned is tied to DCD questions re MUAP-08015, US-APWR Equipment Qualification Program. Once the DCD issues are resolved, this RCOLA question may be resolved as well or followup may be necessary.</p> <p>Question 03.11-20 - Resolved-Closed</p> <p>DCD submitted EQ Program update 11/1/2012.</p> <p>2013-01-09 - Staff reviewing DCD now and RCOLA next. ECD two to three weeks (about 1/30/13). 2013-02-27 update - still working DCD. No ECD for RCOLA.</p>	<p>NRC review response.</p> <p>US-APWR DCD effort needed to resolve via PSC and MUAP-08015 reviews.</p>	2/27/2012
8.2-31 RAI-263 (6884) NRC re Loss of one phase offsite power	<p>One question (8.2-31) with three parts. Concerns the Byron event where a problem on one phase of offsite power resulted in unit trip.</p> <p>Response submitted via TXNB-12040 on 11/29/2012.</p>	1	<p>Question 8.2-31 - In Evaluation</p> <p>2012-11-01 - Clarifying conference call held.</p> <p>2012-11-07 update - Luminant and Mitsubishi working on the response to address various challenges as identified by operating plants.</p> <p>2012-11-12 Luminant requested an extension to 12/3/12.</p> <p>2012-11-21 extension granted.</p> <p>2013-01-09 - NRC staff may request a conference call to discuss the Luminant response.</p>	<p>NRC review response.</p> <p>NRC staff, Luminant and MHI/MNES to continue to investigate and to follow proposals and progress by the nuclear industry.</p> <p>Industry public meeting expected in February 2013.</p>	11/29/2012
Fukushima related (1)					
Question 01.05-4 - In Evaluation					

<p>01.05 RAI-269 (6929) Rec 4.2</p>	<p>COL item re NTF Recommendation 4.2 for mitigating strategies. Luminant responded via TXNB-13001 on 1/17/2013.</p>	<p>1</p>	<p>2013-01-09 - Luminant informed NRC that the response will be modeled after the approach taken for programs in Chapter 13. An FSAR update will include a table which lists post-COL Fukushima actions and a licensing condition to control the completion of those actions. NRC confirmed that a response of this nature is acceptable for review.</p>	<p>NRC to review and update eRAI Table.</p>	<p>1/17/2013</p>
<p>IHCP Related (3)</p>					
<p>02.04.12 RAI-147 (4314) Groundwater</p>	<p>RAI-147 Q 2.4.12-8 to 17 Response = meeting +60days. Luminant submitted draft meeting materials (TXNB-10039 6/1). Public meeting held 6-28-2010. See TXNB-10060 of 8/26/10. Supplement provided in TXNB-11057 dated 8/29/2011. Supp 03 provided in TXNB-11082 on 1/1/28/11. Included fill properties and extent of above ground fill. S04 provided via TXNB-13013 on 4/29/13.</p>	<p>10</p>	<p>Questions 02.04.12-10, 13, 14, 15 and 16 - In Evaluation Questions 02.04.12- 8, 9, 11, 12 and 17 - In Evaluation NRC issued white paper 10/12/11. Conf call held 10/26/11. White paper provided which included many of the basic parameters needed to address hydrology, groundwater and leakage paths. Public meeting held 3/27/12. To be revised/supplemented as part of IHCP. 4 of 5 CNs in COLA R2. Q02.04.12-8 not in COLA R2 6/28/2012 update - Changed 5 questions from Confirmatory to Issued pending implementation of IHCP. Per Update 1, the planned submittal for RAI-147 related topics is changed from 3/29/13 to 1/31/13. 2013-07-15 update - all questions changed to In Evaluation.</p>	<p>NRC review responses as supplemented by S04.</p>	<p>4/29/2013</p>
<p>02.04.02 RAI-139 (4309) Flood Calc</p>	<p>Q 2.4.2-2. Will develop responses by modifying current calculations and conclusion that SBR is not a proposed feature. See TXNB-10052 dated 7/16/10. RAI-139 Supplement issued 10/21/11 via TXNB-11066. Supplemental response to RAI-139 provided via TXNB-13016 on 5/13/13. Revised disc sent 6/19/13 to remove incorrect proprietary label.</p>	<p>1</p>	<p>Question 02.04.02-2 - In Evaluation NRC issued white paper on 11/12/11. Conference call held on 12/1/11. Several items identified for clarification by Luminant. All but one are impacted by the changes in the DCD Layout. Luminant to update 12/31/12 as part of IHCP. 6/28/2012 update - Changed from Confirmatory to Issued pending implementation of IHCP. Per Update 1, the planned submittal for RAI-139 related topics is changed from 12/31/12 to 4/30/13. 2013-06-24 update - question changed from IW to IE 2013-03-19 Update - due to issues re finalizing the GWL Model and Calculations, the submittal date has been moved from 4/30/13 to 5/17/13.</p>	<p>Updates planned as part of IHCP on 4/30/2013 5/17/2013. NRC continue review with supplemental response.</p>	<p>5/13/2013</p>
			<p>Q 02.04.13-5, 6, and 7. Based on eRAI dated</p>		

<p>02.04.13, RAI-145(4315) Rad Liq Release</p>	<p>Assumptions, inputs being used, and calc methods were discussed in a public meeting 6-28-2010. Q 2.4.13-5, 6, 7 Response in 90 days after the meeting depending on results. Luminant submitted draft meeting materials (TXNB-10039 6/1). Luminant response submitted via TXNB-10063 on 9/16/10. Supplemental responses submitted via TXNB-11057 on 8/29/11. Response to RAI-145 Supplement 2 provided by TXNB-13018 on 5/28/13.</p>	<p>3</p>	<p>8/31/2011 were statused as confirmatory. Supp response submitted 8/29/11. 9/28/11 eRAI Report, changed from Confirmatory to Responded. NRC issued white paper 10/12/11. Conf call held 10/26/11. Public meeting cancelled. Public conference call planned for week of December 12, 2011. 2/7/12 Changed from Responded to Confirmatory. Response to be revised/supplemented as part of IHCP. 6/28/2012 update - Changed from Confirmatory to Issued pending implementation of IHCP. Per Update 1, the planned submittal for RAI-145 related topics is unchanged. Questions 02.04.13-5, 6 and 7 - In Evaluation 2013-06-24 update. Question 5 and 6 moved to In Evaluation. 2013-07-15 update - question 7 moved to in evaluation.</p>	<p>Revised response to be provided 3/29/2013 4/30/2013 July or August in late May 2013 as part of IHCP. NRC review RAI-145 S02</p>	<p>5/28/2013</p>
<p>☒ NRC Review Ongoing (3)</p>					
<p>19 RAI-268 (6913) 19-24,25,26 COL Items, RI, Tech Adeq - OI 19-1, 19-2 and 19-3</p>	<p>Three PRA related questions. 19-24 - COL action items 19-25 - Use of PRA and RIed applications 19-26 - Plant-specific PRA technical adequacy Response provided in TXNB-12043 dated 12/18/2012.</p>	<p>1</p>	<p>Question 19-24 - In Evaluation (Open Item 19-1) Question 19-25 - Confirmatory Action NRC (Open Item 19-2) Question 19-26 - Confirmatory Action NRC (Open Item 19-3) 2012-11-20 Added to eRAI Table. 2013-04-17 update - questions 25 and 26 are being made confirmatory. 2013-04-29 update - Chantge questions 25 and 26 from IE to CAN 2013-05-23 Update - NRC reported that question 24 to be UC with followup RAI. Question 03.04.01-1 - In Evaluation 2013-05-28 Update - added to eRAI as IW 2013-06-24 update - changed from IW to IE.</p>	<p>NRC review question 19-24 response. Confirm content FSAR R4 and update SE re 19-25 and 19-26.</p>	<p>12/18/2012</p>
<p>03.04.01 RAI-275 (7099) re CST Failure</p>	<p>One question re capability to handle a CST failure and an error in a left-hand-margin entry. Response provided via TXNB-13019 on 6/19/13.</p>	<p>1</p>	<p>The multiple parts in this question are not understood by the licensee and the regulatory basis for the options is not clear. A clarifying conference call will probably be needed. The question seems to result from ongoing DCD reviews, questions and responses. It may not be appropriate to respond until this issue is fully vetted in the DCD review. 2013-05-01 update - based on complexity of question, Golden Week and potential need for clarifications, Luminant proposed a due date of 6/30/13. NRC concurred. 2013-05-13 update - currently Luminant</p>	<p>NRC review response.</p>	<p>6/19/2013</p>
<p>19.02 RAI-274 (7059) H2 Burns</p>	<p>Re Severe Accident Survivability Studies: Explain why information is not available prior to COL, provide conditions (pressure, temperature and time) for each component, identify ITAAC, Propose license condition. Response submitted via TXNB-13023</p>	<p>1</p>	<p>Luminant-submit response. NRC review response.</p>	<p>6/27/2013</p>	

	on 6/27/2013.	believes a clarifying call will not be needed. Question 19.02-1 - In Evaluation 2013-07-15 - changed from IW to IE		
--	---------------	---	--	--

Totals:

Total: **9**