


Figure 9.2.5-1—Ultimate Heat Sink Piping and Instrumentation Diagram

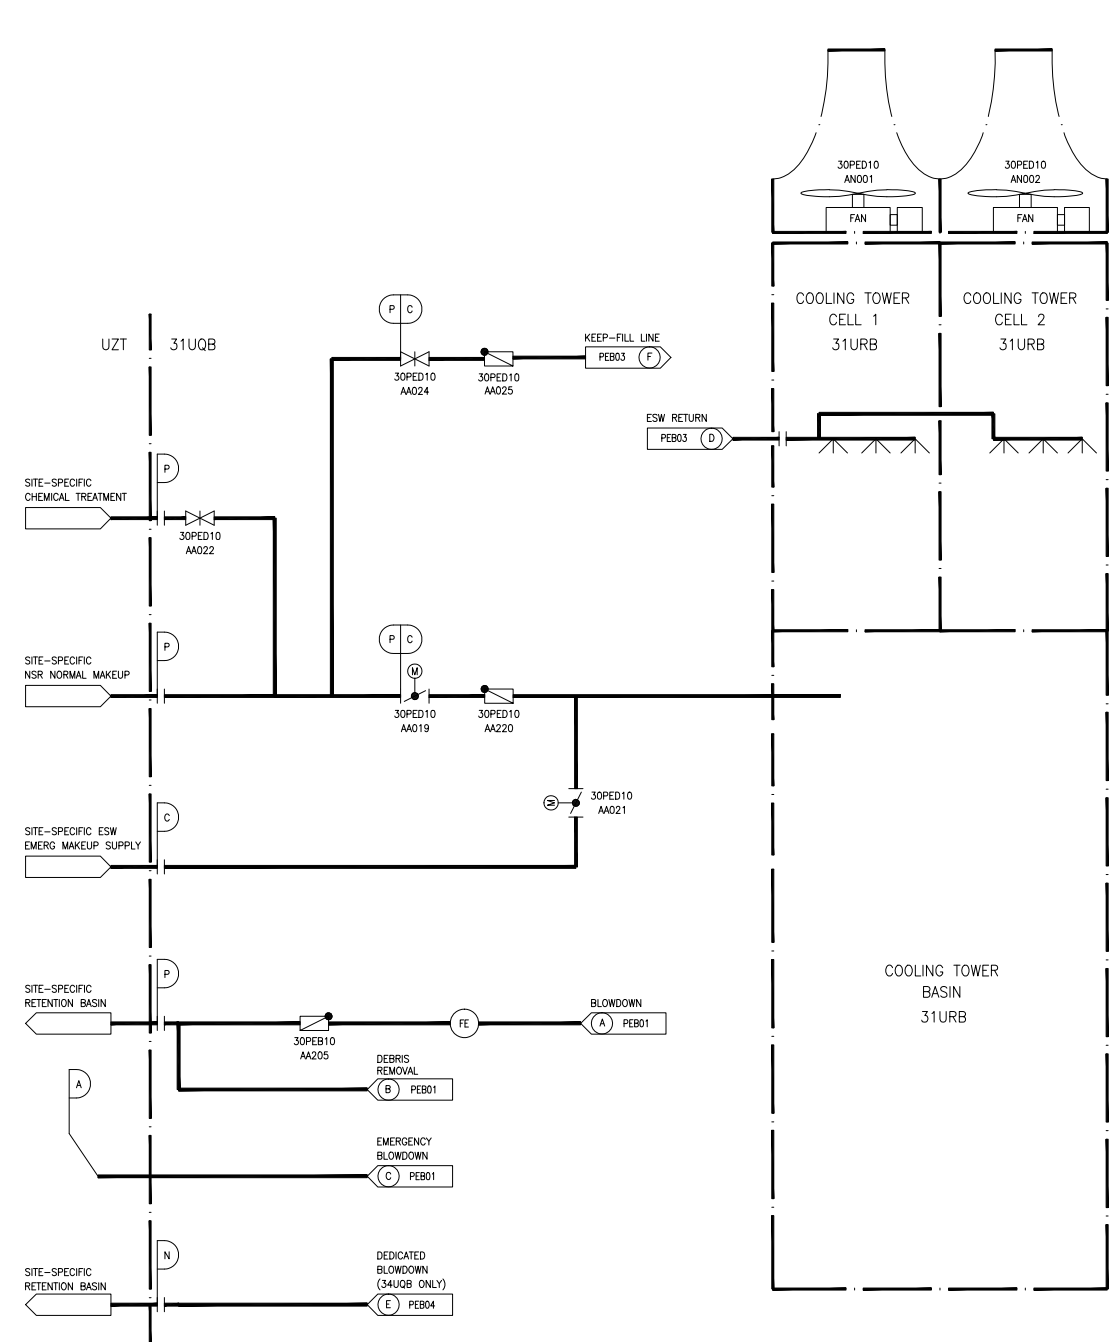


PEB – ESSENTIAL SERVICE WATER PIPING SYSTEM
PED – ESSENTIAL SERVICE WATER RECIRCULATION COOLING SYSTEM
31UQB – ESSENTIAL SERVICE WATER PUMP BUILDING, DIVISION 1
31URB – ESSENTIAL SERVICE WATER COOLING TOWER STRUCTURE, DIVISION 1
UZA – OUTDOOR AREA

NOTE:
1. TRAIN 1 SHOWN IS REPRESENTATIVE OF TRAINS 2, 3 AND 4, WITH EXCEPTIONS AS NOTED.
2. UHS BASIN WATER LEVEL AND TEMPERATURE SENSORS ARE SHOWN ON FIGURE 09.02.01-1.

A	C	I
N	E	NSC
P	E	NSC
C	C	I
DESIGN AREA	SSC QUALITY GROUP	SSC SEISMIC CLASS


REV 003
PED01T2

Figure 9.2.5-2—[[Conceptual Site-Specific UHS Systems]]

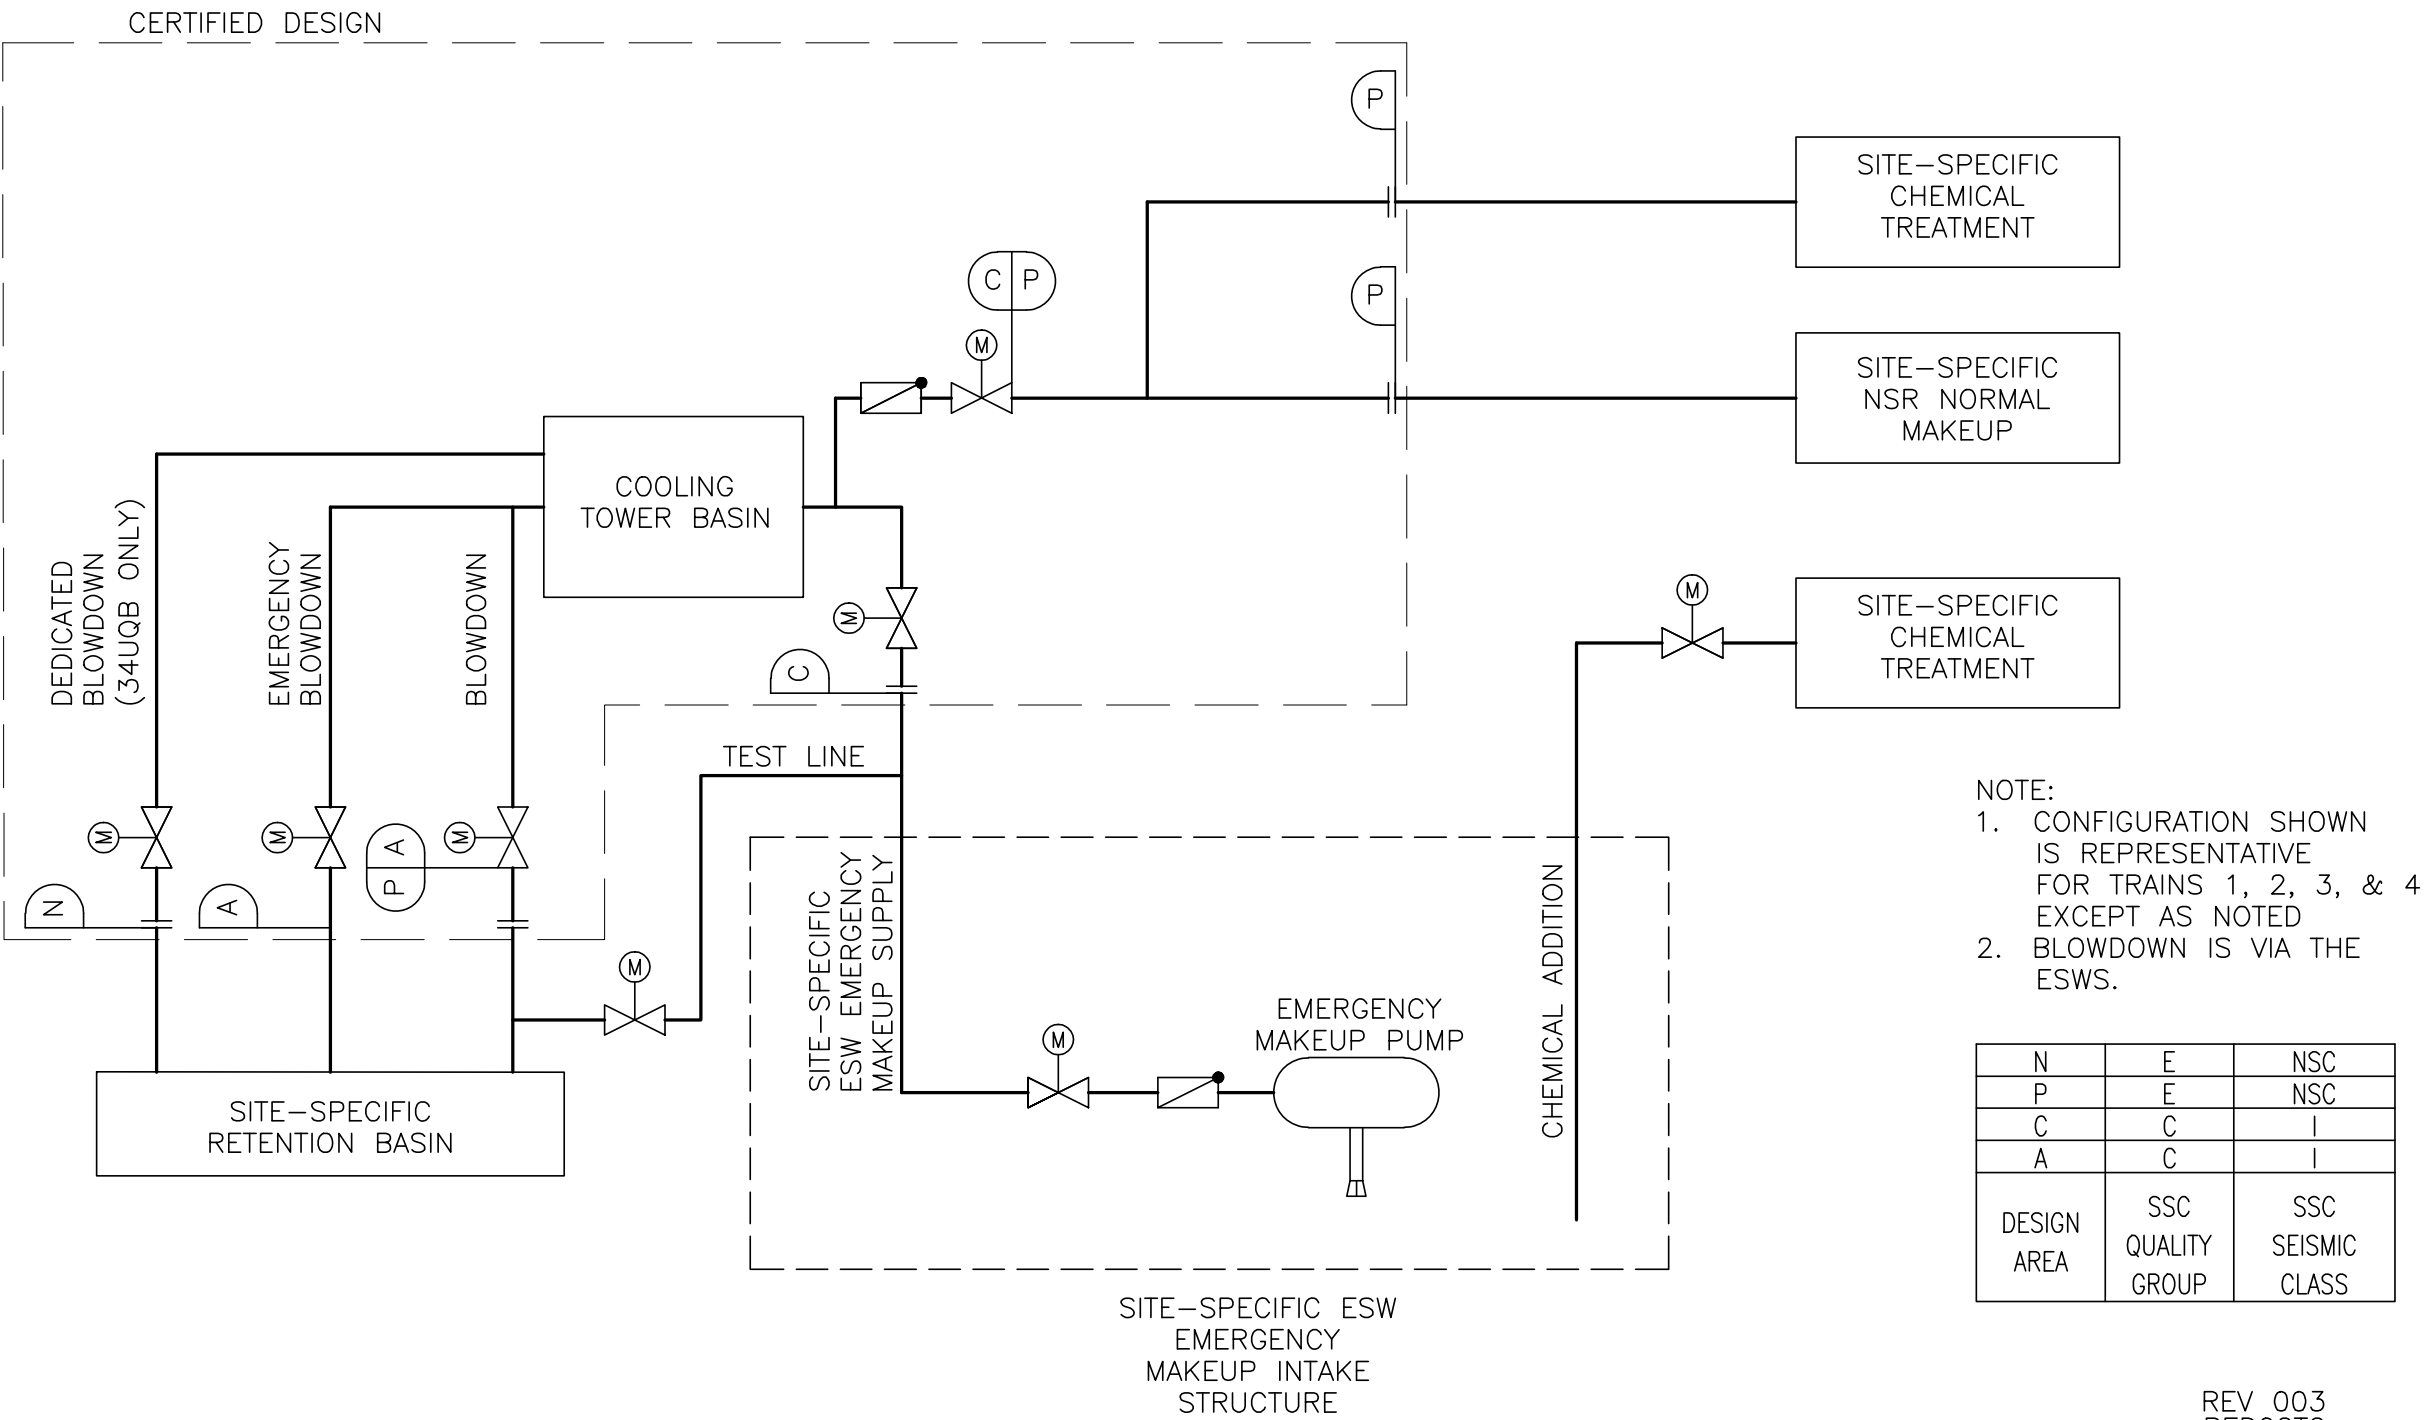

REV 003
PED02T2

Figure 9.2.5-3—Cross-Section of UHS Tower Basin

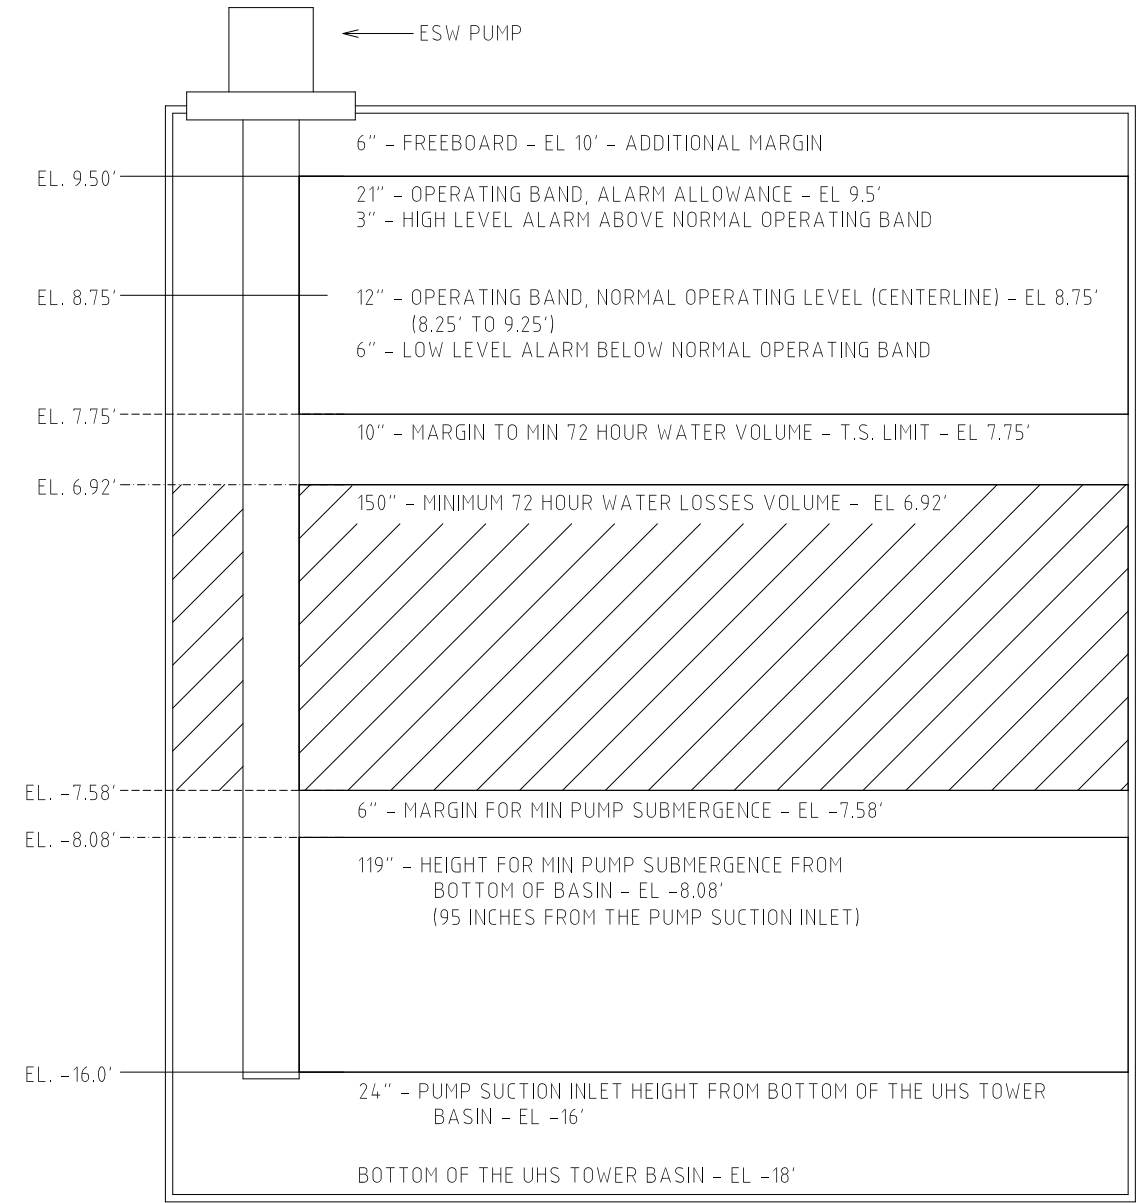

NOTE:
FIGURE NOT DRAWN TO SCALE

REV 005
PED03T2