


Sheet 1 of 4

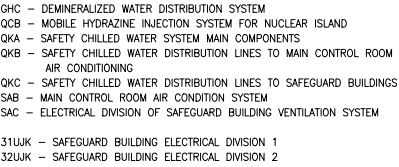


NOTES:

1. TRAIN 1 SHOWN IS REPRESENTATIVE OF TRAIN 4 WITH EXCEPTIONS AS NOTED.
2. FOR MANUAL CONNECTION TO SEISMIC MAKEUP WATER SOURCE.

| | | |
|----------------|-------------------------|-------------------------|
| B | C | I |
| A | C | I |
| DESIGN AREA | SSC QUALITY GROUP | SSC SEISMIC CLASS |

REV 003
QKA01T2

Figure 9.2.8-1—Safety Chilled Water System Diagram
Sheet 2 of 4

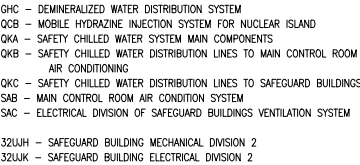


NOTES:

1. TRAIN 2 SHOWN IS REPRESENTATIVE OF TRAIN 3
2. FOR MANUAL CONNECTION TO SEISMIC MAKEUP WATER SOURCE.

| | | |
|-------------|-------------------|-------------------|
| B | C | I |
| A | C | I |
| DESIGN AREA | SSC QUALITY GROUP | SSC SEISMIC CLASS |


REV 003
QKA02T2

Figure 9.2.8-1—Safety Chilled Water System Diagram
Sheet 3 of 4

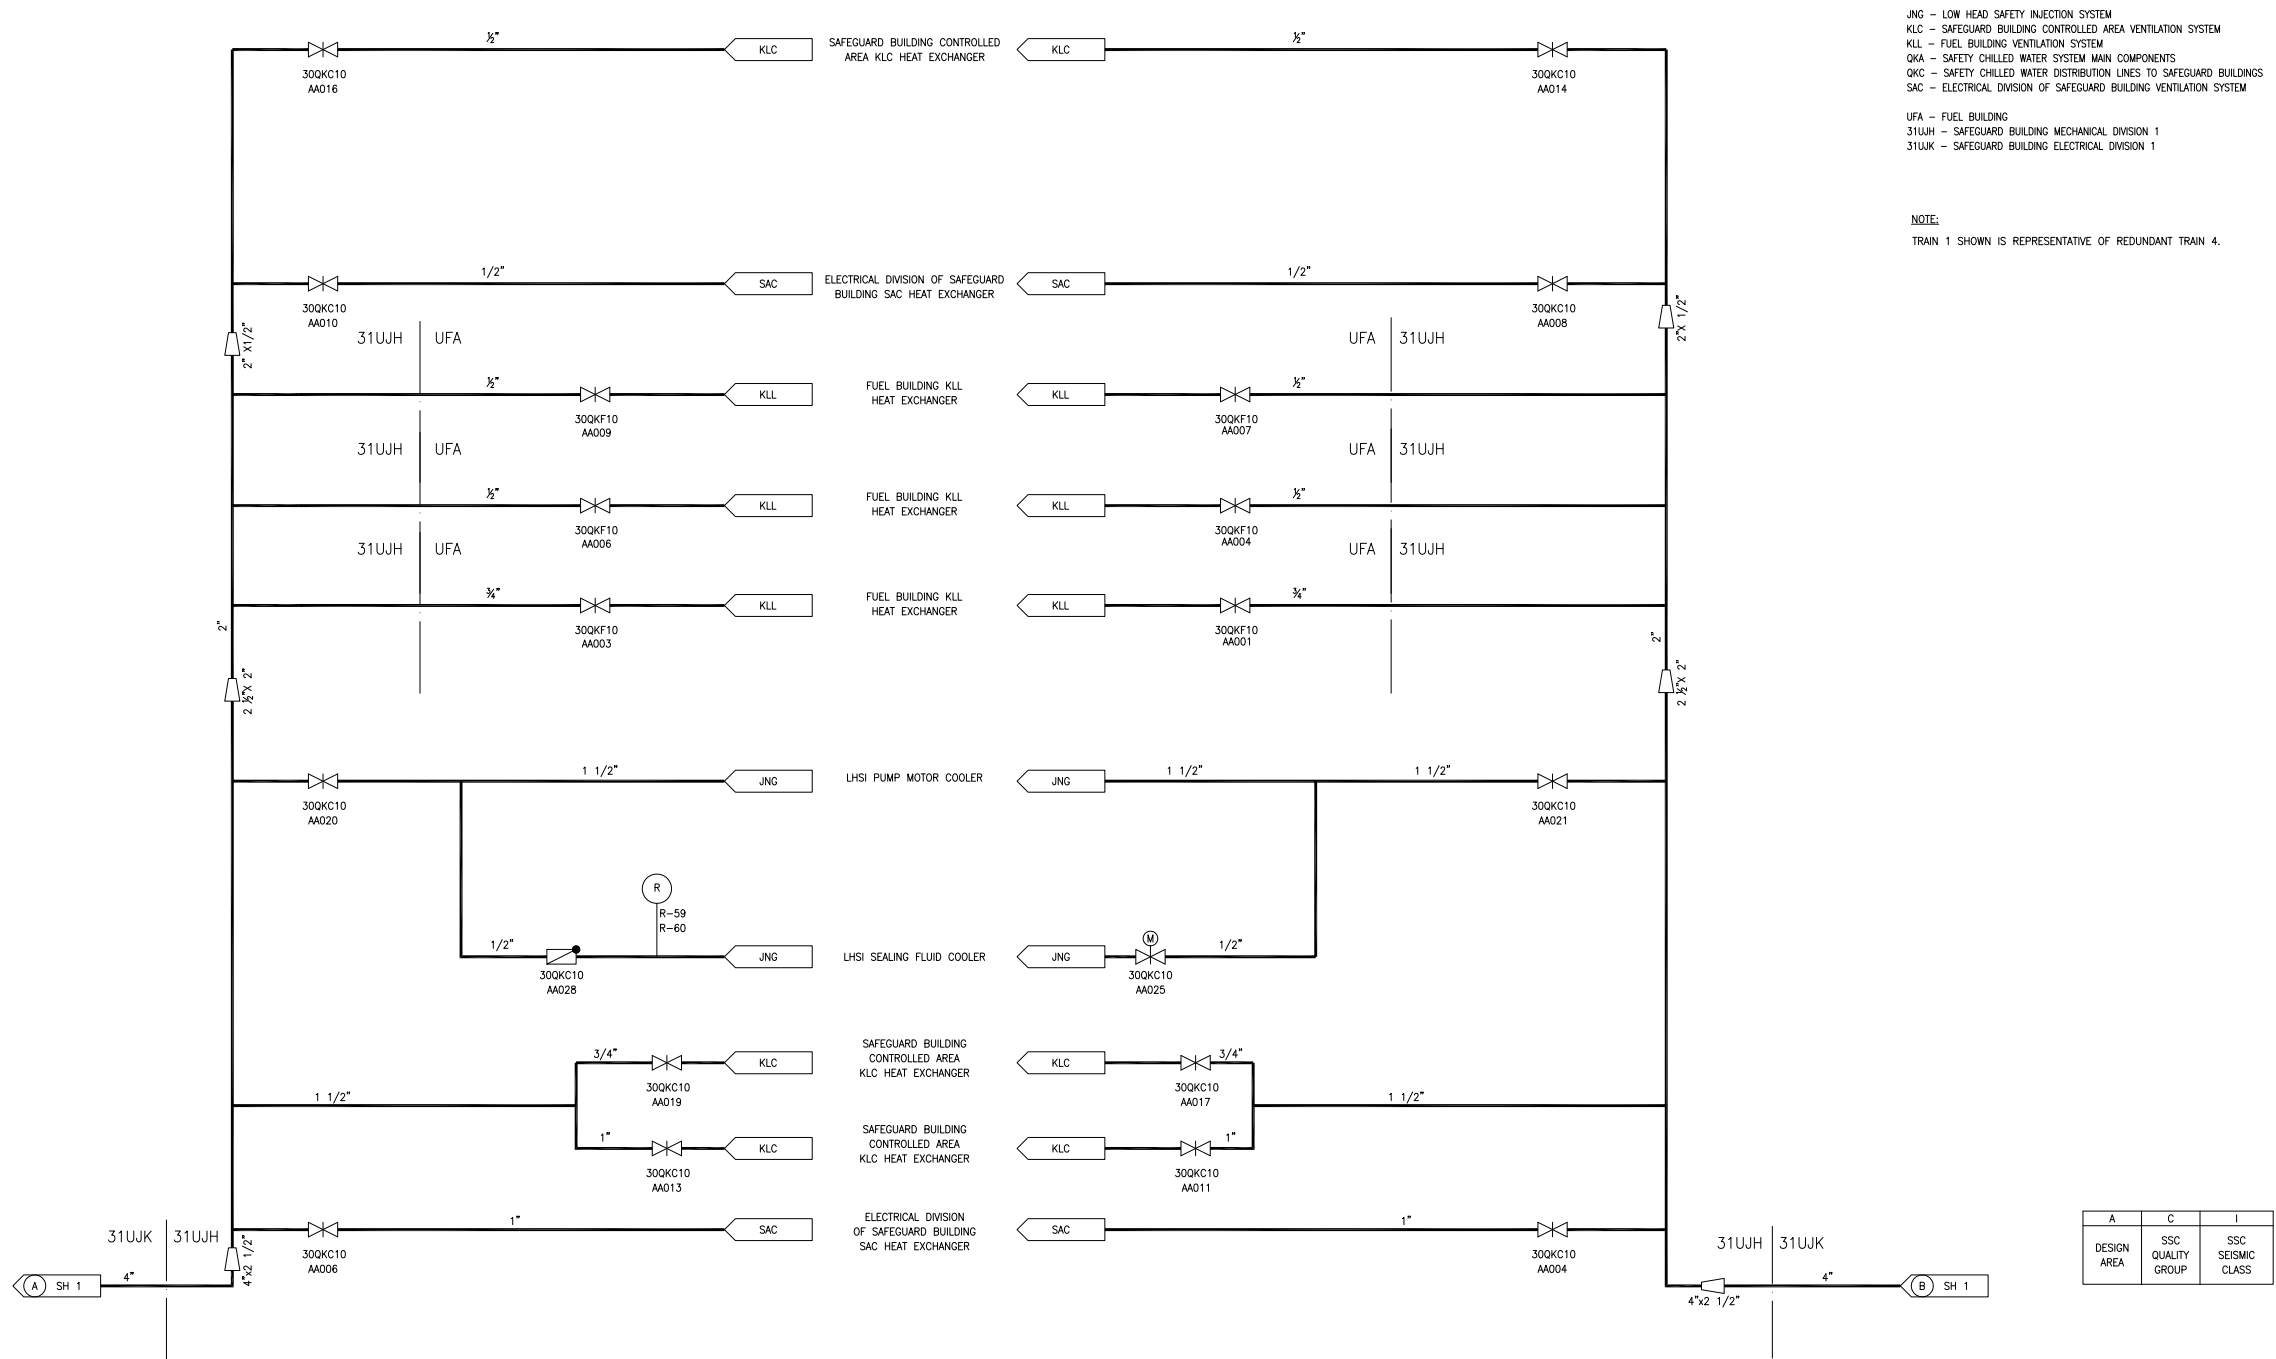

REV 003
QKA03T2

Figure 9.2.8-1—Safety Chilled Water System Diagram
Sheet 4 of 4

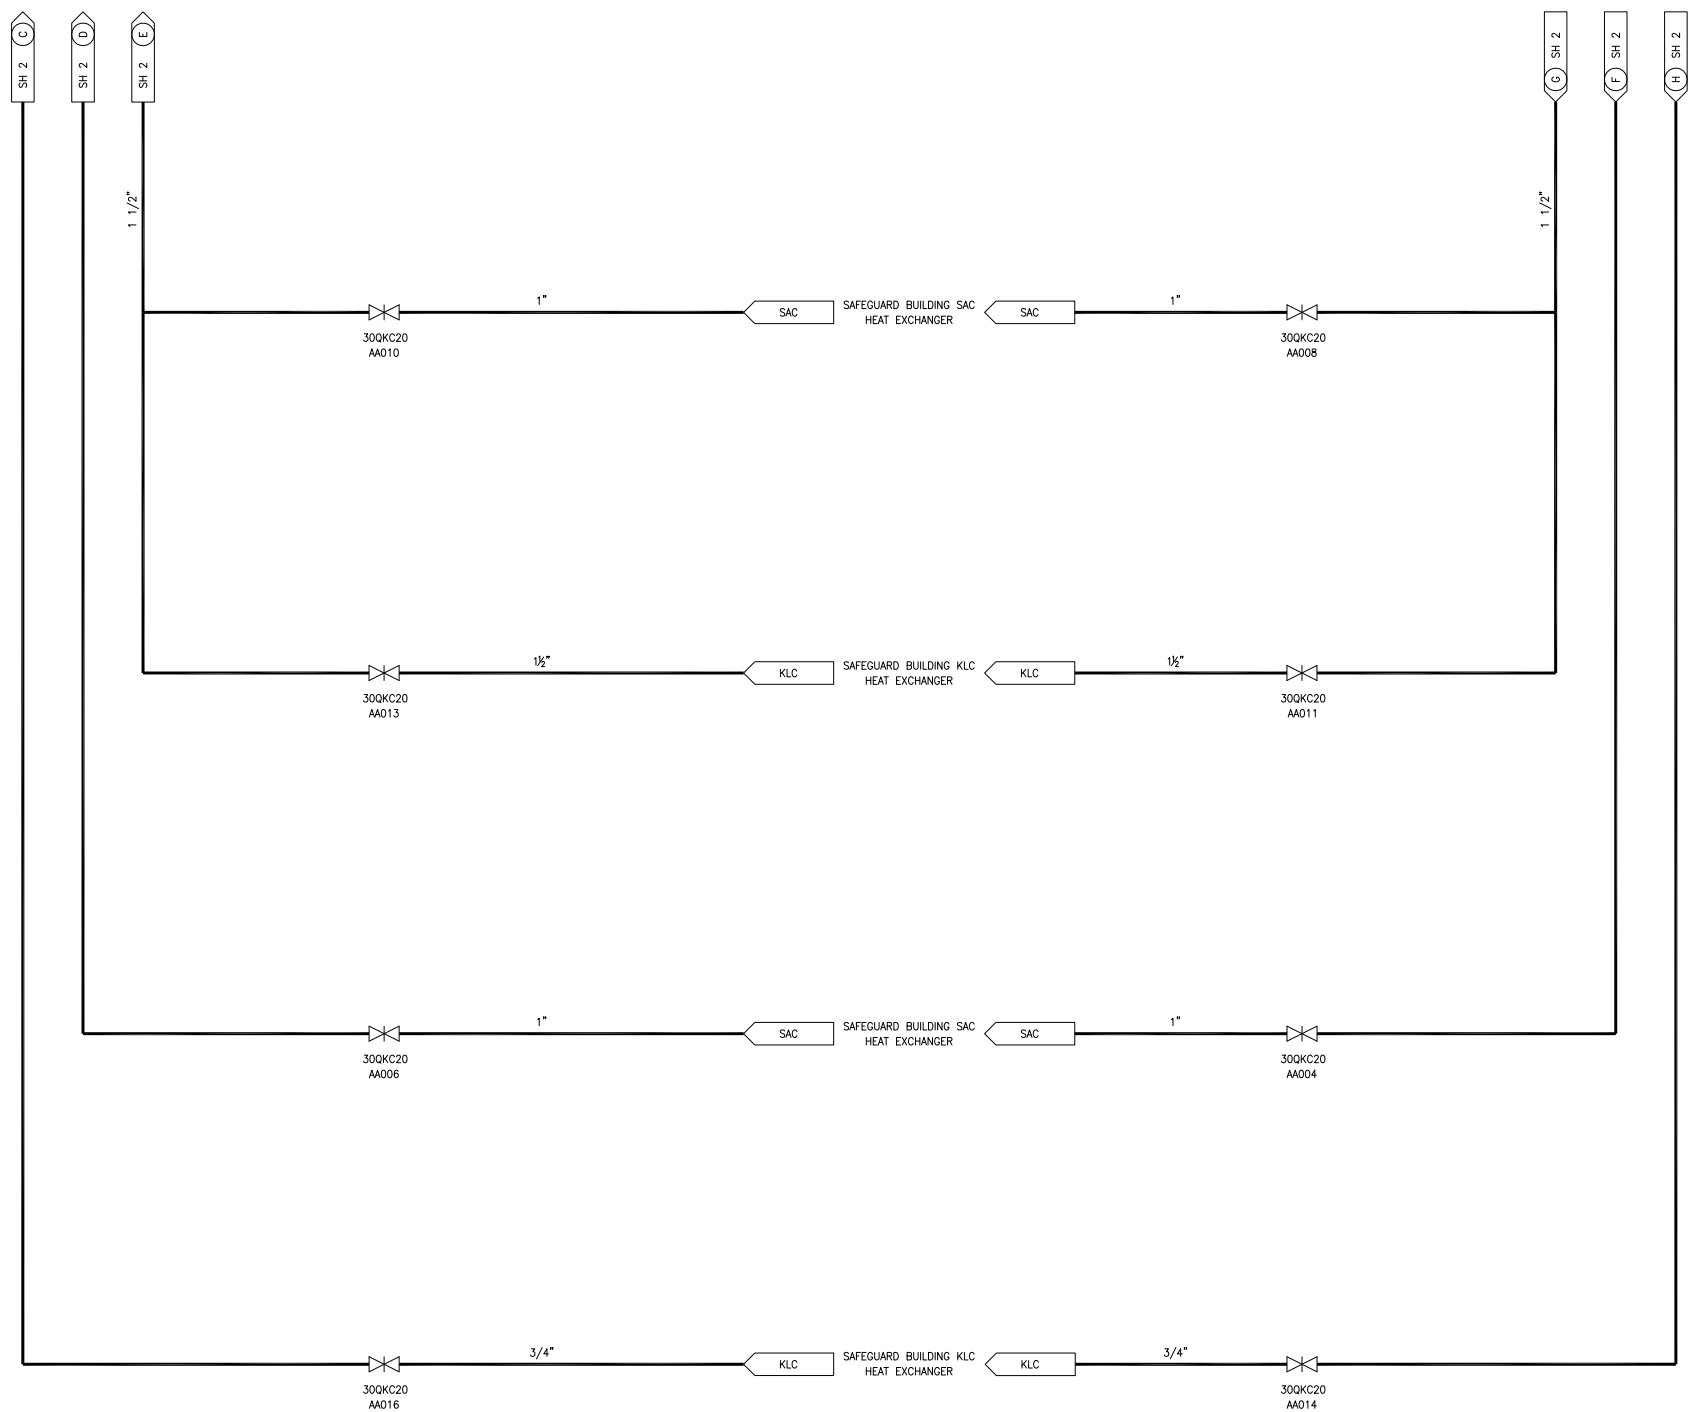


KLC – SAFEGUARD BUILDING CONTROLLED AREA VENTILATION SYSTEM
QKA – SAFETY CHILLED WATER SYSTEM MAIN COMPONENTS
QKC – SAFETY CHILLED WATER DISTRIBUTION LINES TO SAFEGUARD BUILDINGS
SAC – ELECTRICAL DIVISION OF SAFEGUARD BUILDING VENTILATION SYSTEM
32UJH – SAFEGUARD BUILDING MECHANICAL DIVISION 2

NOTE:
TRAIN 2 SHOWN IS REPRESENTATIVE OF REDUNDANT TRAIN 3.

| A | C | I |
|-------------|-------------------|-------------------|
| DESIGN AREA | SSC QUALITY GROUP | SSC SEISMIC CLASS |

REV 003
QKA04T2

Figure 9.2.8-2—Safety Chilled Water System Air Cooled Division Diagram

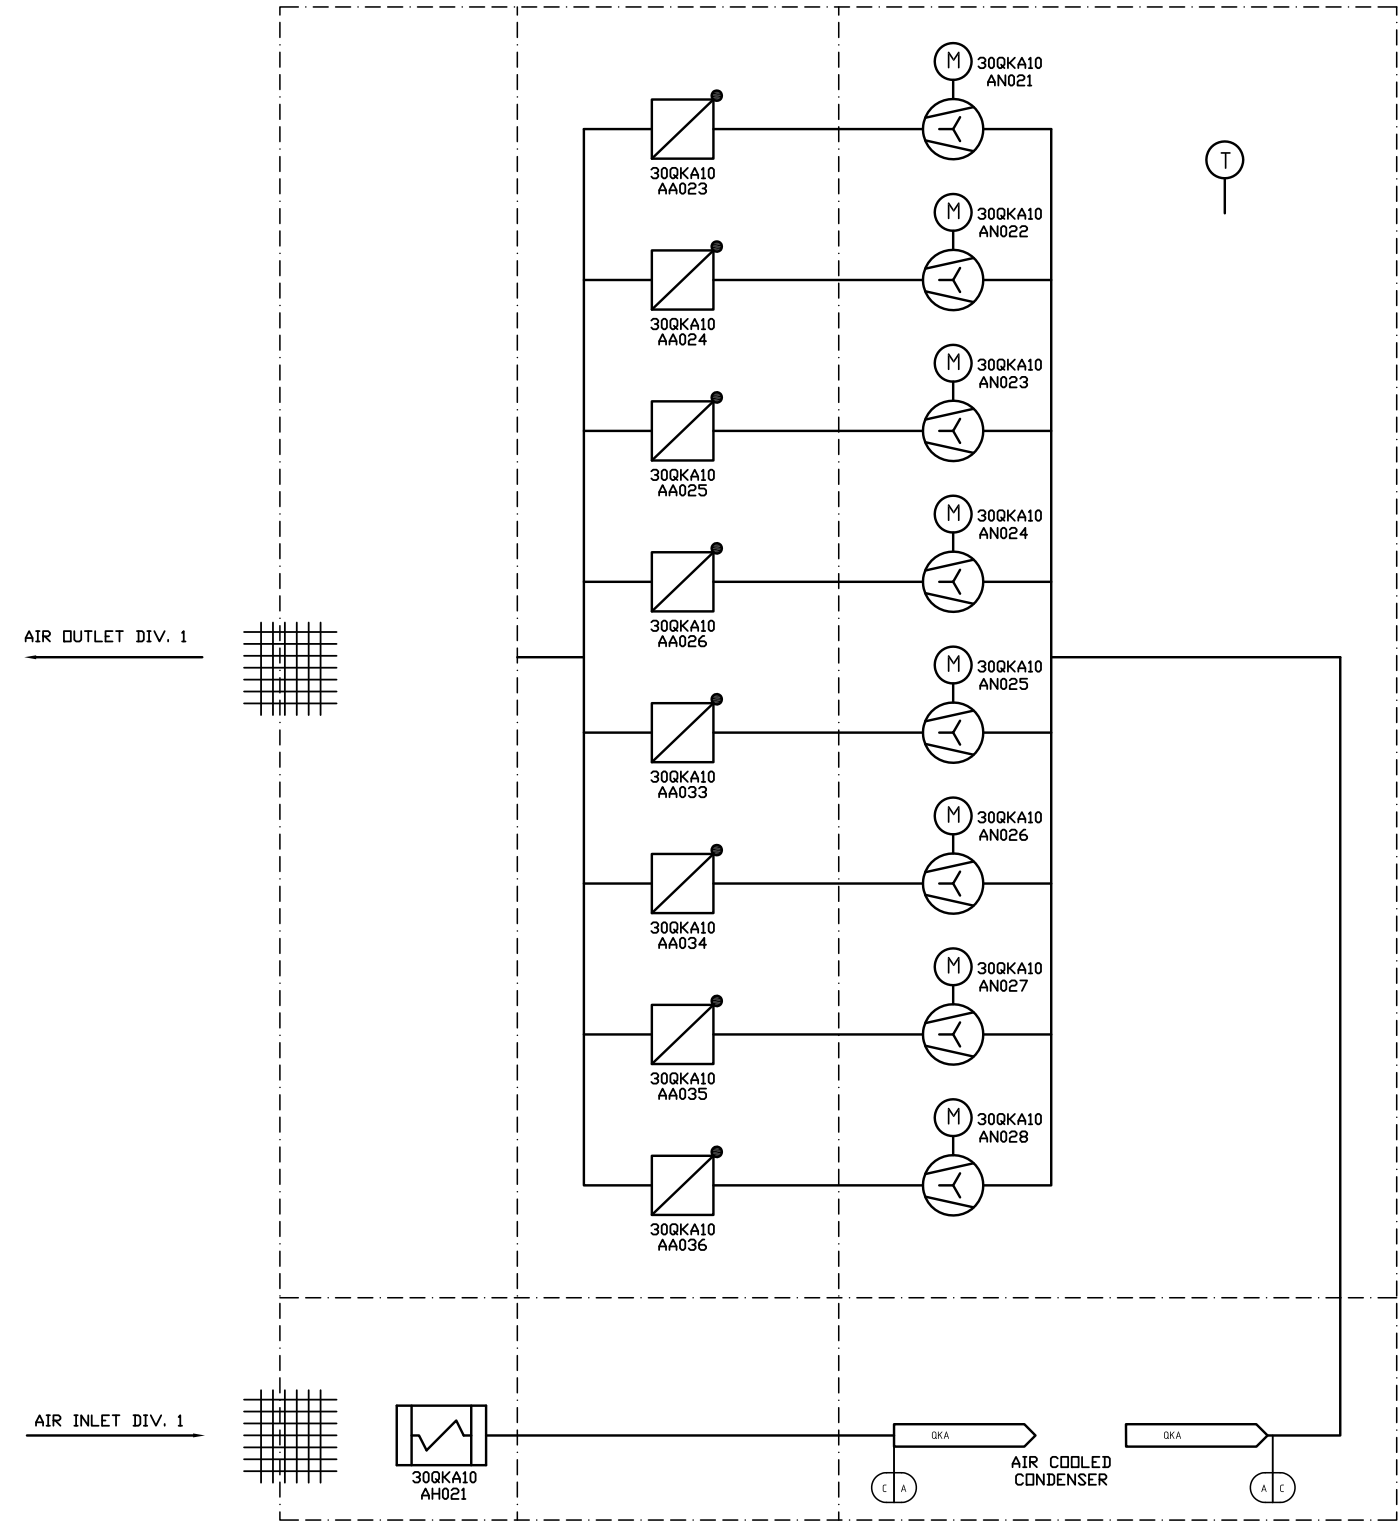

NOTES:
1. TRAIN 1 SHOWN IS REPRESENTATIVE OF TRAIN 4.

| | | |
|----------------|-------------------------|-------------------------|
| A | C | I |
| C | N/A | I |
| DESIGN AREA | SSC QUALITY GROUP | SSC SEISMIC CLASS |

QKA05 T2