


Figure 9.4.3-1—Nuclear Auxiliary Building Supply Air Filtration and A/C Trains

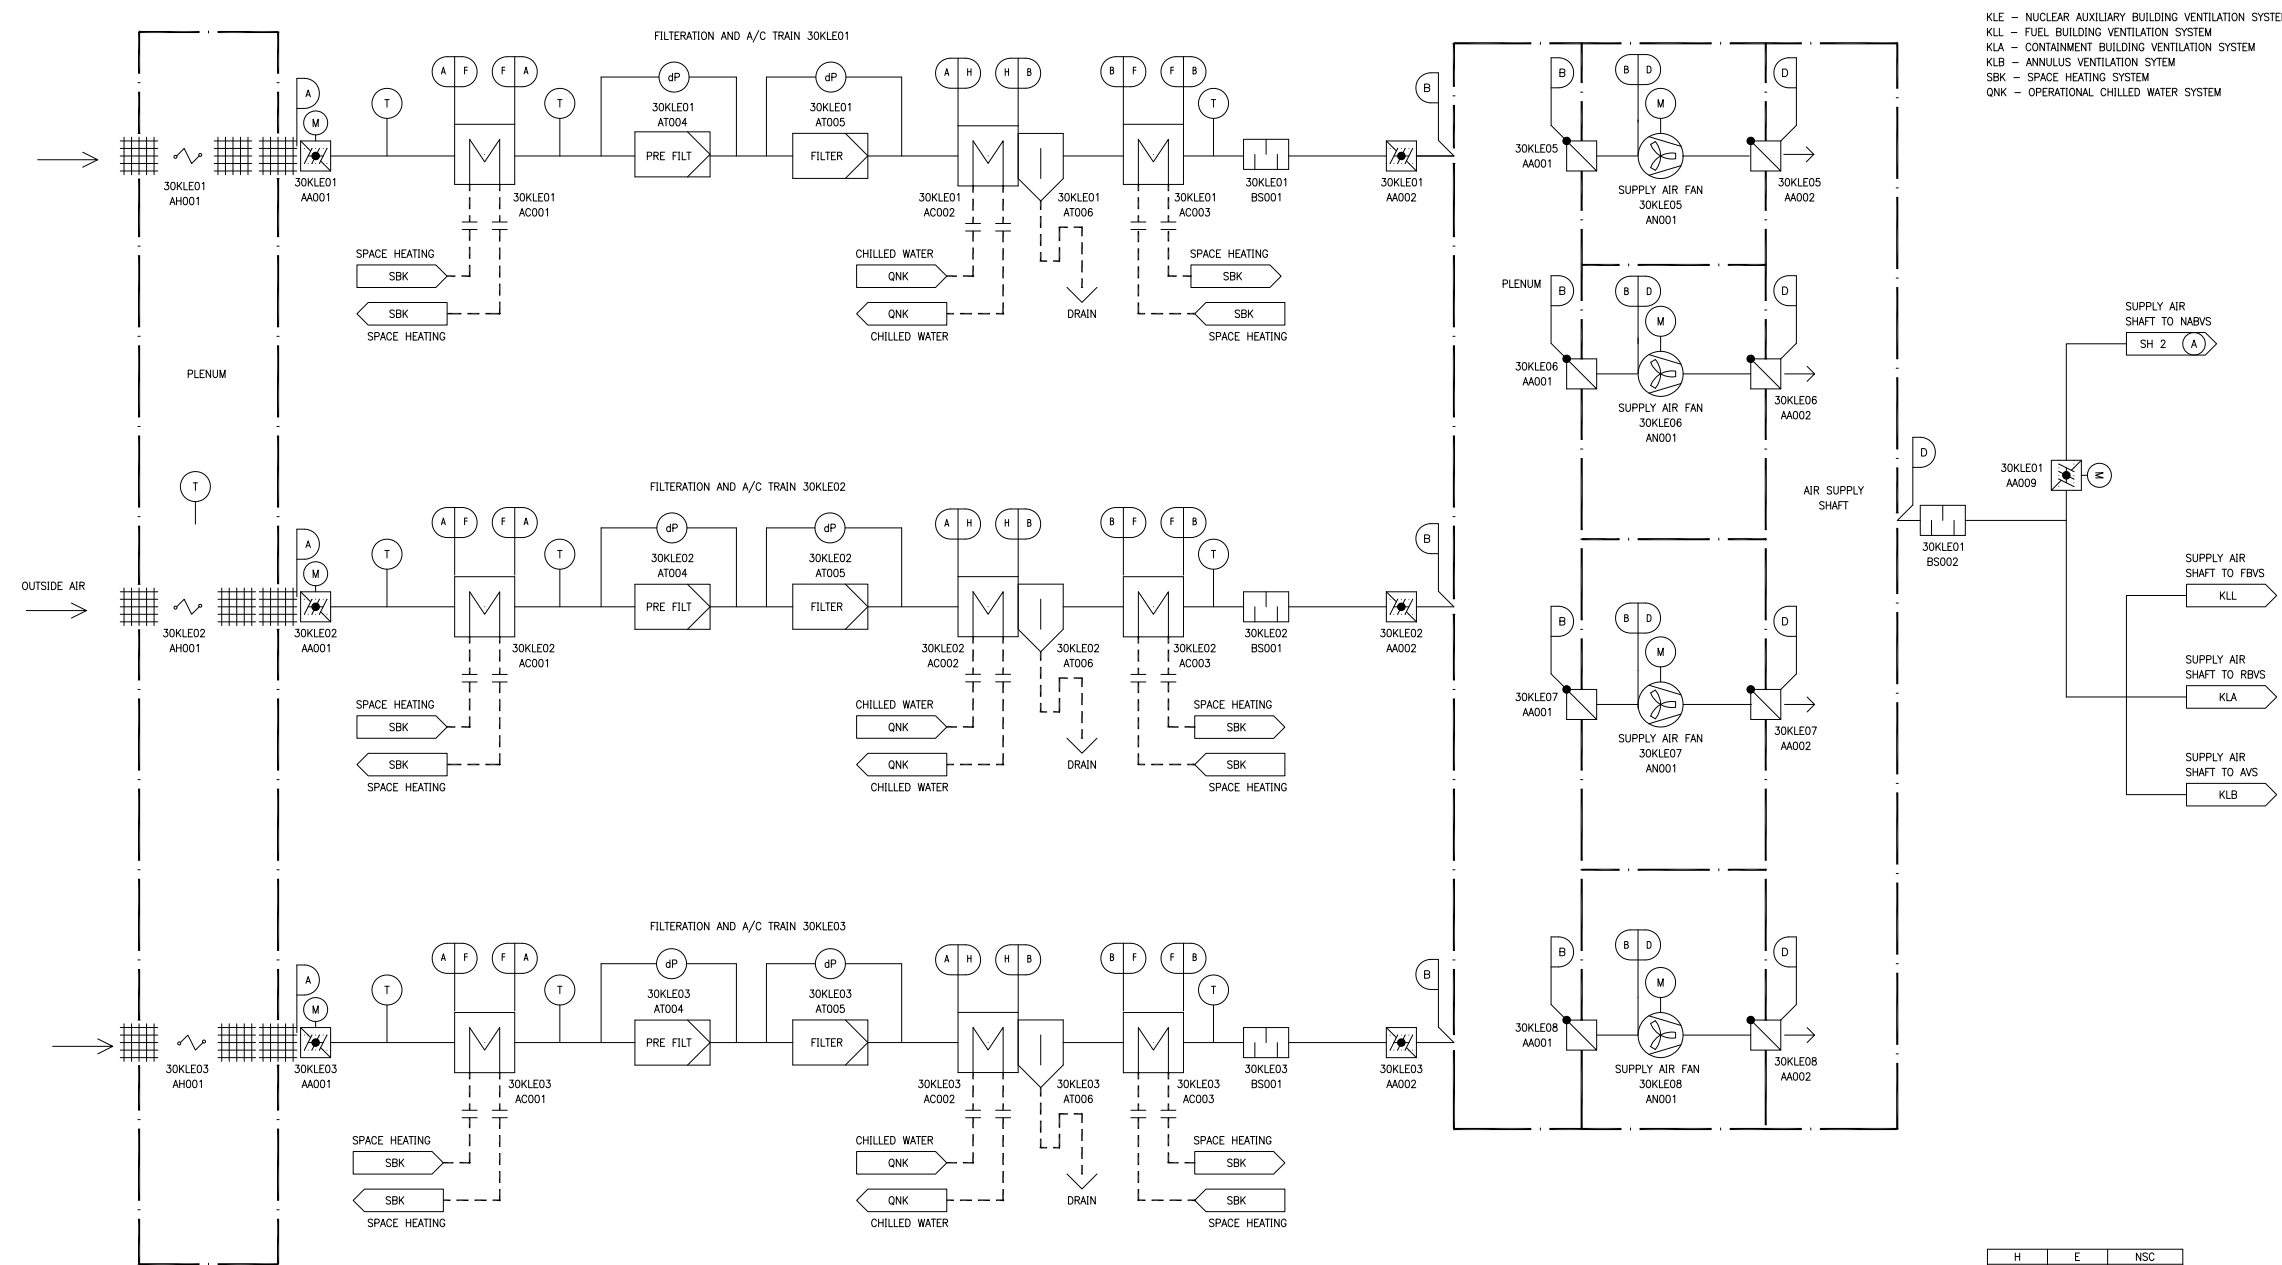


KLE – NUCLEAR AUXILIARY BUILDING VENTILATION SYSTEM
 KLL – FUEL BUILDING VENTILATION SYSTEM
 KLA – CONTAINMENT BUILDING VENTILATION SYSTEM
 KLB – ANNULUS VENTILATION SYSTEM
 SBK – SPACE HEATING SYSTEM
 QNK – OPERATIONAL CHILLED WATER SYSTEM

H	E	NSC
F	E	NSC
D	N/A	NSC
B	N/A	NSC
A	N/A	NSC
DESIGN AREA	SSC QUALITY GROUP	SSC SEISMIC CLASS

REV 005
 KLE01T2

Figure 9.4.3-2—Nuclear Auxiliary Building Air Supply and Exhaust Subsystem

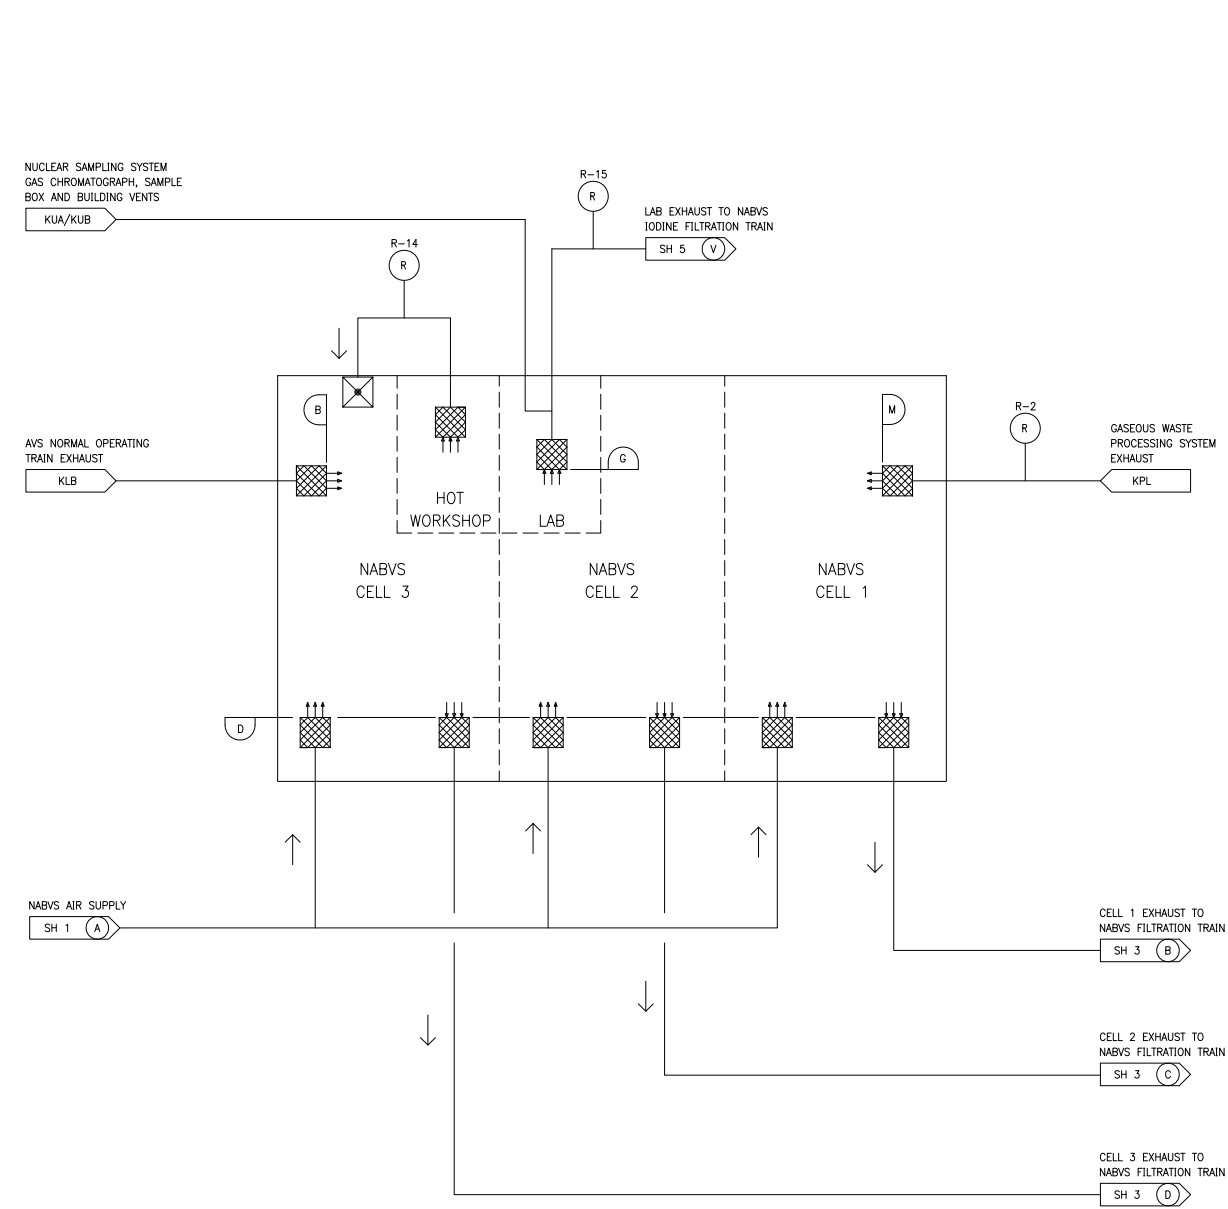


KLE - NUCLEAR AUXILIARY BUILDING VENTILATION SYSTEM
 KLB - ANNULUS VENTILATION SYSTEM
 KPL - GASEOUS WASTE PROCESSING SYSTEM
 KUA/KUB - NUCLEAR SAMPLING SYSTEM

M	N/A	RS
G	N/A	NSC
D	N/A	NSC
B	N/A	NSC
DESIGN AREA	SSC QUALITY GROUP	SSC SEISMIC CLASS


REV 005
 KLE02T2

Figure 9.4.3-3—Nuclear Auxiliary Building Exhaust Filtration Trains Subsystem

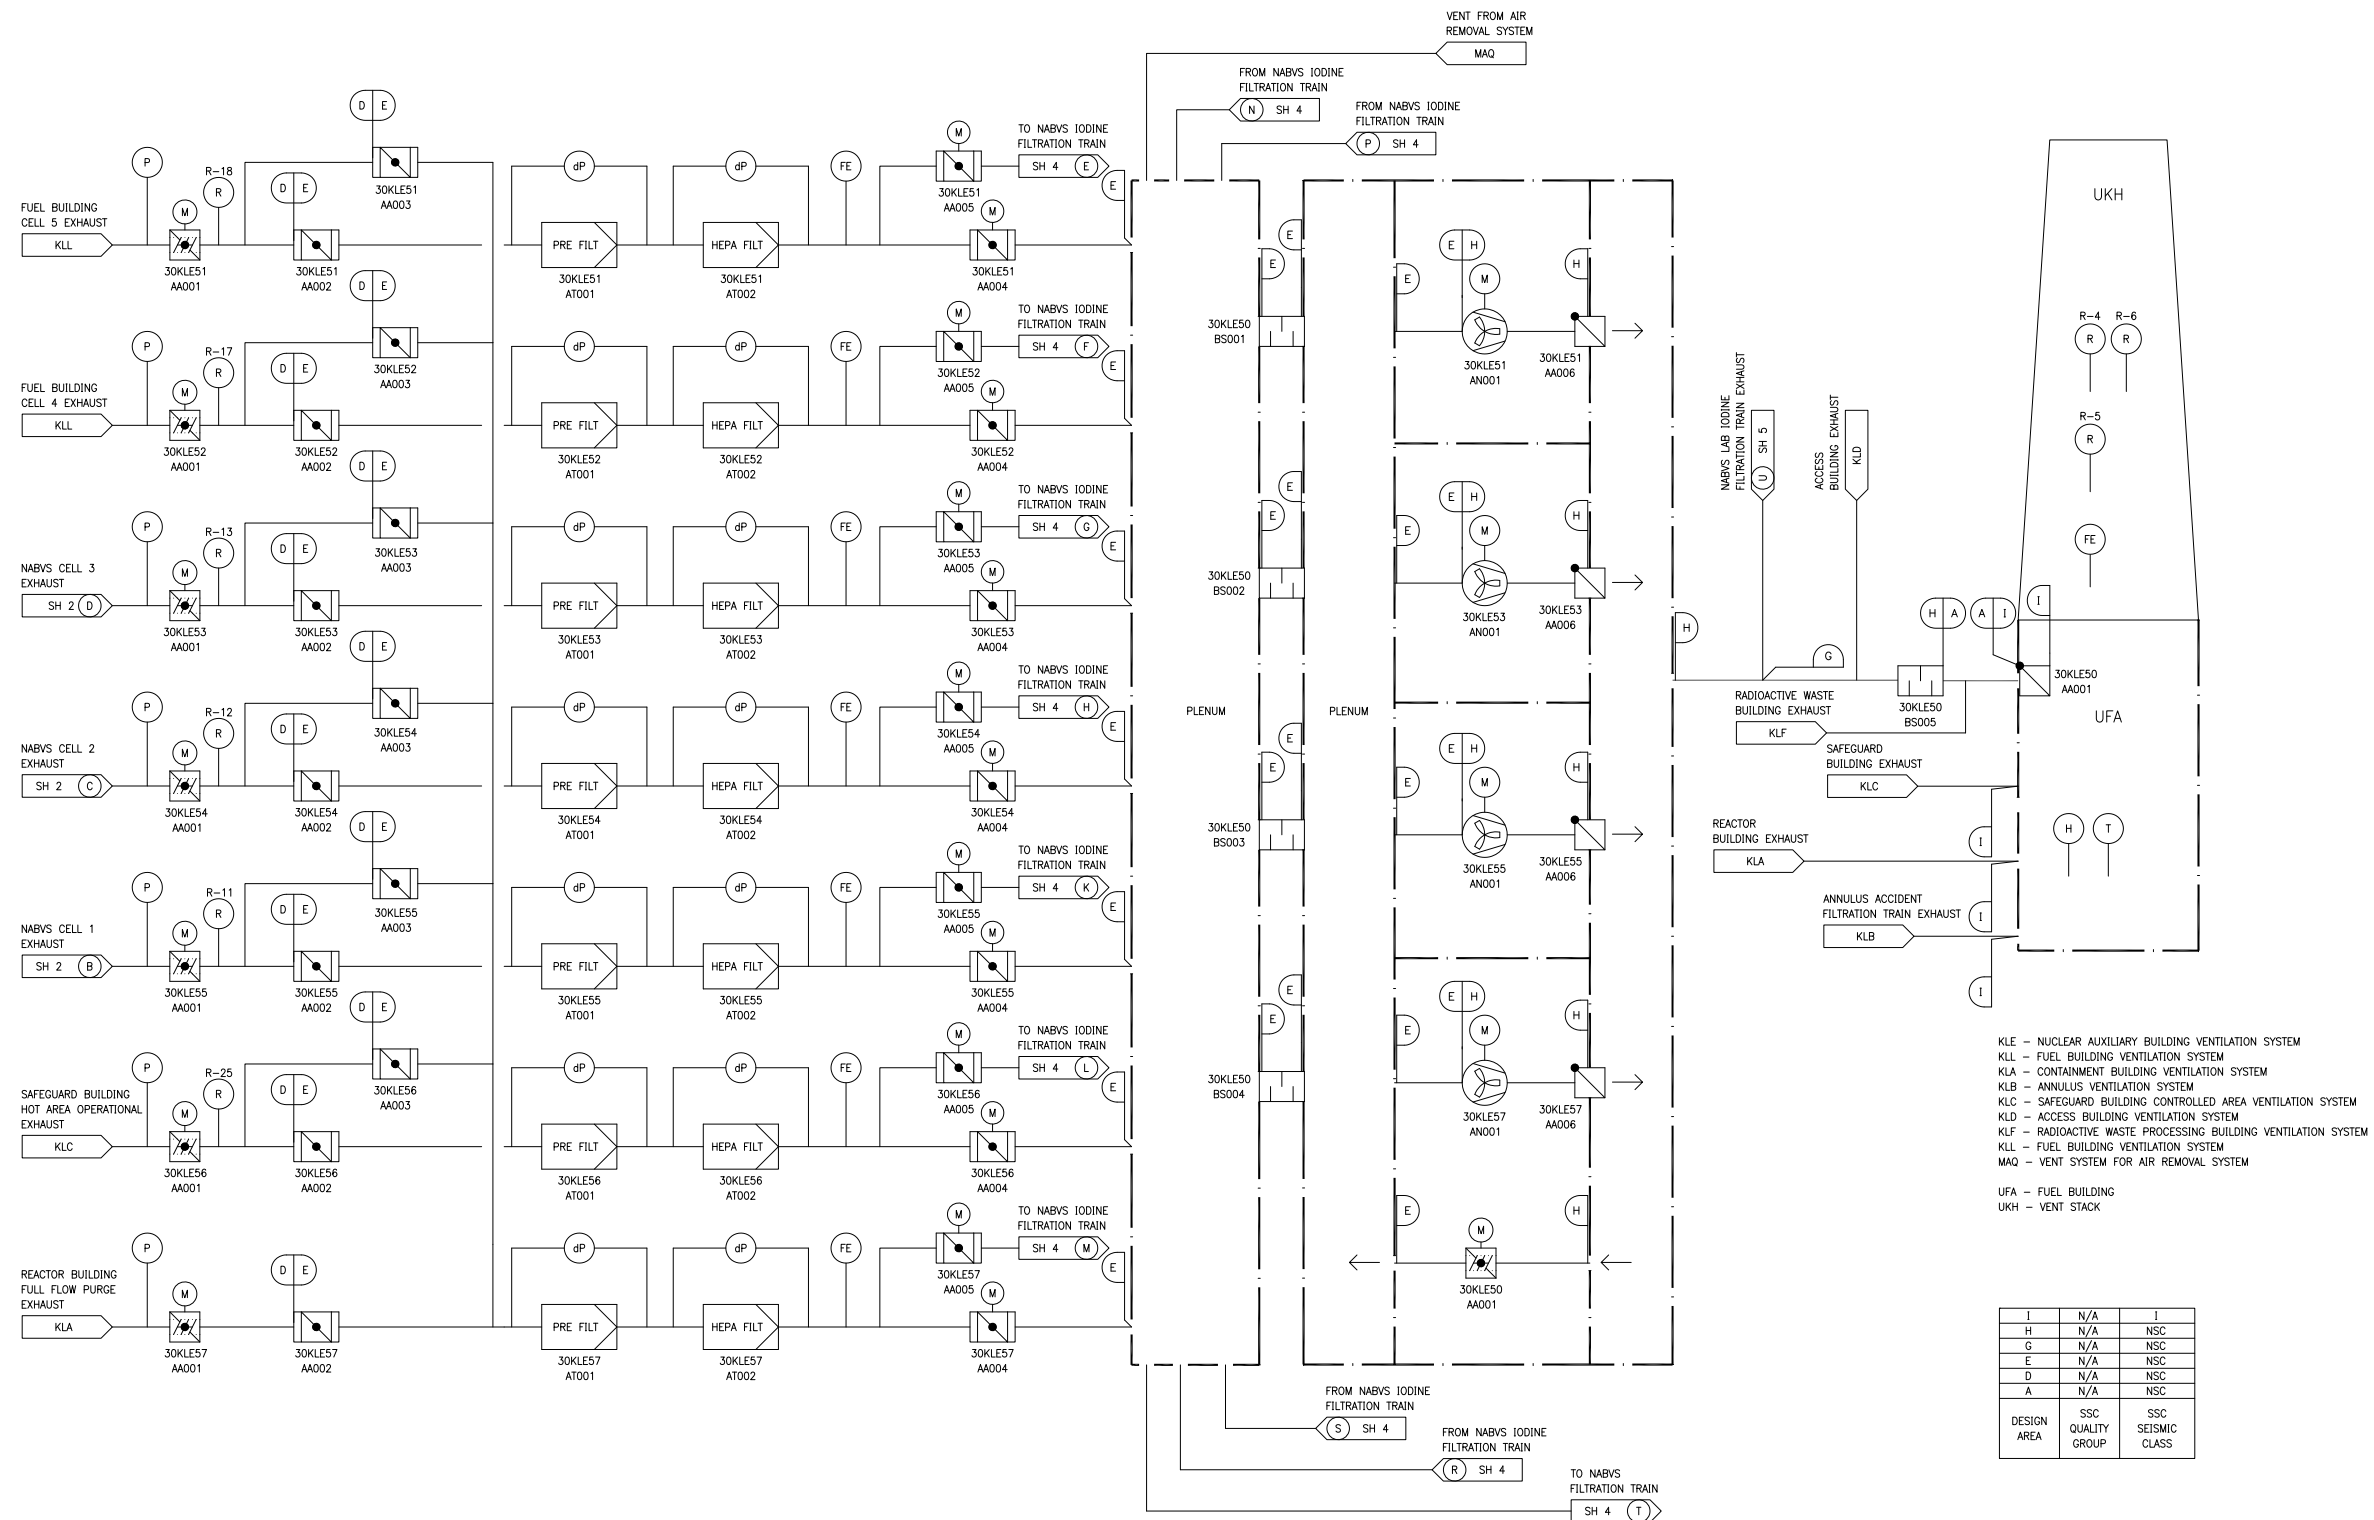

REV 005
KLE03T2


Figure 9.4.3-4—Nuclear Auxiliary Building Exhaust Iodine Filtration Train Subsystem

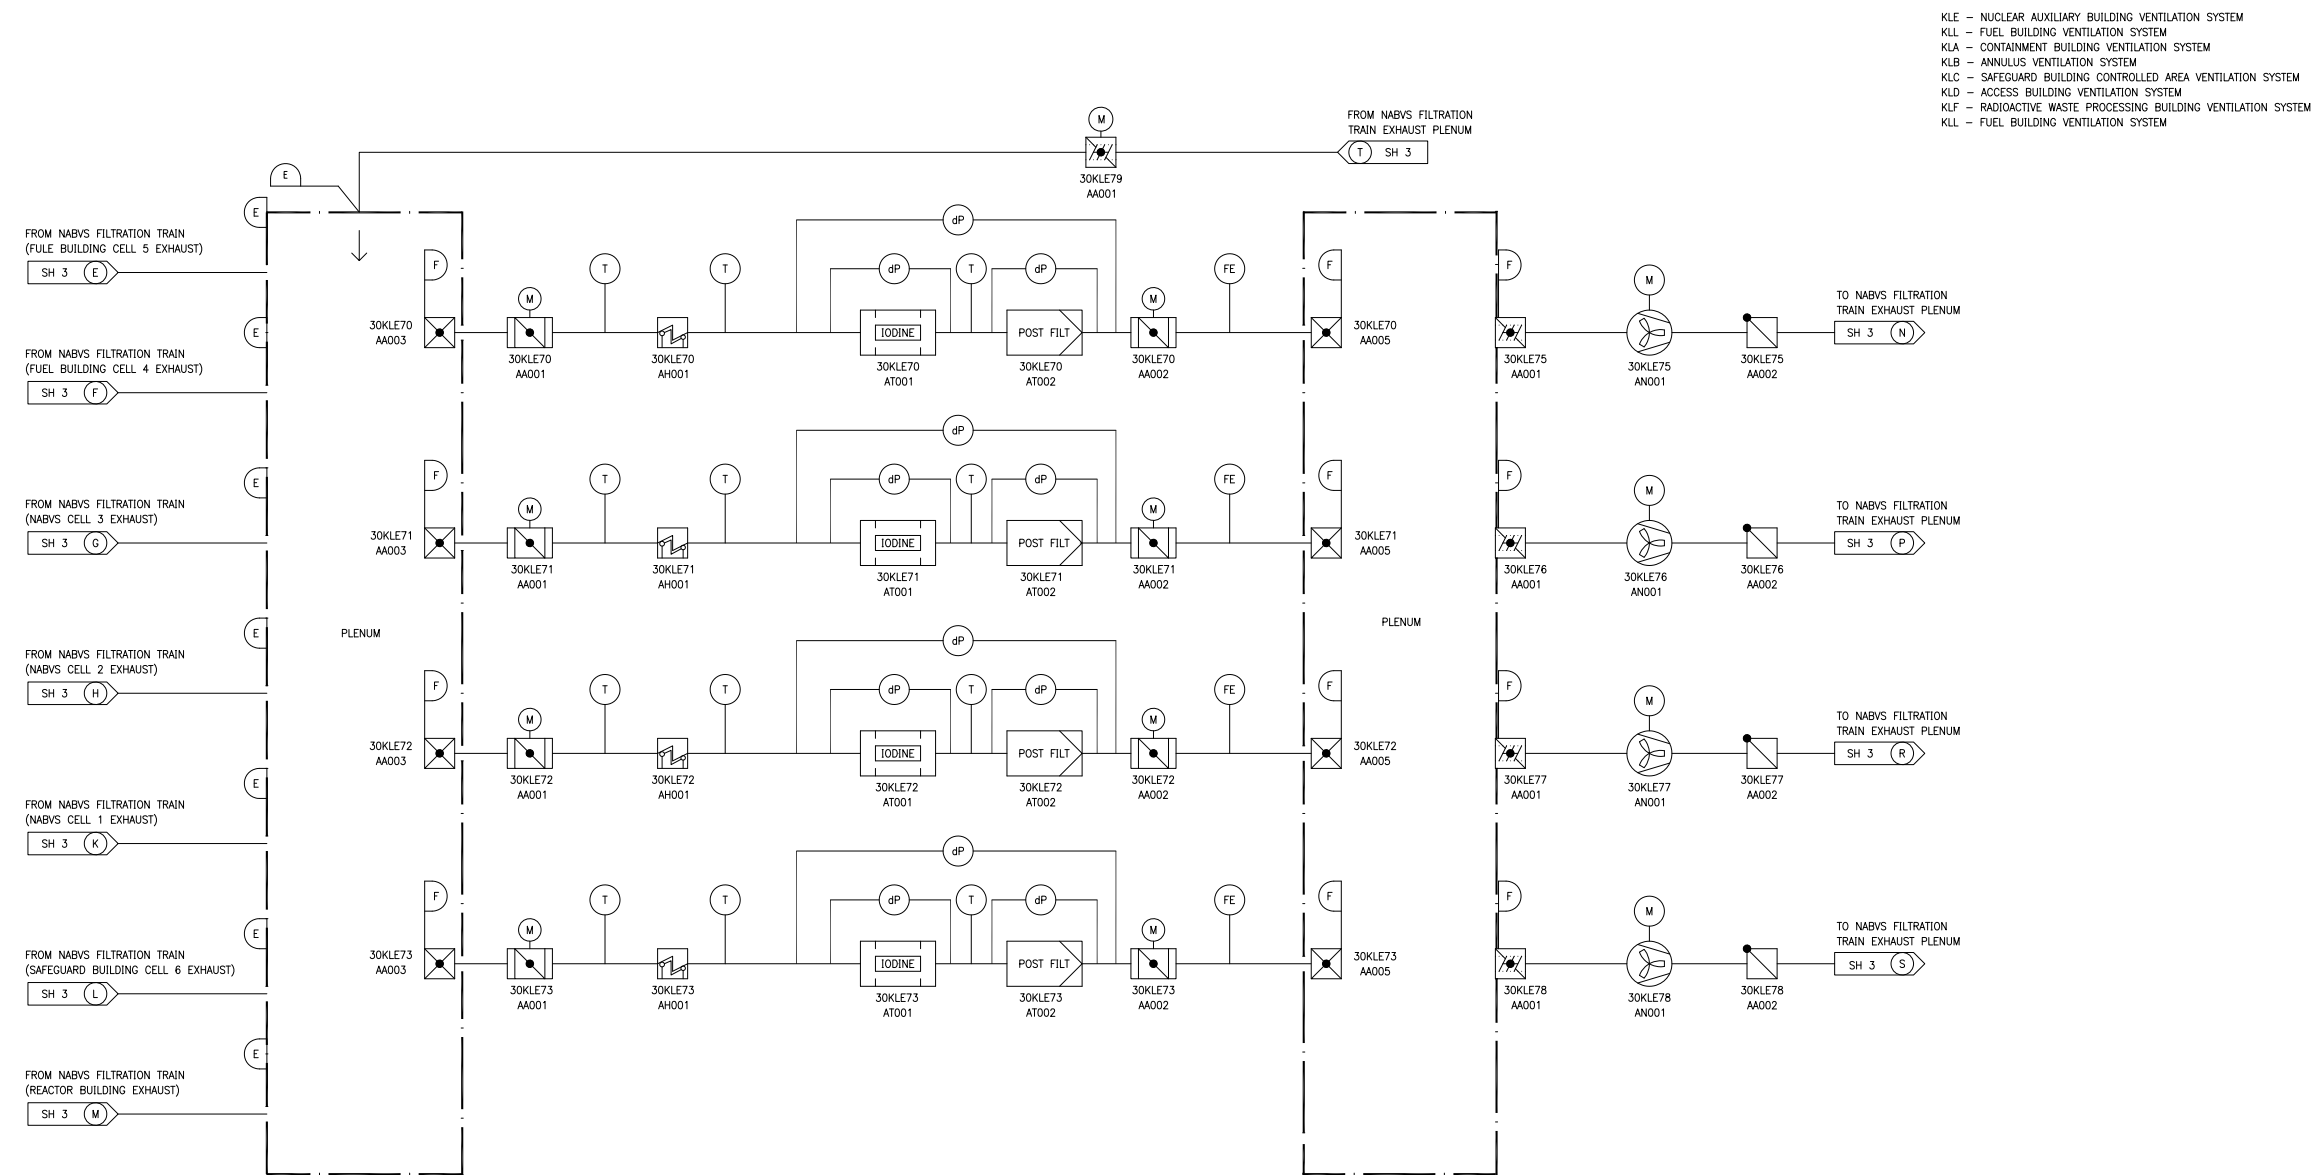

F	N/A	NSC
E	N/A	NSC
DESIGN AREA	SSC QUALITY GROUP	SSC SEISMIC CLASS

REV 005
KLE04T2

Figure 9.4.3-5—Nuclear Auxiliary Building Laboratory Iodine Exhaust Filtration Train

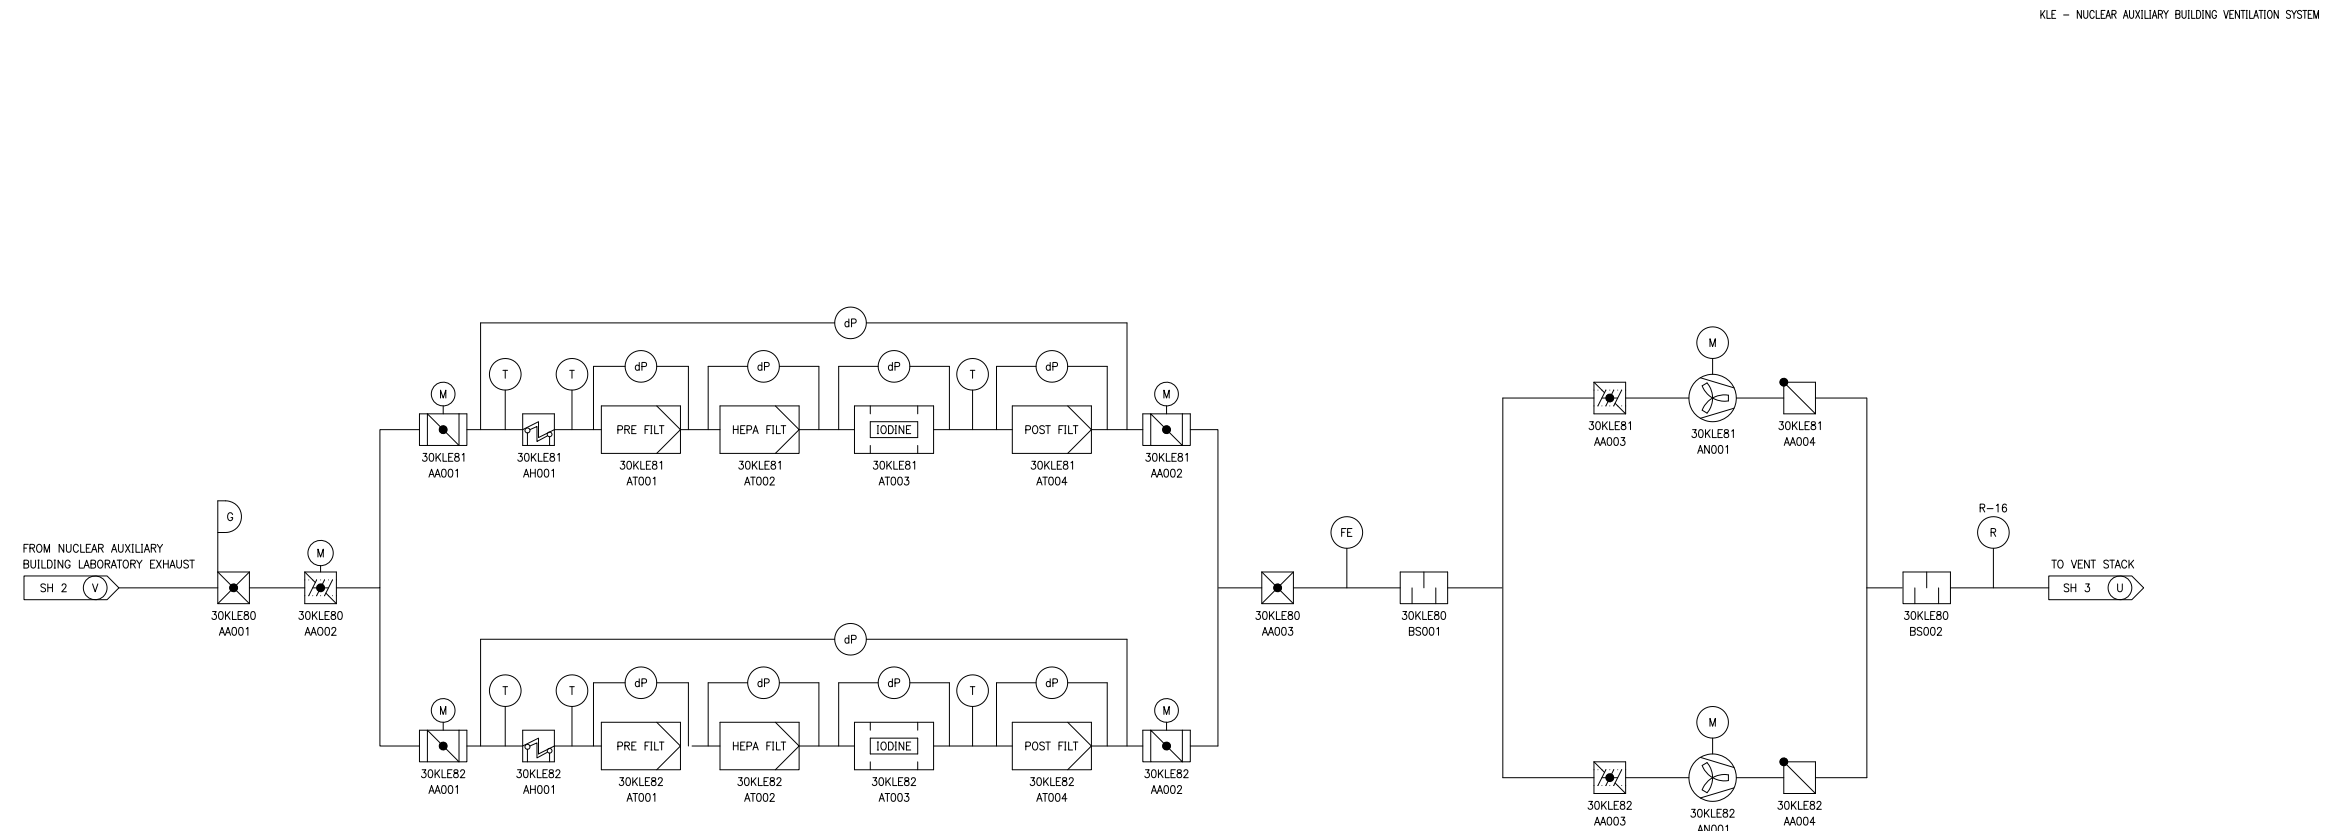

KLE - NUCLEAR AUXILIARY BUILDING VENTILATION SYSTEM

G	N/A	NSC
DESIGN AREA	SSC QUALITY GROUP	SSC SEISMIC CLASS

REV 005
KLE05T2