




REACTOR BUILDINGS

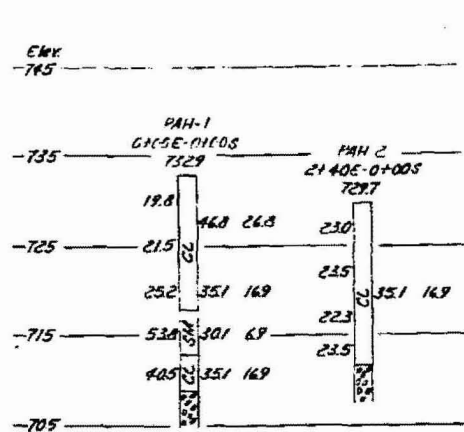


PLANT BUILDINGS

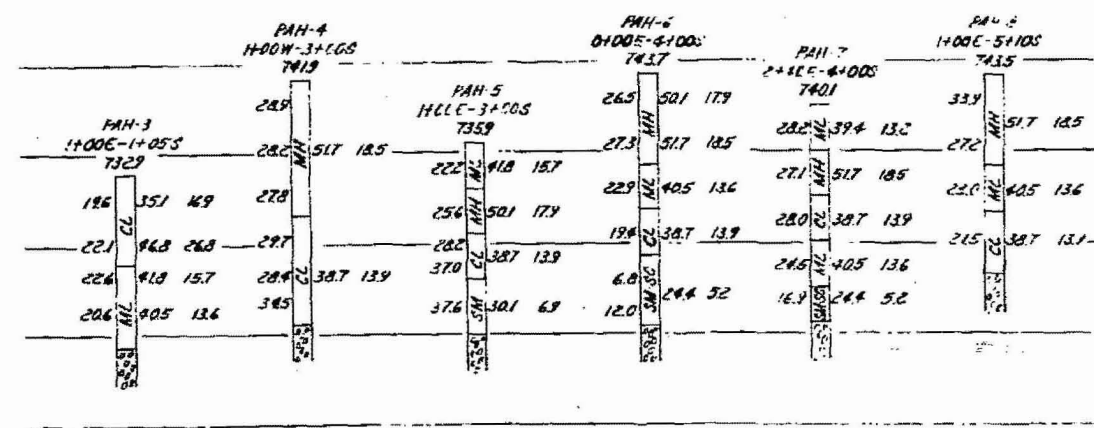


TRANSFORMER YARD & 500 KV SWITCHYARD

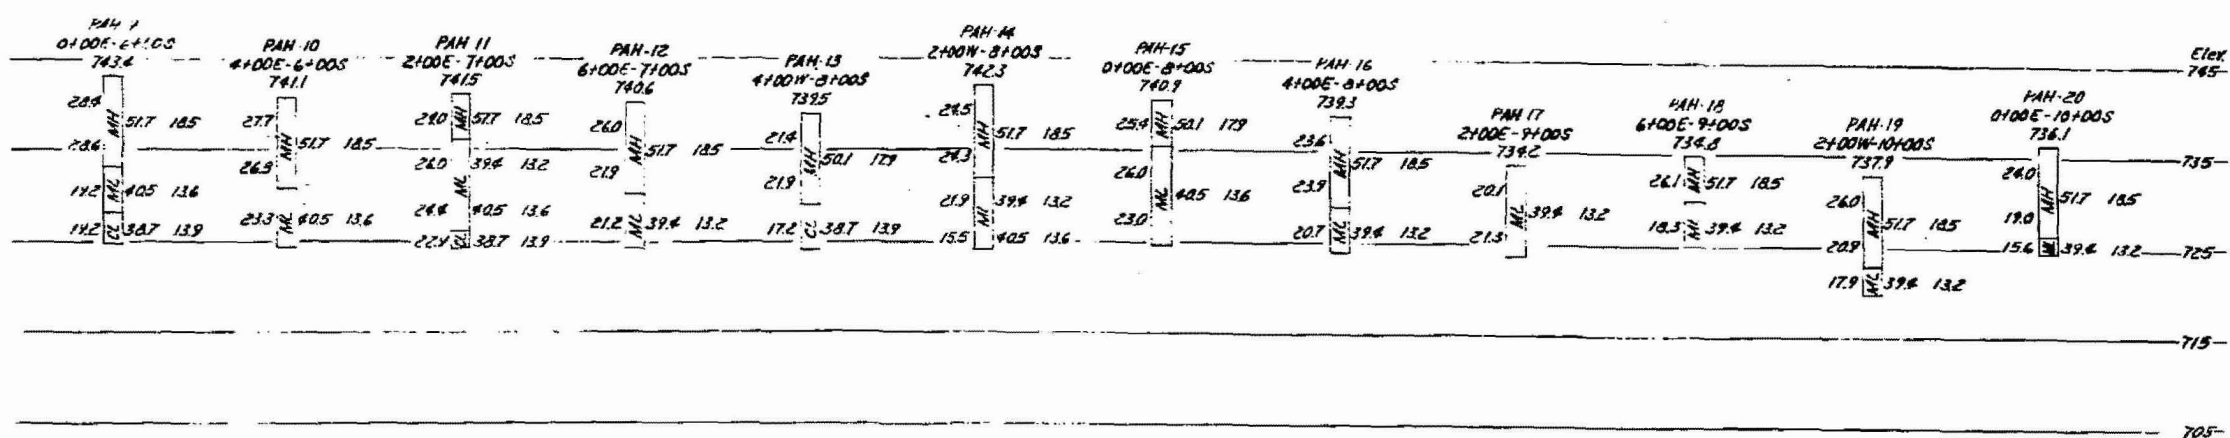

COOLING TOWERS

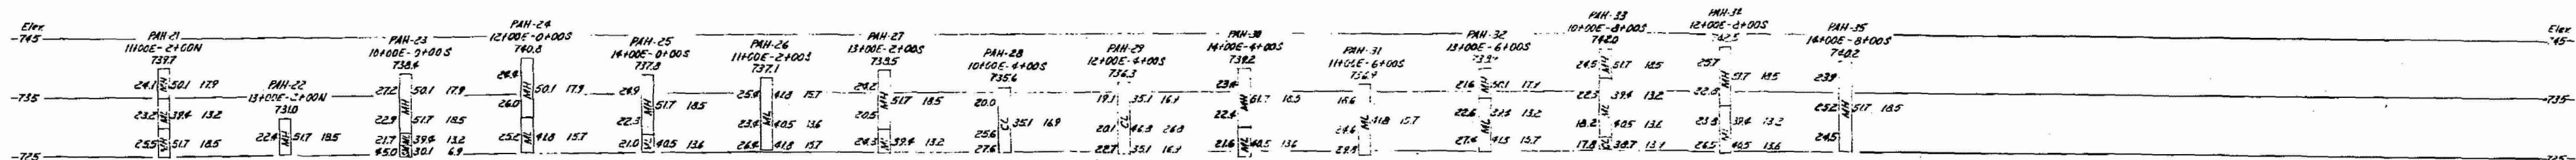

INTAKE CHANNEL

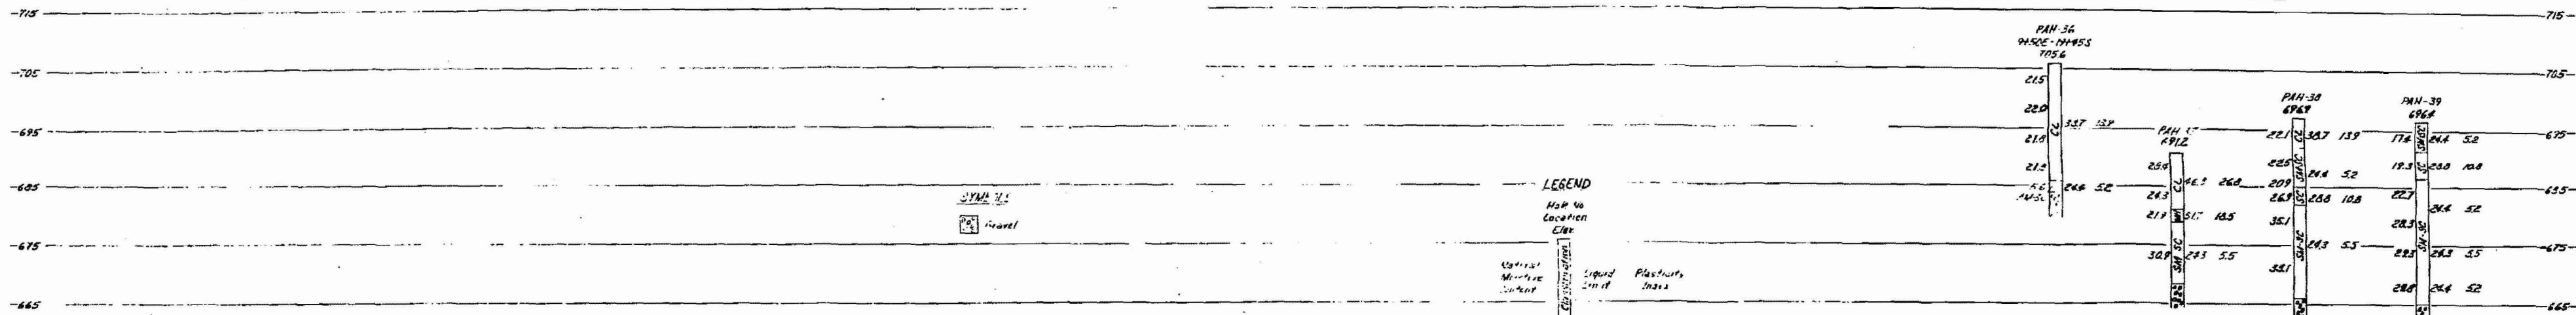

WATTS BAR NUCLEAR PLANT  
FINAL SAFETY  
ANALYSIS REPORT

BORROW INVESTIGATION

Figure 2.5-222