


31

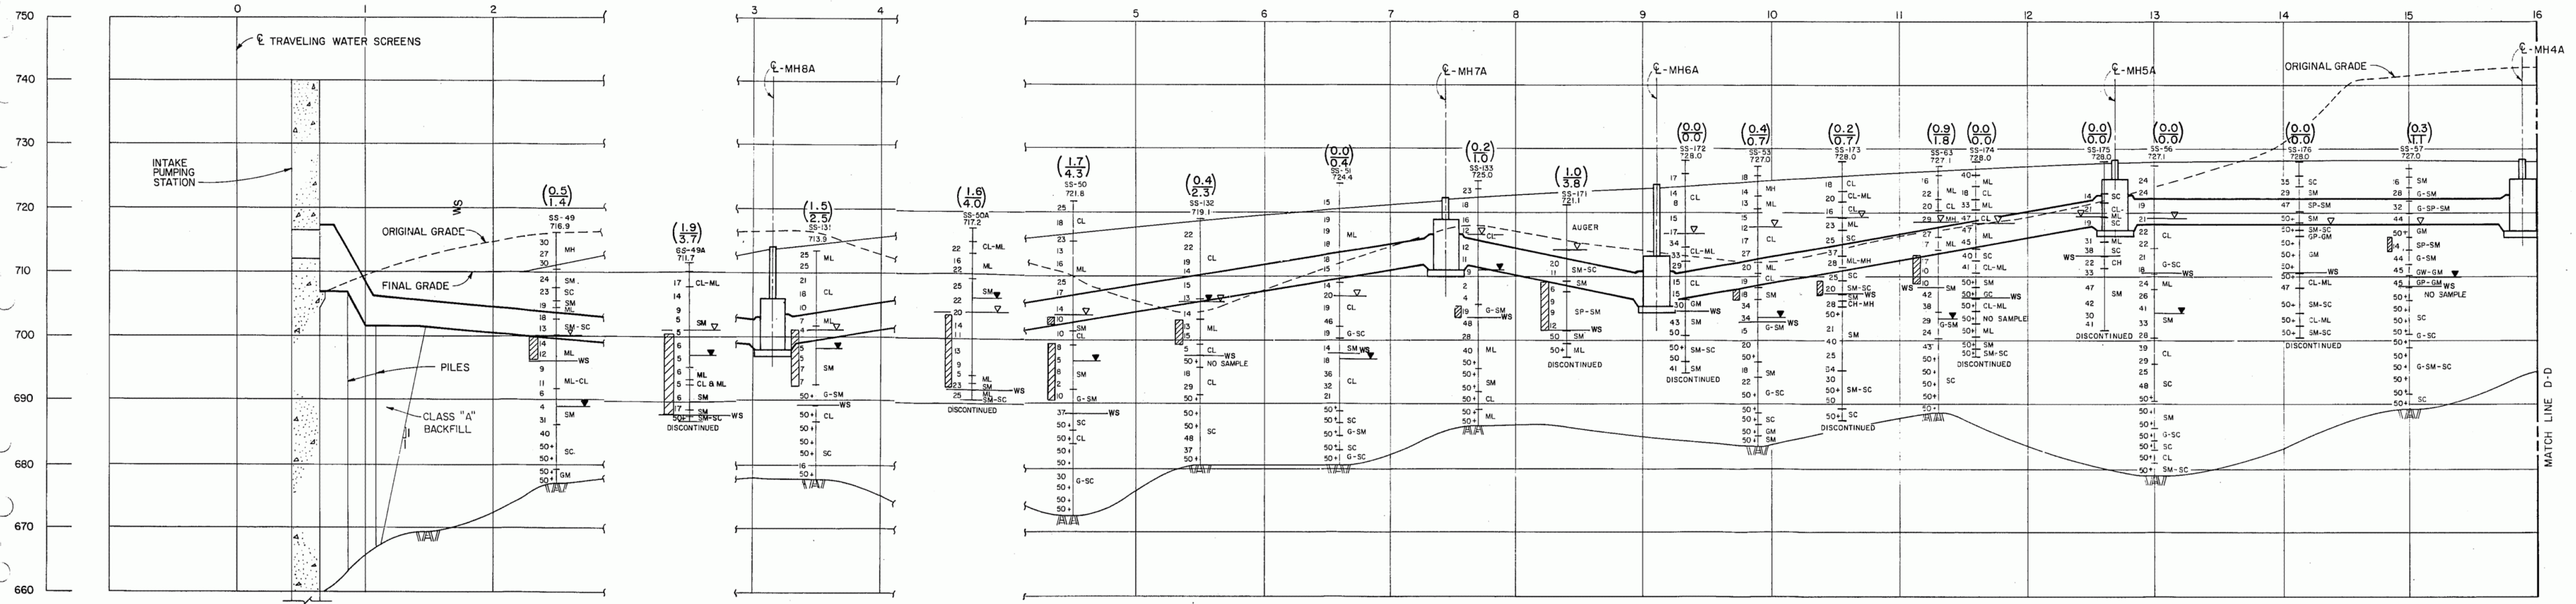

POTENTIAL SETTLEMENT BASED ON 1.5% ϵ CRITERIA (INCHES)
 (0.3)
 POTENTIAL SETTLEMENT BASED ON 6% ϵ CRITERIA (INCHES)
 (1.1)

▽ DESIGN WATER TABLE
 ▼ WATER TABLE (24 HR)
 MH SOIL CLASSIFICATION
 13 BLOW COUNT
 [Hatched Box] POTENTIALLY LIQUEFIABLE SOIL (SEE NOTE)
 -WS WEATHERED SHALE

NOTE:
 1. LIQUEFACTION BASED ON TOP OF GROUND ACCELERATION OF 0.4g AND SEED - IDRISS (1971) CORRELATION FOR SANDS.

Added by Amendment 50

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT
 CATEGORY I ELECTRICAL CONDUITS
 SECTION F - F SHEET 1 OF 2
 FIGURE 2.5-576