

Southern California Edison Company




P. O. BOX 800  
2244 WALNUT GROVE AVENUE  
ROSEMEAD, CALIFORNIA 91770

K. P. BASKIN  
MANAGER, NUCLEAR ENGINEERING  
AND LICENSING

February 4, 1980

TELEPHONE  
(213) 572-1401

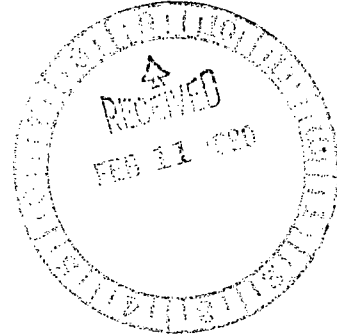

U. S. Nuclear Regulatory Commission  
Region V  
Suite 202, Walnut Creek Plaza  
1990 N. California Boulevard  
Walnut Creek, California 95696

Attention: Mr. R. H. Engelken, Director

Gentlemen:

Subject: IE Bulletin 79-28  
Docket Nos. 50-361 and 50-362  
San Onofre Nuclear Generating Station  
Units 2 and 3

Your letter of December 7, 1979 forwarded the subject bulletin entitled, "Possible Malfunction of NAMCO Model EA180 Limit Switches at Elevated Temperatures."

To date, we have determined that the subject switches are utilized on thirteen valves at San Onofre Units 2 and 3. Our A/E (Bechtel Power Corporation) has initiated action to procure the necessary materials to perform the corrective action prescribed by the bulletin. Additionally, we are awaiting confirmation from other valve manufacturers that the subject switches are not supplied within their respective scopes of supply. Should the manufacturers' response indicate otherwise, the prescribed corrective action will be performed prior to plant operation.

Should you have any questions or require additional clarification, please contact me.

Very truly yours,

*K.P. Baskin*

cc: U. S. Nuclear Regulatory Commission  
Office of Inspection and Enforcement  
Division of Reactor Construction Inspection  
Washington, D. C. 20555

R. Pate, U.S.N.R.C.  
Site Inspector  
San Onofre Units 2 and 3

*AO/E* *60*