

# REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8201220256 DOC. DATE: 82/01/20 NOTARIZED: NO  
 FACIL: 50-361 San Onofre Nuclear Station, Unit 2, Southern California  
 50-362 San Onofre Nuclear Station, Unit 3, Southern California  
 AUTH. NAME: AUTH. AFFILIATION: Southern California Edison Co.  
 DIETCH, R. RECIP. NAME: RECIP. AFFILIATION: Office of Nuclear Reactor Regulation, Director  
 DENION, H. R. EISENHUT, D. G. Division of Licensing

DOCKET #  
 05000361  
 05000362

SUBJECT: Forwards Potential Finding Repts 0020, 0021 & 0025 issued to:  
 Bechtel Power Co & 0027-0030 issued to C-E by SA Co.

DISTRIBUTION CODE: 3001S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 10  
 TITLE: PSAR/FSAR AMDTS and Related Correspondence

NOTES: L Chandler: all FSAR & ER amends. 1 cy: J Hanchett (Region V). 05000361  
 D Scaletti: 1 cy all envir info.  
 L Chandler: all FSAR & ER amends. 1 cy: J Hanchett (Region V). 05000362  
 D Scaletti: 1 cy all envir info.

| ACTION:   | RECIPIENT<br>ID CODE/NAME | COPIES          |      | RECIPIENT<br>ID CODE/NAME | COPIES           |      |   |
|-----------|---------------------------|-----------------|------|---------------------------|------------------|------|---|
|           |                           | LTR             | ENCL |                           | LTR              | ENCL |   |
| ACTION:   | A/D LICENSING             | 1               | 0    | LIC BR #3 BCI             | 1                | 0    |   |
|           | LIC BR #3 LA              | 1               | 0    | RODD, H. 01               | 1                | 1    |   |
| INTERNAL: | ELD                       | 1               | 0    | IE                        | 06               | 3    |   |
|           | IE/DEP/EPDB 35            | 1               | 1    | IE/DEP/EPLB 36            | 3                | 3    |   |
|           | MPA                       | 1               | 0    | NRR/DE/CEB 11             | 1                | 1    |   |
|           | NRR/DE/EPB 13             | 3               | 3    | NRR/DE/GB 28              | 2                | 2    |   |
|           | NRR/DE/HGB 30             | 2               | 2    | NRR/DE/MEB 18             | 1                | 1    |   |
|           | NRR/DE/MTB 17             | 1               | 1    | NRR/DE/OAB 21             | 1                | 1    |   |
|           | NRR/DE/SAB 24             | 1               | 1    | NRR/DE/SEB 25             | 1                | 1    |   |
|           | NRR/DHFS/HFB 40           | 1               | 1    | NRR/DHFS/LB 32            | 1                | 1    |   |
|           | NRR/DHFS/OLB 34           | 1               | 1    | NRR/DHFS/PRB 20           | 1                | 1    |   |
|           | NRR/DSI/AB 26             | 1               | 1    | NRR/DSI/ASB 27            | 1                | 1    |   |
|           | NRR/DSI/CPB 10            | 1               | 1    | NRR/DSI/CSB 09            | 1                | 1    |   |
|           | NRR/DSI/ETB 12            | 1               | 1    | NRR/DSI/ICB 16            | 1                | 1    |   |
|           | NRR/DSI/PSB 19            | 1               | 1    | NRR/DSI/RAB 22            | 1                | 1    |   |
|           | NRR/DSI/RB 23             | 1               | 1    | NRR/DST/LB 33             | 1                | 1    |   |
|           | REG FILE 04               | 1               | 1    |                           |                  |      |   |
|           | EXTERNAL:                 | ACRS 41         | 16   | 16                        | BNL (AMDTS ONLY) | 1    | 1 |
|           |                           | FEMA-REP DIV 39 | 1    | 1                         | LPOR 03          | 1    | 1 |
|           |                           | VRC POR 02      | 1    | 1                         | NSIC 05          | 1    | 1 |
| VTIS      |                           | 1               | 1    |                           |                  |      |   |

TOTAL NUMBER OF COPIES REQUIRED: LTR 64 ENCL 59

*Southern California Edison Company*

**SEE**

P. O. BOX 800

2244 WALNUT GROVE AVENUE

ROSEMEAD, CALIFORNIA 91770

ROBERT DIETCH

VICE PRESIDENT

TELEPHONE

213-572-4144


January 20, 1982

Mr. Harold R. Denton,  
Office of Nuclear Reactor Regulation  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

Attention: Mr. Darrell G. Eisenhut

Dear Mr. Denton:

Subject: Docket Nos. 50-361 and 50-362  
San Onofre Nuclear Generating Station  
Units 2 and 3

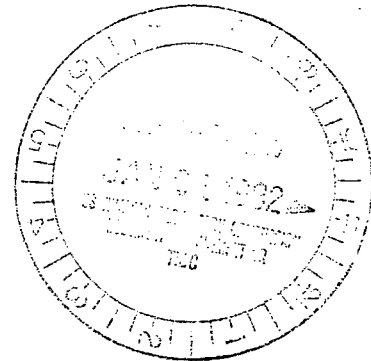

Enclosed are seven copies each of Potential Finding Reports Nos. 0020, 0021 and 0025 issued to Bechtel Power Company, as well as Nos. 0027 through 0030 issued to Combustion Engineering by General Atomic Company. These reports reflect the reviewer's initial opinion and have not been verified for validity and accuracy by the original design organization.

If you have any questions regarding this matter, please call me.

Very truly yours,

*Robert Dietch*

cc: NRC Region V  
R. H. Engelken (with enclosure)

**Boo's**  
**1/1**

8201220256 820120  
PDR ADOCK 05000341  
A PDR

**A**



TORREY PINES TECHNOLOGY

P.O. Box 81608  
San Diego, California 92138  
Telephone: (714) 435-2654

Rcd on Telex 1/19/82  
@ 5:15 P.M.

GEORGE L. WESSMAN  
Director

January 19, 1982

Mr. D. J. Fogarty  
Executive Vice President  
Southern California Edison  
P. O. Box 800  
Rosemead, CA 91770

Dear Mr. Fogarty:

Attached are Potential Finding Reports 2408-PFR-0020, 0021 and 0025.

Sincerely,

*George L. Wessman*  
George L. Wessman  
Project Manager

Enclosures

cc: J. Hempe - Bechtel  
J. Adrian - SCE

THIS POTENTIAL FINDING IS  
UNDER REVIEW BY ORIGINAL  
DESIGN ORGANIZATION FOR  
VALIDITY AND ACCURACY.

POTENTIAL FINDING REPORT  
SONGS 2&3 SEISMIC DESIGN VERIFICATION

PFR NO. 2408-PFR-0020

REVISION \_\_\_\_\_

PREPARATION BY GA INITIATOR

AFFECTED ITEMS: Safety Injection Line to Reactor Coolant Loop 1A, Piping Stress Analysis Package PSG-78. Calculation Sheets for Node 167, Tag No. S2-S1-059-H308.

REQUIREMENT REFERENCE DOCUMENTS:

Specification S023-409-2 "Nuclear Service Pipe Support, Hangers and Accessories for SONGS 2 and 3" Certified 4/24/74, p. 4F-9

BASIC REQUIREMENT:

Allowable stresses under DBE for structural steel at standard temperature shall be 0.9 times the minimum guaranteed yield stresses listed in AISC Spec. 1969.

DESCRIPTION OF POTENTIAL FINDING:

Sheet 3 of the calculation uses  $0.6 F_y \times 0.9 = 19.14$  KSI for allowable bending stress. Sheet 4 uses 13.6 KSI for the allowable shearing stress in the weld. (Material and weld electrode not identified).

PREPARED BY: T.T. Lee

DATE: 1-18-82

REJECTION OF GA TASK LEADER COMMENTS BY: \_\_\_\_\_

DATE: \_\_\_\_\_

REJECTION OF ORIGINAL DESIGN ORG. COMMENTS BY: \_\_\_\_\_

DATE: \_\_\_\_\_

REVIEW BY GA TASK LEADER

COMMENTS

☒ AGREE PF IS VALID

BY FTZ/10/2

DATE 1/15/82

☐ REQUEST RE-REVIEW

BY \_\_\_\_\_

DATE \_\_\_\_\_

☐ DISAGREE

BY \_\_\_\_\_

DATE \_\_\_\_\_

☐ REVIEW OF ORIGINAL DESIGN ORGS. COMMENTS BY: \_\_\_\_\_

DATE: \_\_\_\_\_

POTENTIAL FINDING REPORT  
SONGS 2&3 SEISMIC DESIGN VERIFICATION

PFR NO. 4575-17A-0021  
REVISION - 0021

PREPARATION BY GA INITIATOR

AFFECTED ITEMS: Safety Injection Line to Reactor Coolant Loop 1A, Piping Stress Analysis package PSG-78. Calculation sheets for Node 167. Tag No. S2-SL-059-H008.

REQUIREMENT REFERENCE DOCUMENTS:

Specification S023-409-2, "Nuclear Service, Pipe Support Hangers and Accessories for SONGS 2 & 3", Certified 4/24/74, p. 4F-9.

BASIC REQUIREMENT: Structural Design per AISC Specification. (Feb. 12, 1969)

DESCRIPTION OF POTENTIAL FINDING:

Calculation sheet 4 uses 13.6 KSI for the allowable shearing stress in the weld. In AISC Spec. 1969 the corresponding allowable is 18.0 KSI.

PREPARED BY: T.T.Lee

DATE: 1-18-82

REJECTION OF GA TASK LEADER COMMENTS BY: \_\_\_\_\_

DATE: \_\_\_\_\_

REJECTION OF ORIGINAL DESIGN ORG. COMMENTS BY: \_\_\_\_\_

DATE: \_\_\_\_\_

REVIEW BY GA TASK LEADER

COMMENTS

☒ AGREE PF IS VALID

BY R. J. Lee

DATE 1/18/82

☐ REQUEST RE-REVIEW

BY \_\_\_\_\_

DATE \_\_\_\_\_

☐ DISAGREE

BY \_\_\_\_\_

DATE \_\_\_\_\_

☐ REVIEW OF ORIGINAL DESIGN ORGS. COMMENTS BY: \_\_\_\_\_

DATE: \_\_\_\_\_

POTENTIAL FINDING REPORT  
SONGS 2&3 SEISMIC DESIGN VERIFICATION

PFR NO. 2408-PFR-0025

REVISION -

PREPARATION BY GA INITIATOR

AFFECTED ITEMS: Safety Injection Line to Reactor Coolant Loop 1A, Piping Stress Analysis Package PSG-78. Calculation Sheets for Node 167. Tag No. S2-S1-059-H008

REQUIREMENT REFERENCE DOCUMENTS:

Not Applicable

BASIC REQUIREMENT:

Not Applicable

DESCRIPTION OF POTENTIAL FINDING:

The note on Sheet 1, "Margin of safety in as-built calculations is adequate to accommodate increased loads. Include DCN's 1, 2, 3, 4, 5, & 6" is not substantiated. (DCN5 gives modified dimensions.) Sheet 3 shows an 1% safety margin based on the original dimension and load magnitude. The increase in the maximum horizontal load shown in Sheet 1 is 32%. No discussion on the effect of changed dimension was provided.

PREPARED BY: T. T. Lee DATE: 1/18/82

REJECTION OF GA TASK LEADER COMMENTS BY: DATE:

REJECTION OF ORIGINAL DESIGN ORG. COMMENTS BY: DATE:

REVIEW BY GA TASK LEADER COMMENTS

☒ AGREE PFR IS VALID

BY finer

DATE 1/19/82

☐ REQUEST RE-REVIEW

BY

DATE

☐ DISAGREE

BY

DATE

☐ REVIEW OF ORIGINAL DESIGN ORGS. COMMENTS BY:

DATE:



**TORREY PINES TECHNOLOGY**

P.O. Box 81528  
San Diego, California 92138  
Telephone: (714) 455-2654

*Rec'd on Telex 1/19/82  
c 5:15 P.M.*

**GEORGE L. WESSMAN**  
Director

**January 19, 1982**

**Mr. D. J. Fogarty**  
Executive Vice President  
Southern California Edison  
P. O. Box 800  
Rosemead, CA 91770

Dear Mr. Fogarty:

Attached are Potential Finding Reports 2408-PFR-0027 through  
2408-PFR-0030.

Sincerely,

*George Lj*

George L. Wessman  
Project Manager

Enclosures

cc: V. Hall - CE  
J. Adrian - SCE

THIS POTENTIAL FINDING IS  
UNDER REVIEW BY ORIGINAL  
DESIGN ORGANIZATION FOR  
VALIDITY AND ACCURACY.

POTENTIAL FINDING REPORT  
SONGS 2&3 SEISMIC DESIGN VERIFICATION

PFR NO. 2408-PFR-0027

REVISION \_\_\_\_\_

PREPARATION BY GA INITIATOR

AFFECTED ITEMS: Engineered Safety Features Actuation System Auxiliary Relay Cabinet (2L-34)

REQUIREMENT REFERENCE DOCUMENTS: General Engineering Specification for Engineered Safety Features Actuation System Auxiliary Relay Cabinet, Specification No. 00000-ICE-002, Rev. 04. July 14, 1975, Combustion Engineering, Inc.

BASIC REQUIREMENT: Paragraph 3.2.2.2 of IEEE Standard 344-1971 requires that devices being tested should demonstrate their ability to perform their intended function and sufficient monitoring equipment should be provided to evaluate performance before, during and after the (seismic) test.

DESCRIPTION OF POTENTIAL FINDING: The specification fails to require functional testing of the in-cabinet devices during seismic excitation. It fails to specify whether device contact chatter is acceptable and, if acceptable to specify the maximum acceptable time duration of contact chatter.

PREPARED BY: S. Rodkha

DATE: 1/18/82

REJECTION OF GA TASK LEADER COMMENTS BY: \_\_\_\_\_

DATE: \_\_\_\_\_

REJECTION OF ORIGINAL DESIGN ORG. COMMENTS BY: \_\_\_\_\_

DATE: \_\_\_\_\_

REVIEW BY GA TASK LEADER

COMMENTS

☐ AGREE PFR IS VALID

BY 1507.00

DATE 1/19/82

☐ REQUEST RE-REVIEW

BY \_\_\_\_\_

DATE \_\_\_\_\_

☐ DISAGREE

BY \_\_\_\_\_

DATE \_\_\_\_\_

☐ REVIEW OF ORIGINAL DESIGN ORGS. COMMENTS BY: \_\_\_\_\_

DATE: \_\_\_\_\_



POTENTIAL FINDING REPORT  
SONGS 2&3 SEISMIC DESIGN VERIFICATION

PFR NO. 2402-PFR-0028

REVISION -

PREPARATION: BY GA INITIATOR

AFFECTED ITEMS: Engineered Safety Features Actuation System Auxiliary Relay Cabinet (2L-34)

REQUIREMENT REFERENCE DOCUMENTS: General Engineering Specification for Engineered Safety Features Actuation System Auxiliary Relay Cabinet, Specification No. 00000 -ICE-3002, Rev. 04, July 14, 1975, Combustion Engineering, Inc.

BASIC REQUIREMENT: Paragraph 5.11.1 of the specification states in part that the equipment will be considered Class I seismically qualified if certain requirements are met when the equipment has been subjected to motions of the floor to which the equipment will be mounted.

DESCRIPTION OF POTENTIAL FINDING: The specification does not give the specific RRS to be used nor does it give any references as to where the specific RRS is to be found, although several sub-paragraphs of paragraph 5.11.2 refer in a general way to RRS and TRS and to the need for the TRS to envelope the RRS

PREPARED BY: S. Rodkey DATE: 1-18-82

REJECTION OF GA TASK LEADER COMMENTS BY:

DATE:

REJECTION OF ORIGINAL DESIGN ORG. COMMENTS BY:

DATE:

REVIEW BY GA TASK LEADER

COMMENTS

☒ AGREE PF IS VALID

BY me Figuer

DATE 1/17/82

☐ REQUEST RE-REVIEW

BY \_\_\_\_\_

DATE \_\_\_\_\_

☐ DISAGREE

BY \_\_\_\_\_

DATE \_\_\_\_\_

☐ REVIEW OF ORIGINAL DESIGN ORGS. COMMENTS BY: \_\_\_\_\_

DATE: \_\_\_\_\_

POTENTIAL FINDING REPORT  
SONGS 2&3 SEISMIC DESIGN VERIFICATION

PFR NO. 24CE-PFP-0029

REVISION \_\_\_\_\_

PREPARATION BY GA INITIATOR

AFFECTED ITEMS: Engineered Safety Features Actuation System Auxiliary Relay Cabinet (2L-34)

REQUIREMENT REFERENCE DOCUMENTS: General Engineering Specification for Engineered Safety features Actuation System Auxiliary Relay Cabinet, Specification No 00000-ICE-2002, Rev. 04, July 14, 1975, Combustion Engineering, Inc.

BASIC REQUIREMENT:

Paragraph 5.11.3 of the Specification states in part that functional equipment shall be tested in accordance with Section 5.7.1.

DESCRIPTION OF POTENTIAL FINDING:

Section 5.7.1 does not exist as a part of the specification.

PREPARED BY: Stan Rodkin DATE 1-18-82

REJECTION OF GA TASK LEADER COMMENTS BY: \_\_\_\_\_ DATE: \_\_\_\_\_

REJECTION OF ORIGINAL DESIGN ORG. COMMENTS BY: \_\_\_\_\_ DATE: \_\_\_\_\_

REVIEW BY GA TASK LEADER

COMMENTS

☒ AGREE PF IS VALID

BY one Rodkin

DATE 1/19/82

☐ REQUEST RE-REVIEW

BY \_\_\_\_\_

DATE \_\_\_\_\_

☐ DISAGREE

BY \_\_\_\_\_

DATE \_\_\_\_\_

☐ REVIEW OF ORIGINAL DESIGN ORGS. COMMENTS BY: \_\_\_\_\_

DATE: \_\_\_\_\_

# POTENTIAL FINDING REPORT

## SONGS 2&3 SEISMIC DESIGN VERIFICATION

REVISION -PREPARATION BY GA INITIATOR

AFFECTED ITEMS: Engineered Safety Features Actuation System Auxiliary Relay Cabinet (2L-34)

REQUIREMENT REFERENCE DOCUMENTS: General Engineering Specification for Engineered Safety Features Actuation System Auxiliary Relay Cabinet, Specification No. 00000 -ICE -3002, Rev. 04, July 14, 1975, Combustion Engineering, Inc.

BASIC REQUIREMENT: Paragraph 5.11.2.4 of the specification requires that no major structural resonances below 10 HZ. shall occur. The same paragraph requires that construction of the cabinet shall preclude amplification factors that could result in failure of equipment mounted therein.

DESCRIPTION OF POTENTIAL FINDING: The specification does not require the vendor to consider the anchorage details (embedments) supplied by Bechtel in his analysis or in his test. Consideration of those details might result in amplification factors and natural frequencies outside the specified limits.

PREPARED BY: S. Backin DATE: 1-18-82

REJECTION OF GA TASK LEADER COMMENTS BY: \_\_\_\_\_ DATE: \_\_\_\_\_

REJECTION OF ORIGINAL DESIGN ORG COMMENTS BY: \_\_\_\_\_ DATE: \_\_\_\_\_

REVIEW BY GA TASK LEADER

COMMENTS

☒ AGREE PF IS VALID

BY me

DATE 1/19/82

☐ REQUEST RE-REVIEW

BY \_\_\_\_\_

DATE \_\_\_\_\_

☐ DISAGREE

BY \_\_\_\_\_

DATE \_\_\_\_\_

☐ REVIEW OF ORIGINAL DESIGN ORGS. COMMENTS BY: \_\_\_\_\_

DATE: \_\_\_\_\_