

Southern California Edison Company



P. O. BOX 800
2244 WALNUT GROVE AVENUE
ROSEMEAD, CALIFORNIA 91770

May 31, 1979

K. P. BASKIN
MANAGER, GENERATION ENGINEERING

TELEPHONE
213-572-1401

Director, Office of Nuclear Reactor Regulation
Attention: Mr. D. G. Eisenhut
Assistant Director for
Systems and Projects
Division of Operating Reactors
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Gentlemen:

Subject: Docket No. 50-206
Provisional Operating License No. DPR-13
Amendment No. 77
San Onofre Nuclear Generating Station
Unit 1

By letter dated April 18, 1979, we submitted Amendment No. 77 in Docket No. 50-206. Amendment No. 77 consists of Proposed Change No. 77 to the Technical Specifications incorporated into the above-numbered license. Figures 6.2.2.2 and 5.2-2 of Proposed Change No. 77 reflects San Onofre Unit 1 reorganization changes.

The purpose of this letter is to inform you that several corrections are required to Figures 6.2.2.2 and 5.2-2 to accurately reflect the San Onofre Unit 1 operating staff. These corrections are as follows:

1. Chem Rad Protection is replaced by Technicians, and
2. Instrument Test Technicians is replaced by Technicians.

As requested by members of your staff, enclosed are forty copies of each of the corrected Figures 6.2.2.2 and 5.2-2 which supersede the corresponding figures of Proposed Change No. 77.

If you have any questions or desire further information concerning the enclosed figures, please contact me.


Very truly yours,

KP Baskin

*Acc'd
5/1*

Enclosures

7906040 167

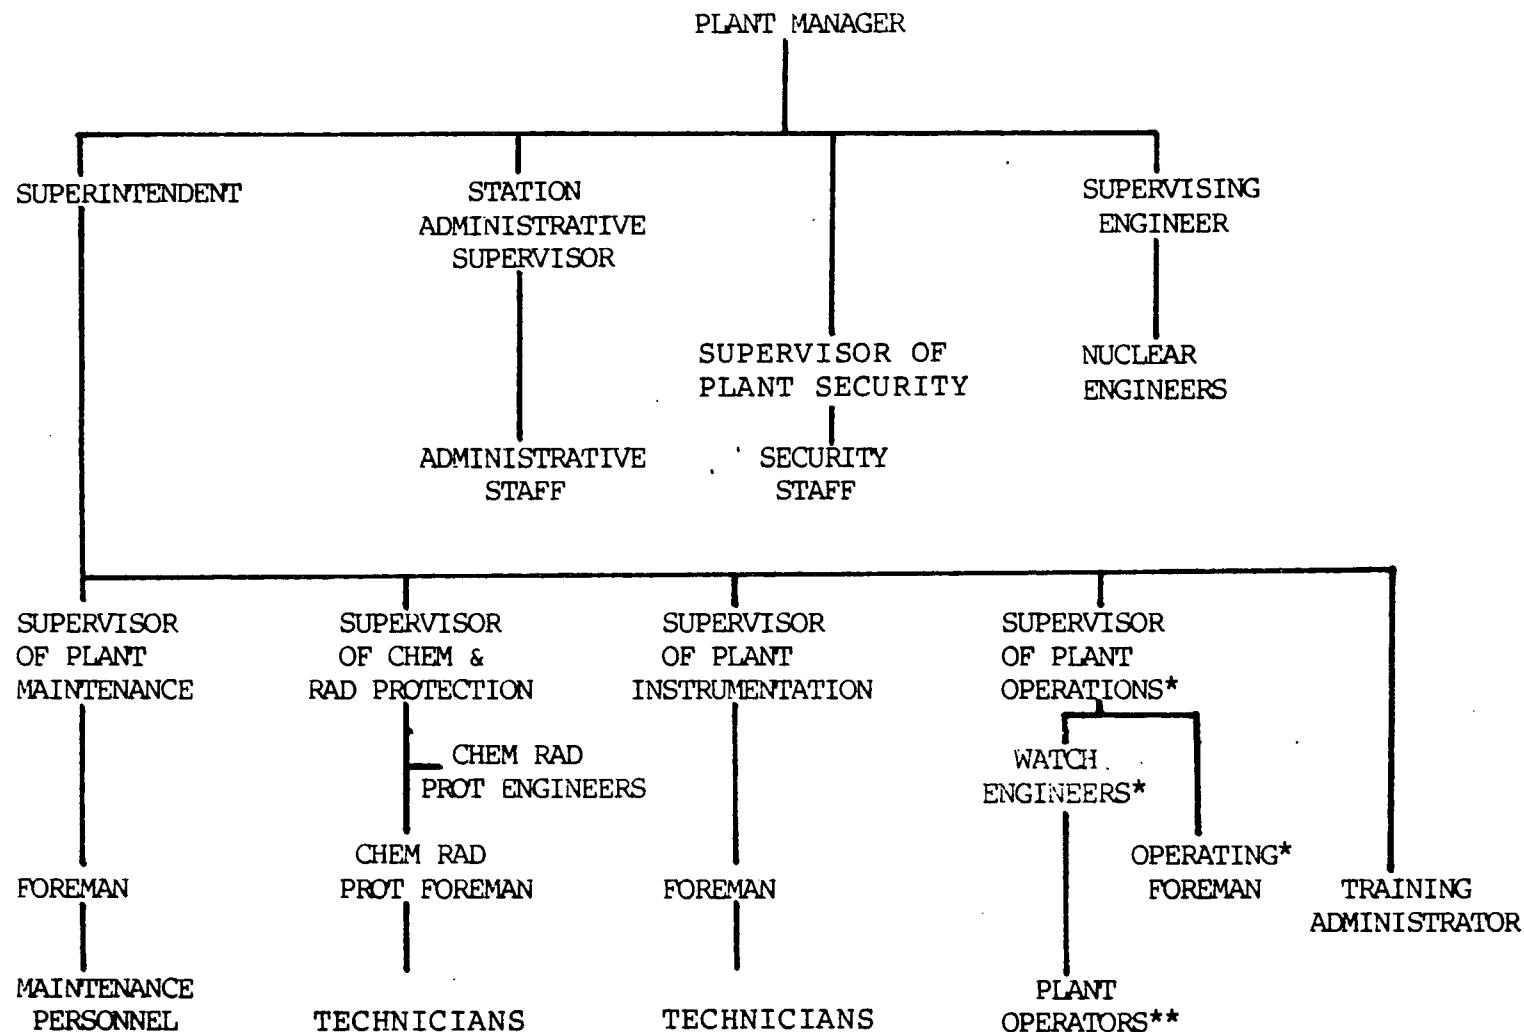


* Senior Reactor Operator License Required

** Control and Assistant Control Operators are holders of Reactor Operator Licenses

FIGURE 5.2-2 SAN ONOFRE NUCLEAR GENERATING STATION (UNIT 1) ORGANIZATION

FIGURE 6.2.2.2
FACILITY ORGANIZATION

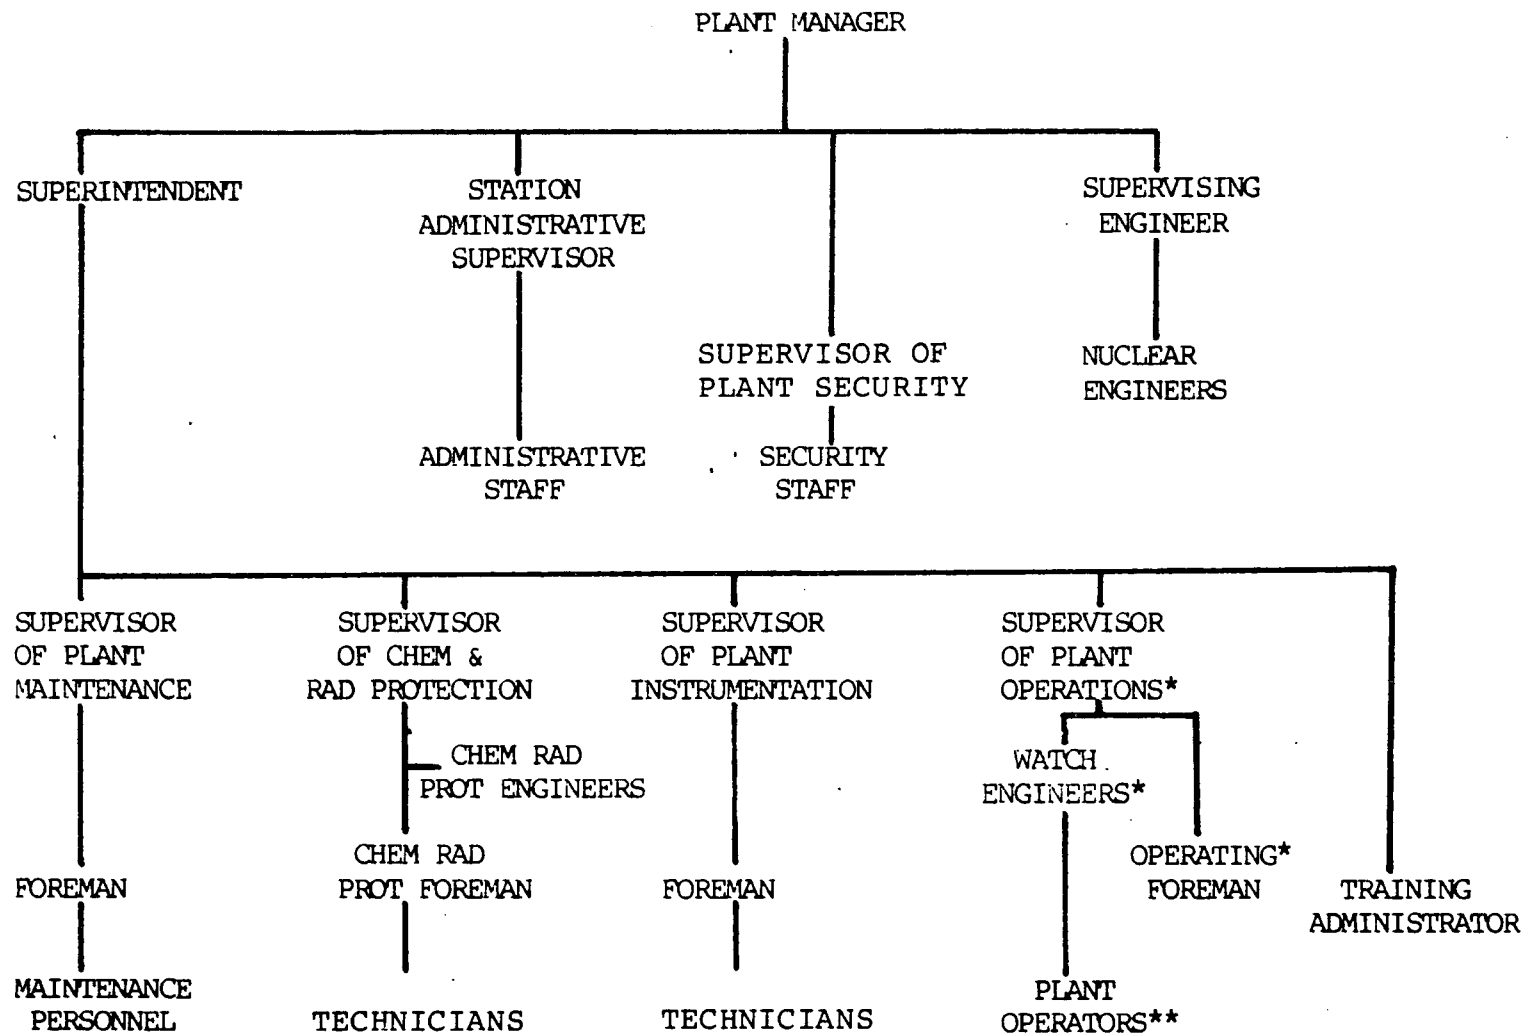

* Senior Reactor Operator License Required

** Control and Assistant Control Operators are holders of Reactor Operator Licenses