

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8202110098 DOC. DATE: 82/02/09 NOTARIZED: NO DOCKET #
 FACIL: 50-361 San Onofre Nuclear Station, Unit 2, Southern California 05000361
 50-362 San Onofre Nuclear Station, Unit 3, Southern California 05000362
 AUTH. NAME AUTHOR AFFILIATION
 BASKIN, K.P. Southern California Edison Co.
 RECIP. NAME RECIPIENT AFFILIATION
 MIRAGLIA, F. Licensing Branch 3

SUBJECT: Forwards Pump Relief Request 4 revising 801006 inservice testing program. Statistical pump failure rate justifies quarterly surveillance testing. Auxiliary feedwater pumps will be tested monthly per Tech Spec. FSAR to be updated.

DISTRIBUTION CODE: B001S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2
 TITLE: PSAR/FSAR AMDTS and Related Correspondence

NOTES: L Chandler: all FSAR & ER amends. 1 cy: J Hanchett (Region V). 05000361
 D Scaletti: 1 cy all envir info.
 L Chandler: all FSAR & ER amends. 1 cy: J Hanchett (Region V). 05000362
 D Scaletti: 1 cy all envir info.

ACTION:	RECIPIENT ID CODE/NAME	COPIES		RECIPIENT ID CODE/NAME	COPIES		
		LTTR	ENCL		LTTR	ENCL	
ACTION:	A/D LICENSNG	1	0	LIC BR #3 BC	1	0	
	LIC BR #3 LA	1	0	ROOD, H. 01	1	1	
INTERNAL:	ELD	1	0	IE	06	3	
	IE/DEP/EPDB 35	1	1	IE/DEP/EPLB 36	3	3	
	MPA	1	0	NRR/DE/CEB 11	1	1	
	NRR/DE/eqb 13	3	3	NRR/DE/GB 28	2	2	
	NRR/DE/HGEB 30	2	2	NRR/DE/MEB 18	1	1	
	NRR/DE/MTEB 17	1	1	NRR/DE/QAB 21	1	1	
	NRR/DE/SAB 24	1	1	NRR/DE/SEB 25	1	1	
	NRR/DHFS/HFEB40	1	1	NRR/DHFS/LQB 32	1	1	
	NRR/DHFS/OLB 34	1	1	NRR/DHFS/PTRB20	1	1	
	NRR/DSI/AEB 26	1	1	NRR/DSI/ASB 27	1	1	
	NRR/DSI/CPB 10	1	1	NRR/DSI/CSB 09	1	1	
	NRR/DSI/ETSB 12	1	1	NRR/DSI/ICSB 16	1	1	
	NRR/DSI/PSB 19	1	1	NRR/DSI/RAB 22	1	1	
	NRR/DSI/RSB 23	1	1	NRR/DST/LGB 33	1	1	
	REG FILE	04	1				
	EXTERNAL:	ACRS 41	16	16	BNL (AMDTS ONLY)	1	1
		FEMA-REP DIV 39	1	1	LPDR 03	1	1
		NRC PDR 02	1	1	NSIC 05	1	1
NTIS		1	1				

TOTAL NUMBER OF COPIES REQUIRED: LTTR 64 ENCL 59

64

59

RG

Southern California Edison Company

SCE


P. O. BOX 800
2244 WALNUT GROVE AVENUE
ROSEMEAD, CALIFORNIA 91770

K. P. BASKIN
MANAGER OF NUCLEAR ENGINEERING,
SAFETY, AND LICENSING

February 9, 1982

TELEPHONE
(213) 572-1401

Director, Office of Nuclear Reactor Regulation
Attention: Mr. Frank Miraglia, Branch Chief
Licensing Branch No. 3
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

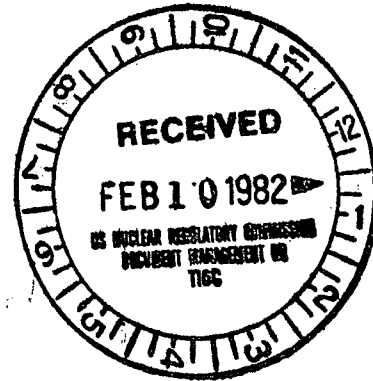

Gentlemen:

Subject: Docket Nos. 50-361 and 50-362
San Onofre Nuclear Generating Station
Units 2 and 3

Enclosed are seven (7) copies of Pump Relief Request No. 4, which is a revision to the Inservice Testing Program submitted to the NRC by letter dated October 6, 1980.

Section 1.8 of the FSAR will be updated to reflect the submittal of this change to the Inservice Testing Program; however, additional copies will not be provided.

Please let me know if you have any questions.

Very truly yours,

R. Krueger
for KPBaskin

Enclosures

cc: H. Rood (W/encl) (To be opened by addressee only)

Boo!
5/1

8202110098 820209
PDR ADOCK 05000361
A PDR

PUMP RELIEF REQUEST NO. 4

SYSTEM: Safety Related Systems

COMPONENT All pumps in the program

CLASS: Class 2 and 3

FUNCTION: To provide flow to safety systems

TEST
REQUIREMENT: An inservice test shall be run on each pump nominally each month during normal plant operation.

BASIS
FOR RELIEF: Relief is requested from the requirements of IWP-2300(a) regarding monthly testing of each pump. The experience of the industry has shown that the statistical failure rate of these pumps is such that monthly surveillance testing is not justified. The statistics do, however justify testing on a quarterly basis. Later editions of the code infer these findings by allowing surveillance to occur on a quarterly period.

ALTERNATE
TESTING: Inservice testing shall be accomplished on each pump at least once every 3 months. The exception to this will be the Auxiliary Feedwater pumps they will be tested monthly per Technical Specification requirements.