

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION # 8202160499 DOC. DATE: 82/02/11 NOTARIZED: NO DOCKET #
 FACIL: 50-361 San Onofre Nuclear Station, Unit 2, Southern Californ 05000361
 50-362 San Onofre Nuclear Station, Unit 3, Southern Californ 05000362
 AUTH. NAME AUTHOR AFFILIATION
 BASKIN, K. P. Southern California Edison Co.
 RECIP. NAME RECIPIENT AFFILIATION
 MIRAGLIA, F. Licensing Branch 3

SUBJECT: Forwards info identifying effluent monitoring capability for
 turbine driven auxiliary feedwater pump exhaust, in response
 to NRC 820210 request. Monitoring of subj path is also
 addressed in util NUREG-0737, Item II.F.1 response.

DISTRIBUTION CODE: B001S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2
 TITLE: PSAR/FSAR AMDTS and Related Correspondence

NOTES: L Chandler: all FSAR & ER amends. 1 cy: J Hanchett (Region V). 05000361
 D Scaletti: 1 cy all envir info.
 L Chandler: all FSAR & ER amends. 1 cy: J Hanchett (Region V). 05000362
 D Scaletti: 1 cy all envir info.

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTTR	ENCL		ID CODE/NAME		LTTR	ENCL
ACTION:	A/D LICENSNG		1	0		LIC BR #3 BC		1	0
	LIC BR #3 LA		1	0		ROOD, H. 01		1	1
INTERNAL:	ELD		1	0		IE	06	3	3
	IE/DEP/EPDB 35		1	1		IE/DEP/EPLB 36		3	3
	MPA		1	0		NRR/DE/CEB 11		1	1
	NRR/DE/eqB 13		3	3		NRR/DE/GB 28		2	2
	NRR/DE/HGEB 30		2	2		NRR/DE/MEB 18		1	1
	NRR/DE/MTEB 17		1	1		NRR/DE/QAB 21		1	1
	NRR/DE/SAB 24		1	1		NRR/DE/SEB 25		1	1
	NRR/DHFS/HFEB 40		1	1		NRR/DHFS/LQB 32		1	1
	NRR/DHFS/OLB 34		1	1		NRR/DHFS/PTRB 20		1	1
	NRR/DSI/AEB 26		1	1		NRR/DSI/ASB 27		1	1
	NRR/DSI/CPB 10		1	1		NRR/DSI/CSB 09		1	1
	NRR/DSI/ETSB 12		1	1		NRR/DSI/ICSB 16		1	1
	NRR/DSI/PSB 19		1	1		NRR/DSI/RAB 22		1	1
	NRR/DSI/RSB 23		1	1		NRR/DST/LGB 33		1	1
	REG FILE 04		1	1					
EXTERNAL:	ACRS	41	16	16		BNL (AMDTS ONLY)		1	1
	FEMA-REP DIV 39		1	1		LPDR 03		1	1
	NRC PDR 02		1	1		NSIC 05		1	1
	NTIS		1	1					

TOTAL NUMBER OF COPIES REQUIRED: LTTR

ENCL

64

59

W

Southern California Edison Company



P. O. BOX 800
2244 WALNUT GROVE AVENUE
ROSEMEAD, CALIFORNIA 91770

K. P. BASKIN
MANAGER OF NUCLEAR ENGINEERING,
SAFETY, AND LICENSING

TELEPHONE
(213) 572-1401

February 11, 1982

Director, Office of Nuclear Reactor Regulation
Attention: Mr. Frank Miraglia, Branch Chief
Licensing Branch No. 3
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

Gentlemen:

Subject: Docket Nos. 50-361 and 50-362
San Onofre Nuclear Generating Station
Units 2 and 3


During a recent conversation with the NRC, Effluent Treatment Systems Branch (ETSB) reviewer (Mr. T. Chandrasekaran) on February 10, 1982, it was requested that SCE identify effluent monitoring capability for the turbine driven auxiliary feedwater pump exhaust.

The enclosure provides formal documentation of information which was previously provided to the NRC ETSB reviewer and satisfies all NRC concerns relative to this issue.

If you have any questions or comments, please let me know.

Very truly yours,

KP Baskin

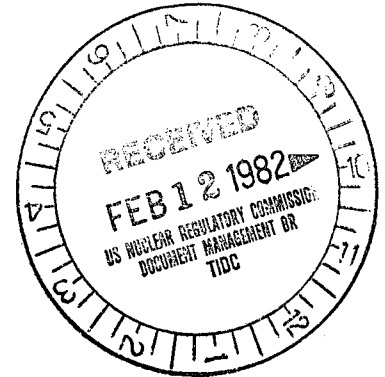

Boo1
s
1/1

8202160499 820211
PDR ADDCK 05000361
A PDR

ENCLOSURE TO FEBRUARY 11, 1982 LETTER

EFFLUENT MONITORING OF AUXILIARY FEEDWATER PUMP TURBINE EXHAUST

The turbine-driven auxiliary feedwater pump draws steam from the main steam lines, upstream of the main steam isolation valves and exhausts from the tank building roof. This pump is operated once per month (during power operation) for inservice testing and for a few hours each normal plant shutdown. Although the pump would be actuated for emergency feedwater, it would be automatically isolated from a ruptured steam generator. Monitoring of this infrequent effluent path is provided by the main steam line area monitors as described in our NUREG-0737 Item II.F.1 response. As recognized by NUREG-0737 Item II.F.1, direct noble gas, iodine and particulate monitoring of live steam releases is not possible. It is noted that the condenser air ejector monitor may also be used to estimate the noble gas releases through the auxiliary feedwater pump turbine pathway. Iodine and particulate monitoring is not required.