

Southern California Edison Company



P. O. BOX 800
2244 WALNUT GROVE AVENUE
ROSEMEAD, CALIFORNIA 91770

M. O. MEDFORD
MANAGER, NUCLEAR LICENSING

July 29, 1985

TELEPHONE
(818) 302-1749

Director, Office of Nuclear Reactor Regulation
Attention: Mr. George W. Knighton, Branch Chief
Licensing Branch No. 3
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

Gentlemen:

Subject: Docket Nos. 50-206, 50-361 and 50-362
San Onofre Nuclear Generating Station
Units 1, 2 and 3

On February 11, 1985, SCE transmitted Revision 1 of the Updated Fire Hazards Analysis (FHA) for San Onofre Nuclear Generating Station Units 1, 2 and 3 (SONGS 1, 2 and 3) to the NRC. This submittal was in accordance with the requirements of 10 CFR 50.71(e).

Figure 8-16, Sheet 1 of 3 (U/2 Fire Areas) and Figures 8-6, sheet 4 of 4 and 8-7, sheet 4 of 4 (U/2 Lighting) were inadvertently omitted from Revision 1. These drawings have now been recopied and enclosed are 13 copies for Docket No. 50-206 and 13 copies for Docket Nos. 50-361 and 50-362 to be inserted in the SONGS 1, 2 and 3 Updated FHA.

If you have any questions or require additional information, please contact me.

Very truly yours,

M. O. Medford

Enclosures

cc: (w/o enclosures)

H. Rood, NRC Project Manager
San Onofre Units 2 and 3


R. F. Dudley, Jr., NRC Project Manager
San Onofre Unit 1

J. B. Martin
Regional Administrator, Region V

F. R. Huey, USNRC Senior Resident Inspector
Units 1, 2 and 3

8507310041 850729
PDR ADOCK 05000206
F PDR

ACB
1/26
EXTRAS TO PM'S

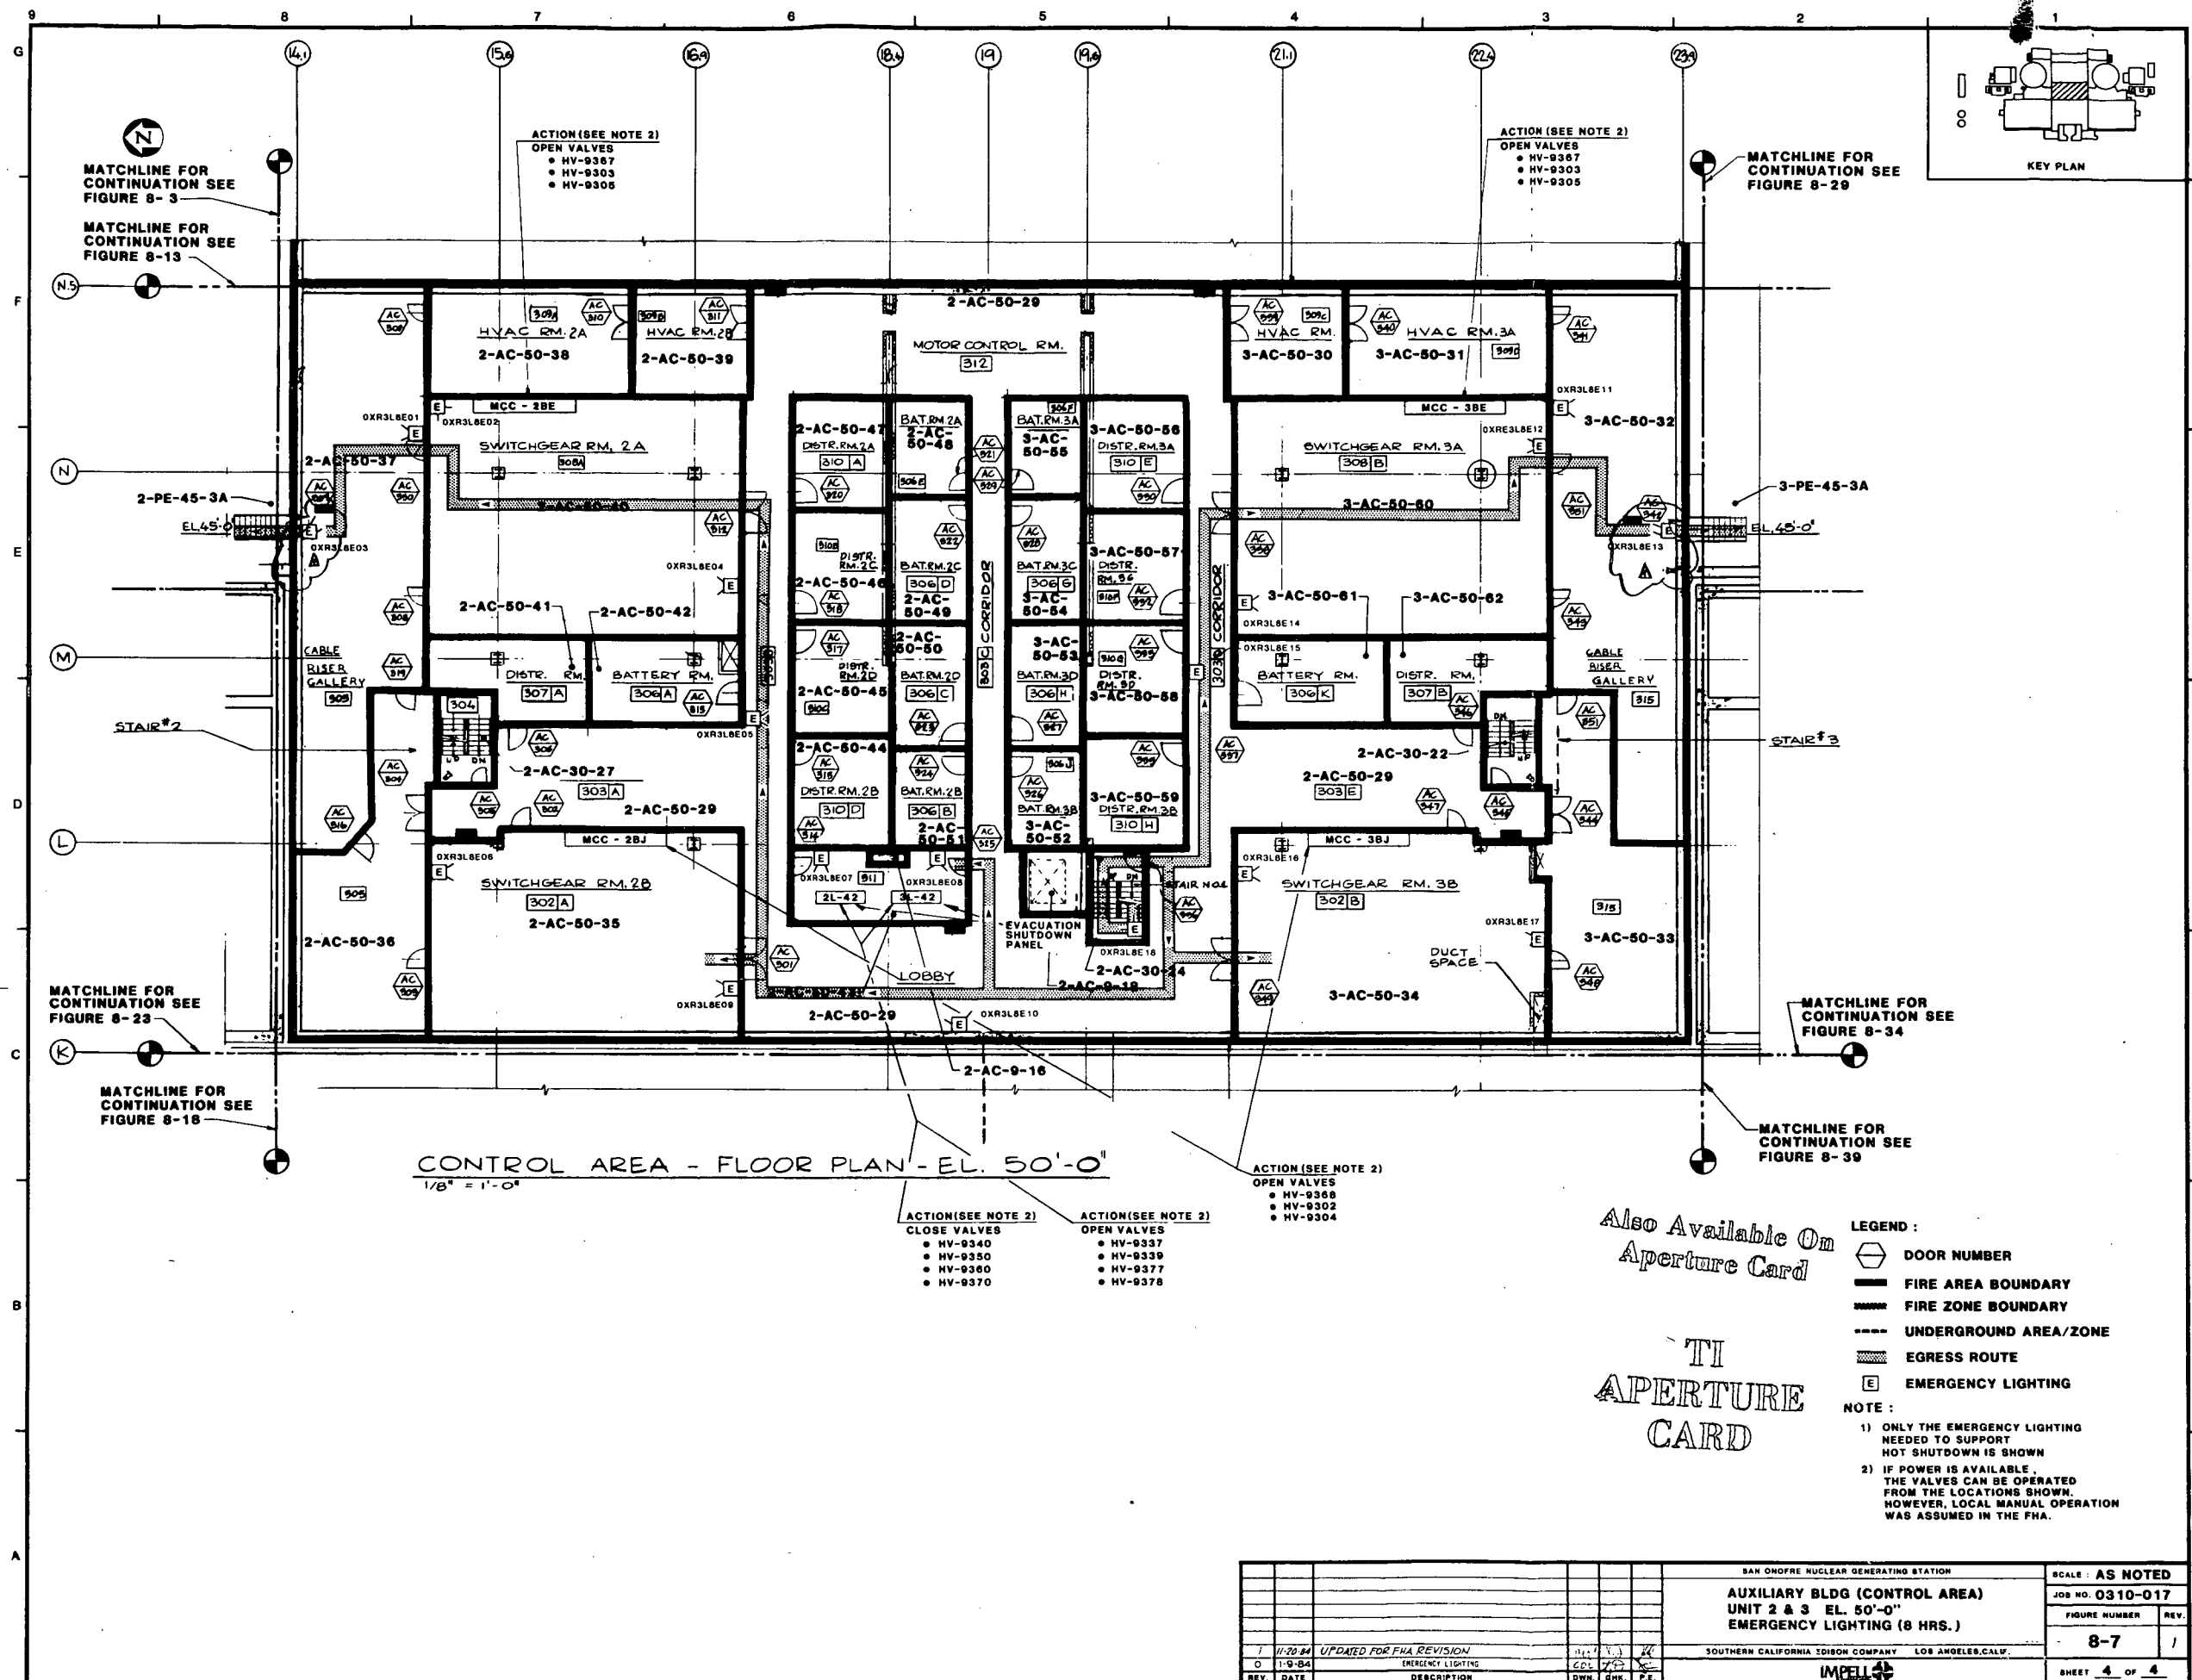


Also Available On
Aperture Card

TI
APERTURE
CARD

SAN ONOFRE NUCLEAR GENERATING STATION				SCALE: AS NOTED	
AUXILIARY BLDG (CONTROL AREA)				JOB NO. 0310-017	
UNIT 2 & 3 EL. 50'-0"				FIGURE NUMBER	REV.
EMERGENCY LIGHTING (8 HRS.)				8-7	1
SOUTHERN CALIFORNIA Edison COMPANY LOS ANGELES, CALIF.				SHEET 4 OF 4	
REV.	DATE	DESCRIPTION	BY	CHK	P.E.
1	11-20-84	UPDATED FOR FHA REVISION	W.L.	W.L.	W.L.
2	1-9-84	EMERGENCY LIGHTING	W.L.	W.L.	W.L.

8507310041-02

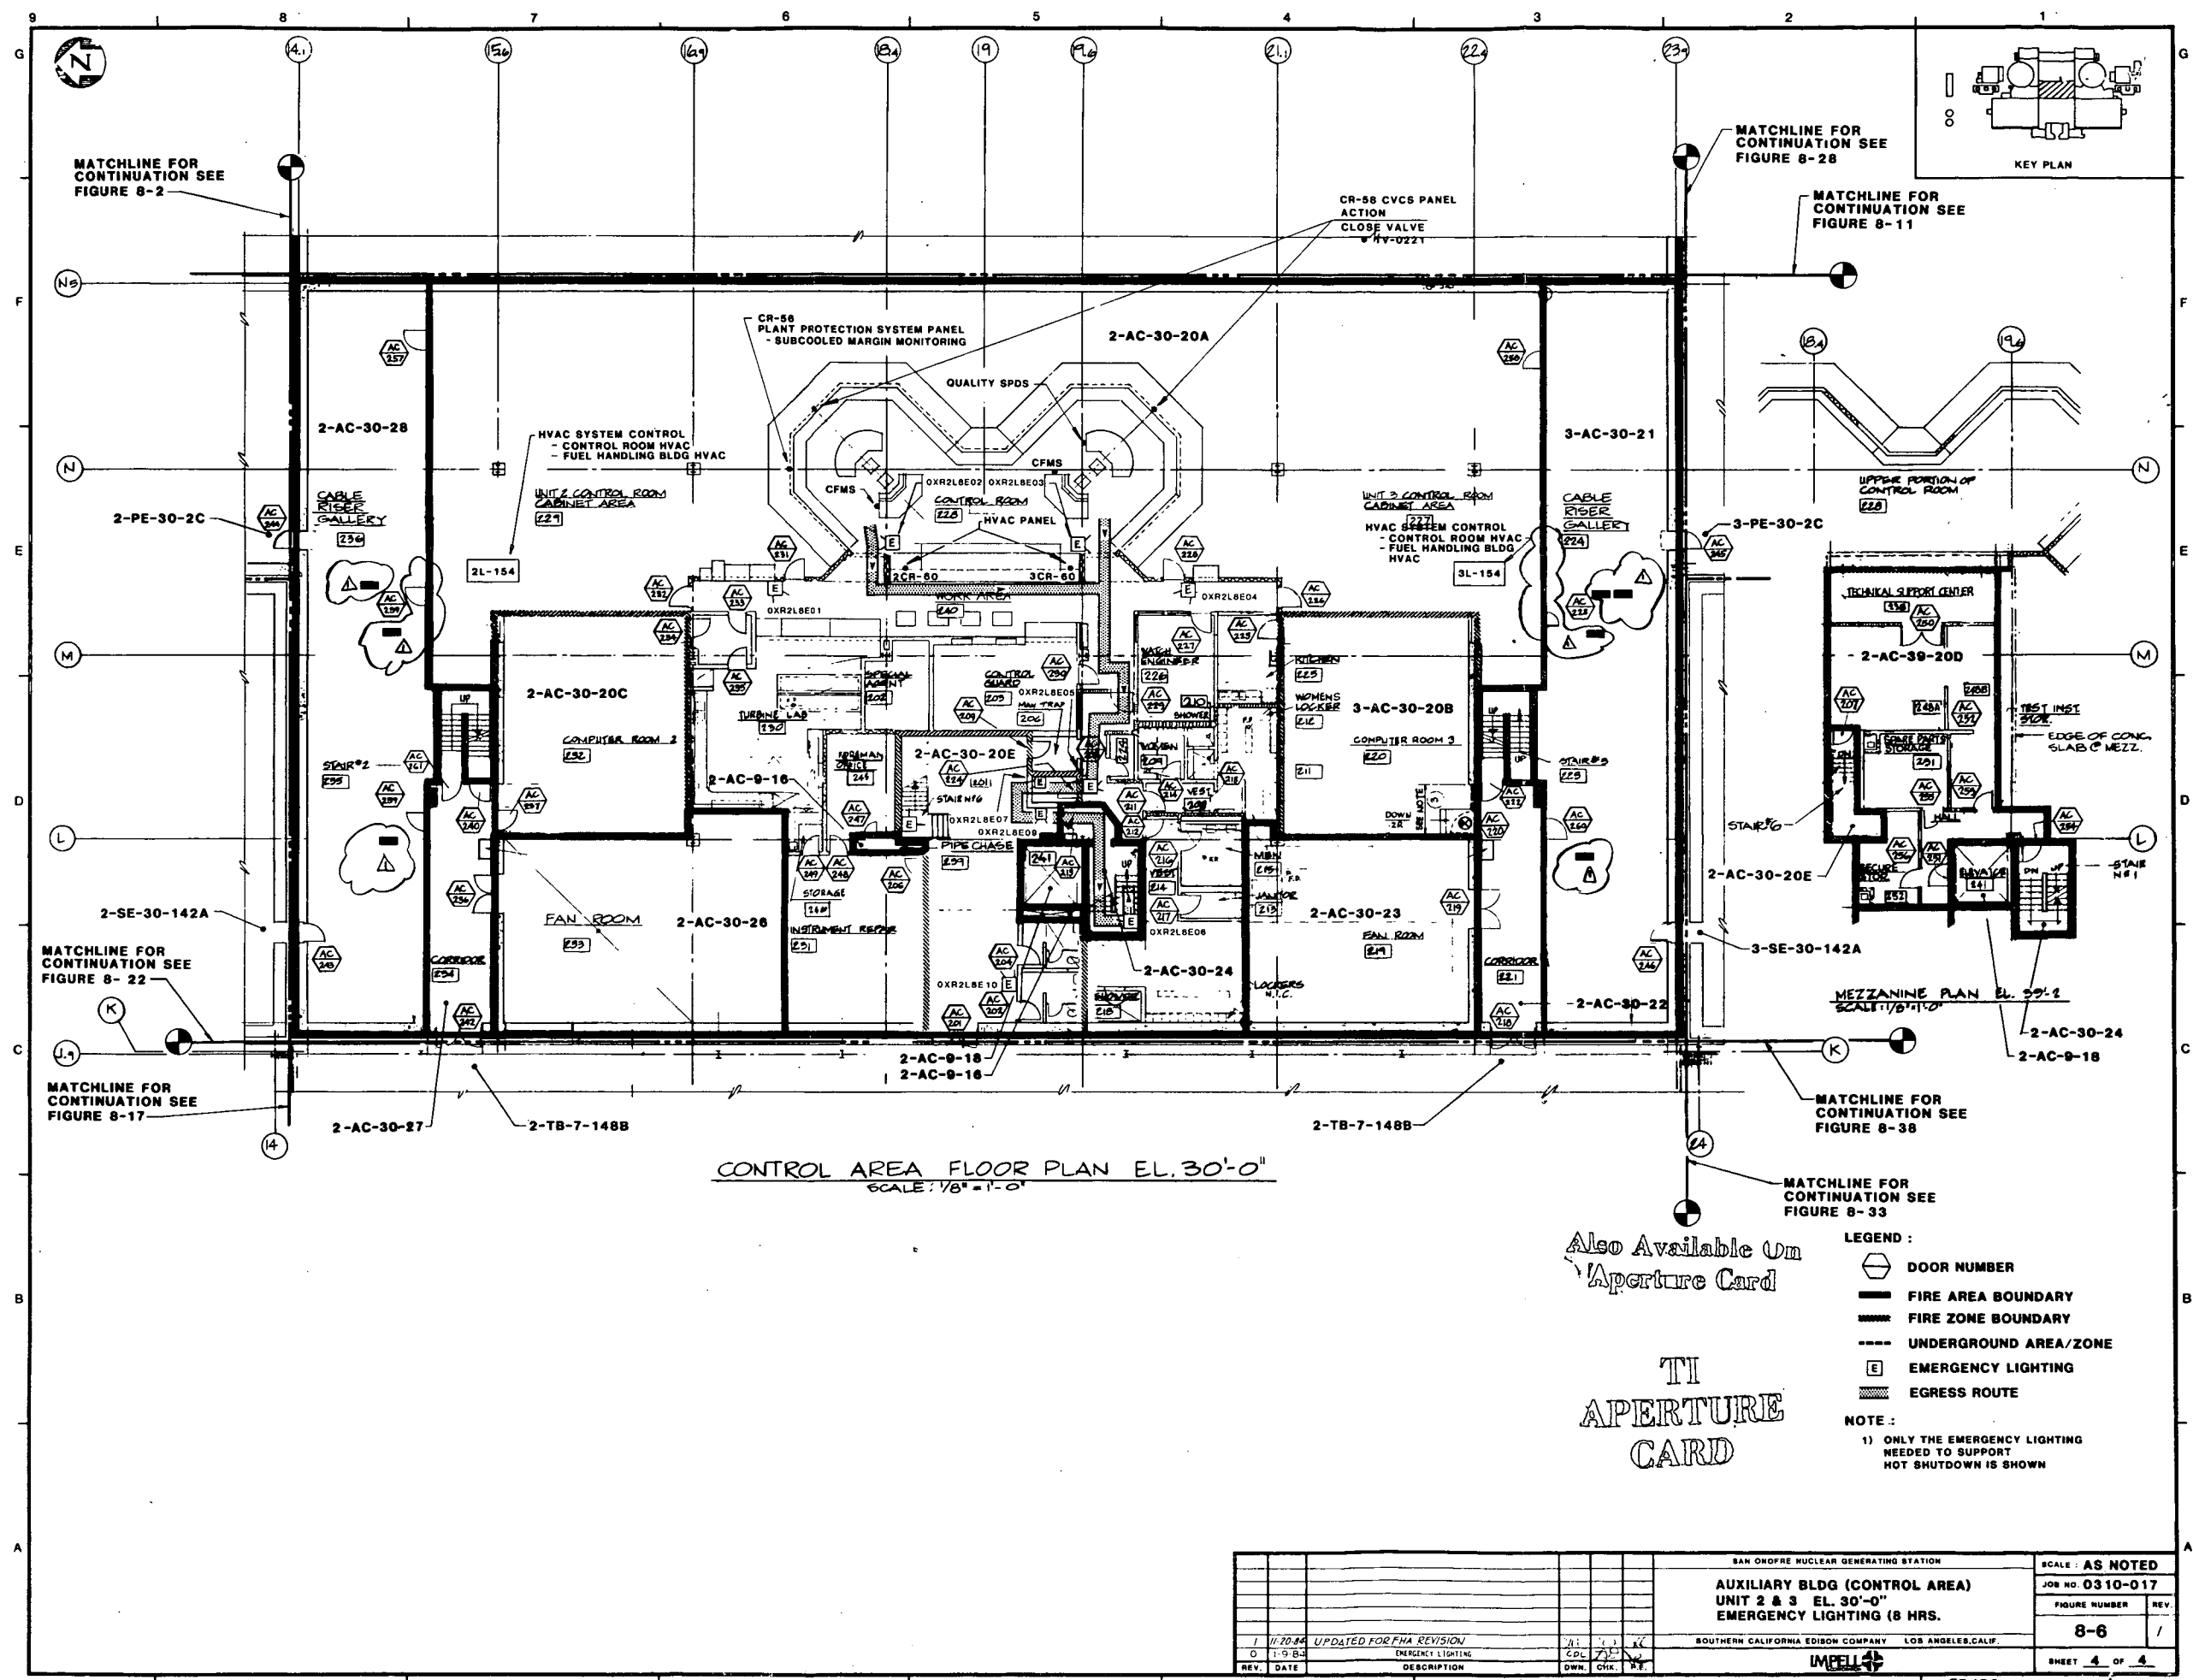

Also Available On
Aperture Card

TI
APERTURE
CARD

- LEGEND:
- DOOR NUMBER
 - FIRE AREA BOUNDARY
 - FIRE ZONE BOUNDARY
 - UNDERGROUND AREA/ZONE
 - EMERGENCY LIGHTING
 - EGRESS ROUTE
- NOTE:
- 1) ONLY THE EMERGENCY LIGHTING NEEDED TO SUPPORT HOT SHUTDOWN IS SHOWN

SAN ONOFRE NUCLEAR GENERATING STATION				SCALE: AS NOTED	
AUXILIARY BLDG (CONTROL AREA)				JOB NO. 0310-017	
UNIT 2 & 3 EL. 30'-0"				FIGURE NUMBER	
EMERGENCY LIGHTING (8 HRS.)				8-6	
SOUTHERN CALIFORNIA EDISON COMPANY LOS ANGELES, CALIF.				SHEET 4 OF 4	
IMPELL					
REV.	DATE	DESCRIPTION	BY	CHK	APP
1	11-20-84	UPDATED FOR FMA REVISION	CDL	7/5	7/5
0	1-9-84	EMERGENCY LIGHTING	CDL	7/5	7/5

8507310041-03