



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

SOUTHERN CALIFORNIA EDISON COMPANY AND

SAN DIEGO GAS AND ELECTRIC COMPANY

DOCKET NO. 50-206

SAN ONOFRE NUCLEAR GENERATING STATION, UNIT 1

AMENDMENT TO PROVISIONAL OPERATING LICENSE

Amendment No. 42
License No. DPR-13

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Southern California Edison Company and San Diego Gas and Electric Company (the licensees) dated April 18, 1979 (Proposed Change No. 77), as supplemented by letters dated May 11 and May 31, 1979, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.

7908070827


2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment and paragraph 3.B of Facility Operating License No. DPR-13 is hereby amended to read as follows:

"B. Technical Specifications

The Technical Specifications contained in Appendices A and B, as revised through Amendment No. 42, are hereby incorporated in the license. Southern California Edison Company shall operate the facility in accordance with the Technical Specifications."

3. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION

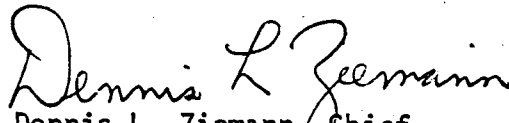

Dennis L. Ziemann, Chief
Operating Reactors Branch #2
Division of Operating Reactors

Attachment:
Changes to the Technical
Specifications

Date of Issuance: July 6, 1979

ATTACHMENT TO LICENSE AMENDMENT NO. 42

PROVISIONAL OPERATING LICENSE NO. DPR-13

DOCKET NO. 50-206


Revise Appendix A Technical Specifications and Bases and Appendix B Technical Specifications by removing the following pages and inserting the enclosed pages. The revised pages are identified by the captioned amendment number and contain vertical lines indicating the areas of change.

PAGES

(Appendix A) 70
70a
73

(Appendix B) 5-3
5-5

FIGURE 6.2.2.2
FACILITY ORGANIZATION

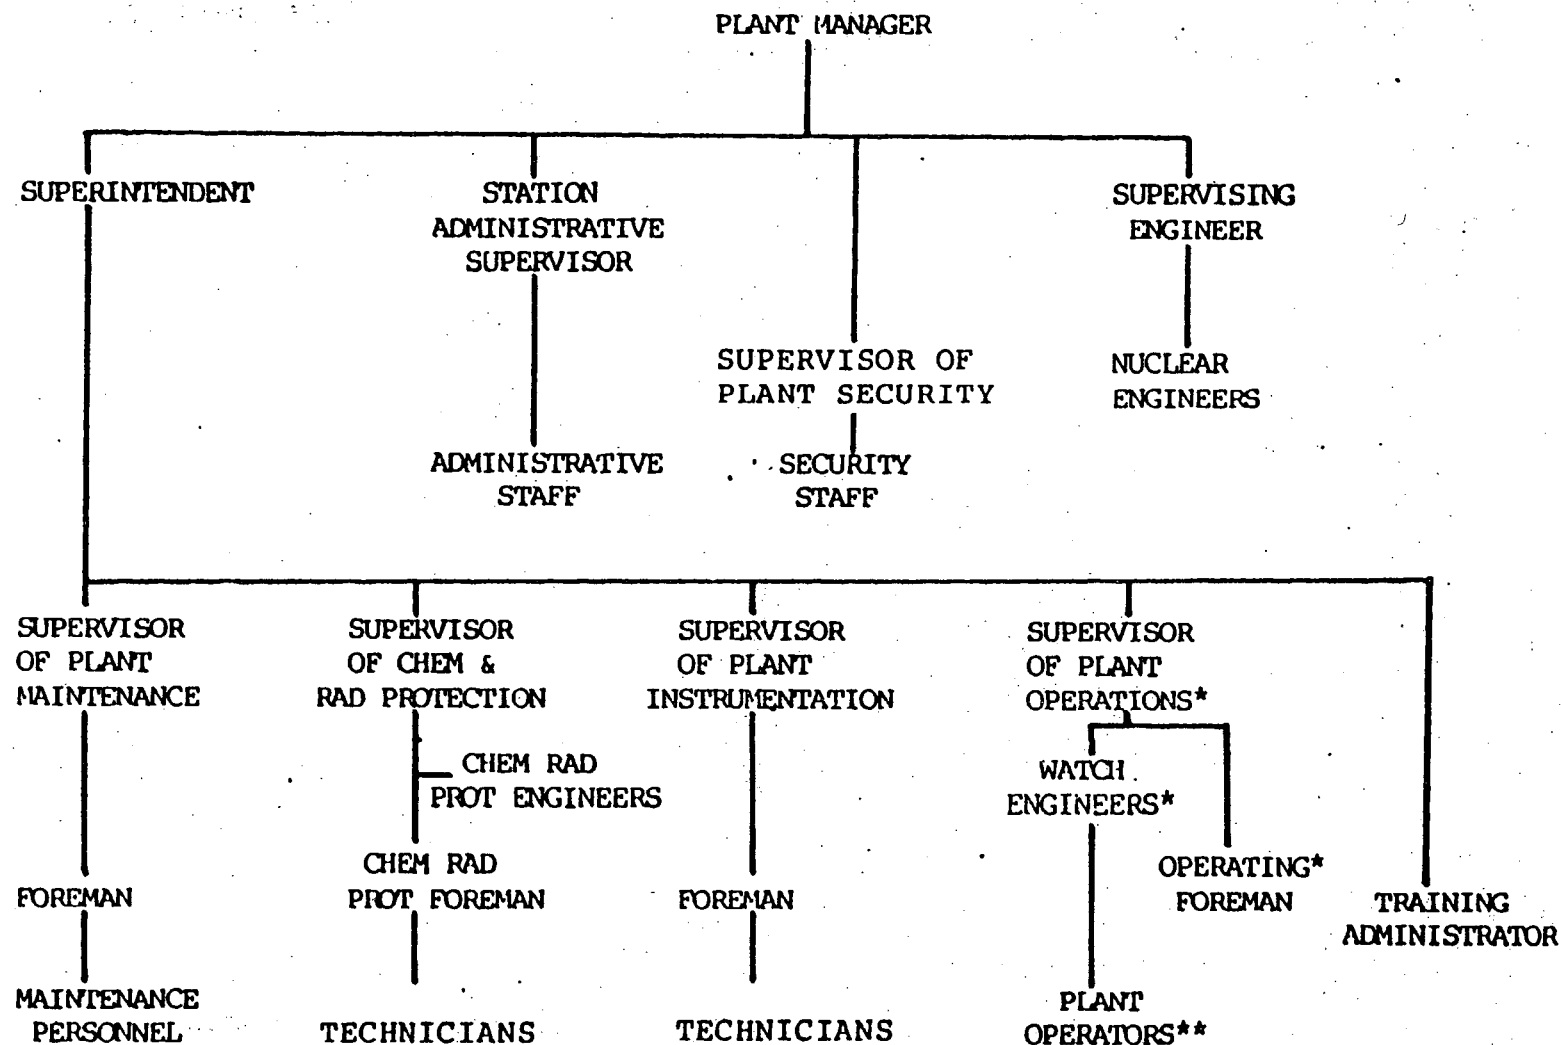

- * Senior Reactor Operator License Required
 ** Control and Assistant Control Operators are holders of Reactor Operator Licenses

Vice President
Power Supply Department

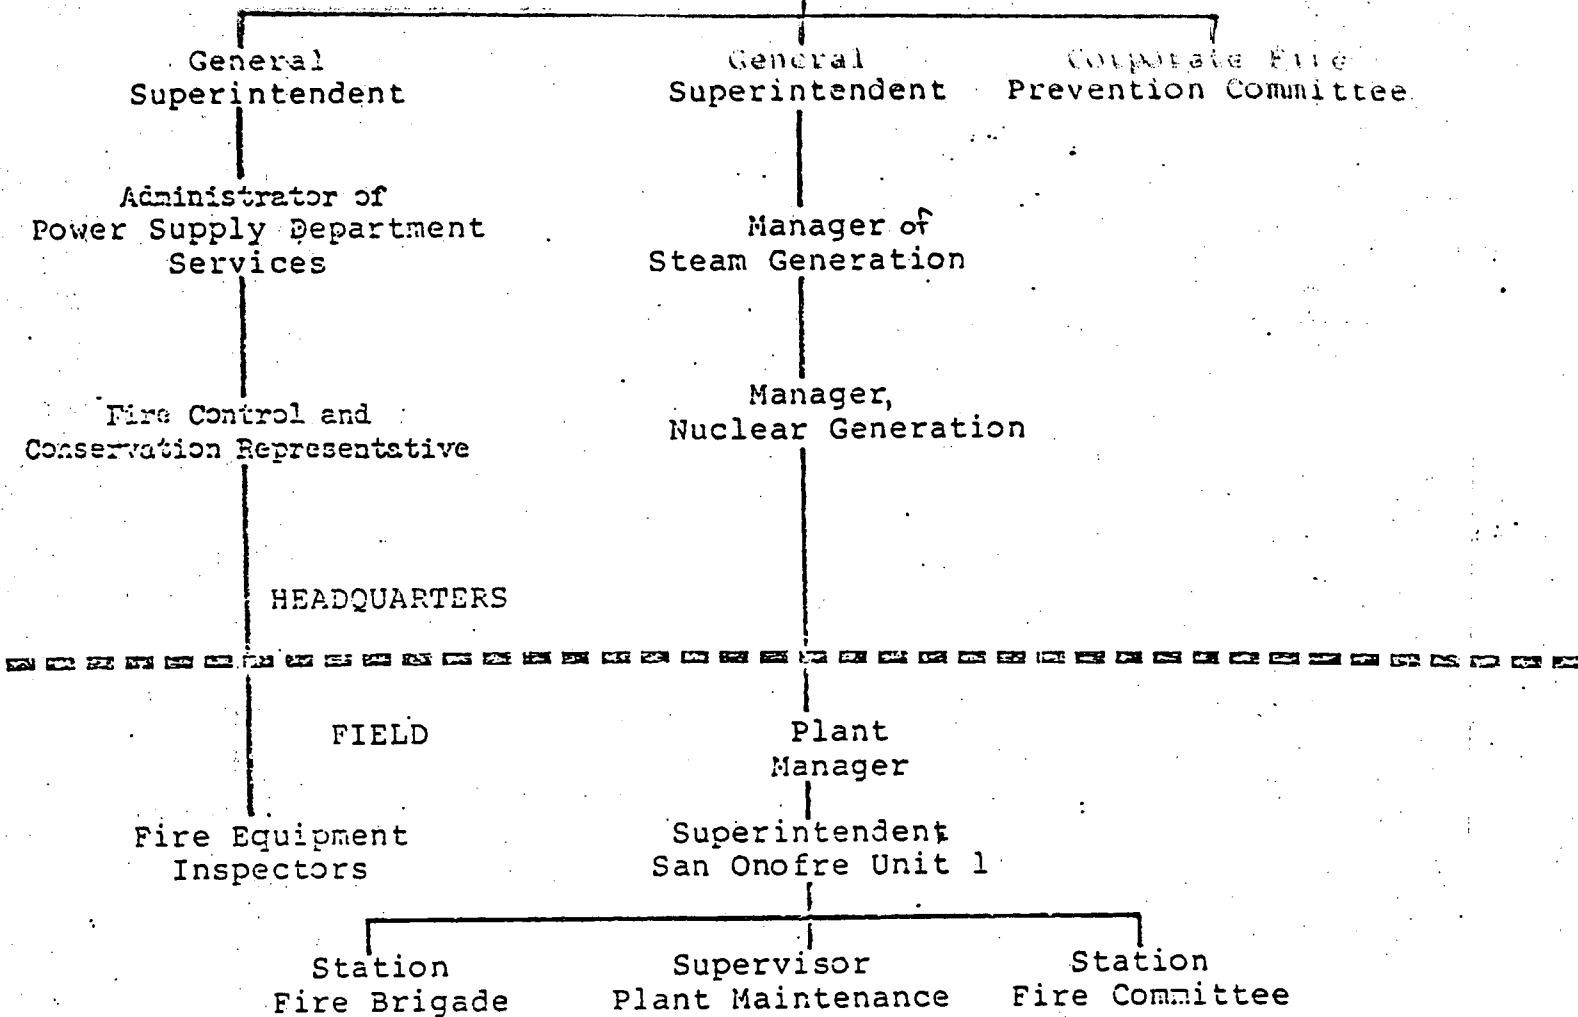


FIGURE 6.2.3.1
FIRE PROTECTION STAFF AND LINE ORGANIZATIONS

6.5 REVIEW AND AUDIT

6.5.1 ONSITE REVIEW COMMITTEE (OSRC)

FUNCTION

- 6.5.1.1 The OSRC shall function to advise the Plant Manager on all matters related to nuclear safety.

COMPOSITION

- 6.5.1.2 The OSRC shall be composed of the:
- | | |
|-----------|--|
| Chairman: | Plant Manager |
| Member: | Superintendent |
| Member: | Supervising Engineer |
| Member: | Supervision of Plant Operations |
| Member: | Supervisor of Plant Instrumentation |
| Member: | Supervisor of Chemistry & Radiation Protection |
| Member: | Supervisor of Plant Maintenance |
| Member: | Nuclear Engineer |
| Member: | San Diego Gas & Electric Representative |

ALTERNATES

- 6.5.1.3 Alternate members shall be appointed in writing by the OSRC Chairman to serve on a temporary basis; however, no more than two alternates shall participate in OSRC activities at any one time.

MEETING FREQUENCY


- 6.5.1.4 The OSRC shall meet at least once per calendar month and as convened by the OSRC Chairman.

QUORUM

- 6.5.1.5 A quorum of the OSRC shall consist of the Chairman or his designated alternate and three members, including alternates. For environmental matters, the Supervisor of Chemistry & Radiation Protection or an adequately qualified representative shall be present.

RESPONSIBILITIES

- 6.5.1.6 In performing their duties with regard to these Appendix A Technical Specifications, the OSRC shall be responsible for:
- Review of 1) all procedures required by Specification 6.8 and changes thereto, 2) any other proposed procedures or changes thereto as determined by the Plant Manager to affect nuclear safety.
 - Review of all proposed tests and experiments that affect nuclear safety.

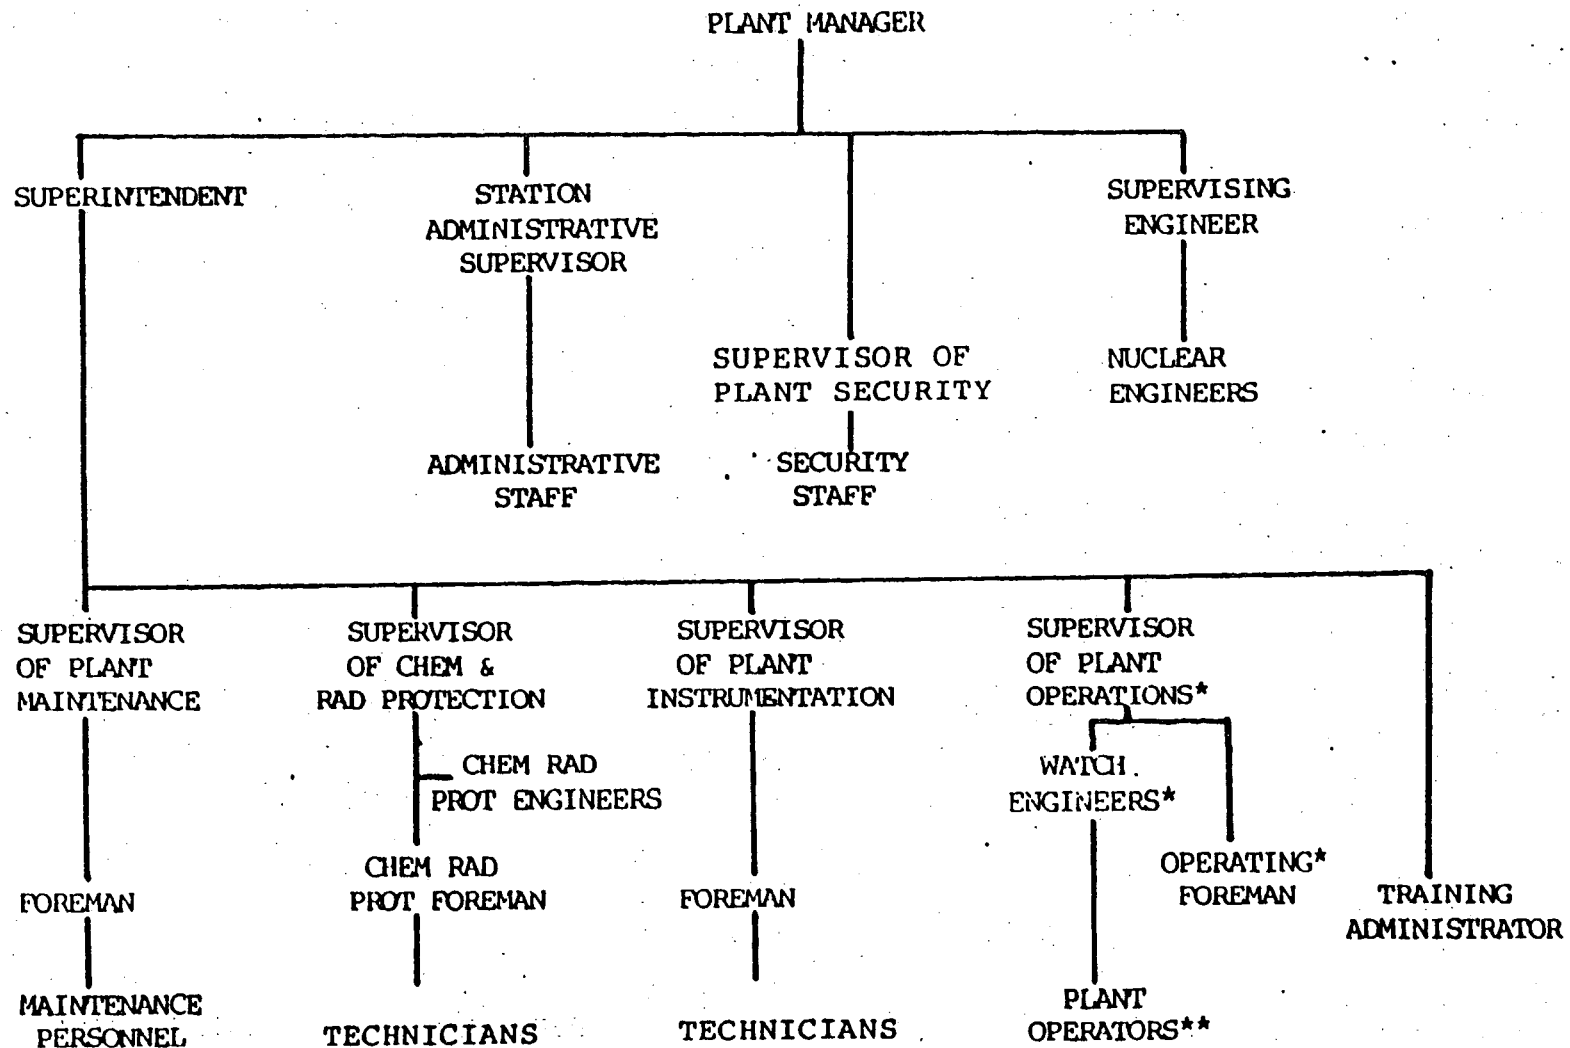

* Senior Reactor Operator License Required

** Control and Assistant Control Operators are holders of Reactor Operator Licenses

FIGURE 5.2-2 SAN ONOFRE NUCLEAR GENERATING STATION (UNIT 1) ORGANIZATION

The membership of the Nuclear Audit and Review Committee and the responsibilities and authorities of the Committee with respect to these environmental technical specifications are as follows:

a. Membership (Chairman designated by the Nuclear Control Board)

- (1) Plant Manager (Chairman)
- (2) Superintendent
- (3) Supervising Engineer
- (4) Supervisor of Plant Operations
- (5) Supervisor of Plant Instrumentation
- (6) Supervisor of Chemical & Radiation Protection
- (7) Supervisor of Plant Maintenance
- (8) Nuclear Engineer
- (9) San Diego Gas & Electric Representative

b. Responsibilities

- (1) Review and investigate reports concerning violations of the Environmental Technical Specifications. Where investigation indicates, evaluate and prepare recommendations to prevent their recurrence.
- (2) Review proposed changes to the Environmental Technical Specifications. Coordinate environmental technical specifications with the safety technical specifications to avoid conflicts and maintain consistency. Submit approved proposed changes to the Environmental Technical Specifications to the Nuclear Control Board for transmittal.
- (3) Review and approve proposed changes to the facility and its procedures or proposed tests or experiments which are forwarded by the Onsite Review Committee when they involve a change in the Environmental Technical Specifications, or a change which would significantly alter the environmental impact of the facility. Submit such proposed changes when required with appropriate environmental analysis to the Nuclear Control Board for transmittal.
- (4) Review all environmental surveillance programs for compliance with these environmental technical specifications.
- (5) Review all design changes related to changes in the Station which relate to the environmental impact of the station and its operation.
- (6) Review overall facility activities as they relate to environmental impact by:
 - (a) formal facility review annually and as directed by the Committee Chairman.