

**TECHNICAL EVALUATION REPORT**  
**DESIGN CODES, DESIGN CRITERIA,**  
**AND LOADING COMBINATIONS** (SEP, III-7B)<sup>28</sup>

SOUTHERN CALIFORNIA EDISON AND SAN DIEGO GAS AND ELECTRIC COMPANY  
SAN ONOFRE NUCLEAR GENERATING STATION UNIT 1

NRC DOCKET NO. 50-206

FRC PROJECT C5257

NRC TAC NO. 41604

FRC ASSIGNMENT 11

NRC CONTRACT NO. NRC-03-79-118

FRC TASK 318

*Prepared by*

Franklin Research Center  
20th and Race Street  
Philadelphia, PA 19103

FRC Group Leader: T. C. Stilwell

*Prepared for*

Nuclear Regulatory Commission  
Washington, D.C. 20555

Lead NRC Engineer: D. Persinko

August 13, 1982

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, or any of their employees, makes any warranty, expressed or implied, or assumes any legal liability or responsibility for any third party's use, or the results of such use, of any information, apparatus, product or process disclosed in this report, or represents that its use by such third party would not infringe privately owned rights.

Prepared by:

T. C. Stilwell

Principal Author

Date: 8/13/82

Reviewed by:

C. J. Crane

Project Manager

Date: 8/13/82

Approved by:

D. Persinko

Department Director

Date: 8-13-82



**Franklin Research Center**

A Division of The Franklin Institute

The Benjamin Franklin Parkway, Phila., Pa. 19103 (215) 448-1000

**REGULATORY DOCKET FILE COPY**

8208170083XA

## CONTENTS

<u>Section</u>	<u>Title</u>	<u>Page</u>
1	INTRODUCTION . . . . .	1
2	BACKGROUND . . . . .	2
3	REVIEW OBJECTIVES. . . . .	3
4	SCOPE. . . . .	4
5	MARGINS OF SAFETY. . . . .	7
6	CHOICE OF REVIEW APPROACH. . . . .	9
7	METHOD . . . . .	11
	7.1 Information Retrieval . . . . .	11
	7.2 Appraisal of Information Content. . . . .	11
	7.3 Code Comparison Reviews . . . . .	12
	7.4 Assessment of the Potential Impact of Code Changes . . . . .	15
	7.4.1 Classification of Code Changes . . . . .	16
	7.4.1.1 General and Conditional Classifications of Code Change Impacts . . . . .	17
	7.4.1.2 Code Impacts on Structural Margins . . . . .	18
	7.5 Plant-Specific Code Changes . . . . .	20
8	SAN ONOFRE SEISMIC CATEGORY I STRUCTURES . . . . .	21
9	STRUCTURAL DESIGN CRITERIA . . . . .	22
10	LOADS AND LOAD COMBINATION CRITERIA . . . . .	24
	10.1 Description of Tables of Loads and Load Combinations . . . . .	24

## CONTENTS (Cont.)

<u>Section</u>	<u>Title</u>	<u>Page</u>
10.2	Load Definitions . . . . .	27
10.3	Design Load Tables, "Comparison of Design Basis Loads" . . . . .	29
10.4	Load Combination Tables, "Comparison of Load Combination Criteria" . . . . .	39
11	REVIEW FINDINGS . . . . .	52
11.1	Major Findings of AISC-1963 vs. AISC-1980 Code Comparison. . . . .	54
11.2	Major Findings of ACI 318-63 vs. ACI 349-76 Code Comparison . . . . .	57
11.3	Major Findings of ASME B&PV Code, Section III, Subsection NE, 1963 vs. Section III, Subsection NE, 1980 Code Comparison 60. . . . .	61
11.4	Major Findings of ACI 318-71 vs. ACI 349-76 Code Comparison. . . . .	67
11.5	Major Findings of AISC-1971 vs. AISC-1980 Code Comparison. . . . .	69
12	SUMMARY . . . . .	71
13	RECOMMENDATIONS . . . . .	73
14	REFERENCES . . . . .	78
APPENDIX A - SCALE A AND SCALE A <sub>x</sub> CHANGES DEEMED INAPPROPRIATE TO SAN ONOFRE PLANT		
APPENDIX B - SUMMARIES OF CODE COMPARISON FINDINGS		
APPENDIX C - COMPARATIVE EVALUATIONS AND MODEL STUDIES		
APPENDIX D - ACI CODE PHILOSOPHIES		
APPENDIX I - CODE COMPARISON REVIEW OF TECHNICAL DESIGN BASIS DOCUMENTS DEFINING CURRENT LICENSING CRITERIA FOR SEP TOPIC III-7.B (SEPARATELY BOUND)		

## CONTENTS (Cont.)

<u>Section</u>	<u>Title</u>
APPENDIX II	- CODE COMPARISON REVIEW OF AISC SPECIFICATION FOR THE DESIGN, FABRICATION, AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS FOR THE YEARS 1980 VS. 1963 (SEPARATELY BOUND)
APPENDIX III	- NOT APPLICABLE TO SAN ONOFRE PLANT
APPENDIX IV	- CODE COMPARISON REVIEW OF CODE REQUIREMENTS FOR NUCLEAR SAFETY-RELATED CONCRETE STRUCTURES ACI 349-76 VS. BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE ACI 318-63 (SEPARATELY BOUND)
APPENDIX V	- NOT APPLICABLE TO SAN ONOFRE PLANT
APPENDIX VI	- NOT APPLICABLE TO SAN ONOFRE PLANT
APPENDIX VII	- NOT APPLICABLE TO SAN ONOFRE PLANT
APPENDIX VIII	- CODE COMPARISON REVIEW OF AISC SPECIFICATION FOR THE DESIGN, FABRICATION, AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS FOR THE YEARS 1980 VS. 1971 (SEPARATELY BOUND)
APPENDIX IX	- CODE COMPARISON REVIEW OF CODE REQUIREMENTS FOR ASME B&PV CODE SECTION III, SUBSECTION NE, 1980 VS. ASME B&PV CODE SECTION VIII, 1962 (SEPARATELY BOUND)
APPENDIX X	- NOT APPLICABLE TO SAN ONOFRE PLANT
APPENDIX XI	- NOT APPLICABLE TO SAN ONOFRE PLANT
APPENDIX XII	- NOT APPLICABLE TO SAN ONOFRE PLANT
APPENDIX XIII	- CODE COMPARISON REVIEW OF AISC SPECIFICATION FOR THE DESIGN, FABRICATION, AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS FOR THE YEARS 1980 VS. 1971 INCLUDING SUPPLEMENTS 1 AND 2 (SEPARATELY BOUND)



## FOREWORD

This Technical Evaluation Report was prepared by Franklin Research Center under a contract with the U.S. Nuclear Regulatory Commission (Office of Nuclear Reactor Regulation, Division of Operating Reactors) for technical assistance in support of NRC operating reactor licensing actions. The technical evaluation was conducted in accordance with criteria established by the NRC.

Principal contributors to the technical preparation of this report were T. Stilwell and M. Darwish of the Franklin Research Center.

Dr. E. W. Wallo, Chairman of the Civil Engineering Department, Villanova University, and Dr. R. Koliner, Professor of Civil Engineering, Villanova University, provided assistance both as contributing authors and in an advisory capacity as consultants under subcontract with the Franklin Research Center.

The report also incorporates the suggestions, guidance, and supportive efforts provided by Mr. D. Persinko, the NRC Lead Engineer for this task.

## 1. INTRODUCTION

For the Seismic Category I buildings and structures at the San Onofre Nuclear Generating Station, Unit 1, this report provides a comparison of the structural design codes and loading criteria used in the actual plant design against the corresponding codes and criteria currently used for licensing of new plants.

The objective of the code comparison review is to identify deviations in design criteria from current criteria, and to assess the effect of these deviations on margins of safety, as they were originally perceived and as they would be perceived today.

The work was conducted as part of the Nuclear Regulatory Commission's (NRC) Systematic Evaluation Program (SEP) and provides technical assistance for Topic III-7.B, "Design Codes, Design Criteria, and Load Combinations." The report was prepared at the Franklin Research Center under NRC Contract No. NRC-03-79-118.

## 2. BACKGROUND

With the development of nuclear power, provisions addressing facilities for nuclear applications were progressively introduced into the codes and standards to which plant building and structures are designed. Because of this evolutionary development, older nuclear power plants conform to a number of different versions of these codes, some of which have since undergone considerable revision.

There has likewise been a corresponding development of other licensing criteria, resulting in similar non-uniformity in many of the requirements to which plants have been licensed. With this in mind, the NRC undertook an extensive program to evaluate the safety of 11 older plants (and eventually all plants) to a common set of criteria. The program, entitled the Systematic Evaluation Program (SEP), employs current licensing criteria (as defined by NRC's Standard Review Plan) as the common basis for these evaluations.

To make the necessary determinations, the NRC is investigating, under the SEP, 137 topics spanning a broad spectrum of safety-related issues. The work reported herein constitutes the results of part\* of the investigation of one of these topics, Topic III-7.B, "Design Codes, Design Criteria, and Load Combinations."

This topic is charged with the comparison of structural design criteria in effect in the late 1950's to the late 1960's (when the SEP plants were constructed) with those in effect today. Other SEP topics also address other aspects of the integrity of plant structures. All these structurally oriented tasks, taken together, will be used to assess the structural adequacy of the SEP plants with regard to current requirements. The determinations with respect to structural safety will then be integrated into an overall SEP evaluation encompassing the entire spectrum of safety-related topics.

---

\*The report addresses only the San Onofre plant.

### 3. REVIEW OBJECTIVES

The broad objective of the NRC's Systematic Evaluation Program (SEP) is to reassess the safety of 11 older nuclear power plants in accordance with the intent of the requirements governing the licensing of current plants, and to provide assurance, possibly involving backfitting, that operation of these plants conforms to the general level of safety required of modern plants.

Task III-7.B of the SEP effort seeks to compare actual and current structural design criteria for the major civil engineering structures at each SEP plant site, i.e., those important to shutdown, containment, or both, and therefore designated Seismic Category I structures. The broad safety objective of SEP Task III-7.B is (when integrated with several other interfacing SEP topics) to assess the capability of all Seismic Category I structures to withstand all design conditions stipulated by the NRC, at least to a degree sufficient to assure that the nuclear power plant can be safely shut down under all circumstances.

The objective of the present effort under Task III-7.B is to provide, through code comparisons, a rational basis for making the required technical assessments, and a tool which will assist in the structural review.

Finally, the objective of this report is to present the results of Task III-7.B as they relate to the San Onofre Nuclear Generating Station, Unit 1.

#### 4. SCOPE

In general, the scope of work requires comparison of the provisions of the structural codes and standards used for the design of SEP plant Seismic Category I civil engineering structures\* against the corresponding provisions governing current licensing practice. The review includes the containment and all Category I structures within and exterior to it. Explicit among the criteria to be reviewed are loads and loading combinations postulated for these structures.

The review scope consists of the following specific tasks:

1. Identify current design requirements, based on a review of NRC Regulations; 10CFR50.55a, "Codes and Standards"; and the NRC Standard Review Plan (SRP).
2. Review the structural design codes, design criteria, design and analysis procedures, and load combinations (including combinations involving seismic loads) used in the design of all Seismic Category I structures as defined in the Final Safety Analysis Report (FSAR) for each SEP plant.
3. Based upon the plant-specific design codes and standards identified in Task 2 and current licensing codes and standards from Task 1, identify plant-specific deviations from current licensing criteria for design codes and criteria.
4. Assess the significance of the identified deviations, performing (where necessary) comparative analyses to quantify significant deviations. Such analyses may be made on typical elements (beams, columns, frames, and the like) and should be explored over a range of parameters representative of plant structures.
5. Prepare a Technical Evaluation Report for each SEP plant including:
  - a. comparisons of plant design codes and criteria to those currently accepted for licensing
  - b. assessment of the significance of the deviations

---

\*In general, these are the structures normally examined in licensing reviews under Section 3.8 of the SRP (but note the list at the end of this section of structures specifically excluded from the scope of this review).

- c. results of any comparative stress analyses performed in order to assess the significance of the code changes on safety margins
- d. overall evaluation of the acceptability of structural codes used at each SEP plant.

A number of SEP topics examine aspects of the integrity of the structures composing SEP facilities. Several of these interface with the Task III-7.B effort as shown below:

<u>Topic</u>	<u>Designation</u>
III-1	Classification of Structures, Components, Equipment, and Systems (Seismic and Quality)
III-2	Wind and Tornado Loading
III-3.A	Effects of High Water Level on Structures
III-4	Missile Generation and Protection
III-5	Evaluation of Pipe Breaks
III-6	Seismic Design Considerations
III-7.D	Structural Integrity Tests
VI-2	Mass and Energy Release for Postulated Pipe Break.

Because they are covered either elsewhere within the SEP review or within other NRC programs, the following matters are explicitly excluded from the scope of this review:

Mark I torus shell, supports, vents, local region of drywell at vent penetrations	Reviewed in Generic Task A-7.
Reactor pressure vessel supports, steam generator supports, pump supports	Reviewed in Generic Task A-2, A-12.
Equipment supports in SRP 3.8.3	Reviewed generically in Topic III-6, Generic Task A-12.

Other component supports (steel and concrete)

Specific supports have been analyzed in detail in Topic III-6. (Component supports may be included later if items of concern applicable to component supports are found as a result of reviewing the structural codes.)

Testing of containment

Reviewed in Topic III-7.D.

Inservice inspection; quality control/assurance

Should be considered in the review only to the extent that it affects design criteria and design allowables. Aspects of inservice inspection are being reviewed in Topics III-7.A and III-3.C

Determination of structures that should be classified Seismic Category I

Not within scope.

Shield walls and subcompartments inside containment

Reviewed in Generic Task A-2.

Masonry walls

Reviewed generically in IE Bulletin 80-11.

Seismic analysis

Being reviewed as an independent SEP Topic.

## 5. MARGINS OF SAFETY

There are several bases upon which margins of safety\* may be defined and discussed.

The most often used is the margin of safety based on yield strength. This is a particularly useful concept when discussing the behavior of steels, and became ingrained into the engineering vocabulary at the time when steel was the principal metal of engineering structures. In this usage, the margin of safety reflects the reserve capacity of a structure to withstand extra loading without experiencing an incipient permanent change of shape anywhere throughout the structure. Simultaneously, it reflects the reserve load carrying capacity existing before the structure is brought to the limit for which an engineer could be certain the computations (based on elastic behavior of the metal) applied.

This is the conventional use of the term and the meaning which engineers take as intended, unless the term is further qualified to show something else is meant. Thus, if a structure is stated to have a margin of safety of 1.0 under a given set of loads, then it will be generally understood that every load on the structure may be simultaneously doubled without encountering (anywhere) inelastic stresses or deflections. On the other hand, if (under load) a structure has no margin of safety, any increment to any load will cause the structure to experience, in a least one (and possibly more than one) location, some permanent distortion (however small) of its original shape.

Because the yield strengths of common structural steels are generally well below their ultimate strengths, the engineer knows that in most (but not all) cases, the structure possesses substantial reserve capacity--beyond his computed margin--to carry additional load.

There are other useful ways, however, to speak of safety margins and these (not the conventional one) are particularly relevant to the aims of the systematic evaluation program.

---

\*Factors of safety (FS) are related to margins of safety (MS) through the relation,  $MS = FS - 1$ .



One may speak of margins of safety with respect to code allowable limits. This margin reflects the reserve capacity of a structure to withstand extra loading while still conforming to all criteria governing its design.

One may also speak (if it is made clear in advance that this is the intended meaning) of margins of safety against actual failure. Both steel and concrete structures exhibit much higher "margins of safety" on this second basis than is shown by computation of margins of safety based on code allowables.

These latter concepts of "margin of safety" are very significant to the SEP review. Indeed the basic review concept, at least as it relates to structural integrity, cannot be easily defined in any quantitative manner without considering both. The SEP review concept is predicated on the assumption that it is unrealistic to expect that plants which were built to, and were in compliance with, older codes will still conform to current criteria in all respects. The SEP review seeks to assess whether or not plants meet the "intent" of current licensing criteria as defined by the Standard Review Plan (SRP). The objective is not to require that older plants be brought into conformance with all SRP requirements to the letter, but rather to assess whether or not their design is sufficient to provide the general level of safety that current licensing requirements assure.

With respect to aspects of the SEP program that involve the integrity of structures, the SEP review concept can be rephrased in a somewhat more quantitative fashion in terms of these two "margins of safety." Thus, it is not expected or demanded that all structures show positive margins of safety based upon code allowables in meeting all current SRP requirements; but it is demanded that margins of safety based upon ultimate strength are not only positive, but ample. In fact, the critical judgments to be made (for SEP plants) are:

1. to what extent may current code margins be infringed upon.
2. what minimum margin of safety based on ultimate strength must be assured.

The choice of method for Topic III-7.B review can be discussed in terms of these two key considerations.

## 6. CHOICE OF REVIEW APPROACH

The approach taken in the review process depends on which key questions (of Section 5) one chooses to emphasize and address first.

One could give primary consideration to the second. If this approach is chosen, one first sets up a minimum margin of safety (based on failure) that will be acceptable for SEP plants. This margin is to be computed in accordance with current criteria. Then one investigates structures designed in accordance with earlier code provisions, and to different loading combinations, to see if they meet the chosen SEP margin when challenged by current loading combinations and evaluated to current criteria. This approach gives the appearance of being efficient. The review proceeds from the general (the chosen minimum margin of safety) to the particular (the ability of a previously designed structure to meet the chosen margin). Moreover, issues are immediately resolved on a "go; no-go" basis. The initial step in this approach is not easy, nor are the necessary evaluations. One is dealing with highly loaded structures in regions where materials behave inelastically. Rulemaking in such areas is sure to be difficult, and likely to be highly controversial.

The alternative approach is taken in this review. It proceeds from the particular to the general, and places initial emphasis upon seeking to answer (for SEP plants) questions as to what, how many, and of what magnitude are the infringements on current criteria. No new rulemaking is involved (at least at the outset). All initial assessments are based on existing criteria.

Current and older codes are compared paragraph-by-paragraph to see the effects that code changes may have on the load carrying ability of individual elements (beams, columns, frames, and the like). It should be noted that this process, although involving judgments, is basically fact-finding -- not decisionmaking.

This kind of review is painstaking, and there is no assurance in advance that it in itself will be decisive. It may turn out, after examination of the

facts, that designs predicated upon the older criteria infringe upon current design allowables in many cases and to extensive depths. If so, such information will certainly be of value to the final safety assessment, but many unresolved questions will remain.

On the other hand, it may turn out that infringements upon current criteria are infrequent and not of great magnitude. If this is the case, many issues will have been resolved, and questions of structural integrity will be sharply focused upon a few remaining key issues.

## 7. METHOD

A brief description of the approach used to carry out SEP Topic III-7.B follows. For discussion of the work, it is convenient to divide the approach into six areas:

1. information retrieval and assembly
2. appraisal of information content
3. code comparison reviews
4. code change impact assessment
5. plant-specific review of the relevancy of code change impacts
6. summarizing plant status vis-a-vis design criteria changes.

### 7.1 INFORMATION RETRIEVAL

The initial step (and to a lesser extent an ongoing task of the review) was to collect and organize necessary information. At the outset, NRC forwarded files relevant to the work. These submittals included pertinent sections of plant FSARs, Standard Review Plan (SRP) 3.8, responses to questions on Topic III-7.B previously requested of licensees by the NRC, and other relevant data and reports.

These submittals were organized into Topic III-7.B files on a plant-by-plant basis. The files also contain subsequently received information, as well as other documents developed for the plant review.

A number of channels were used to gather additional information. These included information requests to NRC; letter requests for additional information sent to licensees; plant site visits; and retrieval of representative structural drawings, design calculations, and design specifications.

In addition, a separate file was set up to maintain past and present structural codes, NRC Regulatory Guides, Staff Position Papers, and other relevant documents (including, where available, reports from SEP tasks interfacing with the III-7.B effort).

### 7.2 APPRAISAL OF INFORMATION CONTENT

Most of the information sources were originally written for purposes other than those of the Task III-7.B review. Consequently, much of the

information sought was embedded piecemeal in the documents furnished. These sources were searched for the relevant information that they did contain. Generally, it was found that information gaps remained (i.e., some items were not referenced at all or were not specific enough for Task III-7.B purposes). The information found was assembled and the gaps were filled through the information retrieval efforts mentioned earlier.

### 7.3 CODE COMPARISON REVIEWS

The codes and standards used to represent current licensing practice were selected as described in Appendix I of this report. Briefly summarized, the criteria selection corresponds to NUREG-800 (NRC's Standard Review Plan), the operative document providing guidance to NRC reviewers on licensing matters (see Reference 1).

Next, the Seismic Category I structures at the San Onofre Nuclear Generating Station were identified (see Section 8). For these, the codes and standards which were used for actual design were likewise identified on a structure-by-structure basis (see Section 9). Each code was then paired with its counterpart which would govern design were the structure to be licensed today.

Workbooks were prepared for each code pair. The workbook format consisted of paragraph-by-corresponding-paragraph photocopies of the older and the current versions laid out side-by-side on 11-by-17-inch pages. A central column between the codes was left open to provide space for reviewer comments.

The code versions were initially screened to discover areas where the text either remained identical in both versions or had been reedited without changing technical content. Code paragraphs which were found to be essentially the same in both versions were so marked in the comments column.

The review then focused on the remaining portions of the codes where textual disparities existed. Pertinent comments were entered. Typical comments address either the reason the change had been introduced, the intent

of the change, its impact upon safety margins, or a combination of such considerations.

As can be readily appreciated, many different circumstances arise in such evaluations--some simple, some complex. A few examples are cited and briefly discussed below.

Provisions were found where code changes liberalized requirements, i.e., less stringent criteria are in force today than were formerly required. Such changes are introduced from time to time as new information becomes available regarding the provision in question. Not infrequently, code committees are called upon to protect against failure modes where the effects are well known; but too little is yet clear concerning the actual failure mechanism and the relative importance of the contributing factors. The committee often cannot defer action until a full investigation has been completed, but must act on behalf of safety. Issues such as these are usually resolved with prudence and caution--sometimes by the adoption of a rule (based upon experience and judgment) known to be conservative enough to assure safety. Subsequent investigation may produce evidence showing the adopted rule to be overly cautious, and provide grounds for its relaxation.

On the other hand, some changes which on first view may appear to reflect a relaxation of code requirements do not in fact actually do so. Structural codes tend to be documents with interactive provisions. Sometimes apparent liberalization of a code paragraph may really reflect a general tightening of criteria, because the change is associated with stiffening of requirements elsewhere.

To cite a simple example, a newly introduced code provision may be found making it unnecessary to check thin flanged, box section beams of relatively small depth-to-width ratio for buckling. This might appear to be a relaxation of requirements; however, elsewhere the code has also introduced a requirement that the designer must space end supports closely enough to preclude buckling. Thus, code requirements have been tightened, not relaxed.

Whenever it was found that code requirements had truly been relaxed, this was noted in the reviewer's comments in the code comparison review. Because liberalization of code criteria clearly cannot give rise to safety issues concerning structures built to more stringent requirements, such matters were not considered further.

On the other hand, whenever it was clear that a code change introduced more stringent criteria, the potential impact of the change on margins of safety shown for the structure was assessed. When it was felt that the change (although more restrictive) would not significantly affect safety margins, this judgment was entered as a reviewer comment. When it was clear that the code change had the potential to significantly affect the perceived margin of safety, this was noted in the comments and the paragraph flagged for further consideration.

Sometimes the effects of a code change are not apparent. Indeed, depending upon a number of factors,\* the change may reflect a tightening of requirements for some structures and a liberalization for others. When doubtful or ambiguous situations were encountered in the review, the effect of the code change was explored analytically using simple models.

A variety of analytical techniques were used, depending on the situation at hand. One general approach was to select a basic structural element (a beam, a column, a frame, a slab, or the like) and analytically test it, under both the older and the current criteria. For example, a typical structural element and a simple loading were selected; the element was then designed to the older code requirements. Next, the load carrying capacity of this structure was reexamined using current code criteria. Finally, the load carrying capacities of the element, as shown by the older criteria and as determined by the current criteria, were compared. Examples of investigations performed to assess code change impacts are found in Appendix C.

---

\*Geometry, material properties, magnitude or type of loading, type of supports-- to name a few.

In making these studies, an attempt was made to use structural elements, model dimensions, and load magnitudes that were representative of actual structures. For studies that were parametized, an attempt was made to span the parametric range encountered in nuclear structures.

Although one must be cautious about claiming that results from simplified models may be totally applicable to the more complex situations occurring in real structures, it was felt that such examples provided reasonable guidance for making rational judgments concerning the impact of changed code provisions on perceived margins of safety.

#### 7.4 ASSESSMENT OF THE POTENTIAL IMPACT OF CODE CHANGES

As the scope of the Task III-7.B assignment indicates, a limited objective is sought in assessing the effects of code changes on Seismic Category I structures.

The scope of this review is not set at the level of appraisal of individual, as-built structures on plant sites. Consequently, the review does not attempt to make quantitative assessments as to the structural adequacy under current NRC criteria of specific structures at particular SEP plants.

To the contrary, the scope is confined to the comparison of former structural codes and criteria with counterpart current requirements. Correspondingly, the assessment of the impact of changes in codes and criteria is confined to what can be deduced solely from the provisions of the codes and criteria.

Although the review is therefore carried out with minimal reference to actual structures in the field, the assessments of code change impacts that can be made at the code comparison level hold considerable significance for actual structures.

In this respect, two important points should be noted:

1. The review brings sharply into focus the changes in code provisions that may give rise to concern with respect to structural margins of



safety as perceived from the standpoint of the requirements that NRC now imposes upon plants currently being licensed.

The review simultaneously culls away a number of code changes that do not give rise to such concerns, but which (because they are there) would otherwise have to be addressed, on a structure-by-structure basis.

2. The effects of code changes that can be determined from the level of code review are confined to potential or possible impacts on actual structures.

A review conducted at the code comparison level cannot determine whether or not potentially adverse impacts are actually realized in a given structure. The review may only warn that this may be the case.

For example, current criteria may require demonstration of structural integrity under a loading combination that includes an additional load not specified in the corresponding loading combination to which the structure was designed. If the non-considered load is large (i.e., in the order of or larger than other major loads that were included), then it is quite possible that some members in the structure would appear overloaded as viewed by current criteria. Thus a potential concern exists.

However, no determination as to actual overstress in any member can be made by code review alone. Actual margins of safety in the controlling member (and several others\*) must certainly be examined before even a tentative judgment of this kind may be attempted.

In order to carry out the code review objective of identifying criteria changes that could potentially impair perceived margins of safety, the following scheme classifying code change impacts was adopted.

#### 7.4.1 Classification of Code Changes

Where code changes involve technical content (as opposed to those which are editorial, organizational, administrative, and the like), the changes are classified according to the following scheme.

---

\*The addition of a new load can change the location of the point of highest stress.

Each such code change is classified according to its potential to alter perceived margins of safety\* in structural elements to which it applies. Four categories are established:

Scale A Change - The new criteria have the potential to substantially impair margins of safety as perceived under the former criteria.

Scale A<sub>x</sub> Change - The impact of the code change on margins of safety is not immediately apparent. Scale A<sub>x</sub> code changes require analytical studies of model structures to assess the potential magnitude of their effect upon margins of safety.

Scale B Change - The new criteria operate to impair margins of safety but not enough to cause engineering concern about the adequacy of any structural element.

Scale C Change -- The new criteria will give rise to larger margins of safety than were exhibited under the former criteria.

#### 7.4.1.1 General and Conditional Classifications of Code Change Impacts

Scale ratings of code changes are found in two different forms in this report. For example, some are designated as "Scale A," and others as "Scale C." Others have dual designation, such as "Scale A if --- [a condition statement] or Scale C if --- [a second condition statement]."

In assigning scale classifications, an efficient design to original criteria is assumed. That is, it is postulated that (a) the provision in question controls design, and (b) the structural member to which the code provision applies was proportioned to be at (or close to) the allowable limit. The impact scale rating is assigned accordingly.

If the code change is Scale A, and it applies (in a particular structure) to a member which is not highly stressed, then this may afford excellent grounds for asserting that this particular member is adequate; but it does not thereby downgrade the ranking to, say, a Scale B change for that member. The

---

\*That is, if (all other considerations remaining the same) safety margins as computed by the older code rules were to be recomputed for an as-built structure in accordance with current code provisions, would there be a difference due only to the code change under consideration?

scale ranking is neither a function of member stress\* nor a ranking of member adequacy. The scale system ranks code change impact, not individual members.

However, a number of code provisions are framed so that the allowable limit is made a function of member proportion. When this kind of a code provision is changed, the change may affect members of certain proportions one way and members of other proportions differently.

For example, assume a change in column design requirements is introduced into the code and is framed in terms of the ratio of the effective column length to its radius of gyration. The new rule acts to tighten design requirements for slender columns, but liberalizes former requirements for columns that are not slender. This change may be rated Scale A for slender columns, and simultaneously, Scale C for non-slender ones. Although some columns now appear to be Scale A columns while others appear to be Scale C columns, the distinction between them resides in the code, and is not a reflection of member adequacy. Clearly, it is still the code changes that are ranked; but, in this case, the code change does not happen to affect all columns in a unilateral way.

#### 7.4.1.2 Code Impact on Structural Margins

This classification of code changes identifies both (a) changes that have the potential to significantly impair perceived margins of safety (Scale A) and (b) changes that have the potential to enhance perceived margins of safety (Scale C).

Emphasis is subsequently placed on Scale A changes, not on Scale C changes. The purpose of the code comparison review is to narrow down and bring into sharper focus the areas where structures shown adequate under former criteria may not fully comply with current criteria. Once such criteria changes have been identified, actual structures may be checked to see if the potential concern is applicable to the structure. Depending upon a number of structure-specific circumstances, it may or may not pertain.

---

\*There are exceptions, but these are code-related, not adequacy-related.

The same thing is true of Scale C changes, i.e., those that may enhance perceived structural margins. Specific structures must be examined to see if the potential benefit is actually applicable to the structure. If it is applicable, credit may be taken for it. However, this step can only be taken at the structural level, not at the code level.

A simple example may help clarify this point. Assume a steel beam exists in a structure designed by AISC 1963 rules for the then-specified loading combination. Current criteria require inclusion of an additional load in the loading combination (Scale A change), but the current structural code permits a higher allowable load if the beam design conforms to certain stipulated proportions (Scale C change). Several circumstances are possible for beams in actual structures, as shown below.

<u>New Load</u>	<u>Higher Stress Limit</u>	<u>Results</u>
Maximum stress in beam under original loading conditions was low with ample margin for additional load	Applicability immaterial	Beam adequate under current criteria
Maximum stress in beam under original loading condition was near former allowable limit	Beam qualifies for higher stress limit	Beam may be adequate under current criteria
Maximum stress in beam under original loading condition was near former allowable limit	Beam does not qualify for increased stress limit	Beam unlikely to be adequate under current criteria

It is clear from this example that the function of the code review is to point out code changes which might impair perceived margins of safety, and that assessment of their pertinence is best accomplished at the structure-specific level.

## 7.5 PLANT-SPECIFIC CODE CHANGES

There is substantial overlap among the SEP plants in the codes and standards used for structural design. Several plants, for example, followed the provisions of ACI-318, 1963 edition, in designing major concrete structures.

Thus, the initial work of comparing older and current criteria is not plant-specific. However, when the reviewed codes are packaged in sets containing only those code comparisons relevant to design of Seismic Category I structures in a particular SEP plant, the results begin to take on plant-specific character.

The code changes potentially applicable to particular structures at a particular SEP plant have then been identified. However, this list is almost surely overly long because the list has been prepared without reference to actual plant structures. For example, the code change list might include an item relating to recently introduced provisions for the design of slender columns, while none actually exist in any structures in that particular plant.

In-depth examination of design drawings, audit of structural analyses, and review of plant specifications were beyond the scope of the III-7.B task; accordingly, such activities were not attempted. However, occasional reference to such documents was necessary to the review work. Consequently, it was possible to cull from the list some items that were obviously inappropriate to the San Onofre plant structures. Wherever this was done, the reason for removal was documented, but no attempt was made to remove every such item.

Code changes that may be significant for structures in general but did not appear applicable to any of the Seismic Category I structures at the San Onofre plant were relegated to Appendix A. The Scale A or Scale A<sub>x</sub> changes that remained are listed on a code-by-code basis in Section 11.

## 8. SAN ONOFRE SEISMIC CATEGORY I STRUCTURES

SEP Topic III-1 has for its objectives the classification of components, structures, and systems with respect to both quality group and seismic designation. The task force charged with this responsibility has presented its findings in Reference 6, and the following structures have been determined to be Seismic Category I:

- o Containment sphere structure including penetrations
- o Sphere enclosure building
- o Reactor auxiliary building
- o Control room, switchgear room, and battery room in control building
- o Intake structure
- o Spent fuel building and spent fuel pit in fuel storage building
- o New diesel generator building
- o Turbine building areas 6 and 7 below HP and LP heater platform

The primary vent stack is not mentioned in Reference 6. It may be appropriate, however, to include the primary vent stack in the above list as a Seismic Category I structure based on its proximity to other Seismic Category I equipment and structures; therefore, load and load combination tables for the vent stack are included in this report.

## 9. STRUCTURAL DESIGN CRITERIA

The structural codes governing design of the major Seismic Category I structures for the San Onofre Unit 1 Nuclear Generating Station are detailed in the following table.

<u>Structure</u>	<u>Design Criteria</u>	<u>Current Criteria</u>
1. Containment Sphere	ASME Section III, Subsection B, 1963	ASME Section III, Division 1, Subsection NE, 1980
2. Sphere Enclosure Building	ACI 318-71 UBC, 1973 AISC, 1969 (with supplements 1 & 2)	ACI 349-76 ACI 349-76 AISC, 1980
3. Reactor Auxiliary Building	ACI 318-63 AISC, 1963	ACI 349-76 AISC, 1980
4. Control and Switchgear Rooms in Control Building	ACI 318-63 AISC, 1963	ACI 349-76 AISC, 1980
5. Intake Structure	ACI 318-63	ACI 349-76
6. Fuel Storage Building	ACI 318-63 AISC, 1963	ACI 349-76 AISC, 1980
7. New Diesel Generator Building	ACI 318-71 AISC, 1969 (with supplements 1, 2, & 3)	ACI 349-76 AISC, 1980
8. Turbine Building*	UBC-1961 AISC, 1963	ACI 349-76 AISC, 1980

The major codes used for the original design are identified in References 4 and 8.

\* The implied conformance to ACI 318-63 is assumed in this review.

## 10. LOADS AND LOAD COMBINATION CRITERIA

### 10.1 DESCRIPTION OF TABLES OF LOADS AND LOAD COMBINATIONS

The requirements governing loads and load combinations to be considered in the design of civil engineering structures for nuclear service have been revised since the older nuclear power plants were constructed and licensed. Such changes constitute a major aspect of the general pattern of evolving design requirements; consequently, they are singled out for special consideration in this section of this report.

The NRC Regulatory Guides and Standard Review Plans provide guidance as to what loads and load combinations must be considered. In some cases, the required loads and load combinations are also specified within the governing structural design code; other structural codes have no such provisions and take loads and load combinations as given a priori. In this report, loads and load combinations are treated within the present section whether or not the structural design codes also include them.

Later sections of this report address, paragraph by paragraph, changes in text between design codes current at the time the plant was constructed and those governing design today; however, to avoid repetition, code changes related to loads and load combinations will not be evaluated again although they may appear as provisions of the structural design codes.

To provide a compact and systematic comparison of previous and present requirements, two sets of tables are used:

1. load tables
2. load combination tables.

Both sets of tables are constructed in accordance with current requirements for Seismic Category I structures, i.e., the load tables list all loads that must be considered in today's design of these structures (as enumerated in NRC's Standard Review Plan), and the load combination tables list all combinations of these loadings for which current licensing procedures require demonstration of structural integrity.



In general, the loads and load combinations to be considered are determined by the structure under discussion. The design loads for the structure housing the emergency power diesel generator, for example, are quite different than those for the design of the containment vessel. Consequently, structures must be considered individually. Each structure usually requires a load table and load combination table appropriate to its specific design requirements.

The design requirements for the various civil engineering structures within a nuclear power plant are echoed in applicable sections of NRC's Standard Review Plan (SRP) 3.8. The tables in the present report correspond to, and summarize, these requirements for each structure. A note at the bottom of each table provides the reference to the applicable section of the Standard Review Plan. Section 10.2 of this report lists, for reference, the load symbols used in the charts together with their definitions.

The loads actually used for design are considered, structure by structure, and the load tables are filled in according to the following scheme:

1. The list of potentially applicable loads (according to current requirements) is examined to eliminate loads which either do not occur on, or are not significant for, the structure under consideration.
2. The loads included in the actual design basis are then checked against the reduced list to see if all applicable loads (according to current requirements) were actually considered during design.
3. Each load that was considered during design is next screened to see if it appears to correspond to current requirements. Questions such as the following are addressed: Were all the individual loads encompassed by the load category definition represented in the applied loading? Do all loads appear to match present requirements (1) in magnitude? (2) in method of application?
4. An annotation is made as to whether deviations from present requirements exist, either because of load omissions or because the loads do not correspond in magnitude or in other particulars.
5. If a deviation is found, a judgment (in the form of a scale ranking) is made as to the potential impact of the deviation on perceived margins of safety.
6. Relevant notes or comments are recorded.

Of particular importance to the Topic III-7.B review are comments indicating that the effects of certain loadings (tornado and seismic loads, in particular) are being examined under other SEP topics. In all such cases, the findings of these special SEP topics (where review in depth of the indicated loading conditions will be undertaken) will be definitive for the overall SEP effort. Consequently, no licensee investigation of such issues is required under Topic III-7.B nor is such effort within the scope of Topic III-7.B (see Section 4). Licensee participation in the resolution of such issues may, however, be requested under the scope of other SEP topics devoted to such issues.

After the load tables have been filled out, the load combination tables are compiled. Like the load tables, the load combination tables are drawn up to current requirements and the load combinations actually used in the design basis are matched against these requirements.

Current criteria require consideration during plant design of 13 load combinations for most structures, as shown in the load combination tables. These specific requirements were not in effect at the time when SEP plants were designed. Consequently, other sets of load combinations were used. In comparing actual and current criteria, an attempt was made to match each of the load combinations actually considered to its nearest counterpart under present requirements. For example, consider a plant where the safe shutdown earthquake was addressed in combination with other loads, but not in combination with the effects of a LOCA (load combination 13). The load combination tables would reflect this by showing that load case 9 was addressed, but that load case 13 was not. If six load cases were considered, only six (nearest counterpart) load cases are indicated in the table--not partial fulfillment of all 13.

For ease of comparison, the load combinations actually used are superimposed on the load combinations currently required. This is accomplished in two steps:

1. Currently specified load combinations include loads sufficient for the most general cases. In particular applications, some of these are either inappropriate or insignificant. Therefore, the first step

is to strike all loads that are not applicable to the structure under consideration from all load combinations in which they appear.

2. Next, loads actually combined are indicated by encircling (in the appropriate load combinations) each load contributing to the summation considered for design.

Thus, the comparison between what was actually done and what is required today is readily apparent. If the load combinations used are in complete accord with current requirements, each load symbol on the sheet appears as either struck or encircled. Load combinations not considered, and loads omitted from the load combinations stand out as unencircled items.

A scale ranking is next assigned to the load combinations; however (unlike the corresponding ranking of loads), a scale ranking is not necessarily assigned to each one. When the load combinations used for design correspond closely to current requirements, scale ratings may be assigned to all combinations. However, when the number of load combinations considered in design was substantially fewer than current criteria prescribe, it did not appear to serve any engineering purpose to rank the structure for each currently required load combination. Instead, a limited number of loading cases (usually two) were ranked.

The following considerations guided the selection of these cases:

1. For purposes of the SEP review, it was not believed necessary to require an extensive reanalysis of structures under all load combinations currently specified.
2. SEP plants have been in full power operation for a number of years. During this time, they have experienced a wide spectrum of operating and upset conditions. There is no evidence that major Seismic Category I structures lack integrity under these operating conditions.
3. The most severe load combinations occur under emergency and accident conditions. These are also the conditions associated with the greatest consequences to public health and safety.
4. If demonstration of structural adequacy under the most severe load combinations currently specified for emergency and accident conditions is provided, a reasonable inference can be drawn that the structure is also adequate to sustain the less severe loadings associated with less severe consequences.

The scale rankings assigned to loads and load combinations in tables are intended as an appraisal of plant status, with respect to demonstration of compliance with current design criteria, based on information available to the NRC prior to the inception of the SEP review. A number of structurally related SEP topics review some loads and load combinations in detail based upon current calculational methods. In order that a consistent basis for the tables be maintained, they are based upon load combinations considered in the original design of the facility or, in the case of facility modifications, they are based upon the combinations used in the design of the modification. Loads that were not included in the original design or that have increased in magnitude and have not been specifically addressed in another SEP topic should be addressed by the Licensee.

## 10.2 LOAD DEFINITIONS

- D Dead loads or their related internal moments and forces (such as permanent equipment loads).
- E or E<sub>0</sub> Loads generated by the operating basis earthquake.
- E' or E<sub>SS</sub> Loads generated by the safe shutdown earthquake.
- F Loads resulting from the application of pre-stress.
- H Hydrostatic loads under operating conditions.
- H<sub>a</sub> Hydrostatic loads generated under accident conditions, such as post-accident internal flooding. (F<sub>L</sub> is sometimes used by others\* to designate post-LOCA internal flooding.)
- L Live loads or their related internal moments and forces (such as movable equipment loads).
- P<sub>a</sub> Pressure load generated by accident conditions (such as those generated by the postulated pipe break accident).
- P<sub>0</sub> or P<sub>v</sub> Loads resulting from pressure due to normal operating conditions.

\*See, for example, SRP 3.8.2.

- $P_S$  All pressure loads which are caused by the actuation of safety relief valve discharge including pool swell and subsequent hydrodynamic loads.
- $R_a$  or  $R_r$  Pipe reactions under accident conditions (such as those generated by thermal transients associated with an accident).
- $R_O$  Pipe reactions during startup, normal operating, or shutdown conditions, based on the critical transient or steady-state condition.
- $R_S$  All pipe reaction loads which are generated by the discharge of safety relief valves.
- $T_a$  Thermal loads under accident conditions (such as those generated by a postulated pipe break accident).
- $T_O$  Thermal effects and loads during startup, normal operating, or shutdown conditions, based on the most critical transient or steady-state condition.
- $T_S$  All thermal loads which are generated by the discharge of safety relief valves.
- $W$  Loads generated by the design wind specified for the plant.
- $W'$  or  $W_t$  Loads generated by the design tornado specified for the plant. Tornado loads include loads due to tornado wind pressure, tornado-created differential pressure, and tornado-generated missiles.
- $Y_j$  Equivalent static load on the structure generated by the impingement of the fluid jet from the broken pipe during the design basis accident.
- $Y_m$  Missile impact equivalent static load on the structure generated by or during the design basis accident, such as pipe whipping.
- $Y_r$  Equivalent static load on the structure generated by the reaction on the broken pipe during the design basis accident.

The load combination charts correspond to loading cases and load definitions as specified in the appropriate SRP. Each chart is associated with a specific SRP as identified in the notes accompanying the chart. Guidance with respect to the specific loads which must be considered in forming each load combination is provided by the referenced SRP. All SRPs are prepared to a standard format; consequently, subsection 3 of each plan always contains the appropriate load definitions and load combination guidance.

10.3 DESIGN LOAD TABLES

"COMPARISON OF DESIGN BASIS LOADS"

COMPARISON OF DESIGN BASIS LOADS

STRUCTURE:  
CONTAINMENT SPHERE -- Steel

PLANT: SAN ONOFRE 1

	Current Design Basis Loads	Is Load Applicable To This Structure?	Is Load Included In Plant Design Basis?	SEP Topic Reviewing This Load	Does Load Magnitude Correspond To Present Criteria?	Does Deviation Exist In Load Basis?	Code Impact Scale Ranking	Comments
Gravity	D	Yes	Yes	-----	Yes	No	---	
	L	Yes	Yes	-----	Yes	No	---	
Pressure	F	No	---	-----	---	No	---	
	H	Yes	No	III-5.A	*	*	*	1.
	P <sub>o</sub>	Yes	Yes	-----	---	No	---	
	P <sub>a</sub>	Yes	Yes	VI-2.D, III-7.B	*	*	*	2. 3
Thermal	P <sub>a</sub>	No	No	-----	---	No	---	
	T <sub>o</sub>	Yes	Yes	-----	---	---	---	
	T <sub>a</sub>	Yes	Yes	VI-2.D, III-7.B	*	*	*	2.
Pipe & Mech.	T <sub>s</sub>	No	No	-----	---	No	---	
	R <sub>o</sub>	Yes	Yes	-----	---	4.	---	
	R <sub>a</sub>	Yes	Yes	-----	---	4.	A <sub>x</sub>	
Environmental	R <sub>s</sub>	No	No	-----	---	No	---	
	E'	Yes	Yes	III-6	*	*	A <sub>x</sub>	6.
	E	Yes	Yes	III-6	*	*	*	
	W'	No	No	III-2, III-4.A	*	*	*	
Impulse	W	No	Yes	III-2, III-4.A	*	*	*	5.
	Y <sub>r</sub>	Yes	No	III-5.A	*	*	*	
	Y <sub>j</sub>	Yes	No	III-5.A	*	*	*	
	Y <sub>m</sub>	Yes	No	III-5.A	*	*	*	

Ref.: SRP(1981) Section 3.3.1 or 3.3.2

Comments

\* To be determined per results of SEP topics. Scale ranking shown for SEP topic items are independent judgments, based on information in the FSAR or other original design documents.

- Item III-3.A of reference 4 states that "The design of the Unit 1 structures did not include water loads resulting from the effects of high water levels. However, in 1977 the capacity of the San Onofre Unit 1 storm drain system was increased such that precipitation of probable maximum intensity will not result in flooding of safety-related structures, systems, and components.
- Paragraph 4.3.2.2 of reference 5 states that the sphere is designed for an internal pressure of 46.4 psig and a temperature of 271.2°F, and a maximum temperature rise of 200°F. This is design pressure.
- Paragraph 3.8.2.3 of reference 8 states that an internal pressure of 49.4 psig was used in the analysis. This pressure represents the post accident containment peak pressure.
- Paragraph 3.8.2.3 of reference 8 states that the feed water piping loads due to differential thermal and seismic movement were treated as primary loads and combined with dead weight, design pressure and seismic inertia loads. No mention of how other pipes were treated.
- Section 4.3.2.3 of the FSA Reference 11 states that the design wind velocity of 100 mph was originally used for the sphere. The sphere enclosure building constructed later relieved the sphere from the necessity of carrying the wind loads.
- Paragraph 9.2.5.2 of Volume V of Part II of the FSAR states that an equivalent horizontal static force equal to 25 percent of the structures dead weight and an equivalent vertical static force equal to two-thirds of the horizontal force were applied to the sphere. For subsequent evaluation containment post accident reanalysis 1977 enclosure 2 to reference 9 states "earthquake loading associated with DBE (2/3g Housner) and OBE (1/3 DBE)" were used.

COMPARISON OF DESIGN BASIS LOADS

STRUCTURE: 1.  
SPHERE ENCLOSURE BUILDING

PLANT: SAN ONOFRE 1

	Current Design Basis Loads	Is Load Applicable To This Structure?	Is Load Included In Plant Design Basis?	SEP Topic Reviewing This Load	Does Load Magnitude Correspond To Present Criteria?	Does Deviation Exist In Load Basis?	Code Impact Scale Ranking	Comments
Gravity	D	Yes	Yes	-----	Yes	No	---	
	L	Yes	Yes	-----	Yes	No	---	
Pressure	F	No	No	-----	---	No	---	
	H	No 4.	No	III-3.A	*	*	*	
	P <sub>a</sub>	Yes	Yes	III-5.B	*	*	*	6.
Thermal	T <sub>o</sub>	Yes	Yes	-----	---	No	---	
	T <sub>a</sub>	Yes	Yes	III-5.B	*	*	*	6.
Pipe & Mech.	R <sub>o</sub>	Yes	Yes	-----	---	---	---	
	R <sub>a</sub>	Yes	Yes	-----	---	---	---	
Environmental	E'	Yes	Yes	III-6	*	*	*	5.
	E	Yes	Yes	III-6	*	*	*	
	W'	Yes	Yes	III-2, III-4.A	*	*	*	3.
	W	Yes	Yes	III-2, III-4.A	*	*	*	2.
Impulse	Y <sub>T</sub>	Yes	Yes	III-5.B	*	*	*	6.
	Y <sub>J</sub>	Yes	Yes	III-5.B	*	*	*	6.
	Y <sub>m</sub>	Yes	Yes	III-5.B	*	*	*	6.

Ref.; SRP(1981) Section 3.3.4

Comments

\* To be determined per results of SEP topics. Scale ranking shown for SEP topic items are independent judgments, based on information in the FSAR or other original design documents.

- Reference 10 indicates that a finite element model with dynamic capabilities is to be used for the design of the building. Results of this analysis is not available for FRC evaluation.
- Paragraph 3.1.1.3.2, Reference 10, states the design wind load will be based on a design wind velocity (defined as the fastest mph of wind at 30 feet above ground level) of 100 mph.
- Section 3.b. of Reference 12 states the following:- "The building is also designed for the effect of a tornado wind having a maximum total horizontal velocity of 250 mph and an atmospheric pressure drop of 1.5 psi in 4.5 seconds followed by a constant pressure for 3 seconds and a repressurization. Because these values deviate from the design basis tornado characteristics for Region II described in Regulatory Guide 1.76, 'Design Basis Tornado for Nuclear Power Plants', the licensee provided an analysis of tornado data from seven southwestern California counties for the period 1952 to 1975. Our independent evaluation of the data, based on the method described in WASH-1300, "Technical Basis for Interim Regional Tornado Criteria", showed that these values are acceptable for the Station site."
- Section 3.b of reference 12 states that the highest flood or ground water elevation is below the base of the sphere enclosure building, therefore, such effects will not affect the design of the building.
- Section 3.b. of reference 12 states that "The seismic input for the sphere enclosure building is the same as that used for SONGS, Units 2 and 3. Units 2 and 3 are located at the same site as Unit 1 and were evaluated and accepted by us using current seismic design criteria. The damping values for structures and components are in agreement with Regulatory Guide 1.61 and the damping values for soil are conservatively estimated from experimental data."
- Section 3.b. of reference 12 states that " The building will be designed to resist various combinations of dead loads, live loads, and environmental loads as discussed above. Loads generated by a postulated high-energy pipe break, including pressure, temperature, reaction and jet impingement forces and impact effects of whipping pipe, are also considered in the design. The load combinations and acceptance criteria are the same as those used on recent license applications and are in agreement with our position on this matter."



COMPARISON OF DESIGN BASIS LOADS

STRUCTURE:  
REACTOR AUXILIARY BUILDING

PLANT: SAN ONOFRE I

	Current Design Basis Loads	Is Load Applicable To This Structure	Is Load Included In Plant Design Basis?	SEP Topic Reviewing This Load	Does Load Magnitude Correspond To Present Criteria?	Does Deviation Exist In Load Basis?	Code Impact Scale Ranking	Comments
Gravity	D	Yes	Yes	---	Yes	No	---	
	L	Yes	Yes	---	Yes	No	---	
Pressure	F	No	No	---	---	No	---	
	H	Yes	Yes	III-3.A	*	*	*	3
	P <sub>a</sub>	Yes	---	III-5.B	*	*	*	
Thermal	T <sub>o</sub>	Negl.	---	---	---	No	---	
	T <sub>a</sub>	Yes	---	III-5.B	*	*	*	
Pipe & Mech.	R <sub>o</sub>	Yes	No	---	---	---	---	
	R <sub>a</sub>	Yes	---	---	---	---	A <sub>x</sub>	
Environmental	E'	Yes	No	III-6	*	*	A <sub>x</sub>	
	E	Yes	Yes	III-6	*	*	*	1.
	W'	Yes	No	III-2, III-4.A	*	*	A <sub>x</sub>	
	W	Yes	Yes	III-2, III-4.A	*	*	*	2.
Impulse	Y <sub>r</sub>	Yes	---	III-5.B	*	*	*	
	Y <sub>j</sub>	Yes	---	III-5.B	*	*	*	
	Y <sub>m</sub>	Yes	---	III-5.B	*	*	*	

Ref.; SRP(1981) Section 3.8.4

Comments

\* To be determined per results of SEP topics. Scale ranking shown for SEP topic items are independent judgments, based on information in the FSAR or other original design documents.

1. Response E.(2) of item III-7.B of reference (4) states that stresses were limited to working stress levels for the 0.25g Housner spectrum. Since the building was assumed rigid, a 0.25g static force was applied.
2. Response E.(2) of item III-7.B of reference (4) states that load corresponding to 80 mph (15psf) were used for this structure since it is less than 30 ft above ground.
3. Response E(2) of item III-7.B of reference (4) states that "Hydrostatic loads due to ground water and vehicle surcharge loadings were also considered."

COMPARISON OF DESIGN BASIS LOADS

STRUCTURE: CONTROL AND SWITCH-  
GEAR ROOMS IN CONTROL  
ADMINISTRATIVE BUILDING  
(Main Building)

PLANT: SAN ONOFRE I

	Current Design Basis Loads	Is Load Applicable To This Structure?	Is Load Included In Plant Design Basis?	SEP Topic Reviewing This Load	Does Load Magnitude Correspond To Present Criteria?	Does Deviation Exist In Load Basis?	Code Impact Scale Ranking	Comments
Gravity	D	Yes	Yes	-----	Yes	No	-----	
	L	Yes	Yes	-----	Yes	No	-----	
Pressure	F	No	---	-----	---	No	-----	
	H	No	No	III-3.A	*	*	*	
	P <sub>a</sub>	---	---	III-5.B	*	*	*	
Thermal	T <sub>O</sub>	Negl.	---	-----	---	No	-----	
	T <sub>a</sub>	---	---	III-5.B	*	*	*	
Pipe & Mech.	R <sub>O</sub>	No	---	-----	---	No	-----	
	R <sub>a</sub>	No	---	-----	---	No	-----	
Environmental	E'	Yes	Yes	III-6	*	*	A <sub>x</sub>	1.
	E	Yes	Yes	III-6	*	*	*	1.
	W'	Yes	No	III-2, III-4.A	*	*	A <sub>x</sub>	
	W	Yes	Yes	III-2, III-4.A	*	*	*	
Impulse	Y <sub>r</sub>	No	---	III-5.B	*	*	*	
	Y <sub>j</sub>	No	---	III-5.B	*	*	*	
	Y <sub>m</sub>	No	---	III-5.B	*	*	*	

Ref.; SRP(1981) Section 3.8.4

Comments

\* To be determined per results of SEP topics. Scale ranking shown for SEP topic items are independent judgments, based on information in the FSAR or other original design documents.

1. Response D (2) of item III-7.B of reference 4 states that seismic inputs of 0.25g and 0.5g were considered.

COMPARISON OF DESIGN BASIS LOADS

STRUCTURE:  
INTAKE STRUCTURE

PLANT: SAN ONOFRE I

	Current Design Basis Loads	Is Load Applicable To This Structure?	Is Load Included In Plant Design Basis?	SEP Topic Reviewing This Load	Does Load Magnitude Correspond To Present Criteria?	Does Deviation Exist In Load Basis?	Code Impact Scale Ranking	Comments
Gravity	D	Yes	Yes	----	Yes	No	---	
	L	Yes	Yes	----	Yes	No	---	
Pressure	F	No	No	----	---	No	---	
	H	Yes	Yes	III-3.A	*	*	*	1.
	P <sub>a</sub>	No	No	III-5.B	*	*	*	
Thermal	T <sub>o</sub>	Negl.	---	----	---	No	---	
	T <sub>a</sub>	No	---	III-5.B	*	*	*	
Pipe & Mech.	R <sub>o</sub>	---	---	----	---	---	---	
	R <sub>a</sub>	No	---	----	---	No	---	
Environmental	E'	Yes	No	III-6	*	*	A <sub>x</sub>	
	E	Yes	Yes	III-6	*	*	*	2.
	W'	Yes	No	III-2, III-4.A	*	*	*	
	W	Yes	---	III-2, III-4.A	*	*	*	
Impulse	Y <sub>r</sub>	No	No	III-5.B	*	*	*	
	Y <sub>j</sub>	No	No	III-5.B	*	*	*	
	Y <sub>m</sub>	No	No	III-5.B	*	*	*	

Ref.; SRP(1981) Section 3.8.4

Comments

\* To be determined per results of SEP topics. Scale ranking shown for SEP topic items are independent judgments, based on information in the FSAR or other original design documents.

1. Response H of Item III-3.B of reference 4 states that "The intake structure was designed for dead load plus live load plus earth pressure plus an H20 vehicle surcharge load."
2. Response H of Item III-3.B of reference 4 states that "A seismic lateral load based upon a 0.25g Housner spectrum was also considered in combination with dead load."

COMPARISON OF DESIGN BASIS LOADS

STRUCTURE:  
FUEL STORAGE BUILDING

PLANT: SAN ONOFRE I

	Current Design Basis Loads	Is Load Applicable To This Structure	Is Load Included In Plant Design Basis?	SEP Topic Reviewing This Load	Does Load Magnitude Correspond To Present Criteria?	Does Deviation Exist In Load Basis?	Code Impact Scale Ranking	Comments
Gravity	D	Yes	Yes	----	Yes	No	---	
	L	Yes	Yes	----	Yes	No	---	
Pressure	F	No	No	----	---	No	---	
	H	Yes	No	III-3.A	*	*	*	3.
	P <sub>a</sub>	No	---	III-5.B	*	*	*	
Thermal	T <sub>o</sub>	Negl.	---	----	---	No	---	
	T <sub>a</sub>	No	No	III-5.B	*	*	*	
Pipe & Mech.	R <sub>o</sub>	No	---	----	---	No	---	
	R <sub>a</sub>	No	---	----	---	No	---	
Environmental	E'	Yes	No	III-6	*	*	A <sub>x</sub>	1.
	E	Yes	Yes	III-6	*	*	*	1.
	W'	Yes	No	III-2, III-4.A	*	*	A <sub>x</sub>	2.
	W	Yes	Yes	III-2, III-4.A	*	*	*	2.
Impulse	Y <sub>r</sub>	No	---	III-5.B	*	*	*	
	Y <sub>j</sub>	No	---	III-5.B	*	*	*	
	Y <sub>m</sub>	No	---	III-5.B	*	*	*	

Ref.; SRP(1981) Section 3.8.4

Comments

- \* To be determined per results of SEP topics. Scale ranking shown for SEP topic items are independent judgments, based on information in the FSAR or other original design documents.
1. Response E.(2) of item III-7.B of reference (4) indicates that static force based on 0.25g was used as the seismic load.
  2. Response E.(2) of item III-7.B of reference (4) states that wind loads of 20 psf, corresponding to 90 mph were utilized.
  3. Paragraph III-3.A of reference (4) states that "The design of the Unit 1 structures did not include water loads resulting from the effects of high water levels. However, in 1977 the capacity of the San Onofre Unit 1 storm drain system was increased such that precipitation of probable maximum intensity will not result in flooding of safety-related structures, systems, and components.

COMPARISON OF DESIGN BASIS LOADS

STRUCTURE: NEW DIESEL  
GENERATOR BUILDING 1.

PLANT: SAN ONOFRE I

	Current Design Basis Loads	Is Load Applicable To This Structure?	Is Load Included In Plant Design Basis?	SEP Topic Reviewing This Load	Does Load Magnitude Correspond To Present Criteria?	Does Deviation Exist In Load Basis?	Code Impact Scale Ranking	Comments
Gravity	D	Yes	Yes	---	Yes	No	---	
	L	Yes	Yes	---	Yes	No	---	
Pressure	F	No	No	---	---	No	---	4.
	H	No	Yes	III-3.A	*	*	*	
	P <sub>a</sub>	No	---	III-5.B	*	*	---	
Thermal	T <sub>o</sub>	Negl.	---	---	---	No	---	
	T <sub>a</sub>	No	---	III-5.B	*	*	---	
Pipe & Mech.	R <sub>o</sub>	Yes	Yes	---	---	---	---	
	R <sub>a</sub>	No /	---	---	---	No	---	
Environmental	E'	Yes	Yes	III-6	*	*	*	3. 2.
	E	Yes	Yes	III-6	*	*	*	
	W'	Yes	Yes	III-2, III-4.A	*	*	*	
	W	Yes	Yes	III-2, III-4.A	*	*	*	
Impulse	Y <sub>r</sub>	No	---	III-5.B	*	*	*	
	Y <sub>j</sub>	No	---	III-5.B	*	*	*	
	Y <sub>m</sub>	No	---	III-5.B	*	*	*	

Ref.; SRP(1981) Section 3.8.4

Comments

\* To be determined per results of SEP topics. Scale ranking shown for SEP topic items are independent judgments, based on information in the FSAR or other original design documents.

- Reference 9 indicates that the referenced analysis is intended to be used in the design of the new diesel generator building. This building was being designed at the time reference 9 was issued.
- Paragraph B-2, item 2, reference 9 states that the design wind load will be based on a design wind velocity of 100 mph at 30 ft. above ground level.
- Paragraph C-2, item 2, reference 9 states that the diesel generator building will be designed to withstand a tornado wind having a maximum total horizontal velocity of 260 mph, corresponding to 220 mph rotational wind with translational velocity of 40 mph. and per reference 13, those wind loading criteria we found to be acceptable.
- Reference 13 states the highest flood or ground water elevation is below the diesel generator building foundation, which will not be adversely affected by flooding.

## COMPARISON OF DESIGN BASIS LOADS

STRUCTURE: TURBINE BUILDING  
AREAS 6 & 7 BELOW HP & LP HEATER  
PLATFORM

PLANT: SAN ONOFRE I

	Current Design Basis Loads	Is Load Applicable To This Structure?	Is Load Included In Plant Design Basis?	SEP Topic Reviewing This Load	Does Load Magnitude Correspond To Present Criteria?	Does Deviation Exist In Load Basis?	Code Impact Scale Ranking	Comments
Gravity	D	Yes	Yes	---	---	No	---	
	L	Yes	Yes	---	---	No	---	
Pressure	F	No	---	---	---	No	---	
	H	Yes	---	III-3.A	*	*	*	
	P <sub>a</sub>	Yes	No	III-5.B	*	*	*	
Thermal	T <sub>o</sub>	Negl.	No	---	---	No	---	
	T <sub>a</sub>	Yes	No	III-5.B	*	*	*	
Pipe & Mech.	R <sub>o</sub>	Yes	No	---	---	Yes	---	
	R <sub>a</sub>	Yes	No	---	---	Yes	---	
Environmental	E'	Yes	No	III-6	*	*	A <sub>x</sub>	1
	E	Yes	Yes	III-6	*	*	*	
	W'	Yes	No	III-2, III-4.A	*	*	A <sub>x</sub>	1
	W	Yes	Yes	III-2, III-4.A	*	*	*	
Impulse	Y <sub>r</sub>	Yes	---	III-5.B	*	*	*	
	Y <sub>j</sub>	Yes	---	III-5.B	*	*	*	
	Y <sub>m</sub>	Yes	---	III-5.B	*	*	*	

Ref.; SRP(1981) Section 3.3.4

Comments

\* To be determined per results of SEP topics. Scale ranking shown for SEP topic items are independent judgments, based on information in the FSAR or other original design documents.

1. Response G.2 of item III-7.B of reference 4 states that "The design seismic load was 0.2 times the dead load (including the gantry crane) applied in any direction. A wind load of 15 psf was considered, however, the seismic load case governed the design."

COMPARISON OF DESIGN BASIS LOADS

STRUCTURE:

VENT STACK (steel)

PLANT: SAN ONOFRE I

	Current Design Basis Loads	Is Load Applicable To This Structure?	Is Load Included In Plant Design Basis?	SEP Topic Reviewing This Load	Does Load Magnitude Correspond To Present Criteria?	Does Deviation Exist In Load Basis?	Code Impact Scale Ranking	Comments
Gravity	D	Yes						
	L	Yes						
Pressure	F	No	-	-	-	No	-	
	H	No	-	III-3.A	*	*	*	
	P <sub>a</sub>	No	-	III-5.B	*	*	*	
Thermal	T <sub>o</sub>	Yes						
	T <sub>a</sub>	No		III-5.B	*	*	*	
Pipe & Mech.	R <sub>o</sub>	Yes						(Duct)
	R <sub>a</sub>	No	-	-	-	-	-	
Environmental	E'	Yes		III-6	*	*	*	
	E	Yes		III-6	*	*	*	
	W'	Yes		III-2, III-4.A	*	*	*	
	W	Yes		III-2, III-4.A	*	*	*	
Impulse	Y <sub>r</sub>	No		III-5.B	*	*	*	
	Y <sub>j</sub>	No		III-5.B	*	*	*	
	Y <sub>m</sub>	No		III-5.B	*	*	*	

Ref.: SRP(1981) Section 3.8.4

Comments

\* To be determined per results of SEP topics. Scale ranking shown for SEP topic items are independent judgments, based on information in the FSAR or other original design documents.

10.4 LOAD COMBINATION TABLES

"COMPARISON OF LOADING COMBINATION CRITERIA"



COMPARISON OF LOADING COMBINATION CRITERIA

PLANT: SAN ONOFRE 1

		STRUCTURE CONTAINMENT SPHERE						
	Combined Loading Cases	Gravity Dead, Live	Thermal	Pressure	Mechanical	Natural Phenomena	Impulsive Loading	Scale Ranking
Service Level A	1	$\textcircled{D + L}$	$\textcircled{T_o}$	$\textcircled{P_o}$	$\textcircled{R_o}$			
	2	D + L	$T_a$	$P_a$	$R_a$			
	3	D + L	$T_a$	$P_a$	$R_a$			
	4	D + L	$T_a + T_e$	$P_a + P_e$	$R_a + R_e$			
Service Level B	1	$\textcircled{D + L}$	$\textcircled{T_a}$	$\textcircled{P_a}$	$\textcircled{R_a}$	$\textcircled{E}$		
	2	$\textcircled{D + L}$	$\textcircled{T_o}$	$\textcircled{P_o}$	$\textcircled{R_o}$	$\textcircled{E}$		
	3	D + L	$T_a$	$P_a$	$R_a$	E		
	4	D + L	$T_a + T_e$	$P_a + P_e$	$R_a + R_e$			
Service Level C	1	$\textcircled{D + L}$	$\textcircled{T_a}$	$\textcircled{P_a}$	$\textcircled{R_a}$	$\textcircled{E'}$		
	2	$\textcircled{D + L}$	$\textcircled{T_o}$	$\textcircled{P_o}$	$\textcircled{R_o}$	$\textcircled{E'}$		
	3	D + L	$T_a + T_e$	$P_a + P_e$	$R_a + R_e$	E'		
Service Level D	1	D + L	$T_a$	$P_a$	$R_a$	E'	$Y_r + Y_j + Y_m$	
	2	D + L	$T_a + T_e$	$P_a + P_e$	$R_a + R_e$	E'	$Y_r + Y_j + Y_m$	$A_x$ 2.
Post - LOCA Flooding	1	D + L		$F_L$		E		

Ref.: SRP Section 3.8.2 Steel Containment

Notes

1. Encircled loads are those actually considered in the design per FSAR. When load factors different from those currently required were used, the factor used is also encircled.
2. For purposes of the SEP Review, demonstration that structural integrity is maintained for load case indicated above (per current criteria) may be considered as providing reasonable assurance that this structure meets the intent of current design criteria.

COMPARISON OF STRESS LIMITS

FOR  
STEEL CONTAINMENT STRUCTURES

PLANT SAN ONOFRE 1

Franklin Research Center  
A Division of The Franklin Institute

SERVICE LEVEL	CURRENT CRITERIA (REF.: TABLE NE - 3221-1, ASME SECTION III, 1980)		DESIGN CRITERIA (REF.: Seismic Reevaluation and Modification, San Onofre 1 April 29, 1977 - NRC Docket 50-206)	
	CRITERIA	VALUE, psi	CRITERIA	VALUE, psi
A	$P_m$	$1.0 S_{mc}$		
	$P_L$	$1.5 S_{mc}$		
	$P_L + P_b$	$1.5 S_{mc}$		
	$P_L + P_b + Q$ (See note 6)	$3.0 S_{m1}$		
B	$P_m$	$1.0 S_{mc}$	$P_m$	$1.0 S_m$ 21600
	$P_L$	$1.5 S_{mc}$	$P_L$	$1.5 S_m$ 32400
	$P_L + P_b$	$1.5 S_{mc}$	$P_L + P_b$	$1.5 S_m$ 32400
	$P_L + P_b + Q$ (See note 6)	$3.0 S_{m1}$		
C	$P_m$	$1.2 S_{mc}$ or $1.0 S_y$	$P_m$	$1.2 S_m$ 25920
	$P_L$	$1.8 S_{mc}$ or $1.5 S_y$	$P_L$	$1.8 S_m$ 38880
	$P_L + P_b$	$1.8 S_{mc}$ or $1.5 S_y$	$P_L + P_b$	$1.8 S_m$ 38880
	$P_L + P_b + Q$ (See notes 3, 4 & 6)		$P_L + P_b + Q$	$3.0 S_m$ 64800
D	$P_m$	$1.0 S_f$		
	$P_L$	$1.5 S_f$		
	$P_L + P_b$ (See notes 2, 5 & 6)	$1.5 S_f$		
POST-FLOODING CONDITION	$P_m$	$1.2 S_{mc}$ or $1.0 S_y$		
	$P_L$	$1.8 S_{mc}$ or $1.5 S_y$		
	$P_L + P_b$	$1.8 S_{mc}$ or $1.5 S_y$		
	$P_L + P_b + Q$ (See notes 4 & 6)	$3.0 S_{m1}^y$		

SHELL MATERIAL *	
SPEC. NO. SA 212 GRADE: B SA 300 Requirements	
YIELD STRESS ( $S_y$ ) = 38,000 psi	
ULT. STRENGTH ( $S_u$ ) = 70,000 psi (see note 8)	
CURRENT PRIMARY STRESS INTENSITY LIMIT	$S_{mc} = 19,250$ psi $S_{m1} = 22,500$ psi $\phi = 300$ °F (see notes 1 & 8)
DESIGN PRIMARY MEMBRANE STRESS LIMIT	$S = 17,500$ psi $\phi = 300$ °F

\* SA 212 Grade B is equivalent to SA-516 Grade 70 of the ASME Section III, 1980 Code

- NOTES: 1. NOTE THAT CURRENT PRIMARY STRESS INTENSITY LIMITS PRESUME (AMONG OTHER CODE QUALITY CONTROLS) MODERN COMPUTERIZED METHODS OF ANALYSIS. CONSEQUENTLY, CAUTION SHOULD BE OBSERVED IN MAKING DIRECT COMPARISONS WITH DESIGN STRESS LIMITS APPROPRIATE FOR LESS MODERN ANALYTICAL PROCEDURES.
2. THE COMPARABLE CURRENT CRITERIA ASSUMING ELASTIC METHODS WERE USED FOR THE ORIGINAL DESIGN ANALYSIS.
3. VALUES SHOWN PERTAIN TO INTEGRAL AND CONTINUOUS STRUCTURES ONLY.
4. THE LARGER OF THE TWO LIMITS IS APPLICABLE.
5.  $S_f$  IS 85% OF THE GENERAL PRIMARY MEMBRANE ALLOWABLE PERMITTED IN APPENDIX F OF SECTION III, ASME CODE.
6. IN ALL INSTANCES FATIGUE AND BUCKLING CRITERIA MUST ALSO BE SATISFIED.
7. IN ACCORDANCE WITH ASME III, DIV. 1, SUBSECT. NE, SUBPARA. NE 2121, THIS MATERIAL IS NOT LISTED AMONG THOSE CURRENTLY PERMITTED. REF: APPENDICES TABLE 1-10.1 "CURRENT" STRESS VALUES LISTED ARE DERIVED USING  $S_{mc} = 1.1 \times 1/4 \times S_u$ , and  $S_{m1} = 0.300 \phi F$  FROM TABLE N-421 ASME B&PV CODE SEC. III, CLASS A, (1965).
8. AS PER PARA. 3.8.2.5 OF REFERENCE 10, THE MINIMUM TENSILE STRENGTH OF THE CONTAINMENT SPHERE MATERIAL AS USED IN THE ANALYSIS WAS ESTABLISHED BY STATISTICAL APPROACH. THE RESULTING ALLOWABLE STRESS INTENSITY  $S_m$  WAS 21,600 PSI, WHICH AMOUNTS TO AN INCREASE OF 12% OVER THE VALUE OF  $S_m$  WHICH WOULD BE OBTAINED BASED UPON THE MATERIAL SPECIFICATIONS.

COMPARISON OF LOADING COMBINATION CRITERIA  
 CONCRETE STRUCTURES  
 PLANT: SAN ONOFRE 1

STRUCTURE: 4.,5.  
 SPHERE ENCLOSURE BUILDING  
 (concrete)

Combined Loading Cases	Gravity Dead, Live	Thermal	Pressure	Mechanical	Natural Phenomena	Impulsive Loading	Scale Ranking
1	1.4D + 1.7L						
2	1.4D + 1.7L				1.9E		
3	1.4D + 1.7L				1.7W		
4	.75 (1.4D + 1.7L)	.75 x 1.7 T <sub>o</sub>		.75 x 1.7 R <sub>o</sub>			
5	.75 (1.4D + 1.7L)	.75 x 1.7 T <sub>o</sub>		.75 x 1.7 R <sub>o</sub>	.75 x 1.9E		
6	.75 (1.4D + 1.7L)	.75 x 1.7 T <sub>o</sub>		.75 x 1.7 R <sub>o</sub>	.75 x 1.7W		
7	1.2D				1.9E		
8	1.2D				1.7W		
9	D + L	T <sub>o</sub>		R <sub>o</sub>	E'		
10	D + L	T <sub>o</sub>		R <sub>o</sub>	W <sub>c</sub>		
11	D + L	T <sub>a</sub>	1.5 P <sub>a</sub>	R <sub>a</sub>			
12	D + L	T <sub>a</sub>	1.25 P <sub>a</sub>	R <sub>a</sub>	1.25E	Y <sub>r</sub> + Y <sub>j</sub> + Y <sub>m</sub>	
13	D + L	T <sub>a</sub>	P <sub>a</sub>	R <sub>a</sub>	E'	Y <sub>r</sub> + Y <sub>j</sub> + Y <sub>m</sub>	

Ref.: SRP (1981) Sect. 3.8.4 Other Category I structures (concrete)

Notes

1. Ultimate strength method required by ACI-349 (1977).
2. Methods used in design { working stress  
ultimate strength
3. Loads deemed inapplicable or negligible struck from loading combinations.
4. Full compliance with the above load combinations was planned for this design, as indicated in reference 10. The licensee should indicate which load combinations were selected as governing design and analyzed for resulting stresses.
5. In a number of cases, the compliance with current criteria of assumed loads is to be determined by other SEP tasks. (See the appropriate chart comparing design basis loads to current criteria in Section 10.3 of this report). For any loads found to deviate from current criteria, the licensee should assess the effect of this deviation on the stress results found for the load combinations in which such loads appear.

COMPARISON OF LOADING COMBINATION CRITERIA  
 STEEL STRUCTURES (Elastic Analysis)  
 PLANT: SAN ONOFRE 1

STRUCTURE:  
 SPHERE ENCLOSURE BUILDING  
 (steel) 3.

Combined Loading Cases	Gravity Dead, Live	Thermal	Pressure	Mechanical	Natural Phenomena	Impulsive Loading	Scale
1	D + L						
2	D + L				E		
3	D + L				W		
4	D + L	$T_o$		<del><math>R_a</math></del>			
5	D + L	$T_o$		<del><math>R_a</math></del>	E		
6	D + L	$T_o$		<del><math>R_a</math></del>	W		
7	D + L	$T_o$		<del><math>R_a</math></del>	E'		
8	D + L	$T_o$		<del><math>R_a</math></del>	$W_t$		
9	D + L	$T_a$	$P_a$	<del><math>R_a</math></del>			
10	D + L	$T_a$	$P_a$	<del><math>R_a</math></del>	E	$Y_j + Y_r + Y_m$	
11	D + L	$T_a$	$P_a$	<del><math>R_a</math></del>	E'	$Y_j + Y_r + Y_m$	

Ref: SRP (1981) SECT. 3.8.4 Other Category I structures (steel)

Notes

1. Encircled loads are those actually considered in the design. When load factors are different from those currently required were used, the factor used is also encircled.
2. Loads deemed inapplicable or negligible struck from loading combinations.
3. Full compliance with the above load combinations was planned for this design, as indicated in reference 10. The licensee should indicate which load combinations were selected as governing design and analyzed for resulting stresses.
4. In a number of cases, the compliance with current criteria of assumed loads is to be determined by other SEP tasks. (See the appropriate chart comparing design basis loads to current criteria in Section 10.3 of this report). For any loads found to deviate from current criteria, the licensee should assess the effect of this deviation on the stress results found for the load combinations in which such loads appear.

5.  
COMPARISON OF LOADING COMBINATION CRITERIA  
CONCRETE STRUCTURES  
PLANT: SAN ONOFRE 1

STRUCTURE:  
REACTOR AUXILIARY BUILDING

Combined Loading Cases	Gravity Dead, Live	Thermal	Pressure	Mechanical	Natural Phenomena	Impulsive Loading	Scale Ranking
1	1.4D + 1.7L						
2	1.4D + 1.7L				1.9E		
3	1.4D + 1.7L				1.7W		
4	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		.75 x 1.7 R <sub>o</sub>			
5	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		.75 x 1.7 R <sub>o</sub>	.75 x 1.9E		
6	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		.75 x 1.7 R <sub>o</sub>	.75 x 1.7W		
7	1.2D				1.9E		
8	1.2D				1.7W		
9	$\boxed{D + L}$	<del>A</del>		$\boxed{R_o}$	$\boxed{E'}$		
10	D + L	<del>A</del>		R <sub>o</sub>	W <sub>c</sub>		A <sub>x</sub>
11	D + L	T <sub>a</sub>	1.5 P <sub>a</sub>	R <sub>a</sub>			
12	D + L	T <sub>a</sub>	1.25 P <sub>a</sub>	R <sub>a</sub>	1.25E	Y <sub>r</sub> + Y <sub>j</sub> + Y <sub>m</sub>	
13	D + L	T <sub>a</sub>	P <sub>a</sub>	R <sub>a</sub>	E'	Y <sub>r</sub> + Y <sub>j</sub> + Y <sub>m</sub>	A <sub>x</sub>














Ref.: SRP (1981) Sect. 3.8.4 Other Category I structures (concrete)

Notes

1. Ultimate strength method required by ACI-349 (1977).
2. Methods used in design { working stress ✓  
ultimate strength
3. Loads deemed inapplicable or negligible struck from loading combinations.
4. Encircled loads are those actually considered in the design. When load factors different from those currently required were used, the factor used is also encircled.
5. Information on original design basis is not stated in the material provided for review.
6. For purposes of the SEP Review demonstration that structural integrity is maintained for load cases 10, 13 (per current criteria) may be considered as providing reasonable assurance that this structure meets the intent of current design criteria.
7. Loads which enter the load combination proposed by SCECo for seismic review under SEP Topic III-6 are indicated by dash-lined boxes.
8. The loads contributing to the loading combinations appropriate to the steel portions of this structure are essentially the same as those shown above for the concrete construction.

COMPARISON OF LOADING COMBINATION CRITERIA  
 CONCRETE STRUCTURES  
 PLANT: SAN ONOFRE I

STRUCTURE: CONTROL & SWITCH-  
 GEAR ROOMS IN CONTROL  
 ADMINISTRATIVE BUILDING

Combined Loading Cases	Gravity Dead, Live	Thermal	Pressure	Mechanical	Natural Phenomena	Impulsive Loading	Scale Ranking
1	1.4D + 1.7L						
2	1.4D + 1.7L				1.9E <sup>5.</sup>		
3	1.4D + 1.7L				1.7W		
4	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		<del>.75 x 1.7 R<sub>o</sub></del>			
5	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		<del>.75 x 1.7 R<sub>o</sub></del>	.75 x 1.9E		
6	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		<del>.75 x 1.7 R<sub>o</sub></del>	.75 x 1.7W		
7	1.2D				1.9E		
8	1.2D				1.7W		
9	D + L				E <sup>5.</sup>		A <sub>x</sub>
10	D + L				W <sub>c</sub>		A <sub>x</sub>
11	D + L	T <sub>a</sub>	1.5 P <sub>a</sub>				
12	D + L	T <sub>a</sub>	1.25 P <sub>a</sub>		1.25E	 +  + 	
13	D + L	T <sub>a</sub>	P <sub>a</sub>		E'	 +  + 	

Ref.: SRP (1981) Sect. 3.8.4 Other Category I structures (concrete)

Notes

1. Ultimate strength method required by ACI-349 (1977).
2. Methods used in design { working stress ✓  
~~ultimate strength~~
3. Loads deemed inapplicable or negligible struck from loading combinations.
4. Encircled loads are those actually considered in the design. When load factors different from those currently required were used, the factor used is also encircled.
5. Paragraph D.2 of Section III-7.3, Reference 4, states that seismic inputs of 0.25g and 0.5g were considered.
6. For purposes of the SEP Review, demonstration that structural integrity is maintained for load cases 9, 10 (per current criteria) may be considered as providing reasonable assurance that this structure meets the intent of current design criteria.
7. Loads which enter the load combination proposed by SCECo for seismic review under SEP Topic III-6 are indicated by dash-lined boxes.
8. The loads contributing to the loading combinations appropriate to the steel portions of this structure are essentially the same as those shown above for the concrete construction.

5.  
COMPARISON OF LOADING COMBINATION CRITERIA

CONCRETE STRUCTURES  
PLANT: SAN ONOFRE I

STRUCTURE:  
INTAKE STRUCTURE

Combined Loading Cases	Gravity Dead, Live	Thermal	Pressure	Mechanical	Natural Phenomena	Impulsive Loading	Scale Ranking
1	1.4D + 1.7L						
2	1.4D + 1.7L				1.9E		
3	1.4D + 1.7L				1.7W		
4	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		.75 x 1.7 R <sub>o</sub>			
5	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		.75 x 1.7 R <sub>o</sub>	.75 x 1.9E		
6	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		.75 x 1.7 R <sub>o</sub>	.75 x 1.7W		
7	1.2D				1.9E		
8	1.2D				1.7W		
9	<u>D + L</u>	<del>T<sub>o</sub></del>		<u>R<sub>o</sub></u>	<u>E'</u>		A <sub>x</sub>
10	D + L	<del>T<sub>o</sub></del>		R <sub>o</sub>	W <sub>t</sub>		A <sub>x</sub>
11	D + L	<del>T<sub>o</sub></del>	<del>1.5 P<sub>a</sub></del>	<del>R<sub>o</sub></del>			
12	D + L	<del>T<sub>o</sub></del>	<del>1.25 P<sub>a</sub></del>	<del>R<sub>o</sub></del>	1.25E	<del>T<sub>o</sub></del> + <del>R<sub>o</sub></del> + <del>P<sub>a</sub></del>	
13	D + L	<del>T<sub>o</sub></del>	<del>P<sub>a</sub></del>	<del>R<sub>o</sub></del>	E'	<del>T<sub>o</sub></del> + <del>R<sub>o</sub></del> + <del>P<sub>a</sub></del>	

Ref.: SRP (1981) Sect. 3.8.4 Other Category I structures (concrete)

Notes

1. Ultimate strength method required by ACI-349 (1977).
2. Methods used in design { working stress ✓  
~~ultimate strength~~
3. Loads deemed inapplicable or negligible struck from loading combinations.
4. Encircled loads are those actually considered in the design. When load factors different from those currently required were used, the factor used is also encircled.
5. Information on original design basis is not stated in the material provided for review. The licensee should indicate which load combinations were selected as governing design and analyzed for resulting stresses.
6. For purposes of the SEP Review, demonstration that structural integrity is maintained for load cases 9, 10 (per current criteria) may be considered as providing reasonable assurance that this structure meets the intent of current design criteria.
7. Loads which enter the load combination proposed by SCECo for seismic review under SEP Topic III-6 are indicated by dash-lined boxes.

COMPARISON OF LOADING COMBINATION CRITERIA <sup>5.</sup>  
 CONCRETE STRUCTURES  
 PLANT: SAN ONOFRE I

STRUCTURE:  
 FUEL STORAGE BUILDING

Combined Loading Cases	Gravity Dead, Live	Thermal	Pressure	Mechanical	Natural Phenomena	Impulsive Loading	Scale Ranking
1	1.4D + 1.7L						
2	1.4D + 1.7L				1.9E		
3	1.4D + 1.7L				1.7W		
4	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		<del>.75 x 1.7 R<sub>o</sub></del>			
5	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		<del>.75 x 1.7 R<sub>o</sub></del>	.75 x 1.9E		
6	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		<del>.75 x 1.7 R<sub>o</sub></del>	.75 x 1.7W		
7	1.2D				1.9E		
8	1.2D				1.7W		
9	<u>D + L</u>	<del>T<sub>a</sub></del>		<del>R<sub>a</sub></del>	<u>E'</u>		A <sub>x</sub>
10	D + L	<del>T<sub>a</sub></del>		<del>R<sub>a</sub></del>	W <sub>c</sub>		A <sub>x</sub>
11	D + L	T <sub>a</sub>	<del>1.5 P<sub>a</sub></del>	<del>R<sub>a</sub></del>			
12	D + L	T <sub>a</sub>	<del>1.25 P<sub>a</sub></del>	<del>R<sub>a</sub></del>	1.25E	<del>T<sub>a</sub></del> + <del>R<sub>a</sub></del> + <del>R<sub>a</sub></del>	
13	D + L	T <sub>a</sub>	<del>R<sub>a</sub></del>	<del>R<sub>a</sub></del>	E'	<del>T<sub>a</sub></del> + <del>R<sub>a</sub></del> + <del>R<sub>a</sub></del>	

Ref.: SRP (1981) Sect. 3.8.4 Other Category I structures (concrete)

- Notes:
1. Ultimate strength method required by ACI-349 (1977).
  2. Methods used in design { working stress ✓  
ultimate strength
  3. Loads deemed inapplicable or negligible struck from loading combinations.
  4. Encircled loads are those actually considered in the design. When load factors different from those currently required were used, the factor used is also encircled.
  5. Information on original design basis is not stated in the material provided for review. The licensee should indicate which load combinations were selected as governing design and analyzed for resulting stresses.
  6. For purposes of the SEP Review, demonstration that structural integrity is maintained for load cases 9, 10 (per current criteria) may be considered as providing reasonable assurance that this structure meets the intent of current design criteria.
  7. Loads which enter the load combination proposed by SCECo for seismic review under SEP Topic III-6 are indicated by dash-lined boxes.



3.  
 COMPARISON OF LOADING COMBINATION CRITERIA  
 STEEL STRUCTURES (Elastic Analysis)  
 PLANT: SAN ONOFRE I

STRUCTURE:  
 FUEL STORAGE BUILDING

Combined Loading Cases	Gravity Dead, Live	Thermal	Pressure	Mechanical	Natural Phenomena	Impulsive Loading	Scale
1	D + L						
2	D + L				E		
3	D + L				W		
4	D + L	<del>T<sub>a</sub></del>		<del>P<sub>a</sub></del>			
5	D + L	<del>T<sub>a</sub></del>		<del>P<sub>a</sub></del>	E		
6	D + L	<del>T<sub>a</sub></del>		<del>P<sub>a</sub></del>	W		
7	<span style="border: 1px solid black; padding: 2px;">D + L</span>	<del>T<sub>a</sub></del>		<del>P<sub>a</sub></del>	<span style="border: 1px solid black; padding: 2px;">E'</span>		A <sub>x</sub>
8	D + L	<del>T<sub>a</sub></del>		<del>P<sub>a</sub></del>	W <sub>t</sub>		A <sub>x</sub>
9	D + L	T <sub>a</sub>	<del>P<sub>a</sub></del>	<del>P<sub>a</sub></del>			
10	D + L	T <sub>a</sub>	<del>P<sub>a</sub></del>	<del>P<sub>a</sub></del>	E	<del>J</del> + <del>J</del> + <del>J</del>	
11	D + L	T <sub>a</sub>	<del>P<sub>a</sub></del>	<del>P<sub>a</sub></del>	E'	<del>J</del> + <del>J</del> + <del>J</del>	

Ref; SRP (1981) SECT. 3.8.4 Other Category I structures (steel)

Notes

1. Encircled loads are those actually considered in the design. When load factors are different from those currently required were used, the factor used is also encircled.
2. Loads deemed inapplicable or negligible struck from loading combinations.
3. Information on original design basis is not stated in the material provided for review.
4. For purposes of the SEP Review, demonstration that structural integrity is maintained for load cases 7, 8 (per current criteria) may be considered as providing reasonable assurance that this structure meets the intent of current design criteria.
5. Loads which enter the load combination proposed by SCECo for seismic review under SEP Topic III-6 are indicated by dash-lined boxes.

COMPARISON OF LOADING COMBINATION CRITERIA  
 CONCRETE STRUCTURES  
 PLANT: SAN ONOFRE I

STRUCTURE:  
 NEW DIESEL GENERATOR  
 BUILDING 5.

Combined Loading Cases	Gravity Dead, Live	Thermal	Pressure	Mechanical	Natural Phenomena	Impulsive Loading	Scale Ranking
1	1.4D + 1.7L						
2	1.4D + 1.7L				1.9E		
3	1.4D + 1.7L				1.7W		
4	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		.75 x 1.7 R <sub>o</sub>			
5	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		.75 x 1.7 R <sub>o</sub>	.75 x 1.9E		
6	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		.75 x 1.7 R <sub>o</sub>	.75 x 1.7W		
7	1.2D				1.9E		
8	1.2D				1.7W		
9	D + L	<del>T<sub>o</sub></del>		R <sub>o</sub>	E'		
10	D + L	<del>T<sub>o</sub></del>		R <sub>o</sub>	W <sub>t</sub>		
11	D + L	<del>T<sub>o</sub></del>	<del>1.5 P<sub>a</sub></del>	R <sub>a</sub>			
12	D + L	<del>T<sub>o</sub></del>	<del>1.35 P<sub>a</sub></del>	R <sub>a</sub>	1.25E	<del>T<sub>o</sub></del> + <del>T<sub>o</sub></del> + <del>T<sub>o</sub></del>	
13	D + L	<del>T<sub>o</sub></del>	<del>T<sub>o</sub></del>	R <sub>a</sub>	E'	<del>T<sub>o</sub></del> + <del>T<sub>o</sub></del> + <del>T<sub>o</sub></del>	

Ref.: SRP (1981) Sect. 3.8.4 Other Category I structures (concrete)

- Notes
1. Ultimate strength method required by ACI-349 (1977).
  2. Methods used in design { working stress ✓  
~~ultimate strength~~
  3. Loads deemed inapplicable or negligible struck from loading combinations.
  4. Licensee states that all 13 load combinations will be considered in the design.
  5. Reference 9 indicates that the referenced load combinations are intended to be used in the design of the new diesel generator building. This building was being designed at the time reference 9 was issued. Information on the final load combinations actually used was not made available. The licensee should indicate which load combinations were selected as governing design and analyzed for resulting stresses.
  6. In a number of cases, the compliance with current criteria of assumed loads is to be determined by other SEP-tasks. (See the appropriate chart-comparing design basis loads to current criteria in Section 10.3 of this report). For any loads found to deviate from current criteria, the licensee should assess the effect of this deviation on the stress results found for the load combinations in which such loads appear.

5.  
COMPARISON OF LOADING COMBINATION CRITERIA  
CONCRETE STRUCTURES  
PLANT: SAN ONOFRE I

STRUCTURE: TURBINE BUILDING  
AREAS 6 & 7 BELOW HP & LP  
HEATER PLATFORM

Combined Loading Cases	Gravity Dead, Live	Thermal	Pressure	Mechanical	Natural Phenomena	Impulsive Loading	Scale Ranking
1	1.4D + 1.7L						
2	1.4D + 1.7L				1.9E		
3	1.4D + 1.7L				1.7W		
4	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		.75 x 1.7 R <sub>o</sub>			
5	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		.75 x 1.7 R <sub>o</sub>	.75 x 1.9E		
6	.75 (1.4D + 1.7L)	<del>.75 x 1.7 T<sub>o</sub></del>		.75 x 1.7 R <sub>o</sub>	.75 x 1.7W		
7	1.2D				1.9E		
8	1.2D				1.7W		
9	<u>D + L</u>	<del>T<sub>a</sub></del>		<u>R<sub>o</sub></u>	<u>E'</u>		
10	D + L	<del>T<sub>a</sub></del>		R <sub>o</sub>	W <sub>t</sub>		A <sub>x</sub>
11	D + L	T <sub>a</sub>	1.5 P <sub>a</sub>	R <sub>a</sub>			
12	D + L	T <sub>a</sub>	1.25 P <sub>a</sub>	R <sub>a</sub>	1.25E	Y <sub>r</sub> + Y <sub>j</sub> + Y <sub>m</sub>	
13	D + L	T <sub>a</sub>	P <sub>a</sub>	R <sub>a</sub>	E'	Y <sub>r</sub> + Y <sub>j</sub> + Y <sub>m</sub>	A <sub>x</sub>

Ref.: SRP (1981) Sect. 3.8.4 Other Category I structures (concrete)

- Notes
1. Ultimate strength method required by ACI-349 (1977).
  2. Methods used in design { working stress  
ultimate strength
  3. Loads deemed inapplicable or negligible struck from loading combinations.
  4. Encircled loads are those actually considered in the design. When load factors different from those currently required were used, the factor used is also encircled.
  5. Information on original design basis is not stated in the material provided for review. The licensee should indicate which load combinations were selected as governing design and analyzed for resulting stresses.
  6. For purposes of the SEP Review, demonstration that structural integrity is maintained for load cases 10, 13 (per current criteria) may be considered as providing reasonable assurance that this structure meets the intent of current design criteria.
  7. Loads which enter the load combination proposed by SCECo for seismic review under SEP Topic III-6 are indicated by dash-lined boxes.
  8. The loads contributing to the loading combinations appropriate to the steel portions of this structure are essentially the same as those shown above for the concrete construction.

COMPARISON OF LOADING COMBINATION CRITERIA  
 STEEL STRUCTURES (Elastic Analysis)  
 PLANT: SAN ONOFRE I

STRUCTURE:  
 PRIMARY VENT STACK

Combined Loading Cases	Gravity Dead, Live	Thermal	Pressure	Mechanical	Natural Phenomena	Impulsive Loading	Scale
1	D + L						
2	D + L				E		
3	D + L				W		
4	D + L	T <sub>o</sub>		R <sub>o</sub>			
5	D + L	T <sub>o</sub>		R <sub>o</sub>	E		
6	D + L	T <sub>o</sub>		R <sub>o</sub>	W		
7	D + L	T <sub>o</sub>		R <sub>o</sub>	E'		A <sub>x</sub> 4.
8	D + L	T <sub>o</sub>		R <sub>o</sub>	W <sub>t</sub>		A <sub>x</sub> 4.
9	D + L	<del>T<sub>o</sub></del>	<del>P</del>	<del>R<sub>o</sub></del>			
10	D + L	<del>T<sub>o</sub></del>	<del>P</del>	<del>R<sub>o</sub></del>	E	<del>J</del> + <del>K</del> + <del>L</del>	
11	D + L	<del>T<sub>o</sub></del>	<del>P</del>	<del>R<sub>o</sub></del>	E'	<del>J</del> + <del>K</del> + <del>L</del>	

Ref; SRP (1981) SECT. 3.8.4 Other Category I structures (steel)

Notes

1. Encircled loads are those actually considered in the design. When load factors are different from those currently required were used, the factor used is also encircled.
2. Loads deemed inapplicable or negligible struck from loading combinations.
3. Information on original design basis is not stated in material provided for review.
4. The principal loads on the stack are D, E, E', W and W<sub>t</sub>. Reanalysis of the stack for these loadings is being carried out within the SEP Program. Therefore, no action need be taken by licensee in response to this item.

## 11. REVIEW FINDINGS

The most important findings of the review are summarized in this section in tabular form.

The major structural codes used for design of Seismic Category I buildings and structures for the San Onofre Nuclear Generating Station, Unit 1, were:

1. AISC, "Specification for Design, Fabrication, and Erection of Structural Steel for Buildings," 1963
2. ACI 318-63, "Building Code Requirements for Reinforced Concrete," 1963
3. ASME Boiler and Pressure Vessel Code, Section III, 1963
4. ACI 318-71, "Building Code Requirements for Reinforced Concrete," 1971
5. AISC, "Specification for Design, Fabrication, and Erection of Structural Steel for Buildings," 1971.

Each of these design codes has been compared with the corresponding structural code governing current licensing criteria. Tables follow, in the order listed above, summarizing important results of these comparisons for each code.

These tables provide:

1. identification by paragraph number (both of the original code and of its current counterpart) of code provisions where Scale A or Scale  $A_x$  deviations exist.
2. identification of structural elements to which each such provision may apply.

Some listed provisions may apply only to elements that do not exist in the San Onofre structures. When it could be determined that this was the case, such provisions were struck from the list. Any provisions that appeared to be inapplicable for other reasons also were eliminated. Items so removed are listed in Appendix A to this report.

Access to further information concerning code provision changes is provided by additional appendixes. Each pair of codes (the design and the

current ones) has a tabular summary within the report (Appendix B) which lists all code changes by scale ranking.

In addition, a separately bound appendix exists for each code pair. The appendix provides:

1. full texts of each revised provision in both the former and current versions
2. comments or conclusions, or both, relevant to the code change
3. the scale ranking of the change.

11.1 MAJOR FINDINGS OF AISC-1963 VS. AISC-1980 CODE COMPARISON

## MAJOR FINDINGS OF AISC 1963 VS. AISC 1980 CODE COMPARISON

(Summary of Code Changes with the Potential to Significantly  
Degrade Perceived Margin of Safety)

Scale A

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>AISC 1980</u>	<u>AISC 1963</u>		
1.5.1.2.2	--	Beam end connection where the top flange is coped and subject to shear, or failure by shear along a plane through fasteners or by a combination of shear along a plane through fasteners plus tension along a perpendicular plane	See case study 1 for details.
1.5.1.4.1 Subpara 7	1.5.1.4.1	Hollow circular sections subject to bending	New requirements in the 1980 Code
1.9.1.2 and Appendix C	1.9.1	Slender compression unstiffened elements subject to axial compression or compression due to bending when actual width-to-thickness ratio exceeds the values specified in subsection 1.9.1.2	New provisions added in the 1980 Code, Appendix C  See case study 10 for details.
1.9.2.3 and Appendix C	--	Circular tubular elements subject to axial compression	New requirements added in the 1980 Code
1.11.4	--	Shear connectors in composite beams	New requirements added in the 1980 Code regarding the distribution of shear connectors (eqn. 1.11-7). The diameter and spacing of the shear connectors are also subject to new controls.



Scale A (Cont.)

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>AISC 1980</u>	<u>AISC 1963</u>		
1.11.5	--	Composite beams or girders with formed steel deck	New requirements added in the 1980 Code
1.14.2.2	--	Axially loaded tension members where the load is transmitted by bolts or rivets through some but not all of the cross-sectional elements of the members	New requirement added in the 1980 Code
1.15.5.2 1.15.5.3 1.15.5.4	--	Restrained members when flange or moment connection plates for end connections of beams and girders are welded to the flange of I or H shaped columns	New requirement added in the 1980 Code
2.9	2.8	Lateral bracing of members to resist lateral and torsional displacement	<p><u>Scale</u></p> <p>A <math>0.0 &lt; M/M_p &lt; 1.0</math>  C <math>0.0 &gt; M/M_p &gt; -1.0</math></p> <p>See case study 7 for details.</p>

11.2 MAJOR FINDINGS OF ACI 318-63 VS. ACI 349-76 CODE COMPARISON

## MAJOR FINDINGS OF ACI 318-63 VS. ACI 349-76 CODE COMPARISON

(Summary of Code Changes with the Potential to Significantly  
Degrade Perceived Margin of Safety)

Scale A

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-63</u>		
7.10.3	805	Columns designed for stress reversals with variation of stress from $f_y$ in compression to $1/2 f_y$ in tension	Splices of the main reinforcement in such columns must be reasonably limited to provide for adequate ductility under all loading conditions.
11.13		Short brackets and corbels which are primary load-carrying members	As this provision is new, any existing corbels or brackets may not meet these criteria and failure of such elements could be non-ductile type failure. Structural integrity may be seriously endangered if the design fails to fulfill these requirements.
11.15	--	Applies to any elements loaded in shear where it is inappropriate to consider shear as a measure of diagonal tension and the loading could induce direct shear type cracks.	Structural integrity may be seriously endangered if the design fails to fulfill these requirements.

## MAJOR FINDINGS OF ACI 318-63 VS. ACI 349-76 CODE COMPARISON

(Summary of Code Changes with the Potential to Significantly Degrade Perceived Margin of Safety)

Scale A (Cont.)

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-63</u>		
11.16	--	All structural walls - those which are primary load carrying, e.g., shear walls and those which serve to provide protection from impacts of missile-type objects.	Guidelines for these kinds of wall loads were not provided by older codes; therefore, structural integrity may be seriously endangered if the design fails to fulfill these requirements.
Appendix A	--	All elements subject to time-dependent and position-dependent temperature variations and restrained so that thermal strains will result in thermal stresses.	For structures subject to effects of pipe break, especially jet impingement, thermal stresses may be significant. "Scale A" for areas of jet impingement or where conditions could develop causing concrete temperature to exceed the limitations of A.4.2.  For structures not subject to effects of pipe break accident, thermal stresses are unlikely to be significant (Scale B).

## MAJOR FINDINGS OF ACI 318-63 VS. ACI 349-76 CODE COMPARISON

(Summary of Code Changes with the Potential to Significantly Degrade Perceived Margin of Safety)

Scale A (Cont.)

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-63</u>		
Appendix B	--	All steel embedments used to transmit loads from attachments into the reinforced concrete structure.	New appendix; therefore, considerable review of older designs is warranted. Since stress analysis associated with these conditions is highly dependent on definition of failure planes and allowable stress for these special conditions, past practice varied with designers' opinions. Stresses may vary significantly from those thought to exist under previous design procedures.
Appendix C	--	All elements whose failure under impulsive and impactive loads must be precluded.	Same as above

11.3 MAJOR FINDINGS OF ASME B&PV CODE COMPARISON,  
SECTION III, Subsection B, 1963 VS. SECTION III, SUBSECTION NE, 1980

Note: Rules of ASME B&PV Code Section VIII apply (see page B-3.2 of this  
TER for details)

MAJOR FINDINGS OF ASME B&PV CODE COMPARISON, SECTION VIII, 1962 VS.  
SECTION III, SUBSECTION NE, 1980

(Summary of Code Changes with the Potential to Significantly  
Degrade Perceived Margin of Safety)

Scale A

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>Sec. III 1980</u>	<u>Sec. VIII 1962</u>		
NE-3112.4	UG-23	Vessels of materials no longer listed as Code acceptable	Section III, 1980 Code references materials identical to those referenced in Section VIII, 1962 Code. However, several materials which were referenced in Section VIII, 1962 are no longer given in Section III, 1980. Verification of the allowable stress values and validation of the materials used are required.
---	UG-25(d)	Vessels containing telltale holes	The removal of this provision from Section III, 1962 Code, bans the use of telltale holes, particularly since the only non-destructive test methods are recommended in Section XI of the Code, Rules for Inservice Inspection. Moreover, a more recent version of Section VIII specifically excludes using telltale holes when using lethal substances.
NE-3131	---	Containment shells designed by formula	Section VIII, 1962 Code calls for the design of the vessel by formula, while Section III, 1980 Code requires that the

MAJOR FINDINGS OF ASME B&PV CODE COMPARISON, SECTION VIII, 1962 VS.  
SECTION III, SUBSECTION NE, 1980

(Summary of Code Changes with the Potential to Significantly  
Degrade Perceived Margin of Safety)

Scale A (Cont.)

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>Sec. III 1980</u>	<u>Sec. VIII 1962</u>		
NE-3131 Cont.			rules of Subsection NE-3200 (Design by Analysis) be satisfied. In the absence of substantial thermal or mechanical loads other than pressure, the rules of "Design by Formula" may be used (substantial loads are those loads which cumulatively result in stresses which exceed 10% of the primary stresses induced by the design pressure, such stresses being defined as maximum principal stresses). The Scale rating for a Containment Shell where substantial thermal or mechanical loads other than pressure are absent, is Scale B. Otherwise it is Scale A.
NE-3133.5(a)	UG-29	Stiffening rings for cylindrical shells subject to external pressure	The requirements of the 1980 Code for defining the minimum moment of inertia of the stiffening ring as compared to the requirements of the 1962 Code may result in a lower margin of safety.

Scale

$I_s' > 1.28 I_s$	C
$I_s' > 1.22 I_s$	B
$I_s' < 1.22 I_s$	A



MAJOR FINDINGS OF ASME B&PV CODE COMPARISON, SECTION VIII, 1962 VS.  
SECTION III, SUBSECTION NE, 1980

(Summary of Code Changes with the Potential to Significantly  
Degrade Perceived Margin of Safety)

Scale A (Cont.)

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>Sec. III 1980</u>	<u>Sec. VIII 1962</u>		
NE-3133.5(a) Cont.	UG-29		where $I_S$ is the minimum required moment of inertia of the stiffening ring about its neutral axis parallel to the axis of the shell. $I_S'$ is the moment of inertia of the combined ring-shell section about its neutral axis parallel to the axis of the shell. The width of shell which is taken as contributing to $I_S'$ shall not be greater than $1.1\sqrt{D_o/T}$ .
NE-3133.5(b)	---	Different materials used for the shell and the stiffening rings	This new insert in Section III of the 1980 Code requires using the material chart which gives the larger value of the factor A. This may result in a larger stiffening ring section needed to meet the requirements of the Code.
Fig. 3324.11 (a) (6)-1	Fig. UG-36(d)	Vessels with a reducer section with "reversed" curvature	Scale A for ring-stiffened shells where (1) the ring and the shell are of different materials and, in addition, (2) the "factor A" (as computed by the procedures of NE-3133.5) for the two materials differs by more than 6%; otherwise Scale B.
			The effect of the change in the requirements of the code code on the margin of safety depends on the $R_T/t$ ratio

MAJOR FINDINGS OF ASME B&PV CODE COMPARISON, SECTION VIII, 1962 VS.  
SECTION III, SUBSECTION NE, 1980

(Summary of Code Changes with the Potential to Significantly  
Degrade Perceived Margin of Safety)

Scale A (Cont.)

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>	
<u>Sec. III 1980</u>	<u>Sec. VIII 1962</u>		<u>Limitations</u>	<u>Scale</u>
Fig. 3324.11 (a) (6)-1 (Cont.)	Fig. UG-36 (d)		$R_L/t > 24$ $R_L/t < 23$	C A
where				
$R_L$ = radius of the large end of the reducer				
t = shell thickness				
NE-3327.1	---	Vessels with positive locking devices - Quick actuating closures	New requirements in the 1980 Code	
NE-3327.4	---	Pressure indicating devices for vessels having quick actuating closures	Safety-related provision requires that the pressure indicating device be visible from the operating area	
NE-3331(b)	UG-36	Openings and reinforce- ments Provisions for fatigue analysis	Requirements for fatigue analysis of vessels or parts which are in cyclic service are provided in Section III, 1980 Code. No specific guidance was given in Section VIII, 1962 Code.	
NE-3334.1	UG-40 (b)	Reinforcement for openings along and normal to vessel wall	New requirements in the 1980 Code limit the rein- forcement, measured along the midsurface of the nominal wall thickness and normal to the vessel wall	
NE-3334.2	UG-40 (c)			

MAJOR FINDINGS OF ASME B&PV CODE COMPARISON, SECTION VIII, 1962 VS.  
SECTION III, SUBSECTION NE, 1980

(Summary of Code Changes with the Potential to Significantly  
Degrade Perceived Margin of Safety)

Scale A (Cont.)

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>Sec. III 1980</u>	<u>Sec. VIII 1962</u>		
NE-3365(f)	---	Bellows expansion joints over 6 inches in diameter	Provisions regarding the internal sleeve design (for sizes over 6-inch diameter) and flow velocity limitations (for all sizes) are introduced in the 1980 Code.
NE-3365.2	---	Bellows	New design requirements specified in the 1980 Code

11.4 MAJOR FINDINGS OF ACI 318-71 VS. ACI 349-76 CODE COMPARISON

## MAJOR FINDINGS OF ACI 318-71 VS. ACI 349-76 CODE COMPARISON

(Summary of Code Changes with the Potential to Significantly Degrade Perceived Margin of Safety)

Scale A

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-71</u>		
19.1	19.1	Shell structure with thickness equal to or greater than 12 inches	The new provisions apply to the sphere enclosure building whose cylindrical wall thickness is 3 feet.
Appendix A	-	All elements subject to time-dependent and position-dependent temperature variations and which are restrained so that thermal strains will result in thermal stresses.	New appendix; older code did not give specific guidelines on temperature limits for concrete. The possible effects of strength loss of concrete at high temperatures should be assessed.
Appendix B	-	All steel embedments used to transit loads from attachments into the reinforced concrete structures.	New appendix; therefore, considerable review of older design is warranted.*
Appendix C	-	All elements whose failure under impulsive and impactive loads must be precluded.	New appendix; therefore, consideration and review of older designs is considered important.*

\*Since stress analysis associated with these conditions is highly dependent on definition of failure planes and allowable stress for these special conditions, past practice varied with designers' opinions. Stresses may vary significantly from those thought to exist under previous design procedures.

11.5 MAJOR FINDINGS OF AISC-1971\* VS. AISC-1980 CODE COMPARISON

            
\*Including supplements 1 and 2

## MAJOR FINDINGS OF AISC 1971 VS. AISC 1980 CODE COMPARISON

(Summary of Code Changes with the Potential to Significantly Degrade Perceived Margin of Safety)

Scale A

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>AISC 1980</u>	<u>AISC 1971</u>		
1.5.1.2.2	--	Beam end connection where the top flange is coped and subject to shear, or failure by shear along a plane through fasteners or by a combination of shear along a plane through fasteners plus tension along a perpendicular plane	See case study 1 for details.
1.5.1.4.1 Subpara 7	1.5.1.4.1	Hollow circular sections subject to bending	New requirement in the 1980 Code
1.9.2.3 and Appendix C	--	Circular tubular elements subject to axial compression	New requirements added in the 1980 Code
1.11.5	--	Composite beams or girders with formed steel deck	New requirements added in the 1980 Code
1.14.2.2	--	Axially loaded tension members where the load is transmitted by bolts or rivets through some but not all of the cross-sectional elements of the members	New requirement added in the 1980 Code
1.15.5.2 1.15.5.3 1.15.5.4	--	Restrained members when flange or moment connection plates for end connections of beams and girders are welded to the flange of I or H shaped columns	New requirement added in the 1980 Code

## 12. SUMMARY

The table that follows provides a summary of the status of the findings from the Task III-7.B criteria comparison review of structural codes and loading requirements for Seismic Category I structures at the San Onofre Nuclear Generating Station, Unit 1.

The first and second columns of the table show the number of changes in requirements found for the design codes used for Seismic Category I structures external to containment, classified by scale ranking. The first column applies to the concrete portion of these structures and to the concrete cradle supporting the containment sphere; the second column applies to the portions of the external structures which are of steel frame construction. The third column applies to the spherical containment shell. The fourth applies in full to the sphere enclosure building and also to the new diesel generator building. The fifth column applies to the arched composite roof of the sphere enclosure building and the steel construction portions of the new diesel generator building. However, the number of code changes applicable to the new diesel generator building is slightly less than the number shown in column four, because the diesel generator design specification included Supplement 3 to AISC 1971, whereas the specifications for the sphere enclosure building did not.

The salient feature of this table is the limited number of code change impacts requiring a Scale A ranking. Consequently, resolution, at the structural level, of potential concerns with respect to changes in structural code requirements appears, at least for the San Onofre plant, to be an effort of tractable size.



## SUMMARY

NUMBER OF CODE CHANGE IMPACTS FOR  
SAN ONOFRE CATEGORY I STRUCTURES

SCALE RANKING		ACI 318-63 vs. ACI 349-76	AISC 1963 vs. AISC 1980	ASME E & PV SEC III SUB. SECT. B, 1963 vs. SUB. SECT. NE 1980	ACI 318-71 vs. ACI 349-76	AISC 1971 (with suppl. 1 & 2) vs. AISC 1980
TOTAL CHANGES FOUND		82	33	27	70	18
Do Not Require Further Investigation	A or A <sub>x</sub> not applicable to San Onofre I	1 + 4*	10	3*	4*	6
	B	63	10	9	59	5
	C	7	4	3	3	1
To Be Further Investigated	A	7	9	12	4	6
	A <sub>x</sub>	0	0	0	0	0

## SCALE RATINGS:

- Scale A Change - The new criteria have the potential to substantially impair margins of safety as perceived under the former criteria.
- Scale A<sub>x</sub> Change - The impact of the code change on margins of safety is not immediately apparent. Scale A<sub>x</sub> code changes require analytical studies of model structures to assess the potential magnitude of their effect upon margins of safety.
- Scale C Change - The new criteria will give rise to larger margins of safety than were exhibited under the former criteria.

\*These changes are related to specified loads and load combinations. Loading criteria changes are separately considered elsewhere.

## 13. RECOMMENDATIONS

Potential concerns with respect to the ability of Seismic Category I buildings and structures in SEP plants to conform to current structural criteria are raised by the review at the code comparison level. These must ultimately be resolved by examination of individual as-built structures.

It is recommended that Southern California Edison Company be requested to take three actions:

1. Review individually all Seismic Category I structures at the San Onofre plant to see if any of the structural elements listed in the following table occur in their designs. These are the structural elements for which a potential exists for margins of safety to be less than originally computed, due to criteria changes since plant design and construction. For structures which do incorporate these features, assess the actual impact of the associated code changes on margins of safety.
2. Reexamine the margins of safety of Seismic Category I structures under loads and load combinations which correspond to current criteria. Only those load combinations assigned a Scale A or Scale  $A_x$  rating in Section 10 of this report need be considered in this review. If the load combination includes individual loads which have themselves been ranked A or  $A_x$ , indicating that they do not conform to current criteria, update such loads.

Full reanalysis of these structures is not necessarily required. Simple hand computations or appropriate modifications of existing results can qualify as acceptable means of demonstrating structural adequacy.

3. Review Appendix A of this report to confirm that all items listed there have no impact on safety margins at the San Onofre plant.

## LIST OF STRUCTURAL ELEMENTS TO BE EXAMINED

<u>Structural Elements to be Examined</u>	<u>Code Change Affecting These Elements</u>			<u>Scale</u>
	<u>New Code</u>	<u>Old Codes</u>		
<u>Beams/Columns</u>	AISC 1980	AISC 1963	AISC 1971	
Hollow circular sections subject to bending	1.5.1.4.1 Subpara 7	1.5.1.4.1	1.5.1.4.1	A
<u>Composite Beams</u>				
1. Shear connectors in composite beams	1.11.4	1.11.4	NA	A
2. Composite beams or girders with formed steel deck	1.11.5	--	--*	A
<u>Compression Elements</u>	AISC 1980	AISC 1963	AISC 1971	
With width-to-thickness ratio higher than specified in 1.9.1.2	1.9.1.2 and Appendix C	1.9.1	NA	A
Hollow circular sections subject to axial compression	1.9.2.3 and Appendix C	--*	--	A
<u>Tension Members</u>	AISC 1980	AISC 1963	AISC 1971	
When load is transmitted by bolts or rivets	1.14.2.2	--	--	A
<u>Connections</u>	AISC 1980	AISC 1963	AISC 1971	
a. Beam ends with top flange coped, if subject to shear	1.5.1.2.2	--	--	A
b. Connections carrying moment or restrained member connection	1.15.5.2 1.15.5.3 1.15.5.4	--	--	A

\*Double dash (--) indicates that older code had no provisions.  
NA indicates not applicable.

## LIST OF STRUCTURAL ELEMENTS TO BE EXAMINED (Cont.)

<u>Structural Elements to be Examined</u>	<u>Code Change Affecting These Elements</u>			<u>Scale</u>
	<u>New Code</u>	<u>Old Codes</u>		
<u>Members Designed to Operate in an Inelastic Regime</u>	AISC 1980	AISC 1963	AISC 1971	
Spacing of lateral bracing	2.9	2.8	NA	A
<u>Short Brackets and Corbels</u> having a shear span-to-depth ratio of unity or less	ACI 349-76 11.13	ACI 318-63 --	ACI 318-71 NA	A
<u>Shear Walls</u> used as a primary load-carrying member	ACI 349-76 11.16	ACI 318-63 --	ACI 318-71 NA	A
<u>Precast Concrete Structural Elements</u> , where shear is not a member of diagonal tension	ACI 349-76 11.15	ACI 318-63 --	ACI 318-71 NA	A
<u>Concrete Regions Subject to High Temperatures</u>	ACI 349-76	ACI 318-63	ACI 318-71	
Time-dependent and position-dependent temperature variations	Appendix A	--	--	A
<u>Columns with Spliced Reinforcement</u> subject to stress reversals; $f_y$ in compression to $1/2 f_y$ in tension	ACI 349-76 7.10.3	ACI 318-63 805	ACI 318-71 NA	A
<u>Steel Embedments</u> used to transmit load to concrete	ACI 349-76 Appendix B	ACI 318-63 --	ACI 318-71 --	A
<u>Element Subject to Impulsive and Impactive Loads</u> whose failure must be precluded	ACI 349-76 Appendix C	ACI 318-63 --	ACI 318-71 --	A
<u>Shell Structures</u> with thickness equal to or greater than 12 inches	ACI 349-76 19.1	ACI 318-63 --	ACI 318-71 19.1	A

## LIST OF STRUCTURAL ELEMENTS TO BE EXAMINED (Cont.)

Structural Elements to be Examined	Code Change Affecting These Elements		Scale
	New Code	Old Codes	
<u>Containment Vessels</u>			
1. Containment vessels of materials no longer listed as code acceptable	ASME Sec. III, NE-3112.4	ASME Sec. VIII, UG-23	A
2. Containment vessels containing telltale holes	ASME Sec. III, ---	ASME Sec. VIII, 1962 UG-25 (d)	A
3. Containment vessels designed by formula and subject to substantial loads	ASME Sec. III, NE-3131	ASME Sec. VIII, ---	A
4. Stiffening rings for cylindrical shells subject to external pressure	ASME Sec. III, NE-3133.5 (a)	ASME Sec. VIII, UG-29	A
5. Different materials used for the shell and stiffening rings	ASME Sec. III, NE-3133.5 (b)	ASME Sec. VIII, ---	A
6. Vessels with reducer section with "reversed" curvature when $R_L/t < 23$	ASME Sec. III, Fig. 3324.11 (a) (6) -1	ASME Sec. VIII, Fig. UG-36 (d)	A
7. Vessels with positive locking devices - Quick actuating closures	ASME Sec. III, NE-3327.1	ASME Sec. VIII, ---	A
8. Pressure indicating devices for vessels having quick actuating closures	ASME Sec. III, NE-3327.4	ASME Sec. VIII, ---	A
<u>Shell Openings and Attachments</u>			
1. Openings and reinforcements; Provisions for fatigue analysis	ASME Sec. III, NE-3331 (b)	ASME Sec. VIII, UG-36	A

## LIST OF STRUCTURAL ELEMENTS TO BE EXAMINED (Cont.)

Structural Elements to be Examined	Code Change Affecting These Elements		Scale
	New Code	Old Codes	
2. Reinforcement for openings	ASME Sec. III, NE-3334.1 NE-3334.2	ASME Sec. VIII, UG-40(b) UG-40(c)	A
3. Bellows expansion joints, over 6 inches in diameter	ASME Sec. III, NE-3365(f)	ASME Sec. VIII, ---	A
4. Bellows - New design requirements	ASME Sec. III, NE-3365.2	ASME Sec. VIII, ---	A

## 14. REFERENCES

1. Standard Review Plan  
NRC, July 1981  
NUREG-0800 (Formerly NUREG-75/087), Rev. 1
2. AISC Specification for Design, Fabrication, and Erection of  
Structural Steel for Buildings  
American Institute of Steel Construction, Inc., New York, NY  
1963
3. "Building Code Requirements for Reinforced Concrete"  
American Concrete Institute, Detroit, MI, 1963  
ACI 318-63
4. Letter from Southern California Edison Company to Mr. D. M.  
Crutchfield (NRC) dated Sept. 8, 1980  
Subject: Systematic Evaluation Program, San Onofre Nuclear  
Generating Station Unit 1  
NRC Docket No. 50-206
5. Southern California Edison Company, San Onofre Nuclear Station Unit  
1, Final Safety Analysis Report Part II-6 Volumes
6. Southern California Edison Company Letter to NRC Dated August 29,  
1979, Subject: San Onofre Unit 1, Classification of Structures and  
Components (Seismic and Quality)
7. Appendix I to Technical Evaluation Report, "Design Codes, Design  
Criteria, and Loading Combinations"  
Contains List of Basic Documents Defining Current Licensing Criteria  
for SEP Topic III-7.B  
Franklin Research Center, 1981  
TER-C5257-327
8. Seismic Reevaluation and Modification, San Onofre Nuclear Generating  
Station Unit 1, dated April 29, 1977 NRC Docket No. 50-206
9. Southern California Edison Company Letter to Mr. R. A. Purple (NRC)  
dated May 7, 1975 Subject: Docket 50-206 Provisional Operating  
Licensee #DPR-13. Additional information concerning the addition of  
standby power and ECCS modifications, San Onofre Nuclear Generating  
Station Unit 1
10. Amendment 52 to Final Safety Analysis Report, San Onofre Nuclear  
Generating Station, Unit 1,  
Docket 50-206

11. Final Safety Analysis, San Onofre Nuclear Generating Station Unit 1,  
Docket 50-206
12. The SER supporting Amendment No. 20 to Provisional Operating  
Licensee No. DPR-13 for the San Onofre Generating Station, Unit 1  
Docket 50-206  
Issued April 2, 1976
13. NRC letter (with enclosure) dated April 1, 1977 to Southern  
California Edison Company



APPENDIX A

SCALE A AND SCALE A<sub>x</sub> CHANGES  
DEEMED INAPPROPRIATE TO SAN ONOFRE PLANT



Franklin Research Center

A Division of The Franklin Institute

The Benjamin Franklin Parkway, Phila., Pa. 19103 (215) 448-1000

APPENDIX A-1

AISC 1963 VS. AISC 1980 CODE COMPARISON

(SCALE A AND SCALE A<sub>x</sub> CHANGES DEEMED INAPPROPRIATE TO SAN ONOFRE PLANT  
OR CODE CHANGES RELATED TO LOADS OR LOAD COMBINATIONS  
AND THEREFORE TREATED ELSEWHERE)

AISC 1963 VS. AISC 1980 CODE COMPARISON

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>AISC 1980</u>	<u>AISC 1963</u>		
1.5.1.1	1.5.1.1	Structural members under tension, except for pin connected members	Structural steel used in San Onofre Cat. I structures is A-36. Thus, $F_y < 0.83 F_u$ Therefore, Scale C for San Onofre.

<u>Limitations</u>	<u>Scale</u>
$F_y < 0.833 F_u$	C
$0.833 F_u < F_y < 0.875 F_u$	B
$F_y \geq 0.875 F_u$	A

1.5.1.4.1 Subpara. 6	1.5.1.4.1	Box-shaped members (subject to bending) of rectangular cross section whose depth is not more than 6 times its width and whose flange thickness is not more than 2 times the web thickness  New requirement in the 1980 Code	Box-shaped members not found to be used in San Onofre Cat. I structures; therefore, not applicable
1.5.1.4.4	--	Lateral support requirements for box sections whose depth is larger than 6 times their width  New requirement in the 1980 Code	Box section members not found to be used in San Onofre Cat. I structures; therefore; not applicable

AISC 1963 VS. AISC 1980 CODE COMPARISON

Referenced Subsection		Structural Elements Potentially Affected	Comments
AISC 1980	AISC 1963		
1.5.2.2	1.7	Rivets, bolts, and threaded parts subject to 20,000 cycles or more	Cat. I structures are not subject to such cyclic loading; therefore, not applicable
1.7 and Appendix B	1.7	Members and connections subject to 20,000 cycles or more	Cat. I structures are not subject to such cyclic loading; therefore, not applicable
1.10.6	1.10.6	Hybrid girder - reduction in flange girder	All structural steel is A-36. No hybrid girder found in San Onofre; therefore, not applicable
1.13.3	--	Roof surface not provided with sufficient slope towards points of free drainage or adequate individual drains to prevent the accumulation of rain water (ponding)	
2.4 1st Para.	2.3 1st Para.	Slenderness ratio for columns. Must satisfy:	
		$\frac{l}{r} < \frac{2\pi^2 E}{F_y}$	
		$F_y < 40$ ksi $40 < F_y < 44$ ksi $F_y \geq 44$ ksi	<u>Scale</u> C B A
			Scale C for San Onofre. See case study 4 for details.

AISC 1963 VS. AISC 1980 CODE COMPARISON

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>AISC 1980</u>	<u>AISC 1963</u>		
2.7	2.6	Flanges of rolled W, M, or S shapes and similar built-up single-web shapes subject to compression	Scale C for San Onofre. See case study 6 for details.
			<u>Scale</u>
		$F_y \leq 36$ ksi	C
		$36 < F_y < 38$ ksi	B
		$F_y \geq 38$ ksi	A
Appendix D	--	Web tapered members	New requirement added in the 1980 Code  Web tapered members are not found to be used in San Onofre Cat. I structures; therefore, not applicable

APPENDIX A-2

ACI 318-63 VS. ACI 349-76 CODE COMPARISON

(SCALE A AND SCALE A<sub>x</sub> CHANGES DEEMED INAPPROPRIATE TO SAN ONOFRE PLANT  
OR CODE CHANGES RELATED TO LOADS OR LOAD COMBINATIONS  
AND THEREFORE TREATED ELSEWHERE)---

ACI 318-63 VS. ACI 349-76 CODE COMPARISON

Referenced Section		Structural Elements Potentially Affected	Comments
ACI 349-76	ACI 318-63		
Chapter 9 9.1, 9.2, & 9.3 most specifi- cally	Chapter 15	All primary load-carrying members or elements of the structural system are potentially affected.  Definition of new loads not normally used in design of traditional buildings and redefinition of load factors and capacity reduction factors have altered the traditional analysis requirements.*	
10.1 and 10.10	--	All primary load-carrying members  Design loads here refer to Chapter 9 load combinations.*	
11.1	--	All primary load-carrying members  Design loads here refer to Chapter 9 load combinations.*	
18.1.4 and 18.4.2		Prestressed concrete elements  New loadings here refer to Chapter 9 load combinations.*	No prestressed elements outside primary containment; therefore, not applicable.
Chapter 19	--	Shell structures with thickness equal to or greater than 12 in  This chapter is completely new; therefore, shell structures designed by the general criteria of older codes may not satisfy all aspects of this chapter. This chapter also refers to Chapter 9 load provisions.	Not applicable because there are no concrete shell structures except the sphere enclosure building (see corresponding provisions of ACI 318-71 vs ACI 349-76 in Section 11.4).

\*Special treatment of loads and load combinations is addressed in other sections of the report.

APPENDIX A-3

ASME B&PV CODE COMPARISON

SECTION III, SUBSECTION B, 1963\* VS. SECTION III, SUBSECTION NE, 1980

(SCALE A AND SCALE A<sub>x</sub> CHANGES DEEMED INAPPROPRIATE TO SAN ONOFRE PLANT  
OR CODE CHANGES RELATED TO LOAD COMBINATIONS  
AND THEREFORE TREATED ELSEWHERE)

\*Note: Rules of ASME B&PV Code Section VIII apply (see page  
B-3.2 of this TER for details).



ASME B&PV CODE COMPARISON  
SECTION VIII, 1962, VS. SECTION III, SUBSECTION NE, 1980

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>Section III 1980</u>	<u>Section VIII 1962</u>		
NE-3111	UG-22	Loading as applied to load-carrying components*	Section III, 1980 Code, specifies new loads to be considered in designing the vessel. These are: o dynamic head of liquids o snow loads and vibration loads o reaction to steam and water jet impingement
NE-3112.2	---	Design temperature as applied to the vessel and its components*	The effect of heating the vessel by external or internal heat generation is to be considered in establishing the vessel design temperature
NE-3112.3	---	Design mechanical loads as applied to the vessel and its components*	In computations involving design pressure and design temperature, the values of dead loads and any hydrostatic loads coincident with design pressure (designated as design mechanical loads) should be used

\*Special treatment of load and load combinations is addressed in other sections of the report.

APPENDIX A-4

ACI 318-71 VS. ACI 349-76 CODE COMPARISON

(SCALE A AND SCALE A<sub>x</sub> CHANGES DEEMED INAPPROPRIATE TO SAN ONOFRE PLANT  
OR CODE CHANGES RELATED TO LOADS OR LOAD COMBINATIONS  
AND THEREFORE TREATED ELSEWHERE)

## ACI 318-71 VS. ACI 349-76 CODE COMPARISON

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-71</u>		
Chapter 9 9.1, 9.2, & 9.3 most specifi- cally	Chapter 9	All primary load-carrying members or elements of the structural system are potentially affected.  Definition of new loads not normally used in design of traditional buildings and redefinition of load factors and capacity reduction factors have altered the traditional analysis requirements.*	
10.1 and 10.10	--	All primary load-carrying members  Design loads here refer to Chapter 9 load combinations.*	
11.1	--	All primary load-carrying members  Design loads here refer to Chapter 9 load combinations.*	
18.1.4 and 18.4.2		Prestressed concrete elements  New loadings here refer to Chapter 9 load combinations.*	No prestressed elements outside primary containment; therefore, not applicable.

\*Special treatment of loads and load combinations is addressed in other sections of the report.

APPENDIX A-5

AISC 1971\* VS. AISC 1980 CODE COMPARISON

(SCALE A AND SCALE A<sub>x</sub> CHANGES DEEMED INAPPROPRIATE TO SAN ONOFRE PLANT  
OR CODE CHANGES RELATED TO LOADS OR LOAD COMBINATIONS  
AND THEREFORE TREATED ELSEWHERE)

---

\* Includes supplements 1 and 2

AISC 1971 VS. AISC 1980 CODE COMPARISON

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>AISC 1980</u>	<u>AISC 1971</u>		
1.5.1.1	1.5.1.1	Structural members under tension, except for pin connected members	Structural steel used in San Onofre Cat. I structures is A-36. Thus, $F_y < 0.83 F_u$ Therefore, Scale C for San Onofre.
		<u>Limitations</u>	<u>Scale</u>
		$F_y < 0.833 F_u$	C
		$0.833 F_u < F_y < 0.875 F_u$	B
		$F_y \geq 0.875 F_u$	A
1.5.1.4.1 Subpara. 6	1.5.1.4.1	Box-shaped members (subject to bending) of rectangular cross section whose depth is not more than 6 times its width and whose flange thickness is not more than 2 times the web thickness  New requirement in the 1980 Code	Box-shaped members not found to be used in San Onofre Cat. I structures; therefore, not applicable
1.5.1.4.4	--	Lateral support requirements for box sections whose depth is larger than 6 times their width  New requirement in the 1980 Code	Box section members not found to be used in San Onofre Cat. I structures; therefore; not applicable

## AISC 1971 VS. AISC 1980 CODE COMPARISON

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>AISC 1980</u>	<u>AISC 1971</u>		
1.5.2.2 and Appendix B	1.7	Rivets, bolts, and threaded parts subject to 20,000 cycles or more	Cat. I structures are not subject to such cyclic loading; therefore, not applicable
1.7 and Appendix B	1.7	Members and connections subject to 20,000 cycles or more	Cat. I structures are not subject to such cyclic loading; therefore, not applicable
Appendix D	--	Web tapered members	New requirement added in the 1980 Code  Web tapered members are not found to be used in San Onofre Cat. I structures; therefore, not applicable

APPENDIX B

SUMMARIES OF CODE COMPARISON FINDINGS



Franklin Research Center

A Division of The Franklin Institute

The Benjamin Franklin Parkway, Phila., Pa. 19103 (215) 448-1000

APPENDIX B-1

AISC 1963 VS. AISC 1980

SUMMARY OF CODE COMPARISON

B-1.1



AISC 1963 VS. AISC 1980  
SUMMARY OF CODE COMPARISON

Scale A

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>	<u>Scale</u>
<u>AISC 1980</u>	<u>AISC 1963</u>			
1.5.1.1	1.5.1.1	Structural members under tension, except for pin connected members	<u>Limitations</u> $F_y \leq 0.833 F_u$ $0.833 F_u < F_y < 0.875 F_u$ $F_y \geq 0.875 F_u$	C B A
1.5.1.2.2	--	Beam end connection where the top flange is coped and subject to shear, failure by shear along a plane through fasteners, or shear and tension along and perpendicular to a plane through fasteners	See case study 1 for details.	
1.5.1.4.1 Subpara. 6	1.5.1.4.1	Box-shaped members (subject to bending) of rectangular cross section whose depth is not more than 6 times their width and whose flange thickness is not more than 2 times the web thickness	New requirement in the 1980 Code	
1.5.1.4.1 Subpara. 7	1.5.1.4.1	Hollow circular sections subject to bending	New requirement in the 1980 Code	
1.5.1.4.4	--	Lateral support requirements for box sections whose depth is larger than 6 times their width	New requirement in the 1980 Code	
1.5.2.2	1.7	Rivets, bolts, and threaded parts subject to 20,000 cycles or more	Change in the requirements	

AISC 1963 VS. AISC 1980  
SUMMARY OF CODE COMPARISON

Scale A

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>AISC 1980</u>	<u>AISC 1963</u>		
1.7 and Appendix B	1.7	Members and connections subject to 20,000 cycles or more	Change in the requirements
1.9.1.2 and Appendix C	1.9.1	Slender compression unstiffened elements subject to axial compression or compression due to bending when actual width-to-thickness ratio exceeds the values specified in subsection 1.9.1.2	New provisions added in the 1980 Code, Appendix C. See case study 10 for details.
1.9.2.3 and Appendix C	--	Circular tubular elements subject to axial compression	New requirements added in the 1980 Code
1.10.6	1.10.6	Hybrid girder - reduction in flange stress	New requirement added in the 1980 Code. Hybrid girders were not covered in the 1963 Code. See case study 9 for details.
1.11.4	1.11.4	Shear connectors in composite beams	New requirements added in the 1980 Code regarding the distribution of shear connectors (eqn. 1.11-7). The diameter and spacing of the shear connectors are also introduced.
1.11.5	--	Composite beams or girders with formed steel deck	New requirements added in the 1980 Code
1.15.5.2 1.15.5.3 1.15.5.4	--	Restrained members when flange or moment connection plates for end connections of beams and girders are welded to the flange of I or H shaped columns	New requirement added in the 1980 Code

AISC 1963 VS. AISC 1980  
SUMMARY OF CODE COMPARISON

Scale A (Cont.)

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>	
<u>AISC 1980</u>	<u>AISC 1963</u>			
1.13.3	--	Roof surface not provided with sufficient slope towards points of free drainage or adequate individual drains to prevent the accumulation of rain water (ponding)		
1.14.2.2	--	Axially loaded tension members where the load is transmitted by bolts or rivets through some but not all of the cross-sectional elements of the members	New requirement added in the 1980 Code	
2.4 1st Para.	2.3 1st Para.	Slenderness ratio for columns. Must satisfy:	See case study 4 for details.	<u>Scale</u>
		$\frac{l}{r} \leq \sqrt{\frac{2\pi^2 E}{F_y}}$	$F_y \leq 40 \text{ ksi}$ $40 < F_y < 44 \text{ ksi}$ $F_y \geq 44 \text{ ksi}$	 B A
2.7	2.6	Flanges of rolled W, M, or S shapes and similar built-up single-web shapes subject to compression	See case study 6 for details.	<u>Scale</u>
			$F_y \leq 36 \text{ ksi}$ $36 < F_y < 38 \text{ ksi}$ $F_y \geq 38 \text{ ksi}$	 C B A
2.9	2.8	Lateral bracing of members to resist lateral and torsional displacement	See case study 7 for details.	
Appendix D	--	Web tapered members	New requirements added in the 1980 Code	

AISC 1963 VS. AISC 1980  
SUMMARY OF CODE COMPARISON

Scale B

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>AISC 1980</u>	<u>AISC 1963</u>		
1.9.2.2	1.9.2	Flanges of square and rectangular box sections of uniform thickness, of stiffened elements, when subject to axial compression or to uniform compression due to bending	The 1980 Code limit on width-to-thickness ratio of flanges is slightly more stringent than that of the 1963 Code.
1.10.1	--	Hybrid girders	Hybrid girders were not covered in the 1963 Code. Application of the new requirement could not be much different from other rational method.
1.11.4	1.11.4	Flat soffit concrete slabs, using rotary kiln produced aggregates conforming to ASTM C330	Lightweight concrete is not permitted in nuclear plants as structural members (Ref. ACI-349).
1.13.2	--	Beams and girders supporting large floor areas free of partitions or other source of damping, where transient vibration due to pedestrian traffic might not be acceptable	Lightweight construction not applicable to nuclear structures which are designed for greater loads
1.14.6.1.3	--	Flare type groove welds when flush to the surface of the solid section of the bar	
1.16.4.2	1.16.4	Fasteners, minimum spacing, requirements between fasteners	
1.16.5	1.16.5	Structural joints, edge distances of holes for bolts and rivets	

AISC 1963 VS. AISC 1980  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>AISC 1980</u>	<u>AISC 1963</u>		
1.15.5.5	--	Connections having high shear in the column web	New insert in the 1980 Code
2.3.1 2.3.2	--	Braced and unbraced multi-story frame - instability effect	Instability effect on short buildings will have negligible effect.
2.4	2.3	Members subject to combined axial and bending moments	Procedure used in the 1963 Code for the interaction analysis is replaced by a different procedure. See case study 8 for details.

AISC 1963 VS. AISC 1980  
SUMMARY OF CODE COMPARISON

Scale C

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>AISC 1980</u>	<u>AISC 1963</u>		
1.3.3	1.3.3	Support girders and their connections - pendant operated traveling cranes  The 1963 Code requires 25% increase in live loads to allow for impact as applied to traveling cranes, while the 1980 Code requires 10% increase.	The 1963 Code requirement is more stringent, and, therefore, conservative.
1.5.1.5.3	1.5.2.2	Bolts and rivets - projected area - in shear connections $F_p = 1.5 F_u$ (1980 Code) $F_p = 1.35 F_y$ (1963 Code)	Results using 1963 Code are conservative.
1.10.5.3	1.10.5.3	Stiffeners in girders - spacing between stiffeners at end panels, at panels containing large holes, and at panels adjacent to panels containing large holes	New design concept added in 1980 Code giving less stringent requirements. See case study 5 for details.
1.11.4	1.11.4	Continuous composite beams, where longitudinal reinforcing steel is considered to act compositely with the steel beam in the negative moment regions	New requirement added in the 1980 Code

APPENDIX B-2  
ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale A

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-63</u>		
7.10.3	805	Columns designed for stress reversals with variation of stress from $f_y$ in compression to $1/2 f_y$ in tension	Splices of the main reinforcement in such columns must be reasonably limited to provide for adequate ductility under all loading conditions.
Chapter 9 9.1, 9.2, & 9.3 most specifically	Chapter 15	All primary load-carrying members or elements of the structural system are potentially affected	Definition of new loads not normally used in design of traditional buildings and redefinition of load factors and capacity reduction factors has altered the traditional analysis requirements.*
10.1 and 10.10	--	All primary load-carrying members	Design loads here refer to Chapter 9 load combinations.*
11.1	--	All primary load-carrying members	Design loads here refer to Chapter 9 load combinations.*
11.13	--	Short brackets and corbels which are primary load-carrying members	As this provision is new, any existing corbels or brackets may not meet these criteria and failure of such elements could be non-ductile type failure. Structural integrity

\*Special treatment of load and loading combinations is addressed in other sections of the report.



ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale A (Cont.)

Referenced Section		Structural Elements Potentially Affected	Comments
ACI 349-76	ACI 318-63		
11.13 (Cont.)			may be seriously endangered if the design fails to fulfill these requirements.
11.15	--	Applies to any elements loaded in shear where it is inappropriate to consider shear as a measure of diagonal tension and the loading could induce direct shear-type cracks	Structural integrity may be seriously endangered if the design fails to fulfill these requirements.
11.16	--	All structural walls - those which are primary load carrying, e.g., shear walls and those which serve to provide protection from impacts of missile-type objects	Guidelines for these kinds of wall loads were not provided by older codes; therefore, structural integrity may be seriously endangered if the design fails to fulfill these requirements.
18.1.4 and 18.4.2	--	Prestressed concrete elements	New load combinations here refer to Chapter 9 load combinations.*
Chapter 19	--	Shell structures with thickness equal to or greater than 12 inches	This chapter is completely new; therefore, shell structures designed by the general criteria of older codes may not satisfy all aspects of this chapter.

\*Special treatment of loads and loading combinations is addressed in other sections of the report.

ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale A (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-63</u>		
Chapter 19 (Cont.)			Additionally, this chapter refers to Chapter 9 provisions.
Appendix A	--	All elements subject to time-dependent and position-dependent temperature variations and which are restrained such that thermal strains will result in thermal stresses	New appendix; older Code did not give specific guidelines on short-term temperature limits for concrete. The possible effects of strength loss in concrete at high temperatures should be assessed.  Scale A for any accident temperature or other thermal condition exceeding limits of paragraph A.4.2.
Appendix B	--	All steel embedments used to transmit loads from attachments into the reinforced concrete structures	New appendix; therefore, considerable review of older designs is warranted.**
Appendix C	--	All elements whose failure under impulsive and impactive loads must be precluded	New appendix; therefore, considerations and review of older designs is considered important.**

\*\*Since stress analysis associated with these conditions is highly dependent on definition of failure planes and allowable stress for these special conditions, past practice varied with designers' opinions. Stresses may vary significantly from those thought to exist under previous design procedures.

ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B

Referenced Section		Structural Elements Potentially Affected	Comments
ACI 349-76	ACI 318-63		
1.3.2	103(b)	Ambient temperature control for concrete inspection - upper limit reduced 5° (from 100°F to 95°F) applies to all structural concrete	Tighter control to ensure adequate control of curing environment for cast-in-place concrete.
1.5	--	Requirement of a "Quality Assurance Program" is new. Applies to all structural concrete	Previous codes required inspection but not the establishment of a quality assurance program.
Chapter 3	Chapter 4	Any elements containing steel with $f_y > 60,000$ psi or lightweight concrete	Use of lightweight concrete in a nuclear plant not likely. Elements containing steel with $f_y > 60,000$ psi may have inadequate ductility or excessive deflections at service loads.
3.2	402	Cement	This serves to clarify intent of previous code.
3.3	403	Aggregate	Eliminated reference to lightweight aggregate.
3.3.1	403	Any structural concrete covered by ACI 349-76 and expected to provide for radiation shielding in addition to structural capacity	Controls of ASTM C637, "Standard Specifications for Aggregates for Radiation Shielding Concrete," closely parallel those for ASTM C33, "Standard Specification for Concrete Aggregates."

ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-63</u>		
3.3.3	403	Aggregate	To ensure adequate control.
3.4.2	404	Water for concrete	Improve quality control measures.
3.5	405	Metal reinforcement	Removed all reference to steel with $f_y > 60,000$ psi.
3.6	406, 407 & 408	Concrete admixtures	Added requirements to improve quality control.
4.1 and 4.2	501 & 502	Concrete proportioning	Proportioning logic improved to account for statistical variation and statistical quality control.
4.3	504	Evaluation and acceptance of concrete	Added provision to allow for design specified strength at age $> 28$ days to be used. Not considered to be a problem, since large cross sections will allow concrete in place to continue to hydrate.
5.7	607	Curing of very large concrete elements and control of hydration temperature	Attention to this is required because of the thicker elements encountered in nuclear-related structures.
6.3.3	--	All structural elements with embedded piping containing high temperature materials in excess	Previous codes did not address the problem of long periods of exposure to high temperature and

ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

Referenced Section		Structural Elements Potentially Affected	Comments
ACI 349-76	ACI 318-63		
6.3.3 (Cont.)		of 150°F, or 200°F in localized areas not insulated from the concrete	did not provide for reduction in design allowables to account for strength reduction at high (>150°F) temperatures.
7.5, 7.6, & 7.8	805	Members with spliced reinforcing steel	Sections on splicing and tie requirements amplified to better control strength at splice locations and provide ductility.
7.9	805	Members containing deformed wire fabric	New sections to define requirements for this new material.
7.10 & 7.11	--	Connection of primary load-carrying members and at splices in column steel	To ensure adequate ductility.
7.12.3 7.12.4	--	Lateral ties in columns	To provide for adequate ductility.
7.13.1 through 7.13.3	--	Reinforcement in exposed concrete	New requirements to conform with the expected large thicknesses in nuclear related structures.
8.6	--	Continuous nonprestressed flexural members.	Allowance for redistribution of negative moments has been redefined as a function of the steel percentage.
9.5.1.1	--	Reinforced concrete members subject to bending - deflection limits	Allows for more stringent controls on deflection in special cases.

ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-63</u>		
9.4	1505	Reinforcing steel - design strength limitation	See comments in Chapter 3 summary.
9.5.1.2 through 9.5.1.4	--	Slab and beams - minimum thickness requirements	Minimum thickness generally would not control this type of structure.
9.5.2.4	909	Beams and one-way slabs	Affects serviceability, not strength.
9.5.3	--	Nonprestressed two-way construction	Immediate and long time deflections generally not critical in structures designed for very large live loadings; however, design by ultimate requires more attention to deflection controls.
9.5.4 & 9.5.5	--	Prestressed concrete members	Control of camber, both initial and long time in addition to service load deflection, requires more attention for designs by ultimate strength.
10.2.7	--	Flexural members - new limit on B factor	Lower limit on B of 0.65 would correspond to an $f'_c$ of 8,000 psi. No concrete of this strength likely to be found in a nuclear structure.
10.3.6	--	Compression members, with spiral reinforcement or tied reinforcement, non-prestressed and pre-stressed	Limits on axial design load for these members given in terms of design equations.  See case study 2

ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-63</u>		
10.6.1 10.6.2 10.6.3 10.6.4	1508	Beams and one-way slabs	Changes in distribution of reinforcement for crack control.
10.6.5	--	Beams	New insert
10.11.1 10.11.2 10.11.3 10.11.4 10.11.5 10.11.5.1 10.11.5.2 10.11.6 10.11.7 10.12	915 916	Compression members, slenderness effects	For slender columns, moment magnification concept replaces the so-called strength reduction concept but for the limits stated in ACI 318-63 both methods yield equal accuracy and both are acceptable methods.
10.15.1 10.15.2 10.15.3 10.15.4 10.15.5 10.15.6	1404-1406	Composite compression members	New items - no way to compare; ACI 318-63 contained only working stress method of design for these members.
10.17	--	Massive concrete members, more than 48 in thick	New item - no comparison.

ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-63</u>		
11.2.1 11.2.2	--	Concrete flexural members	For nonprestressed members, concept of minimum area of shear reinforcement is new. For prestressed members, Eqn. 11-2 is the same as in ACI 318-63. Requirement of minimum shear reinforcement provides for ductility and restrains inclined crack growth in the event of unexpected loading.
11.7 through 11.8.6	--	Nonprestressed members	Detailed provisions for this load combination were not part of ACI 318-63. These new sections provide a conservative logic which requires that the steel needed for torsion be added to that required for transverse shear, which is consistent with the logic of ACI 318-63. This is not considered to be critical, as ACI 318-63 required the designer to consider torsional stresses; assuming that some rational method was used to account for torsion, no problem is expected to arise.



ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-63</u>		
11.9 through 11.9.6	--	Deep beams	Special provisions for shear stresses in deep beams is new. The minimum steel requirements are similar to the ACI 318-63 requirements of using the wall steel limits. Deep beams designed under previous ACI 318-63 criterion were reinforced as walls at the minimum and therefore no unreinforced section would have resulted.
11.10 through 11.10.7	--	Slabs and footings	New provision for shear reinforcement in slabs or footings for the two-way action condition and new controls where shear head reinforcement is used. Logic consistent with ACI 318-63 for these conditions and change is not considered major.

ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-63</u>		
11.11.1	1707	Slabs and footings	<p>The change which deletes the old requirement that steel be considered as only 50% effective and allows concrete to carry 1/2 the allowable for two-way action is new. Also deleted was the requirement that shear reinforcement not be considered effective in slabs less than 10 in thick.</p> <p>Change is based on recent research which indicates that such reinforcement works even in thin slabs.</p>
11.11.2 through 11.11.2.5	--	Slabs	<p>Details for the design of shearhead is new. ACI 318-63 had no provisions for shearhead design. The requirements in this section for slabs and footings are not likely to have been used in older plant designs. If such devices were used, it is assumed a rational design method was used.</p>
11.12	--	Openings in slabs and footings	<p>Modification for inclusion of shearhead design. See above conclusion.</p>

ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-63</u>		
11.13.1 11.13.2	--	Columns	No problem anticipated since previous code required design consideration by some analysis.
Chapter 12	--	Reinforcement	Development length concept replaces bond stress concept in ACI 318-63. The various $l_d$ lengths in this chapter are based entirely on ACI 318-63 permissible bond stresses. There is essentially no difference in the final design results in a design under the new code compared to ACI 318-63.
12.1.6 through 12.1.6.3	918(C)	Reinforcement	Modified with minimum added to ACI 318-63, 918(C).
12.2.2 12.2.3	--	Reinforcement	New insert in ACI 349-76.
12.4	--	Reinforcement of special members	New insert. Gives emphasis to special member consideration.
12.8.1 12.8.2	--	Standard hooks	Based on ACI 318-63 bond stress allowables in general; therefore, no major change.

ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-63</u>		
12.10.1 12.10.2(b)	--	Wire fabric	New insert. Use of such reinforcement not likely in Category I structures for nuclear plants.
12.11.2	--	Wire fabric	New insert. Mainly applies to precast prestressed members.
12.13.1.4	--	Wire fabric	New insert. Use of this material for stirrups not likely in heavy members of a nuclear plant.
13.5	--	Slab reinforcement	New details on slab reinforcement intended to produce better crack control and maintain ductility. Past practice was not inconsistent with this in general.
14.2	--	Walls with loads in the Kern area of the thickness	Change of the order of the empirical equation (14-1) makes the solution compatible with Chapter 10 for walls with loads in the Kern area of the thickness.

ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

Referenced Section		Structural Elements Potentially Affected	Comments
ACI 349-76	ACI 318-63		
15.5	--	Footings - shear and development of reinforcement	Changes here are intended to be compatible with change in concept of checking bar development instead of nominal bond stress consistent with Chapter 12.
15.9	--	Minimum thickness of plain footing on piles	Reference to minimum thickness of plain footing on piles which was in ACI 318-63 was removed entirely.
16.2	--	Design considerations for a structure behaving monolithically or not, as well as for joints and bearings.	New but consistent with the intent of previous code.
17.5.3	2505	Horizontal shear stress in any segment	Use of Nominal Average Shear Stress equation (17-1) replaces the theoretical elastic equation (25-1) of ACI 318-63. It provides for easier computation for the designer.
18.4.1	--	Concrete immediately after prestress transfer	Change allows more tension, thus is less conservative but not considered a problem.

ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-63</u>		
18.5	2606	Tendons (steel)	Augmented to include yield and ultimate in the jacking force requirement.
18.7.1	--	Bonded and unbonded members	Eqn. 18-4 is based on more recent test data.
18.9.1 18.9.2 18.9.3	--	Two-way flat plates (solid slabs) having minimum bonded reinforcement	Intended primarily for control of cracking.
18.11.3 18.11.4	--	Bonded reinforcement at supports	New to allow for consideration of the redistribution of negative moments in the design.
18.13 18.14 18.15 18.16.1	--	Prestressed compression members under combined axial load and bending. Unbonded tendons. Post tensioning ducts. Grout for bonded tendons.	New to emphasize details particular to prestressed members not previously addressed in the codes in detail.
18.16.2	--	Proportions of grouting materials	Expanded definition of how grout properties may be determined.
18.16.4	--	Grouting temperature	Expanded definition of temperature controls when grouting.

ACI 318-63 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale C

Referenced Section		Structural Elements Potentially Affected	Comments
ACI 349-76	ACI 318-63		
7.13.4	--	Reinforcement in flexural slabs	
10.8.1 10.8.2 10.8.3	912	Compression members, limiting dimensions	Minimum size limitations are deleted in newer Code, giving the designer more freedom in cross-sectional dimensioning.
10.14	2306	Bearing - sections controlled by design bearing stresses	ACI 318-63 is more conservative, allowing a stress of $1.9(0.25 f'_c) = 0.475 f'_c < 0.6 f'_c$
11.2.5	1706	Reinforcement concrete members without prestressing	Allowance of spirals as shear reinforcement is new. Requirement of two lines of web reinforcement, where shear stress exceeds $6\phi\sqrt{f'_c}$ , was removed.
13.0 to end	--	Two-way slabs with multiple square or rectangular panels	Slabs designed by the previous criteria of ACI 318-63 are generally the same or more conservative.
13.4.1.5	--	Equivalent column flexibility stiffness and attached torsional members	Previous code did not consider the effect of stiffness of members normal to the plane of the equivalent frame.
17.5.4 17.5.5	--	Permissible horizontal shear stress for any surface, ties provided or not provided	Nominal increase in allowable shear stress under new code.

APPENDIX B-3

ASME B&PV CODE, SECTION III, SUBSECTION B, 1963 VS.

ASME B&PV CODE, SECTION III, SUBSECTION NE, 1980

SUMMARY OF CODE COMPARISON

Note:

Rules of ASME B&PV Code Section VIII apply (see next page)



ASME B&PV CODE, SECTION III, CLASS B, 1963

VS.

ASME B&PV CODE, SECTION III, SUBSECTION NE, 1980

For the purpose of the SEP review, the design requirements of Section III, Class B, 1963 are to be compared with the requirements of Section III, Subsection NE, 1980.

Paragraph N-132 in Section III of the 1963 code states that Class B vessels such as containment vessels shall be designed and constructed in accordance with the rules of Subsection B of the code. However, paragraph N-111, Article 11, Subsection B, states that the rules of Section VIII of the code shall apply except as otherwise provided in rules newly introduced in Subsection B itself.

Article 13 of Subsection B, Section III, of the 1963 code contains these new design requirements. It is very brief and supplies few changes, none of which have a substantial effect on the SEP review, except that some materials that are accepted under Section VIII of the code had been removed from the list of acceptable materials in Section III.

Therefore, for the purpose of the SEP program, Section VIII requirements apply and the ASME B&PV code comparison for Section VIII, 1962 vs. Section III, Subsection NE, 1980 will be used.

ASME B&PV CODE COMPARISON  
SECTION VIII, 1962 VS. SECTION III, SUBSECTION NE, 1980

Scale A

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>Section III 1980</u>	<u>Section VIII 1962</u>		
NE-3111	UG-22	Loading as applied to load carrying components*	Section III, 1980 Code specifies new loads to be considered in designing the vessel. These are: o Dynamic head of liquids o Snow loads and vibration loads o Reaction to steam and water jet impingement
NE-3112.2	---	Design temperature as applied to the vessel and its components*	The effect of heating the vessel by external or internal heat generation is to be considered in establishing the vessel design temperature.
NE-3112.3	---	Design mechanical loads as applied to the vessel and its components*	In computations involving design pressure and design temperature, the values of dead loads and any hydrostatic loads coincident with design pressure (designated as design mechanical loads) should be used.
NE-3112.4	UG-23	Vessels of materials no longer listed as Code acceptable	Section III, 1980 Code references materials which are identical to those referenced in Section VIII, 1962 Code. However, several materials which were referenced in Section VIII, 1962 are no longer given in Section III, 1980.

\*Special treatment of load and load combinations is addressed in other sections of the report.

ASME B&PV CODE COMPARISON  
SECTION VIII, 1962 VS. SECTION III, SUBSECTION NE, 1980

Scale A (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>Section III 1980</u>	<u>Section VIII 1962</u>		
NE-3112.4 (Cont.)			Verification of the allowable stress values and validation of the materials used are required.
---	UG-25(d)	Vessels containing telltale holes	The removal of this provision from Section III, 1962 Code, bans the use of telltale holes, particularly since the only non-destructive test methods are recommended in Section XI of the Code, Rules for Inservice Inspection. Moreover, the more recent version of Section VIII specifically excludes using telltale holes when using lethal substances.
NE-3131	---	Containment shells designed by formula	Section VIII, 1962 Code calls for the design of vessels by formula, while Section III, 1980 Code requires that the rules of Subsection NE-3200 (Design by Analysis) be satisfied. In the absence of substantial thermal or mechanical loads other than pressure, the rules of "Design by Formula" may be used (substantial loads are those loads which cumulatively result in stresses which exceed 10% of the primary stresses induced by the design pressure, such stresses being defined as maximum principal stresses).

ASME B&PV CODE COMPARISON  
SECTION VIII, 1962 VS. SECTION III, SUBSECTION NE, 1980

Scale A (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>Section III 1980</u>	<u>Section VIII 1962</u>		
NE-3131 (Cont.)			The scale rating for containment shells where substantial thermal or mechanical loads other than pressure are absent is Scale B; otherwise it is Scale A.
NE-3133.5(a)	UG-29	Stiffening rings for cylindrical shells subject to external pressure	The requirements of the 1980 Code for defining the minimum moment of inertia of the stiffening ring as compared to the requirements of the 1962 Code may result in a lower margin of safety.

Scale

$I'_S > 1.28 I_S$	C
$I'_S > 1.22 I_S$	B
$I'_S < 1.22 I_S$	A

where

$I_S$  is the minimum required moment of inertia of the stiffening ring about its neutral axis parallel to the axis of the shell.  
 $I'_S$  is the moment of inertia of the combined ring-shell section about its neutral axis parallel to the axis of the shell. The width of shell which is taken as contributing to  $I'_S$  shall not be greater than  $1.1\sqrt{D_o/T}$ .

ASME B&PV CODE COMPARISON  
SECTION VIII, 1962 VS. SECTION III, SUBSECTION NE, 1980

Scale A (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>Section III 1980</u>	<u>Section VIII 1962</u>		
NE-3133.5(b)	---	Different materials used for the shell and the stiffening rings	This new insert in Section III of the 1980 Code requires using the material chart which gives the larger value of the factor A. This may result in a larger stiffening ring section needed to meet the requirements of the code.  Scale A for ring-stiffened shells where (1) the ring and the shell are of different materials and, in addition, (2) the "factor A" (as computed by the procedure of NE-3133.5) for the two materials differs by more than 6%; otherwise Scale B.
Fig. 3324.11 (a) (6) -1	Fig. UG-36(d)	Vessels with a reducer section with "reversed" curvature	The effect of the change in the requirements of the code on the margin of safety depends on the $R_L/t$ ratio

<u>Limitations</u>	<u>Scale</u>
$R_L/t > 24$	C
$R_L/t < 23$	A

where

$R_L$  = radius of the large end of the reducer

t = shell thickness

ASME B&PV CODE COMPARISON SECTION VIII, 1962 VS. SECTION III, SUBSECTION G SECTION VIII, 1962 VS. SECTION III, SUBSECTION G

Scale A (Cont.)

Scale A (Cont.)

Referenced Section		Structural Potential	Referenced Section		Structural Potential
Section III 1980	Section VIII 1962		Section III 1980	Section VIII 1962	
NE-3327.1	---	Vessels with locking devices actuating closures	NE-3327.1	---	Vessels with locking devices actuating closures
NE-3327.4	---	Pressure devices for having quick closures	NE-3327.4	---	Pressure devices for having quick closures
NE-3331.(b)	UG-36	Openings and provisions for fatigue analysis	NE-3331.(b)	UG-36	Openings and provisions for fatigue analysis
NE-3334.1 NE-3334.2	UG-40.(b) UG-40.(c)	Reinforcement openings normal to vessel wall	NE-3334.1 NE-3334.2	UG-40.(b) UG-40.(c)	Reinforcement openings normal to vessel wall
NE-3365.(f)	---	Bellows expansion joints over 6 in diameter	NE-3365.(f)	---	Bellows expansion joints over 6 in diameter
NE-3365.2	---	Bellows	NE-3365.2	---	Bellows

\*Special treatment of load and load combination sections of the report.

ASME B&PV CODE COMPARISON  
SECTION VIII, 1962 VS. SECTION III, SUBSECTION NE, 1980

Scale B

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>Section III 1980</u>	<u>Section VIII 1962</u>		
NE-3133.1	UG-28	Components under external pressure	The design rules as given in Section VIII, 1962 are nearly identical to those specified in Section III, 1980. The differences will have little effect on the margin of safety.
NE-3133.6	---	Cylinders under axial compression	This new requirement is based on standard methods of analysis which do not differ much from those previously used in the analysis of cylinders under compressive loads.
NE-3324.8(c)	---	Torispherical heads made of materials having minimum tensile strength exceeding 80 ksi	The allowable stress for such a material should not exceed 22 ksi at room temperature as specified in the 1980 Code. Allowable stresses for those materials specified in the 1962 Code could be slightly higher, giving somewhat less conservative results.
NE-3324.12	---	Nozzles	The specified requirements imposed on the wall thickness of the nozzles or other connections are considered to be within the limitations of standard practice.

ASME B&PV CODE COMPARISON  
SECTION VIII, 1962 VS. SECTION III, SUBSECTION NE, 1980

Scale B (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>Section III 1980</u>	<u>Section VIII 1962</u>		
NE-3328	---	Combination units	This new insert gives the design requirements for pressure vessels consisting of more than one independent pressure chamber. These requirements are standard practice for designing such vessels.
NE-3335	UG-40	Reinforcement in nozzles and vessel walls	These new provisions in Section III, 1980 Code detail specific requirements which are usually considered in good design practice.
NE3365	---	Bellows expansion joint - general requirements	This new section provides specific requirements usually considered in the design and selection of bellows.
NE-3367	---	Closures on small penetrations	This new insert gives details used in common practice. However, compliance with the standards listed in Table NE-3132-1 is covered in SEP Topic III.1.
NE-3700	---	Electrical and mechanical penetration assemblies	Provisions usually adopted in standard engineering design of such assemblies.



ASME B&PV CODE COMPARISON  
SECTION VIII, 1962 VS. SECTION III, SUBSECTION NE, 1980

Scale C

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>Section III 1980</u>	<u>Section VIII 1962</u>		
NE-3332.2	UG-37(b)	Area of reinforcement - vessels under internal pressure	The introduction of the correction factor F in Section III, 1980 Code will render the applicable equation to be the same or less conservative.
NE-3325.2(b)	UG-34(c)	Flat unstayed heads, covers, and blind flanges	The applicable revised equation (2) will have a minor effect in the calculation of the thickness.
NE-3362(b)	UG-42	Bolted flanges and studded connections	The requirements for length of stud engagement are relaxed in Section III, 1980 Code.

APPENDIX B-4

ACI 318-71 VS. ACI 349-76

SUMMARY OF CODE COMPARISON

B-4.1

ACI 318-71 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale A

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-71</u>		
9.1.1.1	--	Normal loads	Impact of these conditions must be assessed.*
9.1.1.2	--	Severe environmental loads	
9.1.1.3	--	Extreme environmental loads	
9.1.1.4	--	Abnormal loads	
9.1.2	--	Normal loads	Impact of these conditions must be assessed.*
9.1.3	--	Earthquake loads	
9.1.4	--	Design loads and forces	
9.3	9.3	All loads	Impact of these conditions must be assessed.*
9.3.1	9.3.1		
9.3.2	9.3.2		
9.3.3	9.3.3		
9.3.4	9.3.4		
9.3.5	9.3.5		
9.3.6	9.3.6		
9.3.7	9.3.7		
10.1	--	All primary load-carrying members	Design loads here refer to Chapter 9 load combinations.*
11.1	--	All primary load-carrying members	Design loads here refer to Chapter 9 load combinations.*
18.1.4	--	Prestressed concrete elements	New load combinations here refer to Chapter 9 load combinations.*
Chapter 19	Chapter 19	Shell structures with thickness equal to or greater than 12 inches	New provisions for thick walls added.

\*Special treatment of loads and loading combinations is addressed in other sections of the report.

ACI 318-71 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale A (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-71</u>		
Appendix A	--	All elements subject to time-dependent and position-dependent temperature variations and which are restrained so that thermal strains will result in thermal stresses.	New appendix; older code did not give specific guidelines on temperature limits for concrete. The possible effects of strength loss of concrete at high temperatures should be assessed.
Appendix B	--	All steel embedments used to transmit loads from attachments into the reinforced concrete structures.	New appendix; therefore, considerable review of older designs is warranted.**
Appendix C	--	All elements whose failure under impulsive and impactive loads must be precluded.	New appendix; therefore, consideration and review of older designs is considered important.**

\*Special treatment of loads and loading combinations is addressed in other sections of the report.

\*\*Since stress analysis associated with these conditions is highly dependent on definition of failure planes and allowable stress for these special conditions, past practice varied with designers' opinions. Stresses may vary significantly from those thought to exist under previous design procedures.

ACI 318-71 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-71</u>		
--	1.5	All structural concrete elements	Cites requirements of 10CFR50 for quality assurance requirements and guidelines.
3.2.3	--	Structural concrete	New requirement on cement mill certification for better quality control.
--	3.3.1	Lightweight concrete aggregates	Lightweight aggregate most likely will not be found in nuclear related structure.
3.3.1	--	Shielding concrete element	Previous codes made no reference to this special purpose concrete.
3.3.3	--	All structural concrete	For better control of concrete quality through control of possible aggregate variations.
3.5.1	--	Reinforcing bar	New requirement which prohibits use of $f_y > 60,000$ psi to provide for better ductility and crack control. Also improves serviceability.
3.5.1(a) 3.5.1(b) Table 3.5.1	3.5.1(a) --	Deformed and plain billet-steel bar	Bend test pin diameter for #14 and #18 bars was decreased from 10D to 9D. However, steel with $f_y$ greater than 60,000 psi was eliminated from this code. Therefore, this change is not seen to be a problem. In general, the higher strength steels have lower ductility.
3.5.3	3.5.3	Reinforcing steel	For quality control improvement

ACI 318-71 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-71</u>		
3.5.5	--	Cold drawn steel wire for concrete reinforcement	High $f_y$ steels eliminated for control of cracking and improved ductility
3.5.6	--	Welded steel wire fabric for concrete reinforcement	For improved ductility and crack control.
3.5.7	--	Deformed steel wire for concrete reinforcement	For improved ductility and crack control.
3.5.8	--	Welded deformed steel wire fabric for concrete reinforcement	For improved ductility and crack control.
3.6.5	--	Concrete mixtures	Improve quality assurance by preventing variation in admixtures.
4.3	--	Concrete	Decreases the number of tests required when quality of concrete production is high.
5.3.3	--	Aluminum pipe	Prevents problems which result from aluminum-cement reaction.
5.4.1	5.4.1	Concrete	Explicit statement of what has in the past been considered good construction practice. Editorial change.
5.5.1	--	Concrete	Method of curing now required to be part of specifications. Curing compound compatibility does not affect structural integrity.

ACI 318-71 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-71</u>		
6.3.3	--	All structural elements with embedded piping containing high temperature materials in excess of 150°F, or 200°F in localized areas not insulated from the concrete	Previous code did not address the problem of long periods of exposure to high temperature and did not provide for reduction in design allowables to account for strength reduction at high (> 150°F) temperatures.
7.5.5	--	Welded splices or other positive connections	Limits intended to provide for ductility and crack control.
7.6.2	7.6.2	Splices	New requirement eliminates dependence of tension stress transfer on concrete, thereby insuring tension tie integrity.
7.6.4	--	Splices in area of membrane tension	Past design practice has been consistent with the intent of this new provision.
7.8.1	7.8.1	Splices of welded smooth wire fabric	Past practice preference was to avoid such splices. Therefore, this is not considered to be critical.
7.8.2	7.8.2	Lapped splices	Smooth wire probably not used in large structures, as found in nuclear facilities, for primary reinforcement.
7.9	7.9	Lapped splices	Splice length definition augmented but not considered to be critically changed.
7.13 7.13.1 7.13.2	--	Concrete surface	Minimum steel for each face is intended to provide crack control and to develop the cracking moment of the section in anticipation of two-way bending and possible

ACI 318-71 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-71</u>		
		Concrete surface (Cont.)	load reversals. Also, the thicker sections required in nuclear structures require controls similar to those ordinarily used in massive concrete structures.
9.5.4.1	--	Prestressed concrete	No major effect on older designs.
9.5.4.3	--	Prestressed concrete	Will not affect the overall structural strength.
9.5.6	--	Walls	Requirement added to control service of walls. Not considered critical.
9.5.1.1	--	All members	Allows for greater control of deflection in special cases.
9.5.1.3 9.5.1.4 Table 9.5(a)	--	All members	New control on serviceability under factored loads to provide for service under abnormal conditions.
Table 9.5.(b)	Table 9.5(a)	Beam or one-way slabs	Minimum thickness generally would not control the design in this type of structure.
Table 9.5(c)	Table 9.5(b)	Two-way slabs	Minimum thickness generally would not control the design in this type of structure.
9.5.3 9.5.3.6	9.5.3 --	Non-prestressed two-way construction	Immediate and long-time deflections generally not a problem where live loads are very large. However, design by strength logic requires more attention to control of deflections.



ACI 318-71 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-71</u>		
10.2.7	10.2.7	Concrete	New limit corresponds to a concrete strength of 8000 psi. Older design not likely to have considered such a concrete design strength.
10.3.6	--	Compression members	Consistent with previous logic.
10.6.3	10.6.3	Reinforcement	May not be effective. Applies only to $f_y$ in excess of 40,000 psi.
10.11.6	10.11.6	Compression members	No major change.
10.17	--	Thick massive concrete structures	Past practice should have used similar reference material.
11.7.8	--	All members	Not considered critical since design would have required consideration if Code did not.
11.7.9	--	Statically indeterminate structure	Past practice covered this in an empirical manner.
11.10.4	11.10.3	Concrete	Upper limit of shear stress maintained.
11.10.5	--	Nuclear-related structure slab	New provision for shear for the two-way action condition and where shear head reinforcement is used. Intent is consistent with previous Code logic.
11.10.6	--		
11.10.7	--		
11.16.7	--	Nuclear structures	New provision for peripheral shear in walls.
12.10.1	12.10.1	Welded wire fabric	Use of such reinforcement not likely in older nuclear plant designs.

ACI 318-71 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

Referenced Section		Structural Elements Potentially Affected	Comments
ACI 349-76	ACI 318-71		
12.10.2 (a) (b)	-- 12.10.2 --	Welded deformed wire fabric	Logic consistent with previous Code.
12.13.1.2	--	Deformed wire	Deformed wire not likely to be found in older structures.
13.3.1.7	--	Slab	Logic consistent with previous Codes.
13.5.6	--	Bent bar for slabs	Past practice is consistent with this logic.
15.10 (b)	--	Combined footing and mats	Not considered to be a problem as general practice probably used continuous frame logic.
16.2.2	--	Precast concrete members	Consistent with the logic of previous Codes and past practice.
16.4.2	--	Concrete dowels or inserts	Consistent with past practice.
18.9.2 18.9.2.1 18.9.2.2 18.9.2.3	18.9.2	Slab joints and column	Increases in some of the allowable tensile stresses require greater control of cracking.
18.9.3	18.9.3	Bonded reinforcement	Minimum length definition needed to complete definition of bonded reinforcement requirements.
18.15.2	18.16.2	Tendon	Consistent with good practice.
18.15.3	--	Grout	Consistent with past good construction practice.

ACI 318-71 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale B (Cont.)

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-71</u>		
18.16.2	18.17.3	Grout	Provides for higher quality grout and grout quality control.
18.19.2	18.20.3	Unbonded structure	
19.2.1	--	Concrete structure	These new inserts are consistent with past good design practice.
19.2.6	--	Opening or penetration of the overall structure	These new inserts are consistent with good design practice.
19.2.7	--		
19.3.2	--		
19.3.3	--		
19.3.7	--		

ACI 318-71 VS. ACI 349-76  
SUMMARY OF CODE COMPARISON

Scale C

<u>Referenced Section</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>ACI 349-76</u>	<u>ACI 318-71</u>		
7.13.4	--	Concrete surface	Less conservative than older Codes.
18.4.1 (a), (b), (c)	18.4.1 (a), (b)	Concrete structure	Older designs will, as a result, appear more conservative.
18.4.2	--		Older designs more conservative for the same gross loads.

APPENDIX B-5  
AISC 1971\* VS. AISC 1980  
SUMMARY OF CODE COMPARISON

\*Includes supplements 1 and 2

AISC 1971 VS. AISC 1980  
SUMMARY OF CODE COMPARISON

Scale A

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>	<u>Scale</u>
<u>AISC 1980</u>	<u>AISC 1971</u>			
1.5.1.1	1.5.1.1	Structural members under tension, except for pin connected members	<u>Limitations</u>  $F_y \leq 0.833 F_u$ $0.833 F_u < F_y < 0.875 F_u$ $F_y \geq 0.875 F_u$	C B A
1.5.1.2.2	--	Beam end connection where the top flange is coped and subject to shear, failure by shear along a plane through fasteners, or shear and tension along and perpendicular to a plane through fasteners	See case study 1 for details.	
1.5.1.4.1 Subpara. 6	1.5.1.4.1	Box-shaped members (subject to bending) of rectangular cross section whose depth is not more than 6 times their width and whose flange thickness is not more than 2 times the web thickness	New requirement in the 1980 Code	
1.5.1.4.1 Subpara. 7	1.5.1.4.1	Hollow circular sections subject to bending	New requirement in the 1980 Code	
1.5.1.4.4	--	Lateral support requirements for box sections whose depth is larger than 6 times their width	New requirement in the 1980 Code	
1.5.2.2 and Appendix B	1.7	Rivets, bolts, and threaded parts subject to 20,000 cycles or more	Change in the requirements	

AISC 1971 VS. AISC 1980  
SUMMARY OF CODE COMPARISON

Scale A (Cont.)

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>AISC 1980</u>	<u>AISC 1971</u>		
1.7 and Appendix B	1.7	Members and connections subject to 20,000 cycles or more	Change in the requirements
1.9.2.3 and Appendix C	--	Circular tubular elements subject to axial compression	New requirements added in the 1980 Code
1.11.5	--	Composite beams or girders with formed steel deck	New requirements added in the 1980 Code
1.15.5.2 1.15.5.3 1.15.5.4	1.15.5	Restrained members when flange or moment connection plates for end connections of beams and girders are welded to the flange of I or H shaped columns	New requirement added in the 1980 Code
1.14.2.2	--	Axially loaded tension members where the load is transmitted by bolts or rivets through some but not all of the cross-sectional elements of the members	New requirement added in the 1980 Code
Appendix D	--	Web tapered members	New requirements added in the 1980 Code

AISC 1971 VS. AISC 1980  
SUMMARY OF CODE COMPARISON

Scale B

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>AISC 1980</u>	<u>AISC 1971</u>		
1.14.6.1.3	--	Flare type groove welds when flush to the surface of the solid section of the bar	
1.16.4.2	1.16.4	Fasteners, minimum spacing, requirements between fasteners	
1.16.5.2 1.16.5.3 1.16.5.4	1.16.6	Structural joints, edge distances of holes for bolts and rivets	
1.15.5.5	--	Connections having high shear in the column web	New insert in the 1980 Code
2.3.2	--	Unbraced multi-story frame - instability effect	Instability effect on short buildings will have negligible effect.



AISC 1971 VS. AISC 1980  
SUMMARY OF CODE COMPARISON

Scale C

<u>Referenced Subsection</u>		<u>Structural Elements Potentially Affected</u>	<u>Comments</u>
<u>AISC 1980</u>	<u>AISC 1971</u>		
1.3.3	1.3.3	Support girders and their connections - pendant operated traveling cranes  The 1971 Code requires 25% increase in live loads to allow for impact as applied to traveling cranes, while the 1980 Code requires 10% increase.	The 1971 Code requirement is more stringent, and, therefore, conservative.

APPENDIX C

COMPARATIVE EVALUATIONS AND MODEL STUDIES



Franklin Research Center

A Division of The Franklin Institute

The Benjamin Franklin Parkway, Phila., Pa. 19103 (215) 448-1000



CASE STUDY -1-

The allowable stress for structural steel subject to shear is specified in section 1.5.1.2 of the AISC code both in the 1963 and 1980 editions as

$$F_v = 0.40 F_y \quad \text{--- (1) based on the sectional area effective in resisting shear}$$

However, in the 1980 Code a new section 1.5.1.2.2 is introduced stating that;

"At beam end connections where the top flange is coped, and in similar situations where failure might occur by shear along a plane through the fasteners, or by a combination of shear along a plane through the fasteners plus tension along a perpendicular plane, on the area effective in resisting tearing failure:  $F_v = 0.30 F_u$  where the effective area is the minimum net failure surface, bounded by the bolt holes."

Referring to the 1980 Commentary and Fig. C.1.5.1.2

The connection allowable capacity in the tearing failure mode can be taken as

$$0.30 A_v F_u + 0.50 A_t F_u \quad \text{--- (2)}$$

where  $A_v$  and  $A_t$  are the net shear and net tension areas respectively.

In order to evaluate the effect of the code change, 3 sets of each; Material, beam size & coefficients for web tear out (Table 1-6 page 4-11 of the AISC Steel Manual) were used.

The results obtained by using equations (1) & (2) above indicate that the 1980 Code gives less conservative results as shown on the following tabulation.

Therefore, Scale -A-



BEAM END CONNECTION WHERE TOP FLANGE IS COPEd, CASE STUDY -1-

FY, PSI	FU, PSI	H, IN	C1	C2	ALLOWABLE LOAD, LB		PCT.
					1963 CODE	1960 CODE	
36000.	60000.	12.00	1.00	0.74	172800.	104400.	40.
36000.	60000.	12.00	1.50	0.74	172800.	134400.	22.
36000.	60000.	24.00	1.00	0.74	345600.	104400.	70.
36000.	60000.	24.00	1.00	2.48	345600.	208800.	40.
36000.	60000.	24.00	1.50	0.74	345600.	134400.	61.
36000.	60000.	24.00	1.50	2.48	345600.	238800.	31.
36000.	60000.	24.00	2.25	0.74	345600.	179400.	48.
36000.	60000.	24.00	2.25	2.48	345600.	283800.	18.
36000.	60000.	36.00	1.00	2.48	518400.	208800.	60.
36000.	60000.	36.00	1.00	4.81	518400.	348600.	33.
36000.	60000.	36.00	1.50	2.48	518400.	238800.	54.
36000.	60000.	36.00	1.50	4.81	518400.	378600.	27.
36000.	60000.	36.00	2.25	2.48	518400.	283800.	45.
36000.	60000.	36.00	2.25	4.81	518400.	423600.	18.
50000.	70000.	12.00	1.00	0.74	240000.	121800.	49.
50000.	70000.	12.00	1.50	0.74	240000.	156800.	35.
50000.	70000.	12.00	2.25	0.74	240000.	209300.	13.
50000.	70000.	24.00	1.00	0.74	480000.	121800.	75.
50000.	70000.	24.00	1.00	2.48	480000.	243600.	49.
50000.	70000.	24.00	1.50	0.74	480000.	156800.	67.
50000.	70000.	24.00	1.50	2.48	480000.	278600.	42.
50000.	70000.	24.00	2.25	0.74	480000.	209300.	56.
50000.	70000.	24.00	2.25	2.48	480000.	331100.	31.
50000.	70000.	36.00	1.00	2.48	720000.	243600.	66.
50000.	70000.	36.00	1.00	4.81	720000.	406700.	44.
50000.	70000.	36.00	1.50	2.48	720000.	278600.	61.
50000.	70000.	36.00	1.50	4.81	720000.	441700.	39.
50000.	70000.	36.00	2.25	2.48	720000.	331100.	54.
50000.	70000.	36.00	2.25	4.81	720000.	494200.	31.
65000.	80000.	12.00	1.00	0.74	312000.	139200.	55.
65000.	80000.	12.00	1.50	0.74	312000.	179200.	43.
65000.	80000.	12.00	2.25	0.74	312000.	239200.	23.
65000.	80000.	24.00	1.00	0.74	624000.	139200.	78.
65000.	80000.	24.00	1.00	2.48	624000.	278400.	55.
65000.	80000.	24.00	1.50	0.74	624000.	179200.	71.
65000.	80000.	24.00	1.50	2.48	624000.	318400.	49.
65000.	80000.	24.00	2.25	0.74	624000.	239200.	62.
65000.	80000.	24.00	2.25	2.48	624000.	378400.	39.
65000.	80000.	36.00	1.00	2.48	936000.	278400.	70.
65000.	80000.	36.00	1.00	4.81	936000.	464800.	50.
65000.	80000.	36.00	1.50	2.48	936000.	318400.	66.
65000.	80000.	36.00	1.50	4.81	936000.	504800.	46.
65000.	80000.	36.00	2.25	2.48	936000.	378400.	60.
65000.	80000.	36.00	2.25	4.81	936000.	564800.	40.

NOTES:

- 1- ALLOWABLE LOADS ARE GIVEN PER INCH OF WEB THICKNESS
- 2- PCT= PERCENT OF THE REDUCTION OF PERCEIVED MARGIN OF SAFETY



CASE STUDY 2

AXIALLY LOADED COLUMNS

Maximum allowable axial load on tied columns by working stress design criteria is defined by

$$P = 0.85 [A_g (0.25 f'_c + f_s p_g)]$$

where  $p_g = \frac{A_{st}}{A_g}$  and allowable  $f_s = 0.4f_y \leq 30,000$  psi

that is,  $\max f_y \leq 75,000$  psi

therefore, the maximum load could be expressed as:

$$P_{allow} = (0.21 A_g f'_c + 0.34 f_y A_{st})$$

Maximum allowable axial load on tied columns by strength design criteria is defined by

$$P_{allow} = \phi P_o = \phi 0.8 [0.85 f'_c (A_g - A_{st}) + A_{st} f_y]$$

for a tied column in axial compression  $\phi = 0.7$  and  $P_u = 1.4 D + 1.7 L$

Reducing these equations to be comparable to working stress limits and considering all extremes of steel % and D. to L. load ratios, we get

if  $A_{st} = 0.01 A_g$   $P_u = \phi P_o = \phi (0.673 f'_c A_g + 0.8 A_{st} f_y)$

if  $A_{st} = 0.08 A_g$   $P_u = \phi P_o = \phi (0.626 f'_c A_g + 0.8 A_{st} f_y)$

and to bracket extremes, consider the following three cases.

(a)  $D = 0$

(b)  $L = D$  and

(c)  $L = 0$  with  $P_{allow} = \frac{P_u}{L.F.}$



Franklin Research Center  
A Division of The Franklin Institute  
The Benjamin Franklin Parkway, Phila., Pa. 19103

Project		C5257		Page C.2-2	
By	Date	Ch'k'd	Date	Rev.	Date
<i>E.M.D.</i>	<i>2/12</i>	TCS	4-82		

(a) for L.F. = 1.7

$$P_{allow} = 0.28 f'_c A_g + 0.33 f_y A_{st} \quad \text{or}$$

$$P_{allow} = 0.26 f'_c A_g + 0.33 f_y A_{st}$$

(b) for L.F. = 1.55

$$P_{allow} = 0.30 f'_c A_g + 0.36 f_y A_{st} \quad \text{or}$$

$$P_{allow} = 0.28 f'_c A_g + 0.36 f_y A_{st}$$

(c) for L.F. = 1.4

$$P_{allow} = 0.34 f'_c A_g + 0.40 f_y A_{st} \quad \text{or}$$

$$P_{allow} = 0.31 f'_c A_g + 0.40 f_y A_{st}$$

Comparison of these resulting equations to the  $P_{allow}$  by working stress design criteria shows that the new code allows from 1.24 to 1.62 times more load on the concrete in a tied column and from 0.97 to 1.18 times more load on the longitudinal steel in a tied column.

Therefore, Scale C



Project		C5257		Page		C.3-1	
By	Date	Ch'k'd	Date	Rev.	Date		
<i>E. Miller</i>	6/13/32	T.C.S.	6-13-32				

CASE STUDY 3

FLEXURAL MEMBERS

Sections with Tension Reinforcing Only:

For purposes of code comparison, with emphasis on comparing safety margins of designs conforming to older codes and practices with corresponding margins provided by current criteria, the following case studies were prepared.

For designs prepared by working stress criteria, a comparison with strength design was made by reducing the strength equation to an allowable moment by the following definition.

$$M_{allow} = \frac{\phi M_u}{L.F.}$$

To bracket extremes of load ratios, the following three cases were considered in each working stress comparison.

- |                |             |
|----------------|-------------|
| (a) when L = 0 | L.F. = 1.4  |
| (b) when L = D | L.F. = 1.55 |
| (c) when D = 0 | L.F. = 1.7  |

For designs prepared by yield-strength criteria, a comparison with strength design was made directly with a load factor equal to 1.0. The yield-strength definition used here was not a code endorsed practice; but was the method widely adopted by architect engineers, at the time, to design for the extreme loadings postulated for accident and faulted conditions. It possesses the practical advantage of permitting an extended use of linearly elastic computer codes to provide design guidance for extreme loading cases and is documented in Ref. 1\*

Since older codes did not contain any strict limitation on the percent of reinforcement, the comparisons presented here used the defined balanced steel percentage and additionally steel percentages 60 percent lower and 50 percent higher than balanced in order to show the effect of this parameter on the comparisons.

\*Ref. 1


*A Study of the Design and Construction Practices of Prestressed Concrete and Reinforced Concrete Containment Vessels by C. P. Tan prepared by FIRC for the U. S. Atomic Energy Commission, Aug. 1969 under contract to the ORNL (TID 25176).*



For Working Stress Design

The definition of balanced design is that both concrete and steel reach their theoretical working stress allowable limit simultaneously.

The strain diagram and neutral axis location for this condition are:

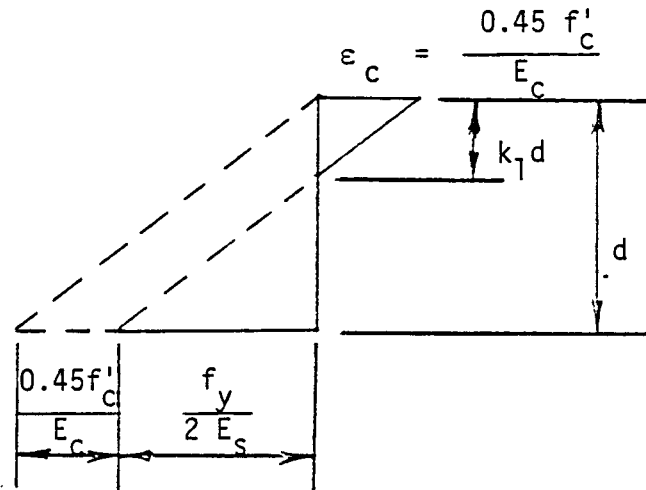

$$\frac{k_1 d}{d} = \frac{0.45 \frac{f'_c}{E_c}}{\frac{0.45 \frac{f'_c}{E_c} + \frac{f_y}{2 E_s}}$$

$$k_1 = \frac{1}{1 + \left(\frac{1}{0.9}\right) \left(\frac{f_y}{f'_c}\right) \left(\frac{E_c}{E_s}\right)}$$

let  $r = \frac{f_y}{f'_c}$  and  $n = \frac{E_s}{E_c}$

then for elastic balanced design:

$$k_1 = \frac{1}{1 + 1.11 \left(\frac{r}{n}\right)}$$

and from equilibrium:

$$\frac{F_s}{F_c} = \frac{A_s f_y}{(0.45 f'_c) b k d} = \left(\frac{A_s}{b d}\right) \left(\frac{f_y}{f'_c}\right) \frac{1}{0.45 k} = 1$$






$$\rho_1 = \frac{A_s}{bd} = 0.45 \frac{k_1}{r}$$

$$M_t = f_s A_s j d \quad \text{or} \quad M_c = 1/2 f_c b d^2 j k$$

### For Yield-Limit Design

The Yield-Limit concept assumes that the system behaves in a linear fashion up to the yield of the steel or to the ultimate strength of the concrete. For the balanced condition again  $f_s = f_y$  and  $f_c = f'_c$  simultaneously.

The strain diagram and neutral axis location for this condition are:

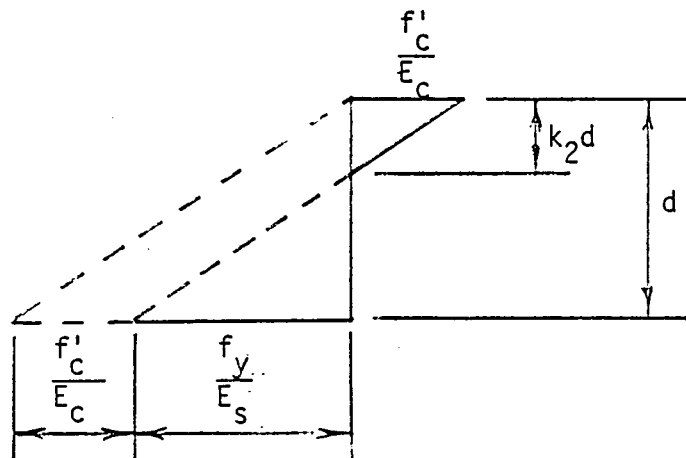

$$\frac{k_2 d}{d} = \frac{\frac{f'_c}{E_c}}{\frac{f'_c}{E_c} + \frac{f_y}{E_s}}$$

$$k_2 = \frac{1}{1 + \frac{f_y}{f'_c} \frac{E_c}{E_s}}$$

then for balanced conditions

$$k_2 = \frac{1}{1 + \left(\frac{r}{n}\right)}$$

and from equilibrium

$$\frac{F_s}{F_c} = \frac{A_s f_y}{1/2 (f'_c) b k d} = 2 \rho_2 \frac{r}{k_2} = 1$$

$$\rho_2 = \frac{k_2}{2r}$$

$$M_t = f_y A_s j d \quad \text{or} \quad M_c = 1/2 f'_c b d^2 j k$$



Project		C5257		Page		C.3-4	
By	Date	Ch'k'd	Date	Rev.	Date		
<i>E.M.W.</i>	6/52	TCS	6-15-32				

For Strength Design

Ultimate strength capacity is defined as:

$$M_u = A_s f_y d \left[ 1 - 0.59 \rho \frac{f_y}{f'_c} \right]$$

Example 1.

for Yield-Limit design at balanced design

$$M_t = f_y A_s j d \quad M_c = 1/2 f'_c b d^2 j k = 1/2 \left( \frac{f'_c}{f_y} \right) \frac{j k}{\rho} (A_s f_y d)$$

$$k_2 = \frac{1}{1 + \frac{f_y}{f'_c} \frac{E_c}{E_s}} \quad \rho_2 = 1/2 k_2 \frac{f'_c}{f_y} \quad n = \frac{E_s}{E_c} = \frac{508}{\sqrt{f'_c}}$$

for  $f'_c = 4,000$  psi     $f_y = 40,000$  psi     $n = 8$

$$k_2 = \frac{1}{1 + 10 (1/8)} = 0.444 \quad \rho_2 = 1/2 (0.444) 4/40 = 0.022$$

$$j = 0.852$$

$$M_t = 0.852 f_y A_s d$$

$$M_u = A_s f_y d [1 - 0.59(0.022)10] = 0.869 A_s f_y d$$

$$\frac{M_u}{M_t} = \frac{0.869}{0.852} = 1.02$$

Also:

if  $\rho < \rho_2$     (say 60%  $\rho_2$ )

$$\rho = 0.6 (0.022) = 0.0132$$



$$\alpha = 2\rho n = 2 (0.0132)(8) = 0.211$$

$$k = \left(0.211 + \frac{(0.211)^2}{4}\right)^{1/2} - \frac{0.211}{2} = 0.366$$

$$j = 0.878$$

$$M_t = 0.878 f_y A_s d$$

$$M_u = A_s f_y d [1 - 0.59 (0.0132)10] = 0.922 A_s f_y d$$

$$\frac{M_u}{M_t} = 1.05$$

and; similarly,

$$\text{if } \rho > \rho_2 \quad \rho = 1.5 \rho_2 = 1.5 (0.022) = 0.033$$

One finds  $M_c$  controls, and:

$$\frac{M_u}{M_c} = 1.26$$

For working stress design at balanced design

$$k_1 = \frac{1}{1 + 1.11 (10/8)} = 0.419 \quad \rho_1 = 0.45 \frac{0.419}{(10)} = 0.0188$$

$$j = 0.86$$

$$M_t = 0.86 f_y A_s d = 0.86 \frac{f_y}{2} A_s d = 0.43 A_s f_y d$$

$$M_u = A_s f_y d [1 - 0.59(0.0188)10] = 0.889 A_s f_y d$$

$$\frac{M_u}{M_t} = 2.07$$

$$\frac{M_{allow}}{M_t} = \frac{0.9}{L.F.} \frac{M_u}{M_t} = \begin{cases} 1.33 & \text{if } L = 0 \\ 1.20 & \text{if } L = D \\ 1.09 & \text{if } D = 0 \end{cases}$$



Also:

if  $\rho < \rho_1$  (say 60%  $\rho_2$ )

$$\rho = 0.6 (0.0188) = 0.0113 \quad \alpha = 2 \rho n = 0.180$$

$$k = (0.18 + \frac{(0.18)^2}{4})^{1/2} - \frac{0.18}{2} = 0.344$$

$$j = 0.885$$

$$M_t = 0.885 A_s f_s d = 0.885 A_s \frac{f_y}{2} d = 0.443 A_s f_y d$$

$$M_u = A_s f_y d [1 - 0.59(0.0113)10] = 0.933 A_s f_y d$$

$$\frac{M_u}{M_t} = 2.11$$

$$\therefore \frac{M_{allow}}{M_t} = \begin{cases} 1.36 & \text{if } L = 0 \\ 1.22 & \text{if } L = D \\ 1.12 & \text{if } D = 0 \end{cases}$$

and:

if  $\rho > \rho_1$  (say 1.5  $\rho_1$ )

One finds concrete controls, and:

$$\frac{M_u}{M_c} = 2.43$$

$$\therefore \frac{M_{allow}}{M_c} = \begin{cases} 1.56 & \text{if } L = 0 \\ 1.41 & \text{if } L = D \\ 1.29 & \text{if } D = 0 \end{cases}$$



In summary,

for yield limit design comparisons:

$$\frac{M_u}{M_t} = 1.02 \text{ to } 1.26$$

for working stress design comparisons:

$$\frac{M_{allow}}{M_t} = 1.09 \text{ to } 1.56$$

Strength design allows beams to operate at a higher stress level. For these beams the older code is more conservative

Scale C

Example 2.

For Yield-Limit design at balanced design

for  $f'_c = 3000 \text{ psi}$

$f_y = 36,000 \text{ psi}$

$$k_2 = \frac{1}{1 + (12)(1/9)} = 0.429$$

$$\rho_2 = 1/2 (0.429) 1/12 = 0.0179$$

$$j = 0.857$$

$$M_t = 0.857 A_s f_y d$$

$$M_u = A_s f_y d [1 - 0.59(0.0179)12] = 0.873 A_s f_y d$$

$$\frac{M_u}{M_t} = 1.02$$

Also:

if  $\rho < \rho_2$  (say 60%)

$$\frac{M_u}{M_t} = 1.05$$



*E.M.W.*

6/82

TCS 6-18-82

And:

if  $\rho > \rho_2$  (say  $\rho = 1.5 \rho_2 = 0.0268$ )

$$\frac{M_u}{M_c} = 1.26$$

For Working Stress Design at balanced design

$f'_c = 3 \text{ ksi}$

$f_y = 36 \text{ ksi}$

$n = 9$

$\frac{f_y}{f'_c} = 12$

$k_1 = 0.403$

$\rho_1 = 0.0151$

$$\frac{M_u}{M_t} = 2.06$$

$$\therefore \frac{M_{allow}}{M_t} = \begin{cases} 1.32 & \text{if } L = 0 \\ 1.20 & \text{if } L = D \\ 1.09 & \text{if } D = 0 \end{cases}$$

Also:

if  $\rho < \rho_1$  (say 60%)

$$\frac{M_u}{M_t} = 2.1$$

$$\therefore \frac{M_{allow}}{M_t} = \begin{cases} 1.35 & \text{if } L = 0 \\ 1.22 & \text{if } L = D \\ 1.11 & \text{if } D = 0 \end{cases}$$



Project		C5257		Page		C.3-9	
By	Date	Ch'k'd	Date	Rev.	Date		
<i>E/MW</i>	6/82	TCS	6-18-82				

And:

if  $\rho > \rho_1$  (say  $1.5 \rho_1$ )

$$\frac{M_u}{M_c} = 2.58$$

$$\frac{M_{allow}}{M_c} = \begin{cases} 1.66 & \text{if } L = 0 \\ 1.50 & \text{if } L = D \\ 1.36 & \text{if } D = 0 \end{cases}$$

In summary,

for yield limit design comparisons:

$$\frac{M_u}{M_t} = 1.02 \text{ to } 1.26$$

for working stress design comparisons:

$$\frac{M_{allow}}{M_t} = 1.09 \text{ to } 1.66$$

- Strength design allows beams to operate at a higher stress level. For these beams the older code is more conservative.

Scale C

In general, for designs controlled by flexure, beams designed by strength design methods will have higher stresses at service load levels than beams designed for the same service loads by working stress design methods.



CASE STUDY -4 -

Ref AISC 1980 CODE

Subsection 2.4 Columns

" In the plane of bending of columns which would develop a plastic hinge at ultimate loading, the slenderness ratio  $\frac{l}{r}$  shall not exceed  $C_c, \dots$  "

Where

$$C_c = \sqrt{\frac{2\pi^2 E}{F_y}}$$

$$E = 29 \times 10^3 \text{ KSI}$$

$F_y$  = yield stress

$$\text{Therefore } \frac{l}{r} \leq \frac{756.6}{\sqrt{F_y}}$$

Ref AISC 1963 Code

Subsection 2.3 Columns

" In the plane of bending of columns which would develop a plastic hinge at ultimate loading, the slenderness ratio shall not exceed 120,  $\dots$  "

$$\frac{l}{r} \leq 120$$





which of the two codes is the more restrictive on  $l/r$  ratio depends on the yield strength of the steel used for the columns.

1) Both codes give  $\frac{l}{r} = 120$  when

$$C_c = \frac{756.6}{\sqrt{F_y}} = 120$$

then,

$$F_y = 40 \text{ KSI}$$

2) The 1980 Code is 5% more conservative when

$$\frac{l}{r} = 114 = \frac{756.6}{\sqrt{F_y}}$$

then,  $F_y = 44 \text{ KSI}$

Conclusion:

Scale

$$F_y \leq 40 \text{ KSI} \text{ --- } \textcircled{C}$$

$$40 < F_y < 44 \text{ --- } \textcircled{B}$$

$$F_y > 44 \text{ --- } \textcircled{A}$$



CASE STUDY -5-

Ref AISI 1980 Code

Subsection 1.10.5.3

"In girders designed on the basis of tension field action, the spacing between stiffeners at end panels, at panels containing large holes, and at panels adjacent to panels containing large holes shall be such that  $f_v$  does not exceed the value given" below

$$F_v = \frac{F_y}{2.89} C_v \leq 0.4 F_y$$

Where

$$C_v = \frac{45000k}{F_y(h/t)^2} \quad \text{when } C_v < 0.8$$

$$k = 4 + \frac{5.34}{(a/h)^2} \quad \text{when } a/h < 1.0$$

$$= 5.34 + \frac{4}{(a/h)^2} \quad \text{when } a/h > 1.0$$



Franklin Research Center  
 A Division of The Franklin Institute  
 The Benjamin Franklin Parkway, Phila., Pa. 19103

Project		C5257		Page		C.5-2	
By	Date	Ch'k'd	Date	Rev.	Date		
MD	SEPT. '81	E.M.L.	12/81				

Ref AISC 1963 code

Subsection 1.10.5.3

" The spacing between stiffeners at end panels and panels containing large holes shall be such that the smaller panel dimension a or b shall not exceed

$$\frac{1100t}{\sqrt{fv}} "$$



REF AISC SUB section 1.10.5.3

V = 240 Kips

EXAMPLE


$$h = 68''$$

$$t = .375''$$

$$A_w = 68 \times \frac{3}{8} = 25.5 \text{ in}^2$$

$$V = 240 \text{ KIPS}$$

$$f_v = \frac{240}{25.5} = 9.06 \text{ KSI}$$

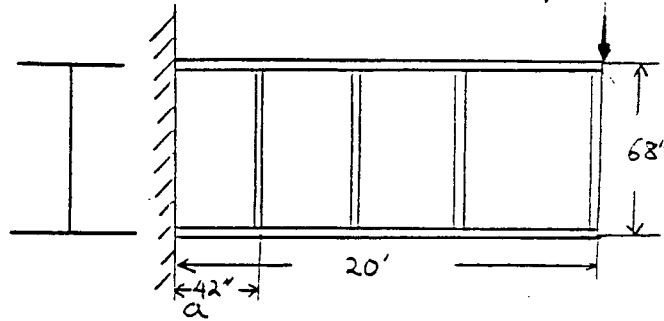

from 1.10.5.3 1963 Code

$$a \text{ or } h \nlessgtr \frac{11000t}{\sqrt{f_v}} = \frac{11000 \times 3/8}{\sqrt{9.06 \times 1000}} = 43 \text{ in}$$

Which is the distance from the end of the girder to the first transverse stiffener.

By considering the tension field action

as specified in 1980 Code subsection 1.10.5.3

$$f_v = 9.06 \text{ KSI} \quad \frac{h}{t} = \frac{68}{.375} = 181 \quad \& \quad \frac{a}{h} = \frac{42}{68} = .618$$

$$k = 4 + \frac{5.34}{(a/h)^2} = 4 + \frac{5.34}{(.618)^2} = 17.98$$

$$C_v = \frac{45000k}{F_y (h/t)^2} = \frac{45000 \times 17.98}{36 (181)^2} = .686$$

$$F_v = \frac{F_y}{2.89} C_v \leq .4 F_y$$

$$= \frac{36}{2.89} \times .686 = 8.54 \text{ KSI} \quad \& \quad \text{from table 10.36 the}$$

Allowable shear stress  $\approx 8.6 \text{ KSI}$  (checks Computed Value)

however, lower than  $f_v$  of 9.06 KSI

$\therefore$  Scale B for this example



Franklin Research Center  
A Division of The Franklin Institute  
The Benjamin Franklin Parkway, Phila., Pa. 19103

Project		C5257		Page C.5-4	
By	Date	Ch'k'd	Date	Rev.	Date
MD	SEPT. '81	<i>[Signature]</i>	<i>[Date]</i>		

Remarks

The following two figures show  $F_v$  vs.  $A/T$  for various values of  $A/H$  and  $F_y$ .  
By knowing the shear stress  $F_v$  or  $F_v'$  the  $A/T$  value can be obtained and compared with the design  $A/T$ . Thus comparison should be examined on a case by case basis.



**Franklin Research Center**  
 A Division of The Franklin Institute  
 The Benjamin Franklin Parkway, Phila., Pa. 19103

Project

C5257

Page

C.5-5

By

MD

Date

SEPT. 31

Ch'k'd


*[Signature]*

Date

10/1

Rev.

Date

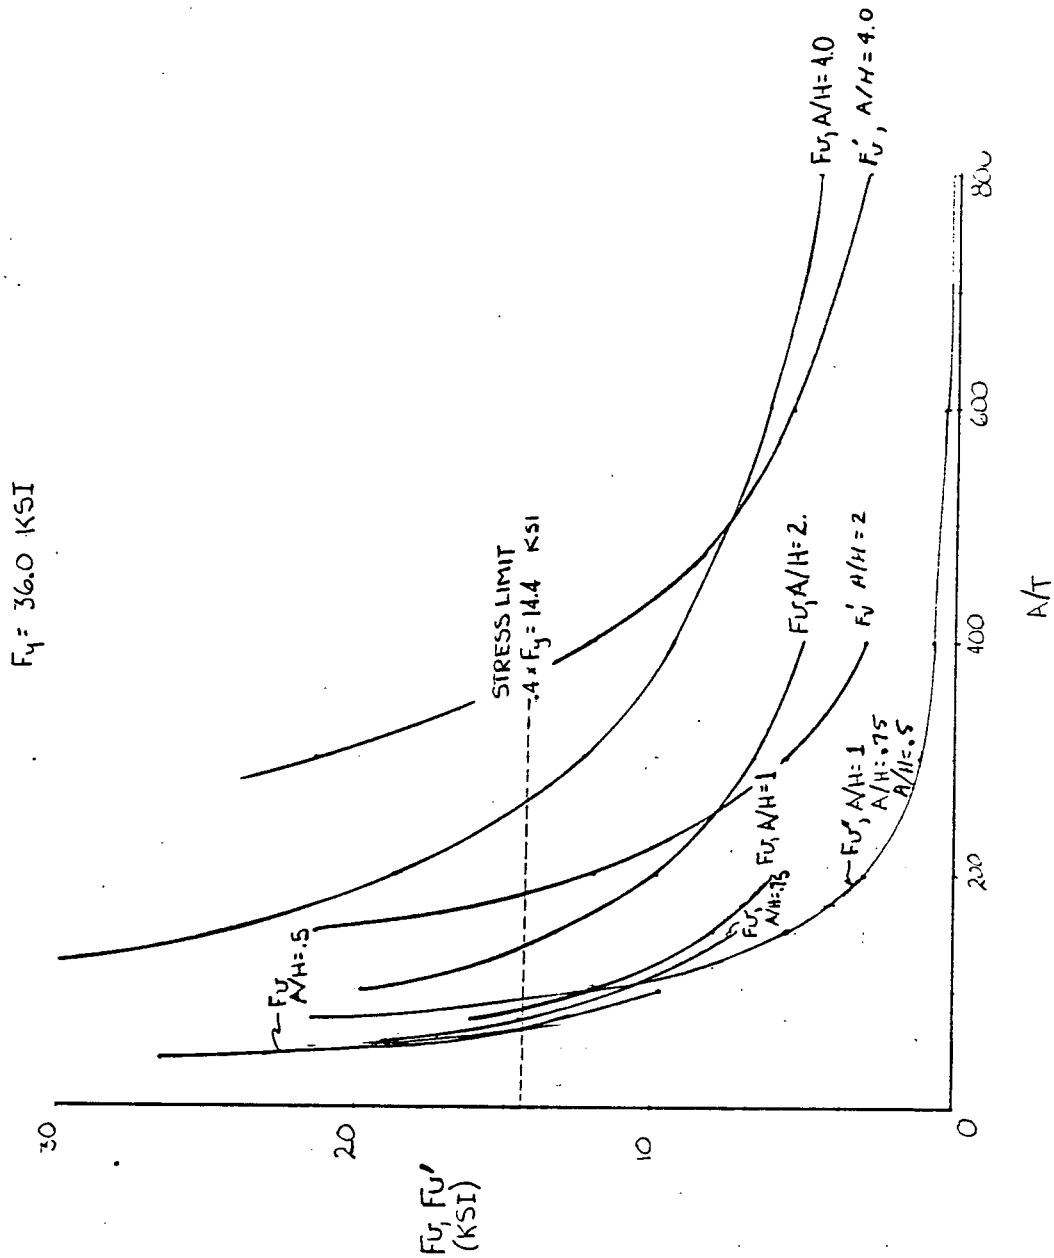



**Franklin Research Center**  
 A Division of The Franklin Institute  
 The Benjamin Franklin Parkway, Phila., Pa. 19103

Project

C5257

Page

C.5-6

By  
 MD


Date  
 SEPT '31

Ch'k'd  
 [Signature]

Date  
 1/27

Rev.

Date

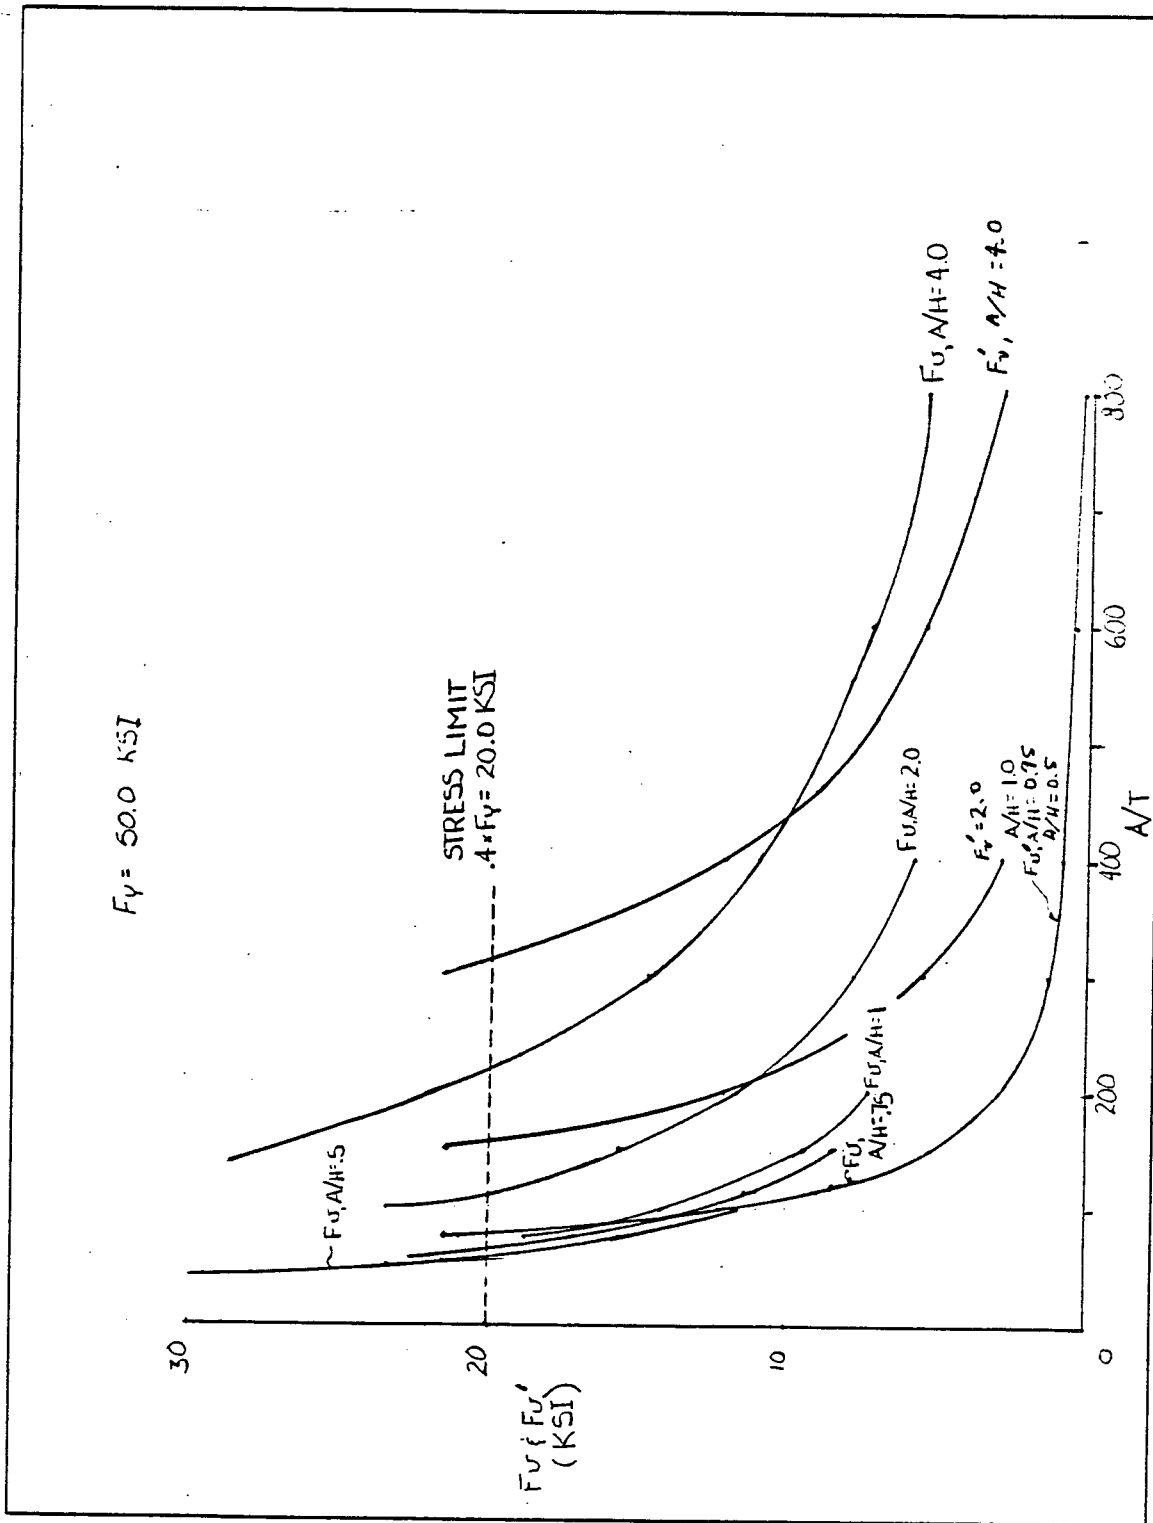



CASE STUDY -6-

Ref AISC 1980 Code  
Section 2.7

" The width - thickness ratio for flange of rolled W, M, or S shapes and similar built-up single-web shapes that would be subjected to compression involving hinge rotation under ultimate loading shall not exceed the following values: "

$F_y, \text{ksi}$	$b_f/2t_f$
36	8.5
42	8.0
45	7.4
50	7.0
55	6.6
60	6.3
65	6.0

" The width - thickness ratio of similarly compressed flange plates in box sections and cover plates shall not exceed  $190/\sqrt{F_y}$  "

Example

$$\frac{b}{t} = \frac{190}{\sqrt{F_y}}$$

$F_y$	$b/t$
36	31.7
50	26.9
75	22
100	19





" The depth - thickness ratio of webs of members subjected to plastic bending shall not exceed .... "

$$d/t = \frac{412}{\sqrt{F_y}} \left( 1 - 1.4 \frac{P}{P_y} \right) \text{ when } \frac{P}{P_y} \leq 0.27$$

For  $\frac{P}{P_y} = 0.0$

$F_y$	$d/t$
36	68.7
50	58.3
75	47.6
100	41.2

$$d/t = \frac{257}{\sqrt{F_y}} \text{ when } \frac{P}{P_y} > 0.27$$

$F_y$	$d/t$
36	42.8
50	36.3
75	30
100	25.7



Ref AISC 1963 Code  
Section 2.6

" Projecting element, that would be subjected to compression involving plastic hinge rotation under ultimate loading shall have width-thickness ratio no greater than the following: "

$$b_f/2t_f \leq 8.5 \quad \text{Rolled Shapes}$$

$$b_f/t_f \leq 32 \quad \text{Box Sections}$$

" The depth-thickness ratio of beam and girder webs subjected to plastic bending " is given by the following formula

$$43 \leq d/w \leq 70 - 100 \frac{P}{P_y}$$

### Remarks

The 1963 Code take into account material for A36 of  $F_y = 36$  KSI or less (note that the two codes are the same for  $F_y = 36$ ).

If the structure was designed using material having higher yield, the design might not be acceptable under present requirements.

$$F_y \leq 36 \text{ KSI} \quad \text{(C)}$$

$$36 < F_y < 38 \text{ KSI} \quad \text{(B)}$$

$$F_y \geq 38 \text{ KSI} \quad \text{(A)}$$



CASE STUDY -7-

Ref AISC 1980 Code  
Section 2.9 Lateral Bracing

" Members shall be adequately braced to resist lateral and torsional displacements ... The laterally unsupported distance,  $l_{cr}$ , ... shall not exceed the value determined from "

$$\frac{l_{cr}}{r_y} = \frac{1375}{F_y} + 25 \quad \text{when } 1.0 > \frac{M}{M_p} > -0.5$$

$$\text{or } \frac{l_{cr}}{r_y} = \frac{1375}{F_y} \quad \text{when } -0.5 \geq \frac{M}{M_p} > -1.0$$

example

$l_{cr}/r_y$	$F_y = 36 \text{ KSI}$	50	75	100
$1 > \frac{M}{M_p} > -0.5$	63.2	52.5	43.3	38.75
$-0.5 \geq \frac{M}{M_p} > -1.0$	38.2	27.5	18.3	13.75



Ref AISC 1963 Code

Section 2.8 Lateral Bracing

When the moment definition is compatible with the 1980 code, the formula for  $l_{cr}/r_y$  becomes:

$$35 < \frac{l_{cr}}{r_y} = 60 + 40 \frac{M}{M_p}$$

example

$\frac{M}{M_p}$	$\frac{l_{cr}}{r_y}$
1	100
0	60
-0.5	40

CONCLUSIONS

The figure which follows ( $l_{cr}/r_y$  vs.  $M/M_p$ ) indicates that for A-36 steel ( $F_y=36$  ksi)

Scale

$$0 < \frac{M}{M_p} < 1 \quad \text{---} \quad \textcircled{A}$$

$$0 > \frac{M}{M_p} > -1 \quad \text{---} \quad \textcircled{C}$$

Note: The summary is based on material with  $F_y=36$ , other material should be examined on a case by case basis.



**Franklin Research Center**  
 A Division of The Franklin Institute  
 The Benjamin Franklin Parkway, Phila., Pa. 19103

Proj.



By  
 M.F.



**Franklin Research Center**  
 A Division of The Franklin Institute  
 The Benjamin Franklin Parkway, Phila., Pa. 19103

Project

By  
 M.D.

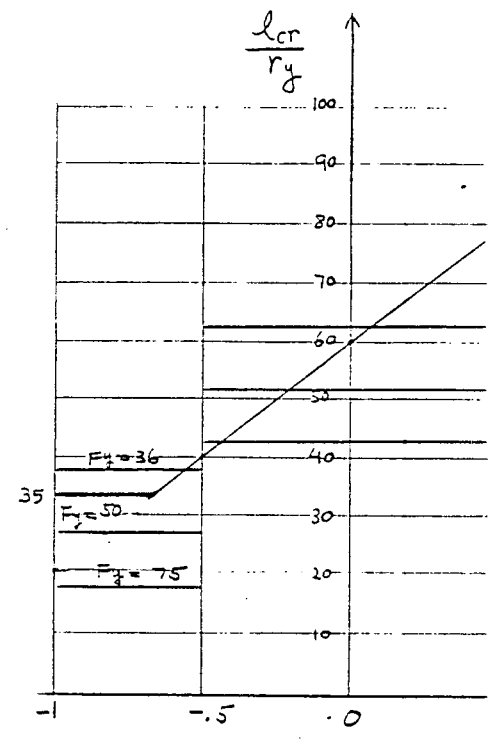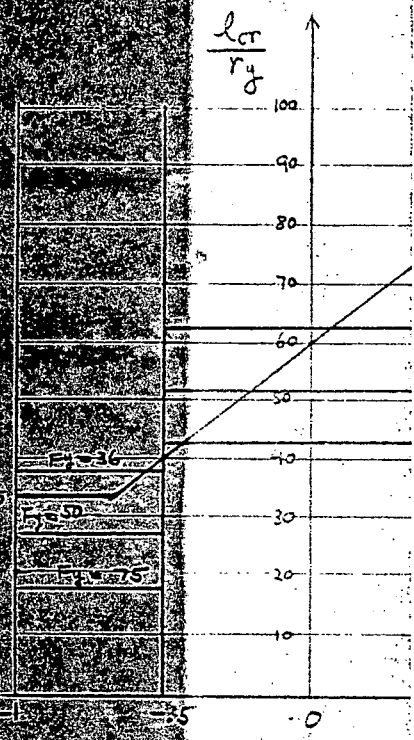



CASE STUDY - 8 -

Comparison of Section 2.3, Columns (AISC, 1963)  
with Section 2.4, Columns (AISC, 1980)

AISC 1963

1. Slenderness ratio for columns in continuous frames where sideway is not prevented, is limited by Formula (20)

$$\frac{2P}{P_y} + \frac{l}{70r} \leq 1.0$$

This limits slenderness Ratio  $\frac{l}{r} \leq 70$  and axial load not to exceed  $0.5 P_y$  for  $\frac{l}{r} = 0$ . Also limited by Formula (26) given below.

2. For columns in braced frames the maximum axial load  $P$  shall not exceed  $0.6 P_y$ .

AISC 1980

1. Slenderness ratio for Columns in continuous frames where Sidesway is not prevented, not limited to only 70. But limited by Formulas (2.9-1a) and (2.9-1b) given below and  $\frac{l}{r}$  not to exceed  $C_c$ , as given below

2. The axial load in columns in braced frames not to exceed  $0.85 P_y$

(See Case Study 4 also, for Slenderness ratio)



3. a) Slenderness ratio  
 $\frac{l}{r}$  not to exceed 120

b) The allowable  
laterally unsupported  
distance

$$l_{cr} = (60 - 40 \frac{M}{M_p}) r_y,$$

Formula (26) But  $l_{cr} \leq 35 r_y$

c)  $\frac{kl}{r_{min}}$  not to exceed  
200 in any case

3a. a Slenderness ratio  
 $\frac{l}{r}$  not to exceed  $C_c$

$$\text{where } C_c = \sqrt{\frac{2\pi^2 E}{F_y}}$$

and for  $F_y = 36 \text{ Ksi},$   
 $C_c = 126.1$

3 b. The laterally unsupported  
distance  $l_{cr}$  not to exceed  
the following

$$\frac{l_{cr}}{r_y} = \frac{1375}{F_y} + 25 \quad (2.9-1a)$$

$$\text{When } +1.0 > \frac{M}{M_p} > -0.5$$

And

$$\frac{l_{cr}}{r_y} = \frac{1375}{F_y} \quad (2.9-1b)$$

$$\text{When } -0.5 \geq \frac{M}{M_p} > -1.0$$

3c.  $\frac{kl}{r_{min}}$  not to exceed 200 in  
any case.



4(a) Interaction formulas for single curvature are

Formula (22)

$$\frac{M}{M_p} \leq B - G \left( \frac{P}{P_y} \right) \leq 1.0$$

$$M \leq M_p$$

and Formula (23)

$$\frac{M}{M_p} \leq 1.0 - H \left( \frac{P}{P_y} \right) - J \left( \frac{P}{P_y} \right)^2$$

Values of B, G, H and J listed in tables as a function of slenderness ratio and  $F_y$

(b) Interaction formulas for double curvature are

Formula (21)

$$M \leq M_p \text{ for } P/P_y \leq 0.15$$

$$\frac{M}{M_p} \leq 1.18 - 1.18 \left( \frac{P}{P_y} \right) \leq 1.0$$

$$\text{for } P/P_y \geq 0.15$$

and Formula (22)

$$\frac{M}{M_p} \leq B - G \left( \frac{P}{P_y} \right) \leq 1.0 ;$$

$$M \leq M_p$$

4. Interaction formulas are

Formula (2.4-2)

$$\frac{P}{P_{cr}} + \frac{C_m M}{\left(1 - \frac{P}{P_e}\right) M_m} \leq 1.0$$

and Formula (2.4-3)

$$\frac{P}{P_y} + \frac{M}{1.18 M_p} \leq 1.0 ; M \leq M_p$$

where  $P_{cr} = 1.7 A F_a$

$$P_e = \frac{23}{12} A F_e$$

$F_a$  given by (1.5-1) and

$F_e$  given in Section 1.6.1

$M_m = M_p$  (braced in the weak direction)

$$= \left[ 1.07 - \frac{(r/r_y) \sqrt{F_y}}{3160} \right] M_p \leq M_p$$

(Unbraced in weak direction)

a) For single curvature

$$0.6 \leq C_m \leq 1.0$$

b) For double curvature

$$0.4 \leq C_m \leq 0.6$$





For comparison of these specifications, graphs of  $P/P_y$  vs  $M/M_p$  are drawn for slenderness ratio of 30, 70 and 100. Typical Column 14W150 with  $F_y = 36$  ksi has been taken as an example for our purposes. Separate graphs are drawn for single curvature ( $0.6 \leq C_m \leq 1.0$ ) and double curvature ( $0.4 \leq C_m \leq 0.6$ ) cases.

For frames with sidesway ( $C_m = 0.85$ ) allowed, graphs of  $P/P_y$  vs  $M/M_p$  are drawn for two types of columns 14W150 and 12W45, with  $F_y = 36$  ksi. Columns assumed to be braced in the weak direction, for all graphs.

It can be inferred from the graphs that in all cases, the major change is the limit of allowable axial load, which is increased from  $0.5 P_y$  to  $0.75 P_y$  for unbraced columns (Sidesway allowed) and  $0.6 P_y$  to  $0.85 P_y$  for braced columns. But the acceptable design region in both codes is almost same. For single curvature we notice for  $\frac{Kl}{r} = 30$  the Formula (2.4-2) line for  $C_m = 1.0$  is below the formula (23) line, but for  $\frac{Kl}{r} = 70$ , they overlap and for  $\frac{Kl}{r} = 100$ , the Formula (2.4-2) for  $C_m = 1.0$  is above the formula (23) line. Thus for  $\frac{Kl}{r} = 30$  1980 code being more conservative, while for  $\frac{Kl}{r} = 100$ , 1963 code seems to be more conservative. This change can thus be classified best as a B change.



$F_y = 36 \text{ ksi}$        $\frac{kl}{r} = 30$      $14 \text{ WF } 150$

SINGLE CURVATURE  
Assume: braced in weak direction  
 $\therefore M_m = M_p$

1963 Code



Formula (22)  $\frac{M}{M_p} \leq B-G(P/P_y) \leq 1.0$   
 $M \leq M_p$

1980 Code

(2.4-2)  $\frac{P}{P_{cr}} + \frac{C_m M}{(1 - \frac{P}{P_e}) M_p} \leq 1.0$   
 $0.6 \leq C_m \leq 1.0$

Formula (23)  $\frac{M}{M_p} \leq 1.0 - H(P/P_y) - J(P/P_y)^2$     (2.4-3)  $\frac{P}{P_y} + \frac{M}{1.18 M_p} \leq 1.0, M \leq M_p$

TYPICAL EXAMPLES

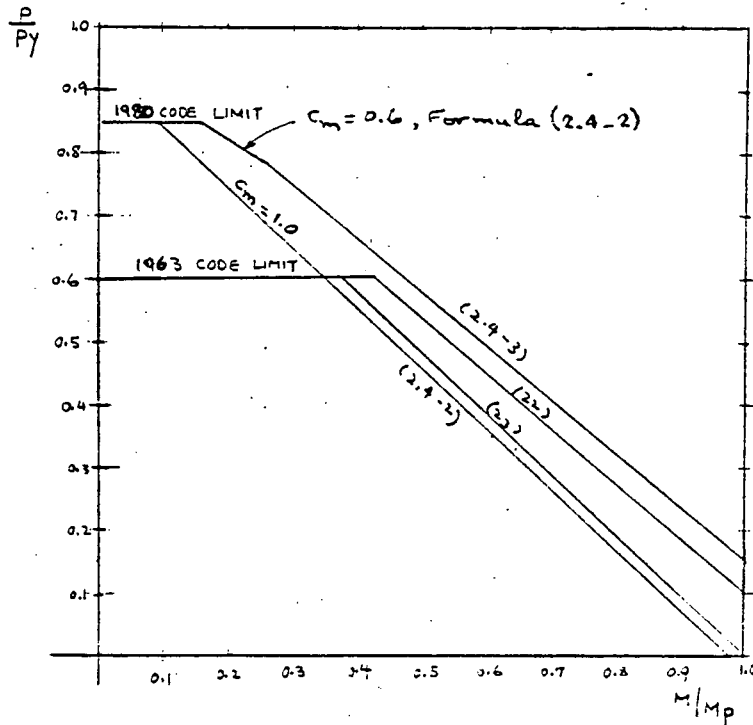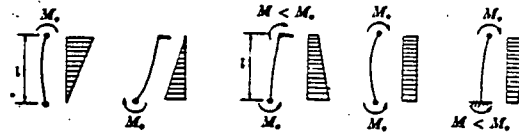



Project		C5257		Page		C.8-6	
By	RA	Date	SEPT '81	Ch'k'd	SMJ	Date	1-21-81
Rev.		Date		Rev.		Date	

$F_y = 36 \text{ ksi}$        $\frac{kl}{r} = 30 \cdot 14 \cdot 150$

DOUBLE CURVATURE  
Assume braced in weak direction  
 $\therefore M_m = M_p$

1963 Code

1980 Code

Formula (21)  $M = M_p$  when  $P/P_y \leq 0.15$

$\frac{M}{M_p} \leq 1.18 - 1.18(P/P_y) \leq 1.0$



(2.4-2)  $\frac{P}{P_{cr}} + \frac{C_m M}{(1 - \frac{P}{P_e}) M_p} \leq 1.0$

$0.4 \leq C_m \leq 0.6$

Formula (22)  $\frac{M}{M_p} \leq B - G(P/P_y) \leq 1.0$   
 $M \leq M_p$

(2.4-3)  $\frac{P}{P_y} + \frac{M}{1.18 M_p} \leq 1.0, M \leq M_p$

TYPICAL EXAMPLES

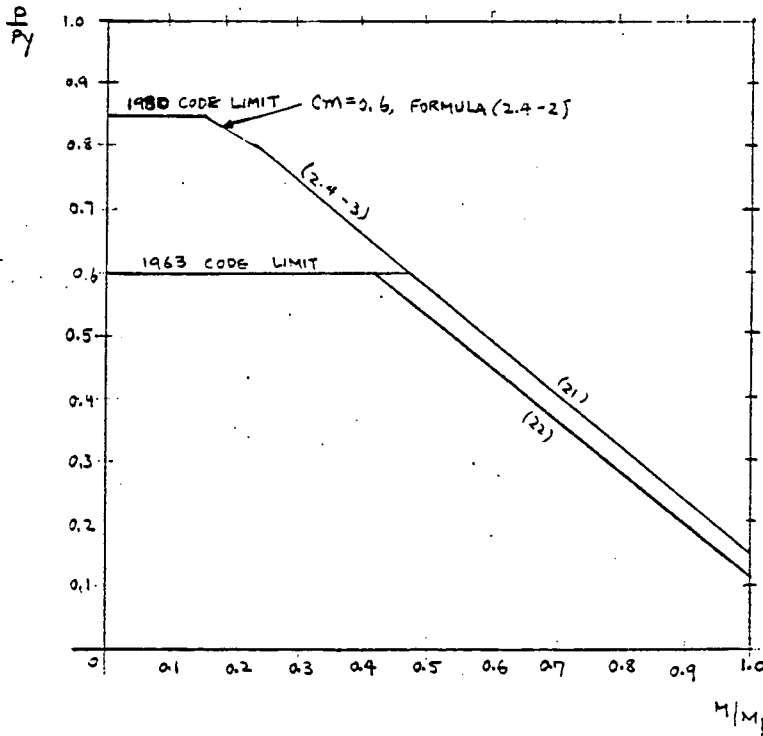



$F_y = 36 \text{ ksi}$        $\frac{kl}{r} = 70 \text{ } 14 \text{ } 150$

SINGLE CURVATURE  
Assume braced in weak direction  
 $\therefore M_m = M_p$

1963 Code

Formula (22)  $\frac{M}{P} \leq B-G(P/P_y) \leq 1.0$   
 $M \leq M_p$



1980 Code

(2.4-2)  $\frac{P}{P_{cr}} + \frac{C_m M}{(1 - \frac{P}{P_e}) M_p} \leq 1.0$   
 $0.6 \leq C_m \leq 1.0$

Formula (23)  $\frac{M}{M_p} \leq 1.0 - H(P/P_y) - J(P/P_y)^2$

(2.4-3)  $\frac{P}{P_y} + \frac{M}{1.18 M_p} \leq 1.0, M \leq M_p$

TYPICAL EXAMPLES

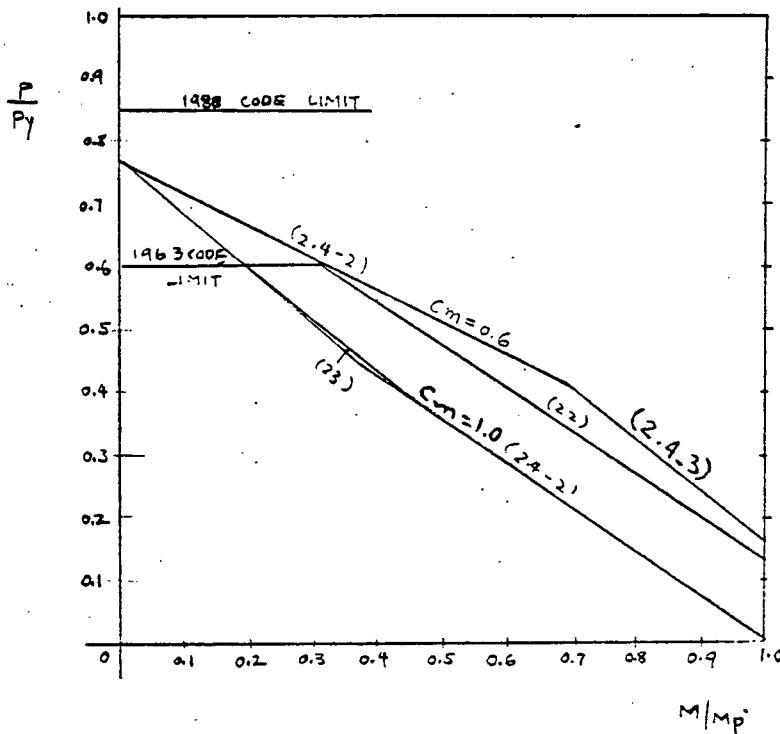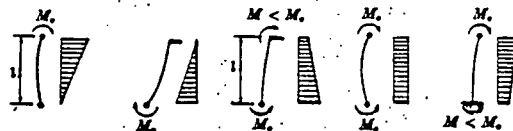



$F_y = 36 \text{ ksi}$        $\frac{kl}{r} = 70$  14 WF 150

DOUBLE CURVATURE

Assume braced in weak direction  
 $\therefore M_m = M_p$

1963 Code

1980 Code

Formula (21)  $M = M_p$  when  $P/P_y \leq 0.15$

(2.4-2)  $\frac{P}{P_{cr}} + \frac{C_m M}{(1 - \frac{P}{P_e}) M_p} \leq 1.0$        $0.4 \leq C_m \leq 0.6$



$\frac{M}{M_p} \leq 1.18 - 1.18(P/P_y) \leq 1.0$

(2.4-3)  $\frac{P}{P_y} + \frac{M}{1.18 M_p} \leq 1.0, M \leq M_p$

Formula (22)  $\frac{M}{M_p} \leq B - G(P/P_y) \leq 1.0$

$M \leq M_p$

TYPICAL EXAMPLES

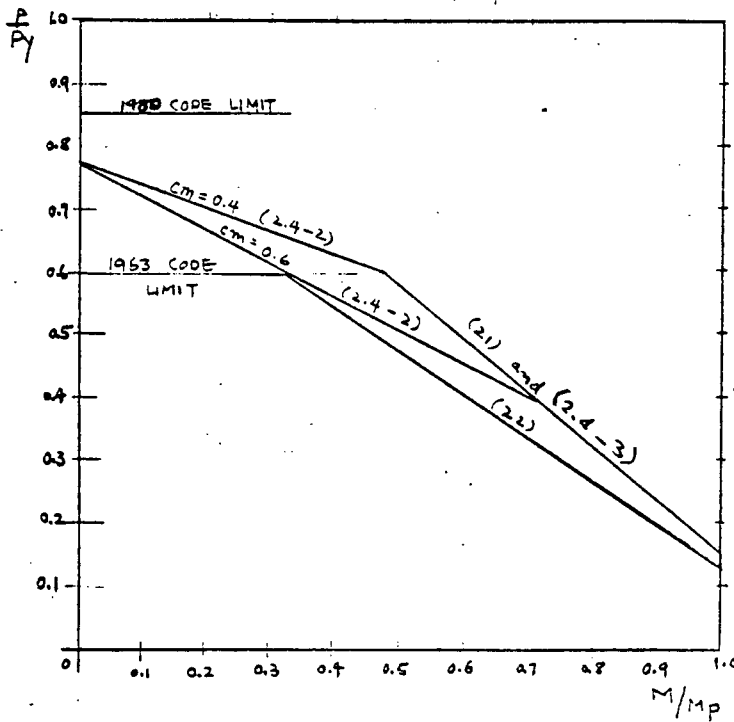



$F_y = 36 \text{ ksi}$

$\frac{kl}{r} = 100 \text{ 14 WF 150}$

SINGLE CURVATURE

Assume braced in weak direction

$\therefore M_m = M_p$

1963 Code

1980 Code



Formula (22)  $\frac{M}{M_p} \leq B - G(P/P_y) \leq 1.0$   
 $M \leq M_p$

(2.4-2)  $\frac{P}{P_{cr}} + \frac{C_m M}{(1 - \frac{P}{P_e}) M_p} \leq 1.0$   $0.6 \leq C_m \leq 1.0$

Formula (23)  $\frac{M}{M_p} \leq 1.0 - H(P/P_y) - J(P/P_y)^2$

(2.4-3)  $\frac{P}{P_y} + \frac{M}{1.18 M_p} \leq 1.0, M \leq M_p$

TYPICAL EXAMPLES

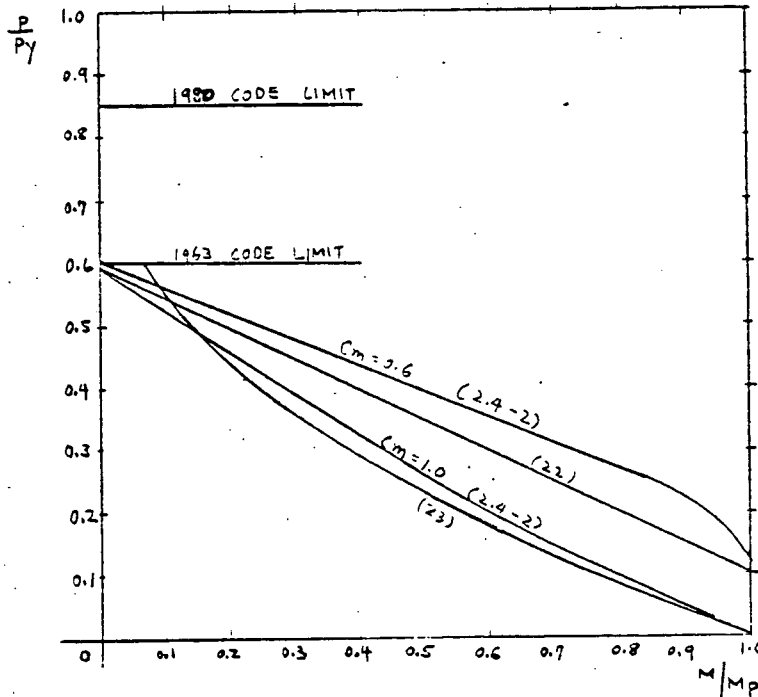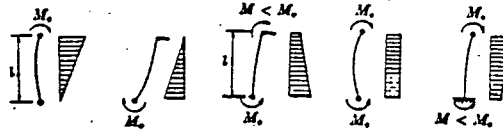



$F_y = 36 \text{ ksi}$        $\frac{kl}{r} = 100 \text{ } 14 \text{ W } 150$

DOUBLE CURVATURE  
Assume braced in weak direction  
 $\therefore M_m = M_p$

1963 Code

Formula (21)  $M = M_p$  when  $P/P_y \leq 0.15$

$\frac{M}{M_p} \leq 1.18 - 1.18(P/P_y) \leq 1.0$



Formula (22)  $\frac{M}{M_p} \leq B-G(P/P_y) \leq 1.0$   
 $M \leq M_p$

1980 Code

(2.4-2)  $\frac{P}{P_{cr}} + \frac{C_m M}{(1 - \frac{P}{P_e}) M_p} \leq 1.0$        $0.4 \leq C_m \leq 0.6$

(2.4-3)  $\frac{P}{P_y} + \frac{M}{1.18 M_p} \leq 1.0, M \leq M_p$

TYPICAL EXAMPLES

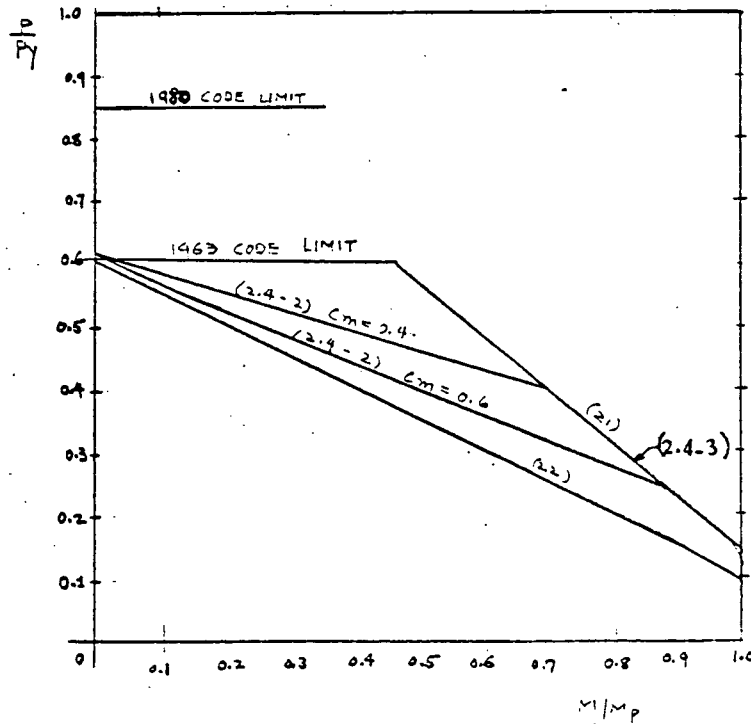



$F_y = 36 \text{ ksi}$        $\frac{kl}{r} = 30$  12 W<sup>45</sup>

SIDESWAY ALLOWED

Assume braced in weak direction

$\therefore M_m = M_p$

1963 Code

1980 Code

Formula (21)  $M = M_p$  when  $P/P_y \leq 0.15$

$\frac{M}{M_p} \leq 1.18 - 1.18(P/P_y) \leq 1.0$

(2.4-2)  $\frac{P}{P_{cr}} + \frac{C_m M}{(1 - \frac{P}{P_e}) M_p} \leq 1.0$



$C_m = 0.85$

Formula (22)  $\frac{M}{M_p} \leq B-G(P/P_y) \leq 1.0$   
 $M \leq M_p$

(2.4-3)  $\frac{P}{P_y} + \frac{M}{1.18 M_p} \leq 1.0, M \leq M_p$

Formula (23)  $\frac{M}{M_p} \leq 1.0 - H(P/P_y) - J(P/P_y)^2$

TYPICAL EXAMPLES

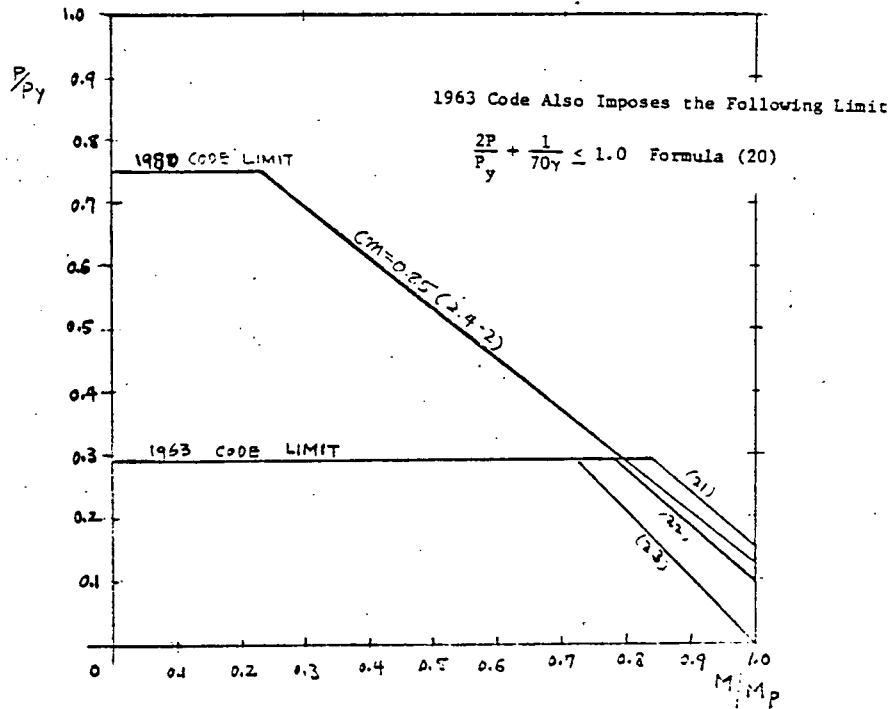





Project		C5257		Page C.8-12	
By	Date	Ch'k'd	Date	Rev.	Date
RA	SEPT '81	EMM	12/81		

$F_y = 36 \text{ ksi}$        $\frac{kl}{r} = 30 \quad 14 \text{ vs } 150$

SIDESWAY ALLOWED  
Assume braced in weak direction  
 $\therefore M_m = M_p$

1963 Code

1980 Code

Formula (21)  $M = M_p$  when  $P/P_y \leq 0.15$

$\frac{M}{M_p} \leq 1.18 - 1.18(P/P_y) \leq 1.0$

(2.4-2)  $\frac{P}{P_{cr}} + \frac{C_m M}{(1 - \frac{P}{P_e}) M_p} \leq 1.0$

$C_m = 0.85$



Formula (22)  $\frac{M}{M_p} \leq 3 - G(P/P_y) \leq 1.0$

$M \leq M_p$

(2.4-3)  $\frac{P}{P_y} + \frac{M}{1.18 M_p} \leq 1.0, M \leq M_p$

Formula (23)  $\frac{M}{M_p} \leq 1.0 - H(P/P_y) - J(P/P_y)^2$

TYPICAL EXAMPLES

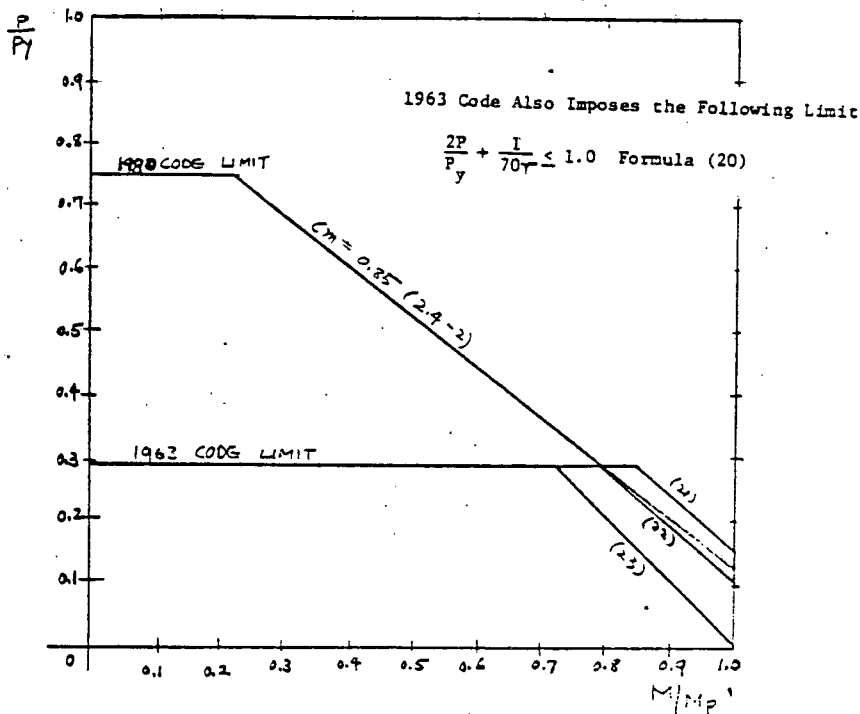



CASE STUDY -9-

Comparison of AISC-1980 Section 1.10.6 with AISC-1963 Section 1.10.6, Reduction in Flange Stress, HYbrid Girders only.

The only change between the two codes is the introduction of Formula (1.10-6) for case of hybrid girder, in the 1980 code. Formula (1.10-5) of 1980 Code with  $F_b$  in ksi is identical to Formula (12) of 1963 with  $F_b$  in Psi. Hybrid girder designed in 1963 would be designed in accordance with Formula (12) which is identical to (1.10-5) in 1980 code. But a hybrid girder designed in accordance with 1980 has to conform to both Formulas (1.10-5) and (1.10-6). For  $F_b = 25$  ksi and 50 ksi, we draw graphs of reduction factor  $\left(\frac{F_b}{F_b}\right)$  vs. Area of web to Area of Flange ratio  $\left(\frac{A_w}{A_f}\right)$ , using Formulas (1.10-5) and (1.10-6) for given  $\alpha = 0.3, 0.6, \text{ and } 0.9$  and for given  $h/t$  ratios (162, 172 & 182, for  $F_b = 25$  ksi and 117, 127 & 137 for  $F_b = 50$  ksi). We find in all six cases depending on  $A_w/A_f$  ratio for  $\alpha = 0.45$ , Formula (1.10-6) in the 1980 code is quite conservative.



But for  $0.45 < \alpha \leq 0.75$ , Formula (1.10-6) or Formula (1.10-5) could be conservative as compared to each other depending on  $h/t$  ratio for given  $F_b$ . But for  $\alpha > 0.75$ , in any case, Formula (1.10-5) is more conservative. Thus we can make the following judgment on them.

OLD Formulas

a) Formula (12), 1963 Code

$$F_b' \leq F_b \left[ 1.0 - 0.0005 \frac{A_w}{A_f} \left( \frac{h}{t} - \frac{24000}{\sqrt{F_b}} \right) \right]$$

with  $F_b$  in Psi.

b) Formula (1.10-5) 1980 code

$$F_b' \leq F_b \left[ 1.0 - 0.0005 \frac{A_w}{A_f} \left( \frac{h}{t} - \frac{760}{\sqrt{F_b}} \right) \right],$$

with  $F_b$  in Ksi

New Formula

Formula (1.10-6) 1980 code

$$F_b' \leq F_b \left[ \frac{12 + \left( \frac{A_w}{A_f} \right) (3\alpha - \alpha^3)}{12 + 2 \left( \frac{A_w}{A_f} \right)} \right]$$

$\alpha$	Scale
$\leq 0.45$ and low $\frac{A_w}{A_f}$ ratio	A
0.45 to 0.75	B
$\geq 0.75$	C



**Franklin Research Center**  
 A Division of The Franklin Institute  
 The Benjamin Franklin Parkway, Phila., Pa. 19103

Project

C5257

Page

C.9-3

By

RA

Date

OCT '81

Ch'k'd

CMW


Date

11/81

Rev.

Date

AISC 1.10.6 1963/1980 CODE COMPARISON

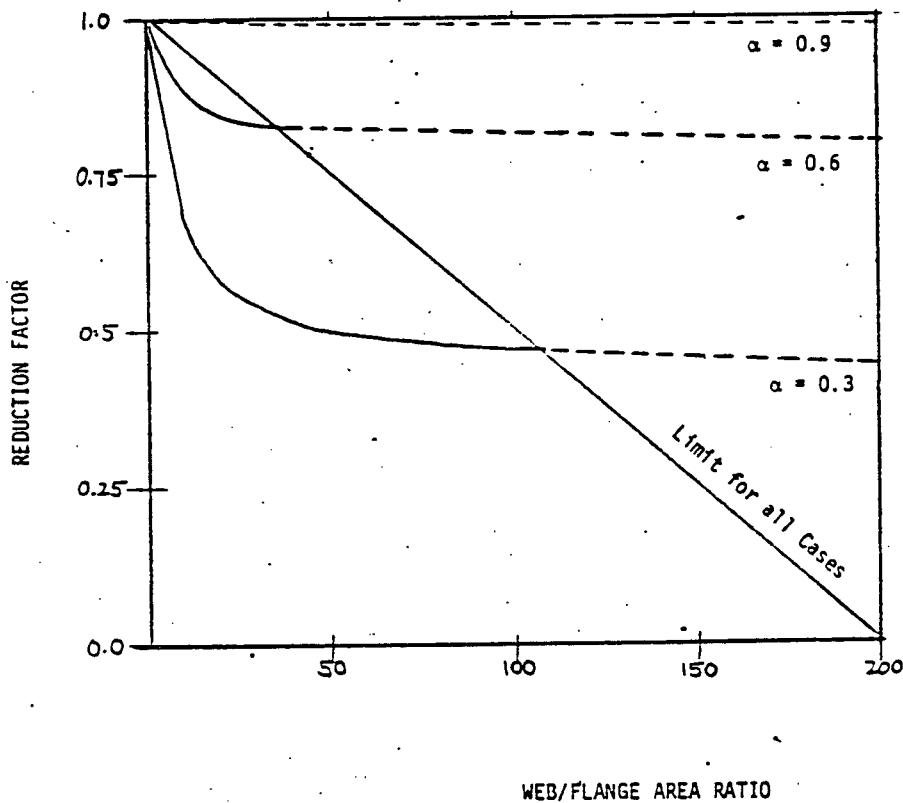

BENDING STRESS = 25KSI ALPHA=0.3, 0.6, 0.9, H/T RATIO = 162



Franklin Research Center  
A Division of The Franklin Institute  
The Benjamin Franklin Parkway, Phila., Pa. 19103

Project

C5257

Page

C.9-4

By

RA

Date

OCT '81

Ch'k'd

3/11/81


Date

11/81

Rev.

Date

AISC 1.10.6 1963/1980 CODE COMPARISON

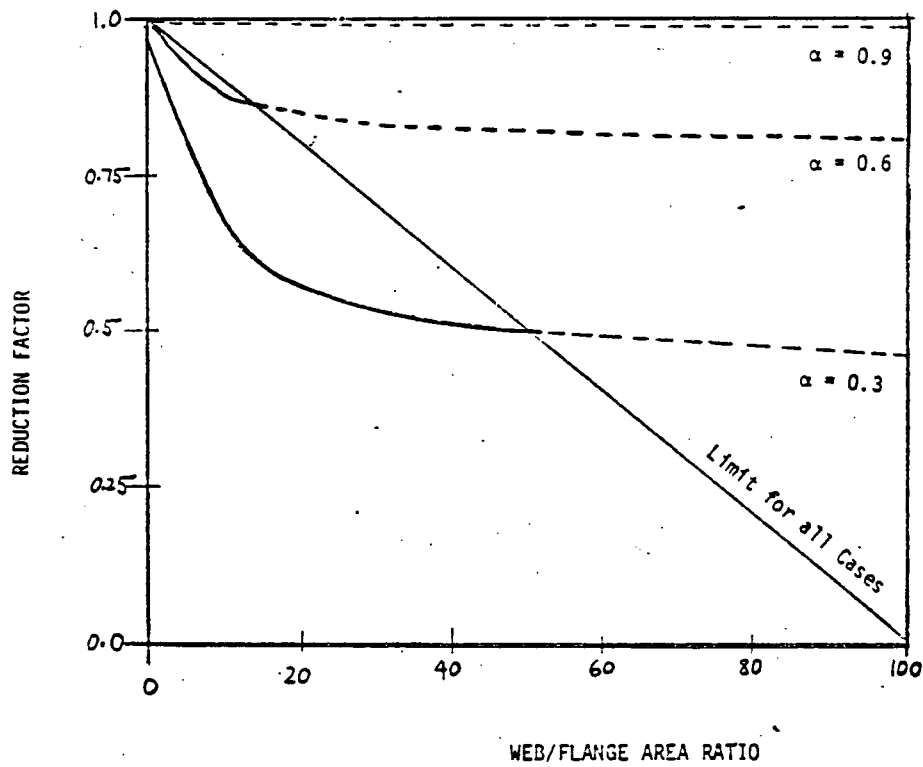


BENDING STRESS = 25KSI ALPHA=0.3, 0.6, 0.9, H/T RATIO = 172



**Franklin Research Center**  
 A Division of The Franklin Institute  
 The Benjamin Franklin Parkway, Phila., Pa. 19103

Project		C5257		Page C.9-5	
By	Date	Ch'k'd	Date	Rev.	Date
RA	OCT '81	EMU	11/81		

**AISC 1.10.6 1963/1980 CODE COMPARISON**

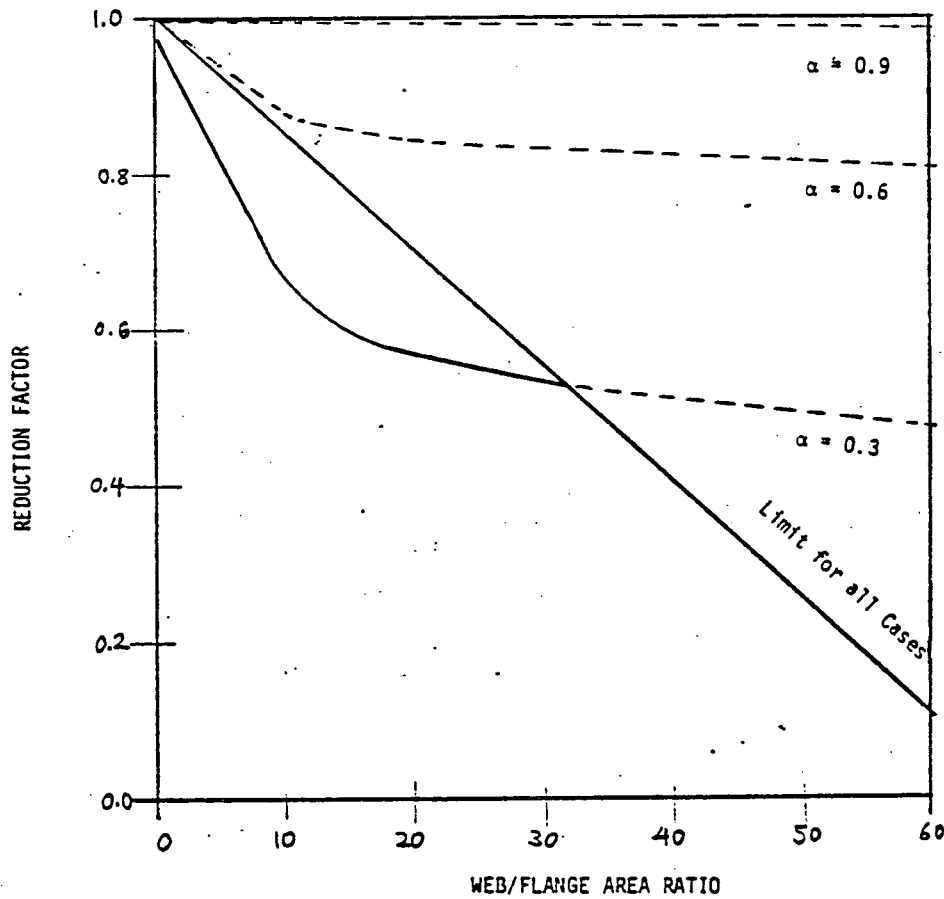


BENDING STRESS = 25KSI      ALPHA=0.3, 0.6, 0.9, H/T RATIO = 182



**Franklin Research Center**  
 A Division of The Franklin Institute  
 The Benjamin Franklin Parkway, Phila., Pa. 19103

Project		C5257		Page C.9-6	
By	Date	Ch'k'd	Date	Rev.	Date
RA	OCT '81	<i>[Signature]</i>	11/21		

AISC 1.10.6 1963/1980 CODE COMPARISON

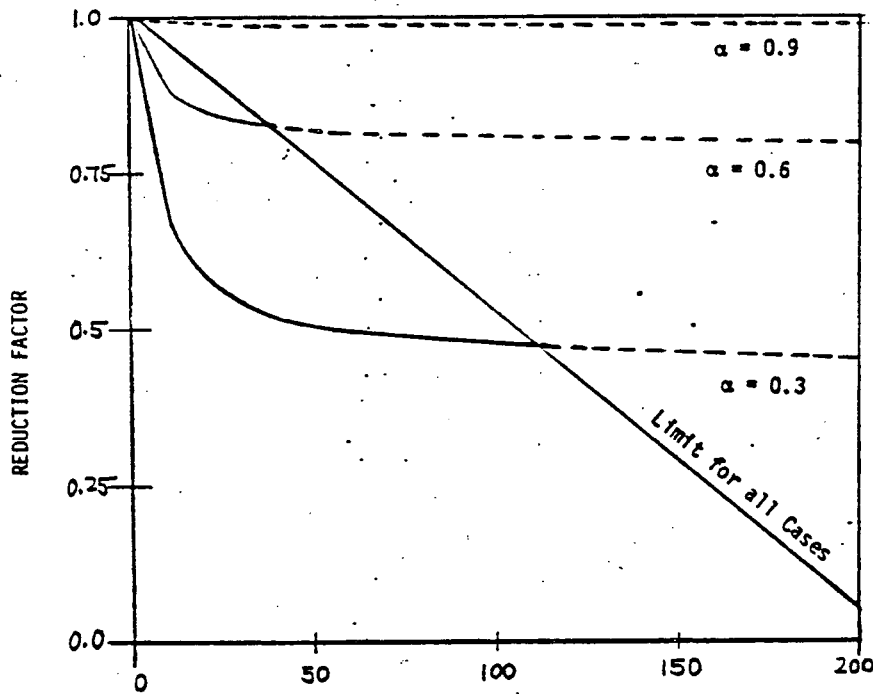

WEB/FLANGE AREA RATIO  
 BENDING STRESS = 50KSI ALPHA=0.3, 0.6, 0.9, H/T RATIO = 117



**Franklin Research Center**  
 A Division of The Franklin Institute  
 The Benjamin Franklin Parkway, Phila., Pa. 19103

Project

C5257

Page C.9-7

By

RA

Date

OCT '81

Ch'k'd

E.M.W.


Date

11/81

Rev.

Date

**AISC 1.10.6 1963/1980 CODE COMPARISON**

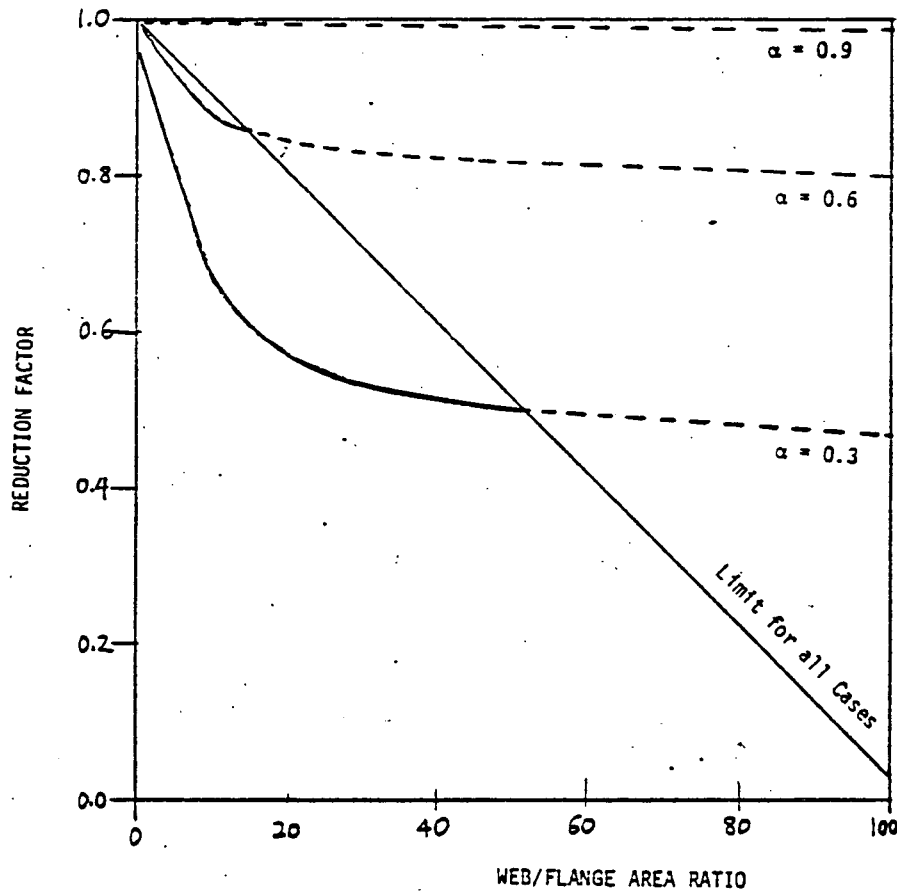

BENDING STRESS = 50KSI ALPHA=0.3, 0.6, 0.9, H/T RATIO = 127






**Franklin Research Center**  
 A Division of The Franklin Institute  
 The Benjamin Franklin Parkway, Phila., Pa. 19103

Project	C5257		Page	C.9-8	
By	RA	Date	Ch'k'd	Date	Rev. Date
		OCT '81	EMD	11/71	

**AISC 1.10.6 1963/1980 CODE COMPARISON**

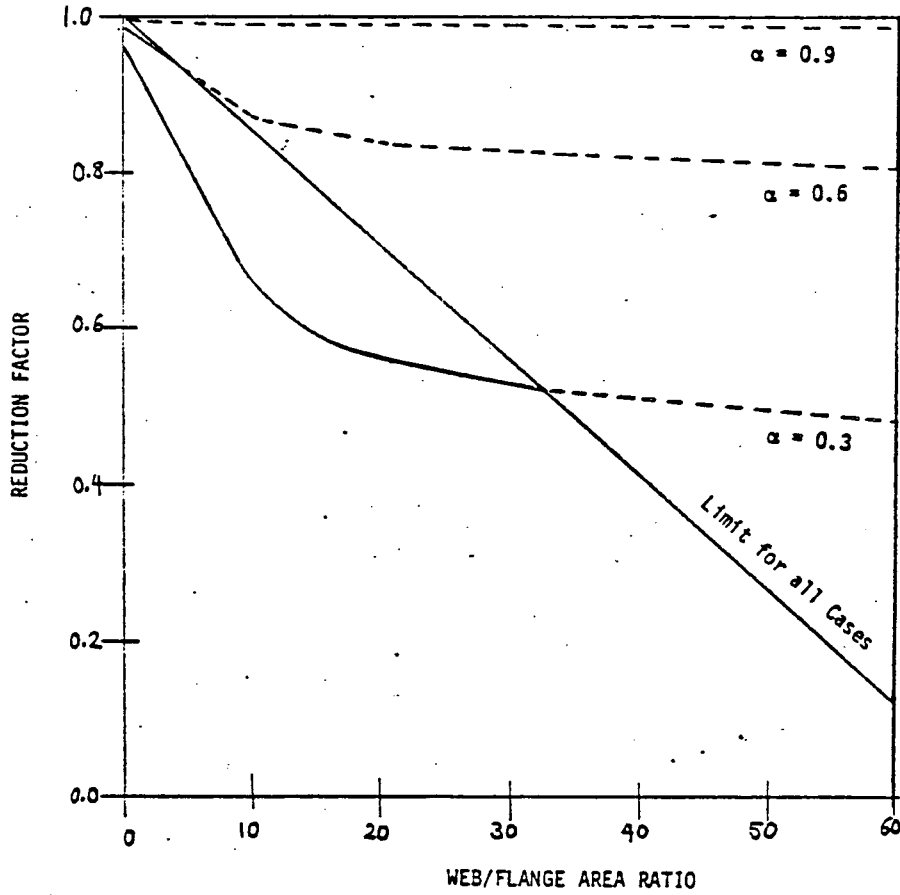

BENDING STRESS = 50KSI ALPHA=0.3, 0.6, 0.9, H/T RATIO = 137



Project		C5257		Page C.10-1	
By	Date	Ch'k'd	Date	Rev.	Date
RA	SEPT '81	EMD	10/81		

CASE STUDY - 10 -

Comparison of Section (1.9.1.2) and Appendix C (AISC 1980) with Section 1.9.1 (AISC, 1963); width-thickness ratio of unstiffened elements Subject to axial compression and compression due to bending.

In both sections the limit of width-thickness ratio is given for the following various cases.

CASE I: single-angle struts; double-angle struts with separators

CASE II: Struts comprising double angles in contact; angles or plates projecting from girders, columns, or other compression members; compression flanges of beams; stiffeners on plate girders

CASE III: Stems of tees

In AISC, 1980, according to the specifications for the above cases, when compression members exceed the allowable width-thickness ratio, the allowable stresses are reduced by a factor based on formulas given in appendix C which depends on yield stress ( $F_y$ ) and the width-thickness ratio.



But according to AISC, 1963 Specifications, when compression members exceed the allowable width - thickness ratio, the member is acceptable if it satisfies the allowable stress requirements with a portion of width i.e. effective width meets stress requirements.

For the case study, two values of  $F_y$  36 ksi and 50 ksi are chosen. For the two values for typical angle section and T sections given in AISC Manual graphs have been plotted for Reduction Factor vs Width - thickness ratio.

Reduction Factor for AISC, 1980 Code is based on formulas given in appendix C' and for AISC, 1963, reduction factor is the ratio of effective width to actual width of the section.

Based on the graphs, the change for case I and Case II at higher width/thickness ratio would be a C change, as Specifications were more conservative in 1963 code. But for Case III the change in Specification is A change as it is more conservative in 1980 Code, at higher width - thickness ratio.



Franklin Research Center  
A Division of The Franklin Institute  
The Benjamin Franklin Parkway, Phila., Pa. 19103

Project

C5257

Page C.10-3

By  
RA

Date

SEPT '81

Ch'k'd

E.M.D.


Date

10/21

Rev.

Date

FY=36KSI ANGLES SEPARATED

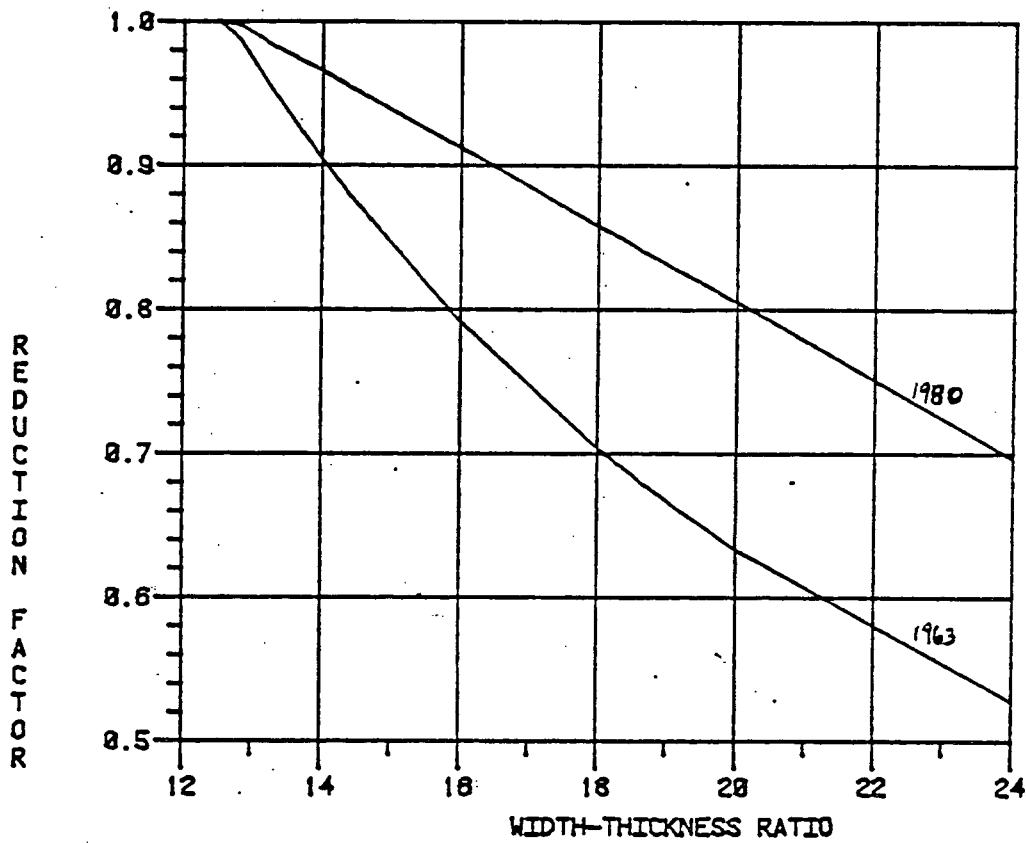



Franklin Research Center  
A Division of The Franklin Institute  
The Benjamin Franklin Parkway, Phila., Pa. 19103

Project

C5257

Page C.10-4


By  
RA

Date  
SEPT '81

Ch'k'd  
E.D. 10/81

Rev. Date

FY=50KSI ANGLES SEPARATED

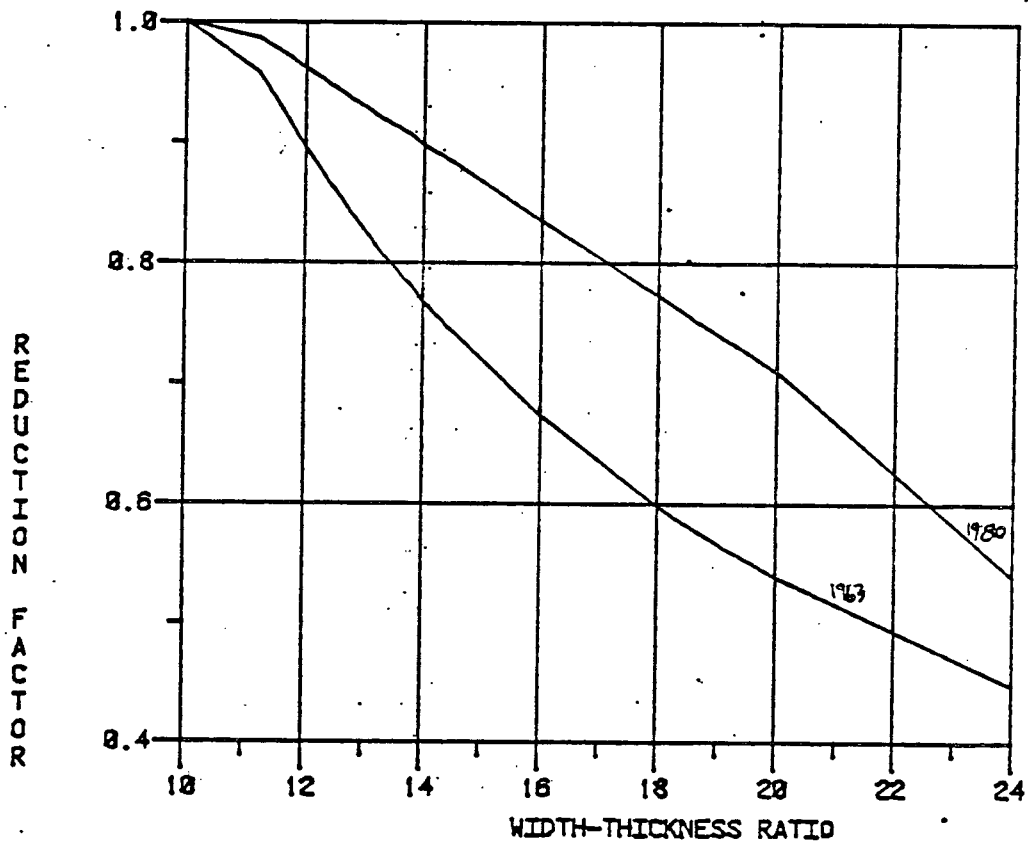



Franklin Research Center  
A Division of The Franklin Institute  
The Benjamin Franklin Parkway, Phila., Pa. 19103

Project

C5257

Page

C.10-5

By

RA

Date

SEPT '61

Ch'k'd

E.M.W.


Date

10/21

Rev.

Date

FY=36KSI ANGLES IN CONTACT

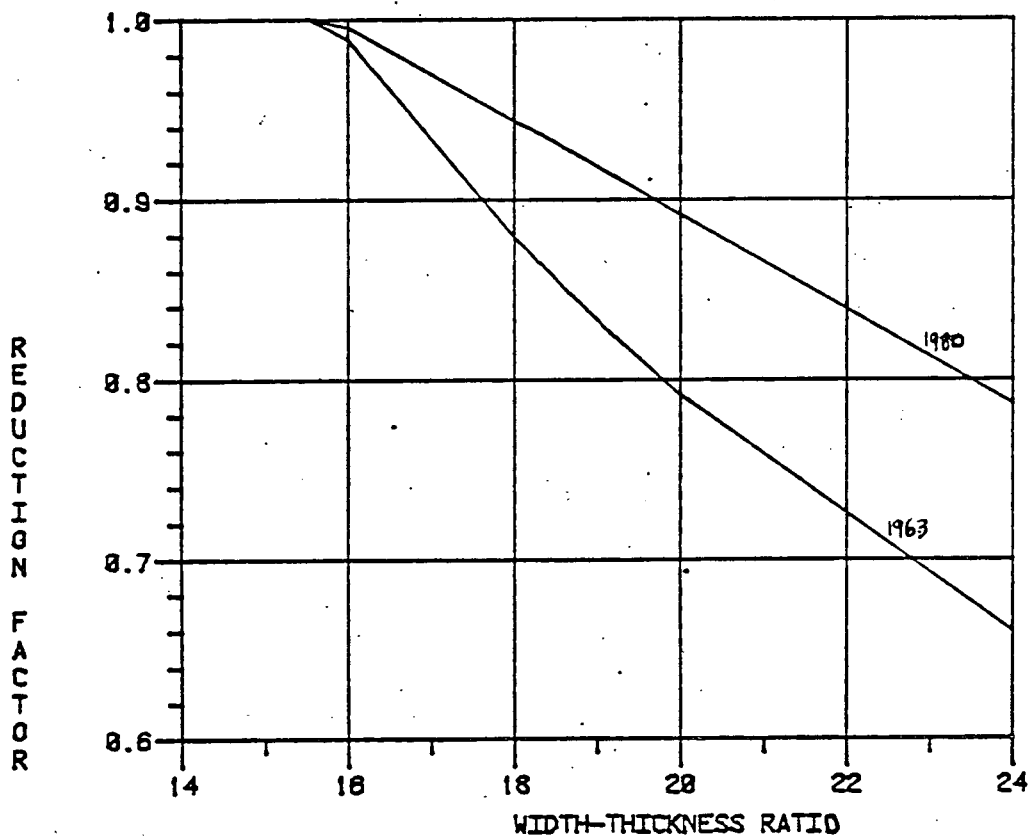



**Franklin Research Center**  
 A Division of The Franklin Institute  
 The Benjamin Franklin Parkway, Phila., Pa. 19103

Project

C5257

Page C.10-6

By  
RA

Date

SEPT '81

Ch'k'd

SMW


Date

12/81

Rev.

Date

FY=50KSI ANGLES IN CONTACT

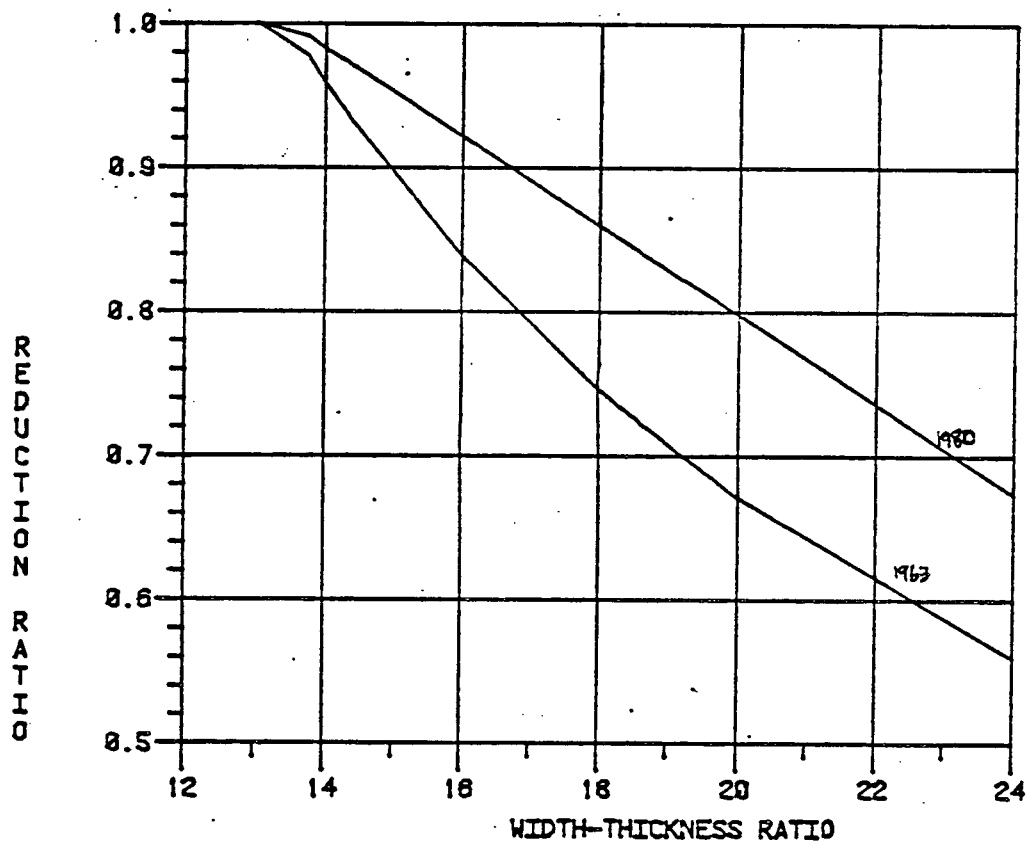



Franklin Research Center  
A Division of The Franklin Institute  
The Benjamin Franklin Parkway, Phila., Pa. 19103

Project

C5257

Page

C.10-7

By

RA

Date

SEPT '81

Ch'k'd

E. Mill


Date

12/81

Rev.

Date

FY=36KSI T SHAPES

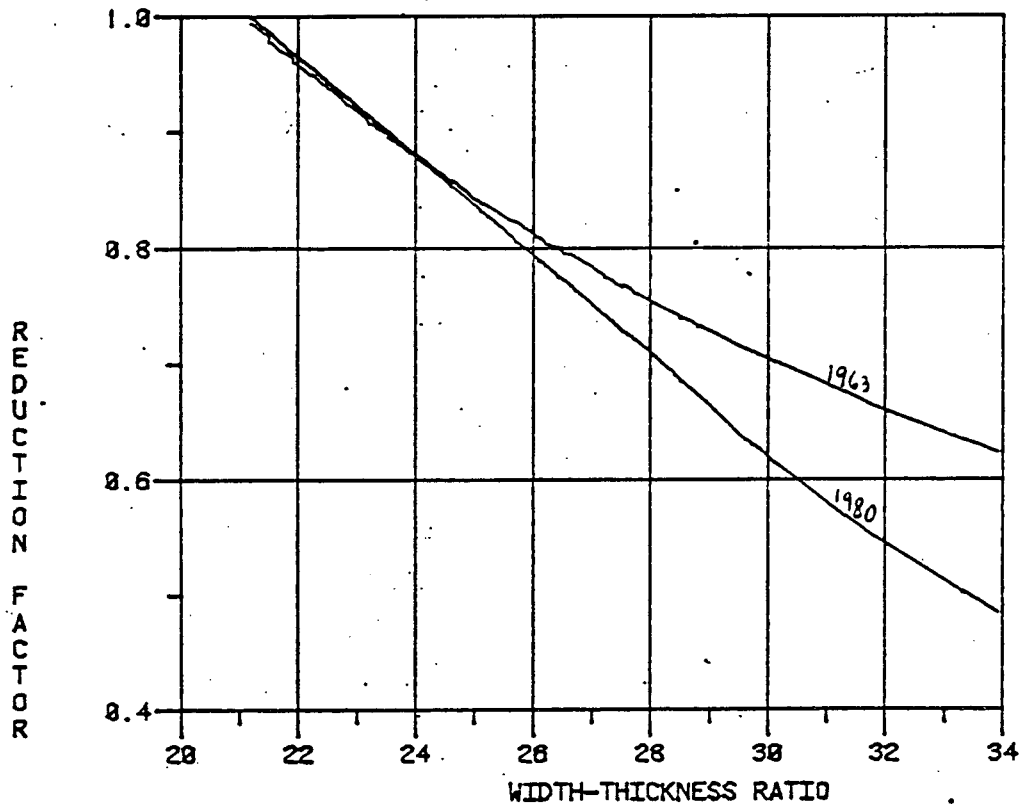






Franklin Research Center  
A Division of The Franklin Institute  
The Benjamin Franklin Parkway, Phila., Pa. 19103

Project		C5257		Page C.10-8	
By	Date	Ch'k'd	Date	Rev.	Date
RA	SEPT 81	EMM	10/81		

FY=50KSI T SHAPES

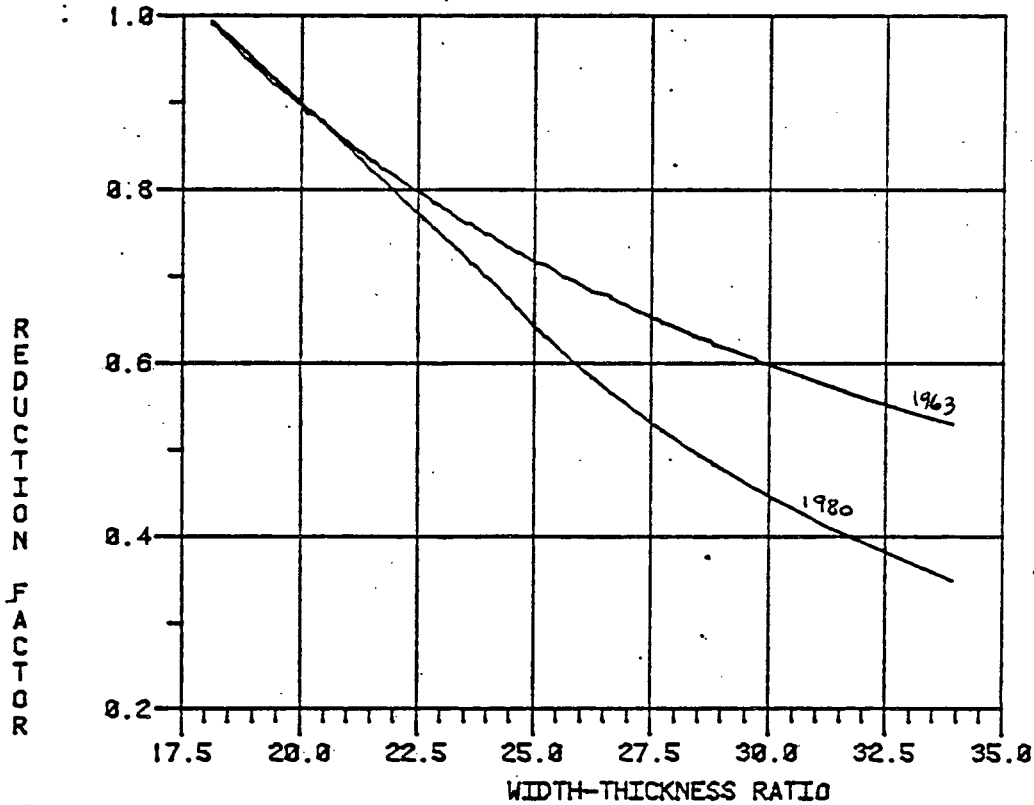



CASE STUDY - 11 -

Comparison of AISC 1980 Section 1.11.4 with  
AISC 1963 Section 1.11.4; Shear connectors for  
Composite beams, where longitudinal reinforcing steel  
acts with beam.

According to AISC 1980, Formula (1.11-5)

$$V_h = A_{sr} F_{yr} / 2 \quad (1.11-5)$$

is given for continuous composite beam where  
longitudinal reinforcing steel is considered to  
act compositely with the steel beam in the negative  
moment regions, to calculate the total horizontal  
shear to be resisted by shear connectors between  
an interior support and each adjacent point  
of contraflexure.

Whereas in AISC 1963 specifications,  
the total horizontal shear to be resisted between  
the point of maximum positive moment and  
each end or a point of contraflexure in  
continuous beams is given as the smaller  
value of Formula (18) and (19)

$$V_h = 0.85 \frac{f'_c A_c}{2} \quad (18)$$

and 
$$V_h = \frac{A_s F_y}{2} \quad (19)$$



There is no separate formula for negative moment region in AISC, 1963. The above formulas are the same in AISC, 1980; Formula (1.11-3) and (1.11-4) for the positive moment region. Moreover in AISC, 1963, there is no consideration of reinforcing steel in concrete acting compositely with the steel beam in negative moment regions.

This implies that in computing the section modulus at the points of negative bending, reinforcement parallel to the steel beam, and lying within the effective width of slab may be included according to AISC, 1980. But it is not allowed to include reinforcing steel in computing the section modulus for the above case as per the specifications of AISC, 1963. Thus design criteria is being liberalized in AISC 1980. Since the quantification of this liberal criteria is unknown, this change can best be classified as C. Any composite beam designed as per AISC 1963 specifications will show more moment capacity when calculated according to AISC, 1980 Specifications.



CASE STUDY -12-

The allowable peripheral Shear Stress (punching Shear Stress) as stated in the B & PV ASME Code Section III Div. 2, 1980 (ACI 359-80) Para. CC-3421.6 is limited to  $V_c$  where  $V_c$  shall be calculated as the weighted average of  $V_{ch}$  and  $V_{cm}$

$$V_{ch} = 4\sqrt{f'_c} \sqrt{1 + (f_m/4\sqrt{f'_c})}$$

$$V_{cm} = 4\sqrt{f'_c} \sqrt{1 + (f_h/4\sqrt{f'_c})}$$

The ACI 318-63 Code Section 1707 states that the ultimate Shear Strength  $V_u$  shall not exceed  $V_c = 4\sqrt{f'_c}$ .

Comparing the above two cases the following is concluded:

When:

- |   | <u>Scale</u> |
|---|--------------|
| 1. Membrane stresses are compressive<br>318-63 is more conservative | (C)          |
| 2. Membrane stresses are tensile<br>318-63 is less conservative     | (A)          |



Franklin Research Center  
A Division of The Franklin Institute  
The Benjamin Franklin Parkway, Phila., Pa. 19103

Project		C5257		Page		C.12-2	
By	Date	Ch'k'd	Date	Rev.	Date		
<i>E.M.W.</i>	10/81	RK/MD	10/81				

Scale

3. Membrane stresses are zero  
318-63 is identical No rating
4. Membrane stresses are opposite  
in sign  
318-63 could be less conservative (A)



CASE STUDY -13-

The B & PV ASME Code Section III Division 2, 1980 (ACI 359-80) Para. CC-3421.7 states that the shear stress taken by the concrete resulting from pure torsion shall not exceed  $V_{ct}$  where

$$V_{ct} = 6\sqrt{f'_c} \sqrt{1 + \frac{f_h + f_m}{6\sqrt{f'_c}} + \frac{f_m f_h}{(6\sqrt{f'_c})^2}}$$

While the ACI 318-63 Code Section 1707 limits the ultimate Shear Strength  $V_u$  to

$$V_c = 4\sqrt{f'_c}$$

From the above two cases the following is concluded;

When :

- |                                      |              |
|--------------------------------------|--------------|
|                                      | <u>Scale</u> |
| 1. Membrane stresses are compressive |              |
| 318-63 is more conservative          | (C)          |
| 2. Membrane stresses are tensile     |              |
| 318-63 is less conservative          | (A)          |



Franklin Research Center  
A Division of The Franklin Institute  
The Benjamin Franklin Parkway, Phila., Pa. 19103

Project

C5257

Page

C.13-2

By

E.M.W

Date

10/21

Ch'k'd

RK/MD

Date

10/31

Rev.

Date

Scale

3. Membrane stresses are zero  
318-63 is more conservative (C)
4. Membrane stresses are opposite in sign  
318-63 could be less conservative (A)



Franklin Research Center  
A Division of The Franklin Institute  
The Benjamin Franklin Parkway, Phila., Pa. 19103

Project C5257				Page C.14-1	
By C.M.W.	Date 4/82	Ch'k'd TCS	Date 4/82	Rev.	Date

CASE STUDY -14-

Section 1301(c) - Allowable bond stresses - working stress design.

Allowable bond stresses for working stress design in the 318-63 code were newly described as functions of both the square root of concrete compressive strength and reinforcing bar diameter. The 318-56 code defined allowable bond stress as a linear function of concrete compressive strength only.

Plots for three commonly used concrete compressive strengths showing bond stress allowed by each code for deformed bars conforming to ASTM-A-305 plotted against bar diameter show that for small diameter bars the old code is more conservative and for large diameter bars the new code is more conservative. For bars No. 10, 11, 14 and 18 the new code is considerably more conservative.

Based on the plots shown, a reasonable interpretation of the code changes as regards scale rating is that for deformed bars conforming to ASTM-A-305:

1. For reinforcing bars with diameter less than or equal to 0.875 in. (No. 7 bar) - Scale C
2. For reinforcing bars with diameter greater than 0.875 in. (No. 7 bar) - Scale A
3. For deformed bars conforming to ASTM-A-408 for all diameters - Scale A






Franklin Research Center  
A Division of The Franklin Institute  
The Benjamin Franklin Parkway, Phila., Pa. 19103

Project	C5257		Page	C.14-2	
By	Date	Ch'k'd	Date	Rev.	Date
MLP	APRIL '82	C.M.W.	4/82		

— TOP BARS  
- - - OTHERS

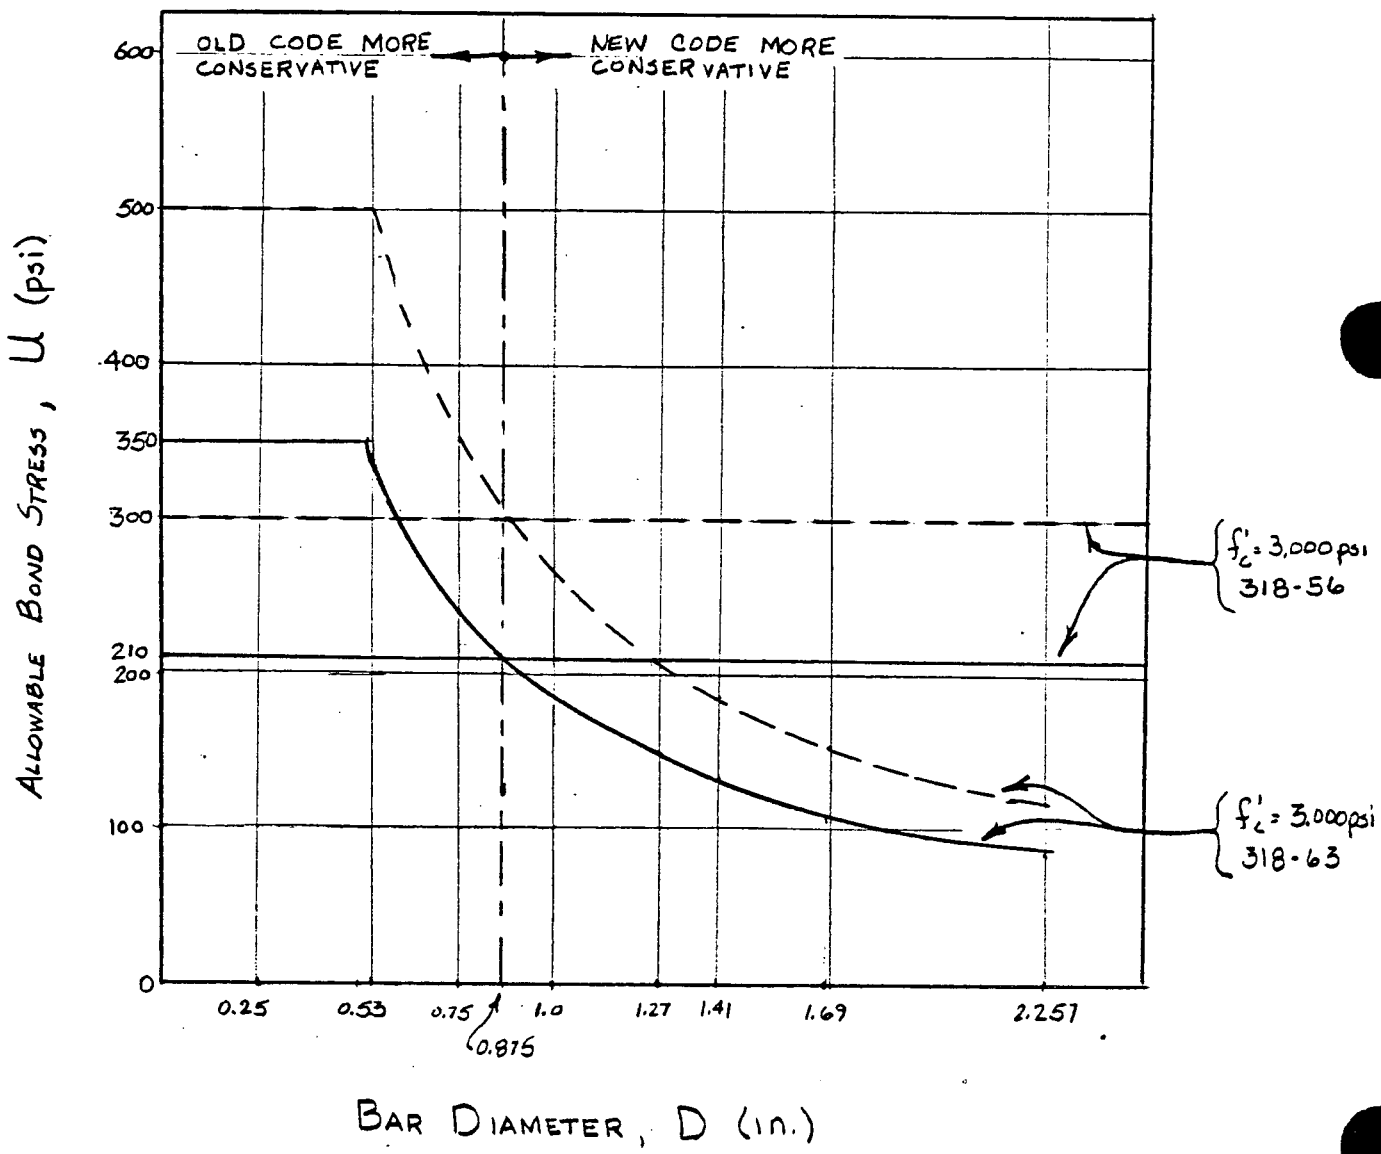



**Franklin Research Center**  
 A Division of The Franklin Institute  
 The Benjamin Franklin Parkway, Phila., Pa. 19103

Project

C5257

Page C.14-3

By MLP

Date APRIL '82

Ch'k'd


Date

EMJ 7/82

Rev.

Date

— TOP BARS  
 - - - OTHERS

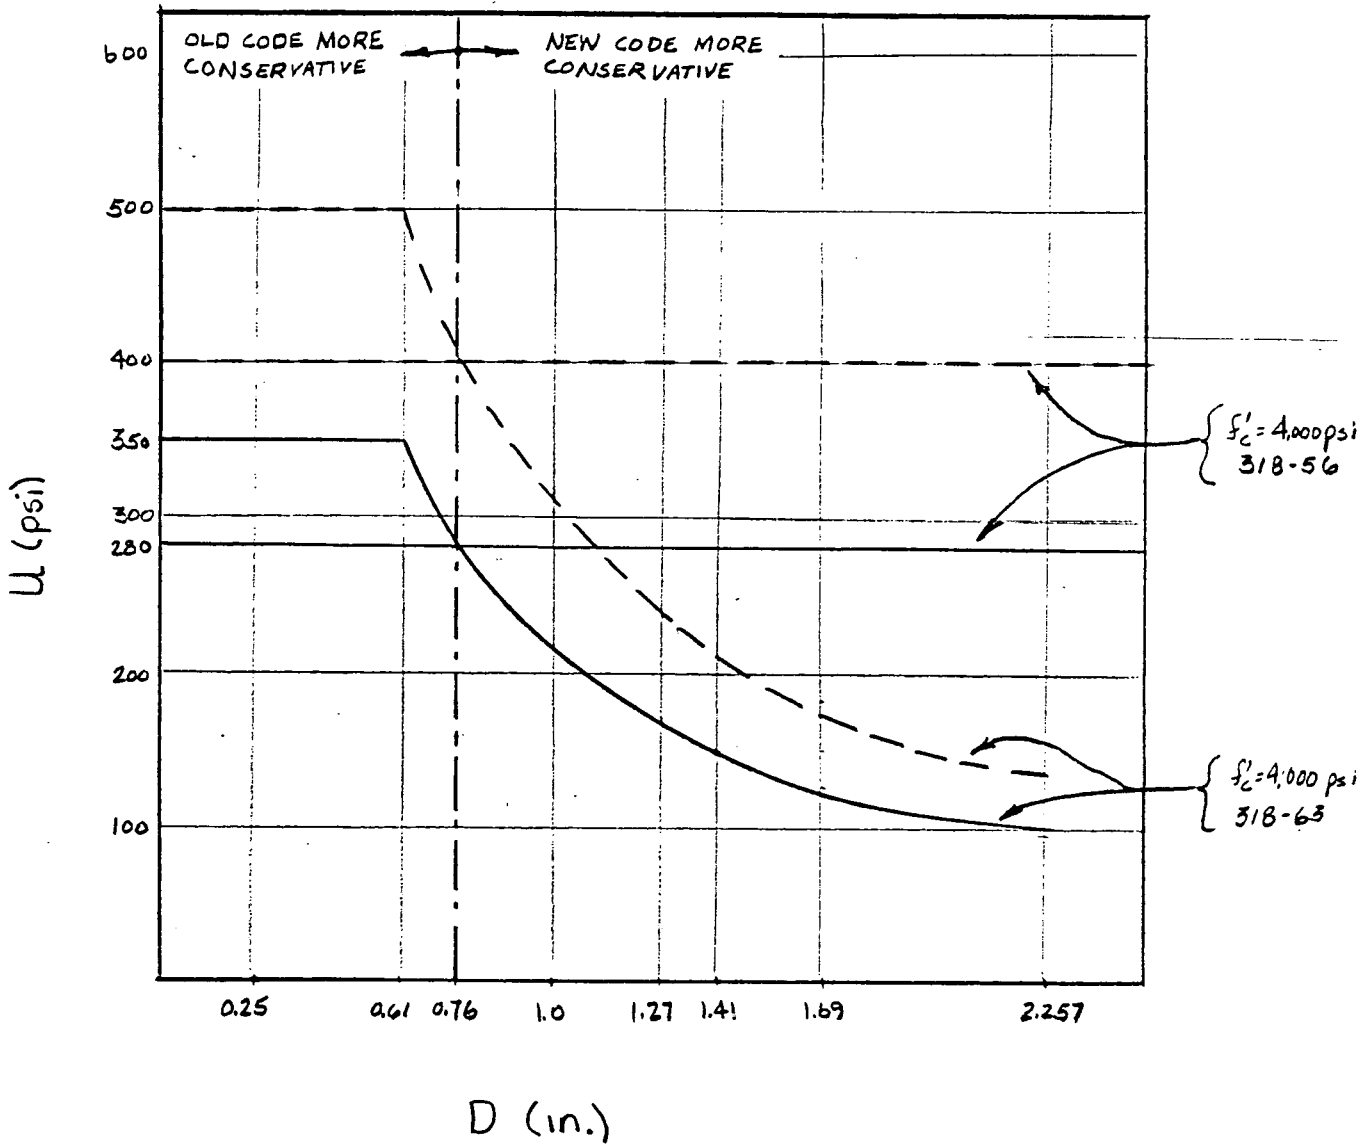



**Franklin Research Center**  
 A Division of The Franklin Institute  
 The Benjamin Franklin Parkway, Phila., Pa. 19103

Project C5257

Page C.14-4


By MLP

Date APRIL '82

Ch'k'd Date EMD 4/22

Rev. Date

— TOP BARS  
 - - - OTHERS

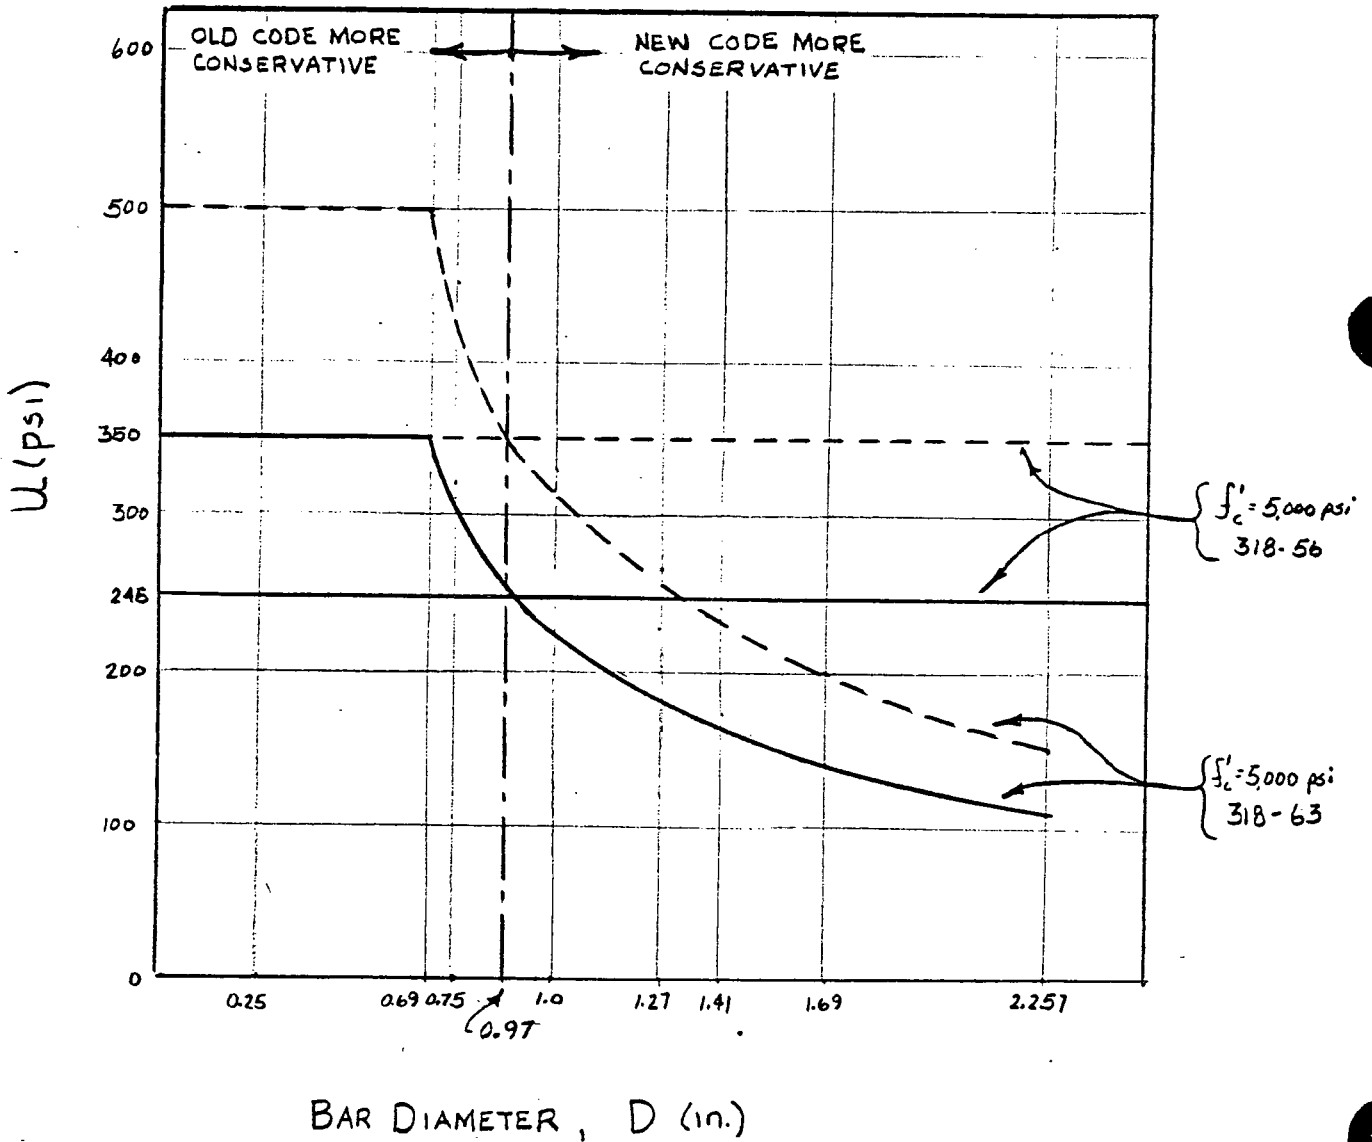



Franklin Research Center  
A Division of The Franklin Institute  
The Benjamin Franklin Parkway, Phila., Pa. 19103

Project

C5257

Page C.15-1

By

C.M.W.

Date

4/82

Ch'k'd

NLP

Date

4/82

Rev.


Date

CASE STUDY - 15-

Ⓐ Subsection 1.5.1.3, 1963 code & 1<sup>st</sup> para. section 15(a)(2), 1953 code.

ALLOWABLE COMPRESSION ON MAIN MEMBERS

AISC 1963 (NEW) & 1953 (OLD)

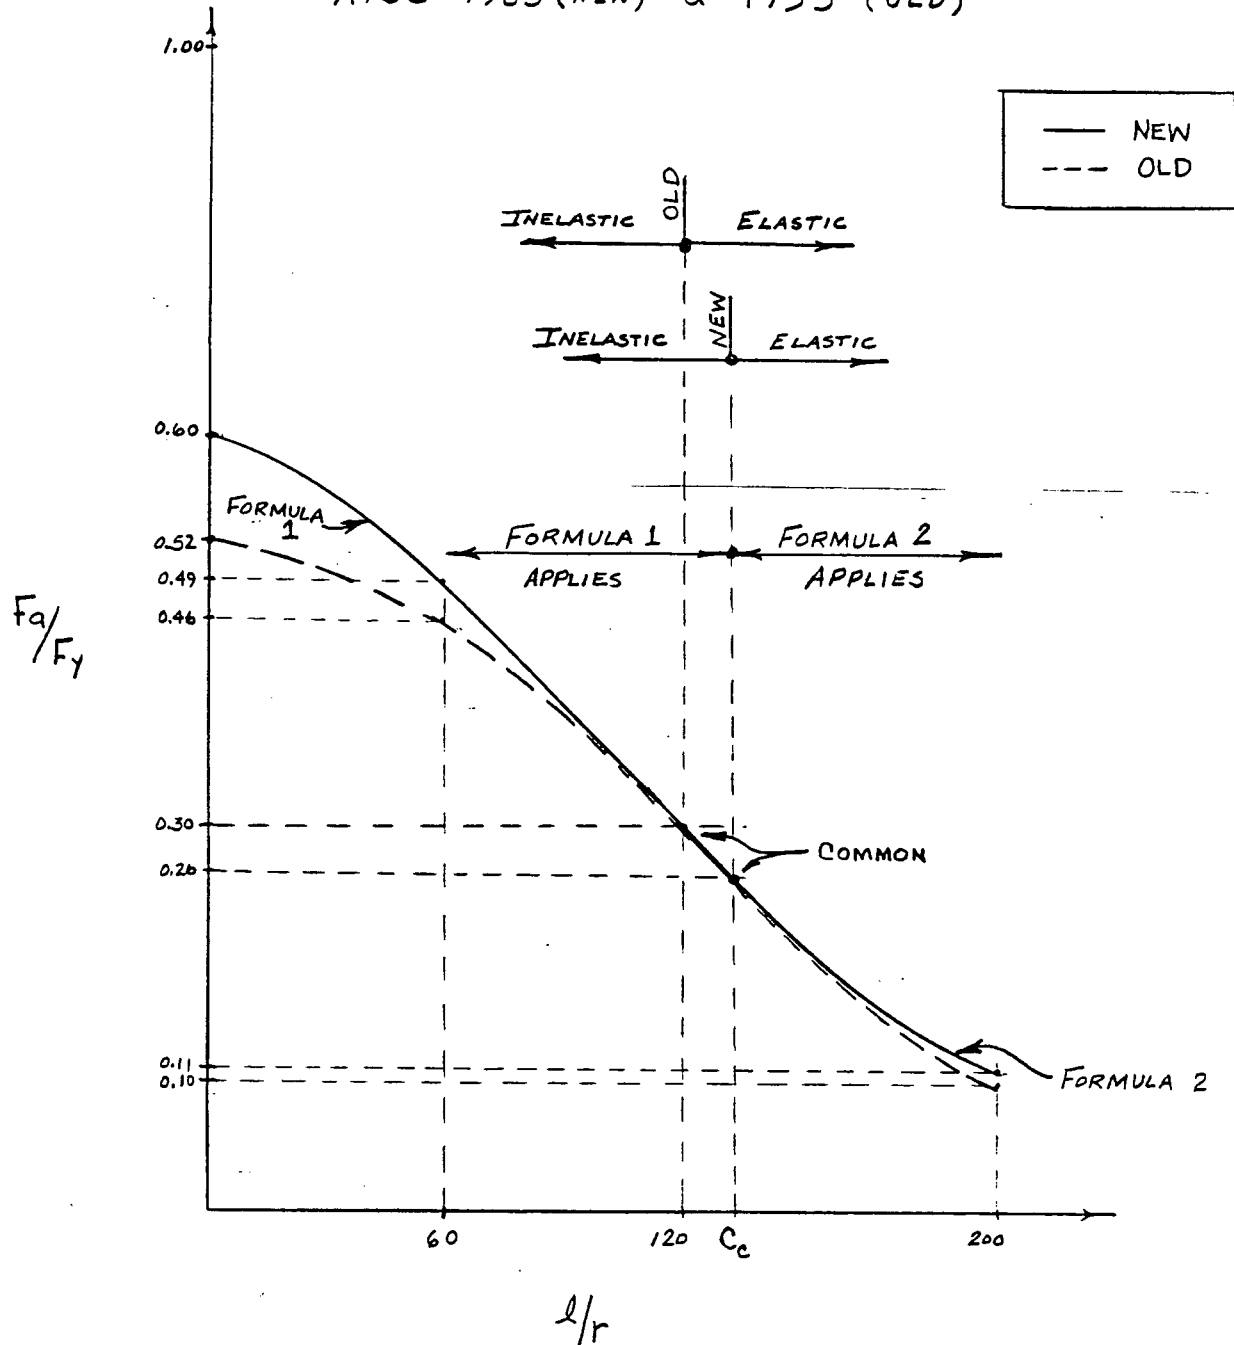

SCALE RATING C



Franklin Research Center  
A Division of The Franklin Institute  
The Benjamin Franklin Parkway, Phila., Pa. 19103

Project		C5257		Page C.15-2	
By	Date	Ch'k'd	Date	Rev.	Date
<i>E. M.W.</i>	<i>4/82</i>	<i>MLP</i>	<i>4/82</i>		

- ③ Subsection 1.5.1.3.3, 1963 code & 2<sup>ND</sup> paragraph section 15(a)(2), 1953 code.

For axially loaded bracing and secondary members when  $l/r$  exceeds 120 both the new (Formula 3) and old allowable stress equations are shifted vertically up on the above type plot by the same function

- ∴ new allowables remain above the old
- ∴ Scale Rating C

APPENDIX D

ACI CODE PHILOSOPHIES



**Franklin Research Center**

A Division of The Franklin Institute

The Benjamin Franklin Parkway, Phila., Pa. 19103 (215) 448-1000

## ACI CODE PHILOSOPHIES

The American Concrete Institute (ACI) Building Code Requirements for Reinforced Concrete delineate two philosophies of design which have long been in use: the so-called working stress method, which was in general acceptance and predominant use from early in this century to the early 1960's, and the ultimate strength method, which has been rapidly replacing working stress since about 1963.

### Working Stress Method

The working stress method of design is referred to as the "alternate design method" by the most recent ACI code. By this method, the designer proportions structural elements so that internal stresses, which result from the action of service loads\* and are computed by the principles of elastic mechanics, do not exceed allowable stress values prescribed by the code.

The allowable stresses as prescribed by the ACI code are set such that the stresses under service load conditions will be within the elastic range of behavior for the materials involved. As a result of this, the assumption of straight line stress-strain behavior applies reasonably for properly designed structural members. The member forces used in design by this method are those which result from an elastic analysis of the structure under the action of the service loads.

### Ultimate Strength Design

The ultimate strength method is referred to as the "strength method" in the most recent ACI code. By this method, the proportioning of the members is based on the total theoretical strength of the member, satisfying equilibrium and compatibility of stress and strain, at failure. This theoretical strength is modified by capacity reduction factors which attempt to assess the variations to be encountered in material, construction tolerances, and calculation approximation.

---

\*Service loads are defined as those loads which are assumed to occur during the service life of the structure.

### Strength Reduction Factor

In the present code, the capacity reduction factor ( $\phi$ ) varies for the type of member and is considered to account for the relative seriousness of the member failure as regards the overall integrity of the structure.

### Load Factors

Also, by this method, the designer increases the service loads by applying appropriate load factors to obtain the ultimate design loads in an attempt to assess the possibility that the service loads may be exceeded in the life of the structure. The member forces used to proportion members by this method are based on an elastic analysis of the structure under the action of the ultimate design loads.

### Importance of Ductility

A critical factor involved in the logic of ultimate strength design is the need to control the mode of failure. The present ACI code, where possible, has incorporated a philosophy of achieving ductility in reinforced concrete designs. Ductility in a structural member is the ability to maintain load carrying capacity while significant, large deformations occur. Ductility in members is a desired quality in structures. It permits significant redistribution of internal loads allowing the structure to readjust its load resistance pattern as critical sections or members approach their limiting capacity. This deformation results in cracking and deflections which provide a means of warning in advance of catastrophic collapse. Under conditions of loading where energy must be absorbed by the structure, member ductility becomes very important.

This concern for preserving ductility appears in the present code in many ways and has guided the changes in code requirements over the recent decades. Where research results have confirmed analysis and intuition, the code has provided for limiting steel percentages, reinforcing details, and controls--all directed at guaranteeing ductility. In those aspects of design where ductility cannot be achieved or insured, the code has required added strength to insure potential failure at the more ductile sections of structures.



Examples of this are evident in the more conservative capacity reduction factors for columns and in the special provisions required for seismic design.

### Strength and Serviceability in Design

There are many reasons for the recent trend in reinforced concrete codes toward ultimate strength rather than working stress concepts. Research in reinforced concrete has indicated that the strain distributions predicted by working stress computations in general do not exist in the members under load. There are many reasons for this lack of agreement. Concrete is a brittle, non-linear material in its stress-strain behavior, exhibiting a down trend beyond its ultimate stress and characterized by a tensile stress-strain curve which in all its features is approximately on the order of one tenth smaller than its compressive stress-strain curve.

Time-dependent shrinkage and creep strains are often of significant magnitude at service load levels and are difficult to assess by working stress methods. While ultimate strength methods do not eliminate these factors, they become less significant at ultimate load levels. In addition, ultimate strength methods allow for more reasonable approximations to the non-linear concrete stress-strain behavior.

In the analyses of structures, the designer must, by necessity, make certain assumptions which serve to idealize the structures. The primary assumptions are that the structure behaves in a linearly elastic manner, and that the idealized member stiffness is constant throughout each member and constant in time.

Working stress logic does not lend itself well to accounting for variations in stiffness caused by cracking and variations in material properties with time. Although the ultimate strength method in the present code requires an elastic structural analysis to determine member forces for design, it recognizes these limitations and, in concept, anticipates the redistribution resulting from ductile deformation at the most critically stressed sections and in fact proportions members so that redistribution will occur.

In addition to strength, a design must satisfy serviceability requirements. In some designs, serviceability factors (such as excessive deflection, cracking, or vibration at service load) may prove to be more important than strength. Computations of the various serviceability factors are generally at service load levels; therefore, the present code uses elastic concepts in its controls of serviceability.

### Factors of Safety

Factors of safety\* are subjects of serious concern in this review. For working stress, the definition of the factor of safety is often considered to be the ratio of yield stress to service load stress. This definition becomes suspect or even incorrect where nonlinear response is involved. For ultimate strength, one definition of factors of safety is the ratio of the load that would cause collapse to the service or working load. As presented in the present code, a factor of safety is included for a variety of reasons, each of which is important but has no direct interrelation with the other.

The present ACI code has divided the provisions for safety into two factors; the overload factors and the capacity reduction factors (considered separately by the code) are both provisions to insure adequate safety but for distinctly different reasons. The code provisions imply that the total theoretical strength to be designed for is the ratio of the overload factor (U) over the capacity reduction factor ( $\phi$ ). The present ACI code has assigned values to the above factors such that the ratio  $U/\phi$  ranges from about 1.5 to 2.4 for reinforced concrete structural elements.

---

\*Factors of safety (FS) are related to margins of safety (MS) through the relation  $MS = FS - 1$ .