Comanche Peak Nuclear Power Plant, Units 3 & 4 COL Application Part 3 - Environmental Report

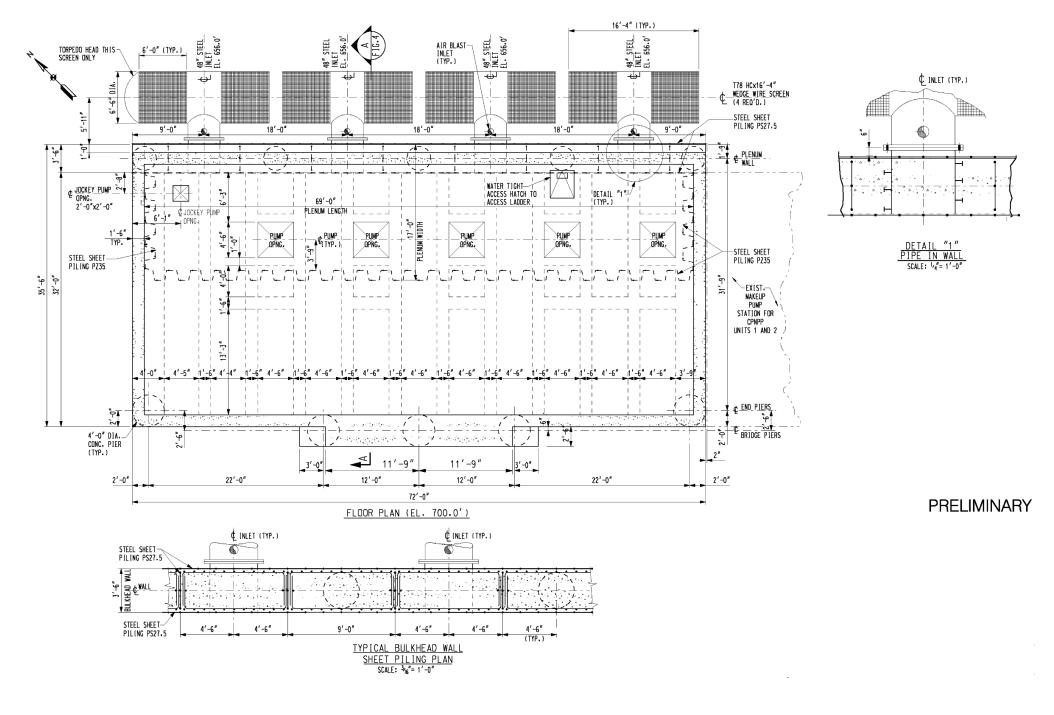


Figure 3.4-4 Makeup Water Intake Structure Floor Plan