

**Comanche Peak Nuclear Power Plant, Units 3 & 4
COL Application
Part 3 - Environmental Report**

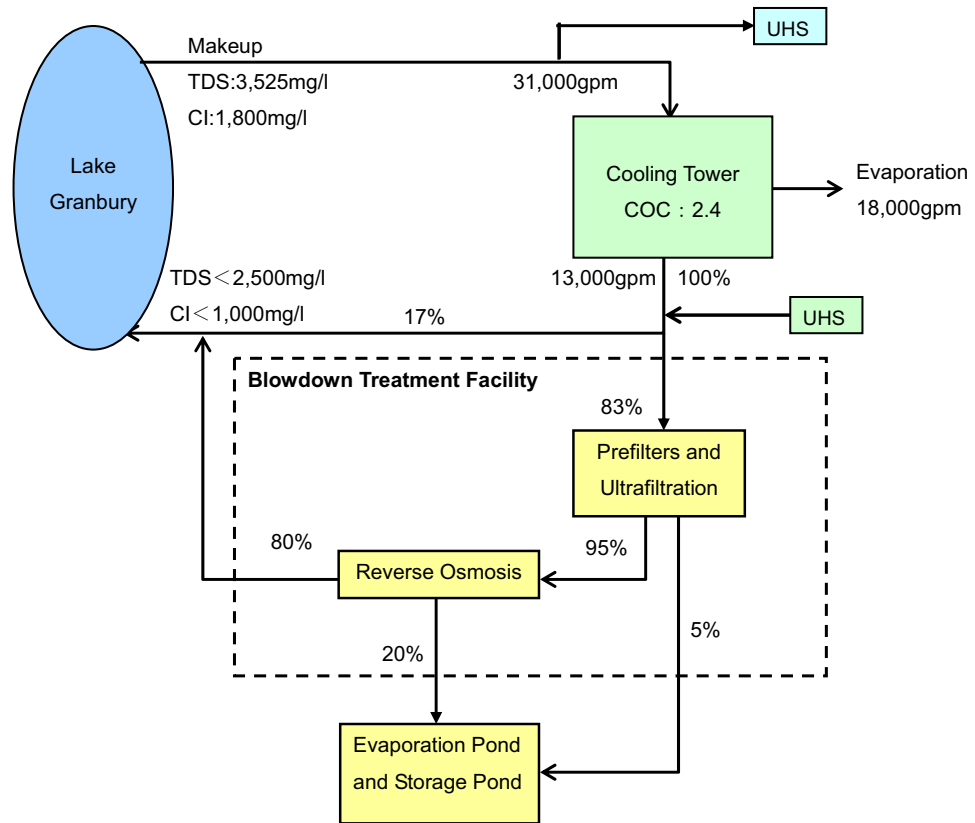


Figure 3.6-1 Sketch of Blowdown Water Treatment Facility Per Unit