



**Comanche Peak Nuclear Power Plant, Units 3 & 4  
COL Application  
Part 3 - Environmental Report**

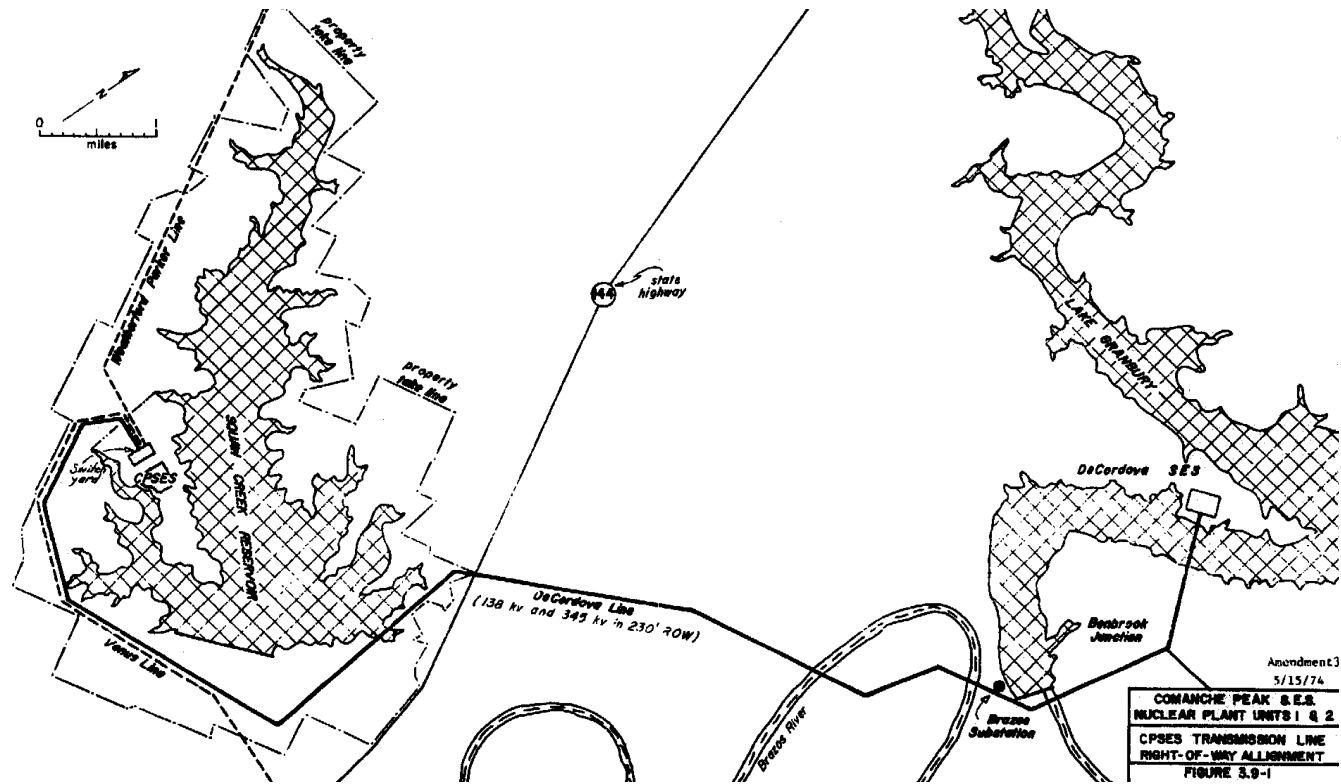

**Figure 3.7-1 Existing CPNPP Transmission Lines (Sheet 1 of 3)**


**Comanche Peak Nuclear Power Plant, Units 3 & 4  
COL Application  
Part 3 - Environmental Report**

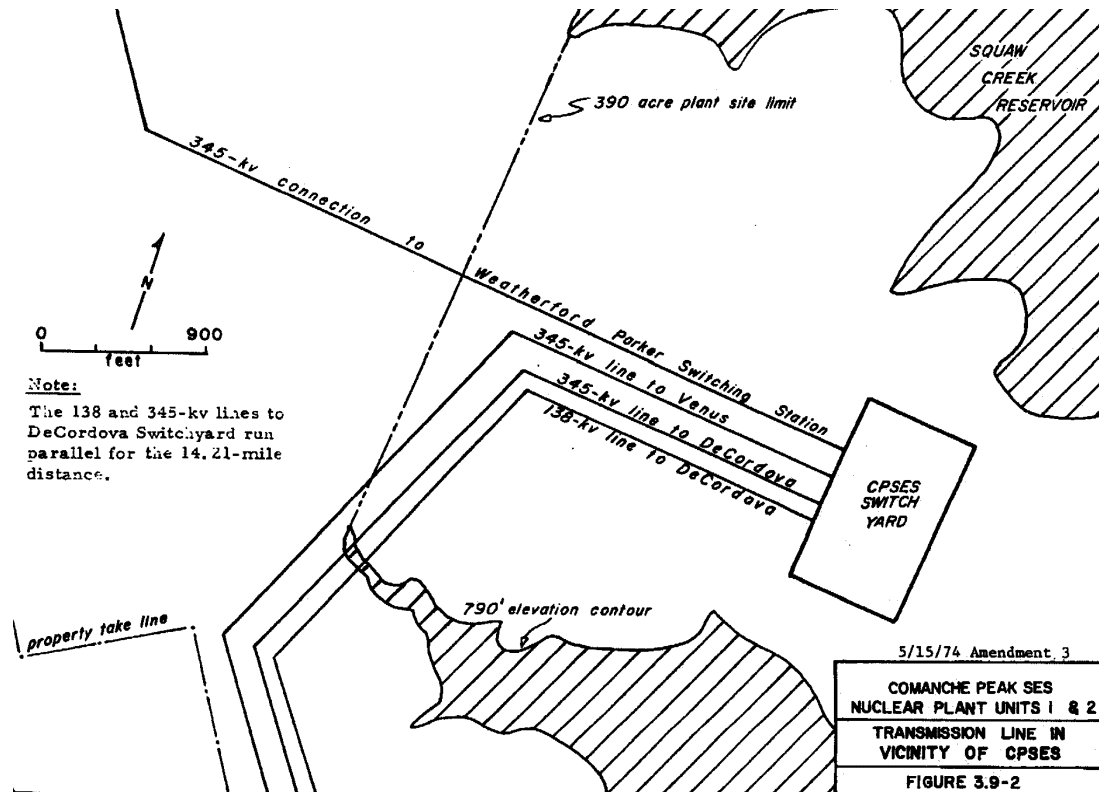

Note:  
The 138 and 345-kv lines to DeCordova Switchyard run parallel for the 14.21-mile distance.

**Figure 3.7-1 Existing CPNPP Transmission Lines (Sheet 2 of 3)**

**Comanche Peak Nuclear Power Plant, Units 3 & 4  
COL Application  
Part 3 - Environmental Report**

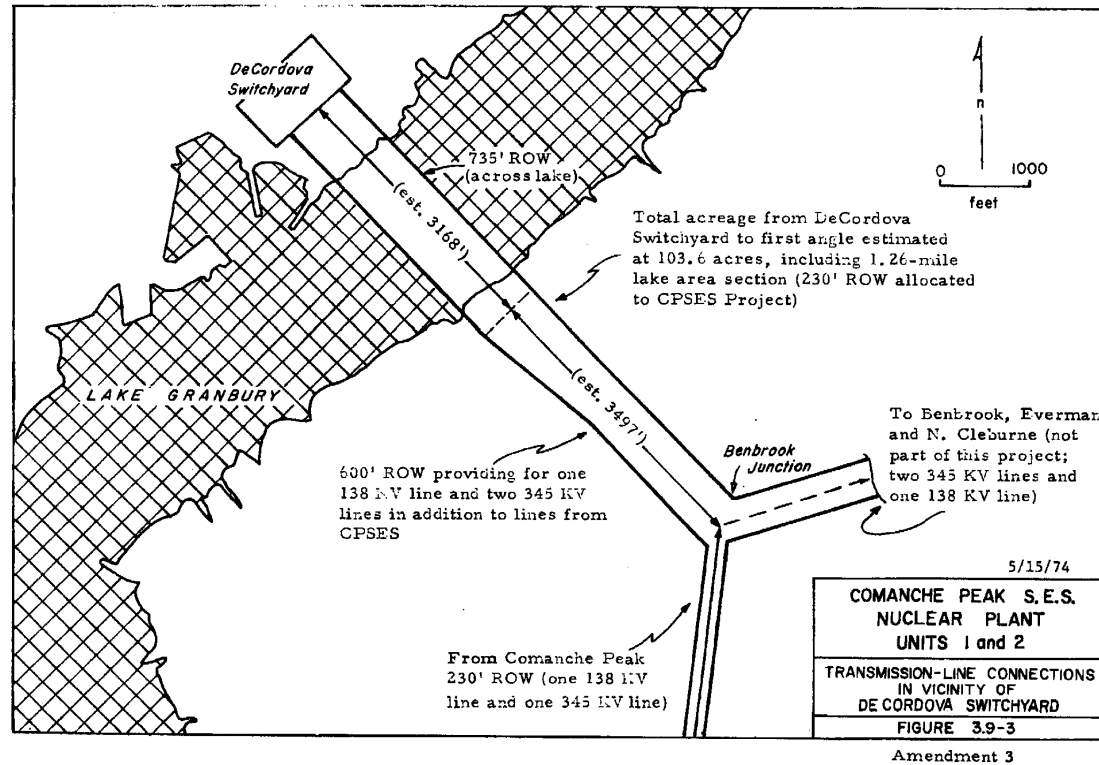

**Figure 3.7-1 Existing CPNPP Transmission Lines (Sheet 3 of 3)**