

**Comanche Peak Nuclear Power Plant, Units 3 & 4
COL Application
Part 2, FSAR**

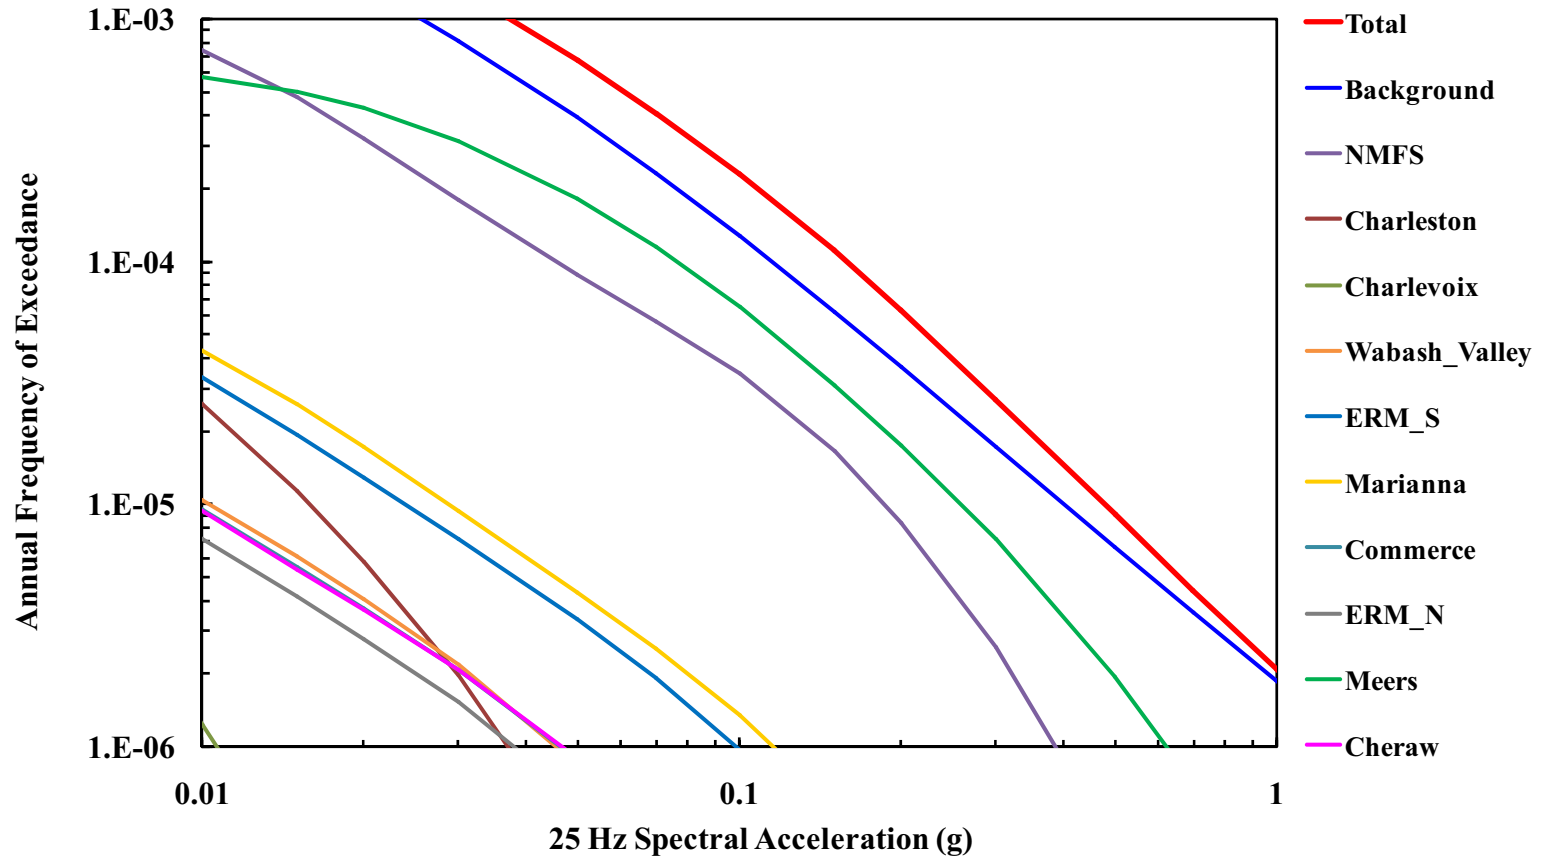


Figure 2.5.2-215 Contribution to 25 Hz Rock Total Mean Hazard