



Figure 2.6.3-1—Annulus Ventilation System Normal Operation Train Functional Arrangement

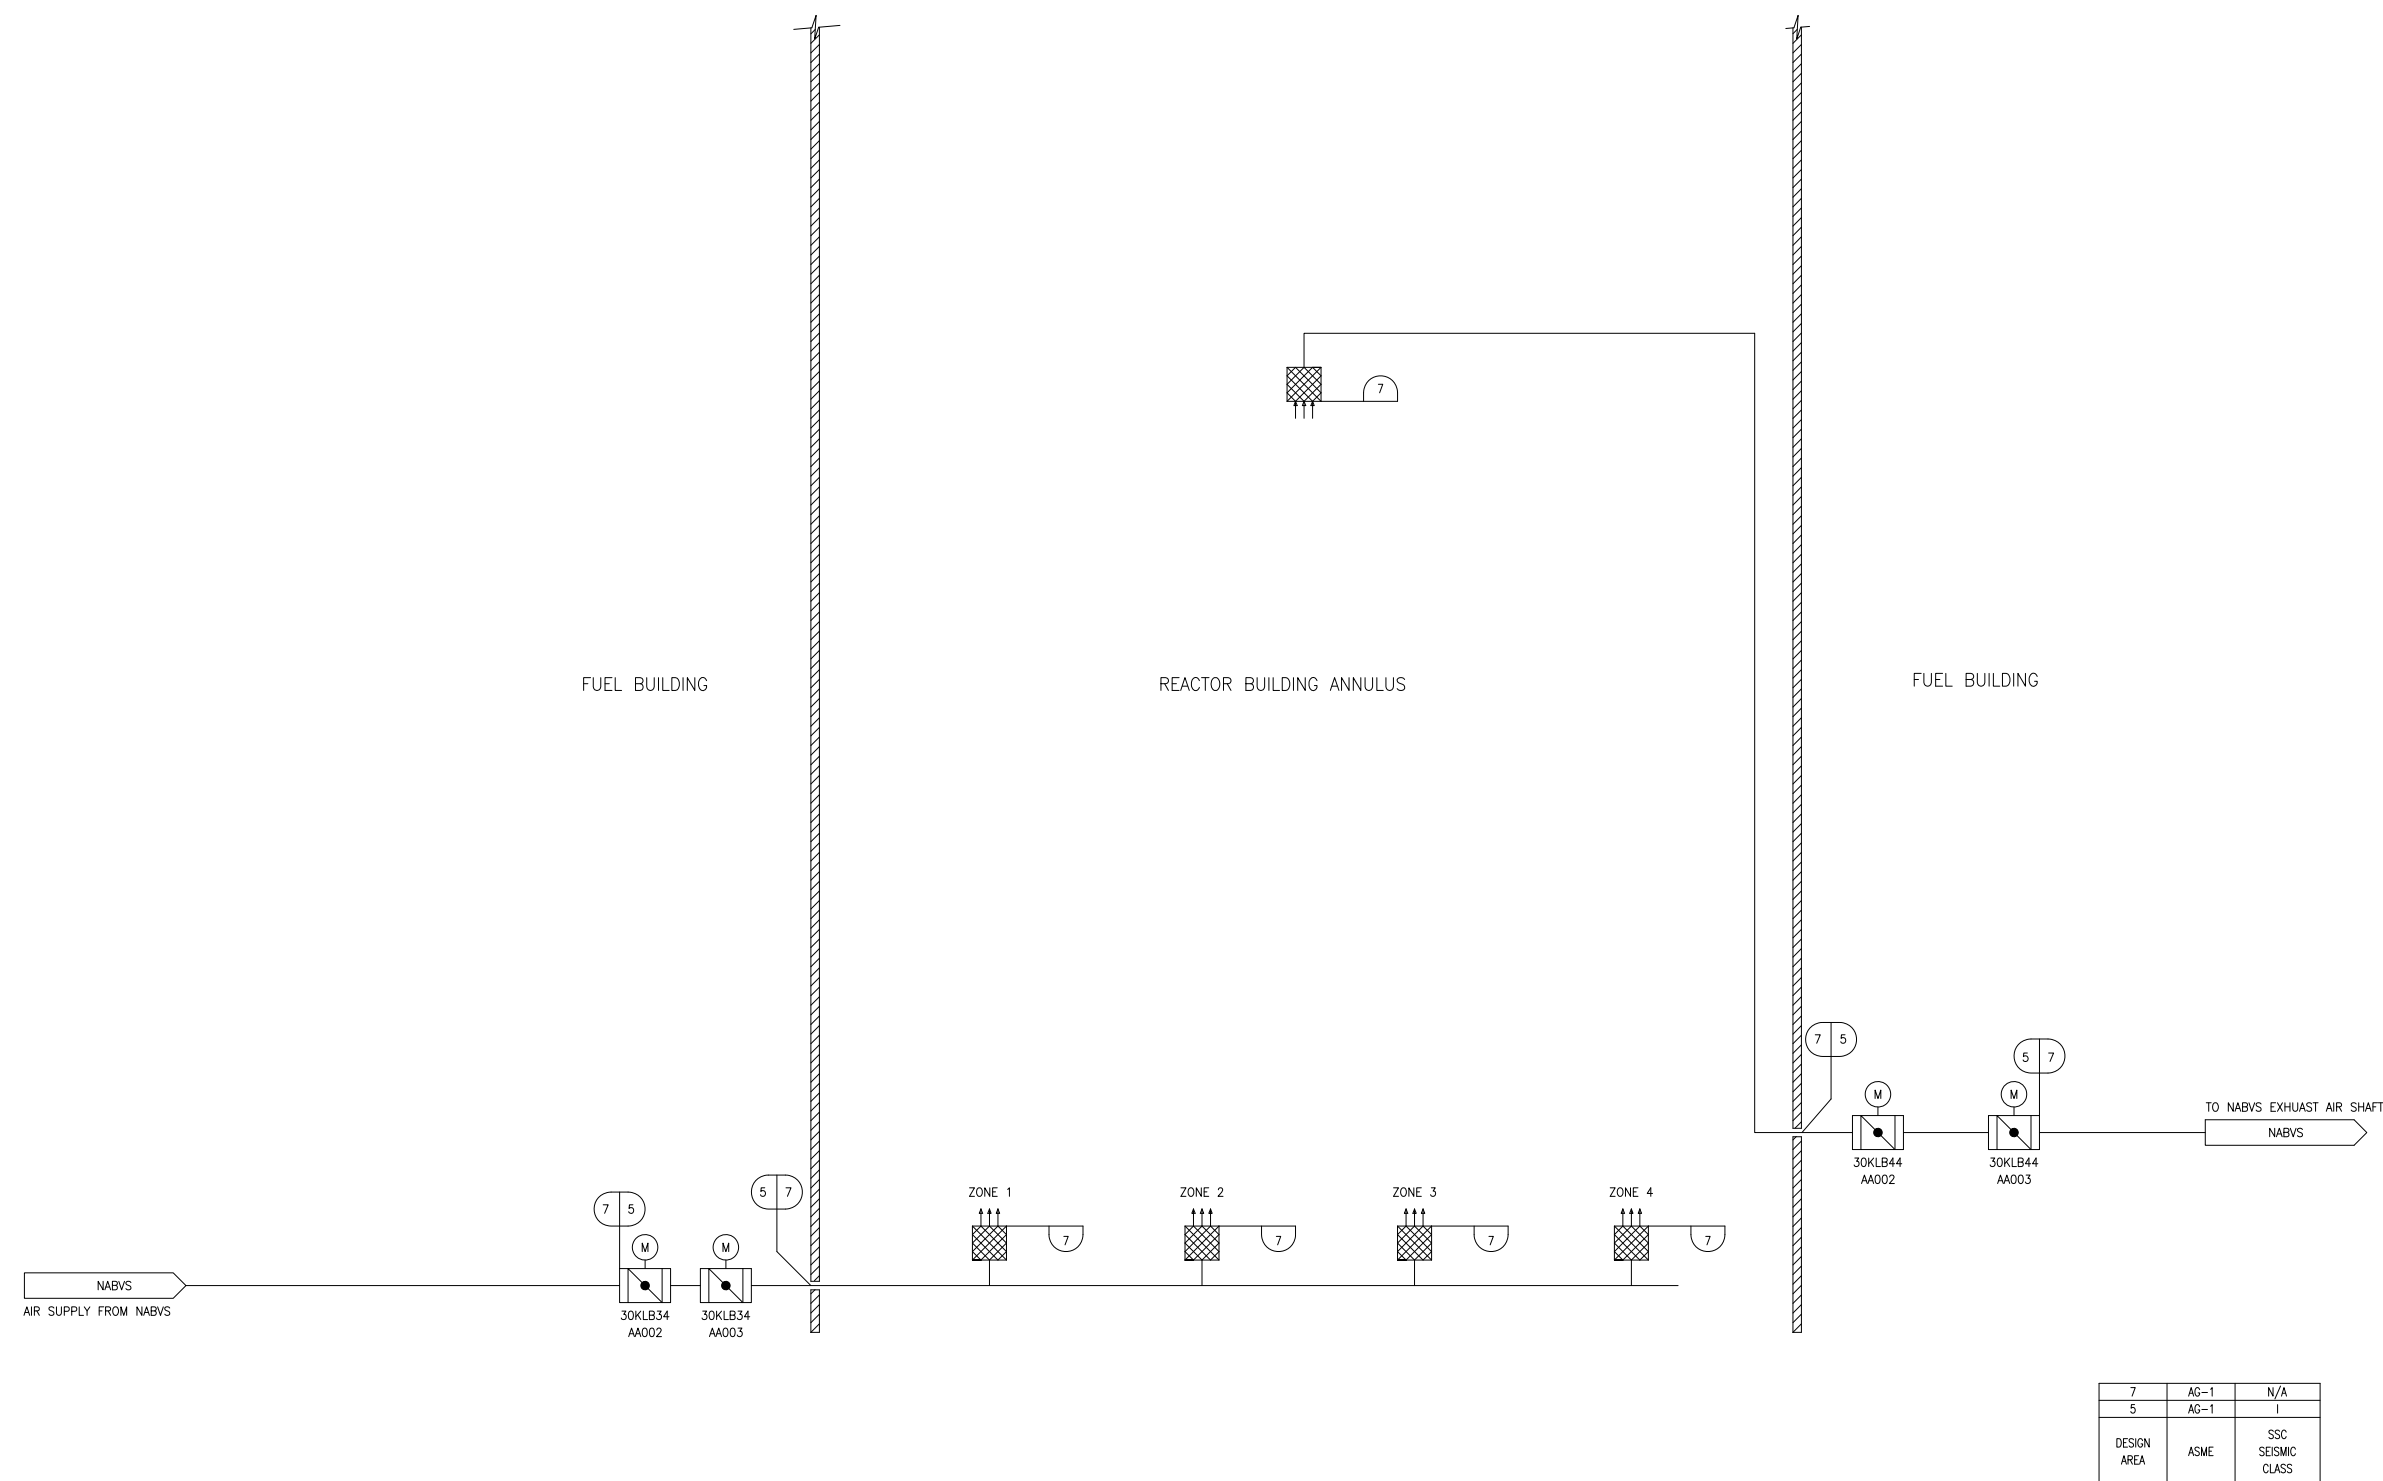

REV 005  
KLB01T1

Figure 2.6.3-2—Annulus Ventilation System Accident Filtration Train Functional Arrangement

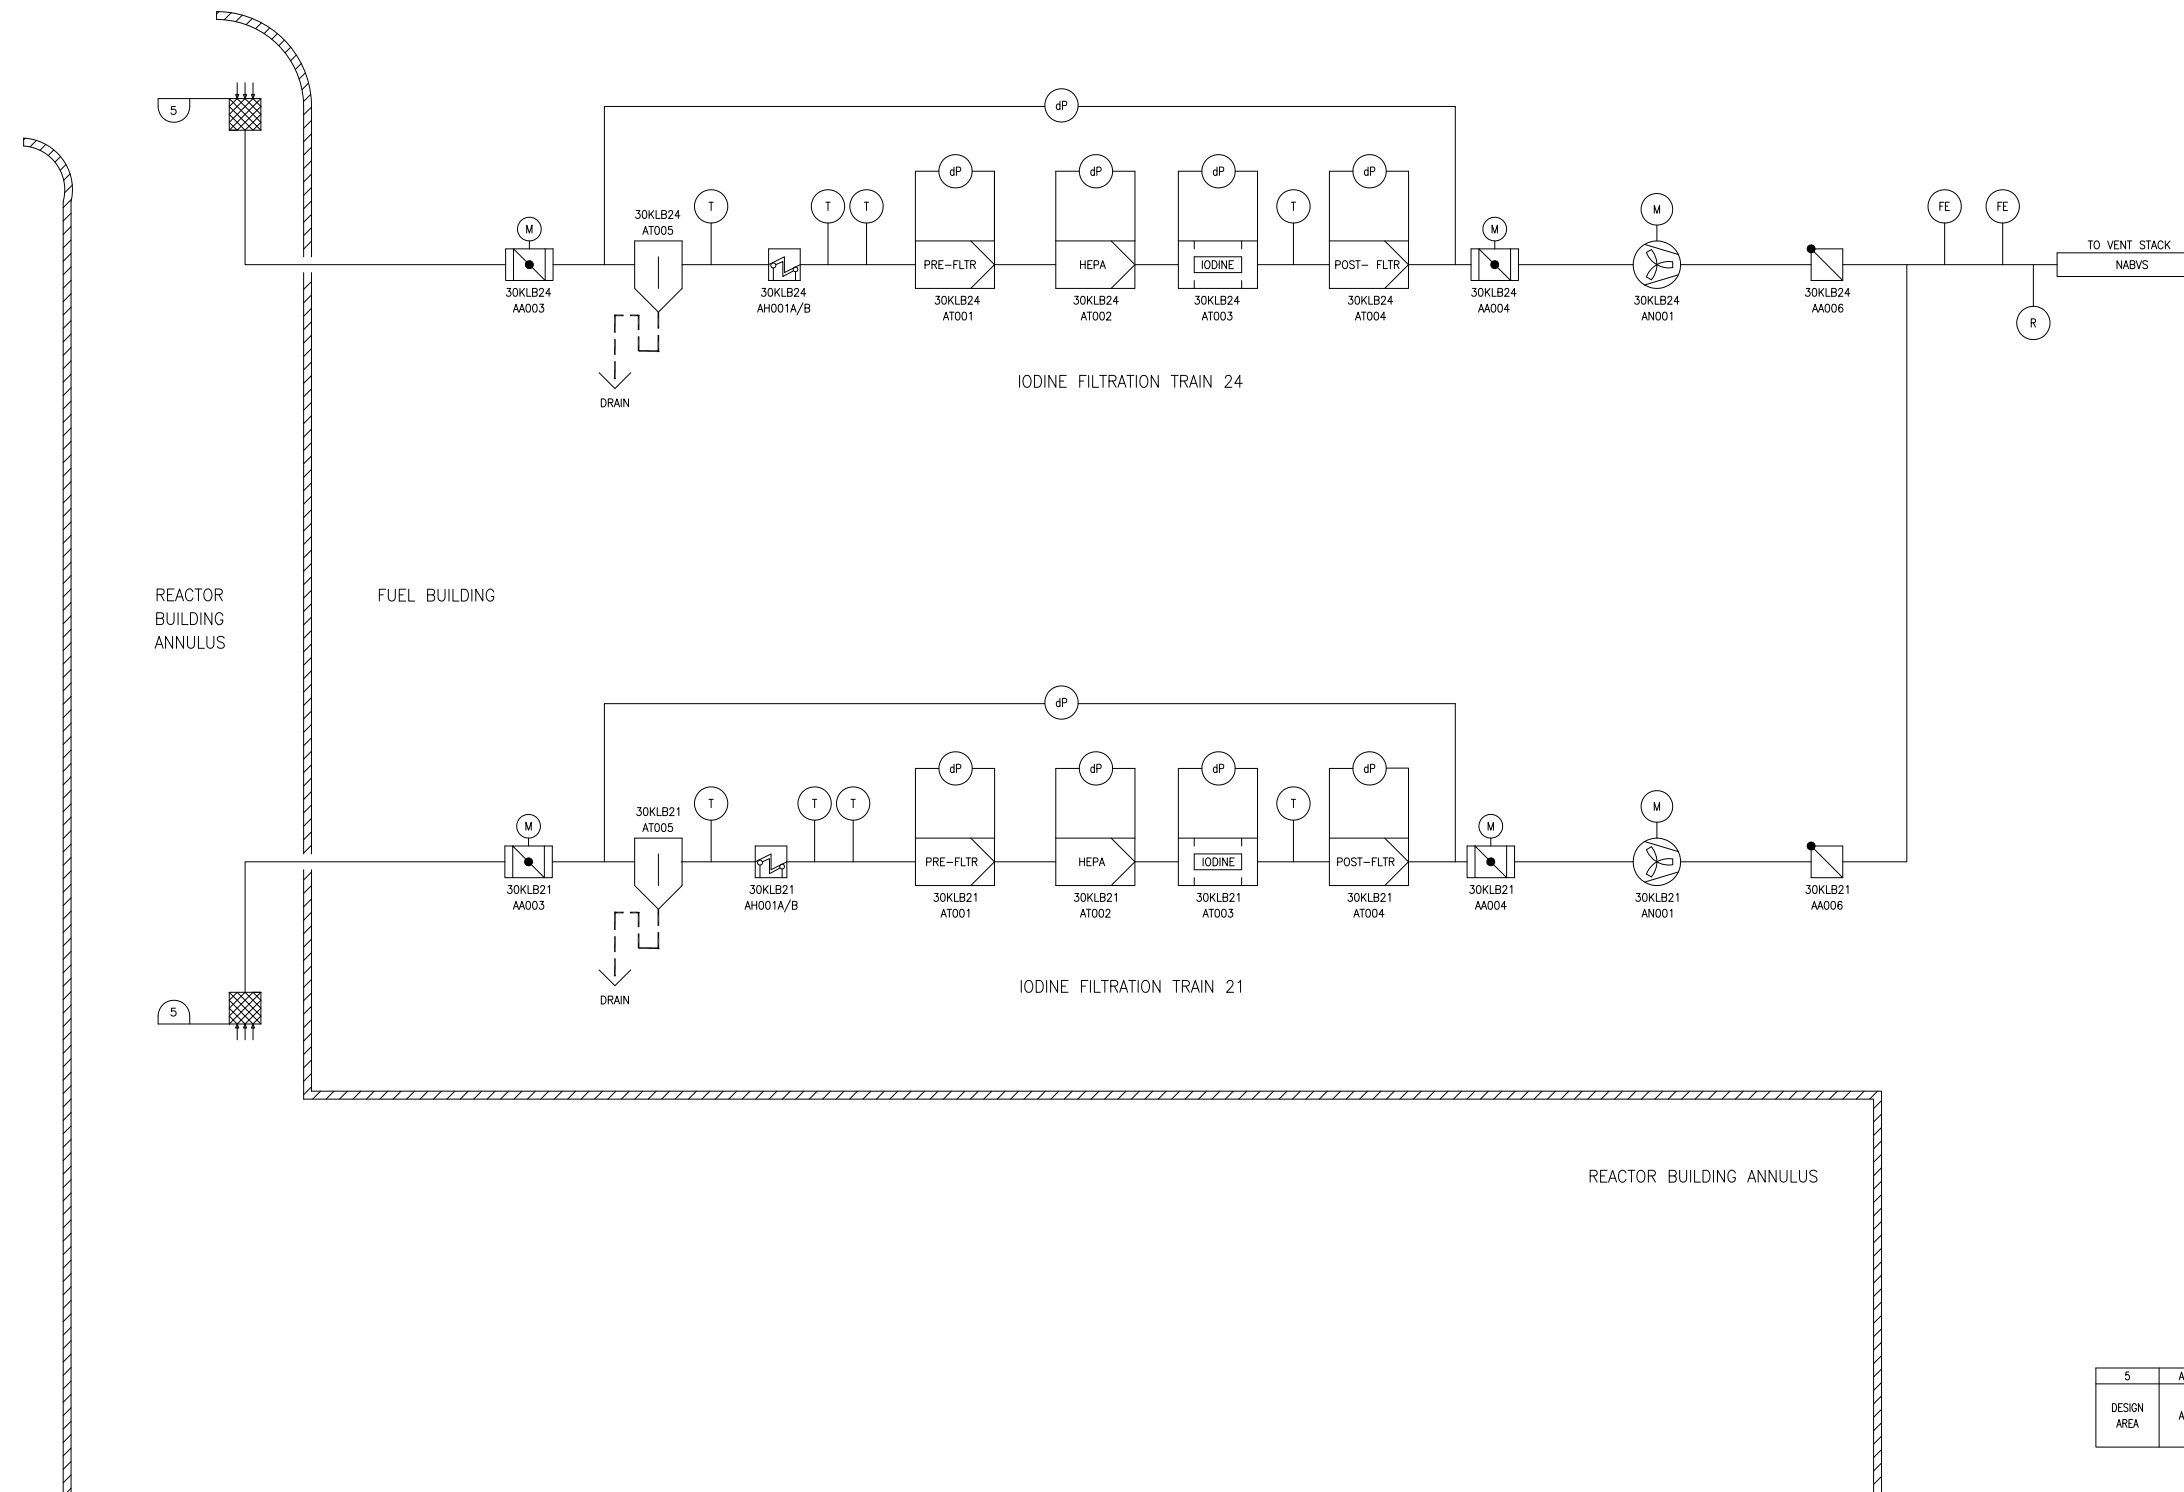

S	AG-1	I
DESIGN AREA	ASME	SSC SEISMIC CLASS

REV 005  
KLB02T1