


Figure 2.6.8-1—Containment Building Ventilation System Functional Arrangement

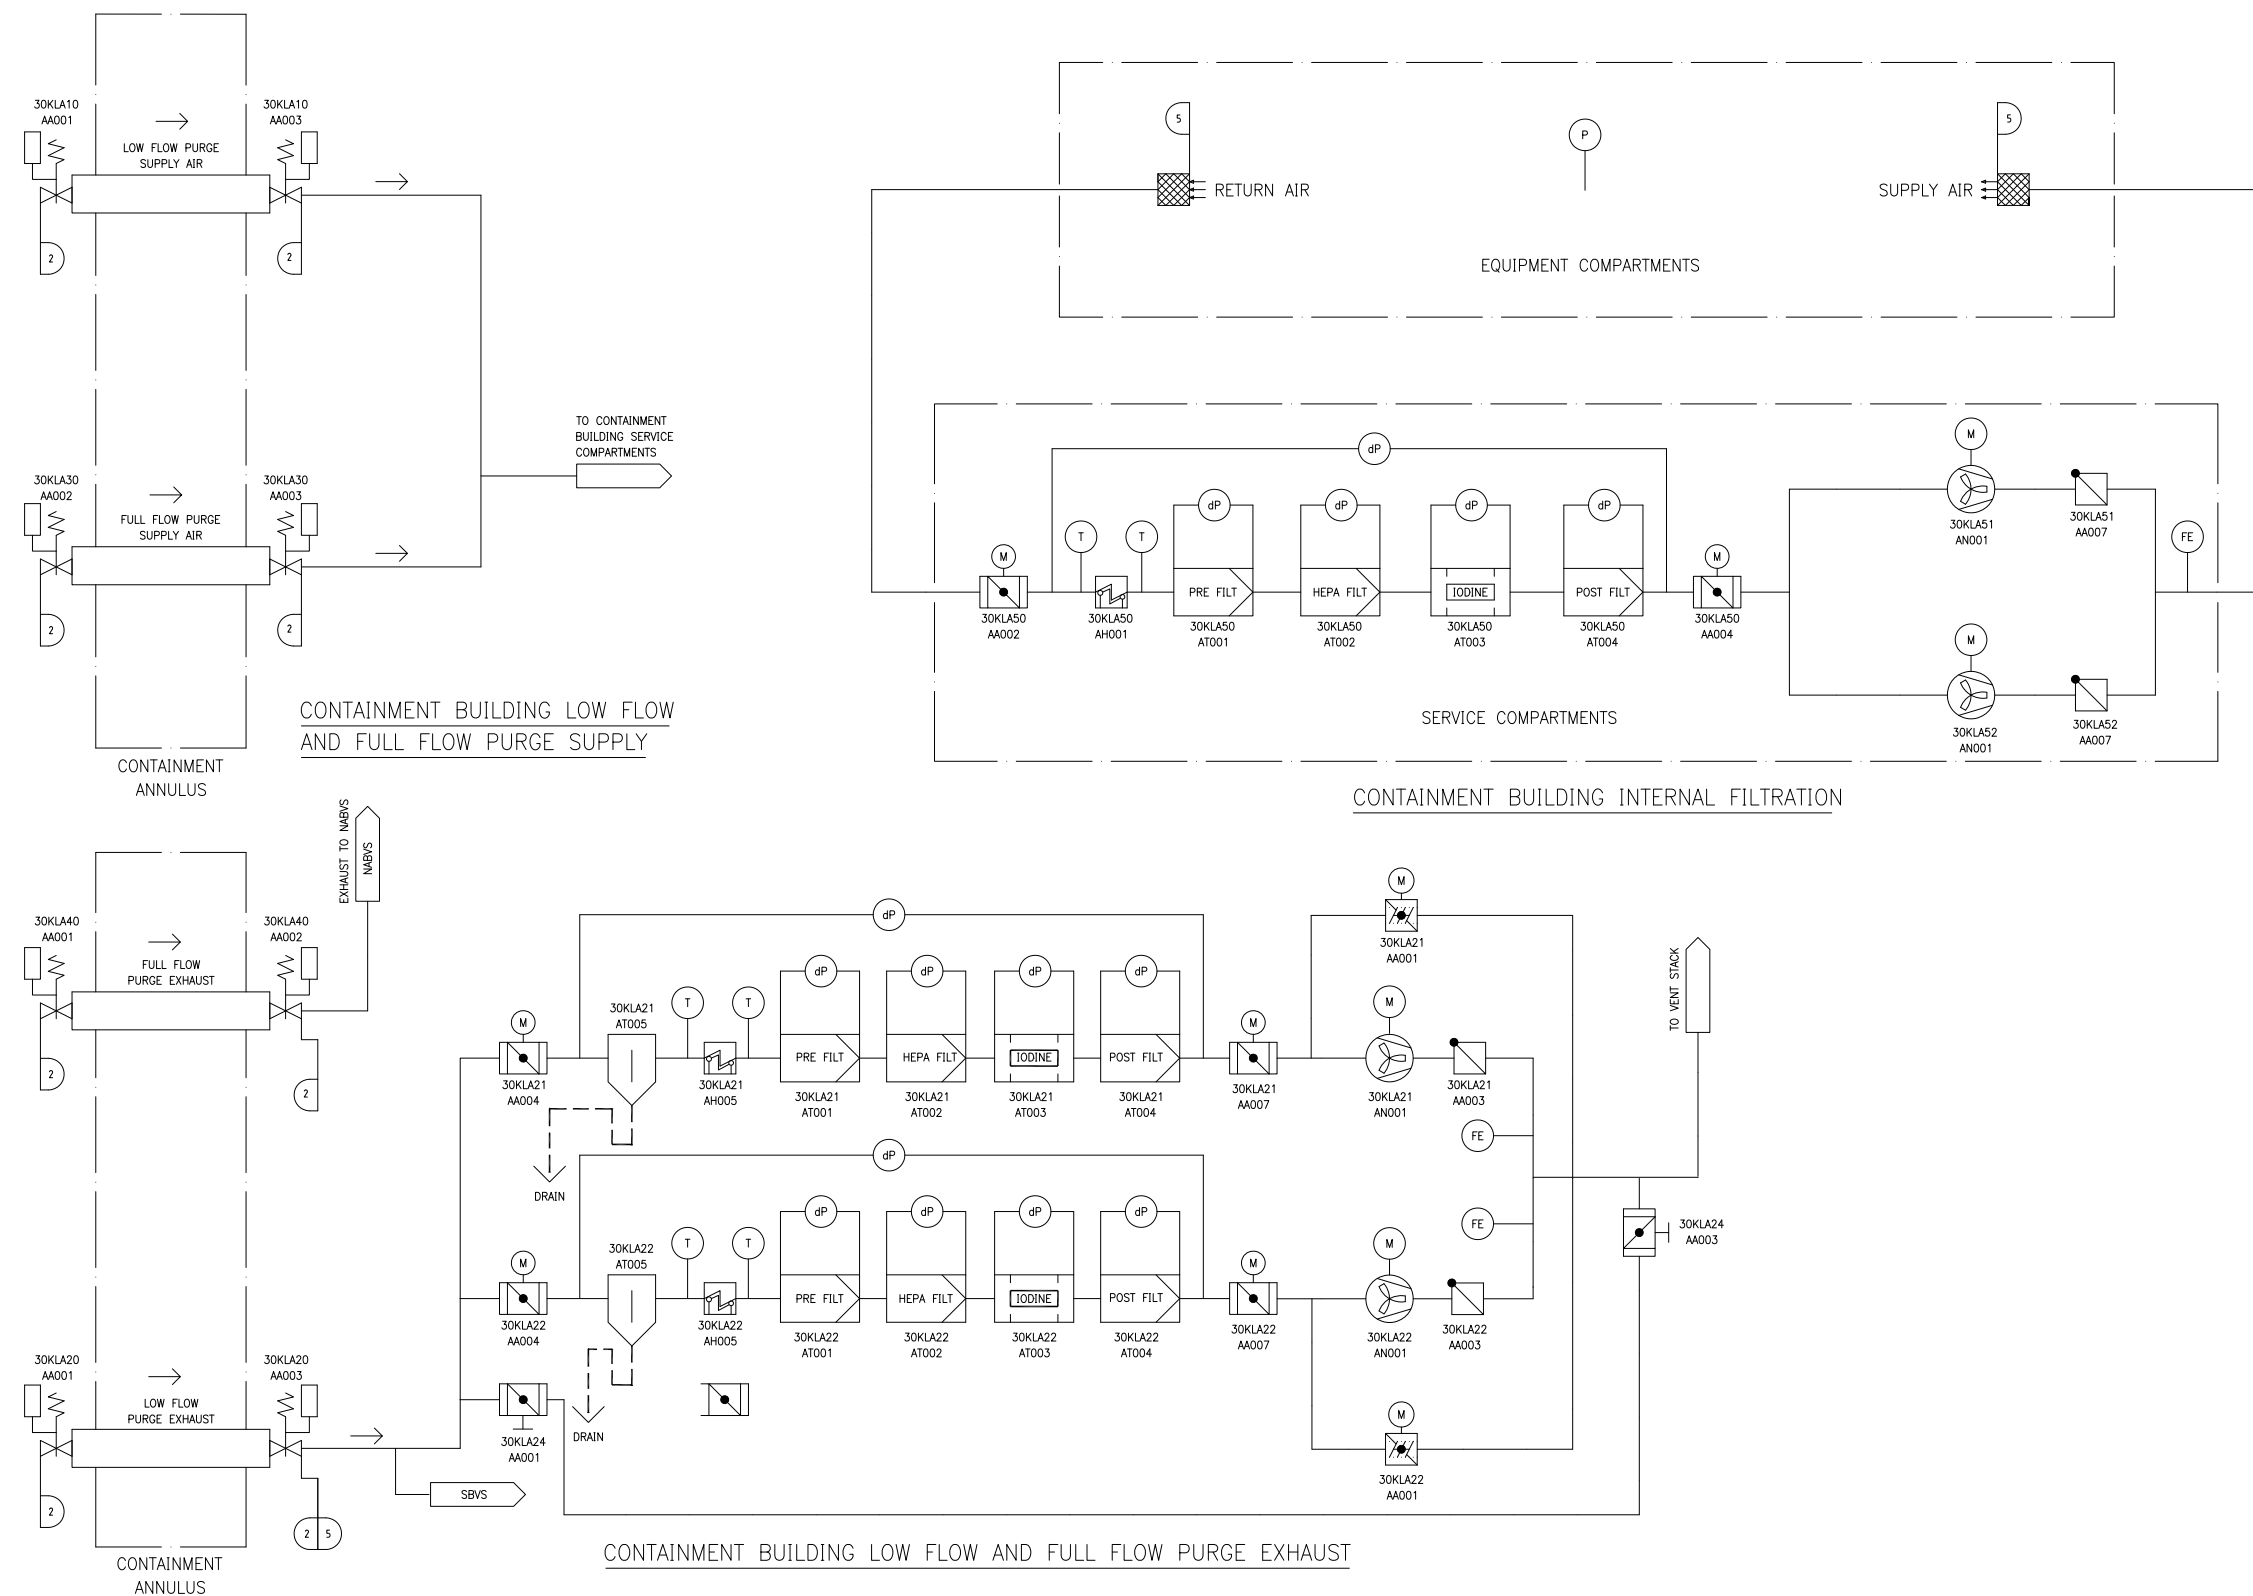

5	AG-1	I
2	III, CLASS 2	I
DESIGN AREA	ASME	SSC SEISMIC CLASS

REV 005
KLA01T1