

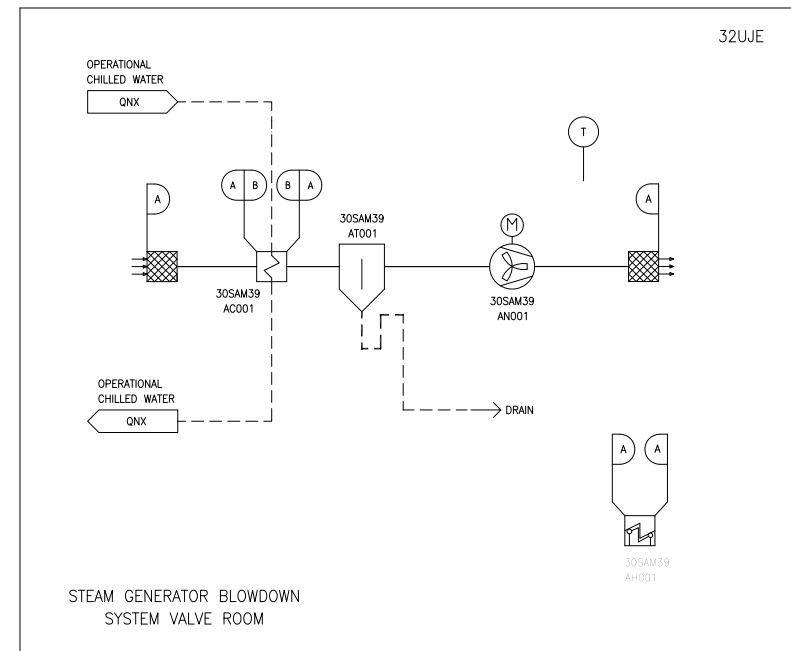


Figure 9.4.12-1—Main Steam and Feedwater Valve Room Ventilation System

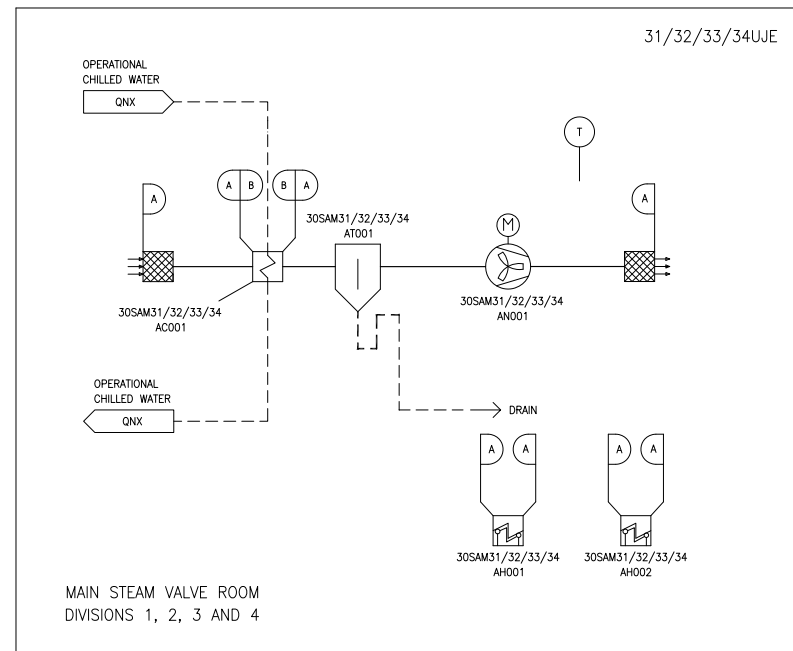

KTE – NUCLEAR ISLAND DRAIN AND VENT SYSTEMS – FLOOR DRAINS 3
 QNX – OPERATIONAL CHILLED WATER SYSTEM
 SAM3 – MAIN STEAM AND MAIN FEEDWATER VALVE ROOM VENTILATION SYSTEM

31UJE – MAIN STEAM VALVE ROOM, DIVISION 1
 32UJE – MAIN STEAM VALVE ROOM, DIVISION 2
 33UJE – MAIN STEAM VALVE ROOM, DIVISION 3
 34UJE – MAIN STEAM VALVE ROOM, DIVISION 4

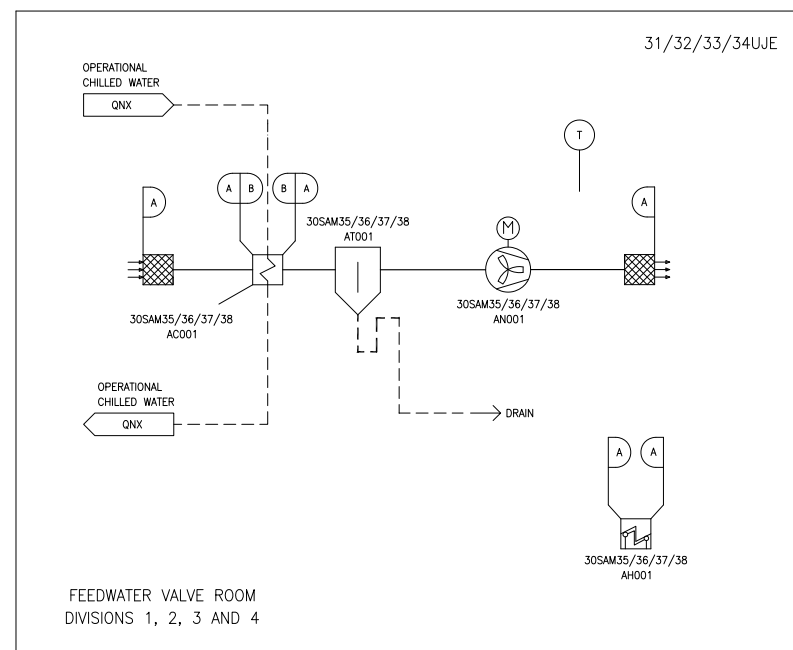

B	E	NSC
A	N/A	NSC
DESIGN AREA	SSC QUALITY GROUP	SSC SEISMIC CLASS

REV 005
 SAM301T2