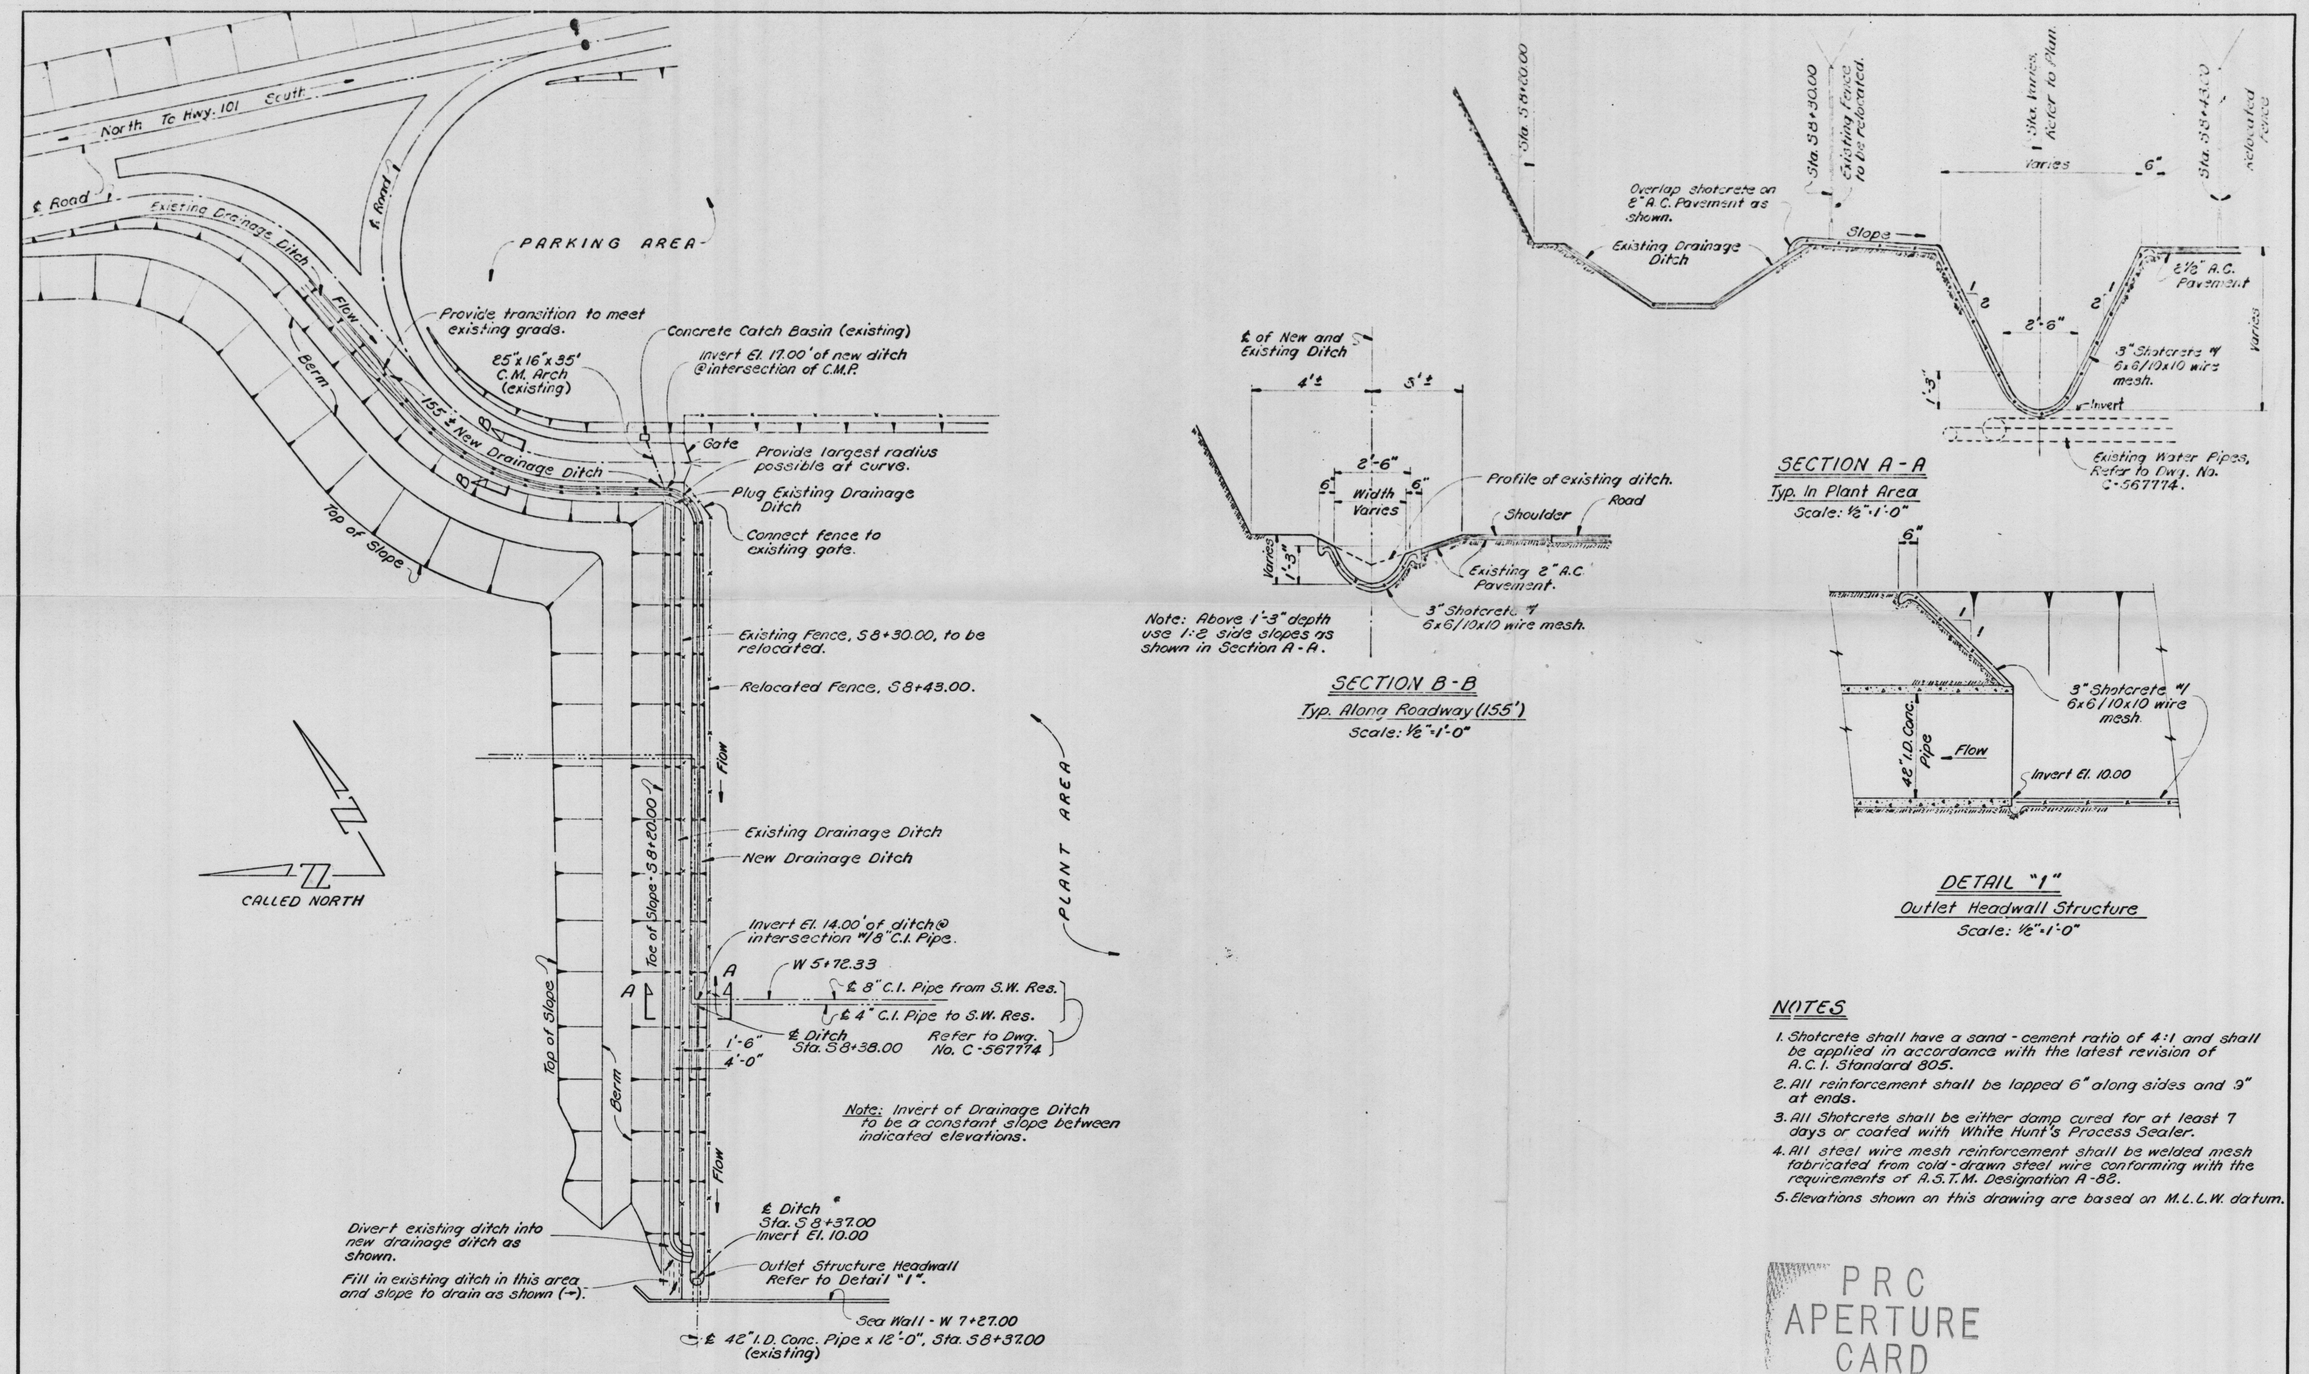

NOTES

1. Shotcrete shall have a sand - cement ratio of 4:1 and shall be applied in accordance with the latest revision of A.C.I. Standard 805.
2. All reinforcement shall be lapped 6" along sides and 9" at ends.
3. All Shotcrete shall be either damp cured for at least 7 days or coated with White Hunt's Process Sealer.
4. All steel wire mesh reinforcement shall be welded mesh fabricated from cold - drawn steel wire conforming with the requirements of A.S.T.M. Designation A-82.
5. Elevations shown on this drawing are based on M.L.L.W. datum.

PRC APERTURE CARD

Reference Drawings		No.	Revisions	Date	Approved	O.K.	O.K.	Ck'd.	Made	J.O. No.
568883	Unit No. 1 - Site Grading									

No.	Revisions	Date	Approved	O.K.	O.K.	Ck'd.	Made	J.O. No.
0		8-19-66	[illegible]		LLL.	B/	CWM	6612

Scale As Shown

Location SAN ONOFRE NUCLEAR GEN. STA.

MODIFICATIONS TO THE NORTH MAIN DRAINAGE DITCH

Southern California Edison Company

INDEXED

589762-0

26X

8209170134

REGULATORY DOCKET FILE COPY

Docket # 50-206
Control # 8209170106
Date 09-13-82 of Document:
REGULATORY DOCKET FILE