


35

750  
740  
730  
720  
710  
700  
690  
680  
670  
660

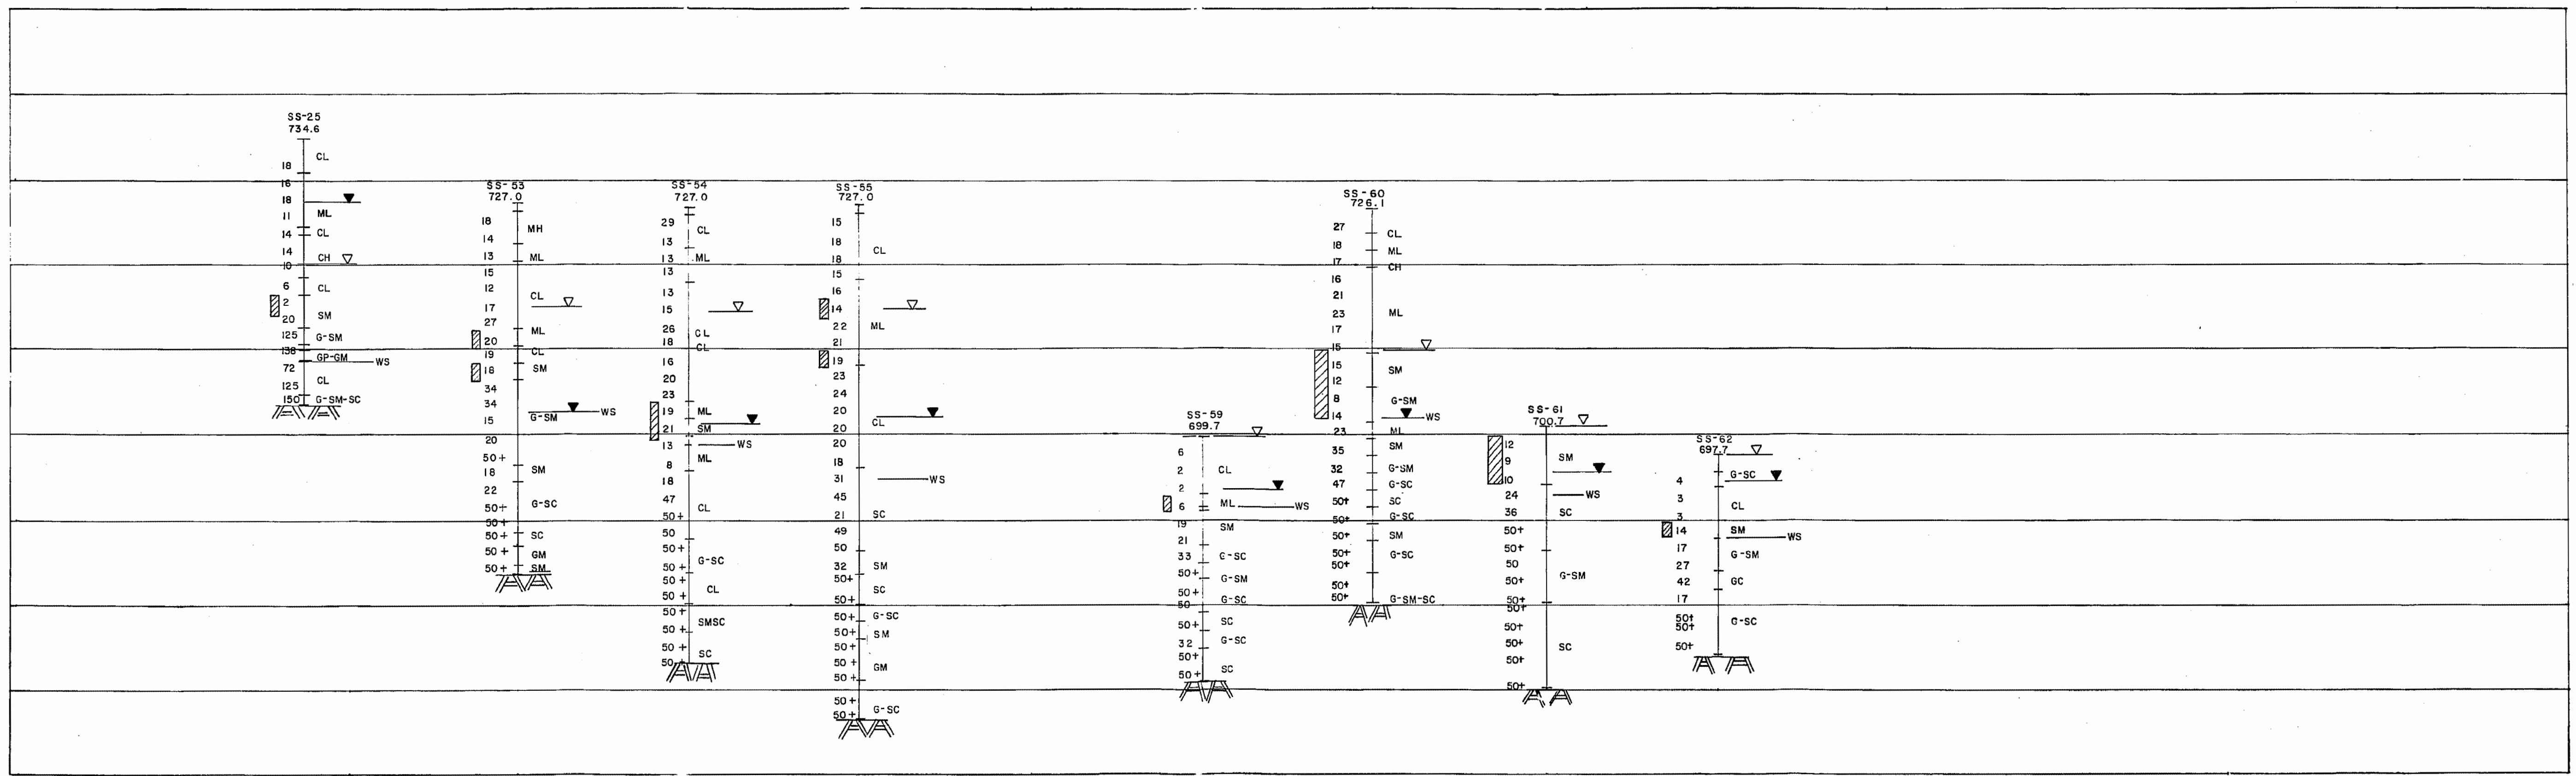

750  
740  
730  
720  
710  
700  
690  
680  
670  
660

- ▽ DESIGN WATER TABLE
- ▼ WATER TABLE (24 HR)
- MH SOIL CLASSIFICATION
- I3 BLOW COUNT
- ▨ POTENTIALLY LIQUEFIABLE SOIL (SEE NOTE)
- WS WEATHERED SHALE

NOTE:  
1. LIQUEFACTION BASED ON TOP OF GROUND ACCELERATION OF 0.4g AND SEED-IDRISS (1971) CORRELATION FOR SANDS.

Added by Amendment 50

WATTS BAR NUCLEAR PLANT  
FINAL SAFETY  
ANALYSIS REPORT  
MISCELLANEOUS ERCW PIPING  
AND IE CONDUIT  
SOIL BORINGS  
FIGURE 2.5-579