



5137-E-6311

REVISIONS	
A	REVISED FOR CLIENT REVIEW BY: [Signature] DATE: 11/2/67
1	CO-01571 CLIENT APPROVED [Signature]

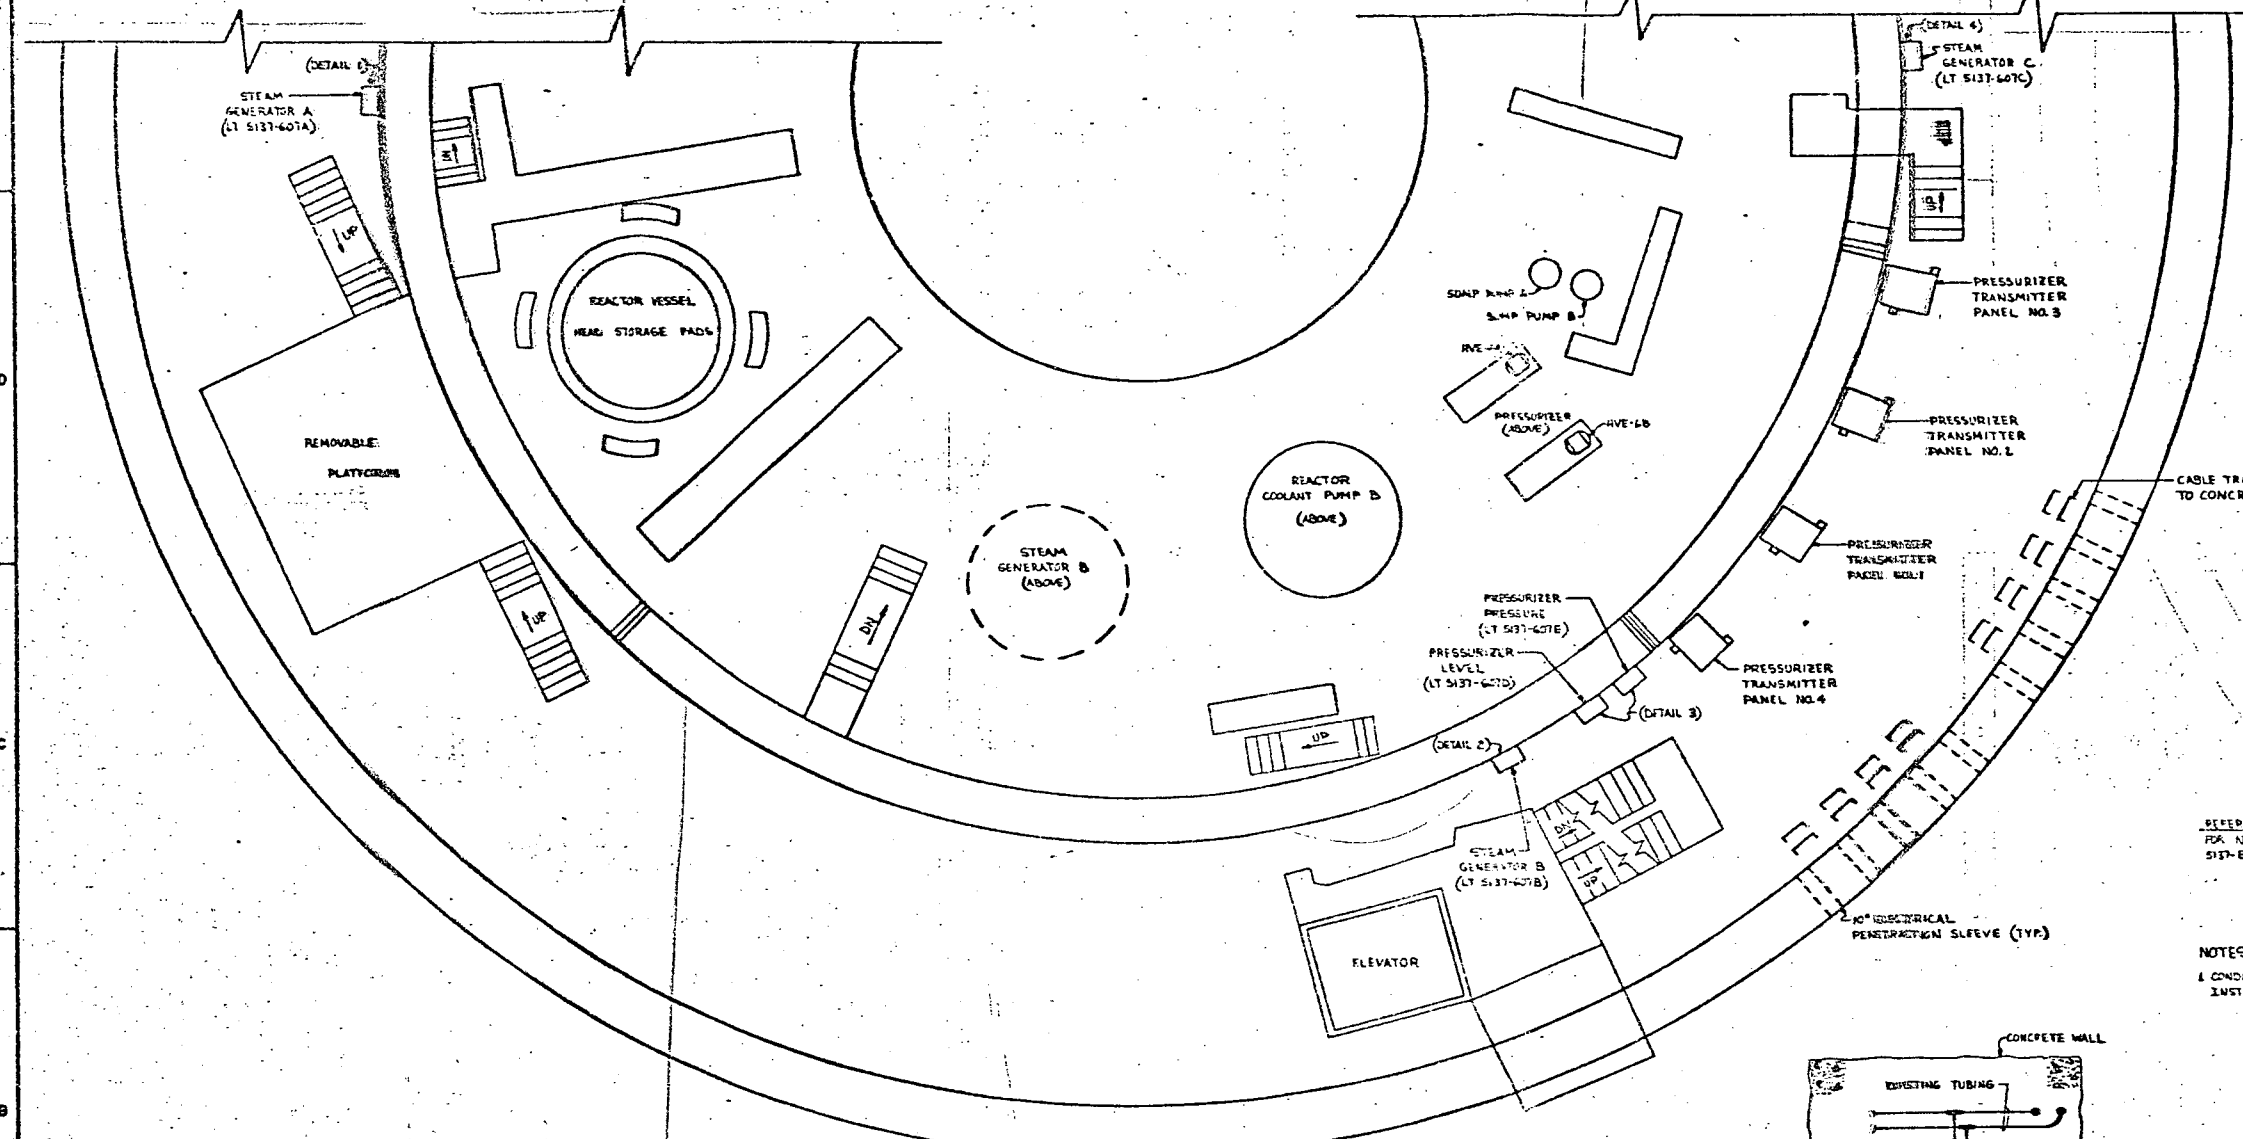


REFERENCE DWG FOR NUCLEAR INSTRUMENTATION DETAILS SEE DWG 5137-E-6306


NOTES:
1 CONDUIT MUST BE SEPARATED FROM EXISTING INSTRUMENT CONDUIT BY A MINIMUM OF 10FT.

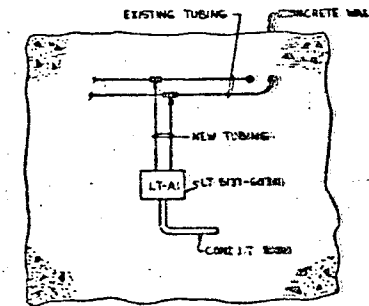


DETAIL 1

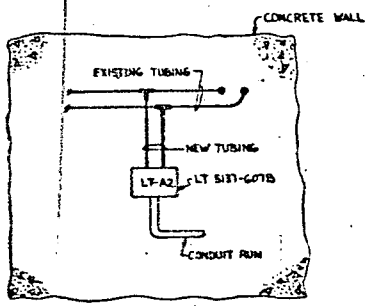

DETAIL 2

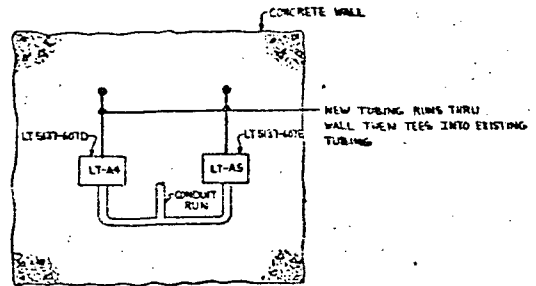

DETAIL 3

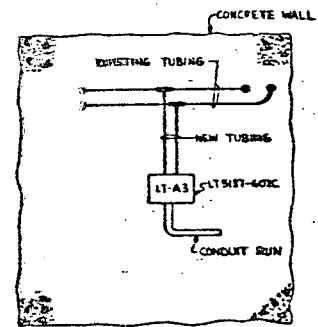

DETAIL 4

2ND LEVEL REVIEW COMPLETED		
REV.	DATE	DATE
1	11/2/67	11/2/67

SAFETY RELATED

CAROLINA POWER & LIGHT COMPANY
H.B. ROBINSON STEAM ELECTRIC PLANT
REACTOR BUILDING EL. 228.00

5137-E-6311

472
800 2110