## Regen Tank Installation Cross Section




## Regen Tank Tie Down Anchor Detail




Not to Scale

Not to Scale

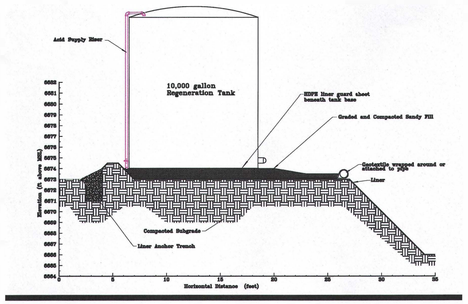


## Acid Storage Tank Installation Cross Section

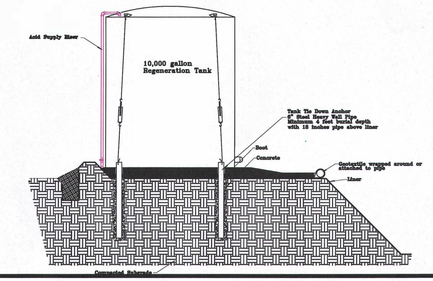


Not to Scale

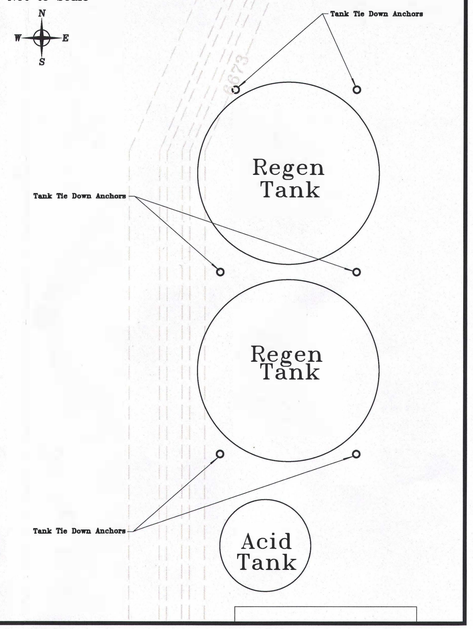


## Acid Transfer Tank Installation Cross Section

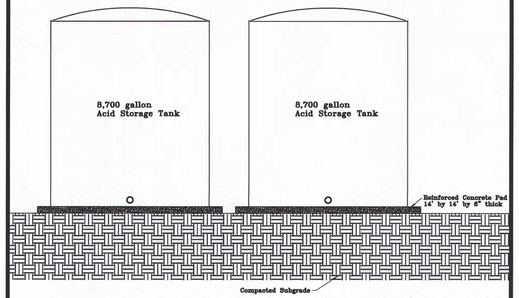


## Acid Transfer Tank Tie Down Anchor Detail

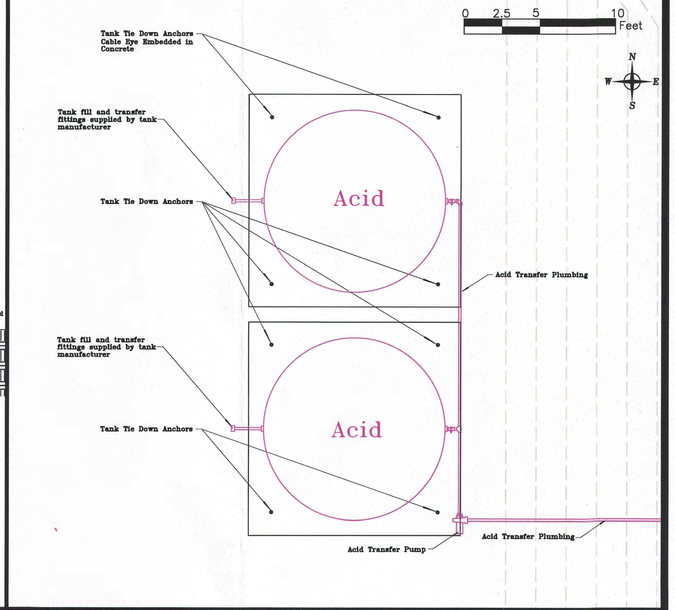


Not to Scale

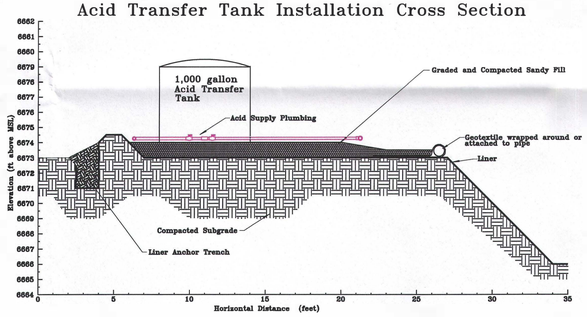


## Acid Tank Concrete Pad Details

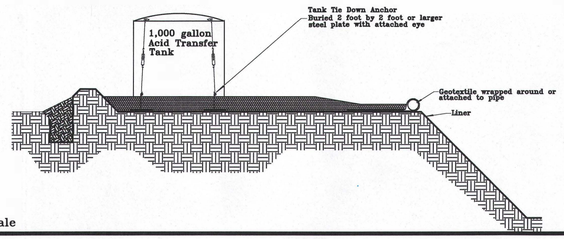


Not to Scale

Note: Tank arrangement shown for Trains A & B.
The locations and installation for Trains C & D
will be a mirror image of those shown above.

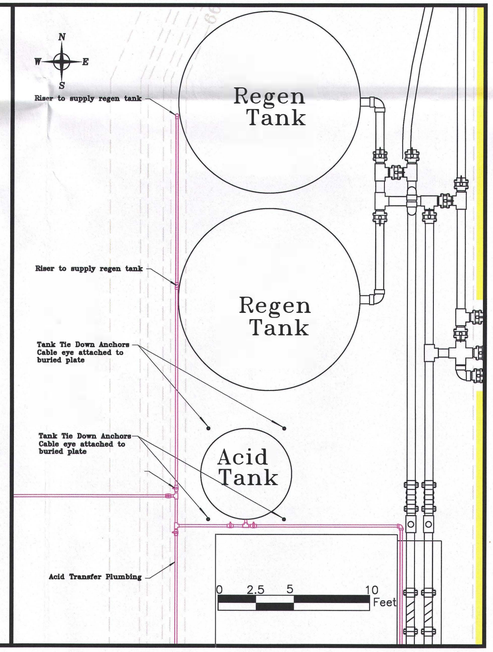Draft
Not for Construction

| REVISIONS | No. | DATE | MADE BY | DESCRIPTION |
|---|---|---|---|---|
| | 1 | | | |
| | 2 | | | |
| | 3 | | | |
| | 4 | | | |
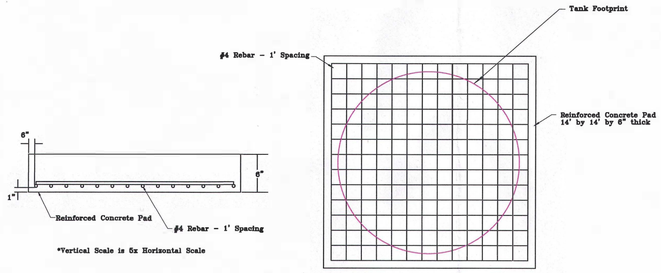
| DATE | DRAWN BY | CHECKED | APPROVED |
|---|---|---|---|
| 6-2014 | TGM | | |

Homestake Mining Company
Grants, New Mexico
1200 GPM Zeolite System

Tank Installation and Anchorage Detail

Exhibit 11

D11