

Figure 7a2.1-1 – Safety Approach for TSV Shutdown

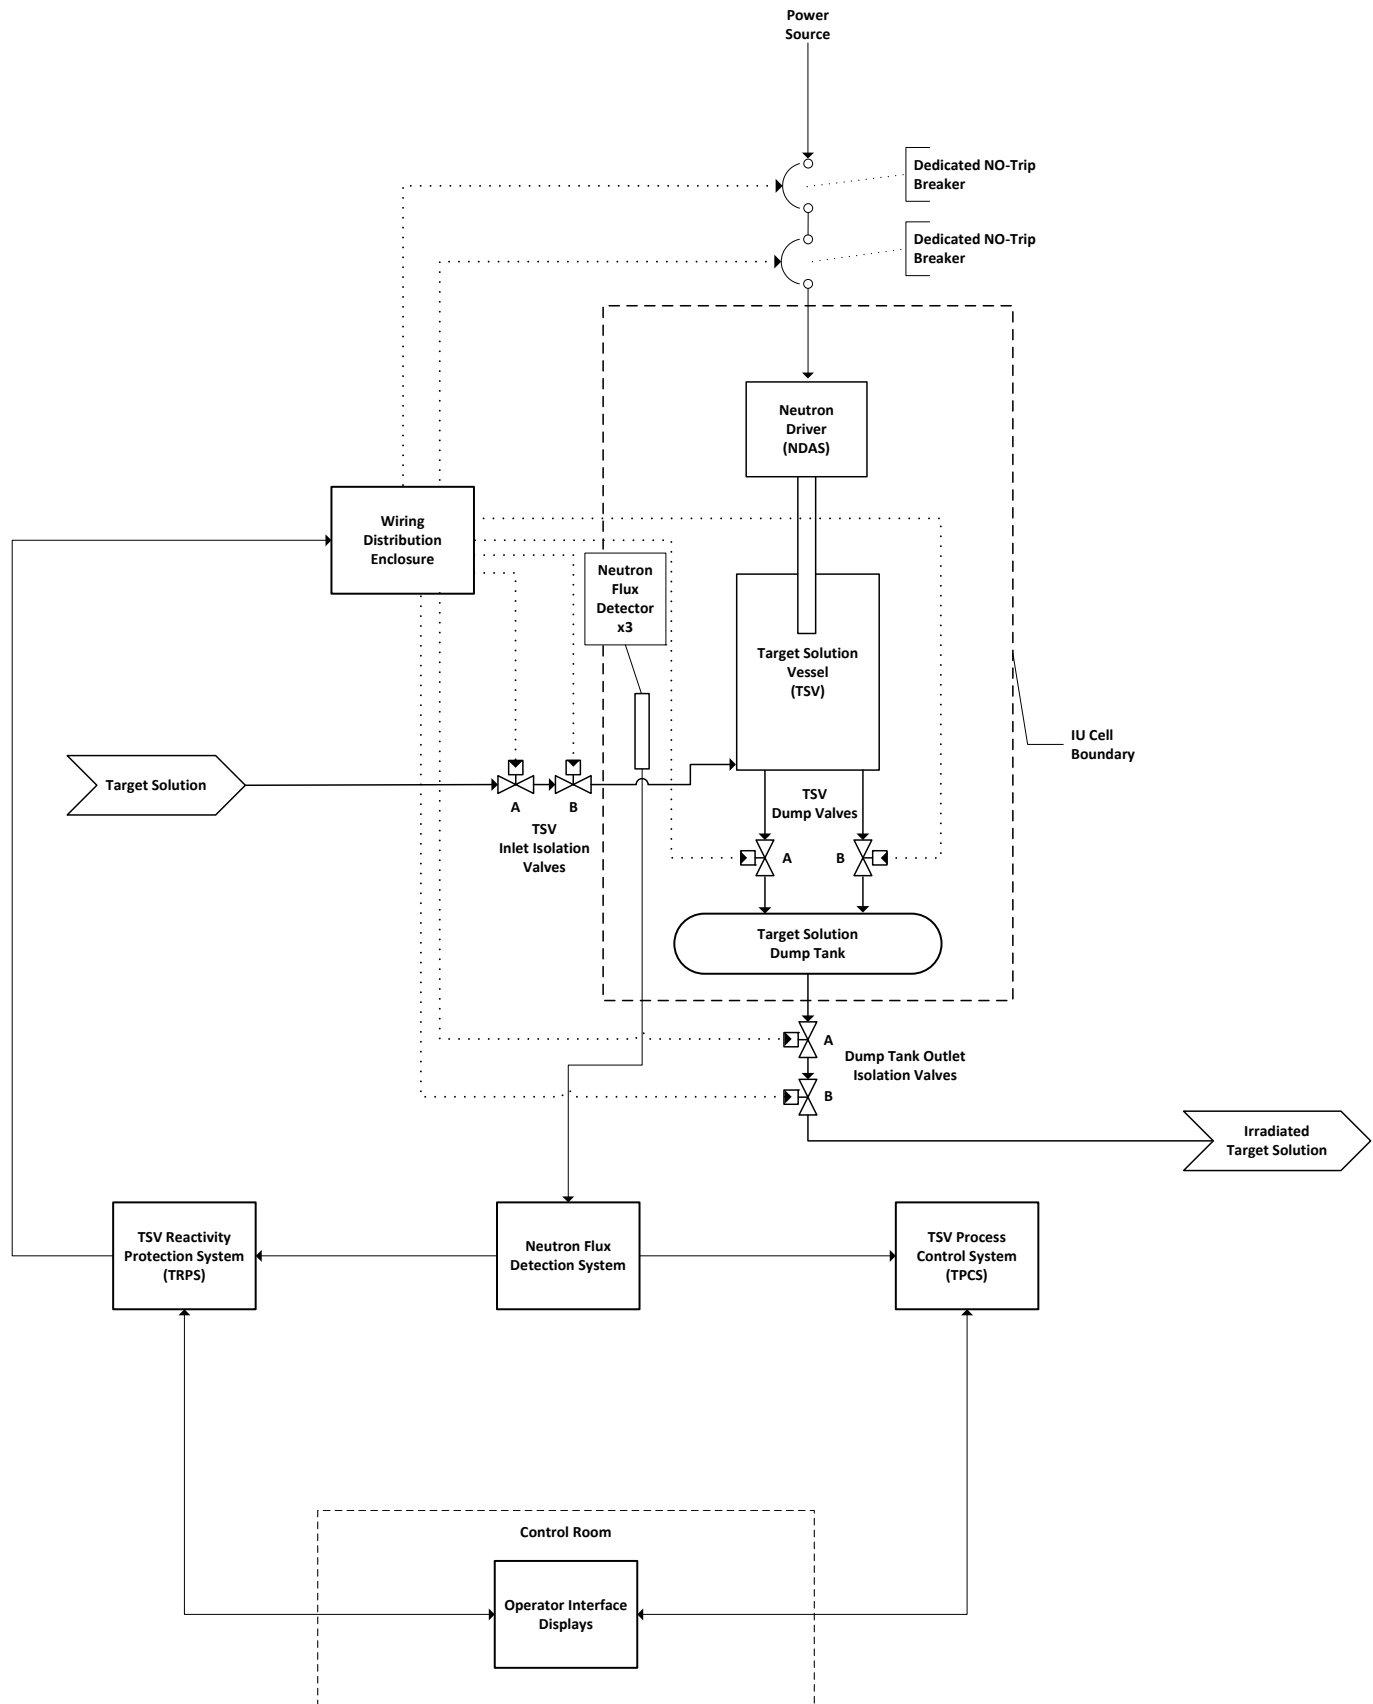


Figure 7a2.2-1 – I&C System Block Diagram for Irradiation Facility

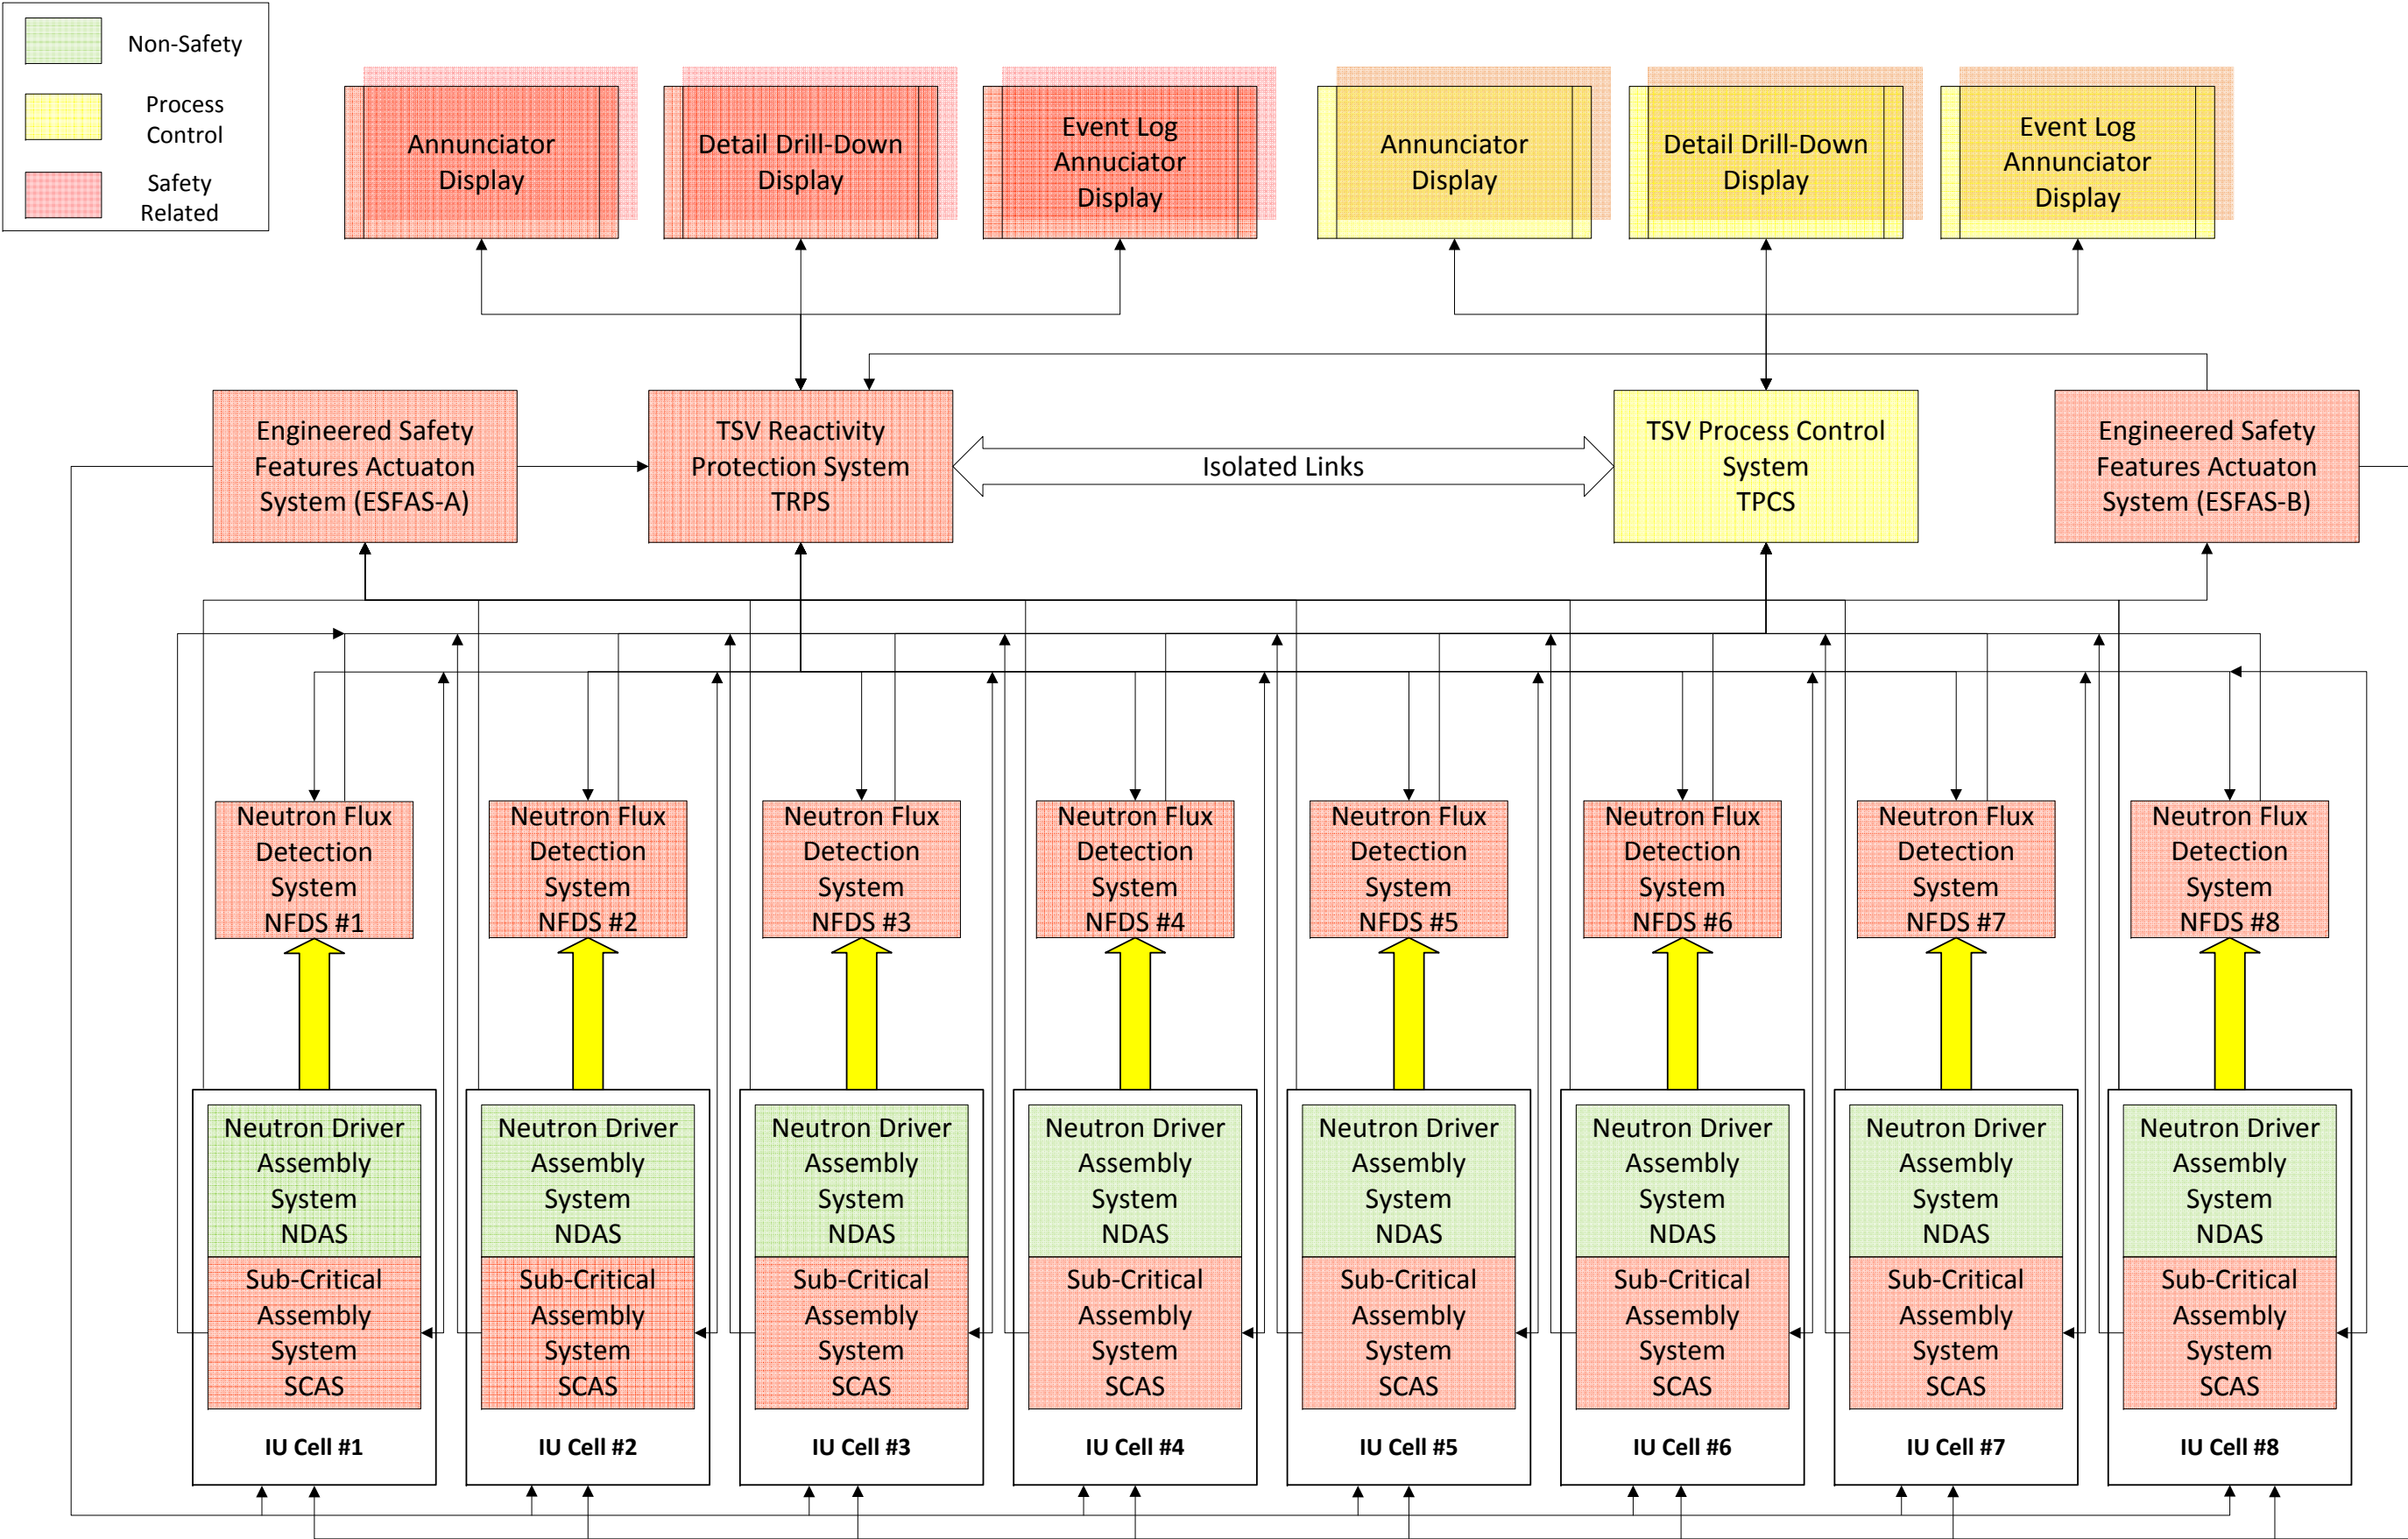


Figure 7a2.5-1 – Typical ESF Circuit

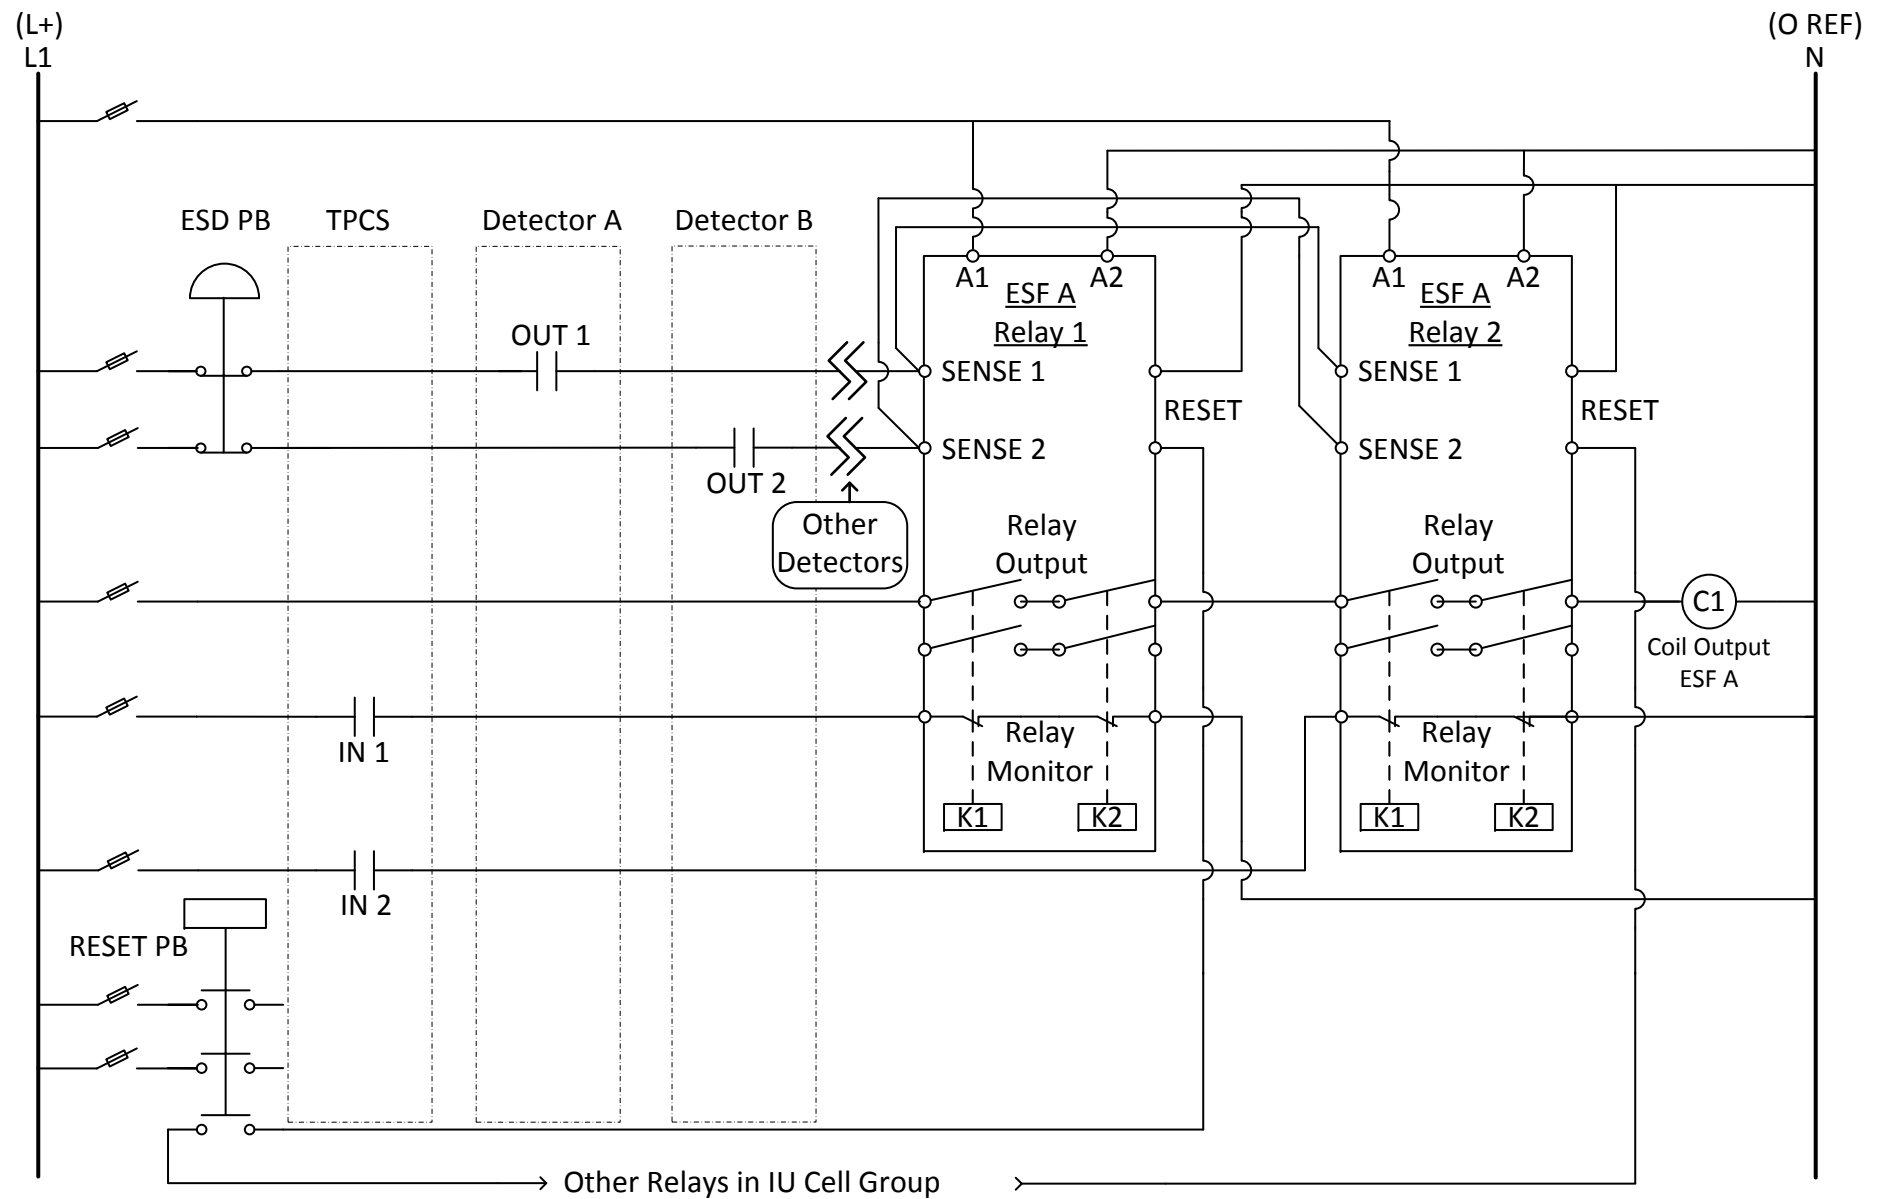


Figure 7a2.5-2 – Example ESFAS Panel

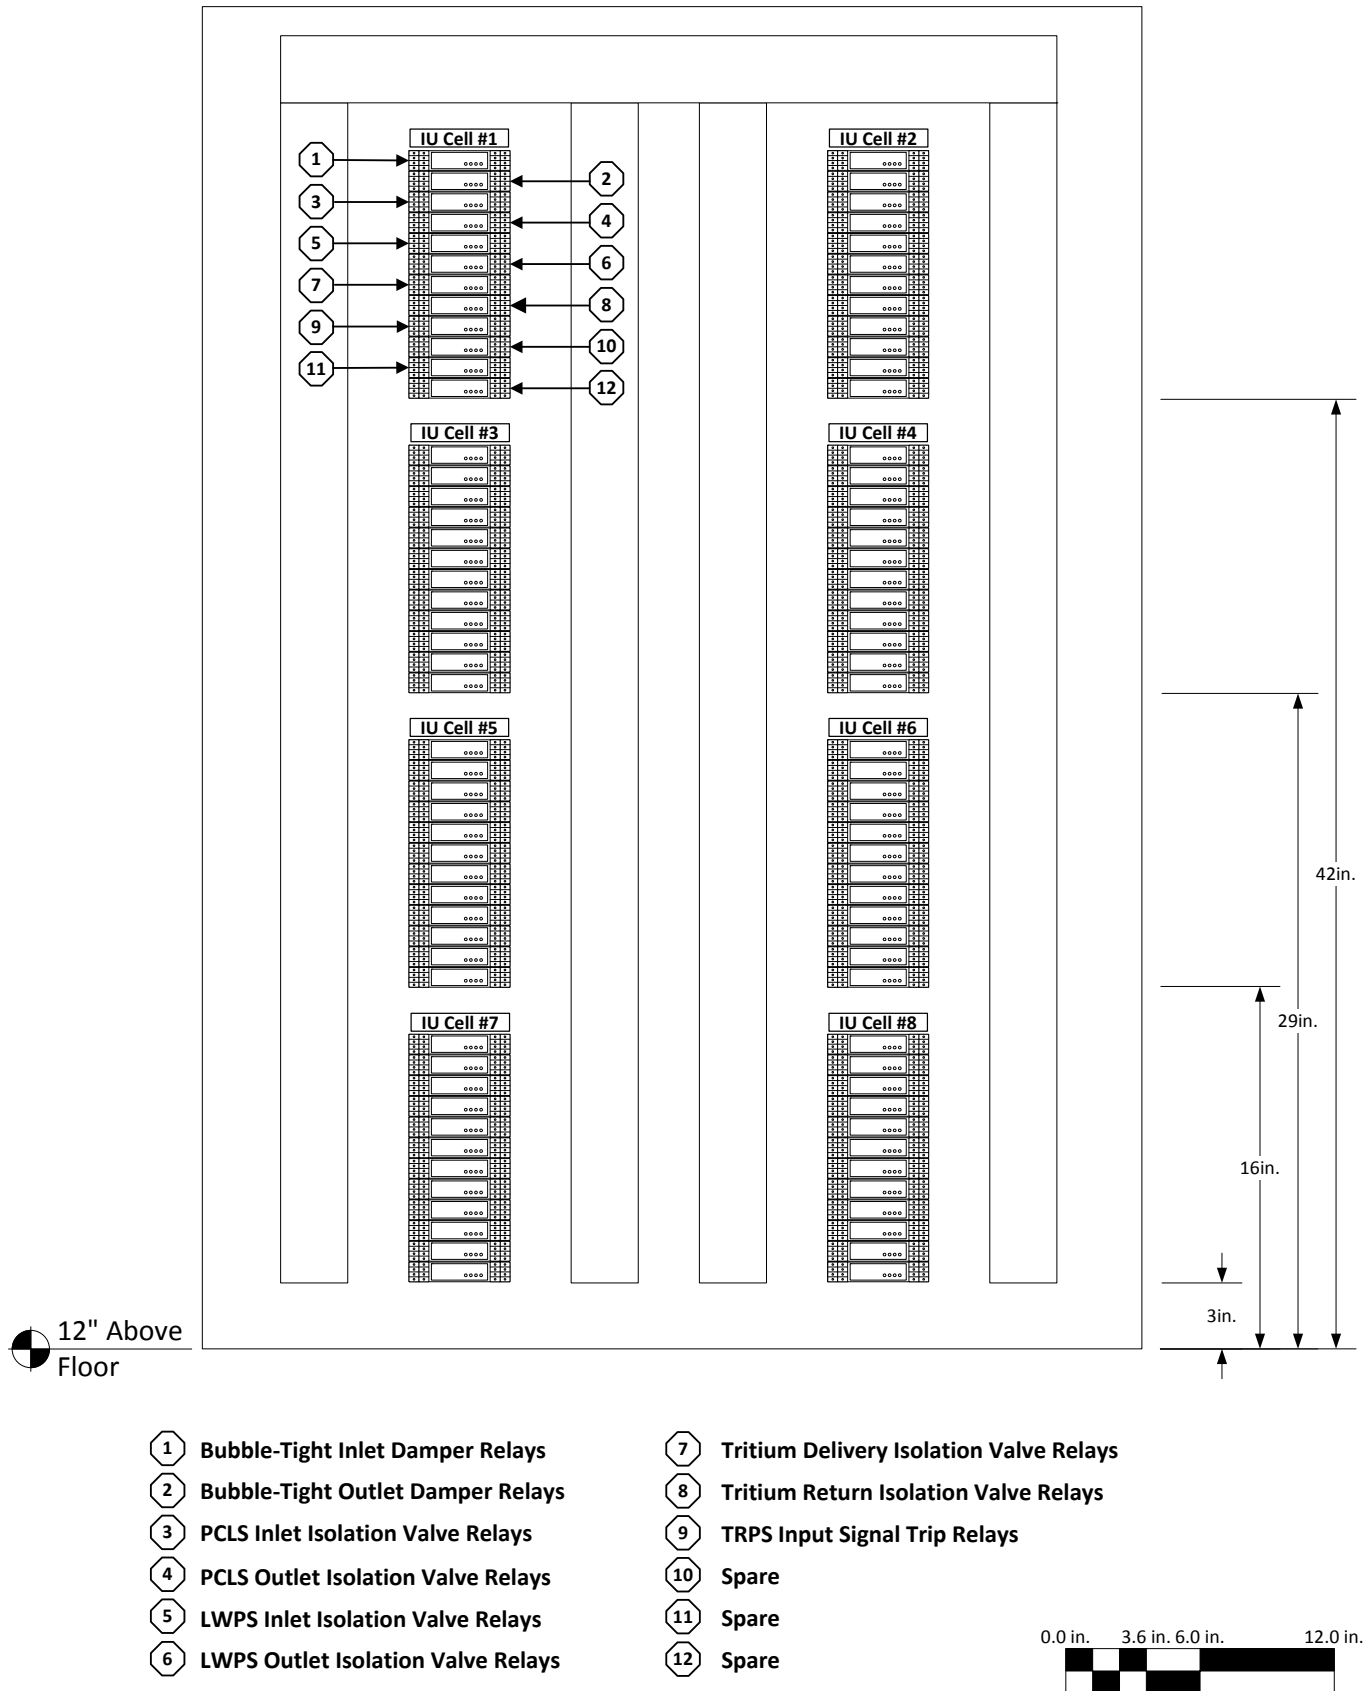


Figure 7a2.5-3 – ESFAS Manual Operator Panel

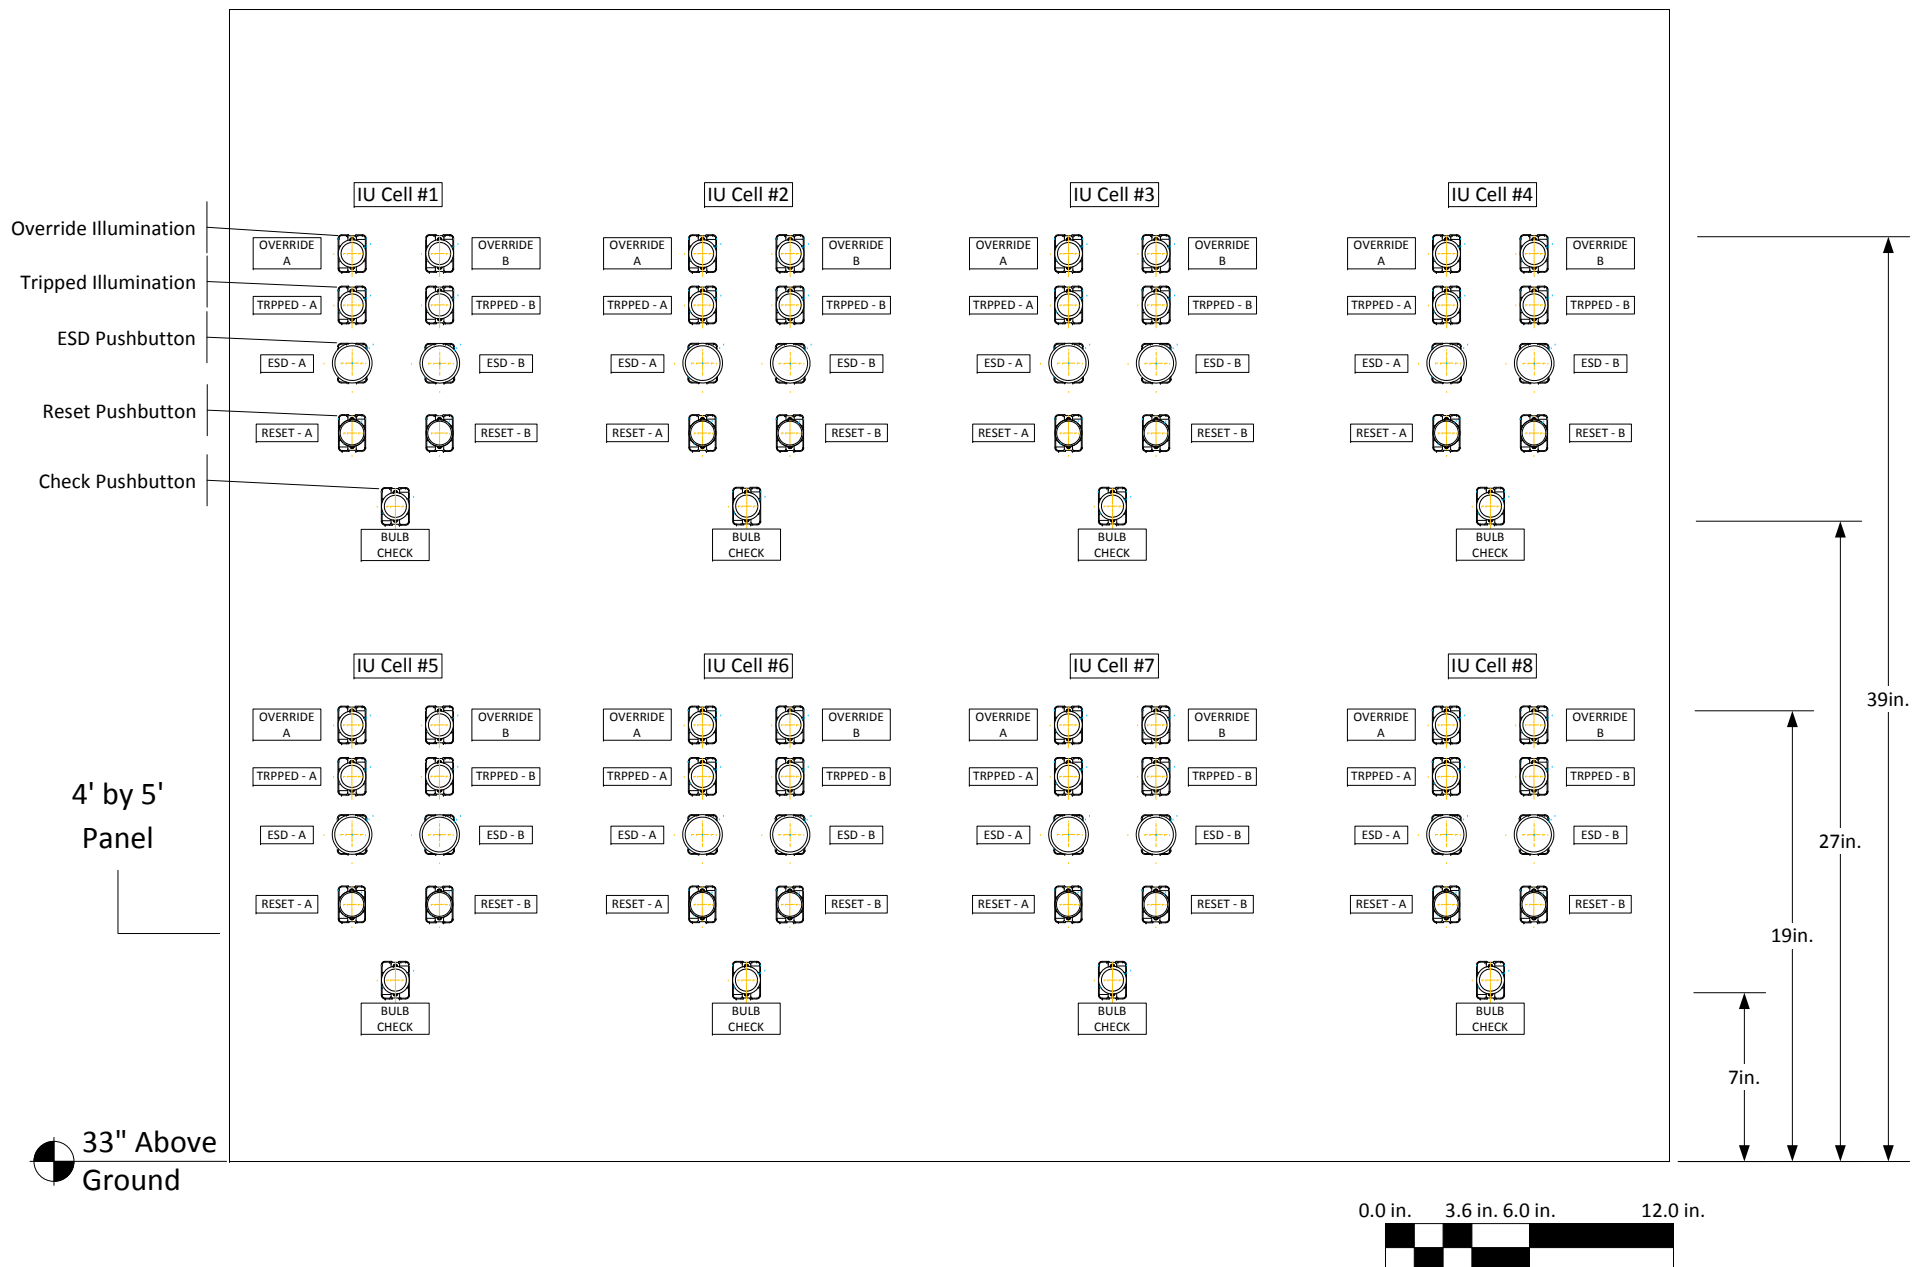


Figure 7a2.6-1 – Irradiation Facility Workstation Layout

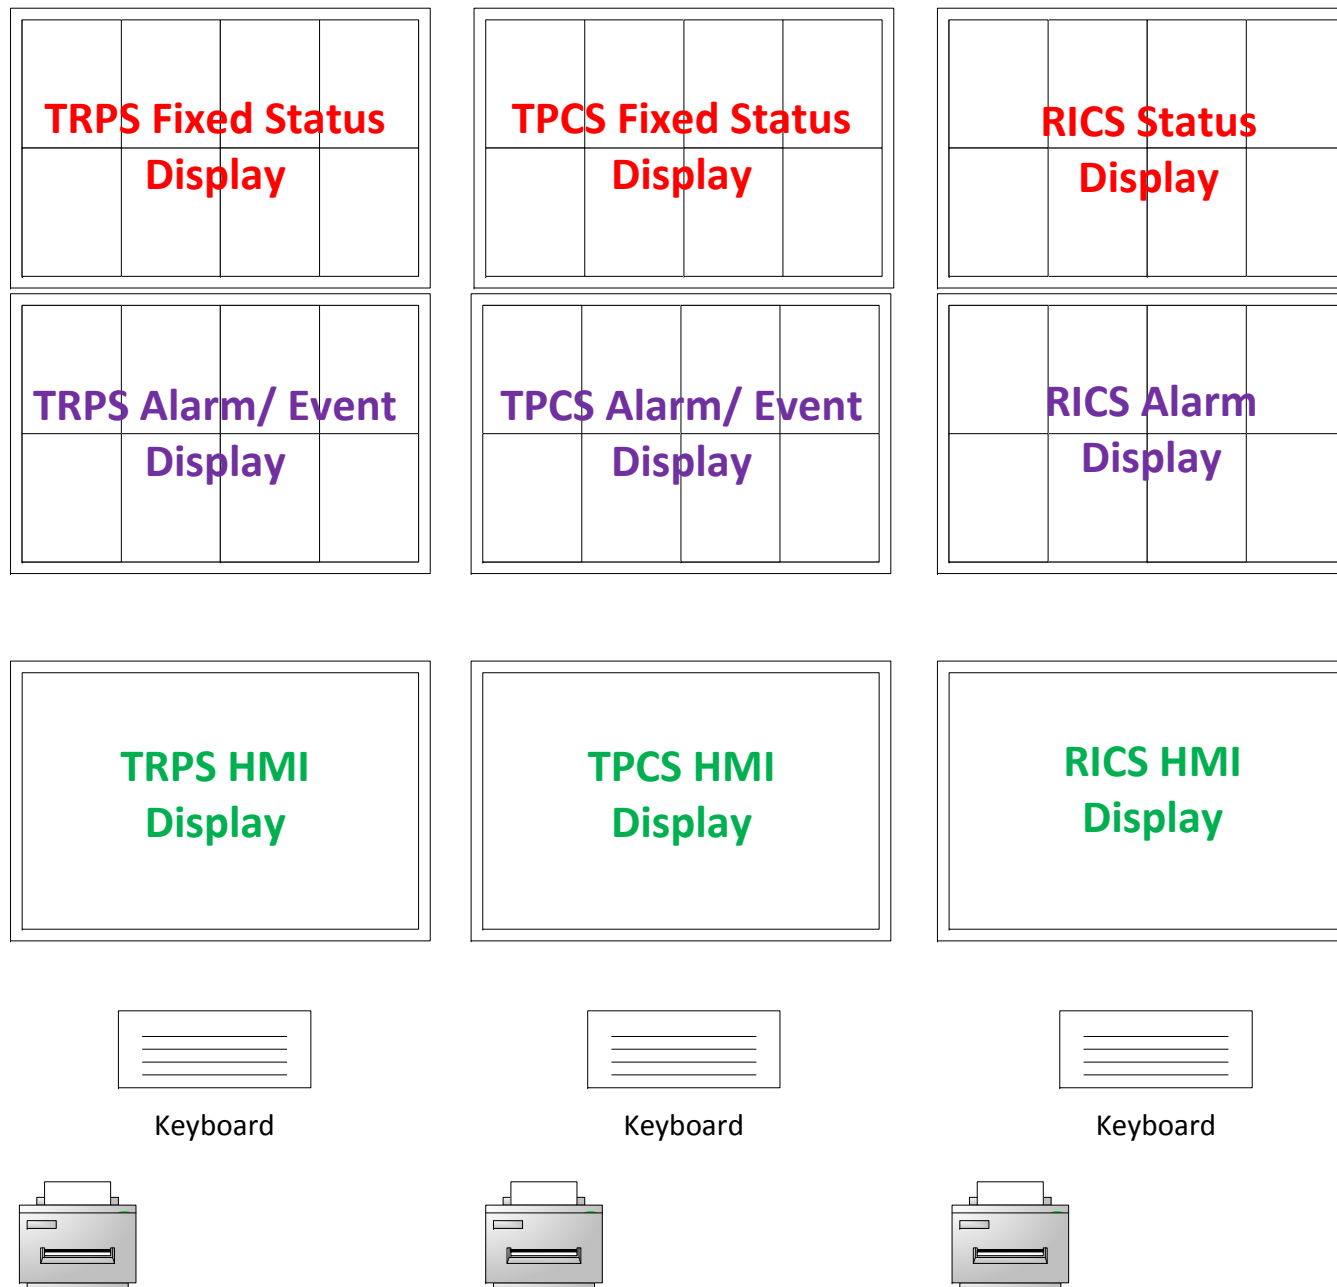


Figure 7a2.6-2 – Control Room Layout

Security-Related Information – Withhold under 10 CFR 2.390