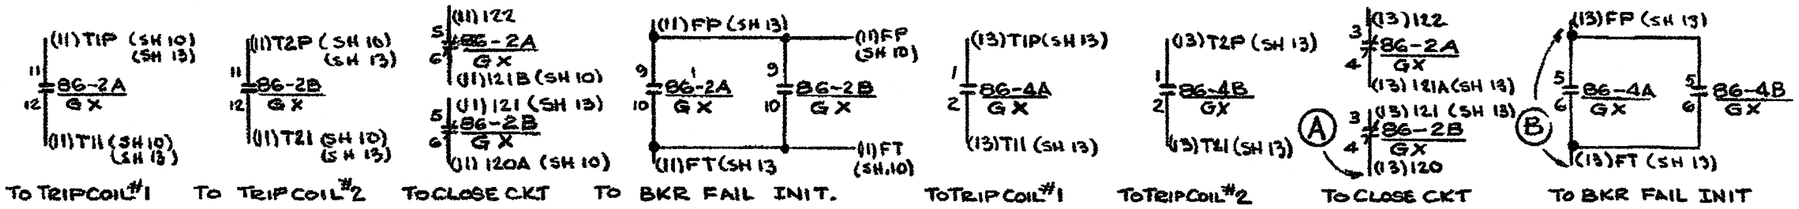

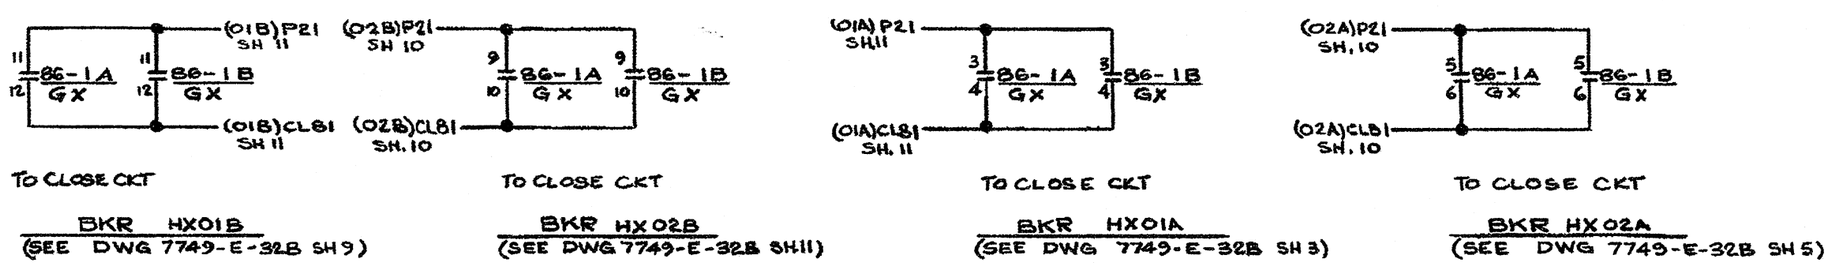

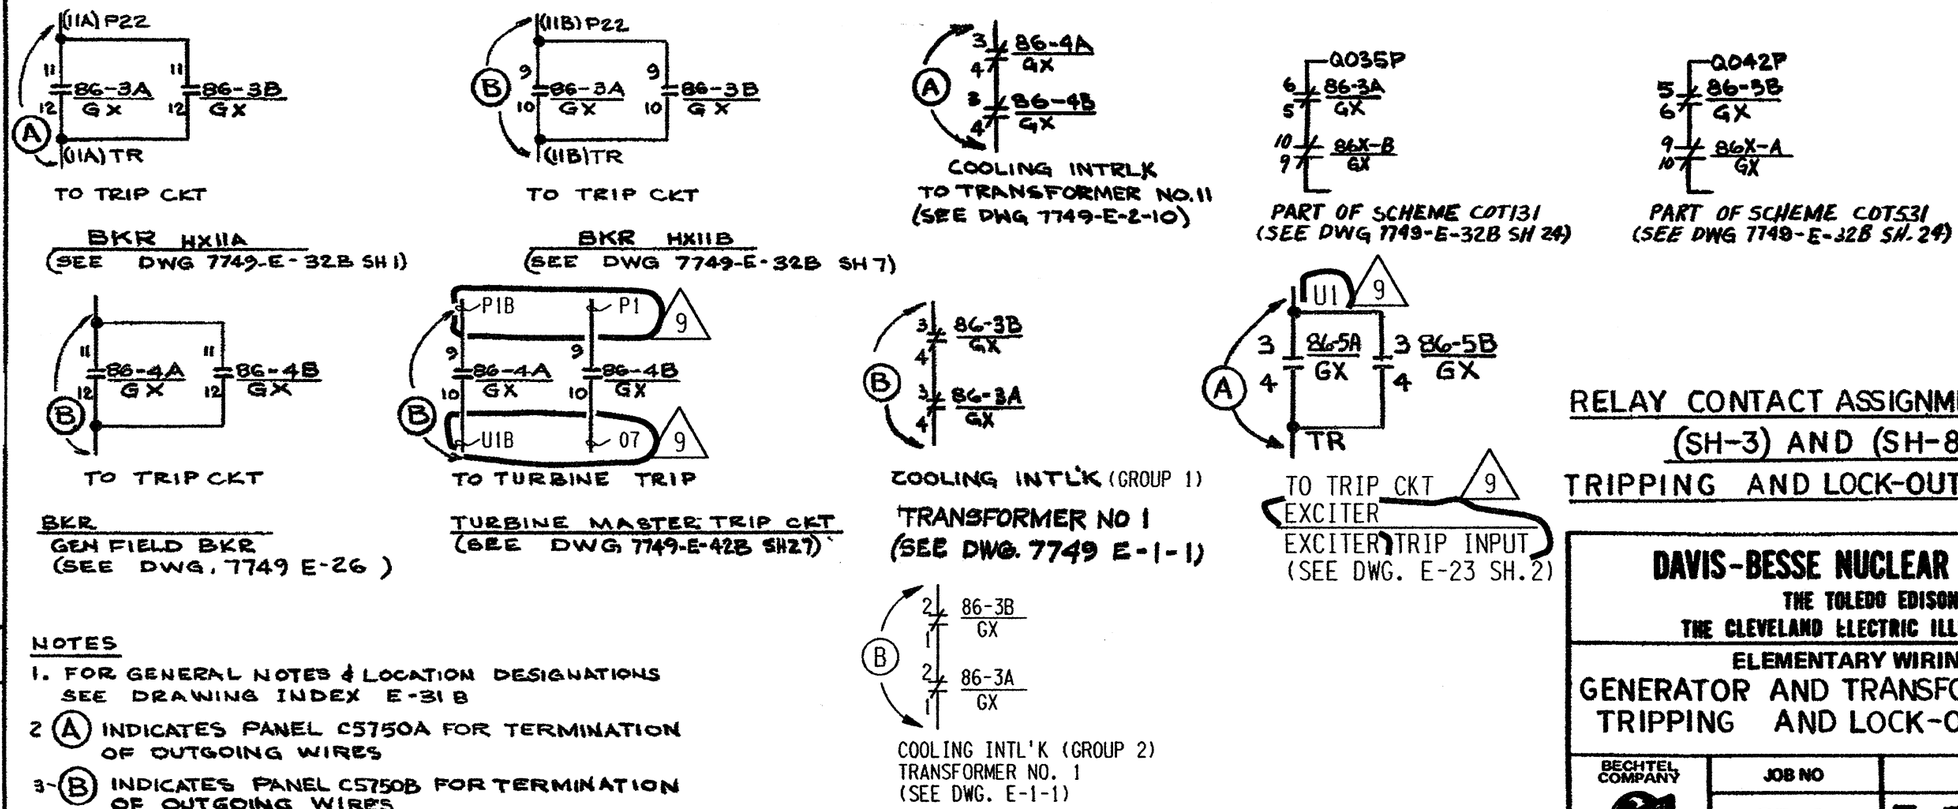

NOTES

1. FOR GENERAL NOTES & LOCATION DESIGNATIONS SEE DRAWING INDEX E-31B
2. (A) INDICATES PANEL C5750A FOR TERMINATION OF OUTGOING WIRES
3. (B) INDICATES PANEL C5750B FOR TERMINATION OF OUTGOING WIRES

RELAY CONTACT ASSIGNMENTS FOR (SH-3) AND (SH-8) TRIPPING AND LOCK-OUT RELAY CKTS

DAVIS-BESSE NUCLEAR POWER STATION
THE TOLEDO EDISON COMPANY
THE CLEVELAND ELECTRIC ILLUMINATING COMPANY

ELEMENTARY WIRING DIAGRAMS
GENERATOR AND TRANSFORMER PROTECTION TRIPPING AND LOCK-OUT RELAY CKTS

BECHTEL COMPANY	JOB NO	DRAWING NO	REV
	7749	E-31B SH-12	9

THIS DRAWING HAS BEEN REDRAWN/SCANNED ON CAD AND SUPERSEDES REV.7.

DB 06-09-14

DFN=F/SCHEME/E31BSH12.DGN/TIF

REV	DESCRIPTION	DATE	DR	CHK	SUPV	CHIEF	PROJ	OWNER	OWNER
9	INC. DUN 05-0140-004-185 REV.01 & 12-0134-001-003 REV.00	6/11/97	SBW						
8	INC. DUN 05-0255-001-008 REV.00 & GEN. UPDATE DO NOT INCLUDE "7749" TO ADDED INFOR. PER GEN. DRFTG. PRACTICE. (REDRAWN)	5-7-12	CW	INITIALS ON FILE					
3	REVISED AS NOTED & ISSUED FOR CONSTRUCTION	12.19.74	CW						

G 231 D