


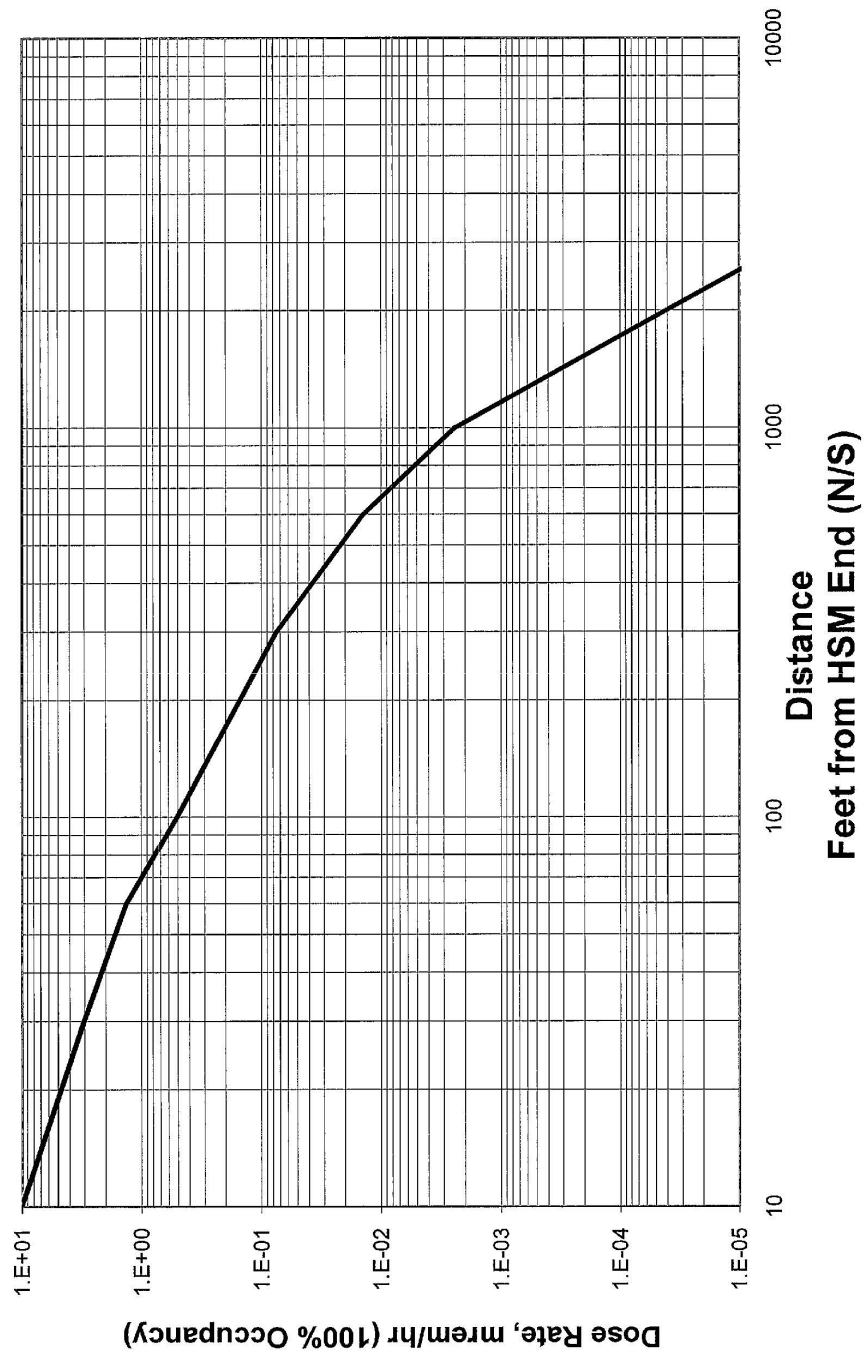

Calvert Cliffs Nuclear
Power Plant, Independent
Spent Fuel Storage
Installation

DOSE RATES VS N-S DISTANCE FROM HSM
(HSM FRONTS)
[REFERENCE 7.23]

USAR
Figure 7.4-2
Revision 20