

CATEGORY 1

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9807210341 DOC. DATE: 98/07/14 NOTARIZED: NO DOCKET #
FACIL: 50-269 Oconee Nuclear Station, Unit 1, Duke Power Co. 05000269
50-270 Oconee Nuclear Station, Unit 2, Duke Power Co. 05000270
50-287 Oconee Nuclear Station, Unit 3, Duke Power Co. 05000287

AUTH. NAME AUTHOR AFFILIATION
MCCOLLUM, W.R. Duke Power Co.
RECIP. NAME RECIPIENT AFFILIATION
 Records Management Branch (Document Control Desk)

SUBJECT: Forwards replacement pages for HPI reliability rept Pages
5-56 & 5-57, which was forwarded to NRC on 971218.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 5
TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD2-2 LA LABARGE, D	1 1 1 1	PD2-2 PD	1 1
INTERNAL:	ACRS	1 1	<u>FILE CENTER 01</u>	1 1
	NRR/DE/ECGB/A	1 1	NRR/DE/EMCB	1 1
	NRR/DRCH/HICB	1 1	NRR/DSSA/SPLB	1 1
	NRR/DSSA/SRXB	1 1	NUDOCS-ABSTRACT	1 1
	OGC/HDS2	1 0		
EXTERNAL:	NOAC	1 1	NRC PDR	1 1

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTTR 14 ENCL 13

C
A
T
E
G
O
R
Y

1

D
O
C
U
M
E
N
T



Duke Power Company
A Duke Energy Company

Oconee Nuclear Site
P.O. Box 1439
Seneca, SC 29679

W. R. McCollum, Jr.
Vice President

(864) 885-3107 OFFICE
(864) 885-3564 FAX

July 14, 1998

U. S. Nuclear Regulatory Commission
Attention: Document Control Desk
Washington, DC 20555

Subject: Oconee Nuclear Station
Docket Nos. 50-269, -270, -287
High Pressure Injection (HPI) Reliability Study

Attached are replacement pages for HPI Reliability Report pages 5-56 and 5-57 (pages 2 of 3 and 3 of 3 of Figure 5.3-1) which was forwarded to you on December 18, 1997. During the printing process, plots from Figures 5.3-2 were inadvertently used in Figure 5.3-1 also.

Please replace pages 5-56 and 5-57 in your copy of the report. We apologize for this inconvenience.

Very truly yours,

W. R. McCollum, Jr. for WRM
W. R. McCollum, Jr.
Site Vice President

Attachment

cc: L. A. Reyes, Regional Administrator
Region II

M. A. Scott, Senior Resident Inspector
Oconee Nuclear Site

D. E. LaBarge, Project Manager
NRR

R. H. Bernhard, Region II

W. G. Rogers, Region II

9807210341 980714
PDR ADDCK 05000269
P PDR

1/1
ADD 1

Uncertainty Analysis Summary

Input Options

Filename	: C:\CAFTA\HP\HCH15.CUT
Module Name	: HCH15INJ
Sample Size	: 5000
Seed	: 2511632
Point Estimate	: 3.57E-03
Number of Modules	: 1
Total Cutsets In All Modules	: 275
Number of Basic Events	: 123
Number of Type Codes	: 18
Inputs Missing Distribution	: 9

Moments

(With 95% Confidence)

	Low	Estimate	High
Mean	3.40E-03	3.50E-03	3.61E-03
Standard Deviation	3.83E-03	3.76E-03	3.69E-03
Skewness	-	9.30E+00	-
Kurtosis	-	1.51E+02	-

Percentiles

(With 95% Confidence)

	Low	Estimate	High
Minimum	-	5.08E-04	-
2.5	1.06E-03	1.09E-03	1.11E-03
5.0	1.20E-03	1.23E-03	1.26E-03
10.0	1.39E-03	1.41E-03	1.43E-03
20.0	1.68E-03	1.71E-03	1.74E-03
25.0	1.81E-03	1.84E-03	1.88E-03
30.0	1.95E-03	1.98E-03	2.02E-03
40.0	2.24E-03	2.28E-03	2.31E-03
50.0	2.55E-03	2.60E-03	2.66E-03
60.0	2.94E-03	3.00E-03	3.06E-03
70.0	3.47E-03	3.56E-03	3.65E-03
75.0	3.83E-03	3.93E-03	4.03E-03
80.0	4.25E-03	4.36E-03	4.47E-03
90.0	5.88E-03	6.10E-03	6.37E-03
95.0	7.99E-03	8.30E-03	8.74E-03
97.5	1.04E-02	1.15E-02	1.26E-02
Maximum	-	9.43E-02	-

Figure 5.3-1 Uncertainty Analysis Summary For DBA LOCA, Injection Mode

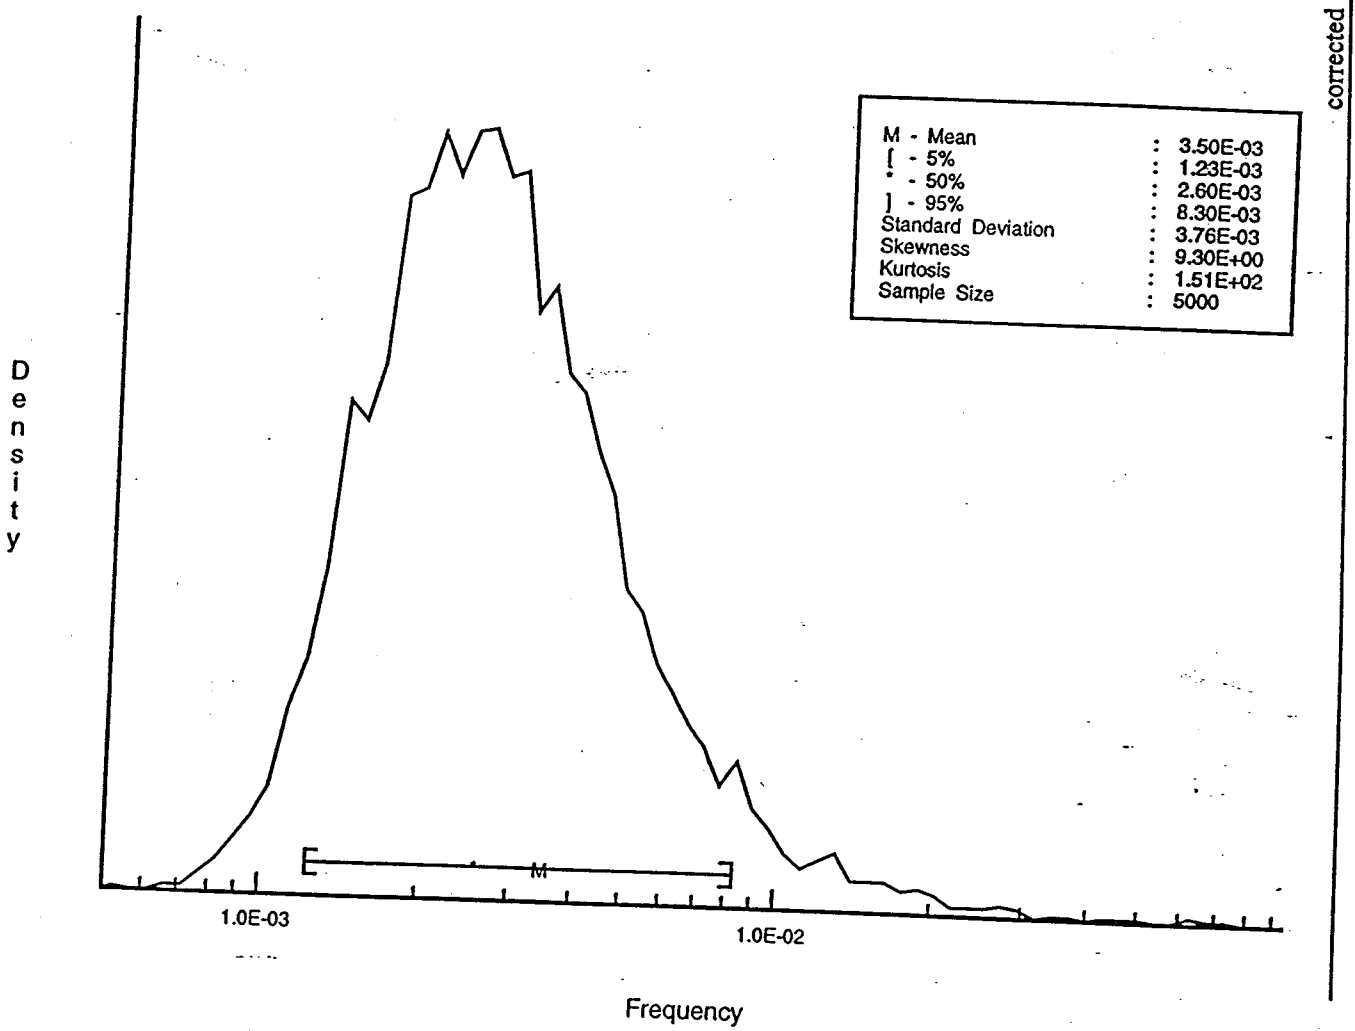


Figure 5.3-1 Uncertainty Analysis Summary For DBA LOCA, Injection Mode

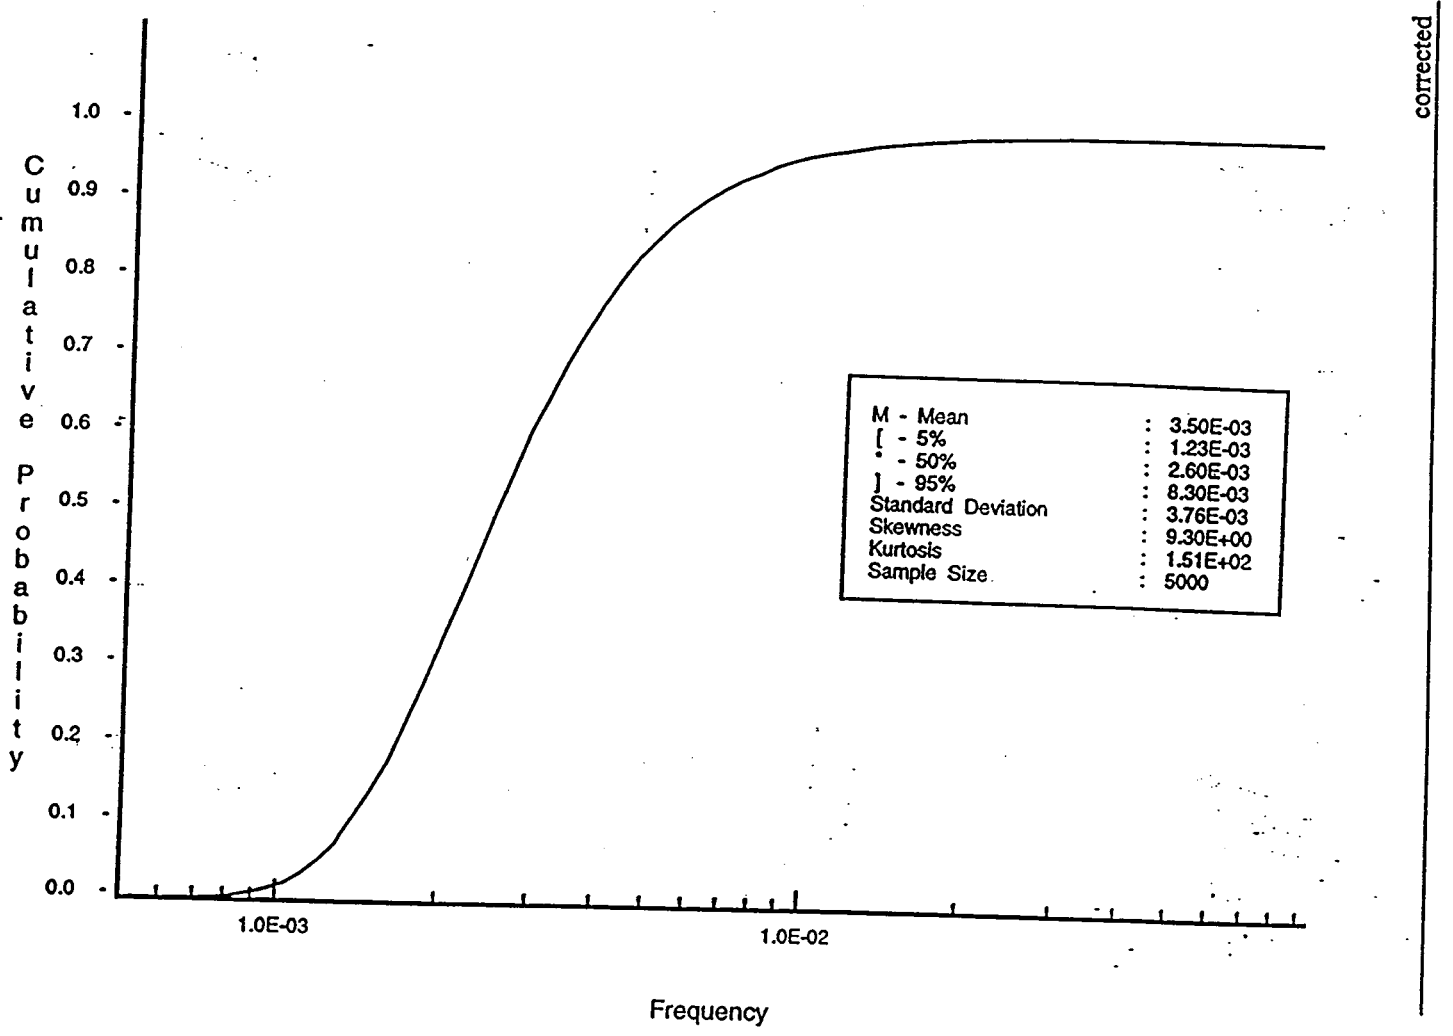


Figure 5.3-1 Uncertainty Analysis Summary For DBA LOCA, Injection Mode

Uncertainty Analysis Summary

Input Options

Filename	: C:\CAFTA\HPI\HR.CUT
Module Name	: HPR001
Sample Size	: 5000
Seed	: 2548465
Point Estimate	: 1.12E-02
Number of Modules	: 1
Total Cutsets In All Modules	: 58
Number of Basic Events	: 44
Number of Type Codes	: 9
Inputs Missing Distribution	: 3

Moments

(With 95% Confidence)

	Low	Estimate	High
Mean	1.08E-02	1.12E-02	1.16E-02
Standard Deviation	1.37E-02	1.35E-02	1.32E-02
Skewness	-	7.98E+00	-
Kurtosis	-	1.46E+02	-

Percentiles

(With 95% Confidence)

	Low	Estimate	High
Minimum	-	3.69E-04	-
2.5	1.41E-03	1.50E-03	1.58E-03
5.0	1.84E-03	1.97E-03	2.05E-03
10.0	2.46E-03	2.55E-03	2.67E-03
20.0	3.57E-03	3.69E-03	3.81E-03
25.0	4.08E-03	4.19E-03	4.34E-03
30.0	4.61E-03	4.72E-03	4.88E-03
40.0	5.83E-03	5.99E-03	6.22E-03
50.0	7.29E-03	7.57E-03	7.78E-03
60.0	9.08E-03	9.32E-03	9.60E-03
70.0	1.13E-02	1.17E-02	1.21E-02
75.0	1.28E-02	1.32E-02	1.38E-02
80.0	1.51E-02	1.56E-02	1.63E-02
90.0	2.20E-02	2.28E-02	2.37E-02
95.0	3.11E-02	3.28E-02	3.49E-02
97.5	4.19E-02	4.43E-02	4.97E-02
Maximum	-	3.42E-01	-

Figure 5.3-2 Uncertainty Analysis Summary For DBA LOCA, Recirculation Mode