

EPRI/NRC-RES
Fire PRA Methodology for Nuclear
Power Facilities
Volume 2: Detailed Methodology

Electric Power Research Institute
3420 Hillview Avenue
Palo Alto, CA 94303

U.S. Nuclear Regulatory Commission
Office of Nuclear Regulatory Research
Washington, DC 20555-0001



AVAILABILITY OF REFERENCE MATERIALS IN NRC PUBLICATIONS

NRC Reference Material

As of November 1999, you may electronically access NUREG-series publications and other NRC records at NRC's Public Electronic Reading Room at <http://www.nrc.gov/reading-rm.html>. Publicly released records include, to name a few, NUREG-series publications; *Federal Register* notices; applicant, licensee, and vendor documents and correspondence; NRC correspondence and internal memoranda; bulletins and information notices; inspection and investigative reports; licensee event reports; and Commission papers and their attachments.

NRC publications in the NUREG series, NRC regulations, and *Title 10, Energy*, in the Code of *Federal Regulations* may also be purchased from one of these two sources.

1. The Superintendent of Documents
U.S. Government Printing Office
Mail Stop SSOP
Washington, DC 20402-0001
Internet: bookstore.gpo.gov
Telephone: 202-512-1800
Fax: 202-512-2250
2. The National Technical Information Service
Springfield, VA 22161-0002
www.ntis.gov
1-800-553-6847 or, locally, 703-605-6000

A single copy of each NRC draft report for comment is available free, to the extent of supply, upon written request as follows:

Address: Office of the Chief Information Officer,
Reproduction and Distribution
Services Section
U.S. Nuclear Regulatory Commission
Washington, DC 20555-0001
E-mail: DISTRIBUTION@nrc.gov
Facsimile: 301-415-2289

Some publications in the NUREG series that are posted at NRC's Web site address <http://www.nrc.gov/reading-rm/doc-collections/nuregs> are updated periodically and may differ from the last printed version. Although references to material found on a Web site bear the date the material was accessed, the material available on the date cited may subsequently be removed from the site.

Non-NRC Reference Material

Documents available from public and special technical libraries include all open literature items, such as books, journal articles, and transactions, *Federal Register* notices, Federal and State legislation, and congressional reports. Such documents as theses, dissertations, foreign reports and translations, and non-NRC conference proceedings may be purchased from their sponsoring organization.

Copies of industry codes and standards used in a substantive manner in the NRC regulatory process are maintained at—

The NRC Technical Library
Two White Flint North
11545 Rockville Pike
Rockville, MD 20852-2738

These standards are available in the library for reference use by the public. Codes and standards are usually copyrighted and may be purchased from the originating organization or, if they are American National Standards, from—

American National Standards Institute
11 West 42nd Street
New York, NY 10036-8002
www.ansi.org
212-642-4900

Legally binding regulatory requirements are stated only in laws; NRC regulations; licenses, including technical specifications; or orders, not in NUREG-series publications. The views expressed in contractor-prepared publications in this series are not necessarily those of the NRC.

The NUREG series comprises (1) technical and administrative reports and books prepared by the staff (NUREG-XXXX) or agency contractors (NUREG/CR-XXXX), (2) proceedings of conferences (NUREG/CP-XXXX), (3) reports resulting from international agreements (NUREG/IA-XXXX), (4) brochures (NUREG/BR-XXXX), and (5) compilations of legal decisions and orders of the Commission and Atomic and Safety Licensing Boards and of Directors' decisions under Section 2.206 of NRC's regulations (NUREG-0750).

DISCLAIMER: This report was prepared as an account of work sponsored by an agency of the U.S. Government. Neither the U.S. Government nor any agency thereof, nor any employee, makes any warranty, expressed or implied, or assumes any legal liability or responsibility for any third party's use, or the results of such use, of any information, apparatus, product, or process disclosed in this publication, or represents that its use by such third party would not infringe privately owned rights.

EPRI/NRC-RES Fire PRA Methodology for Nuclear Power Facilities

Volume 2: Detailed Methodology

EPRI 1011989

NUREG/CR-6850

Final Report

September 2005

Electric Power Research Institute (EPRI)
3420 Hillview Avenue
Palo Alto, CA 94303

Division of Risk Analysis and Applications
Office of Nuclear Regulatory Research (RES)
U.S. Nuclear Regulatory Commission
Two White Flint North, 11545 Rockville Pike
Rockville, MD 20852-2738

EPRI Project Manager
R. P. Kassawara

U.S. NRC-RES Project Manager
J. S. Hyslop

DISCLAIMER OF WARRANTIES AND LIMITATION OF LIABILITIES

THIS DOCUMENT WAS PREPARED BY THE ORGANIZATION(S) NAMED BELOW AS AN ACCOUNT OF WORK SPONSORED OR COSPONSORED BY THE ELECTRIC POWER RESEARCH INSTITUTE, INC. (EPRI). NEITHER EPRI, ANY MEMBER OF EPRI, ANY COSPONSOR, THE ORGANIZATION(S) BELOW, NOR ANY PERSON ACTING ON BEHALF OF ANY OF THEM:

(A) MAKES ANY WARRANTY OR REPRESENTATION WHATSOEVER, EXPRESS OR IMPLIED, (I) WITH RESPECT TO THE USE OF ANY INFORMATION, APPARATUS, METHOD, PROCESS, OR SIMILAR ITEM DISCLOSED IN THIS DOCUMENT, INCLUDING MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE, OR (II) THAT SUCH USE DOES NOT INFRINGE ON OR INTERFERE WITH PRIVATELY OWNED RIGHTS, INCLUDING ANY PARTY'S INTELLECTUAL PROPERTY, OR (III) THAT THIS DOCUMENT IS SUITABLE TO ANY PARTICULAR USER'S CIRCUMSTANCE; OR

(B) ASSUMES RESPONSIBILITY FOR ANY DAMAGES OR OTHER LIABILITY WHATSOEVER (INCLUDING ANY CONSEQUENTIAL DAMAGES, EVEN IF EPRI OR ANY EPRI REPRESENTATIVE HAS BEEN ADVISED OF THE POSSIBILITY OF SUCH DAMAGES) RESULTING FROM YOUR SELECTION OR USE OF THIS DOCUMENT OR ANY INFORMATION, APPARATUS, METHOD, PROCESS, OR SIMILAR ITEM DISCLOSED IN THIS DOCUMENT.

ORGANIZATION(S) THAT PREPARED THIS DOCUMENT

Science Applications International Corporation

Sandia National Laboratories

ORDERING INFORMATION

Requests for copies of this report should be directed to EPRI Orders and Conferences, 1355 Willow Way, Suite 278, Concord, CA 94520, (800) 313-3774, press 2 or internally x5379, (925) 609-9169, (925) 609-1310 (fax).

Electric Power Research Institute and EPRI are registered service marks of the Electric Power Research Institute, Inc. TOGETHER...SHAPING THE FUTURE OF ELECTRICITY is a service mark of the Electric Power Research Institute, Inc.

CITATIONS

This report was prepared by

Science Applications International Corporation (SAIC)
4920 El Camino Real
Los Altos, CA 94022

Technical Program Manager
B. Najafi, SAIC

Technical Area Experts:
F. Joglek, SAIC
D. Funk, Edan Engineering
G. Hannaman, SAIC
R. Anoba, Anoba Consulting

Sandia National Laboratories (SNL)
1515 Eubank SE
Albuquerque, NM 87185

Technical Program Manager
S. P. Nowlen, SNL

Technical Area Experts:
M. Kazarians, Kazarians and Associates
F. Wyant, SNL
A. Kolaczowski, SAIC
J. Forester, SNL

This report describes research sponsored jointly by EPRI, and U.S. Nuclear Regulatory Commission, Office of Nuclear Regulatory Research (RES).

The report is a corporate document that should be cited in the literature in the following manner:

EPRI/NRC-RES Fire PRA Methodology for Nuclear Power Facilities: Volume 2: Detailed Methodology. Electric Power Research Institute (EPRI), Palo Alto, CA, and U.S. Nuclear Regulatory Commission, Office of Nuclear Regulatory Research (RES), Rockville, MD: 2005, EPRI TR-1011989 and NUREG/CR-6850.

ABSTRACT

This report documents state-of-the-art methods, tools, and data for the conduct of a fire Probabilistic Risk Assessment (PRA) for a commercial nuclear power plant (NPP) application. This report is intended to serve the needs of a fire risk analysis team by providing a structured framework for conduct of the overall analysis, as well as specific recommended practices to address each key aspect of the analysis. The methods have been developed under the Fire Risk Requantification Study. This study was conducted as a joint activity between the Electric Power Research Institute (EPRI) and the U.S. Nuclear Regulatory Commission (NRC) Office of Nuclear Regulatory Research (RES) under the terms of an NRC/EPRI Memorandum of Understanding and an accompanying Fire Research Addendum. Participants from the U.S. Nuclear Power Industry supported demonstration analyses and provided peer review of this methodology. Methodological issues raised in past fire risk analyses, including the Individual Plant Examination of External Events (IPEEE) fire analyses, have been addressed to the extent allowed by the current state-of-the-art and the overall project scope. While the primary objective of the project was to consolidate existing state-of-the-art methods, in many areas, the newly documented methods represent a significant advancement over previously documented methods.

CONTENTS

1 PLANT BOUNDARY DEFINITION AND PARTITIONING (TASK 1)	1-1
1.1 Purpose	1-1
1.2 Scope	1-1
1.3 Background Information	1-1
1.3.1 General Task Objectives and Approach	1-1
1.3.2 Assumptions	1-3
1.4 Task Interfaces	1-3
1.4.1 Input from Other Tasks	1-3
1.4.2 Additional Plant Information Needed to Support this Task	1-3
1.4.3 Walkdowns	1-3
1.4.4 Outputs to Other Tasks	1-3
1.5 Procedure	1-4
1.5.1 Step 1: Selection of Global Plant Analysis Boundary	1-4
1.5.2 Step 2: Plant Partitioning	1-4
1.5.3 Step 3: Compartment Information Gathering and Characterization	1-9
1.5.4 Step 4: Documentation	1-9
2 FIRE PRA COMPONENTS SELECTION (TASK 2)	2-1
2.1 Purpose	2-1
2.2 Scope	2-1
2.3 Background Information	2-3
2.3.1 General Task Objectives and Approach	2-3
2.3.2 Assumptions	2-4
2.4 Task Interfaces	2-5
2.4.1 Input from Other Tasks	2-5
2.4.2 Additional Plant Information Needed to Support this Task	2-5
2.4.3 Walkdowns	2-6
2.4.4 Outputs to Other Tasks	2-6

2.5 Procedure.....	2-6
2.5.1 Step 1: Identify Internal Events PRA Sequences to be Included (and those to be excluded) in the Fire PRA Model.....	2-6
2.5.2 Step 2: Review the Internal Events PRA Model Against the Fire Safe Shutdown Analysis	2-10
2.5.2.1 Step 2.1: Reconcile Function/Success Criteria/Sequence Differences	2-12
2.5.2.2 Step 2.2: Reconcile System (Including Support System) Differences	2-13
2.5.2.3 Step 2.3: Reconcile System/Equipment Differences Due to End-State and Mission Considerations.....	2-13
2.5.2.4 Step 2.4: Reconcile Other Miscellaneous Equipment Differences.....	2-14
2.5.2.5 Step 2.5: Specific Review of Manual Actions.....	2-15
2.5.3 Step 3: Identify Fire-Induced Initiating Events Based on Equipment Affected	2-16
2.5.4 Step 4: Identify Equipment with Potential Spurious Actuations that may Challenge the Safe Shutdown Capability	2-17
2.5.5 Step 5: Identify Additional Mitigating, Instrumentation, and Diagnostic Equipment Important to Human Response	2-21
2.5.5.1 Step 5.1: Identify Human Actions of Interest.....	2-21
2.5.5.2 Step 5.2: Identify Instrumentation and Diagnostic Equipment Associated with both Credited and Potentially Harmful Human Actions	2-21
2.5.6 Step 6: Include “Potentially High Consequence” Related Equipment.....	2-24
2.5.7 Step 7: Assemble Fire PRA Component List.....	2-24
2.6 References	2-26
3 FIRE PRA CABLE SELECTION (TASK 3)	3-1
3.1 Purpose	3-1
3.2 Scope	3-1
3.3 Background Information	3-2
3.3.1 General Task Objectives and Approach.....	3-2
3.3.2 Assumptions.....	3-4
3.4 Task Interfaces.....	3-4
3.4.1 Input from Other Tasks.....	3-4
3.4.1.1 Plant Boundary Definition and Partitioning (Task 1)	3-4
3.4.1.2 Fire PRA Components Selection (Task 2).....	3-4
3.4.1.3 Fire PRA Database System (Support Task B).....	3-5
3.4.2 Additional Plant Information Needed to Support this Task	3-5
3.4.2.1 Plant Cable and Raceway Data System	3-5
3.4.2.2 Plant Appendix R Safe Shutdown Analysis	3-5

3.4.2.3 Other Information and Data	3-5
3.4.3 Walkdowns	3-6
3.4.4 Outputs to Other Tasks	3-6
3.5 Procedure.....	3-6
3.5.1 Step 1: Compile and Evaluate Prerequisite Information and Data	3-7
3.5.1.1 Step 1.1: Confirm Plant Partitioning Boundary Designations.....	3-7
3.5.1.2 Step 1.2: Confirm Fire PRA Equipment List.....	3-7
3.5.1.3 Step 1.3: Cable and Raceway System	3-8
3.5.2 Step 2: Select Fire PRA Circuits/Cables	3-9
3.5.2.1 Step 2.1: Develop a Strategy for Conducting Cable Selection	3-9
3.5.2.2 Step 2.2: Develop Plant-Specific Rules for Cable Selection.....	3-11
3.5.2.3 Step 2.3: Select Fire PRA Cables.....	3-14
3.5.3 Step 3: Identify and Select Fire PRA Power Supplies	3-16
3.5.3.1 Step 3.1: Select Fire PRA Power Supplies	3-16
3.5.3.2 Step 3.2: Add Fire PRA Power Supply to Equipment List.....	3-16
3.5.4 Step 4: Perform Associated Circuits Review	3-16
3.5.4.1 Step 4.1: Confirm Satisfactory Electrical Coordination for Fire PRA Power Supplies.....	3-17
3.5.4.2 Step 4.2: Confirm Satisfactory Electrical Overcurrent Protection for Common Enclosures Issues	3-18
3.5.4.3 Step 4.3: Add Associated Circuits to Fire PRA Cable List.....	3-19
3.5.5 Step 5: Determine Cable Routing and Plant Locations	3-19
3.5.5.1 Step 5.1: Determine Cable Routing and End Points.....	3-19
3.5.5.2 Step 5.2: Determine Raceway and End Point Locations	3-20
3.5.5.3 Step 5.3: Determine Raceway Fire Protection Features.....	3-20
3.5.6 Step 6: Fire PRA Cable List and Target Equipment Location Reports.....	3-20
3.5.6.1 Step 6.1: Assemble Fire PRA Cable List	3-21
3.5.6.2 Step 6.2: Generate Target Equipment Location Reports.....	3-21
4 QUALITATIVE SCREENING (TASK 4)	4-1
4.1 Purpose	4-1
4.2 Scope	4-1
4.3 Background Information	4-1
4.3.1 General Task Objectives and Approach.....	4-1
4.3.2 Assumptions.....	4-1

4.4 Task Interfaces.....	4-2
4.4.1 Input from Other Tasks.....	4-2
4.4.2 Additional Plant Information to Support this Task.....	4-2
4.4.3 Walkdowns	4-2
4.4.4 Outputs to Other Tasks	4-2
4.5 Procedure.....	4-2
4.6 References.....	4-3
5 FIRE-INDUCED RISK MODEL (TASK 5)	5-1
5.1 Purpose.....	5-1
5.2 Scope	5-1
5.3 Background Information	5-1
5.3.1 General Task Objectives and Approach.....	5-1
5.3.2 Assumptions	5-2
5.4 Task Interfaces.....	5-3
5.4.1 Input From Other Tasks.....	5-3
5.4.2 Additional Plant Information Needed to Support this Task	5-3
5.4.3 Walkdowns	5-3
5.4.4 Outputs to Other Tasks	5-3
5.5 Procedure.....	5-3
5.5.1 Step 1: Develop CDF/CCDP Model.....	5-4
5.5.1.1 Step 1.1: Select Appropriate Fire-Induced Initiating Events and Sequences and Verify against the Component List and Failure Modes	5-5
5.5.1.2 Step 1.2: Incorporate Fire-Induced Equipment Failures	5-7
5.5.1.3 Step1.3: Incorporate Fire-Induced Human Failures.....	5-9
5.5.2 Step 2: Develop LERF/CLERP Model	5-9
5.5.2.1 Step 2.1: Select Appropriate Fire-Induced Initiating Events and Sequences and Verify against the Component List and Failure Modes	5-11
5.5.2.2 Step 2.2: Incorporate Fire-Induced Equipment Failures	5-11
5.5.2.3 Step 2.3: Incorporate Fire-Induced Human Failures.....	5-11
6 FIRE IGNITION FREQUENCIES (TASK 6).....	6-1
6.1 Purpose.....	6-1
6.2 Scope	6-1
6.3 Background Information	6-1
6.3.1 General Task Objectives and Approach.....	6-1

6.3.2 Assumptions	6-6
6.4 Task Interfaces.....	6-6
6.4.1 Input from Other Tasks.....	6-6
6.4.2 Additional Plant Information Needed to Support this Task	6-7
6.4.3 Walkdowns	6-7
6.4.4 Outputs to Other Tasks	6-7
6.5 Procedure.....	6-7
6.5.1 Step 1: Mapping Plant Ignition Sources to Generic Sources.....	6-7
6.5.2 Step 2: Plant Fire Event Data Collection and Review	6-8
6.5.3 Step 3: Plant Specific Updates of Generic Ignition Frequencies	6-10
6.5.4 Step 4: Mapping Plant-Specific Locations to Generic Locations	6-11
6.5.5 Step 5: Location Weighting Factors.....	6-13
6.5.6 Step 6: Fixed Fire Ignition Source Counts.....	6-14
6.5.7 Step 7: Ignition Source Weighting Factors	6-20
6.5.7.1 Countable Items.....	6-20
6.5.7.2 Transients	6-20
6.5.7.3 Large Systems	6-25
6.5.8 Step 8: Ignition Source and Compartment Fire Frequency	6-25
6.6 References.....	6-26
7 QUANTITATIVE SCREENING (TASK 7).....	7-1
7.1 Purpose.....	7-1
7.2 Scope	7-1
7.3 Background Information	7-1
7.3.1 General Task Objectives and Approach.....	7-1
7.3.2 Assumptions.....	7-3
7.4 Task Interfaces.....	7-3
7.4.1 Input From Other Tasks.....	7-3
7.4.2 Additional Plant Information Needed to Support this Task	7-3
7.4.3 Walkdowns	7-4
7.4.4 Outputs to Other Tasks	7-4
7.5 Procedure.....	7-4
7.5.1 Step 1: Quantify CDF Model.....	7-6
7.5.1.1 Step 1.1: Quantify CCDP Model	7-6
7.5.1.2 Step 1.2: Quantify CDFs.....	7-6

7.5.1.3 Step 1.3: Quantify ICDP Values (Optional).....	7-7
7.5.2 Step 2: Quantify LERF Model.....	7-7
7.5.2.1 Step 2.1: Quantify CLERP Model	7-7
7.5.2.2 Step 2.2: Quantify LERFs	7-7
7.5.2.3 Step 2.3: Quantify ILERP Values (Optional).....	7-8
7.5.3 Step 3: Quantitative Screening.....	7-8
7.6 References.....	7-9
8 SCOPING FIRE MODELING (TASK 8).....	8-1
8.1 Purpose.....	8-1
8.2 Scope.....	8-1
8.3 Background Information.....	8-2
8.3.1 General Task Objectives and Approach.....	8-2
8.3.2 Assumptions.....	8-7
8.4 Task Interfaces.....	8-7
8.4.1 Input from Other Tasks.....	8-7
8.4.2 Additional Plant Information Needed to Support this Task.....	8-7
8.4.3 Walkdowns.....	8-8
8.4.4 Outputs to Other Tasks.....	8-8
8.5 Procedure.....	8-8
8.5.1 Step 1: Preparation for Walkdown.....	8-9
8.5.1.1 Step 1.1: Estimate Heat Release Rate for Fixed Ignition Source Screening.....	8-9
8.5.1.2 Step 1.2: Target and Intervening Combustible Damage and Ignition Criteria.....	8-9
8.5.1.3 Step 1.3: Develop Zones of Influence.....	8-10
8.5.2 Step 2: Plant Walkdown.....	8-11
8.5.3 Step 3: Verification of Screened Fixed Ignition Sources.....	8-12
8.5.4 Step 4: Calculation of Severity Factors.....	8-13
8.5.5 Step 5: Calculation of Revised Compartment Fire Frequency.....	8-13
8.6 References.....	8-14
9 DETAILED CIRCUIT FAILURE ANALYSIS (TASK 9)	9-1
9.1 Purpose.....	9-1
9.2 Scope.....	9-1
9.3 Background Information.....	9-2

9.3.1 General Task Objectives and Approach	9-2
9.3.2 Assumptions	9-3
9.4 Task Interfaces.....	9-4
9.4.1 Input from Other Tasks.....	9-4
9.4.1.1 Fire PRA Components Selection (Task 2)	9-4
9.4.1.2 Fire PRA Cable Selection (Task 3)	9-4
9.4.1.3 Fire PRA Database System (Support Task B).....	9-4
9.4.1.4 Quantitative Screening (Task 7)	9-4
9.4.1.5 Detailed Fire Modeling (Task 11).....	9-4
9.4.2 Additional Plant Information Needed to Support this Task	9-5
9.4.2.1 Plant Appendix R Safe Shutdown Circuit Analysis	9-5
9.4.2.2 Other Information and Data	9-5
9.4.3 Walkdowns	9-5
9.4.4 Outputs to Other Tasks	9-5
9.5 Procedure.....	9-5
9.5.1 Step 1: Compile and Evaluate Prerequisite Information and Data	9-6
9.5.1.1 Step 1.1: Confirm Fire PRA Cable List is Available in the Fire PRA Database	9-6
9.5.1.2 Step 1.2: Confirm Unscreened Plant Compartments and Scenarios are Identified	9-6
9.5.2 Step 2: Perform Detailed Circuit/Cable Failure Analysis	9-7
9.5.2.1 Step 2.1: Develop Strategy for Circuit Analysis	9-7
9.5.2.2 Step 2.2: Develop Plant-Specific Rules for Performing Circuit Analysis.....	9-7
9.5.2.3 Step 2.3: Perform Detailed Circuit Failure Analysis	9-12
9.5.3 Step 3: Generate Equipment Failure Response Reports	9-14
9.6 References.....	9-14
10 CIRCUIT FAILURE MODE LIKELIHOOD ANALYSIS (TASK 10).....	10-1
10.1 Purpose	10-1
10.2 Scope	10-1
10.3 Background Information	10-2
10.3.1 General Task Objectives and Approach.....	10-2
10.3.2 Assumptions	10-3
10.4 Task Interfaces.....	10-3
10.4.1 Input from Other Tasks.....	10-3

10.4.1.1 Fire PRA Cable Selection (Task 3).....	10-3
10.4.1.2 Fire PRA Database System (Support Task B).....	10-3
10.4.1.3 Detailed Circuit Failure Analysis (Task 9).....	10-3
10.4.1.4 Detailed Fire Modeling and Quantification of Fire Risk (Tasks 11 and 14).....	10-4
10.4.2 Additional Plant Information Needed to Support this Task	10-4
10.4.3 Walkdowns	10-4
10.4.4 Outputs to Other Tasks	10-4
10.5 Procedure.....	10-5
10.5.1 Step 1: Compile and Evaluate Prerequisite Information and Data	10-5
10.5.2 Step 2: Select Analysis Approach	10-5
10.5.3 Step 3: Perform Circuit Failure Mode Probability Analyses.....	10-6
10.5.3.1 Option #1: Failure Mode Probability Estimate Table.....	10-6
10.5.3.2 Option #2: Computational Probability Estimates.....	10-9
10.5.4 Step 4: Generate Circuit Failure Mode Probability Reports.....	10-11
10.6 References.....	10-11
11 DETAILED FIRE MODELING (TASK 11)	11-1
11.1 Purpose	11-1
11.2 Scope	11-1
11.3 Background Information	11-2
11.3.1 General Task Objectives	11-2
11.3.2 General Approach	11-3
11.3.3 Selecting Fire Ignition Sources.....	11-6
11.3.4 Severity Factor	11-8
11.3.5 Detection and Suppression Analysis.....	11-11
11.3.6 Assumptions	11-12
11.3.7 Additional Supporting Documentation	11-12
11.4 Task Interfaces.....	11-13
11.4.1 Input From Other Tasks.....	11-13
11.4.2 Additional Plant Information Needed to Support this Task	11-13
11.4.3 Walkdowns	11-14
11.4.4 Outputs to Other Tasks	11-14
11.5 Procedure.....	11-14
11.5.1 Single Compartment Fire Scenarios.....	11-15

11.5.1.1 Step 1.a: Identify and Characterize Compartment.....	11-16
11.5.1.2 Step 2.a: Identify and Characterize Fire Detection and Suppression Features and Systems	11-16
11.5.1.3 Step 3.a: Characterize Fire Ignition Sources	11-18
11.5.1.4 Step 4.a: Identify Secondary Combustibles	11-19
11.5.1.5 Step 5.a: Identify and Characterize Target Sets	11-20
11.5.1.6 Step 6.a: Define the Fire Scenarios to be Analyzed	11-21
11.5.1.7 Step 7.a: Conduct Fire Growth and Propagation Analysis:.....	11-22
11.5.1.7.1 Step 7.a.1: Selection of Fire Modeling Tools	11-22
11.5.1.7.2 Step 7.a.2: Analyze Growth Behavior of the Initial Fire Source (If Applicable)	11-24
11.5.1.7.3 Step 7.a.3: Analyze Fire Spread to Secondary Combustibles (As Applicable)	11-24
11.5.1.7.4 Step 7.a.4: Analyze Growth of Fire in Secondary Combustibles (As Applicable).....	11-25
11.5.1.7.5 Step 7.a.5: Estimate the Resulting Adverse Environmental Conditions	11-25
11.5.1.7.6 Step 7.a.6: Estimate Time to Target Set Damage	11-25
11.5.1.8 Step 8.a: Conduct Fire Detection and Suppression Analysis	11-27
11.5.1.8.1 Step 8.a.1: Assess Fire Detection Timing	11-28
11.5.1.8.2 Step 8.a.2: Assess Timing, Reliability, and Effectiveness of Fixed- Fire Suppression Systems	11-28
11.5.1.8.3 Step 8.a.3: Assess Manual Fire Brigade Response.....	11-30
11.5.1.8.4 Step 8.a.4: Estimate Probability of Fire Suppression as a Function of Time	11-30
11.5.1.9 Step 9.a: Calculate Severity Factor	11-31
11.5.1.10 Step 10.a: Calculate Scenario Frequency	11-31
11.5.1.11 Step 11.a: Document Analysis Results.....	11-31
11.5.2 Analysis of Fire Scenarios in the Main Control Room	11-31
11.5.2.1 Step 1.b: Identify and Characterize Main Control Room Features	11-33
11.5.2.2 Step 2.b: Estimate Control Room Fire Frequency	11-33
11.5.2.3 Step 3.b: Identify and Characterize Fire Detection and Suppression Features and Systems	11-34
11.5.2.4 Step 4.b: Characterize Alternate Shutdown Features.....	11-35
11.5.2.5 Step 5.b: Identify and Characterize Target Sets	11-35
11.5.2.6 Step 6.b: Identify and Characterize Ignition Sources.....	11-36
11.5.2.7 Step 7.b: Define Fire Scenarios.....	11-36

11.5.2.8 Step 8.b: Conduct Fire Growth and Propagation Analysis.....	11-37
11.5.2.9 Step 9.b: Detection and Suppression Analysis and Severity Factor.....	11-39
11.5.2.10 Step 10.b: Estimate Failure Probability of Using Alternate Shutdown Features.....	11-39
11.5.2.11 Step 11.b: Estimate Probability of Control Room Abandonment	11-40
11.5.2.12 Step 12.b: Calculate Scenario Frequencies.....	11-41
11.5.2.13 Step 13.b: Document Analysis Results.....	11-41
11.5.3 Analysis of Fire Scenarios Initiated Outside the Main Control Room that May Impact MCR Functions or Habitability	11-42
11.5.4 Analysis of Fire Scenarios Impacting Multiple Compartments.....	11-42
11.5.4.1 Step 1.c: Exposing and Exposed Compartments Matrix.....	11-43
11.5.4.2 Step 2.c: First Screening – Qualitative.....	11-45
11.5.4.3 Step 3.c: Second Screening – Low Fire Load Exposing Compartments ...	11-45
11.5.4.4 Step 4.c: Third Screening – Frequency of Occurrence.....	11-45
11.5.4.5 Step 5.c: Fourth Screening – CDF Based.....	11-46
11.5.4.6 Step 6.c: Detailed Analysis	11-46
11.5.4.7 Step 7.b: Document Analysis Results.....	11-46
11.6 References.....	11-47
12 POST-FIRE HUMAN RELIABILITY ANALYSIS (TASK 12).....	12-1
12.1 Purpose.....	12-1
12.2 Scope.....	12-1
12.3 Background Information	12-2
12.3.1 General Task Objectives and Approach.....	12-2
12.3.2 Assumptions	12-2
12.4 Task Interfaces.....	12-3
12.4.1 Input from Other Tasks.....	12-3
12.4.2 Additional Plant Information Needed to Support this Task	12-4
12.4.3 Walkdowns	12-4
12.4.4 Outputs to Other Tasks	12-5
12.5 Procedure – Preparation of Post-Fire HRA Package.....	12-5
12.5.1 Step 1: Modifying and Adding Human Failure Events to the Model	12-5
12.5.1.1 Review Existing Internal Events HFES.....	12-5
12.5.1.2 Add New HFES	12-5
12.5.1.3 Elements of the Identification Process.....	12-6

12.5.2 Step 2: Assigning Quantitative Screening Human Error Probabilities	12-7
12.5.3 Method for Assigning Screening Values to HFEs (Sets 1, 2, 3, and 4)	12-7
12.5.3.1 Screening Values Under Set 1.....	12-7
12.5.3.2 Set 1 Criteria.....	12-8
12.5.3.3 Screening Values Under Set 2.....	12-9
12.5.3.4 Set 2 Criteria.....	12-9
12.5.3.5 Screening Values Under Set 3.....	12-10
12.5.3.6 Set 3 Criteria.....	12-10
12.5.3.7 Screening Values Under Set 4.....	12-10
12.5.3.8 Set 4. Criterion.....	12-10
12.5.4 Basis for Quantitative Screening Values	12-11
12.5.5 Step 3: Performing Detailed Best-Estimate Analyses of the Important HFEs ...	12-11
12.5.5.1 PSFs and Fire Effects to Consider.....	12-12
12.5.5.2 Special Case—MCR Abandonment	12-16
12.5.5.3 Cases Where Little or No Credit Should be Allowed	12-17
12.5.6 Step 4: Documenting the Post-Fire HRA.....	12-18
12.6 References.....	12-18
13 SEISMIC-FIRE INTERACTIONS ASSESSMENT (TASK 13).....	13-1
13.1 Purpose.....	13-1
13.2 Scope.....	13-1
13.3 Background Information	13-2
13.3.1 Seismically Induced Fires.....	13-2
13.3.2 Degradation of Fire Suppression Systems and Features.....	13-2
13.3.3 Spurious Actuation of Suppression and/or Detection Systems	13-3
13.3.4 Degradation of Manual Firefighting Effectiveness.....	13-4
13.4 Assumptions.....	13-4
13.5 Task Interfaces.....	13-4
13.5.1 Input from Other Tasks.....	13-4
13.5.2 Additional Plant Information Needed to Complete this Task	13-5
13.5.3 Walkdowns	13-5
13.5.4 Output to Other Tasks	13-5
13.6 Assessment Procedure	13-5
13.6.1 Step 1: Identify Key Seismic-Fire Interaction Analysis Compartments.....	13-5
13.6.2 Step 2: Assess Seismically Induced Fires.....	13-6

13.6.3 Step 3: Assess Seismic Degradation of Fire Suppression Systems and Features	13-7
13.6.4 Step 4: Assess the Potential Impact of Spurious Fire Detection Signals	13-7
13.6.5 Step 5: Assess the Potential Impact of Spurious Fire Suppression System Actuations.....	13-7
13.6.6 Step 6: Assess the Potential Impact of a Seismic Event on Manual Firefighting.....	13-8
13.6.7 Step 7: Complete Documentation.....	13-8
13.7 References.....	13-9
14 FIRE RISK QUANTIFICATION (TASK 14)	14-1
14.1 Purpose.....	14-1
14.2 Scope.....	14-1
14.3 Task Interfaces.....	14-2
14.3.1 Input from Other Tasks.....	14-2
14.3.2 Additional Plant Information Needed to Support this Task	14-2
14.3.3 Walkdowns	14-2
14.4 Background Information	14-2
14.4.1 General Task Objectives and Approach.....	14-2
14.4.2 Assumptions.....	14-3
14.4.3 Outputs to Other Tasks	14-3
14.5 Procedure.....	14-3
14.5.1 Step 1: Quantify Final Fire CDF Model.....	14-3
14.5.1.1 Step 1.1: Quantify Final Fire CCDP Model	14-3
14.5.1.2 Step 1.2: Quantify Final Fire CDFs.....	14-4
14.5.1.3 Step 1.3: Identify Main Contributors to the Fire CDF	14-4
14.5.2 Step 2: Quantify Final Fire LERF Model.....	14-4
14.5.2.1 Step 2.1: Quantify Final Fire CLERP Model	14-4
14.5.2.2 Step 2.2: Quantify Final Fire LERFs	14-4
14.5.2.3 Step 2.3: Identify Main Contributors to the Fire LERF	14-5
14.5.3 Step 3: Propagate Uncertainty Distributions.....	14-5
14.5.4 Step 4: Sensitivity Analysis.....	14-5
14.5.4.1 Step 4.1 Identification of Final Set of Sensitivity Analysis Cases	14-5
14.5.4.2 Step 4.2 CDF and/or LERF Computations and Comparison	14-5
14.6 References.....	14-5

15 UNCERTAINTY AND SENSITIVITY ANALYSES (TASK 15)	15-1
15.1 Purpose	15-1
15.2 Scope	15-1
15.3 Background Information	15-1
15.3.1 General Task Objectives and Approach.....	15-1
15.3.2 Assumptions	15-2
15.4 Task Interfaces.....	15-2
15.4.1 Input from Other Tasks.....	15-2
15.4.2 Additional Plant Information Needed to Support this Task	15-3
15.4.3 Walkdowns	15-3
15.4.4 Outputs to Other Tasks	15-3
15.5 Procedure.....	15-3
15.5.1 Step 1: Identify Uncertainties Associated with Each Task.....	15-3
15.5.2 Step 2: Develop Strategies for Addressing the Uncertainties.....	15-4
15.5.3 Step 3: Perform Review of Uncertainties to Make Final Decisions as to Which Uncertainties Will Be Addressed and How	15-5
15.5.4 Step 4: Perform the Uncertainty and Sensitivity Analyses	15-6
15.5.5 Step 5: Include the Results of the Uncertainty and Sensitivity Analyses in the Fire PRA Documentation.....	15-6
 16 FIRE PRA DOCUMENTATION (TASK 16)	 16-1
16.1 Purpose	16-1
16.2 Scope	16-1
16.3 Background Information	16-1
16.3.1 General Task Objectives and Approach.....	16-1
16.3.2 Assumptions	16-1
16.4 Task Interfaces.....	16-1
16.4.1 Input from Other Tasks.....	16-1
16.4.2 Additional Plant Information Needed to Support this Task	16-1
16.4.3 Walkdowns	16-1
16.4.4 Outputs to Other Tasks	16-2
16.5 Procedure.....	16-2
16.6 Uncertainty	16-2
 17 PLANT WALKDOWNS (SUPPORT TASK A)	 17-1
17.1 Introduction.....	17-1

17.2 Overall Walkdown Approach	17-1
17.3 Typical Walkdown Needs	17-3
18 FIRE PRA DATABASE SYSTEM (SUPPORT TASK B)	18-1
18.1 Purpose	18-1
18.2 Scope	18-1
18.3 Background Information	18-2
18.3.1 General Task Objectives and Approach	18-2
18.3.2 Assumptions	18-3
18.4 Task Interfaces	18-4
18.4.1 Input from Other Tasks	18-4
18.4.1.1 Plant Partitioning Boundaries and Designations	18-4
18.4.1.2 Plant Cable and Raceway Data	18-4
18.4.1.3 Fire PRA Equipment	18-4
18.4.1.4 Fire PRA Cable Selection	18-4
18.4.2 Additional Plant Information Needed to Support this Task	18-4
18.4.3 Walkdowns	18-4
18.4.4 Outputs to Other Tasks	18-5
18.5 Procedure	18-5
18.5.1 Step 1: Database Structure and Functional Criteria	18-5
18.5.1.1 Step 1.1: Database Functional Criteria	18-5
18.5.1.1.1 Data Input Criteria	18-5
18.5.1.1.2 Output Criteria	18-6
18.5.1.2 Step 1.2: Database Structure and Data Fields	18-6
18.5.2 Step 2: Database Platform	18-7
18.5.3 Step 3: Database Augmentation Plan	18-7
18.5.4 Step 4: Implement Database Upgrades	18-8
19 GLOSSARY	19-1
A APPENDIX FOR CHAPTER 2, TECHNICAL BASES	A-1
A.1 Use of the Internal Events PRA and the Fire Safe Shutdown Analysis as the Primary Technical Inputs	A-1
A.1.1 Basis	A-2
A.2 Necessary Modifications/Additions to the Fire PRA Component List	A-3
A.2.1 Basis	A-3

A.3 Consideration of a Reasonable Number of Spurious Events.....	A-4
A.3.1 Basis	A-5
A.4 References.....	A-6
B APPENDIX FOR CHAPTER 3, EXAMPLE.....	B-1
C APPENDIX FOR CHAPTER 6, DETERMINATION OF GENERIC FIRE FREQUENCIES	C-1
C.1 Methodology Summary.....	C-1
C.2 Prior Distributions	C-3
C.3 Screening Events for Inclusion in the Calculation of Generic Fire Frequencies	C-7
C.3.1 Where and When a Fire Occurred	C-7
C.3.2 Potentially Challenging Events	C-7
C.3.3 Criteria for Classification of Fire Events	C-8
C.3.3.1 Objective Classification Criteria.....	C-8
C.3.3.2 Subjective Classification Criteria.....	C-9
C.3.4 Implications of the Event Screening Process and Criteria	C-10
C.4 Additional Considerations	C-11
C.4.1 Event Counting Method	C-11
C.4.2 Fire Events in Decommissioned Plants	C-13
C.4.3 Estimated Reactor Years of Power and Low-Power Operation	C-14
C.5 Event Counts and Generic Frequencies.....	C-14
C.6 Fire Event Classification	C-18
C.7 References	C-18
D APPENDIX FOR CHAPTER 7, TECHNICAL BASES.....	D-1
D.1 References	D-2
E APPENDIX FOR CHAPTERS 8 AND 11, SEVERITY FACTORS.....	E-1
E.1 Severity Factor Determination	E-1
E.2 Discretized Heat Release Rate Distributions for Fixed and Transient Ignition Sources	E-2
E.3 Severity Factors in Oil Spill Fire Scenarios.....	E-12
F APPENDIX FOR CHAPTER 8, WALKDOWN FORMS	F-1
F.1 Fixed Ignition Source Form.....	F-1
F.1.1 Form Inputs	F-1

F.2 Fire Zone of Influence Form.....	F-4
F.2.1 Form Inputs	F-7
G APPENDIX FOR CHAPTERS 8 AND 11, HEAT RELEASE RATES.....	G-1
G.1 Background	G-1
G.2 Recommended HRR Values	G-3
G.2.1 Overview.....	G-3
G.2.2 Basis.....	G-3
G.3 HRRs for Fixed Ignition Sources	G-4
G.3.1 Growth of Electrical Cabinet Fires	G-5
G.3.2 Location of Electrical Cabinet Fires	G-7
G.3.3 Fire Propagation in Electrical Cabinets.....	G-8
G.4 HRRs for Flammable Liquid Fires	G-9
G.5 Technical Basis for Recommended HRR for Transient Ignition Sources	G-11
G.6 Supplemental Information: Experimental HRR Measurements	G-12
G.7 Supplemental Information: Examples of Determining HRRs for Typical Electrical Cabinets in NPPs	G-12
G.8 References	G-37
H APPENDIX FOR CHAPTERS 8 AND 11, DAMAGE CRITERIA.....	H-1
H.1 Electrical Cables.....	H-1
H.1.1 Generic Cable Damage and Ignition Criteria	H-1
H.1.2 Mixed Cable Insulation/Jacket Type Configurations	H-2
H.1.3 Thermoplastic Jacketed, Thermoset Insulated Cables	H-2
H.1.4 Specific Data for Specific Cable Types.....	H-4
H.1.5 Damage Time Considerations	H-5
H.1.5.1 Direct Fire Modeling of Cable Thermal Response	H-5
H.1.5.2 An Empirical Approach.....	H-8
H.2 Other Equipment.....	H-10
H.3 References for Appendix H.....	H-11
I APPENDIX FOR CHAPTER 9, EXAMPLES OF COMPONENT CIRCUITS ANALYSES.....	I-1
I.1 Typical SOV Control Circuit.....	I-1
I.2 Typical MOV Control Circuit.....	I-3
I.3 Control Circuit with Double-Pole Isolation Switches.....	I-5

I.4 Ungrounded AC MOV Control Circuit with Contacts on the Downstream Leg and Normal Contact Arrangement.....	I-7
I.5 Ungrounded MOV Control Circuit with Normal Contact Arrangement	I-8
I.6 MOV with Redundant Main Contactors and Independent Control Circuits	I-11
I.7 Ungrounded Three-Phase Power Supply.....	I-13
I.8 Simple SOV Circuit with Alternate Contact Arrangement.....	I-14

J APPENDIX FOR CHAPTER 10, TECHNICAL BASIS FOR CIRCUIT FAILURE MODE LIKELIHOOD EQUATIONS J-1

J.1 Computational Probability Estimates.....	J-1
J.1.1 Estimating P_{cc}	J-1
J.1.2 Calculating CF	J-4
J.1.3 Calculating PFM	J-6

K APPENDIX FOR CHAPTER 10, EXAMPLES OF COMPONENT CIRCUIT FAILURE MODE LIKELIHOOD ANALYSES K-1

K.1 Typical SOV Control Circuit	K-1
K.2 Typical MOV Control Circuit.....	K-4
K.3 Control Circuit with Double-Pole Isolation Switches	K-6
K.4 Ungrounded AC MOV Control Circuit with Contacts on the Downstream Leg and Normal Contact Arrangement.....	K-9
K.5 Ungrounded MOV Control Circuit with Normal Contact Arrangement	K-12
K.6 MOV with Redundant Main Contactors and Independent Control Circuits	K-14

L APPENDIX FOR CHAPTER 11, MAIN CONTROL BOARD FIRES..... L-1

L.1 Introduction	L-1
L.2 Probability of Target Damage.....	L-3
L.3 Calculating Scenario Frequency	L-4
L.4 Model Description.....	L-5
L.5 Example	L-8
L.6 References	L-9

M APPENDIX FOR CHAPTER 11, HIGH ENERGY ARCING FAULTS M-1

M.1 Introduction	M-1
M.2 High Energy Electrical Arcing Phenomena	M-1
M.3 U.S. Nuclear Power Plants Operating Experience	M-2
M.4 Damage Characterization During the Energetic Phase (Zone of Influence)	M-12

M.4.1 General Room Heat Up	M-12
M.4.2 High Energy Zone of Influence	M-13
M.5 Characterization of Detection/Suppression During the Energetic Phase	M-15
M.6 Modeling High-Energy Arcing Faults in the Fire PRA	M-15
M.6.1 Risk Quantification of High-Arcing Fault Events	M-15
M.6.1.1 Example	M-16
M.6.2 Risk Quantification of Regular Cabinet Fires.....	M-17
M.7 References for Appendix M.....	M-17
N APPENDIX FOR CHAPTER 11, HYDROGEN FIRES.....	N-1
N.1 Background	N-1
N.1.1 Hydrogen in Nuclear Power Plants	N-2
N.1.2 Hydrogen Fire and Explosion Experience.....	N-3
N.2 Evaluation of Fires Involving Hydrogen	N-4
N.2.1 Turbine/Generator Hydrogen Fires	N-5
N.2.2 Boiling Water Reactors–Hydrogen Recombiner	N-5
N.2.3 Plant-Wide Components–Hydrogen Tanks.....	N-6
N.2.3.1 Jet Flame	N-7
N.2.3.2 Storage Tank Explosion	N-7
N.2.3.3 Jet Vapor Cloud Explosion	N-8
N.2.4 Plant-Wide Components–Miscellaneous Hydrogen Fires.....	N-9
N.2.4.1 Jet Flame	N-10
N.2.4.2 Explosion Confined to the Compartment of Origin	N-10
N.2.4.3 Multicompartment Explosion	N-10
N.3 Modeling Hydrogen Fire and Explosion.....	N-11
N.4 References	N-11
O APPENDIX FOR CHAPTER 11, TURBINE GENERATOR FIRES	O-1
O.1 Fire Events Involving Turbine-Generator System.....	O-1
O.2 Modeling Fires Involving Turbine-Generators	O-4
O.2.1 Excitor Fires	O-4
O.2.2 Hydrogen Fires	O-4
O.2.3 Oil Fires	O-4
O.2.4 Catastrophic Fires Involving T/G System	O-6
O.3 References	O-6

P APPENDIX FOR CHAPTER 11, DETECTION AND SUPPRESSION ANALYSIS.....	P-1
P.1 Calculating the Non-Suppression Probability.....	P-2
P.1.1 Identification of Fire Protection Features	P-2
P.1.2 Effectiveness of Fire Detection and Suppression Systems.....	P-2
P.1.3 Solving the Detection-Suppression Event Tree	P-3
P.1.4 Dependency Analysis.....	P-12
P.1.5 Non-Suppression Probability.....	P-14
P.2 Example	P-14
P.3 References.....	P-14
Q APPENDIX FOR CHAPTER 11, PASSIVE FIRE PROTECTION FEATURES	Q-1
Q.1 Analytical Modeling of Passive Fire Protection Features	Q-1
Q.2 Empirical Modeling of Passive Fire Protection Features	Q-2
Q.2.1 Coatings.....	Q-2
Q.2.2 Cable Tray Barriers and Fire Stops	Q-4
Q.3 Probabilistic Modeling of Passive Fire Protection Features	Q-4
Q.3.1 Dampers	Q-4
Q.3.2 Penetration Seals	Q-5
R APPENDIX FOR CHAPTER 11, CABLE FIRES	R-1
R.1 Modeling Cable Fires in a Fire PRA	R-2
R.2 Cable Tray Ignition.....	R-2
R.3 Heat Release Rate from Cable Tray Fires.....	R-4
R.4 Flame Spread and Fire Propagation.....	R-5
R.4.1 Flame Spread	R-5
R.4.1.1 Material Properties	R-6
R.4.1.2 Recommended Values for Flame Spread in Horizontal Cable Trays.....	R-7
R.4.1.3 Calculating Flame Spread in Vertical Cable Trays.....	R-7
R.4.1.4 Flame Spread in Cable Trays with Other Geometries.....	R-8
R.4.2 Fire Propagation	R-9
R.4.2.1 Heat Release Rate	R-9
R.4.2.2 Timing	R-10
R.5 References	R-11
S APPENDIX FOR CHAPTER 11, FIRE PROPAGATION TO ADJACENT CABINETS	S-1

S.1 Fire Propagation to Adjacent Cabinets	S-1
S.2 Damage to Adjacent Cabinets	S-2
S.3 References.....	S-3

T APPENDIX FOR CHAPTER 11, SMOKE DAMAGET-1

T.1 Introduction	T-1
T.1.1 Contact Fouling	T-2
T.1.2 Binding of Mechanical Movement	T-3
T.1.2.1 Relays.....	T-3
T.1.2.2 Strip Chart Recorders	T-4
T.1.2.3 Dial Meters.....	T-4
T.1.2.4 Hard Disk Drive Units	T-5
T.1.2.5 Summary of Insights for Binding Mechanical Movement.....	T-5
T.1.2.6 Risk Implications of Mechanical Binding Damage Mode	T-7
T.2 Summary of Findings	T-7
T.2.1 Failure Modes and Component Vulnerability	T-7
T.2.1.1 Circuit Bridging	T-8
T.2.1.1.1 Damage Mechanism	T-8
T.2.1.1.2 Vulnerable Components	T-8
T.2.1.1.3 Risk Implications	T-8
T.2.1.1.4 Potential Risk Significance.....	T-9
T.2.1.2 Contact Fouling	T-9
T.2.1.2.1 Damage Mechanism	T-9
T.2.1.2.2 Vulnerable Components	T-9
T.2.1.2.3 Risk Implications	T-9
T.2.1.2.4 Overall Risk Significance	T-9
T.2.1.3 Binding of Mechanical Movement.....	T-9
T.2.1.3.1 Damage Mechanism	T-9
T.2.1.3.2 Vulnerable Components	T-9
T.2.1.3.3 Potential Risk Implications	T-10
T.2.1.3.4 Overall Risk Significance	T-10
T.2.1.4 Direct Chemical/Corrosive Attack.....	T-10
T.2.1.4.1 Damage Mechanism	T-10
T.2.1.4.2 Vulnerable Components	T-10
T.2.1.4.3 Risk Implications	T-10

T.2.1.4.4 Overall Risk Significance	T-10
T.2.2 Findings Associated with PRA Modeling of Smoke Damage	T-10
T.2.2.1 High Voltage Components	T-11
T.2.2.1.1 Damage Thresholds.....	T-11
T.2.2.1.2 Screening Analyses	T-11
T.2.2.1.3 Risk Quantification	T-12
T.2.2.2 Lower-Voltage Instrumentation and Control Devices	T-12
T.2.2.2.1 Damage Thresholds.....	T-12
T.2.2.2.2 Screening Analyses	T-12
T.2.2.2.3 Risk Quantification	T-12
T.3 A PRA Framework for Smoke Damage	T-13
T.3.1 Practices Supported by the Current State of the Art	T-13
T.4 References.....	T-14

U APPENDIX FOR CHAPTER 15, UNCERTAINTY ANALYSIS–TECHNICAL BASES..... U-1

U.1 Background	U-1
U.2 Types of Uncertainties: Aleatory and Epistemic	U-2
U.3 Uncertainty Analysis in PRA	U-3
U.4 Uncertainties in the Integrated Fire Analysis	U-4
U.5 References	U-5

V APPENDIX FOR CHAPTER 15, DISCUSSION OF INDIVIDUAL TASK

UNCERTAINTIES..... V-1

V.1 Summary of Task Uncertainties and Suggested Treatment	V-1
V.1.1 Task 1–Plant Boundary Definition and Partitioning.....	V-1
V.1.1.1 Uncertainty Issues	V-1
V.1.1.2 Accuracy Issues	V-1
V.1.2 Task 2–Fire PRA Components Selection.....	V-2
V.1.2.1 Uncertainty Issues	V-2
V.1.2.2 Accuracy and Completeness Issues	V-2
V.1.3 Task 3–Fire PRA Cable Selection.....	V-2
V.1.3.1 Uncertainty Issues	V-2
V.1.3.2 Accuracy and Completeness Issues	V-3
V.1.4 Task 4–Qualitative Screening	V-3
V.1.4.1 Uncertainty Issues	V-3

V.1.4.2 Accuracy Issues	V-4
V.1.5 Task 5–Fire-Induced Risk Model	V-4
V.1.5.1 Uncertainty Issues	V-4
V.1.5.2 Accuracy and Completeness Issues	V-4
V.1.6 Task 6–Fire-Ignition Frequency	V-4
V.1.6.1 Uncertainty Issues	V-4
V.1.6.2 Accuracy Issues	V-5
V.1.7 Task 7–Quantitative Screening	V-5
V.1.7.1 Uncertainty Issues	V-5
V.1.7.2 Accuracy Issues	V-6
V.1.8 Task 8–Scoping Fire Modeling.....	V-6
V.1.8.1 Uncertainty Issues	V-6
V.1.8.2 Accuracy Issues	V-6
V.1.9 Task 9–Detailed Circuit Failure Analysis.....	V-7
V.1.9.1 Uncertainty Issues	V-7
V.1.9.2 Accuracy Issues	V-7
V.1.10 Task 10–Circuit Failure Mode Likelihood Analysis.....	V-7
V.1.10.1 Uncertainty Issues	V-7
V.1.10.2 Accuracy Issues	V-8
V.1.11 Task 11–Detailed Fire Modeling	V-8
V.1.11.1 Uncertainty Issues	V-8
V.1.11.2 Accuracy Issues	V-8
V.1.12 Task 12–Post-Fire Human Reliability Analysis	V-9
V.1.12.1 Uncertainty Issues	V-9
V.1.12.2 Accuracy and Completeness Issues	V-9
V.1.13 Task 13–Seismic-Fire Interactions.....	V-10
V.1.13.1 Uncertainty Issues	V-10
V.1.13.2 Accuracy and Completeness Issues	V-10
V.1.14 Task 14–Fire Risk Quantification	V-10
V.1.15 Task 15–Uncertainty and Sensitivity Analyses	V-10
V.1.16 Task 16–Fire PRA Documentation.....	V-10
V.2 Role of Sensitivity Analyses.....	V-10
W APPENDIX FOR CHAPTER 18, SAMPLE FIRE PRA DATABASE STRUCTURE	W-1
W.1 Database Structure and Relationships	W-1

W.2 Source Data Table Constraints and Data Integrity Logical Requirements.....	W-3
W.3 Data Integrity Rules and Logical Constraints.....	W-5
W.4 Mapping Data Fields to Task Activities	W-6

LIST OF FIGURES

Figure 1 Overview of the Fire PRA Process	xliii
Figure 3-1 Fire PRA Cable Selection Process	3-3
Figure 5-1 Illustration of a FEP Response Model	5-7
Figure 8-1 Conceptual Representation of the Process of Calculating Severity Factors in Task 8	8-13
Figure 9-1 Detailed Circuit Failure Analysis Work Flow	9-3
Figure 10-1 Circuit Failure Mode Likelihood Analysis Work Flow	10-2
Figure 11-1 General Analysis Flow Chart for Task 11–Detailed Fire Modeling11.3.4 Fire Growth and Spread Analysis.....	11-5
Figure 18-1 Fire PRA Database Structure–Equipment and Cables.....	18-3
Figure B-1 Example Cable Block Diagrams.....	B-2
Figure E-1 Severity Factor Estimation Process	E-3
Figure F-1 Example of Fixed Ignition Source Form	F-2
Figure F-2 Fire ZOI. d_p : Critical Distance for Targets in the Plume, d_{pr} : Radius of the Plume at the Critical Distance, d_f : Flame Height, d_{cj} : Critical Distance for Targets in the Ceiling Jet, d_r : Critical Distance for Targets Subjected to Flame Radiation	F-5
Figure F-3 Fire Zone of Influence Form. Predetermined Values are Based on Listed Input Parameters. Analysts Should Verify that Inputs are Applicable to the Compartment Under Study	F-6
Figure G-1 Heat Release Rate Profile	G-2
Figure G-2 4.16 kV Switchgear (Front)	G-25
Figure G-3 4.16 kV Switchgear (Front Panel, Open)	G-26
Figure G-4 4.16 kV Switchgear (Front Panel, Open)	G-26
Figure G-5 4.16 kV Switchgear (Rear Panel)	G-27
Figure G-6 480 V MCC (Front)	G-27
Figure G-7 480 V MCC (Open)	G-28
Figure G-8 Distribution Panel (Front)	G-28
Figure G-9 Distribution Panel (Front)	G-29
Figure G-10 480 V Switchgear (Front)	G-30
Figure G-11 480 V Switchgear (Rear Panel)	G-30
Figure G-12 480 V Switchgear (Rear Panel)	G-31
Figure G-13 480 V Switchgear (Rear Panel)	G-31
Figure G-14 Inverter (Front).....	G-32

Figure G-15 Inverter (Inside Front Panel, Top Portion)	G-32
Figure G-16 Control Panel (Front)	G-33
Figure G-17 Control Panel (Inside the Front Panel)	G-34
Figure G-18 Control Panel (Rear Access)	G-34
Figure G-19 Control Panel (Back of the Rear Face)	G-35
Figure G-20 Example of a Main Control Board	G-35
Figure G-21 Relay Rack (Front).....	G-36
Figure G-22 Relay Rack (Cable Bundles).....	G-36
Figure I-1 Block Diagram for Typical SOV Circuit Analysis Example.....	I-2
Figure I-2 Electrical Schematic for Typical SOV Circuit Analysis Example.....	I-2
Figure I-3 Block Diagram for Typical MOV Circuit Analysis Example	I-3
Figure I-4 Electrical Schematic for Typical MOV Circuit Analysis Example	I-4
Figure I-5 Block Diagram for Double-Pole Isolation Circuit Example.....	I-5
Figure I-6 Electrical Schematic for Double-Pole Isolation Circuit Example.....	I-6
Figure I-7 Block Diagram for Ungrounded, Inverted MOV Control Circuit Example	I-7
Figure I-8 Electrical Schematic for Ungrounded, Inverted MOV Control Circuit Example	I-8
Figure I-9 Block Diagram for Ungrounded MOV Circuit Analysis Example.....	I-9
Figure I-10 Electrical Schematic for Ungrounded MOV Circuit Analysis Example.....	I-9
Figure I-11 Block Diagram for MOV with Independent Control Circuits Example	I-11
Figure I-12 Electrical Schematic for MOV with Independent Control Circuits	I-12
Figure I-13 Ungrounded Three-Phase Motor Power Supply.....	I-14
Figure I-14 Simple SOV Circuit with Alternate Contact Arrangement	I-15
Figure K-1 Highlighted Block Diagram for Typical SOV Circuit Example.....	K-2
Figure K-2 Electrical Schematic for Typical SOV Circuit Example.....	K-2
Figure K-3 Highlighted Block Diagram for Typical MOV Circuit Example	K-4
Figure K-4 Electrical Schematic for Typical MOV Circuit Example	K-5
Figure K-5 Highlighted Block Diagram for Double-Pole Isolation Circuit Example	K-6
Figure K-6 Electrical Schematic for Double-Pole-Isolation Circuit Example	K-7
Figure K-7 Highlighted Block Diagram for Ungrounded, Inverted MOV Example.....	K-10
Figure K-8 Electrical Schematic for Ungrounded, Inverted MOV Example.....	K-10
Figure K-9 Highlighted Block Diagram for Ungrounded MOV Circuit Analysis Example	K-12
Figure K-10 Electrical Schematic for Ungrounded MOV Circuit Analysis Example	K-13
Figure K-11 Highlighted Block Diagram for MOV with Independent Control Circuits Example	K-15
Figure K-12 Electrical Schematic for MOV with Independent Control Circuits.....	K-16
Figure L-1 Likelihood of Target Damage Calculated as the Severity Factor Times the Probability of Nonsuppression for MCB Fires	L-4
Figure L-2 A Representation of the Front of a Control Panel with Two Target Elements	L-6
Figure L-3 Heat Release Rate Profile	L-8

Figure M-1 ZOI for the Energetic Phase of a HEAF	M-14
Figure P-1 Detection Suppression Event Tree NS – Failure of Suppression Activities OK – Success of Suppression Activities	P-4
Figure P-2 Summary of Suppression Curves	P-11
Figure P-3 Summary of Suppression Curves	P-12
Figure P-4 Solution of the Detection-Suppression Event Tree for Example in Section P-2 NS – Failure of Suppression Activities OK – Success of Suppression Activities	P-15
Figure R-1 Ignition Evaluation of a Cable Tray Stack	R-3
Figure R-2 Ignition Evaluation of a Cable Tray Stack in the Ceiling Jet	R-3
Figure R-3 Ignition Evaluation of Adjacent Cable Trays	R-3
Figure R-4 Pictorial Representation of the Beginning of the Flame Spread Process	R-6
Figure R-5 Model for Fire Propagation in a Cable Tray Stack	R-9
Figure W-1 Fire PRA Database Structure–Equipment and Cables	W-2
Figure W-2 Fire PRA Database Structure–Compartment, Areas, and Fire Protection	W-3

LIST OF TABLES

Table 2-1 Illustration of Accident Sequence Types to be Included/Excluded in the Fire PRA	2-10
Table 2-2 Illustrations of Spurious Actuation (Single and Multiple) of Electrical-Operated Equipment Using the Internal Events PRA Model.....	2-19
Table 5-1 Summary of Methods for Addressing Fire-Induced Equipment Failures	5-9
Table 6-1 Fire Frequency Bins and Generic Frequencies	6-3
Table 6-2 Generic Plant Location Descriptions and Weighting Factor W_L	6-12
Table 6-3 Description of Transient Fire Influencing Factors	6-23
Table 7-1 Quantitative Screening–Summary of Inputs and Outputs.....	7-5
Table 7-2 Quantitative Screening Criteria for Single Fire Compartment Analysis	7-9
Table 7-3 Quantitative Screening Criteria for All Screened Fire Compartments.....	7-9
Table 8-1 Zone of Influence and Severity Factor Recommendations	8-4
Table 8-2 Damage Criteria for Cables [8.1]	8-10
Table 10-1 Failure Mode Probability Estimates Given Cable Damage Thermoset Cable with Control Power Transformer (CPT)	10-7
Table 10-2 Failure Mode Probability Estimates Given Cable Damage Thermoset Cable without CPT.....	10-7
Table 10-3 Failure Mode Probability Estimates Given Cable Damage Thermoplastic Cable with CPT	10-8
Table 10-4 Failure Mode Probability Estimates Given Cable Damage Thermoplastic Cable without CPT	10-8
Table 10-5 Failure Mode Probability Estimates Given Cable Damage Armored or Shielded Cable	10-8
Table 11-1 Recommended Severity Factors and Suppression Curves for Ignition Sources in the Frequency Model	11-9
Table 11-2 Appendices Providing Additional Instructions on Technical Issues in Selecting, Characterizing, and Analyzing Physical Fire Scenarios	11-13
Table 11-3 Barrier Types and Their Failure Probabilities.....	11-46
Table 16-1 Suggested Outline for Fire PRA Documentation (Main Fire PRA Report).....	16-2
Table 16-2 Suggested Outline for Fire PRA Documentation (Fire PRA Supporting Documents).....	16-4
Table 17-1 Fire Risk Walkdowns	17-4
Table 17-2 Fire Risk Tasks and Walkdown Needs	17-7
Table B-1 Example Fire PRA Cable Data	B-2

Table B-2 Example Target Equipment Location Reports.....	B-4
Table B-3 Example Equipment Location Vulnerability Summary Report.....	B-5
Table C-1 Summary of Prior Distributions used in R-DAT	C-4
Table C-2 Fire Event Classifications and Frequency Estimation Action	C-12
Table C-3 Generic Fire Ignition Frequency Model for U.S. Nuclear Power Plants	C-15
Table C-4 Fire Event Classification.....	C-19
Table E-1 List of Heat Release Rate Distributions.....	E-4
Table E-2 Discretized Distribution for Case 1 Heat Release Rate (Vertical Cabinets with Qualified Cable, Fire Limited to One Cable Bundle)	E-4
Table E-3 Discretized Distribution for Case 2 Heat Release Rate (Vertical Cabinets with Qualified Cable, Fire in more than One Cable Bundle).....	E-5
Table E-4 Discretized Distribution for Case 3 Heat Release Rate (Vertical Cabinets with Unqualified Cable, Fire Limited to One Cable Bundle).....	E-6
Table E-5 Discretized Distribution for Case 4 Heat Release Rate (Vertical Cabinets with Unqualified Cable, Fire in more than One Cable Bundle Closed Doors)	E-7
Table E-6 Discretized Distribution for Case 5 Heat Release Rate (Vertical Cabinets with Unqualified Cable, Fire in more than One Cable Bundle Open Doors).....	E-8
Table E-7 Discretized Distribution for Case 6 Heat Release Rate (Pumps – Electrical Fires)	E-9
Table E-8 Discretized Distribution for Case 7 Heat Release Rate (Motors)	E-10
Table E-9 Discretized Distribution for Case 8 Heat Release Rate (Transients).....	E-11
Table F-1 Probability Distributions for Heat Release Rates.....	F-3
Table G-1 Recommended HRR Values for Electrical Fires	G-5
Table G-2 Recommended HRR Profiles for Electrical Cabinet Fires (See Table G-6 for Additional Detail of the Experiments)	G-6
Table G-3 Typical Electrical Cabinet Openings and Penetrations	G-8
Table G-4 Flammability Properties for Selected Combustibles	G-9
Table G-5 Information for Pressurized Oil Fires	G-11
Table G-6 Summary of Electrical Cabinet Experiments Reported in NUREG/CR 4527.....	G-13
Table G-7 Transient Ignition Sources	G-17
Table G-8 Properties of Selected Materials	G-24
Table H-1 Damage Criteria for Electrical Cables – Generic Screening Criteria for the Assessment of the Ignition and Damage Potential of Electrical Cables [See Ref 8-1].....	H-1
Table H-2 Cable Properties Decision Matrix for Mixed Cable Insulation/Jacket Configurations [See Ref 8-1].....	H-3
Table H-3 Summary of General Material Specific Cable Thermal Damage Criteria as Reported in Table 6 of Reference H.2	H-6
Table H-4 Failure Temperatures for Specific Cable Products as Reported in Table 5 of Reference H.2.....	H-6
Table H-5 Failure Time-Temperature Relationship for Thermoset Cables (Table A.7.1 from Reference H.6).....	H-9

Table H-6 Failure Time-Temperature Relationship for Thermoplastic Cables (Table A.7.2 from Reference H.6).....	H-9
Table H-7 Failure Time-Heat Flux Relationship for Thermoset Cables (Table A.7.3 from Reference H.6).....	H-10
Table H-8 Failure Time-Heat Flux Relationship for Thermoplastic Cables (Table A.7.4 from Reference H.6).....	H-10
Table I-1 SOV Failure List.....	I-3
Table I-2 MOV Failure List.....	I-5
Table I-3 Double-Pole Isolated Motor Failure List.....	I-6
Table I-4 Ungrounded, Inverted MOV Failure List.....	I-8
Table I-5 Ungrounded MOV Failure List.....	I-10
Table I-6 MOV with Independent Control Circuits Failure List.....	I-13
Table I-7 MOV with Independent Control Circuits Failure List.....	I-15
Table J-1 P_{cc} Probability Factors.....	J-4
Table J-2 Configuration Factors (CF).....	J-6
Table K-1 SOV Cable B Failure Response Probabilities.....	K-4
Table K-2 MOV Cable A Failure Response Probabilities.....	K-6
Table K-3 Double-Pole Isolated Motor Failure Response Probabilities (Cables A and B).....	K-9
Table K-4 Ungrounded, Inverted MOV Failure Response Probabilities.....	K-12
Table K-5 Ungrounded MOV Failure Response (SO) Probabilities.....	K-14
Table K-6 MOV with Independent Control Circuits Failure Response (SO) Probabilities.....	K-17
Table M-1 Summary of the High-Energy Arcing Faults for Switchgears and Load Centers in the U.S. Nuclear Power Industry: 1979 through 2001.....	M-4
Table N-1 Some Properties of Hydrogen (Gleaned from [N-2 through N-6]).....	N-2
Table N-2 Fire Ignition Frequencies, From Task 6.....	N-5
Table O-1 Major Fires Involving T/G System in U.S. and International NPPs.....	O-2
Table O-2 Fire Categories, Severity Level, and Conditional Probability.....	O-5
Table P-1 Event Tree Outputs.....	P-3
Table P-2 Probability Distribution for Rate of Fires Suppressed per Unit Time, λ	P-9
Table P-3 Numerical Results for Suppression Curves.....	P-10
Table P-4 List of Fire Events Included in the Development of the Suppression Curves.....	P-16
Table Q-1 Summary of Principal Two-Tray Diesel Fuel Fire Cable Fire. Retardant Coatings Tests Involving Nonrated 3-Conductor Cables.....	Q-3
Table R-1 Bench Scale HRR Values Under a Heat Flux of 60 kW/m^2 , q_{bs} [R-4].....	R-5
Table R-2 Inputs for Flame Spread Analysis.....	R-7
Table R-3 Inputs for Flame Spread Analysis.....	R-8
Table R-4 Flame Spread Estimates for PVC Cable.....	R-8
Table W-1 Fire-PRA Database Lookup Table Options.....	W-4

REPORT SUMMARY

The Fire Risk Requantification Study has resulted in state-of-the-art methods, tools, and data for a fire probabilistic risk assessment (PRA) for commercial nuclear power plant application. This study was conducted jointly by EPRI and the U.S. Nuclear Regulatory Commission (NRC) Office of Nuclear Regulatory Research (RES) under the terms of an NRC/EPRI Memorandum of Understanding and an accompanying Fire Research Addendum. Industry participants supported demonstration analyses and provided peer review of the methods. The documented methods are intended to support future applications of fire PRA, including risk-informed regulatory applications.

Background

This document is written primarily for practitioners conducting a nuclear power plant fire PRA study. A fire PRA requires a team effort because few individuals have the full range of expertise and knowledge necessary to complete the analysis. This report assumes that the fire risk analysis team will include individuals with expertise in four key areas: 1) fire analysis (basic fire behavior, fire modeling, fire protection engineering, and plant fire protection regulatory compliance practices and documentation); 2) general PRA and plant systems analysis (event tree/fault tree analysis, nuclear power plant systems modeling, reliability analysis, PRA practices as applied in the internal events domain, and specific knowledge of the plant under analysis); 3) human reliability analysis (emergency preparedness, plant operations, plant-specific safe shutdown procedures, and operations staff training practices); and 4) electrical analysis (circuit failure modes and effects analysis and post-fire safe shutdown, including plant-specific regulatory compliance strategies and documentation). While some of this expertise is generic, much of it is specific to the plant under analysis.

The methods documented in this report represent the current state-of-the-art in fire PRA practice. Certain aspects of PRA continue to evolve and likely will see additional developments in the near future. Such developments should be easily captured within the overall analysis framework described here. It is important to emphasize that while specific aspects of the analysis process will likely evolve, the overall analysis framework represents a stable and well-proven platform and should not be subject to fundamental changes in the foreseeable future.

Objectives

- To consolidate recent research and development activities into a single state-of-the-art fire PRA methodology.
- To serve the needs of a fire risk analysis team by providing a structured framework for the overall analysis, as well as specific recommended practices to address key aspects of the analysis.

Approach

Developing this fire PRA methodology document involved a consensus process designed to fully debate and build consensus on past methodological issues. Two technical development teams were assembled, one by EPRI and the second by RES. Each team provided a full complement of experts covering all aspects of the analysis. These experts worked together to develop an overall analysis framework and specific instructions for key aspects of the fire PRA.

Technical differences were aired in sometimes-lively discussions. The technical exchange process was designed to seek consensus where possible. However, the process also allowed RES and EPRI to maintain differing technical views in cases where consensus could not be reached. In practice, this did not prove necessary. The documented methods do, in all cases, represent a consensus view of the two technical development teams.

Another key aspect of the project involved participation of the commercial nuclear power industry in review, demonstration, and, to a lesser extent, development of the recommended methods. An industry peer-review panel was formed from the six non-pilot utility participants in this program. Two nuclear power plants participated as pilot plants and supported demonstration studies conducted jointly by the EPRI and RES technical development teams. A third nuclear power plant participated as an independent pilot plant, exercising the proposed methods independently and providing feedback to the technical development teams.

Results

The documented fire PRA method reflects state-of-the-art fire risk analysis approaches. Methodological issues raised in past fire risk analyses, including individual plant examination of external events (IPEEE) fire analyses, have been addressed to the extent allowed by the current state-of-the-art and overall project scope. Methodological debates were resolved through a consensus process between experts representing both EPRI and RES. The consensus process included a provision allowing both EPRI and RES to maintain differing technical positions if consensus could not be reached. No cases were encountered where this provision was invoked. While the primary objective of the project was to consolidate existing state-of-the-art fire PRA methods, in many areas, the newly documented methods represent a significant advance over previously documented methods. In several areas, this project has, in fact, resulted in new methods and approaches. Such advances typically relate to areas of past methodological debate.

EPRI Perspective

This report provides the single most complete and comprehensive methodology for conducting a fire PRA to date. Two aspects of the approaches described here are especially unique. First, the methodology has been developed based on a consensus process involving both EPRI and RES. Second, the methods specifically address and resolve previously identified methodological issues. Clearly, these fire PRA methods should offer a stable basis for proceeding with risk-informed regulatory approaches to fire protection regulatory compliance.

Keywords

Fire
Probabilistic Risk Assessment (PRA)
Nuclear Plant Fire Safety

Fire Risk
Risk Analysis
Risk-Informed Regulation

PREFACE

This report is presented in two volumes. Volume 1, the Executive Summary, provides general background and overview information including both programmatic and technical, and project insights and conclusions.

Volume 2 provides the detailed discussion of the recommended approach, methods, data and tools for conduct of a Fire PRA. This information is structured in 18 chapters that describe each of the project technical tasks as they are shown in Figure 1. Each chapter contains the following information.

- Section 1. Purpose – This section is a short description of what is the task intended to develop.
- Section 2. Scope – This contains a description of the scope of each task.
- Section 3. Background Information – This is a short description intended for the user to understand, what is expected to be performed as part of this task and why, what are the relevant technical issues and if an how they are to be addressed. It is intended that this would reduce inappropriate use of the methods and data. This section also, describes assumptions specific to the task.
- Section 4. Interfaces – This section contains description of the interfaces between this and other technical tasks. This information is intended to ensure that appropriate input, from other tasks, is used and appropriate results, as necessary by other task, is generated.
- Section 5. Procedure – This section provides the detailed description of steps to develop the task outputs.
- Section 6. Uncertainty – This section is a discussion of uncertainties contributing to the technical task. This is intended to identify sources of uncertainty with some thoughts on how they can or may be addressed.
- Section 7. References – The reference for each technical task are listed at the end of each chapter.
- Appendices. Technical bases, special models, generic data, or other information are organized by task. These appear at the end of appropriate task chapter.

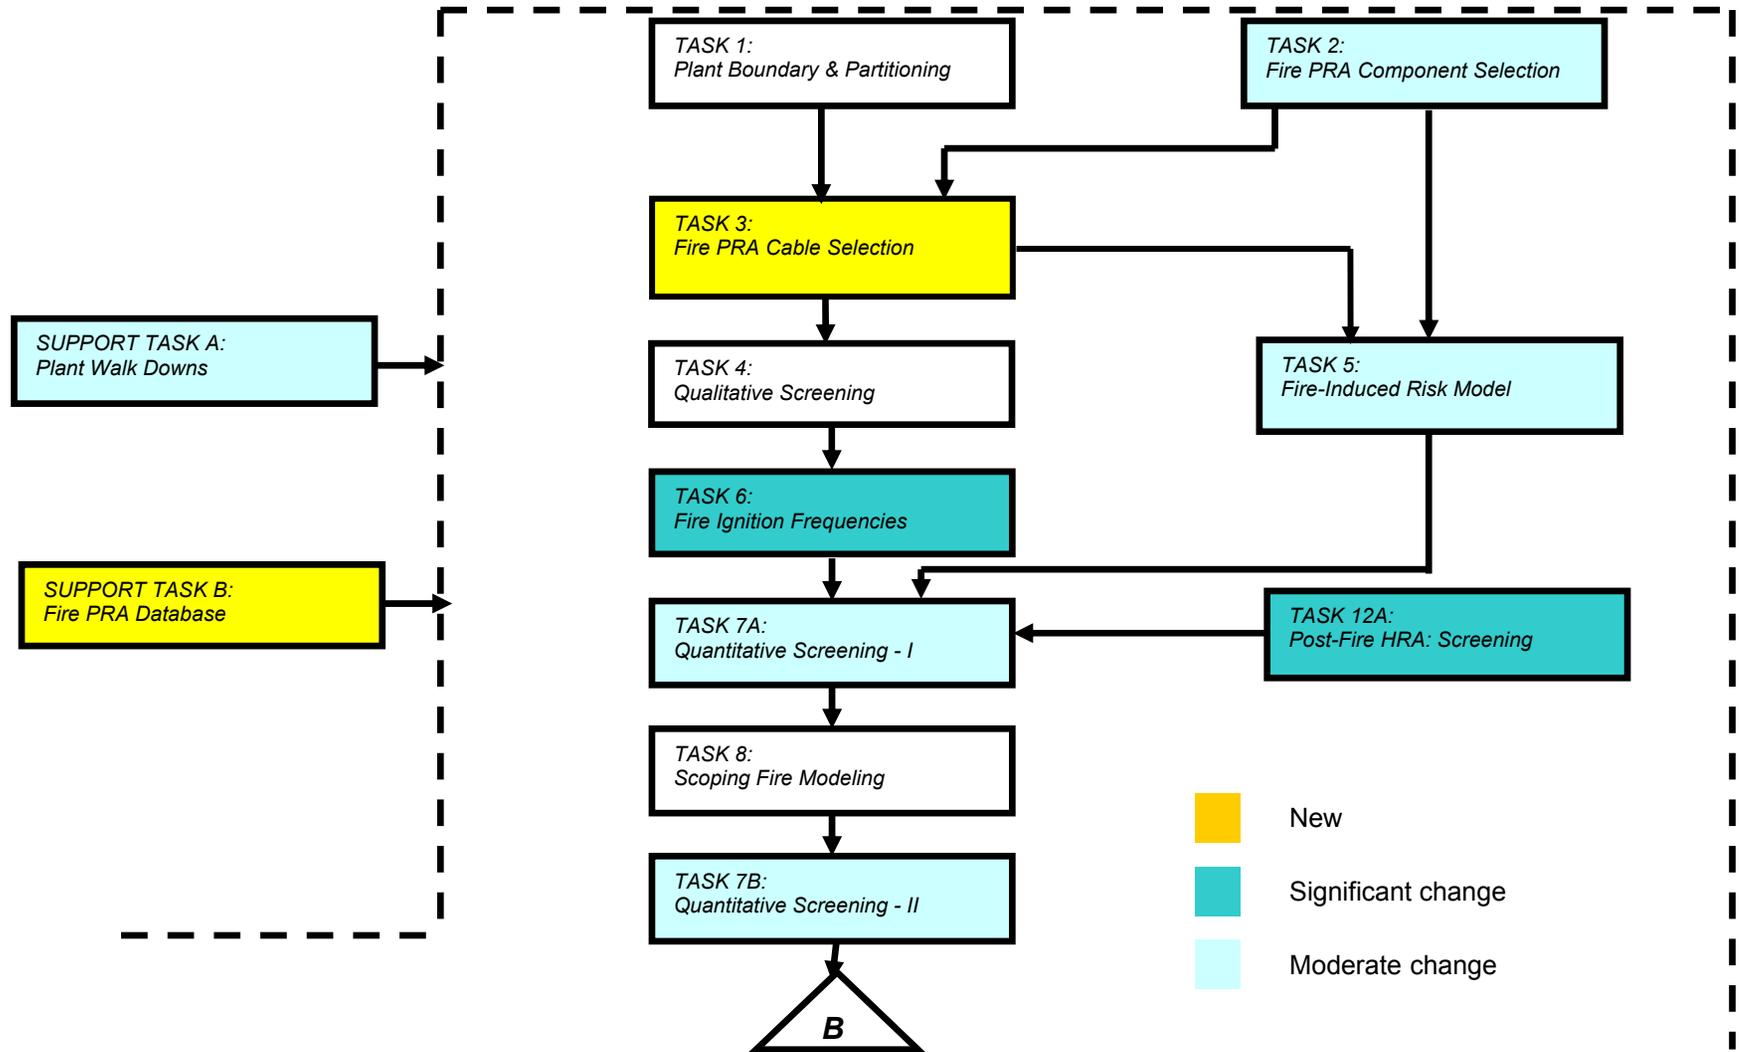


Figure 1
Overview of the Fire PRA Process

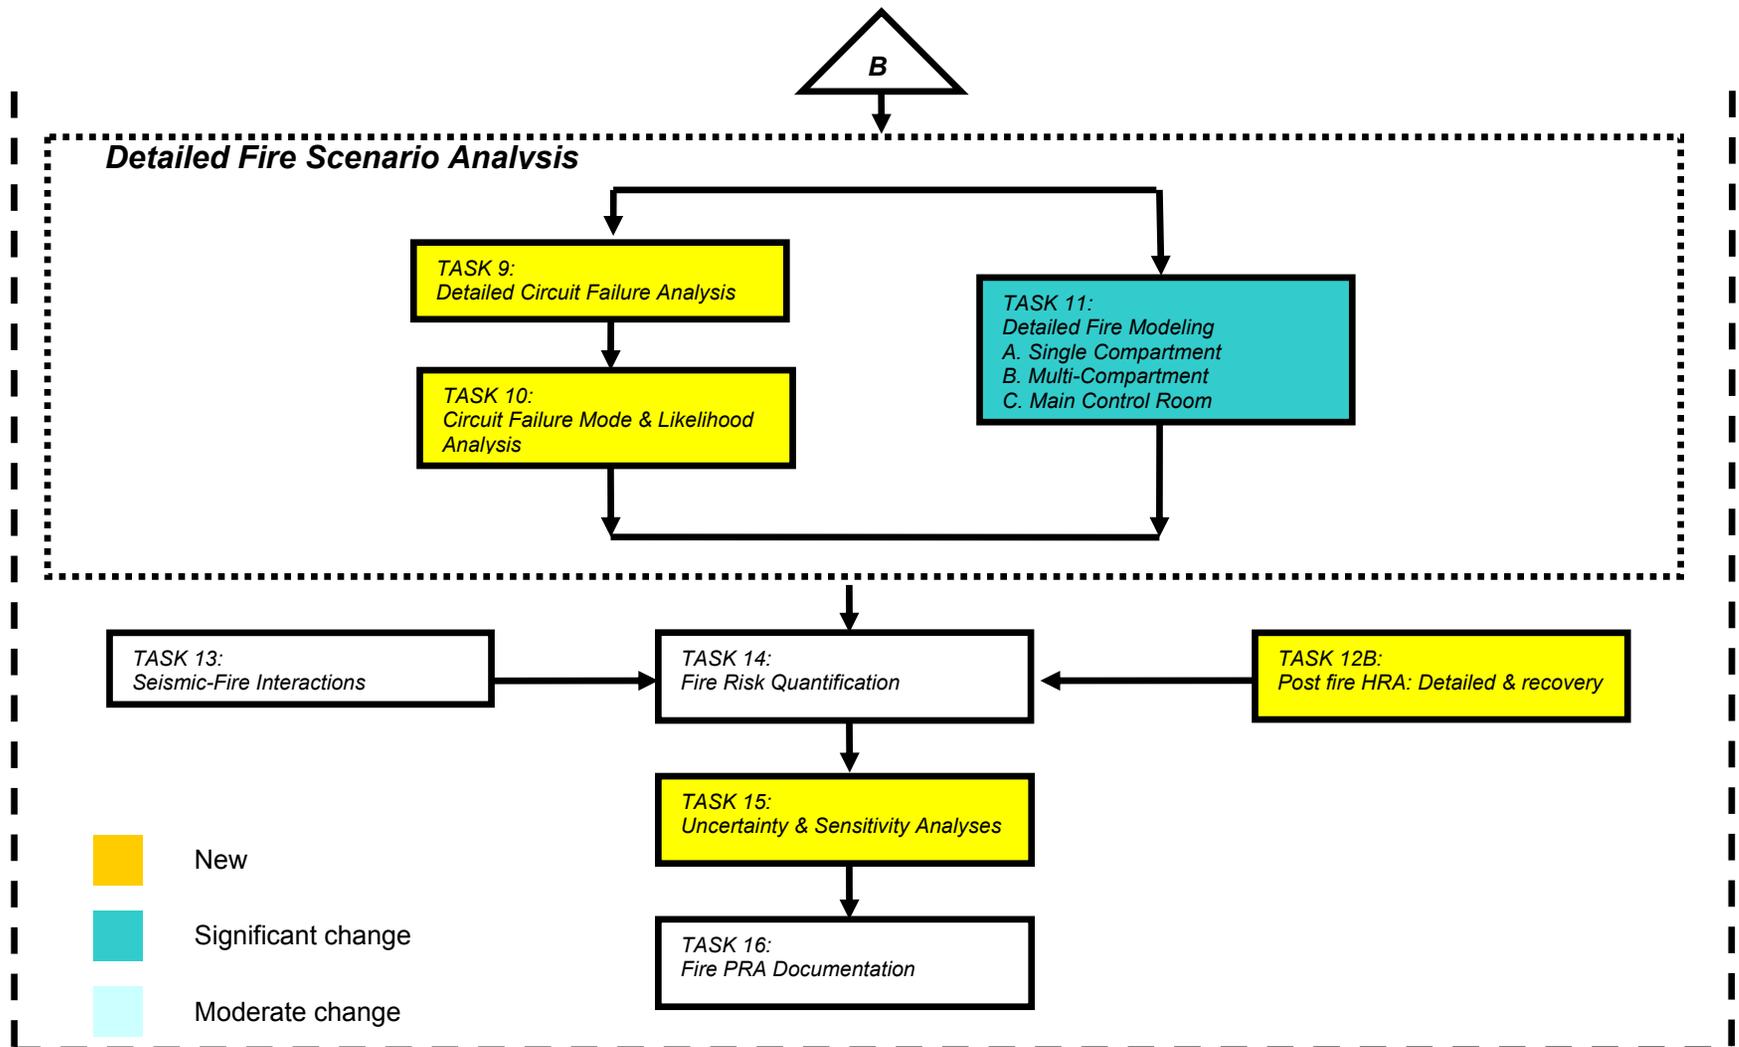


Figure 1
Overview of the Fire PRA Process (Continued)

FOREWORD

Fire probabilistic risk assessment (PRA) methods have been used in the Individual Plant Examinations of External Event (IPEEE) program to facilitate a nuclear power plant examination for vulnerabilities. However, in order to make finer, more realistic decisions for risk-informed regulation, Fire PRA methods needed to be improved. Licensee applications and U.S. Nuclear Regulatory Commission (NRC) review guidance with respect to many regulatory activities such as the risk-informed, performance-based fire protection rulemaking (endorsing National Fire Protection Association Standard 805) will benefit from more robust Fire PRA methods. In order to address the need for improved methods, the NRC Office of Nuclear Regulatory Research (RES) and Electric Power Research Institute (EPRI) embarked upon a program to develop state-of-art Fire PRA methodology.

Under a joint Memorandum of Understanding, RES and EPRI initiated a collaborative, results-oriented research program, the Fire Risk Requantification Study, with the primary objective to develop improved methodology for conducting Fire PRA for a nuclear power plant.

These studies address the full breadth of Fire PRA technical issues for power operations, and include consideration of large early release frequency. The current scope excludes low power/shutdown operations, spent fuel pool accidents, sabotage, and PRA Level 3 estimates of consequence.

Both RES and EPRI have provided specialists in fire risk analysis, fire modeling, electrical engineering, human reliability analysis, and systems engineering for methods development. These improved methods have been applied at pilot plant Fire PRAs to test their viability and effectiveness. Also, the associated procedures have been assessed for technical basis, practicality, and scope by technical review panels comprised of industry participants.

A formal technical issue resolution process was developed to direct the deliberative process between RES and EPRI. The process ensures that divergent technical views are fully considered, yet encourages consensus at many points during the deliberation. Significantly, the process provides that each party maintain its own point of view if consensus is not reached. Consensus was reached on all technical issues documented in this report.

The methodology documented in this report reflects the current state-of-the-art in Fire PRA. These methods are expected to form a basis for risk-informed analyses related to the plant fire protection program. However, such analyses rely upon an evaluation of the condition of fire protection systems and structures which is beyond this methodology, and may need interpretations of this methodology as well.

This document does not constitute regulatory requirements. RES participation in this study does not constitute or imply regulatory approval of applications based upon this methodology.

ACKNOWLEDGMENTS

This work benefited from contributions and considerable technical support from Dominion, American Electric Power, Pacific Gas & Electric, Duke Power, Exelon Corporation, Florida Power & Light, Southern California Edison, Nuclear Management Corporation, and the CANDU Owners Group. The methodology developed was tested at three nuclear facilities in the U.S. The authors extend their gratitude to the staff of these facilities for their support and for sharing their insights gained from use of the methodology. The process benefited significantly from their input.

John Spaargaren (Dominion, Millstone)
Paul Raimondi (Dominion, Millstone)
Joseph Mangeno (Dominion, Millstone)
Fred Ceitek (Dominion, Millstone)
Rasool Baradaran (AEP, DC Cook)
Richard Gray (AEP, DC Cook)
Amir Afzali (PG&E, Diablo Canyon)
Clarence Worrell (PG&E, Diablo Canyon)

The following individuals served on a peer review team that provided review and comments on the interim and final report of this project.

Dennis Henneke (Duke Power)
Christopher Pragman (Exelon Corp.)
Ching Guey (Florida Power & Light)
Sam Chien and Parviz Moini (Southern California Edison)
Robert Ladd (NMC – Point Beach)
Keith Dinnie (formerly with CANDU Owners Group, COG)

The authors extend particular gratitude to Dennis Henneke of Duke Power and Chris Pragman of Exelon Corp. for their tireless review of multiple revisions of the task procedures. Their efforts contributed substantially to the quality and completeness of the final product.

The authors also gratefully acknowledge the technical contributions of Professor Ali Mosleh (University of Maryland) in the development of the fire ignition frequency and uncertainty methods and Dennis Bley (Buttonwood Consulting Inc.) in the development of the post-fire human reliability analysis approach.

LIST OF ACRONYMS

ACB	Air-cooled Circuit Breaker
ACRS	Advisory Committee on Reactor Safeguard
AEP	Abnormal Event Procedure
AFW	Auxiliary Feedwater
AGS	Assistance General Supervisor
AOP	Abnormal Operating Procedure
ATWS	Anticipated Transient Without Scram
BNL	Brookhaven National Laboratory
BWR	Boiling Water Reactor
CCDP	Conditional Core Damage Probability
CF	Cable (Configuration) Factors
CCPS	Center for Chemical Process Safety
CCW	Component Cooling Water
CDF	Core Damage Frequency
CFD	Computational Fluid Dynamics
CFR	Code of Federal Regulations
CLERP	Conditional Large Early Release Probability
CM	Corrective Maintenance
CR	Control Room

CRS	Cable and Raceway (Database) System
CWP	Circulating Water Pump
EDG	Emergency Diesel Generator
EF	Error Factor
EI	Erroneous Status Indicator
EOP	Emergency Operating Procedure
EPR	Ethylene-Propylene Rubber
EPRI	Electronic Power Research Institute
FEDB	Fire Events Database
FEP	Fire Emergency Procedure
FHA	Fire Hazards Analysis
FIVE	Fire-Induced Vulnerability Evaluation (EPRI TR 100370)
FMRC	Factory Mutual Research Corporation
FPRAIG	Fire PRA Implementation Guide (EPRI TR 105928)
FRSS	Fire Risk Scoping Study
FSAR	Final Safety Analysis Report
HEAF	High Energy Arcing Fault
HEP	Human Error Probability
HFE	Human Failure Event
HPI	High Pressure Injection
HPCI	High Pressure Coolant Injection
HRA	Human Reliability Analysis
HRR	Heat Release Rate
HTGR	High Temperature Gas-cooled Reactor

HVAC	Heating, Ventilation, and Air Conditioning
ICDP	Incremental Core Damage Probability
ILERP	Incremental Large Early Release Probability
INPO	Institute for Nuclear Power Operations
IPE	Individual Plant Examination
IPEEE	Individual Plant Examination for External Events
IS	Ignition Source
ISLOCA	Interfacing Systems Loss of Coolant Accident
KS	Key Switch
LCO	Limiting Condition of Operation
LERF	Large Early Release Frequency
LFL	Lower Flammability Limit
LOC	Loss of Control
LOCA	Loss of Coolant Accident
LPG	Liquefied Petroleum Gas
LWGR	Light-Water-cooled Graphite Reactors (Russian design)
MCC	Motor Control Center
MCR	Main Control Room
MG	Motor-Generator
MFW	Main Feedwater
MOV	Motor Operated Valve
MQH	McCaffrey, Quintiere and Harkleroad's Method
MS	Main Steam
NC	No Consequence

NEI	Nuclear Energy Institute
NEIL	Nuclear Electric Insurance Limited
NFPA	National Fire Protection Association
NPP	Nuclear Power Plant
NPSH	Net Positive Suction Head
NQ cable	Non-Qualified (IEEE-383) cable
NRC	Nuclear Regulatory Commission
P&ID	Piping and Instrumentation Diagram
PE	Polyethylene
PM	Preventive Maintenance
PMMA	Polymethyl Methacrylate
PORV	Power Operated Relief Valve
PRA	Probabilistic Risk Assessment
PSF	Performance Shaping Factor
PTS	Pressurized Thermal Shock
PVC	Polyvinyl Chloride
PWR	Pressurized Water Reactor
Q cable	Qualified (IEEE-383) cable
RBMK	Reactor Bolshoy Moshchnosty Kanalny (high-power channel reactor)
RCIC	Reactor Core Isolation Cooling
RCP	Reactor Coolant Pump
RCS	Reactor Coolant System
RDAT	Computer program for Bayesian analysis
RES	The Office of Nuclear Regulatory Research (at NRC)

RHR	Residual Heat Removal
RI/PB	Risk-Informed / Performance-Based
RPS	Reactor Protection System
RWST	Refueling Water Storage Tank
SCBA	Self-Contained Breathing Apparatus
SDP	Significance Determination Process
SGTR	Steam Generator Tube Rupture
SI	Safety Injection
SMA	Seismic Margin Assessment
SO	Spurious Operation
SOV	Solenoid Operated Valve
SRV	Safety Relief Valve
SSD	Safe Shutdown
SSEL	Safe Shutdown Equipment List
SUT	Start-up Transformer
T/G	Turbine/Generator
TGB	Turbine-Generator Building
TSP	Transfer Switch Panel
UAT	Unit Auxiliary Transformer
VCT	Volume Control Tank
VTT	Valtion Teknillinen Tutkimuskeskus (Technical Research Centre of Finland)
VVER	The Soviet (and now, Russian Federation) designation for light water pressurized reactor
XLPE	Cross-Linked Polyethylene
ZOI	Zone of Influence

1

PLANT BOUNDARY DEFINITION AND PARTITIONING (TASK 1)

1.1 Purpose

For the purposes of a Fire Probabilistic Risk Assessment (PRA), the plant is divided into a number of fire compartments. The analysis then considers the impact of fires in a given compartment, and fires that might impact multiple compartments. This procedure establishes the process for defining the global plant analysis boundary and partitioning of the plant into fire compartments. The product of this task will be a list of plant fire compartments in the nuclear power plant under analysis.

1.2 Scope

The work package developed to support the plant-partitioning task should address the following issues:

- Basis for and identification of the limits of the selected global plant boundary,
- Basis for and results of partitioning the selected global plant boundary into fire compartments,
- Mapping of fire compartments to plant fire areas defined in regulatory compliance activities, and
- Documentation of the basic features of some or all fire compartments.

1.3 Background Information

1.3.1 General Task Objectives and Approach

The objectives of the partitioning task are to (1) define the global plant analysis boundaries relevant to the Fire PRA, and (2) divide the plant into discrete physical analysis units (fire compartments). The fire compartments form the fundamental basis of the subsequent Fire PRA. That is, the Fire PRA will initially consider fire threats to safe shutdown primarily in the context of the defined fire compartments. The results of the Fire PRA will be presented in terms of the risk contribution for fires confined to a single compartment and for fires that impact multiple adjacent compartments.

A fire compartment is a well-defined enclosed room, not necessarily with fire barriers. Fire compartments generally fall within a fire area, and are bounded by non-combustible barriers where heat and products of combustion from a fire within the enclosure will be substantially confined. Boundaries of a fire compartment may have open equipment hatches, stairways, doorways or unsealed penetrations. The term fire compartment is defined specifically for fire risk analysis and maps plant fire areas and/or zones, defined by the plant and based on fire protection systems design and/or operations considerations, into compartments defined by fire damage potential. For example, the control room complex or certain areas within the turbine building may be defined as a compartment.

The preceding discussion provides sample criteria for defining fire compartments when partitioning a plant for Fire PRA.

One of the most important effects of the plant partitioning process is in relation to the qualitative and quantitative screening tasks. Qualitative screening (Task 4) assesses each compartment, assuming that fires confined to that single compartment will fail all safe shutdown (SSD) components and cables in the compartment. Similar assumptions are made in the first quantitative screen (Task 7), and again, compartments are screened as individual contributors. Multi-compartment scenarios are also explicitly screened and/or analyzed based on the compartment definitions, and in particular, postulating failure of the partitioning elements that define each compartment. Hence, the definition of fire compartments is critical to the analysis. It is important that fire compartments be defined in a reasonable manner that appropriately supports the Fire PRA.

The partitioning process involves two competing considerations that should be balanced by the analyst. Partitioning the plant into a greater number of compartments has potential advantages, in that each individual compartment may be easier to analyze as an individual risk contributor. This does, however, increase the burden for the analysis of multi-compartment fire scenarios. Defining a smaller number of larger compartments also has advantages in certain cases, particularly for areas that the analyst expects might screen during qualitative screening (Task 4) or during initial quantitative screening (Task 7).

Ideally, the combination of individual compartment analyses and multi-compartment analyses will reach the same final numerical estimates of the plant-wide fire risk, regardless of how the partitioning was performed. This will be accomplished since identification and analysis of multi-compartment fire scenarios will begin with all fire compartments that are screened, qualitatively or quantitatively. In practice, an ideal consistency may be difficult to achieve and/or demonstrate. Furthermore, the partitioning decisions impact the presentation and interpretation of the Fire PRA results in terms of single and multi-compartment fire scenario contributions. Excessive partitioning, beyond that recommended in Section 1.5.2, may appear to artificially dilute the contribution of a given room to fire risk, and should be avoided. When in doubt, retention of larger and more clearly delineated fire compartments is generally considered the more conservative approach.

1.3.2 Assumptions

The partitioning task assumes that a range of fire protection features will be effective at containing the damaging effects of a fire under most fire conditions. These features include fire-rated barriers, non-fire-rated barriers, active features, such as water curtains, and in some cases spatial separation. The potential failure of a credited partitioning feature is addressed in the multicompartment fire scenario analysis task (see Task 11).

1.4 Task Interfaces

1.4.1 Input from Other Tasks

No input from other activities in the Fire PRA is necessary for the definition of the global plant boundary and partitioning of the plant into fire compartments.

1.4.2 Additional Plant Information Needed to Support this Task

In preparation for the partitioning task, the analyst should possess substantial knowledge of the plant layout, the characteristics of compartment boundary elements, and the general location of plant systems and equipment. For multiunit sites, a general knowledge of the extent to which systems, components, cables, and areas are shared between units is also needed.

Plan and elevation views of different buildings in the plant, as well as walkdowns, may be used to perform this task.

1.4.3 Walkdowns

Confirmatory walkdowns will be necessary to complete the partitioning process, although these walkdowns may be deferred pending the identification of walkdown needs associated with other analysis tasks (e.g., fire ignition frequency analysis and fire modeling tasks). Step 3 of this task and Support Task A provide additional information about the recommended walkdown.

1.4.4 Outputs to Other Tasks

The list of fire compartments developed in this task is used throughout the balance of the Fire PRA. The partitioning decisions made in this task define the physical plant analysis units (the fire compartments) –that form the fundamental basis of the Fire PRA.

1.5 Procedure

1.5.1 Step 1: Selection of Global Plant Analysis Boundary

The partitioning task begins with a liberal definition of plant areas of potential interest to the Fire PRA; the global plant boundaries. The definition of the global plant analysis boundary should be a relatively straightforward exercise. The intent is to define this boundary so that all locations with the potential to contribute visibly to fire risk are captured. Hence, the global plant analysis boundary is defined in a broadly inclusive manner. Unimportant areas within this boundary will be readily identified and eliminated from further analysis during the early screening tasks (e.g., Tasks 4 and 7).

It is likely that various areas covered by global plant analysis boundary will actually contain no equipment of interest to the Fire PRA. These areas will likely screen during qualitative screening (Task 4). For such areas, there is no benefit to be gained by additional partitioning of the area. For example, an administrative office building or warehouse within the protected boundary may be identified as a single fire compartment, even though there is extensive internal partitioning of the building. Such buildings will likely screen, and further partitioning of the building would not benefit the analysis.

The global plant analysis boundary should encompass all areas of the plant associated with both normal and emergency reactor operating and support systems, as well as power production (e.g., the turbine building). Note that for multiunit sites, the global plant analysis boundary should initially encompass all units. Some refinement of this decision may be appropriate in cases where sister units are physically and functionally separated (no shared areas, no shared systems, no shared components and associated cables, no conjoined areas) and where the analysis is limited to one unit. Upon confirmation of unit separation, the global analysis boundary might be reduced to encompass only the unit under analysis.

Selection of the global plant analysis boundary should begin with the protected areas of the plant. For most sites, this should be sufficient to capture the important fire risk contributors. However, a review should be performed to ensure that locations not included within the protected area could not contribute to fire risk. In particular, the plant analysis boundary should encompass all locations that house any of the Fire PRA components and cables identified in Tasks 2 and 3 (Fire PRA Equipment Selection and Fire PRA Cable Selection, respectively).

1.5.2 Step 2: Plant Partitioning

The global plant analysis boundary defined in Step 1 should be divided into fire compartments using the definition of fire compartment (see Section 1.3.3). The process for defining fire compartments should start with existing plant partitioning as documented, for example, in regulatory compliance documents associated with the plant fire protection program. This information is generally documented in the plant Fire Hazards Analysis (FHA) or other equivalent compliance documentation, and will typically divide the plant into fire areas. The FHA may also identify fire zones within the fire areas. Partitioning decisions should not, however, be finalized until one or more confirmatory walkdowns have been performed.

As noted above, fire areas defined in a regulatory context should satisfy the criteria of fire compartments in the context of the Fire PRA. However, care should be exercised in accepting fire zones as equivalent to fire compartments. Fire zones may be defined in the context of a fixed fire protection system, i.e., the zone of coverage. A fire zone may not satisfy the fire compartment definition.

Where possible, the use of a consistent naming scheme for fire compartments with an existing fire area (or zone, if appropriate) names will facilitate plant familiarity with this new subdivision. That is, it is highly desirable to utilize the fire area (or zone) designations identified in fire protection program compliance efforts when designating fire compartments. For example, if “Fire Area 25” is partitioned into three fire compartments, a consistent naming scheme for these compartments, e.g., 25A, 25B, 25C, should be employed. If a fire compartment maps to a fire zone, the fire zone designations should be used. In all cases, fire compartments should be traceable to one (or more) plant fire area(s) or zone(s).

Upon completion of the partitioning task, no two partitioned volumes should overlap each other. That is, each location within the plant analysis boundary should map to exactly one fire compartment.

For multiunit sites, specific consideration of shared components, systems, and/or areas is needed. The final treatment of such issues may need some iteration on partitioning. For multiunit sites, one may be analyzing one or more units. In either case, for the purposes of initial partitioning, shared fire areas should be identified and partitioned, as well as other areas of the unit(s) being analyzed. Note that a shared fire area should not be partitioned based only on segregation of one unit’s components from those of another unit.

If more than one unit is being analyzed, the shared compartments should be identified as being associated with each unit, as applicable. However, compartment definitions should be consistent between the two units for such shared areas. If only one unit is being analyzed, it may be appropriate to partition the balance of the sister unit(s) (e.g., those areas that are not shared) as a single compartment in anticipation of screening those areas during qualitative screening (Task 4).

To ensure completeness and to avoid double accounting, the partitioning process should comply with the following:

- The collection of defined fire compartments should cover all areas encompassed by the global plant analysis boundary (as defined below), and
- No two fire compartments should share the same space, i.e., each location within the global plant analysis boundary should map to one, and only one, fire compartment.

In the effort to partition the plant into fire compartments, the analyst will encounter a wide range of field conditions and will address unique applications/needs with respect to the Fire PRA. Definitive sets of partitioning criteria (i.e., rules for defining compartment boundaries) have not been found that can cover all potential field conditions and applications. The Fire PRA process is designed to minimize the level of effort spent on low fire risk areas of the plant and maximizes the level of detail used to analyze high-risk areas. Therefore, analyst judgment is necessary for plant partitioning.

The Fire PRA process is facilitated if the compartments are defined to minimize the need for defining and analyzing multicompartment fires (i.e., damage to SSD components and cables in more than one compartment). This feature allows the analysis to focus primarily on individual fire compartments and minimizes the level of effort expended on identifying and analyzing multicompartment fire scenarios that may be risk significant.

As a starting point, the analyst should identify the fire areas defined in the context of the plant's regulatory compliance fire protection program. The fire area definitions used in regulatory compliance should readily satisfy the PRA fire compartment partitioning criteria. However, caution should be used in applying fire zone definitions as in other contexts. In particular, fire zones may be associated with the "zone of coverage" of a fire detection or suppression system, and these zones may not correspond to partitioning elements, i.e. fire compartments applicable to a Fire PRA.

Individual fire areas can be retained in total as fire compartments without further partitioning. However, with proper justification, a fire area may be partitioned into two or more fire compartments. In some rare cases, it may also be advantageous to combine two or more fire areas into a single fire compartment, particularly if the combined compartment is expected to have a minimal risk contribution (e.g., it may screen at an early stage of the analysis).

As defined above, a fire compartment is a "well-defined volume within the plant ... that is expected to substantially contain the adverse effects of fires within the compartment." The terms "well-defined volume" and "substantially contain" are obviously imprecise. It is the interpretation of these terms that needs the analyst's judgment.

In ideal terms, a well-defined volume would correspond to an enclosed room or to an area separated by permanent physical partitions. However, features other than permanent physical partitions may also be credited in partitioning (see further discussion below). Regardless of the partitioning elements credited, the defined compartment should represent a clearly distinguishable area of the plant. In general terms, "substantially contain" should be interpreted in the context of fire plume development, the development of a hot gas layer, direct radiant heating by the fire, and the actual spread of fire between contiguous or noncontiguous fuel elements. That is, a fire compartment should substantially contain these fire behaviors.

It is acknowledged and accepted that smoke from a fire may spread beyond a fire compartment. It is also acknowledged and accepted that the fire itself may spread beyond a fire compartment, given failure of credited partitioning feature (this behavior is treated in the multicompartment fire analysis). However, the credited partitioning features should assure that the spread of fire and damage to the adjacent compartments is highly unlikely, even if the fire is not promptly suppressed.

Partitioning features that would clearly meet the fire compartment definition include the following.

- Any fire barrier with a minimum fire protection endurance rating of one hour can be credited in partitioning. This assumes that all elements of the fire barrier meet this minimum rating (e.g., doors, penetration seals, etc.).

- Any partition that, while not explicitly rated as a fire barrier, is substantial enough to meet the conditions defining one-hour fire endurance rating can be credited in partitioning. For example, a well-sealed concrete wall with a minimum thickness of 4 inches would be considered an adequate partition in the Fire PRA context, even if it lacks an explicit fire rating.

Features that should not be credited in partitioning include the following:

- Partial height walls or barriers—these may extend from the floor upward, or from the ceiling downward (this is not intended to, a-priori, exclude the crediting of walls with small unsealed gaps, typically below ceiling),
- Beam pockets,
- Radiant heat shields, and
- Equipment obstructions, e.g., pipes.

Beyond these simple examples, judgment may be necessary. The following examples are the types of considerations that will likely be encountered.

- **Open doorways:** Various walls that otherwise meet the partitioning criteria may have open doorways. In general, the existence of an open doorway does not preclude the crediting of the wall in partitioning. However, the analyst should consider whether or not combustible fuels exist in close proximity to one or both sides of the opening. An example would be an open doorway with cables directly above one or both sides of the doorway. In this case, hot gasses passing through the open doorway might ignite these cables, and crediting of the partition may not be appropriate.
- **Unsealed cable penetrations:** Various partitions (walls and floor/ceiling elements) may contain unsealed openings through which cables pass (note that an unsealed opening would imply that the partition is not a rated fire barrier). Unprotected cables represent a likely path for direct fire spread. Hence, it is likely inappropriate to credit a partitioning element that contains unsealed cable penetrations through which unprotected cables pass. Particular care should be exercised when the openings involve vertical cable runs, given the enhanced fire spread rate associated with vertical cables. Note that in this context, additional credit might be taken if either a fire wrap or fire-retardant coating protects the cables, or the cables are all routed in conduits.
- **Grating:** In many cases, various elevations of a given plant area may be separated by incomplete floor/ceiling structures, especially where portions of the floor/ceiling are covered by metal grating (these openings are often related to the building's ventilation flow). In such cases, the floor/ceiling might still be credited in partitioning, but consideration should be given to the size of openings. If openings represent a substantial fraction of the total partition area, or are of substantial size in an absolute sense, it may be inappropriate to credit the partition in defining compartments. The analysis should also consider the cumulative size of multiple openings.
- **Open stairwells:** Open stairwells may connect various levels of a building. In general, the existence of an open stairwell would not preclude partitioning of the region by floor. However, the analyst should consider the proximity of fire ignition and fuel sources to the stairwell.

- Spatial separation, outdoor locations: In exterior locations, spatial separation is an acceptable basis for partitioning. For example, the switchyard is often partitioned as a separate fire compartment from other outdoor areas. Outdoor areas do not involve the potential development of a hot gas layer, but are instead dominated by radiant heating of nearby objects. Hence, spatial separation should be considered in the context of radiant heating.
- Spatial separation, indoor locations: Spatial separation for interior (or covered) spaces is a particularly difficult challenge with respect to partitioning. Note that spatial separation that may be acceptable in the context of regulatory compliance (e.g., the Appendix R of 10 CFR Part 50, 20' separation criteria or a regulatory deviation or exemption) is not, a-priori, an acceptable basis for Fire PRA partitioning. However, in some cases, spatial separation may represent an acceptable basis for plant partitioning. In general terms, spatial separation should only be credited in very large volume spaces with minimal combustible fuel loads, e.g., areas where the potential for developing a damaging hot gas layer can be dismissed. The separation available should be extensive and free of both combustibles and fire ignition sources, i.e., there should be no path for direct fire spread and essentially no potential for damaging radiant heating effects. In the case of vertical separation, the potential for damage or fire spread due to flame zone and fire plume effects should also be considered. The analyst should also be prepared to have partitioning decisions based on spatial separation challenged during review. Hence, clear documentation of the bases for such decisions is needed. Typical applications where spatial separation has been credited in a Fire PRA include the main turbine deck, boiling water reactor (BWR) reactor buildings, and containment.

Another factor that should be considered in the partitioning exercise is the level of detail available for mapping Fire PRA components and cables within the plant. Ultimately, the analyst will map Fire PRA components and cables to specific fire compartments, and possibly to specific locations within a fire compartment. If the information available cannot support this mapping to the level of partitioning exercised in this task, the value of the additional partitioning is reduced.

Partitioning is most helpful when specific fire ignition sources are segregated from specific Fire PRA components and cable damage targets in such a way that they can be partitioned into separate fire compartments. If appropriate segregation cannot be assured, e.g., due to a lack of detailed cable routing information, then additional partitioning may provide little benefit to the analysis.

For example, if the plant cable routing information only traces cables to the level of their existence in, or exclusion from, a given fire area, partitioning beyond fire areas may provide little benefit to the Fire PRA. If cable locations within a fire area are not known, then conservative assumptions regarding potential cable damage will need to be made. As a result, the potential damage states assumed in the analysis will be essentially identical for each scenario developed in that fire area, regardless of the assigned partitions within the fire area.

There are at least two potential exceptions to this observation. First, additional partitioning may be desirable if additional routing information will be developed as a part of the Fire PRA. This might also apply even if the information will not be developed immediately, but is anticipated in support of potential future applications. Second, additional partitioning may be desirable if it helps to more clearly focus the analysis. For example, if most of the significant fire ignition sources in a fire area are confined to one or more compartments within the area, then additional partitioning may be desirable. That is, if the balance of the fire area lacks substantial fire ignition

sources, the analysis may conclude that the partitioned compartment was the primary source of fire risk for the fire area. This kind of insight might be useful in various applications.

1.5.3 Step 3: Compartment Information Gathering and Characterization

The partitioning task includes at least one plant walkdown designed to confirm the partitioning decisions. That is, the primary purpose of the walkdown is to confirm the existence and integrity of the partitioning features and elements credited in defining each fire compartment. The confirmatory walkdown provides an opportunity to adjust and finalize the compartment definitions.

The confirmatory walkdown also provides an opportunity to gather basic information regarding each defined fire compartment. The information gathered facilitates development of the Fire PRA database (Support Task B), compartment fire ignition frequencies (Task 6), and fire modeling (Tasks 8 and 11). The information desirable to document for future reference includes:

1. Compartment boundary characteristics (e.g., walls, ceiling, floor, doors, penetrations, dampers, etc.);
2. Ventilation features, and connections;
3. Fire protection features (e.g., detection, suppression, localized raceway fire barriers, etc.);
4. Fire source hazards (ignition and fuel source types and numbers);
5. Identification of all adjacent compartments (above, below, and to all sides);
6. Identification of components/systems/cables in each fire compartment;
7. Access routes to the fire compartment (e.g., for manual firefighting or for operator actions); and
8. SSD human actions credited in each compartment.

The level of information needed increases as the analysis progresses, and hence, may vary depending on the nature of each compartment. The level of documentation desired may also vary depending on the intended application. For example, minimal documentation would typically be needed for a stand-alone administrative/office building that is expected to screen out during qualitative screening (Task 4).

1.5.4 Step 4: Documentation

The steps performed under this task should be documented in a work package. The work package should contain the following.

- A list of all examined locations within the plant that provides the basis for excluding plant locations—i.e., characterize the global plant analysis boundary.
- A list of all fire compartments, map each fire compartment to plant fire areas/zones, and provide the basis, where necessary, for defining fire compartments.
- A simple set of general plant layout drawings that identify the fire area and fire compartment boundaries.
- Documentation of the confirmatory walkdown(s), including findings, participating personnel, and basic characterization information for the defined compartments (commensurate with the objectives of the Fire PRA and its intended applications).

2

FIRE PRA COMPONENTS SELECTION (TASK 2)

2.1 Purpose

This section provides the procedure for creating the Fire PRA Component List. This list serves as the basis for those components modeled in the Fire PRA, and it is the key source of information for which corresponding cables need to be identified and located for the Fire PRA. As such, the Fire PRA Component List, Fire PRA Model, and corresponding cable identification are iterated upon to ensure an appropriate correspondence among these three items. The product of this task is a list of the equipment to be included in the Fire PRA and for which corresponding cables need to be identified and located for the nuclear power plant under analysis.

2.2 Scope

This procedure addresses creating the Fire PRA Component List, which needs to span (a) equipment that, if affected by a fire, will cause an initiating event such that the appropriate fire-induced initiators can be defined; (b) all equipment necessary to support those mitigating functions and operator actions that are credited in the analysis in response to any initiator, as well as (c) that equipment which can be a source of undesirable responses adverse to safety during a fire-induced accident sequence, such as a component that can spuriously operate . The terms “equipment” or “components” as used in this procedure are considered synonymous and meant to include plant components such as valves, fans, pumps, etc.; structures; barriers; indicators; alarms; and other devices as appropriate. It is recommended that all the equipment credited in the Internal Events PRA (especially equipment in electrically diverse systems) be included in the Fire PRA Component List. More specifically, the scope of the Fire PRA Component List should include the following major categories of equipment:

- Consideration of equipment whose fire-induced failure will cause an initiating event to be modeled in the Fire PRA Model (in this case, the appropriate initiator for a compartment needs to be defined, not that the equipment itself has to be modeled);
- Equipment to support the success of mitigating safety functions credited in the Fire PRA, including equipment implicitly included in Internal Events PRA recovery models;
- Equipment to support the success of operator actions credited in the Fire PRA;
- Equipment whose spurious actuation or other fire-induced failure modes could have an adverse effect on the success of the mitigating safety functions credited in the Fire PRA; and
- Equipment whose spurious operation or other fire-induced failure modes could likely induce inappropriate or otherwise unsafe actions by the plant operators during a fire damage sequence.

In many cases, the same equipment might be in several of the five major categories. For example, the reactor vessel safety relief valves (SRVs) in a boiling water reactor (BWR) may be credited to open in the analysis for emergency depressurization purposes. However, should the SRVs subsequently close due to a fire-induced failure mode or open when not desirable, they can be a source of an undesirable response during a fire and may cause a plant trip. For these reasons, the SRVs would be on the Fire PRA Component List. Sometimes the equipment may only relate to one or two categories. For example, the residual heat removal (RHR) high-low pressure interfacing valves in a pressurized water reactor (PWR) may not be needed to perform a safety function if the shutdown cooling mode is not credited in the fire analysis. However, fire-induced opening of these valves, if they remain powered, could cause an interfacing LOCA (initiator) and possibly cause environmental-related failure of other systems that are credited in the analysis. For this reason, and because such a failure could potentially lead to a high consequence event involving both core damage and containment bypass (see more on such cases in Section 2.5.6), the RHR interfacing valves would be on the Fire PRA Component List.

Similarly, a limited set of mitigating equipment, as well as instrumentation and diagnostic equipment such as indicators, lights, alarms, and similar devices considered necessary to support successful operator actions (e.g., such as carrying out the Emergency Operating Procedures (EOPs), following specific Fire Emergency Procedures (FEPs), or to credit certain recovery actions), or the failure of which could cause inappropriate operator actions, should also be added to the Fire PRA Component List (more on this in Section 2.5.5). Examples could be remote shutdown panel (or areas) equipment and controls, pump room high temperature alarms, certain plant parameter indications with no or little redundancy in the indication, among others.

Because a key emphasis of the Fire PRA Component List is to identify and track relevant cables in Task 3 that could be affected by fires in the plant, the list need not contain passive/mechanical equipment (i.e., non-electrical components) deemed by the analyst to be unaffected by fires. Such equipment may be manual valves, check valves, filters, heat exchangers, tanks, etc. (However, note that temperature, level, or other indications associated with this equipment may need to be on the list for operator action purposes). It is recommended that as part of this procedure, the analyst has identified those types of passive/mechanical equipment that do not need to be on the Fire PRA Component List, even though the equipment may be in the Fire PRA Model with regard to other mechanical failures, such as random plugging. The plant's existing fire analyses or the internal flooding PRA will typically have a similar list of component types not considered affected by fires or flooding, and should be good starting points for creating a list of components not vulnerable to fire. In considering components that should not be affected by a fire, any potential damage to valve packing and other valve internals, filter materials, etc., should not be possible or at least not prevent the equipment's operation, should it be necessary. As part of identifying whether non-electrical equipment is or is not vulnerable to fire effects, the analyst should also be sensitive to identifying such situations as instrument air piping/tubing that is copper or has soldered joints that may fail under high heat conditions and thus fail the instrument air function. In such cases, the PRA model needs to reflect these possible non-electrical equipment failures for applicable compartment fires.

2.3 Background Information

2.3.1 General Task Objectives and Approach

This task's primary purpose is to determine that equipment for which cable identification and location is necessary. This is needed in order to identify what equipment fires in various locations may affect. A fall-out of creating the Fire PRA Component List is determining the majority of the equipment scope in the Fire PRA Model subject to that equipment which is screened out in subsequent tasks or does not need cabling information.

In order to arrive at the Fire PRA Component List, the two most significant inputs available are used to start creating such a list; the Internal Events PRA (with knowledge of any unique aspects from any existing Fire PRA) and the Fire Safe Shutdown Analysis (e.g., called Appendix R of 10 CFR Part 50 Analysis at some plants). Together, these two inputs provide much of what is needed for the Fire PRA. However, because these two analyses were performed for different purposes, this procedure calls for a reconciliation to make sure the differences are appropriately considered. Steps 1 and 2 of this procedure address the analysis activities to start the Fire PRA Component List from the Internal Events PRA and how to perform the reconciliation between the Internal Events PRA and the Fire Safe Shutdown Analysis. Where options are available to the analyst in carrying out these steps, those options and corresponding considerations are offered.

Steps 3 through 6 address how to build on the product of Steps 1 and 2 and more completely identify the equipment of interest. As in the earlier steps, where options are available to the analyst in carrying out each step, they are noted and briefly discussed.

All the options can be generally considered as tradeoffs between the level of accuracy and completeness of the Fire PRA vs. the resources needed to achieve that level. The latter steps in the procedure are largely additions to the Fire PRA Component List from Steps 1 and 2 to make the list more complete and to ensure no potentially important equipment has been missed. For instance, Steps 4 and 5 address the potential for spurious equipment operation or malfunctions that could affect system performance and/or operator performance during the response to a fire. Such spurious operations are usually too improbable for consideration in the Internal Events PRA, but in the case of a fire, multiple spurious equipment operations or malfunctions may be somewhat likely and cannot easily be dismissed. Step 6 addresses the special subject of equipment whose failure may cause "potentially high-consequence" events to ensure this equipment is included in the list.

Finally, Step 7 covers the documentation of the Fire PRA Component List.

2.3.2 Assumptions

The following key assumptions underlie the use of this procedure.

- A good, quality Internal Events PRA and Fire Safe Shutdown Analysis are available.
- The analysts, collectively, have considerable knowledge and understanding of the plant systems and operator performance, as well as the Internal Events PRA and the Fire Safe Shutdown Analysis, and/or have access to other staff that can provide such input.
- The scope and number of spurious equipment operations or malfunctions of concern can easily grow to proportions that are unreasonable to address without unlimited resources. An approach for addressing this subject is found under Steps 4 and 5, with additional considerations provided in Appendix A. In carrying out those steps, it is assumed the analysts will:
 - As a minimum –
 - (a) identify cases where the spurious actuation or mal-operation of any single component within each system would affect a safe shutdown function (e.g., spurious actuation of a valve in the AFW system which creates a flow diversion path in AFW), and
 - (b) identify cases where a single indicator/alarm associated with a particular operator action of interest would cause an undesirable operator action (e.g., a spuriously operating high-temperature pump motor alarm leading to the operator shutting down the pump);
 - And then as resources allow –
 - expand the above search within each system or for operator actions of interest to simultaneous “doubles,” “triples,” or even more combinations of spurious operations or failures (e.g., multiple valves, multiple indicators). However, as a practical matter, going beyond “triples” or even “doubles” may prove unwieldy and of little value considering the reasonably low likelihood of three or more affected devices at the same time. For instance, there may be reasons that the likelihood of spurious operation of a component(s) can easily be judged to be low and thus not worthy of consideration (e.g., by looking ahead and implementing criteria in Steps 4 and 5 that address ways to limit the number of coinciding spurious events to be considered).

It is not expected that these searches will cross system boundaries (e.g. a spurious operation of a high pressure injection (HPI) isolation valve with a spurious operation of an AFW valve) or involve multiple operator activities. Keeping within this framework is analogous to the current state-of-the-art for treating common cause failures in Internal Events PRAs (identified within each system boundary), and thus is considered appropriate for the Fire PRA. This is not to say that the procedure specifically precludes examinations across systems or activities. In fact, if the analysts are aware of known vulnerabilities that cross system or activity boundaries or can easily examine for such simultaneous failures, their inclusion is encouraged. Note that when these individual failures are included in the Fire PRA Model and the model is “solved” for combinations of events that cause core damage or a large early release, combinations of spurious events across systems will automatically be identified. These can be dealt with during the quantitative screening (Task 7) and subsequent analysis tasks as appropriate.

2.4 Task Interfaces

2.4.1 Input from Other Tasks

Given that the initial development of the Fire PRA Component List will largely come from the existing Internal Events PRA and any existing Fire Safe Shutdown Analysis, this task only needs initial assistance from those analysts performing Task 12, Post-Fire Human Reliability Analysis, to define operator actions and hence related equipment (e.g., specific indicators) of potential significance when carrying out Step 4. However, it is also assumed that two prerequisites have been satisfied. The first is the plant boundary definitions and compartment designations from Task 1, Plant Boundary Definition and Partitioning, so that the Fire PRA Component List can include associated location information about each equipment item as well as be useful in defining initiating events for each compartment in Step 3 of this procedure. The second assumed prerequisite, related to Support Task B, Fire PRA Database System, is that the information needed about each component has been agreed upon and is therefore compatible with the expected input for that database.

The initial development of the Fire PRA Component List should be as complete as possible. However, as is the iterative nature of PRA, the Fire PRA Component List may need to be modified by products of other tasks in the Fire PRA process. For example, if Task 12, Post-Fire Human Reliability Analysis, develops new fire-related actions to consider in the analysis, the Fire PRA Component List might have to include new instruments that uniquely support these additional actions (with subsequent cable identification, etc.). In some cases, the analysts may decide that it is more efficient to perform portions of other tasks to demonstrate that certain equipment items do not have to be included on the list (e.g., demonstrating that a valve cannot spuriously fail/operate in an undesirable state). While this latter approach should be followed with care since it tends to disrupt the logical flow of first including any potentially important equipment and then finding reasons to later screen items from the analysis, there may be times when the resource tradeoffs may make this the best course of action. Thus, the analysts should be open to adjusting the Fire PRA Component List as other task products affect the scope of the Fire PRA Model, whether the other tasks are performed after Task 2 (the normal flow expected in carrying out the process) or before or in conjunction with Task 2.

2.4.2 Additional Plant Information Needed to Support this Task

This procedure assumes the availability and use of the following to support the creation of the Fire PRA Component List.

- Internal Events PRA (with use of any existing Fire PRA models, insights, etc.),
- Fire Safe Shutdown Analysis,
- Plant P&IDs and electrical diagrams,
- Plant procedures (e.g., emergency operating procedures, fire procedures, annunciator response procedures),
- Technical Specifications to determine possible limiting conditions of operation (LCOs) requiring forced shutdown of the plant (see Step 3), and
- Other plant drawings and documents, as necessary.

Analysts' knowledge of plant system operation, potential failure modes of equipment, and potential operator responses related to possible conditions of equipment or instrumentation will enhance the use of this procedure and make it more efficient.

2.4.3 Walkdowns

Most likely, existing documentation will be adequate to provide all the necessary information produced for the Fire PRA Component List as described in Step 5. Thus, walkdowns will generally not be necessary for this task. However, especially for equipment location information, there may be times when a walkdown is needed to determine or verify certain information. In such cases, this need for a walkdown should be planned so as to coincide with other task walkdown needs for efficiency reasons. See Support Task A, Plant Walkdowns.

2.4.4 Outputs to Other Tasks

The primary product of this procedure, the Fire PRA Component List, is used to support Fire PRA Cable Selection (Task 3), to provide the necessary inputs about each equipment item into the Fire PRA Database System (Support Task B), and to provide a basis for much of what is modeled in the Fire-Induced Risk Model (Task 5), as modified by subsequent screening and other tasks).

2.5 Procedure

The steps that follow provide a method to create the Fire PRA Component List. While this procedure might suggest this task is carried out once, it should be recognized that as a practical matter, PRA is an iterative process. Hence, as other tasks are performed, there may be reason to revisit and redo portions of Task 2 during the development, screening, and eventual quantification of the Fire PRA.

While it is recommended that Step 1 be performed first, Steps 2 through 5 can be done in any order or coincidentally, as preferred by the analyst. A possible logical order is provided here for procedure writing purposes.

2.5.1 Step 1: Identify Internal Events PRA Sequences to be Included (and those to be excluded) in the Fire PRA Model

In this step, the Internal Events PRA Model is reviewed to identify the accident sequences that should potentially be included in the Fire PRA and, hence, initiate the identification of the related equipment to be included in the Fire PRA Component List. This step sets the initial scope of the fire analysis. The step may both initially reduce as well as add sequences and associated components. For example, Step 1 may identify accident sequences and associated components that are included in the Internal Events PRA Model that can be deleted because they are irrelevant to the Fire PRA. The step may also identify new fire-related accident sequences and associated components that are not currently covered in the Internal Events PRA Model.

Possible Elimination of Sequences and Equipment

The types of sequences that could generally be eliminated from the PRA include the following.

- Sequences associated with initiating events involving a passive/mechanical failure that can generally be assumed to not occur as a direct result of a fire. These typically include LOCAs (pipe breaks only—not due to valve openings), vessel failure, steam generator tube ruptures, and other secondary system pipe breaks (e.g., main steam and feedwater line breaks).
- Sequences associated with events that, while it is possible that the fire could cause the event, a low-frequency argument can be justified. For example, it can often be easily demonstrated that anticipated transient without scram (ATWS) sequences do not need to be treated in the Fire PRA because fire-induced failures will almost certainly remove power from the control rods (resulting in a trip), rather than cause a “failure-to-scram” condition. Additionally, fire frequencies multiplied by the independent failure-to-scram probability can usually be argued to be small contributors to fire risk.
- Sequences on the basis of other specific considerations. For example, it may be decided that no credit will be given in the Fire PRA for certain systems (e.g., RHR shutdown cooling) for reasons related to the anticipated size of the Fire PRA Model and a desire to simplify it (or other considerations). In such a case, any sequences involving the potential success of RHR shutdown cooling would also be eliminated, perhaps eliminating the need to include RHR shutdown equipment in the Fire PRA Component List unless some of the RHR equipment would still need to be included because of spurious operation or other concerns. As another example, the analysts may choose to only credit and model safe shutdown paths associated with fires, such as limiting the effort to just Appendix R of 10 CFR Part 50 equipment. This type of elimination has obvious tradeoffs—simplification of the model vs. a higher risk from fire because no credit for other redundant equipment is given in the Fire PRA. Hence, such elimination should be done thoughtfully and with consideration of future applications of the Fire PRA. *In general, all mitigation systems and related equipment for a given scenario in the Internal Events PRA should be included in the Fire PRA. If the scope of the Fire PRA will instead be limited, such as only addressing Appendix R of 10 CFR Part 50 equipment, a special ‘caution’ is discussed in Appendix A to ensure the resulting analysis is conservative (see Appendix A).*

Whatever is eliminated, justification for exclusion of any scenarios and the resulting “reduced” PRA model should be noted. In particular, be careful not to eliminate sequences that could adversely affect equipment for which credit is given in the Fire PRA. For example, steam generator overfeeds may be considered for elimination, since they involve overcooling and not lack of cooling to the core. However, if the steam driven auxiliary feedwater pump is credited, its operability could be adversely affected by such an overfeed causing subsequent failure and possible loss of all ‘credited’ steam generator feed.

All remaining sequences in the Internal Events PRA Model (besides possible new sequences and equipment addressed below) will be considered in the development of the Fire PRA Model if, for instance, it is intended that the Fire PRA will credit more than just the Appendix R equipment. The equipment associated with the remaining sequences is the primary basis and the recommended starting point for creating the Fire PRA Component List (but not including mechanical/passive equipment, as suggested earlier).

Possible Additions of Sequences and Equipment

Besides the specific cases for adding components to the Fire PRA Component List (and hence to the Fire PRA Model) addressed later in Steps 2 through 6 of this procedure, the following process should be followed to identify any new sequences and associated components that need to be added to the resulting Fire PRA Model and the Fire PRA Component List. It is suggested this be done using an expert panel type of approach or similar technique that utilizes a wide experience base covering possible plant upsets and the potential accident sequences that could result.

- Sequence considerations that were screened out of the Internal Events PRA may become relevant to the Fire PRA and need to be implemented in the Fire PRA Model. For example, spurious safety injection is often screened out from the Internal Events PRA and yet may be important for fires that could cause both the spurious injection and damage to one or more pressurizer PORVs such that pressurizer SRVs are challenged. These SRVs could subsequently stick-open causing a complicating LOCA accident sequence. A review should be conducted for such scenarios originally eliminated from the Internal Events PRA to determine if the analyst needs to add components to the Fire PRA Component List as well as model those components (and failure modes) in new sequences in the Fire PRA Model.
- Particularly when considering the possible effects of spurious operations, new accident sequences and associated components of interest may be identified that should be addressed in the Fire PRA and go beyond considerations in the Internal Events PRA. Typically, these new sequences arise as a result of spurious events that:
 - cause a LOCA: e.g., PORV opening, reactor coolant pump seal failure,
 - adversely affect plant pressure control: e.g., letdown or safety relief valve events,
 - allow overfill situations: e.g., reactor vessel or steam generator overfill that if unmitigated could subsequently fail credited safe shutdown equipment such as turbine-driven feedwater or auxiliary feedwater pumps, or
 - introduce other “new” scenarios that may not be addressed in the Internal Events PRA.

Thus a search should be conducted, in concert with carrying out all the steps of this procedure, for new functional challenges on the plant not otherwise accounted for especially because of spurious event considerations.

- A review of the FEPs or similar fire-related instructions should be conducted (as addressed under Task 12). To the extent the associated human actions and their effects will be explicitly included in the Fire PRA Model, new sequences and corresponding components may need to be included in the Fire PRA. It should be recognized that some of the human actions from these fire-related procedures and instructions could induce new sequences not traditionally covered in the Internal Events PRA. Illustrative examples include the following:
 - The Internal Events PRA likely will not have addressed main control room abandonment scenarios where fire-specific operator actions and equipment sets are relied upon.

- Fire-specific manual actions designed to preclude or overcome spurious operations will likely not have been addressed in the Internal Events PRA. An example is the appropriate closing of a pressurizer PORV block valve by the operator to preclude the effects of a possible spurious opening of the PORV (per a fire procedure). This may cause demands of the pressurizer SRV and subsequent sequences not modeled in the Internal Events PRA.
- Other procedural actions may address a degraded barrier, or deal with a breaker coordination problem, among others.
- Fire specific manual actions may cause intentional failure of a safe shutdown function or a subset of that functional response. For example, a proceduralized action may be to trip a power supply thereby disabling (“failing”) certain equipment in the plant. The effect of this action should be implemented in the Fire PRA Model by acknowledging the affected components in the Fire PRA Component List and noting the success of the proceduralized human action as a “failure mode” of that component in the Fire PRA Model (including any new resulting accident sequences as appropriate).

When treating such sequences, the likely timing of the action as compared to when the affected component is needed should also be considered. For example, if the timing of the manual action to disable a component is such that the safety function will have already been performed and the component is no longer required, the action to disable the component is not detrimental and need not be addressed. To illustrate, consider a fire-specific manual action to de-energize a PORV circuit. In various sequences, operation of the PORV would be a desirable event. If the PORV is disabled prior to the time when its desired function has been performed, new sequences involving SRV challenges could arise. However, if the disabling manual action can be shown to occur after the PORV has already performed the desired safety relief function, and the accident sequence being addressed is such that additional primary system pressure relief should not be needed, then the human action disabling the PORV need not be addressed through the addition of the new sequences to the Fire PRA model.

Table 2-1 illustrates the thought process carried out in this step and presents a possible means to document the choices made. The Table 2-1 entries are illustrative only; i.e., an *a priori* list of sequences that can be eliminated or should be added for all plants cannot be made due to plant differences or specific vulnerabilities. Nevertheless, Table 2-1 illustrates the sequence types that might be eliminated or need to be added with appropriate consideration of plant specific features.

**Table 2-1
Illustration of Accident Sequence Types to be Included/Excluded in the Fire PRA**

Accident Sequence Type	Considered in Internal Events PRA	Considered in Fire PRA Model
Transients with loss of core cooling	Yes	yes
Transient-induced LOCAs	Yes	yes
Loss of Offsite Power, including Station Blackout	Yes	yes, if the fire can induce loss of offsite power
Loss of DC power as an initiator	Yes	yes, if the fire can induce loss of DC power
LOCAs (pipe breaks)	Yes	no—fire cannot induce a pipe break
Steam Generator Tube Rupture (SGTR)	Yes	no—fire cannot induce SGTR
Secondary Steam/Feed Line Breaks/Depressurizations	Yes	no for breaks—fire cannot induce a break yes, if the fire can induce spurious opening of a power-operated secondary relief valve
ATWS	Yes	no—not likely for fires
Interfacing Systems LOCA	Yes	yes, if the fire can induce spurious opening of a power-operated interface valve
Vessel Rupture	Yes	no—fire cannot induce vessel rupture (excluding pressurized thermal shock (PTS) concerns)
Large Early Release Frequency (LERF) Considerations	yes, containment isolation, containment coolers, and containment spray (if in the LERF model).	yes, containment isolation, containment coolers, and containment spray (if in the LERF model).
Various types due to spurious events considerations	no	yes, for those new sequences not normally considered in the Internal Events PRA (e.g., reactor vessel or steam generator overfill scenarios) but considered sufficiently likely and could threaten safe shutdown.

2.5.2 Step 2: Review the Internal Events PRA Model Against the Fire Safe Shutdown Analysis

Considerable work has already gone into the Fire Safe Shutdown Analysis for the plant and the identification of important equipment from that analysis perspective. Hence, it is another significant information source in creating the Fire PRA Component List.

In this step, a series of comparisons are made between the PRA model that is evolving from Step 1, above, and the Fire Safe Shutdown Analysis to see if modifications (typically additions, but further deletions could be justified) to the evolving Fire PRA Component List are appropriate. These comparisons are related to potential differences in:

- Functions/success criteria/sequences considered,
- Systems (including support systems) considered,
- End-states affecting equipment covered by each analysis,
- Other miscellaneous equipment considered, and
- Manual actions, especially those credited in the Fire Safe Shutdown Analysis.

These differences are expected and arise for a number of reasons. First, the PRA is a best estimate analysis and considers beyond design-basis-events, including multiple equipment failures. The result of these two considerations is that the PRA usually models more mitigation systems (or trains of systems) and equipment (e.g., modeling of non-safety systems that may not be credited in the Fire Safe Shutdown Analysis or the Final Safety Analysis Report (FSAR)), considers the possibility of losing even the “protected” Fire Safe Shutdown Analysis equipment, and is often based on more realistic or best-estimate success criteria. Conversely, the PRA may only model equipment necessary to achieve a hot standby end-state condition, rather than cold shutdown, and usually considers only a sustained safe shutdown for an assumed 24 hours, rather than 72 hours.

The PRA model will likely not include fire-related manual actions credited in the Fire Safe Shutdown Analysis or specific operator actions associated with carrying out FEPs that are performed in parallel with the EOPs at some plants or in place of the EOPs at other plants. To the extent these actions should be credited or they affect the operability of certain components, the equipment associated with these actions (as well as the actions themselves) will need to be included in the development of the Fire PRA Component List and the Fire PRA Model.

The PRA model may or may not contain failure modes for spurious operation of equipment, since the random failure probabilities for these failures are often considered too improbable. Since a fire may make the likelihood of such failure modes more important, the PRA model needs to be expanded to include these possible spurious operations.

Finally, while the PRA model explicitly addresses the failure of instrumentation and controls needed for automatic actuation of equipment, it usually does not explicitly treat the availability of process monitoring and diagnostic instrumentation and controls associated with operator actions. These are often implicitly addressed in the Human Reliability Analysis, and the associated equipment is not explicitly included in the PRA logic models.

The mitigation systems defined in the Fire Safe Shutdown Analysis are typically based on the following plant-critical safety functions (which may be similar, but not necessarily identical, to that identified for PRA purposes):

- Reactivity Control,

- Reactor Coolant System (RCS) Integrity/Pressure Control,
- RCS Inventory Control,
- Decay Heat Removal,
- Containment Integrity,
- Process Monitoring, and
- Support Functions.

The Fire Safe Shutdown Analysis ensures that at least one train of the mitigation systems needed to perform each of the above safety functions is protected and thus credited in the design basis fires for the plant. The systems and related equipment identified in the Fire Safe Shutdown Analysis often stem from more conservative assumptions and success criteria than the “best-estimate” approach used in the Internal Events PRA. This, in turn, is based on corresponding design basis rules, such as generally crediting a single protected safe shutdown train of equipment, and demonstrating the ability to achieve a cold shutdown end-state and remain safely shutdown for 72 hours. The Fire Safe Shutdown Analysis also addresses the impact of some spurious actuation due to fire-induced cable shorts during a fire scenario. Local or manual actions are also credited to prevent equipment damage (e.g., disable a valve breaker) or to recover equipment affected by the fire scenario (e.g., close a spuriously opened valve). Finally, the Fire Safe Shutdown Analysis addresses the survivability of certain process monitoring and diagnostic instrumentation and controls needed for fire mitigation.

For these reasons, the Fire Safe Shutdown Analysis and the Internal Events PRA should be reviewed and the above differences reconciled, with the corresponding impact on the creation of the Fire PRA Component List and potential impacts on the Fire PRA Model identified. Additionally, modeling of components relative to unique fire-induced failure modes, such as spurious equipment actuations, need to be added to the PRA and thus be included in the Fire PRA Component List.

Hence, the following comparisons are to be performed, and it is advisable to document these comparisons sufficient to retrieve the bases for the comparison results.

2.5.2.1 Step 2.1: Reconcile Function/Success Criteria/Sequence Differences

It is expected that limited additional equipment considerations will arise on the basis of the Fire Safe Shutdown Analysis as compared to the PRA evolving from Step 1, above. Nevertheless, any differences in the functions, success criteria, or sequences treated in the two analyses should be identified and reconciled. This is done to determine if there are any legitimate functions, success criteria, or sequence considerations in the Fire Safe Shutdown Analysis different from that in the reduced PRA that either suggest additions that should be made to the PRA (and associated equipment to the Fire PRA Component List) or justify further elimination of equipment handled in the PRA.

For example, the Fire Safe Shutdown Analysis may specifically address certain instrumentation as critical to key human actions as part of a sequence definition. If credit for these actions will be carried into the Fire PRA, a limited set of instrumentation may need to be included in the Fire PRA Component List (see Step 5) and failures of the instrumentation should be subsequently treated in the Fire PRA Model.

2.5.2.2 Step 2.2: Reconcile System (Including Support System) Differences

In this step, the analyst should identify other system differences between the two analyses that may not be directly attributable to the differences identified in Step 2.1, above. These differences should be reconciled with decisions made about the impact on the PRA and thus the Fire PRA Component List.

For example, while it may lead to overly conservative results (as long as the scope ‘Caution’ in Appendix A is addressed), the analyst might consider excluding one or more PRA systems (or portions of a system, such as a whole train) from the Fire PRA model based on a similar exclusion in the Fire Safe Shutdown Analysis due to resource limitations, considering all the cables that would otherwise need to be identified. This is not a recommended (but allowable) practice, since it could yield overly conservative results when using the fire portion of the model for risk-informed applications. For instance, if there are three or more diverse/redundant AFW trains for secondary heat removal, one could conceivably make an argument for excluding the feed and bleed function and the associated equipment considerations. A system importance analysis on sequences selected for the Fire PRA Model can be performed using the Internal Events PRA to determine which systems could be excluded from the Fire PRA Model without a likely significant impact. Portions of a system or entire systems that are perceived to have a negligible impact on risk (e.g., have a risk achievement worth of less than two in the Internal Events PRA) may be candidates for exclusion from the Fire PRA Model. The analyst needs to consider the potential equipment outage configurations if the Fire PRA Model will be used to support risk-informed applications. As stated above, decreasing the fire equipment scope from that covered in the Internal Events PRA, while allowable, is not recommended.

On the other hand, the Fire Safe Shutdown Analysis may suggest additions to the Fire PRA. For example, the Fire Safe Shutdown Analysis may assume heating, ventilation, and cooling (HVAC) equipment is needed to support a particular mitigation system, while the PRA (using a best-estimate approach) may determine the HVAC is not needed during internal events. Considering potential heat loads in fire situations or wanting to credit HVAC for smoke removal from an area (based on insights from iterations of Task 8 or 11), could result in a decision to add HVAC equipment to the PRA and hence the Fire PRA Component List.

The point is, in this step, the analyst is reconciling system differences and making judgments about additions or deletions to the PRA based on different observations. While expectations are that the PRA (and hence the Fire PRA Component List) will not change much on the basis of this comparison, some changes may be identified as desirable.

2.5.2.3 Step 2.3: Reconcile System/Equipment Differences Due to End-State and Mission Considerations

If not already addressed in the above steps, the analyst should identify any equipment differences because of analysis end-state differences, such as achieving hot vs. cold shutdown. A typical successful PRA end-state implies that the plant, at 24 hours following the initiator, is safe and stable (not degrading). It is implicitly assumed that accident management actions will be implemented within 24 hours, should they be necessary. In some cases, remaining at hot shutdown is acceptable and the transitional risk of changing plant modes is averted. In other

cases, the plant cannot remain in a stable condition at hot shutdown within the 24-hour period and it is necessary to place the plant in cold shutdown. For example, in a LOCA situation with failure of long-term makeup or recirculation, credit may be given for going to cold shutdown (and thus including RHR-related equipment on the Fire PRA Component List). A review of the necessary end-states for the selected applicable sequences should be performed.

In the Fire Safe Shutdown Analysis, a successful end-state is achieved when the plant is placed in cold shutdown within a 72-hour period, therefore including equipment necessary to achieve this end-state.

If the fire response procedures or the fire event itself necessitates a transition to cold shutdown, the Fire Safe Shutdown Analysis end-state should be used. Otherwise, the PRA end-state definitions should be used as the default. Any new equipment or failure modes added because of end-state differences should be reflected in the Fire PRA and the Fire PRA Component List.

2.5.2.4 Step 2.4: Reconcile Other Miscellaneous Equipment Differences

In this step, other equipment differences not explained by the prior steps should be addressed. This may come from a variety of reasons including, for instance:

- Differences in the level of modeling or definition of component boundaries. For example, the Fire Safe Shutdown Analysis may treat equipment items separately, such as a breaker and a pump motor, while the Internal Events PRA model may treat both under a “super-component”—the pump. Where review of plant drawings or other information discerns that equipment locations (e.g., breaker vs. pump motor) are different, it may be desirable to expand the Fire PRA Component List accordingly. An alternative (and preferred) approach is to only list the pump on the Fire PRA Component List and ensure that the cabling identification and circuit analysis tasks (Tasks 3 and 9), as necessary, will discern the different locations of the pump and breaker, along with their associated cabling.
- Differences due to consideration of spurious actuations or other failure modes. The Fire Safe Shutdown Analysis will have likely considered undesirable spurious actuations and/or other fire-unique equipment failure modes not in the current Internal Events PRA. To the extent these are relevant to the functionality of the systems needed for the Fire PRA Model, this equipment should be added to the Fire PRA Component List, and new failure modes should be noted for inclusion in the Fire PRA Model. Care should be taken in the actual modeling process, under Task 5, to ensure that mutually exclusive failure modes are prevented or otherwise tracked for appropriateness so that, for instance, a breaker “fail to open” and “fail to remain closed” failure modes do not appear in the same sequences/cut sets. Nevertheless, the breaker would become an item on the equipment list. Step 4 provides a more thorough search to identify additional equipment for inclusion because of the potential for spurious actuations (singularly or in combination) that could challenge safe shutdown capability. Additionally, adding the spurious actuation failure modes of electrical components should be conditional on power availability to the component to the extent such details are known or discovered at this point in the analysis. For example, a fire initiating in a switchgear panel that immediately fails all power coming from the panel simultaneously prevents the possibility of spurious control signals whose power source is the same panel. Hence these spurious operations cannot occur under the presented circumstances and the effects of

spurious operation should not be included with regard to the components on the list nor in the logic model for that specific fire. When eliminating such a possibility, the expected timing of the fire scenario also needs to be considered, as best understood at the time of model development or during subsequent refinement of the model. In this same example, if the fire is expected to cause quick failure of the switchgear panel as a power source but it is possible that the flames could affect associated components' control cables before the switchgear power is lost, then the spurious events may still occur and need to be captured within the logic model and on the Fire PRA Component List.

- Differences due to the treatment of instrumentation and diagnostic equipment. For example, the Fire Safe Shutdown Analysis may explicitly consider certain instrumentation and other diagnostic equipment, while the Internal Events PRA may not model these at all. At this stage, some of the Fire Safe Shutdown Analysis instrumentation and diagnostic equipment should be added to the Fire PRA Component List, as they are relevant to monitor fundamental process variables associated with the systems needed for the Fire PRA Model, or to human actions credited in the Internal Events PRA model. Step 5 modifies and enhances this step to identify that instrumentation and diagnostic equipment needed to support the Human Reliability Analysis portion of the Fire PRA and for inclusion in the Fire PRA Component List.
- Differences due to the need to use/protect fire fighting equipment such as fire panels, fire pumps and water sources, and delivery pathways, including any isolation valves. To the extent any of this equipment is going to be credited for safe shutdown (not fire fighting) in some fire situations, it should also be on the Fire PRA Component List; a likely addition from that in the Internal Events PRA. Note that later in the modeling phase, care should be taken when simultaneously crediting fire systems for both firefighting as well as safe shutdown such as crediting a fire pump for both sprinkler operation and as an injection source for cooling the core.

2.5.2.5 Step 2.5: Specific Review of Manual Actions

As a special consideration in the previous step, the need to specifically review manual actions that should be credited in the Fire PRA is an important part of this Internal Events PRA and Fire Safe Shutdown Analysis reconciliation (see more under Step 5). These will take the form of:

- actions needed for safe shutdown,
- actions needed to prevent or recover from spurious events, and
- additional actions deemed appropriate by the operator or recommended by the procedures (e.g., opening two trains of valves when only one is needed in case of spurious closure of a valve).

Numerous manual actions of the types listed above are often credited in a Fire Safe Shutdown Analysis. In this step, the need to review these manual actions and whether they should be credited in the Fire PRA Model and to identify, if any, associated equipment items (for the Fire PRA Component List) to carry out the actions is highlighted here to ensure it is part of the reconciliation process.

With perhaps the exception of following specific FEPs, it is desirable to initially take little or no credit for manual actions (often recovery-related or preventive) cited in the Fire Safe Shutdown Analysis until it is necessary to do so later as the Fire PRA Model is exercised (under Task 7) and the risk-important features of the plant begin to emerge. In this way, the analysis is less encumbered by having to account for and model such actions, and it may not have to rely on such actions to mitigate issues where the risk is already low (indeed, it may be shown that crediting such actions is unnecessary and perhaps can even be dropped from future fire regulatory compliance). Whatever is done with regard to crediting such actions, the Fire PRA model will need to include such actions if they are to be credited and any associated mitigating equipment or diagnostic equipment necessary to take the actions (see Step 5) should also be added to the Fire PRA Component List. Additionally, those manual actions and their effects that will disable credited components in the Fire PRA or cause new sequences (as addressed earlier), will need to be implemented in the Fire PRA Model and the associated components accounted for if not already done so.

2.5.3 Step 3: Identify Fire-Induced Initiating Events Based on Equipment Affected

To the extent the above steps have not already done so, this step addresses that equipment which, if affected by a fire, could cause an initiating event (i.e., forced shutdown of the plant). The goal of this step is to identify what initiator(s) will likely occur if a fire in any given compartment affects equipment identified on the Fire PRA component list. (It is not, per se, the objective of this step to identify new component list entries.) The review for such equipment is expected to consider:

- equipment whose failure would cause an automatic trip;
- equipment whose failure would likely cause a manual trip, as specified in fire procedures or plans, or other instructions; and
- equipment whose failure will invoke a LCO that would necessitate a shutdown. In this latter case, it is only necessary to identify cases where (a) shutdown is likely to be required before the fire is extinguished¹, (b) where a potentially significant effect on safe shutdown capability is caused by the affected equipment, and (c) where the shutdown will be modeled as a plant trip rather than a slow, controlled shutdown of the plant based on the current modeling practice in the Internal Events PRA. If these three conditions are not applicable, the LCO condition need not be modeled as an initiating event. The analyst needs to judge which cases are to be included and should provide justifications for excluding cases.

For a compartment where none of the above conditions is judged to occur (i.e., no automatic, manual, or LCO forced trip), that compartment need not have an initiating event assigned to it. If there are doubts as to whether any of the above criteria are met, the analyst can conservatively assign a “reactor trip”, at a minimum, as the initiator.

Taken individually, there are numerous components in the plant whose failure could cause an automatic or forced manual trip (e.g., many balance-of-plant components). Hence, this identification process needs to balance the accuracy associated with identifying specific

¹ It is recommended that only cases where shutdown needs to occur ≤ 8 hours be considered as per reference [2.1].

equipment items (e.g., feedwater regulator valves) with the potentially conservative treatment of broad equipment groups identified in a global manner (e.g., feedwater equipment). The appropriate balance is largely a function of resources and the practicalities associated with identifying equipment and corresponding cable locations.

Any available information regarding broad definitions of system/equipment effects and locations will be useful in this identification process, since it is simply not practical to trace cables for every individual component that could cause a trip because of a fire. In some cases, the analyst may need to assume that certain equipment or its cabling is in a location even though this has not been definitively determined. For instance, the analyst may use knowledge of where electrical buses and motor control centers are located vs. where the safe shutdown components are located to assess that the intervening compartments likely contain associated cables of interest.

Since it is not practical to perform the necessary review of all components and their cabling to define the fire-induced initiators for various compartments, the analyst may have to assume an initiator will occur for a given fire. Which initiator is assumed to occur (e.g., reactor trip, loss of feedwater, loss of air, loss of service water) should be based on a worst-case consequence point-of-view for the assumed fire. Hence, if there is uncertainty as to the initiator caused by a given fire in a given location because it is impractical to identify all the cabling and related equipment in the location that might cause an initiating event, the analyst should assign a worst-case initiator from the plant consequence perspective based on suspected initiator possibilities and the effects of these initiators at the plant. For instance, if a fire in a AFW room is suspected to cause an initiating event, but it is uncertain whether that would be a loss of feedwater or a loss of offsite power (because all the equipment associated with feedwater or offsite power have not been listed and their cables traced), the analyst should determine which initiator would be worse from a CDF/LERF perspective for the AFW fire and assign the initiating event accordingly. These types of judgments and the associated plant effects (e.g., initiator type induced) should be made conservatively, justified, and documented.

2.5.4 Step 4: Identify Equipment with Potential Spurious Actuations that may Challenge the Safe Shutdown Capability

This step is aimed at further expanding the Fire PRA Component List, and thus potentially the Fire PRA Model, to include adequate consideration of the potential for harmful fire-induced spurious actuations. Prior steps have considered those spurious operations identified in the Post-Fire Safe Shutdown Analysis, and has looked for “new” sequences that might arise from fire-specific procedures and related manual actions. In Step 4, the analyst will conduct a systematic search for additional spurious actuations of relevance to the Fire PRA. Performing this step can potentially be much more efficient if information from other tasks (performed ahead of this task or iteratively with it) is simultaneously used. For instance, considering relevant fire frequencies, severity factors, target effects, scoping CCDP/CLERP estimates, and preliminary circuit failure analyses may eliminate the need to address some postulated spurious actuations because they would be unimportant or cannot occur. This is important in attempting to limit the effort and resources necessary to perform this step in the procedure; hence, it is highly recommended that such iterations be utilized.

In this step, the analyst performs a systematic review of spurious actuations that could challenge the ability to achieve safe shutdown (by causing an initiator or affecting mitigating equipment) based on the systems and initiators identified from previous steps. Note that this review does not assume that just one spurious actuation occurs at a time, but that multiple simultaneous (or sufficiently overlapping to cause the undesired effect of interest) actuations are possible.

This systematic review is conducted on the basis of accident sequence types and related mitigation system functions in the current Internal Events PRA model (if it is possible to credibly identify a new sequence type because of fire events, these should also be considered as discussed earlier under Step 1). This is primarily a rigorous search through the system P&IDs, with additional review of documents such as electrical drawings and the Internal Events PRA sequence solutions, if helpful, to identify single and multiple spurious actuation failures that may be valid failure modes for the Fire PRA Model. As part of this search process and as discussed earlier in Step 1, it is advisable to conduct an expert panel review for any other spurious events and subsequent new scenarios that, because of their dynamic or intricate nature, may not be otherwise easily identified. For example, at one plant, it was determined that a fire-induced spurious closure of a single RCP seal thermal barrier heat exchanger valve, and failure (may be spurious or non-spurious) of seal injection, necessitates the need to use a standby shutdown facility that in turn, does not currently have adequate capability to mitigate a LOCA. Such new spurious events and subsequent fire accident sequences should be addressed in the Fire PRA and Fire PRA Component List. In performing this review, focus should be on equipment not already identified on the Fire PRA Component List, such as those affecting possible diversion paths, or the failure of electrical-operated equipment on the function of passive/mechanical devices, such as heat exchanger operation or tank level. Spurious actuation failure modes of electrical components should be conditional on power availability to the component as already mentioned under Step 2.4.

Table 2-2 (illustrative only) provides an overview of how single and multiple spurious actuation failures might be important for some accident sequences in the Internal Events PRA Model, hence, the appropriate system plant drawings should be reviewed for potential sources of harmful spurious actuations. This table is provided only as an information aid. It provides examples of the links between various initiating events and the ways in which relevant components in the model may be affected. The analyst needs to determine the actual effects appropriate for her/his plant-specific model.

Table 2-2
Illustrations of Spurious Actuation (Single and Multiple) of Electrical-Operated Equipment
Using the Internal Events PRA Model

Accident Sequence Type	Example Effects on Initiating Event Models	Example Effects on Mitigation Models
Transients with Loss of Core Cooling	Will cause loss of MFW	Will cause failure of AFW, HPI, PORVs, HPCI, RCIC, SRVs via loss of flow or flow diversion
Transient-Induced LOCAs	Will cause a stuck-open PORV, SRV, or a RCP/Recirculation Pump Seal LOCA	Will cause failure of HPI, HPCI, RCIC or containment sump recirculation valves via loss of flow or flow diversion
Loss of Offsite Power, including Station Blackout	Will cause a loss of offsite power	Will cause failure of diesel generators or power restoration circuits
Main Steam/Feed Depressurizations	Will cause the opening of a power-operated secondary relief valve	Will cause failure of MFW/AFW, HPI, MS Isolation valves or PORVs
Interfacing Systems LOCA	Will induce spurious opening of power-operated ISLOCA interface valves (if remain powered)	
Large Early Release Considerations		Will induce spurious operation of a containment isolation valve, or failure of containment coolers or spray (if in the LERF model)

To place some practical, yet reasonable limitations on the performance of this step, the following represent typical functional considerations that are recommended (see Appendix A for additional equipment properties (e.g., cable material) and timing considerations on this subject). The analyst may desire to use these or other considerations in performing this step (e.g., see NEI-00-01, Appendix F [2.2]). Whatever approach is used, or if disposition of other or unique situations is necessary, that approach or dispositions should be documented and justified.

- Equipment already on the Fire PRA Component List need not be cited again *if* it is agreed that the cable identification process and circuit analysis will address all failure modes of the equipment based on normal, desired, and failed states considered, including possible spurious operation of indications/alarms associated with that equipment (e.g., motor temperature indication for a pump motor). (Note that not all potentially important failure modes for the Fire PRA may be included in the Internal Events PRA, so care should be exercised in defining the normal, desired, and failed states). Otherwise, the indicator/alarm, if important to include, will need to be listed on the Fire PRA Component List separate from the associated component (in this example, possibly the temperature indicator as well as the pump itself, depending on what will be included in the cable identification and circuit analysis for the pump).

- In the search for spurious operating equipment, the system is assumed to be in its normal configuration and not in an unusual line-up, such as during test and/or maintenance, as long as the time in these less-usual configurations is small (e.g., ~1%) relative to the time it is in its normal configuration. *Note: future SDP or other evaluations involving unusual or misalignments will then need to be analyzed separately.*
- Possible flow diversion paths representing an inconsequential effect are screened from further consideration. For example, a spurious opening of a normally closed valve that represents a small diversion relative to the main mitigation system flow path (e.g., ~1/10 the flow area) may be eliminated from further analysis and hence not placed on the Fire PRA Component List. However, the analyst should consider multiple diversion paths spuriously opening at the same time before making this determination.
- Possible flow diversion paths that are too unlikely to occur can be screened from further consideration. For example, a flow diversion path for a system protected by one or more passive/mechanical devices not affected by a fire (e.g., a manual valve, a check valve, or mechanically locked close electrical-operated valve) may be eliminated from further analysis and that equipment not added to the Fire PRA Component List. Another example might be possible flow diversion paths for a system protected by multiple and supposedly independent electrical equipment items (e.g., multiple normally closed valves divided up among redundant trains that are divisionally separated and thus are not supposed to share common locations). These may be eliminated from further consideration on the basis of an unlikely number of multiple and simultaneous (or sustained or sufficiently overlapping) actuations due to a single fire that are necessary to result in the flow diversion. If eliminating equipment on this basis, a check should be made to ensure separation of cabling and power source so that a fire is very unlikely to affect the redundant equipment. Such eliminations are discouraged, but if performed, should consider pathways prioritized by effects (e.g., degree of mitigation capability that would be defeated). The burden of acceptability of such eliminations is on the analyst.
- Spurious operation of the equipment is considered inconsequential and so screened. For example, suppose a temperature control valve can spuriously operate between two mechanically limited control positions and not significantly affect the safety function of interest, nor cause an initiating event. In such a case, the valve may be eliminated from further consideration and is not added to the Fire PRA Component List.
- Be careful to examine electrical equipment that can affect the function of otherwise passive/mechanical devices, such as level instrumentation on a tank or temperature monitoring of a heat exchanger or filter. If the spurious operation of this electrical equipment can affect the passive/mechanical device in an unsafe way not already accounted for with the existing component list (e.g. automatically drain a tank), that electrical equipment should be added to the Fire PRA Component List.

To the extent that the spurious actuation search identifies new equipment not otherwise on the Fire PRA Component List, the associated equipment should be added to the Fire PRA Component List for cable identification and subsequent circuit analysis, if later needed.

2.5.5 Step 5: Identify Additional Mitigating, Instrumentation, and Diagnostic Equipment Important to Human Response

This step is aimed at expanding the Fire PRA Component List, and thus potentially the Fire PRA Model, to adequately consider other mitigating equipment, instrumentation, and diagnostic equipment necessary for human actions if not already addressed in previous steps. The identification of equipment considered necessary for the operator to correctly perform actions to be credited in the Fire PRA, as well as equipment that, if spuriously operated due to the fire, could likely induce an inappropriate or otherwise harmful action by the operator, are of interest. Such harmful actions primarily consist of shutting down or changing the state of mitigating equipment in an unsafe manner such as thinking the safety injection (SI) throttling criteria are met and shutting down SI when it is inappropriate to do so. This part of the analysis is implemented by performing the following steps. Note that while the steps are presented sequentially, in practice, the two steps will likely be performed simultaneously and with iteration.

2.5.5.1 Step 5.1: Identify Human Actions of Interest

In this step, the analyst, working with human reliability specialists (see Task 12), identifies human actions (procedure-driven and recovery) either credited in the Internal Events PRA or those that may need to be credited because of the FEPs or similar instructions. This is done by reviewing the existing credited actions in the Internal Events PRA, as well as relevant plant procedures, including, as a minimum, the EOPs and specific FEPs that address actions pertaining to safe shutdown that are planned to be modeled.

In deciding which actions to credit, the analyst may choose to perform some sensitivity analyses with the current Internal Events PRA (or during the development of the Fire PRA Model) and set the human action failures to a screening value provided by Task 12 to determine if such actions need to be credited in the Fire PRA. (Note that while such a possible decrease in the scope of the Fire PRA to save resources is possible, it is recommended that all actions treated in the Internal Events PRA and those necessary to achieve safe shutdown in FEPs be included in the Fire PRA).

Possible harmful actions of interest will emerge during both the above review of the procedures (looking for actions that, for instance, shut down mitigating equipment) as well as during performance of the next step, when postulated spurious failures of instrumentation and other diagnostic equipment could induce an unsafe human action of interest.

2.5.5.2 Step 5.2: Identify Instrumentation and Diagnostic Equipment Associated with both Credited and Potentially Harmful Human Actions

In this step, the analyst first identifies the mitigating equipment, as well as instrumentation and diagnostic equipment, deemed necessary to credit the human actions identified in Step 5.1. Again, this comes from review of the Internal Events PRA and relevant procedures (e.g., FEPs) or recovery action considerations to identify the equipment needed to perform the actions of interest. If this equipment is not already included (even implicitly by an associated circuit) on the list, it is added to the Fire PRA Component List. The exception would be if the level of

redundancy and diversity in the instrumentation used by the operator is so high (for instance, multiple channels of indication that are divisionally separated and should not share common locations, at least one of which is diverse, such as rod-in lights as a back-up to neutron power) that the number of failures necessary to confuse or prevent the operator from taking the appropriate action is considered too unlikely. In such cases, the instrumentation does not need to be added to the Fire PRA Component List, but the reason why should be documented.

As part of this step, the spurious instrumentation operation search is somewhat more complicated. To perform this search, a systematic review of procedures like the EOPs, FEPs, or annunciator response procedures, training manuals, and other material is likely to be necessary to identify both where possible spurious operation of instrumentation or diagnostic equipment could induce a harmful action, as well as the harmful action itself (this should be determined with input from operators or training staff, as well as working with the HRA analysts). Cases of particular importance include those where one or more spurious operations of the instrumentation may induce the operator to shut down or harmfully change the state of mitigating equipment (e.g., isolate a good steam generator in a PWR or defeat emergency depressurization in a BWR) during a fire event. Clues of where such concerns exist can come from identifying the steps in the procedures, lists of equipment shutdown actions in training manuals or system design documents, annunciator responses that call for shutting down equipment to protect it (such as a high temperature alarm/indication on a pump motor), or other sources. The aim of the search is to both identify such unsafe actions and the associated instrumentation or diagnostic equipment whose failure or spurious operation could induce such actions. Where identified, the associated instrumentation or diagnostic equipment should be added to the Fire PRA Component List.

Expectations are that the analyst will find few cases where instrumentation needs to be added to the component list. This is because the level of indication redundancy/diversity in typical nuclear plant control rooms is sufficiently high, that it is unlikely a single fire can affect so many indications as to prevent the operator knowing when to take the desired actions or “fool” the operator into taking an undesired action. Even in those few places where cabling concentrations are high (e.g., cable spreading room) and so a single fire might affect many instruments all at once, such a scenario is likely to also lead to loss of equipment control as well. In such cases, safe shutdown would be achieved utilizing alternate shutdown areas which are analyzed separately and backed up by yet additional indications at the alternate shutdown spaces.

To place some practical, yet reasonable limitations on the performance of this search, the following represent typical functional considerations that are recommended (see Appendix A for additional equipment properties (e.g., cable material) and timing considerations on this subject). The analyst may desire to use these or other considerations when performing this search. Whatever approach is used, or if disposition of other or unique situations is necessary, that approach or dispositions should be documented.

- Equipment already on the Fire PRA Component List need not be cited again *if* the same reason as that cited above applies (i.e., the cable identification process and the circuit analysis will address all failure modes of mitigating equipment based on normal, desired, and failed states considered, including possible spurious operation of associated instrumentation, such as if it is used in both the automatic control of an equipment item as well as for operator action). However, since this is from an operator action point of view, explicit listing of the instrument may still be desirable and is recommended.

- In the search for possible harmful spurious operating instrumentation or diagnostic equipment, the instrumentation is assumed to be in its normal configuration and not in an unusual line-up, such as during test and/or maintenance, as long as the time in these less usual configurations is small (e.g., ~1%) relative to the time it is in its normal configuration. *Note: future significance determination process (SDP) or other evaluations involving unusual configurations or misalignments will then need to be separately analyzed.*
- Focus should be on the instrumentation with little redundancy to prevent the unsafe act and which upon spurious or failed operation leads to the unsafe action directly, with no or little alternate verification steps.
- Where the possible spurious or failed instrumentation would dictate the operator first verify the plant condition by local observation or other very reliable means before making the unsafe act, such spurious or failed equipment is not considered further, nor are they added to the Fire PRA Component List if the HRA input can provide reasonable justification that such precautions will be taken even during fire situations. For example, if an annunciator response procedure calls for shutting down a pump at a high room temperature alarm/indication, but only after a local check by an operator to verify the true environmental condition, spurious operation of that alarm/indication circuit(s) would not be considered further if the HRA analyst(s) deems that such precautions would continue to be taken even under complicated and potentially confusing or high workload fire situations.
- Where it would take considerable redundant and particularly diverse indications to spuriously operate or fail simultaneously to induce the undesired/unsafe action, such spurious or failed equipment is not considered further, nor are they added to the Fire PRA Component List if the HRA input can provide reasonable justification that such failures would not likely cause harmful operator actions in fire situations. For example, if, in order to isolate feed to a steam generator, the operator would have to have erroneous indications of two channel steam generator pressure indications, as well as erroneous confirmation by such indications as multiple channel RCS temperature indications, the possibility of the combined situation is considered very unlikely. If, in addition, the HRA analyst(s) can justify it is highly unlikely the operators would make a mistake (such as due to tunnel vision on one set of indications) for the given situation, this equipment need not be considered further and is not added to the Fire PRA Component List.
- Be careful to examine electrical equipment that may not necessarily be associated with equipment already on the Fire PRA Component List, but which could cause an undesirable operator action, such as level instrumentation on a tank, temperature monitoring of a heat exchanger or filter, or a flow or pressure indication in a system flow path. If spurious operation of this electrical equipment could induce an undesired/unsafe operator action (e.g., shutdown of the flow path), that electrical equipment should be added to the Fire PRA Component List.
- Be careful to consider inter-system effects. For example, a spurious indication that low pressure pumps have been lost during recirculation core cooling in a PWR and yet they are needed to provide NPSH to the high pressure pumps in this mode. This could induce the operator to shut down the high pressure pumps inappropriately to protect them, when in actuality, both the low pressure and high pressure pumps are operating properly.

2.5.6 Step 6: Include “Potentially High Consequence” Related Equipment

As a final step in performing this task, it is recommended that equipment associated with potentially high consequence events not be prematurely screened, but analyzed in more detail to determine their risk significance.

High consequence events are those involving:

- (a) one or more related (mostly, similar components in the same system) component failures including spurious operations (where at least one failure/spurious operation must be induced by a fire) that by themselves result in core damage AND a large early release, or
- (b) a single component failure including spurious operation induced by a fire that by itself causes loss of an entire safety function (e.g., RCS inventory) such that it leads directly to core damage.

Equipment associated with such events, if not already on the Fire PRA Component List, should be added to the list and analyzed accordingly.

An example of case (a) above could be the spurious opening of two valves in a high-low pressure interface within a system (e.g., RHR) that might lead directly to core damage and provide a containment bypass pathway that would result in a large early release. An example of case (b) could be the spurious opening of a single valve causing draining of a RWST and loss of all injection when it is needed, and hence, by itself, leading to core damage. In both situations, it is the intent that situations where it is judged the frequency of the high consequence event could be more than $1E-7/\text{yr}$ considering the fire scenario frequency (ignition frequency, severity, suppression) as well as the likelihood of the failure/spurious event(s) as part of this frequency will be included². Rarer events should not be risk significant and it is not intended that they be covered under this step.

It is recommended that such situations be analyzed (i.e., added to the component list, cables identified, and the circuits analyzed) so that these situations are not prematurely and *a priori* dismissed based on unsubstantiated assumptions about their importance or lack thereof. In this way, potential high consequence events will be examined in more detail and screened out as unimportant only after a level of review commensurate with the potential consequences of such an event.

2.5.7 Step 7: Assemble Fire PRA Component List

Once the previous steps have been performed, a cumulative list of all the associated equipment identified in the above steps is generated. This list becomes the Fire PRA Component List and is maintained in the Fire PRA database.

² At this stage of the process, fire frequencies, etc. may not have been analyzed and thus definitively determined. “Estimates” of the necessary frequencies and probabilities will likely have to be made based on combined approximations/judgments from the fire modeling, cable analysis, and PRA analysts, as appropriate.

A typical Fire PRA Component List should include the following information (as applicable):

- Equipment ID (note: this may be an indicator or alarm, as discussed above),
- Equipment Description,
- System Designation,
- Equipment Type,
- Location (i.e., Compartment Identification as a minimum [for fire modeling it may be helpful to also indicate elevation and closest column lines as well]),
- PRA Event Identifier,
- PRA Event Description,
- Normal Position/Status,
- Desired Position/Status,
- Failed Electrical Position,
- Failed Air Position,
- References, and
- Comments/Notes.

The Fire PRA Component List will be used in Task 3 for selecting critical cables associated with the equipment. The above information is put into the Fire PRA Database (see Support Task B). It also serves as a basis for creating the Fire PRA Model (Task 5).

To the extent that analysts have chosen to not model all that is in the Internal Events PRA for their Fire PRA (such a decision is not recommended in this procedure, but certainly allowed because of resource expenditure concerns and/or other reasons), the Fire PRA Component List will likely not contain all that would be present if all the Internal Events PRA equipment were also included. Should the resulting Fire PRA CDF/LERF or other results be considered inadequate (e.g., too high) and it is desired later to expand the equipment list and model more of that credited in the Internal Events PRA, the equipment list from the full Internal Events PRA is readily available. This information, along with insights from the Internal Events PRA as to which equipment may provide the most desirable impacts on the Fire PRA results (such as through importance measure calculations or sensitivity analyses), can be used to help prioritize which additional equipment should be included in the Fire PRA. If/when subsequently adding this equipment, it should be remembered that these and other tasks will need to be revisited to determine the impacts of adding the equipment.

2.6 References

- 2.1 *Fire PRA Implementation Guide*, December 1995. EPRI TR-105928.
- 2.2 “Guidance for Post-Fire Safe Shutdown Analysis,” Nuclear Energy Institute, NEI 00-01, Revision 0, May 2003 (Document available through the NRC Agency-wide Documents Access and Management System (ADAMS), Accession Number ML031640322).

3

FIRE PRA CABLE SELECTION (TASK 3)

3.1 Purpose

Conducting a Fire PRA in accordance with this procedure necessitates an analysis of fire-induced circuit failures beyond that typically conducted during original Fire PRAs. The circuit analysis elements of the project are conducted in three distinct phases:

- Fire PRA cable selection (Task 3),
- Detailed circuit failure analysis (Task 9), and
- Circuit failure mode likelihood analysis (Task 10).

This chapter provides methods and instructions for conducting the first phase of circuit analysis—selecting Fire PRA cables (Task 3). The purpose of Task 3 is to identify for all Fire PRA components the circuits/cables³ associated with the components and the routing/plant location of the identified circuits/cables. These relationships can then be used to determine the Fire PRA components potentially affected by postulated fires at different plant locations.

In most cases, it is advantageous to perform some or all of Task 9 (detailed circuit failure analysis) coincident with Task 3. The degree to which Task 3 and Task 9 are combined is highly dependent on numerous plant-specific factors. Considerations for combining the two tasks are incorporated in relevant sections of Chapter 3.

3.2 Scope

Chapter 3 provides methods and technical considerations for identifying cables to be included in the *Fire PRA Cable List*. This task contains the following key elements:

- Identify cables associated with Fire PRA equipment,
- Determine plant routing and location for the Fire PRA cables,
- Identify Fire PRA power supplies, and

³ The term “circuit” and “cable” are often used interchangeably for fire-related circuit analyses. A circuit is comprised of electrical components, subcomponents, and cables/connection wire. Within the context of fire-induced equipment failures, it is understood that circuit selection or circuit identification refers to the identification of cables that connect all the related components and subcomponents of a complete circuit.

- Correlate Fire PRA cables to Fire PRA equipment and plant locations (fire compartments and/or fire areas).

Implementation of plant-specific quality assurance and configuration control requirements that might apply to a Fire PRA is not within the scope of this task. Nor does this task address validating the accuracy of plant-specific data extracted from plant drawings, documents, or databases. Each plant should follow appropriate quality assurance, administrative, and configuration control procedures applicable to the work conducted. The need to validate input source documents should be addressed as part of assembling the prerequisite information.

3.3 Background Information

3.3.1 General Task Objectives and Approach

The Fire PRA Cable List identifies the circuits/cables needed to support proper operation of equipment contained in the Fire PRA Equipment List. Essential electrical power supplies are also identified during this task. The Fire PRA Cable List might also include *Associated Circuits*. Associated Circuits are cables that are not necessarily directly linked to a component, but have the potential to cause improper operation of a component as a result of certain failure modes associated with fire-induced cable damage.

The Fire PRA Cable List is not simply a list of cables. It also establishes, for each cable, a link to the associated Fire PRA component and to the cable's routing and location. These relationships provide the basis for identifying potential equipment functional failures at a fire area, fire compartment, or raceway level.

Task 3 is broken down into six distinct steps. Generic step-by-step instructions for completing these steps are provided in this chapter. Figure 3-1 shows a summary of the task work flow. A critical aspect of creating the Fire PRA Cable List is preplanning. Experience shows the importance of developing a clear strategy and detailed plant-specific rules for selecting cables. This is true whether cable selection is based on existing analyses (e.g., post-fire safe shutdown analysis, original Fire PRA, etc.) or will be generated from scratch. Also of key importance is assessing up front the degree to which cable and raceway data has been automated and the cables have been correlated against plant locations. The key question is whether or not the existing data allows for easy database retrieval of cable routing and location information. This capability is essential for efficiently conducting a Fire PRA using the methods of this procedure. Plants without this capability should include in the project resource estimate a realistic projection of the level-of-effort necessary to acquire the desired database sort and query capability, which can be substantial, depending on the actual information available.

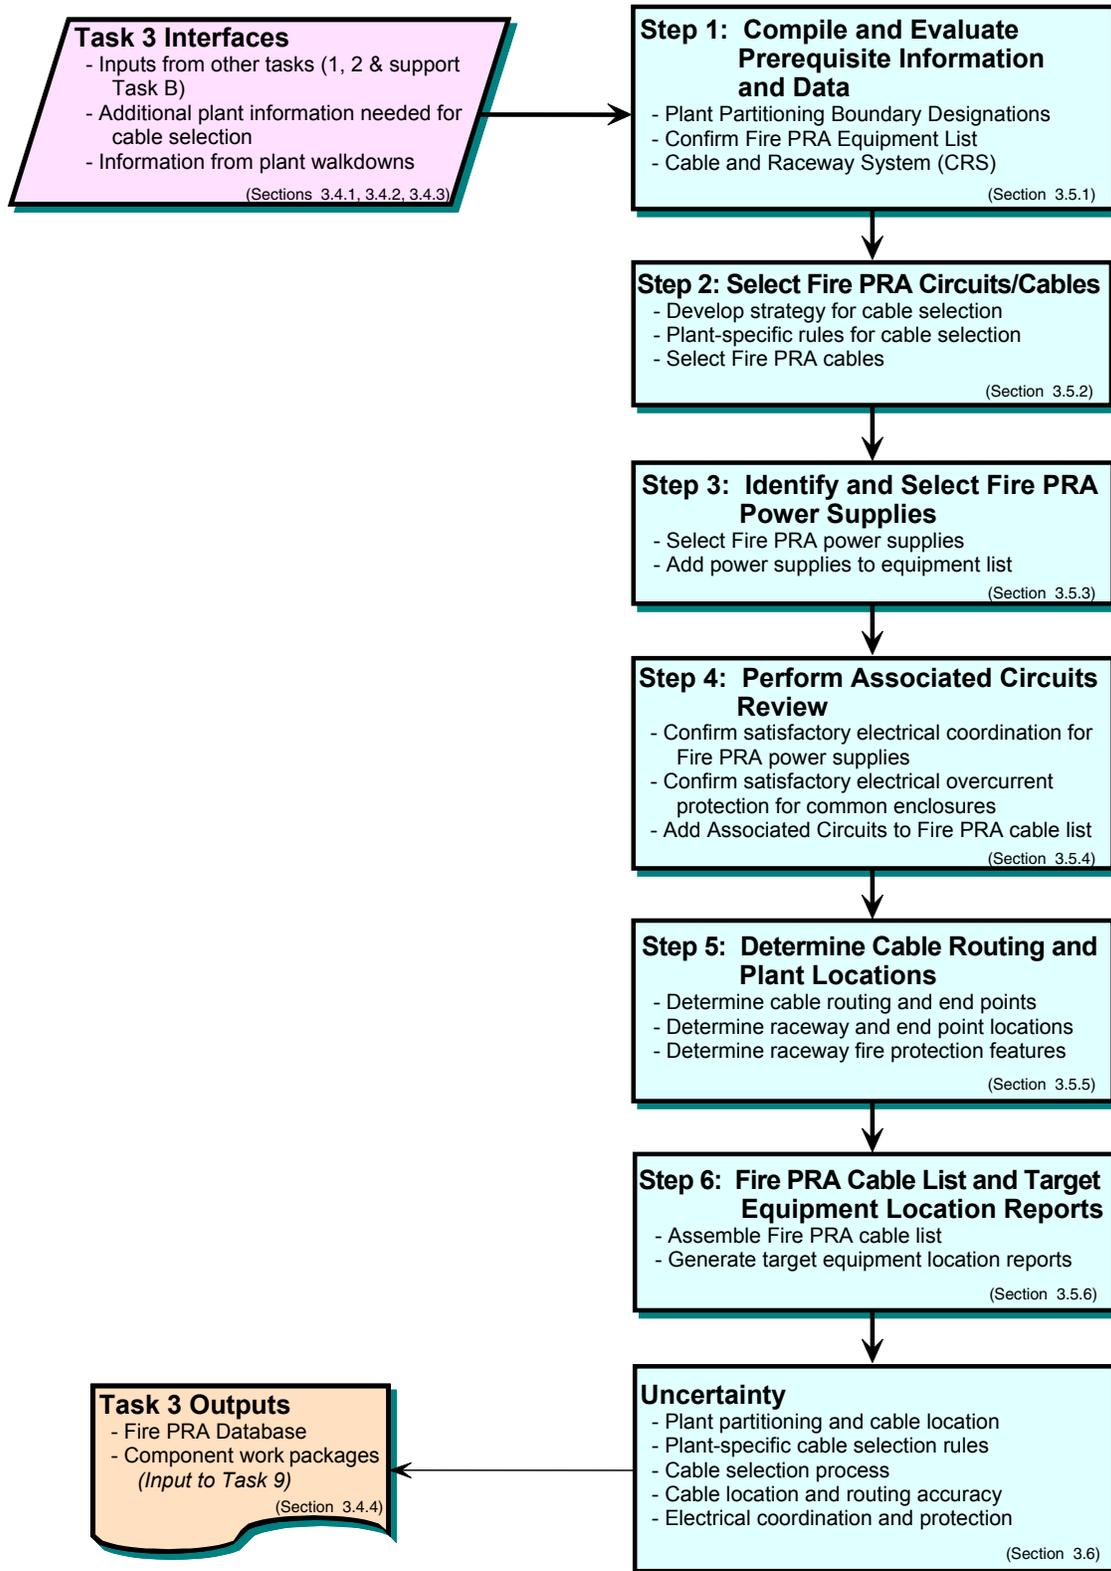


Figure 3-1
 Fire PRA Cable Selection Process

3.3.2 Assumptions

The following assumptions form a basis for this task:

- A cable and raceway database system (CRS) is in place and available to identify cable routing and location. The analysis methods presented in this document assume some degree of automated cable-to-location sort and query capability. The ultimate usefulness of the database to support this task will vary depending on the inherent functionality of the database;
- An Appendix R of 10 CFR Part 50 analysis (herein after referred to simply as *Appendix R analysis*) for the plant has been completed and documented, and is available for helping identify cables associated with Fire PRA equipment. The degree of applicability will vary depending on the plant-specific approach used for the Appendix R circuit analysis;
- Equipment is assumed to be in its normal expected position or condition at the onset of the fire. In cases where the status of a component is indeterminate or could change as a result of expected plant conditions, worst-case initial conditions should be assumed for the purpose of cable selection;
- Properly sized and coordinated electrical protective devices are assumed to function in accordance with their design tripping characteristics, thereby preventing initiation of secondary fires through circuit faults created by the initiating fire; and
- Users of this procedure are knowledgeable in the theory and principles of electrical power and control circuits, and have practical experience with nuclear power plant circuit schemes, power distribution systems, and cable and raceway routing systems. Work under this procedure is assumed to be conducted by or supervised by personnel familiar with circuit failure analysis methods (i.e., Appendix R safe shutdown analysis or similar).

3.4 Task Interfaces

3.4.1 Input from Other Tasks

3.4.1.1 Plant Boundary Definition and Partitioning (Task 1)

This task needs, as a prerequisite, the plant partitioning boundary definitions and fire compartment designations from Task 1, Plant Boundary Definition and Partitioning. This information is used to correlate cable routing to specific plant locations. As a minimum, cables should correlate to plant fire areas. Ideally, the cables will correlate to the established fire compartments.

3.4.1.2 Fire PRA Components Selection (Task 2)

This task needs, as a prerequisite, the list of Fire PRA equipment from Task 2, Fire PRA Components Selection. The Fire PRA Equipment List serves as the starting point for cable selection. The primary objective of Task 3 is to identify circuits/cables associated with the Fire PRA components for the purpose of identifying potential equipment failures on a compartment and fire scenario basis.

3.4.1.3 Fire PRA Database System (Support Task B)

The Fire PRA Database System (or equivalent database system) is a prerequisite for this task. The database system provides a structured framework for capturing and maintaining Fire PRA data. The database system is populated with the data and information generated by this task, which is then compiled to generate the Fire PRA Cable List and accompanying relationships. The data structure and functional relationships established within the database system are specifically designed to maintain data integrity and provide the necessary sort and query capability to conduct compartment and scenario CCDP and CLERP calculations.

3.4.2 Additional Plant Information Needed to Support this Task

3.4.2.1 Plant Cable and Raceway Data System

This task needs basic cable routing and cable location information from the plant CRS or other sources, as applicable. The availability of readily retrievable cable routing and cable location data will significantly impact the analysis strategy and level of effort needed to complete this task. Manually determining cable routing and locations from plant drawings and/or walkdowns is extremely resource intensive. Plants that do not have cable routing and location data in an automated database format should, in the planning stage, carefully consider the additional resources needed to obtain this capability. The analysis methods presented in this document assume some degree of automated cable-to-location database sort and query capability. The ultimate effectiveness of the CRS to support the Fire PRA is directly related to the resolution of cable location information, i.e., a CRS that can readily correlate a cable to a specific raceway and plant compartment is more useful than a CRS that can only correlate a cable to fire areas (lower resolution).

3.4.2.2 Plant Appendix R Safe Shutdown Analysis

Given the substantial overlap between the Fire PRA Equipment List and Appendix R Safe Shutdown Equipment List, the Appendix R circuit analysis information should be used to the maximum extent possible to develop the Fire PRA Cable List. The approach and methods used for the Appendix R cable selection will possibly differ to some extent from that developed for the Fire PRA. These differences should be well-understood to ensure the Appendix R cable set is adjusted as necessary to meet Fire PRA objectives (indication circuits, annunciation circuits, and automatic start features are examples of circuits generally not included in an Appendix R circuit analysis, but might be necessary to meet Fire PRA criteria).

3.4.2.3 Other Information and Data

1. Component elementary circuit diagrams
2. Component cable block diagrams
3. Component wiring/connection diagrams
4. Electrical distribution system single-line diagrams

5. System piping and instrument diagrams (P&IDs)
6. Instrument loop diagrams and block diagrams
7. Cable raceway schedules and routing drawings
8. Equipment location and layout drawings
9. Electrical distribution system protective device coordination studies/calculations
10. Electrical distribution system short circuit and equipment rating studies

3.4.3 Walkdowns

Plant walkdowns are not considered a fundamental part of this task. Rather, plant walkdowns should be considered on a case-by-case basis as a way of obtaining necessary information about cable and/or raceway locations.

3.4.4 Outputs to Other Tasks

The specific products generated by this task are:

- Fire PRA Cable List (input into the Fire PRA Database),
- Fire PRA Power Supply List (input into the Fire PRA Database),
- Associated circuits review, and
- Component analysis work packages (optional).

Developing the Fire PRA Cable List is an essential prerequisite for conducting both qualitative and quantitative screening. The cable list, as input into the Fire PRA Database, provides the functional and spatial relationships that allow potential equipment failures to be identified on a compartment- and fire-scenario level.

Using the Fire PRA Database (which has been populated with the Fire PRA Equipment List and Fire PRA Cable List), *Target Equipment Location Reports* can be produced for use in compartment-level and scenario-level quantitative screening activities (Task 7). Additionally, Task 3 identifies any essential electrical power supplies not previously identified in Task 2. It is highly recommended that component analysis work packages be generated as part of this task. The electrical analysis work packages are useful later during detailed circuit failure analysis (Task 9) and circuit failure mode likelihood analysis (Task 10).

3.5 Procedure

The steps described below provide detailed methods for developing the Fire PRA Cable List and supporting data. Although the instructions cover all aspects of the work, **it is likely that many elements will already be available from previous efforts, such as the Appendix R analysis or previous Fire PRA.** Specifically, how existing analyses and data will be incorporated into the Fire PRA should be thought through carefully during the planning stages. It is strongly recommended that additional plant-specific cable selection “rules” be developed before

beginning work. Plant-specific rules are important to further customize the cable selection methodology to fit the specific circumstances and needs of each plant. The plant-specific rules will also foster consistency between different analysts. As an example, specific rules for addressing status indicators for large pumps might be appropriate to ensure consistency.

3.5.1 Step 1: Compile and Evaluate Prerequisite Information and Data

The purpose of this step is to ensure that prerequisite information and data is available and usable before beginning Fire PRA cable selection. Beginning the process of cable selection without first having the prerequisite information will reduce efficiency and significantly increase the likelihood of rework.

3.5.1.1 Step 1.1: Confirm Plant Partitioning Boundary Designations

Confirm that the plant partitioning boundaries and designations have been identified and input into the Fire-PRA Database (Output from Task 1, Plant Boundary Definition and Partitioning). Consider the following factors in conducting the verification.

1. As a minimum, fire areas should be correlated with the raceway/cable locations. To the degree practical, cable locations should be aligned with the plant fire compartments. If the cable/raceway-to-fire compartment correlations do not match, compartment-level evaluations will be more difficult and resource-intensive. For example, if the raceway location information is based on Fire Area but the Fire PRA partitioning is based on fire zones or rooms (subsets of fire areas), the Fire PRA Database will not be able to develop the necessary correlations for compartment-level losses.
2. The plant partition data should include a correlation to plant fire areas so that fire-area-level analyses can be conducted, if desired.

3.5.1.2 Step 1.2: Confirm Fire PRA Equipment List

Confirm that the Fire PRA Equipment List has been developed and input into the Fire PRA Database, including equipment identifiers, attributes, and functional requirements (Output from Task 2, *Fire PRA Components Selection*). Consider the following factors in conducting the verification.

1. Since identification of Fire PRA cables does not involve a detailed functional failure analysis of the circuit, it is not mandatory that all component position information be available to complete this task. However, conducting the cable selection with knowledge of a component's credited functionality will facilitate the cable selection process and minimize the number of cables included in the Fire PRA Database, as discussed in Section 3.5.2.1.
2. Development of the Fire PRA Equipment List is an iterative process. Thus, it is expected that components will be added or removed during the course of conducting the Fire PRA. The list, however, should be substantially complete before beginning cable selection to ensure major conceptual changes do not result in inconsequential work (e.g., conducting cable selection for an entire system that is ultimately not credited in the PRA model).
3. Depending on the PRA Model, some components may show up in the Fire PRA Equipment List more than once if they have multiple PRA event functions. For example, the PORVs might have two PRA event functions—a function to remain closed for primary inventory

control and a function to open on demand for depressurization capability. A determination should be made at this point whether separate circuit analyses will be conducted for the different events. If separate analyses for the distinct functions are needed, the PRA model and database should be structured to accommodate multiple circuit selection entries for the one equipment item; i.e., one for each distinct function. For example, a valve could be entered into the database with a suffix for the position (e.g., MOV C556 (O) and MOV C556 (C)). In other cases it might be more efficient to simply analyze the component for the bounding case and refine the analysis as needed under Task 9.

4. The Fire PRA Equipment List should specify any unique requirements for additional or supplemental indication, alarm, annunciation, or functionality that deviates from generic rules and methods. For example, the analysis might establish a generic position that annunciation and alarm circuits are not included unless specifically identified due to a human factors concern. On this basis, the cable selection process would not routinely include annunciation and alarm circuits. Rather, these circuits would only be included on a case-by-case basis, as specified by the Fire PRA Equipment List.
5. The Fire PRA component selection process of Task 2 will identify most high-level power supplies. However, additional, less obvious, power supplies will inevitably be identified during the cable selection process. These power supplies should be added to the Fire PRA Equipment List and circuit analysis conducted.

3.5.1.3 Step 1.3: Cable and Raceway System

Determine the extent to which the CRS can be used for automated lookups of cable routing and raceway location data. Manual tracking of cable routing and location data is extremely labor-intensive and should be avoided to the extent possible. Consider the following factors in reviewing CRS capability.

1. Determine if cable routing and location information is available in the CRS and readily retrievable via database query. The availability of readily retrievable cable routing and location data will significantly impact the analysis strategy and level of effort necessary to complete this task. Manually determining cable routing and location from plant drawings and/or walkdowns is extremely resource-intensive. Plants that do not have cable routing and location data in an automated database should carefully consider, in the planning stage, the additional resources needed to obtain this information. In this situation, it is recommended that some amount of detailed circuit analysis be conducted as a part of cable selection to minimize the number of cables requiring tracing. Also confirm that the data has been maintained accurately and is up-to-date. If not, use of the data should include some verification.
2. Establish a plan for addressing missing data, including drawing reviews, conservative assumptions, and field walkdowns. If engineering judgment and/or assumptions are employed, the uncertainty and sensitivity associated with the decision should be established and rolled up into the overall uncertainty analysis for the project.
3. Determine the extent to which Appendix R analysis cable routing information can be used for this study. The Appendix R analysis data will not likely satisfy all requirements, since it is expected that the Fire PRA Equipment List will contain more equipment than that covered by Appendix R. Nonetheless, the Appendix R data can prove helpful in completing this task.

4. Devise a plan/process for downloading and/or accessing cable and raceway data before beginning the cable selection process.
5. Determine the extent to which raceway layout drawings can be used to precisely locate raceways and cables within fire compartments (fire areas, fire zones, and rooms), and the raceway's exact placement with respect to fire hazards in the rooms. Are the drawings "diagrammatic" (field routed with exact location not shown), or are the actual raceway locations shown with some degree of precision specified (ex., ± 3 -feet for Safety-Related, ± 5 -feet for non-safety)? This will determine the extent to which drawings can be used to locate cable and raceway targets vs. plant walkdowns.

3.5.2 Step 2: Select Fire PRA Circuits/Cables

The purpose of this step is to identify the cables associated with each component on the Fire PRA Equipment List. The necessary level of effort and inherent nature of this task will vary greatly depending on the availability of cable location data and usability of Appendix R circuit analysis information. The goal here is to develop a strategy that best leverages available information so as to conduct this task as efficiently as possible.

The cable selection process provided here assumes that three distinct cases will arise.

- Case 1: The component of interest is an Appendix R safe shutdown component and thus has previously undergone a circuit selection process. Cable data is readily available, including cable routing and location information.
- Case 2: The component is not an Appendix R safe shutdown component and has not previously been analyzed to identify cables needed for its proper operation. Although the component has not undergone circuit analysis, cable routing and location data is readily available from the plant CRS.
- Case 3: The same as Case 2, except cable routing and location data is not readily available from the plant CRS. Determining cable location will involve manual drawing reviews and/or walkdowns.

Experience indicates that the Fire PRA Equipment List will contain components not included in the Appendix R safe shutdown equipment list. Thus, the number of "new" components to analyze should be determined early in the planning process so that reasonable estimates for resource requirements can be established.

3.5.2.1 Step 2.1: Develop a Strategy for Conducting Cable Selection

The first step in conducting cable selection is to develop a comprehensive strategy and approach for conducting the analysis. The following factors should be considered.

1. Coordinate with the systems analysts to determine plant-specific rules for indication, alarm, annunciation, and automatic initiation features. The purpose of this step is to ensure complete alignment between the assumed component functionality and the rules developed for cable selection. Experience indicates that a hands-on walkthrough of several components is highly beneficial in fleshing out details that should be considered when developing the cable selection rules.

2. To what extent can the Appendix R circuit analysis data be used? To make this determination, it is necessary to fully understand the analysis approach used to create the original cable set for each component and compare this to the criteria established for the Fire PRA. Determine the level of effort necessary to augment or modify the original cable selection, if at all, to conform to the Fire PRA criteria. Experience indicates that a hands-on review of several components is helpful in revealing differences that should be considered in developing a strategy.
3. Compare the Fire PRA Equipment List to the Appendix R Safe Shutdown Equipment List to determine the number of Fire PRA components that are not covered by an Appendix R circuit analysis. This will help determine the number of components that will need a “new analysis.” *Do not overlook this step; it has a significant impact on the level of effort necessary to complete this task.*
4. The dividing line between Task 3 and Task 9 activities is intentionally fluid. It is, however, intended that the analyst immediately eliminate from the Fire PRA Cable List those cables that are readily identified as not being required to support the credited functionality of the component. Where a detailed and time consuming analysis of a complicated circuit is necessary to fully understand a cable’s impact to a circuit, it is recommended that the analyst include the cable and defer the detailed analysis until quantitative screening confirms that further review is needed to support the Fire PRA. Also determine if cable routing and location correlations will need to be determined by manual drawing reviews and/or walkdowns. If so, it is recommended that some or all of the detailed circuit analysis (Task 9) be conducted as a part of cable selection in order to minimize the number of components that need to be manually routed. This approach will likely prove more efficient overall.
5. Some plants have conducted circuit analysis (in whole or in part) by the exclusion approach, i.e., confirmation that cables are not routed through a selected area. In this case, the availability of equipment should be “hard-wired” into the PRA model for the affected areas. This approach can be highly effective in the initial screening process if screening depends only on a few critical components.
6. Determine how off-site power will be included into the analysis. The cable selection for off-site power can be extensive and complex. Accordingly, the cable selection plan should address this aspect of cable selection up front. In some cases, it might be appropriate to create a “virtual” component that includes all cables for a specific off-site power feed. For other plants, including the off-site power components (switchgear, circuit breakers, transformers, etc.) individually might be more favorable so that the analysis can distinguish between full and partial off-site power losses. Regardless, the approach should be mutually agreed upon by the PRA analysts and electrical analysts. If an off-site power study has already been completed, an alternative approach is to simply hard-wire off-site power losses (full or partial) in the PRA model for the affected areas. This approach would eliminate the need to add the off-site power equipment and cables into the Fire PRA database. The off-site power analysis is generally one of, if not the most, complex circuit analyses. Experience shows that this analysis is most efficiently completed by an experienced engineer with a good working knowledge of the system. Regardless of the approach selected, the key is to address the issue up front before conducting the cable selection.

7. Past assumptions should be revisited to determine their validity and appropriateness within the context of a Fire PRA. In many instances, highly conservative assumptions overly penalize the analysis. For example, assuming a loss of off-site power for all locations containing 4.16 kV cables is highly conservative and does not yield realistic results. Since off-site power is quite influential in the final CCDP values, it is usually worth refining the analysis in lieu of running with an overly conservative assumption.
8. Determine how the cable selection process will be documented. It is often useful to create an analysis package for each component. The analysis package should contain all the necessary references to perform the cable selection. The requisite level of detail to be documented should be clearly established, including the rationale for selecting or excluding specific cables. Analysis packages will also save time and effort for those components in which a detailed circuit failure analysis is needed. If drawings and plant documentation are readily available on-line it might not be beneficial to create a full analysis package as part of this task. In either case, the basis for cable selection should be readily apparent to an independent reviewer.

3.5.2.2 Step 2.2: Develop Plant-Specific Rules for Cable Selection

Once a strategy and approach for conducting the cable selection has been established, it is necessary to translate the approach into specific “rules” that will help determine which cables are to be classified as Fire PRA cables. The benchmark for these rules is that independent review by different analysts should result in identical cable selection. In developing plant-specific cable selection rules, consider the following:

1. The selection of cables should be driven by a functional relationship to the component under review. Any cable that can affect a component’s operation, as credited by the Fire PRA should be designated a Fire PRA cable for that component. In general, all cables should be associated with the primary component listed in the Fire PRA Equipment List. Do not add circuit subcomponents (relays, switches, sensors, modules, gauges, meters, etc.) to the equipment list; they are incorporated automatically into the failure analysis by identifying the fire PRA cables to which the subcomponents are connected.
2. The Appendix R analysis may have more descriptive cable classifications than those used in typical cable and raceway databases (ex., power, control, indication, instrument, control power, spurious). These descriptors reflect possible circuit and equipment failure modes attributable to a cable’s failure. These classifications can be helpful in quickly determining the general effects that a cable’s failure can have on the associated component. Where this Appendix R information exists, it should be carried forward into the Fire PRA database to minimize the effort later in determining cable failure effects on equipment (prevents rework).
3. Consistent with Item 1, above, for components directly supplied from power circuit breakers or motor control centers, it is best to associate the circuit breaker and/or motor starter control circuits with the primary component, instead of adding the circuit breaker as a separate component. Include in the cable selection the feeder/branch power cable(s) supplying the component, but do not include power cables supplying the power supply itself. This approach helps keep the equipment list to a manageable size and maintains a focus on the primary components. Rules should also address inclusion of protective circuits associated with the circuit breaker.

4. For spurious-only equipment in which power is not needed for the component to perform its desired function, it is recommended that cable selection only include cables that could spuriously energize the component. These cables are generally easily identified without a detailed and complex circuit analysis. Overburdening the Fire PRA database with highly conservative circuit analyses for spurious-only equipment is to be avoided. Similarly, the power supplies for these components should not be identified as essential power supplies. The basis for this recommendation is that spurious operation components tend to overwhelm the initial Fire PRA screening. Thus, it is best to minimize the impact of these components from the start.
5. If some aspects of detailed circuit analysis are incorporated into the cable selection process, as recommended, it will be necessary to define the types of circuit faults to be considered by the analysis. Section 9.5.2.2 (Task 9.2.2) provides detailed recommendations for circuit/cable failure modes to be considered by the circuit analysis.
6. A challenging area for consistency and accuracy is how to address auxiliary contacts for interfacing equipment (i.e., interfacing circuits in the form of interlocks, permissives, auto-control functions, etc.). The following methods are suggested; however, each plant should customize the approach to their specific circumstances.
 - If the auxiliary contacts are associated with a component that is included in the Fire PRA Cable List, it should not be necessary to duplicate the cable selection. Instead, confirm the cable selections for both components correlate with each other and that the proper component-level dependencies are established in the Fire PRA model. For example, a turbine-driven AFW pump control circuit might be integrally tied to a steam supply valve. The steam supply valve should be included in the Fire PRA equipment list and PRA Model as an essential support component for the AFW pump. Adding new equipment to the Fire PRA Equipment List and PRA Model should be a corroborative effort between the electrical and system analysts;
 - If the auxiliary contacts are associated with a “system-wide” signal (e.g., safety injection signal, containment isolation signal, etc.), include only those portions of the interfacing circuit uniquely associated with the component under investigation. The rationale here is that higher-level signal failures will affect multiple components, not just the component of interest (e.g., a safety injection signal). Such failures should be addressed on a system-wide basis under the human factors analysis, not a component-level basis, in the analysis. The objective is to include cables that, if subjected to fire-induced faults, could cause a functional problem with only the component under investigation, and thus would not be identified by the operators as a problem with the interfacing circuit. For the system-wide logic signals, it is often advantageous to create a “dummy” component for the system. In this way, the system cables can be associated with the dummy component instead of being added to each individual component affected by the system;
 - If the circuit contains a complex combination of auxiliary contacts, it is usually more efficient to conduct the detailed circuit analysis (Task 9) coincident with cable selection (Task 3). In this way, the analysis can focus specifically on the failure modes of concern, which greatly simplifies the analysis of interposing contacts and minimizes the likelihood of unnecessary work;

- In some cases, normally-open relay or switch contacts may be used to form the “boundary” of a circuit, preventing expending resources modeling or locating cables that do not affect component operation. Whenever this approach is used, the analyst needs to carefully consider whether the switch or relay could change state as part of the anticipated shutdown transient (e.g., BWRs typically anticipate a low and high reactor water level, and high drywell pressure; PWRs typically anticipate low and high pressurizer level and steam generator level, and low reactor pressure);
 - If the auxiliary contacts only serve to reinforce the desired functionality of a component, it is not necessary to include the interfacing component’s cables; and
 - If none of the above criteria apply, either add the interfacing component’s cables to the analysis for the component under investigation, or add the interfacing component to the Fire PRA Equipment List.
7. An area in which traditional electrical circuit analysis might differ from the Fire PRA criteria is indication, alarm, and annunciation circuits. The need for specific indication, alarm, and annunciation circuits should be clearly established before conducting the cable selection (refer to Item 1 of Step 1, above). In determining the rules for cable selection of these circuits, consider the following:
- Indication circuits whose fire-induced failure could impact functional operation of the component should be included as Fire PRA circuits. These circuits are generally integral to the main control circuit. For example, the “green” and “red” indication lights that are integral to the control circuit of a typical motor operated valve (MOV) or pump circuit should be included. Another example is an ammeter or voltmeter that is supplied directly (i.e., no isolation) from the same instrument transformer that provides a signal to circuit breaker control devices, such as overcurrent relays or undervoltage relays;
 - Independent valve or pump annunciation and alarm circuits should be included only to the extent specified by generic criteria or component-specific requirements. For cases in which these circuits are needed, include only those cables that could cause a malfunction to the circuit associated with the component under investigation. Cables whose failure would cause a system-wide impact do not need to be included. As an example, consider an independent alarm for a valve that receives its input signal from isolated contacts of a limit switch. The valve signal is sent to an alarm input module in the annunciator system. The input cable to the module would be considered a Fire PRA cable, since its failure could cause an erroneous annunciation for the component of interest, but would not otherwise impact the annunciation system. In contrast, a cable associated with providing power to the annunciation system would not be included, because failure of this cable would cause the affected block of annunciators to fail, and thus would be recognized as a failure of the annunciator system and not the individual component;
 - Include data acquisition cables associated with plant process computer and/or Emergency Plant Data Systems that are not electrically isolated from the component’s power/control circuits;

- Independent ammeter or voltmeter circuits associated with large motors or switchgear that are independent of the main control circuit (i.e., the meters are supplied via isolators or independent instrument transformers) need only be included to the extent specified by generic criteria or component-specific requirements. Consideration should be given to those indication circuits that have the potential to cause adverse operator actions in the event that the circuit in question fails by falsely indicating component failure. For example, a pump motor ammeter circuit that provides status indication in the control room may fail such that it indicates a loss of electric power to the motor, thus causing the operator (either via procedure or by choice) to trip the otherwise operating pump;
 - Independent overtemperature circuits for large motors should be included if the circuits are designed to initiate a pump trip. If the circuits are designed only to provide an alarm, they should be included to the extent specified by generic criteria or component-specific requirements.
8. For high-voltage buses, it is recommended that supply circuit breakers (EDG supply and off-site supply) be included on the Fire PRA Equipment List as separate components. This approach facilitates the combination of breaker positions needed to accommodate both off-site power and EDG power lineups. Plant experience has shown that this approach is also helpful for panels fed from multiple power sources that can transfer manually or automatically between sources (e.g., swing-bus, static switch, voting instrument power inverter, manual transfer switch).
 9. The circuit analysis assumes a component is in its normal expected position. In some cases, this position could be indeterminate; for example, a set of pumps that are alternately in service to balance run time hours. In this case, the worst-case initial conditions should be assumed for cable selection.
 10. In some situations, fire-induced cable and circuit failures can result in permanent damage to mechanical and electrical equipment in such a way that potential recovery actions are impacted. For example, a spurious actuation of a motor operated valve caused by a hot short that bypasses the valve's torque switch might permanently bind the valve, thereby precluding manual operation of the valve at a later time. The electrical analysts should document these cases and coordinate with systems analysts responsible for assessing recovery actions.

3.5.2.3 Step 2.3: Select Fire PRA Cables

This step constitutes the critical element of this task. Inaccurate selection of cables will ripple through the entire PRA and can result in erroneous CCDP and CLERP calculations. Consider the following factors in conducting cable selection.

- Although detailed circuit functionality and failure modes are not assessed during this phase of the circuit analysis, electrical elementary diagrams, connection diagrams, and one-line diagrams should be reviewed to ensure all appropriate Fire PRA cables are identified;
- If the schematic/elementary drawings do not contain a cable block diagram, it is recommended that a cable block diagram be generated and placed in the component's "Analysis Package." Cable block diagrams are valuable tools in understanding circuit physical relationships and conductor-cable correlations. A sample block diagram is shown in Appendix B;

- To the extent possible, the Appendix R circuit analysis should be used to facilitate cable selection. However, as noted previously, it is essential that differences between cable selection methodologies be understood and reconciled;
- In documenting the selection of Fire PRA cables, the corresponding source references used to obtain the information should be included. It is also important to identify any known or suspected gaps/discrepancies found in the cable information sources and recommend corrective action for future revisions.

Case 1: Incorporation of Existing Analysis

If the basis for cable selection is to be a previous analysis (e.g., Appendix R analysis), complete the cable selection process as follows.

1. Assemble applicable documentation, drawings, and database information, as necessary.
2. Based on the cable selection rules established in Step 2, above, and an understanding of any generic differences between the Appendix R analysis and Fire PRA criteria, identify cables to be added or removed from the original cable list.
3. Document the changes in accordance with the methods established during the planning phase.

Case 2: New Component Analysis—Cable Routing Data Readily Available

If the component to be analyzed has no previous analysis or if the previous analysis is based on substantially different rules, complete the cable selection process as follows.

1. Collect and assemble plant drawings, documents, and data for each component. Create analysis packages in accordance with the methods established during the planning phase.
2. Following the plant-specific rules established for cable selection, identify circuits/cables directly associated with each Fire PRA component, including:
 - Power cables,
 - Control and indication cables, and
 - Instrument cables.
3. Following the plant-specific rules established for auxiliary contacts and interfacing circuits, identify circuits/cables indirectly associated with each component's operation (e.g., permissive circuits, interlocks, auto control circuits, etc.).
4. Document the cable selection in accordance with the methods established during the planning phase.

Case 3: New Component Analysis—Cable Routing Data Not Available:

Components in this category are analyzed as described in Case 2, above, except the cable selection process will generally include a detailed circuit analysis based on the methodology in Task 9. In this way, the functional impact of cable failures can be compared to the desired function of the component to eliminate all cables except those absolutely necessary to support the required functionality.

The objective of conducting the detailed circuit analysis coincident with cable selection is to minimize the number of cables for which manual routing and location reviews need to be performed.

3.5.3 Step 3: Identify and Select Fire PRA Power Supplies

This step identifies the electrical power supplies associated with each component on the Fire PRA Equipment List. The list of Fire PRA power supplies is used for two purposes. First, each power supply should be included in the Fire PRA Equipment List. Secondly, each power supply needs to be reviewed for potential common power supply associated circuit concerns.

3.5.3.1 Step 3.1: Select Fire PRA Power Supplies

In conjunction with reviewing the elementary diagrams and one-line diagrams in Step 2.3, above, identify the power supply (or supplies) associated with the component and any associated system logic cabinets and instrumentation cabinets. It is advantageous to identify the power supply and the specific breaker/fuse supplying the component. If the component has no active function (e.g., solenoid whose desired position is deenergized, MOV that is not required to change state, pump that needs to be turned off), it is not necessary to include the power supply.

3.5.3.2 Step 3.2: Add Fire PRA Power Supply to Equipment List

Each power supply is considered a necessary support component. As such, these power supplies should be included in the Fire PRA Equipment List and the PRA Model. Without this link established in the PRA Model, equipment failures resulting from a loss of power may be masked. In adding power supplies to the Fire PRA Equipment List, consider the following factors:

1. A majority of the Fire PRA power supplies will, most likely, already be included in the Fire PRA Database as a result of Task 2. In these cases, this step serves as confirmation and also identifies any secondary or alternate power supplies that might be discovered as part of the circuit analysis.
2. A circuit analysis should be performed for the power supplies. In performing the cable selection for power supplies, it is important to capture all electrical protective device circuits that could initiate a trip of supply breakers to the bus. These circuits include overcurrent trip circuits, differential trip circuits, ground fault protection, undervoltage and overvoltage circuits, etc.
3. Each power supply itself will have an upstream power supply that should be added to the equipment list, if not already there. Some power supplies (e.g., 4kV bus) may also have separate control power supplies that should be included.

3.5.4 Step 4: Perform Associated Circuits Review

This step determines whether any circuits exist that can indirectly cause a critical component failure due to a shared power supply or raceway. These “associated circuits” result from inadequate electrical coordination (common power supply associated circuit) or inadequate circuit overcurrent protection (common enclosure associated circuit). This step addresses

common power supply and common enclosure associated circuits. Spurious operation associated circuits are addressed in Task 2 by adding to the Fire PRA Equipment List those components that pose a potential spurious operation concern.

In the case of common power supply associated circuits, the concern is that fire-induced damage to a non-Fire PRA cable will result in a fault. If the feeder overcurrent protective devices for a power supply are not coordinated with upstream supply devices, the fault could cause the entire power supply to be deenergized.

Common enclosure associated circuits are of concern when a circuit protective device is not sufficiently rated to interrupt the fault current to which it might be subjected, or the protective device is too large to prevent thermal damage to downstream cables as a result of current flow in excess of the cable rating. In the absence of adequate electrical protection (i.e., properly sized protective relays, circuit breakers, and fuses), heat generated by fire-induced faults on nonessential cables could potentially cause a secondary fire to occur within a common enclosure (e.g., raceway, box, or panel) shared with Fire PRA cables, thereby damaging the essential cables. The engineering principal at the center of concern is an overcurrent condition that allows excessive ohmic heating, which in turn raises the cable insulation temperature to a potentially unsafe level.

In most cases, the plant will have electrical design criteria and a documented electrical coordination study that provide adequate assurance against adverse effects from common power supply and common enclosure associated circuits. In this case, the intent is that existing documentation/analyses be reviewed to ensure sufficient coverage for the Fire PRA analyses. This review should not be construed as requiring a complete revalidation of existing work or criteria. Each plant should evaluate their specific documentation and determine if any additional reviews are appropriate. For example, an Appendix R safe shutdown power supply (electrical panel or bus) that is covered by an existing coordination study should need no additional analysis. If, however, the Fire PRA credits new equipment that is powered from a noncritical bus, and that bus has never been evaluated for proper electrical coordination, additional review is prudent.

3.5.4.1 Step 4.1: Confirm Satisfactory Electrical Coordination for Fire PRA Power Supplies

For each Fire PRA power supply, confirm that electrical overcurrent protective devices are properly coordinated to achieve selective tripping between supply and feeder/branch devices. In reviewing electrical coordination, consider the following factors.

1. It is not the intent of this step to duplicate analyses that have already been completed. Rather, the goal is to confirm that existing analyses and studies satisfy baseline assumptions of the Fire PRA. In most cases, electrical coordination studies will exist as part of the general plant design basis or Appendix R analysis. Thus, this step's evaluation should consist of a summary-level review of the existing calculations/analyses to identify any documented cases of noncoordination that might impact the Fire PRA.

2. Acceptable coordination should be based on standard and customary electrical design practices adopted by the plant. For this screening-level review, full selective tripping should be the basis for acceptance. Presupposed manual actions to reclose breakers and cable separation analyses should not be credited at this stage (Note that these strategies are actually recovery actions to mitigate equipment losses due to inadequate coordination). In determining the applicable criteria, care should be exercised to reconcile any fundamental differences between current and past criteria and expectations for rigor and detail in documenting analysis results.
3. In reviewing past analyses, it is important to ensure that the coordination study encompasses not only the correct power supplies, but also the lineups credited by the Fire PRA. Additionally, coordination should not be predicated on limiting fault current based on cable length. This strategy is commonly employed in Appendix R coordination studies, but it does not generically apply to Fire PRA analyses, since compartment-level and scenario-level reviews are conducted.
4. Coordination issues are most likely to exist for non-safety related buses that are not credited in the Appendix R analysis.
5. Based on historic precedent, low-voltage 120 VAC and 125 VDC circuits are generally more prone to coordination problems than are higher voltage circuits due to overlapping time-current tripping characteristics of small molded case circuit breakers, circuit protectors, or fuses. Accordingly, the low voltage power supplies should be reviewed carefully.

3.5.4.2 Step 4.2: Confirm Satisfactory Electrical Overcurrent Protection for Common Enclosures Issues

Confirm that electrical overcurrent protective devices are properly rated and sized for their application. The criteria for this step are based on normal and customary electrical code requirements. In reviewing the adequacy of overcurrent protection, consider the following factors.

1. As with Step 4.1, above, it is not the intent of this step to duplicate analyses that have already been completed. The objective is to confirm that existing analyses, studies, and design practices satisfy baseline assumptions of the Fire PRA. A review of common enclosure associated circuits has likely been conducted as part of the Appendix R of 10 CFR Part 50 analysis. Thus, this step should primarily involve confirmation that existing studies are adequate for the intended purpose. Any differences between existing studies and the objectives of the upgraded PRA will, of course, need to be addressed.
2. Satisfactory overcurrent protection should be based on standard electrical design practices, which are generally rooted in electrical code requirements. Normal plant design policy typically ensures satisfactory overcurrent protection.
3. Plant short circuit studies generally confirm the adequacy of overcurrent protective device ratings.
4. In evaluating the adequacy of cable thermal protection, the criteria for acceptance should be based on a secondary fire concern and not simply exceeding the continuous or overload thermal limit for the cable. The continuous and overload rating of a cable are based on long-term degradation, not short-term failure.

3.5.4.3 Step 4.3: Add Associated Circuits to Fire PRA Cable List

Any circuits that do not satisfy the criteria specified in Steps 4.1 and 4.2, above, should be added to the Fire PRA Cable List. It is recommended that the cables be associated with the power supply from which they emanate so as to avoid adding the cable to every component fed from the power supply.

3.5.5 Step 5: Determine Cable Routing and Plant Locations

The purpose of this step is to determine the routing and plant location for the Fire PRA cables. This step is conceptually straightforward, but can prove to be highly resource intensive, depending on the availability and format of existing information. If a detailed circuit analysis was conducted as part of cable selection, it is only necessary to determine cable routing and locations for cables that result in functional failures of concern.

This step establishes cable-raceway-location correlations so that the plant compartments through which a cable is routed can be readily determined. The approach below assumes that cable locations are established by correlating cables to raceways and then raceways to plant locations (compartments). In some cases, available plant data might simply correlate cables directly to locations. The process outlined below should be adjusted accordingly if this applies.

3.5.5.1 Step 5.1: Determine Cable Routing and End Points

Identify the raceways through which the Fire PRA cables are routed (raceways include conduit, cable tray, junction boxes, pull boxes, panels, etc.). Also identify the end points for the cable, i.e., the cable “from” and “to” locations. Consider the following factors in determining cable routing.

1. In most instances, it is important to include cable end point locations in the routing because a cable termination can exist in a compartment with no associated raceway. For example, a cable that directly enters a control room panel via a floor sleeve. Cable end points might include junction boxes, panels, control centers, buses, load centers, and electrical penetrations, as well as the components themselves. It is suggested that the analysis document cable end points even if this information is not essential for identifying cable locations.
2. Cable routing information is generally available from the plant CRS. The process of associating raceways to cables should be automated to the extent possible. Ideally, the plant CRS information is downloaded directly to the Fire PRA Database for use, or is accessible on-line.
3. In some cases, raceway routing information may be missing or be incomplete. For these cases, walkdowns might be necessary. Any assumptions regarding routing should be assessed with respect to uncertainty in accordance with Section 3.6.
4. Bus ducts are generally not included in the CRS. Consequently, it might be necessary to manually incorporate bus ducts if the duct extends beyond on plant compartment.

3.5.5.2 Step 5.2: Determine Raceway and End Point Locations

Identify the plant locations (i.e., compartments) in which the raceways and end points are located to establish cable-to-raceway-to-compartment relationships. Consider the following factors in determining raceway locations.

1. This information might exist in one of many different forms. Ideally, it is already contained in the plant CRS. If so, the desired correlations are obtained by simply downloading or linking to the data. The Appendix R circuit analysis might also contain raceway location information.
2. In establishing the overall cable-to-raceway-to-location relationships, it is important not to subrogate the raceway information (i.e., simply correlate cables to compartments). Although this might be more expedient, the missing raceway information will preclude the ability to conduct raceway-by-raceway fire scenario analyses, which is one of the most powerful aspects of the Fire PRA.
3. If raceway information is not readily available in a database format, a review of plant layout drawings and, if necessary, walkdowns, will need to be conducted to obtain the needed information.
4. End point information need not be tracked if this information is not necessary to identify the compartments in which the cable terminates.
5. In some cases, it may not be feasible to determine a cable's exact routing, yet possible to pin down the specific compartment through which it passes. In these cases, a dummy routing point can be established to obtain the desired correlation. The use of dummy routing points should be well-documented in the analysis. In documenting the cable routing locations, it is also important to identify any known or suspected gaps/discrepancies found in the cable information sources and recommend corrective action for future revisions. Any assumptions regarding routing should be documented and factored into the uncertainty analysis.

3.5.5.3 Step 5.3: Determine Raceway Fire Protection Features

Identify any fire protection features associated with the raceway, including fire wrap, flame-retardant coatings, barriers, shields, etc. Record this information in the Fire PRA Database, and, if possible, identify the area, zone, and room in which the protection is provided.

3.5.6 Step 6: Fire PRA Cable List and Target Equipment Location Reports

The information collected in the previous steps is entered into the Fire PRA Database, thereby establishing the Fire PRA Cable List. In entering the data into the Fire PRA Database, it is important to maintain the established data structure and relationships created for the database system. This will ensure that the essential database sort and query capability is achieved and that data integrity is maintained throughout the iterative process of conducting the evaluation.

Once the Fire PRA database is populated with the Fire PRA equipment data and Fire PRA cable data, Target Equipment Location Reports can be generated automatically. The reports are a listing of equipment by compartment that is either located in the compartment or has related cables located in the compartment.

3.5.6.1 Step 6.1: Assemble Fire PRA Cable List

The following information is collected and input into the Fire PRA Database. This information, along with other support data entered into the database, is used to establish the Fire PRA Cable List.

- Cable ID,
- Associated Fire PRA equipment ID,
- Cable function (e.g., power, control, instrumentation),
- Cable vias (i.e., the raceways through which a cable is routed),
- Cable end points (i.e., cable “from” and “to” points),
- Raceway locations,
- End point locations (if applicable),
- Raceway fire protection features,
- References, and
- Comments.

Appendix B contains an example of the requisite information, along with a sample cable block diagram. The information is shown as a cumulative “block” of data to illustrate the information to be collected, and does not necessarily represent the final form of the data in the Fire PRA Database tables.

3.5.6.2 Step 6.2: Generate Target Equipment Location Reports

Using the Fire PRA Database, generate Target Equipment Location Reports for all compartments. Appendix B contains an example of a Target Equipment Location Report for the sample data depicted.

4

QUALITATIVE SCREENING (TASK 4)

4.1 Purpose

This procedure describes the criteria for qualitatively screening the fire compartments defined in Task 1.

4.2 Scope

This work package addresses the following issues in qualitative screening:

- Definition of screening criteria and basis, including definition of plant trip initiator and controlled manual shutdown;
- Reference to Fire PRA component list used in qualitative screening and criteria for equipment selection; and

In most fire IPEEE analyses, the primary containment was qualitatively screened. In this methodology description, the examination of potential risk associated with fires in primary containment will follow steps similar to other locations of the plant.

4.3 Background Information

4.3.1 General Task Objectives and Approach

From Task 1, Plant Partitioning, a set of fire compartments is identified for the Fire PRA. These compartments are subjected to a series of screening analyses that will determine the relative fire risk associated to each. Qualitative screening is the first of such screening analyses. It is not intended to assign risk values to particular fire compartments. It is intended, however, to identify those fire compartments where, according to pre-determined criteria, the fire risk is expected to be relatively low or nonexistent compared to others.

4.3.2 Assumptions

This task assumes that the risk (i.e., CDF and/or LERF) associated with the fire scenarios where a controlled manual plant shutdown may be attempted as a precautionary measure and no other Fire PRA components are affected is low.

4.4 Task Interfaces

4.4.1 Input from Other Tasks

This task needs input from the following tasks:

- Task 1: The list of fire compartments in the plant resulting from the partitioning analysis, and
- Tasks 2 and 3: Equipment and cables selected for the Fire PRA.

4.4.2 Additional Plant Information to Support this Task

No additional plant information is needed in support of this task.

4.4.3 Walkdowns

A formal walkdown is not necessary to complete this task. A walkdown, however, may be appropriate if the analyst needs to confirm information described in plant documents and drawings.

4.4.4 Outputs to Other Tasks

The results of this task, unscreened fire compartments, are used in:

- Task 6: Fire Ignition Frequency, where fire frequencies are estimated for each of the unscreened fire compartments; and
- Task 7: Quantitative Screening. The unscreened fire compartments are subjected to quantitative screening.

The steps performed under this task should be documented in a work package. The work package should contain the following:

- A list of all fire compartments qualitatively screened and the basis for their screening, and
- A list of all the fire compartments that were not screened and need further analysis.

4.5 Procedure

Screen a fire compartment if:

- The compartment does *not* contain any of the equipment (and their associated circuits) identified in Tasks 2 and 3, and
- In concert with Section 2.5.3 of the Task 2 procedure, the compartment is such that fires in the compartment will *not* lead to:

- an automatic trip, or
- a manual trip as specified in fire procedures or plans, emergency operating procedures, or other plant policies, procedures and practices, or
- a mandated controlled shutdown as prescribed by plant technical specifications because of invoking a limiting condition of operation (LCO). In this latter case, it is undesirable to identify cases where shutdown is unlikely to occur before the fire is likely to be extinguished and where limited effects are expected. Hence, the analyst needs to judge which cases will be included and provide justifications.

Note that Reference [4.1] provides a suggestion of including cases where shutdown within 8 hours is mandated.

The above criteria are specifically intended to allow the qualitative screening of fire compartments that do not contain any of the equipment and their associated circuits identified in Tasks 2 and 3, but where a prolonged fire might lead operators to implement a controlled manual shutdown strictly as a judgment-based precautionary measure (i.e., manual shutdown is not specifically directed by procedure, nor due to technical specification mandates). It is assumed these types of scenarios are bounded by internal events analyses of general plant trip initiators.

Note that PRA is an iterative process. Should the analyst choose to modify the list of equipment from Task 2 or the Task 3 cable list at a later stage of analysis, the qualitative screening analysis should also be reviewed to ensure that fire compartments initially screened out still satisfy the screening criteria.

Fire compartments qualitatively screened in this task will be reexamined in Task 11 for fires that may cause potentially risk-significant damage to equipment located in adjacent compartments (multi-compartment fire scenarios).

A fire in a compartment that is qualitatively screened (and does not propagate to an unscreened fire compartment) does not contribute to fire-induced risk individually or collectively, since it neither causes a forced plant shutdown nor will it put the plant in a degraded condition requiring plant shutdown while the plant remains in the degraded condition.

4.6 References

- 4.1 *Fire PRA Implementation Guide*, December 1995, EPRI TR-105928.

5

FIRE-INDUCED RISK MODEL (TASK 5)

5.1 Purpose

This section describes the procedure for developing the Fire PRA Model to calculate CDF, CCDP, LERF, and CLERP for fire events. The procedure addresses the process of implementing temporary or permanent changes to the Internal Events PRA to quantify fire-induced CDF, CCDP, LERF, and CLERP, and for developing special models to address FEPs. The procedure also addresses the transition from temporary changes to permanent changes to the Internal Events PRA Model during the development of the Fire PRA Model.

5.2 Scope

This procedure addresses the following major steps for developing the Fire PRA Model for calculating CDF/CCDP and LERF/CLERP for fire events.

- Step 1–Develop the Fire PRA CDF/CCDP Model.
- Step 2–Develop the Fire PRA LERF/CLERP Model.

5.3 Background Information

5.3.1 General Task Objectives and Approach

The primary objective of this task is to provide an approach that allows the user to configure or modify the Internal Events PRA model to quantify fire-induced CDF, LERF, CCDP, and CLERP. There are at least two different PRA modeling approaches that have evolved in the PRA field. These two models, in the evolution of PRA methodology development efforts have come to be known as the “Fault Tree Linking Approach” and “Event Trees with Boundaries Approach”. There is a number of different PRA software products available in the industry market designed around these two approaches. The approach described in this procedure is based on standard state-of-the-art PRA practices, and is intended to be applicable for any PRA methodology or software product.

This procedure allows the user to quantify CDF and LERF or CCDP and CLERP. The only difference is that the quantified values of the fire scenario frequencies are used for CDF and LERF calculations, while the fire scenario frequencies are set to 1.0 or TRUE⁴ for CCDP and CLERP calculations.

Most Internal Events PRA models are based on the premise that the operators will enter the EOPs. Consequently, the plant response and the operator responses modeled in the PRA are based on the EOPs. For some plants, a fire may drive the operators to FEPs that significantly deviate from the EOPs. In some cases, unprotected trains of mitigation systems (i.e., trains not credited in the Fire Safe Shutdown Analysis) may be placed out of service to preclude the adverse effects of fire-induced spurious actuations. For these cases, the Internal Events PRA model may not be appropriate and special models may have to be developed. For other plants, the FEPs may not significantly deviate from the EOPs, or the EOPs take precedence over the FEPs. For these cases, the Internal Events PRA may be acceptable. The PRA and HRA analysts should review the EOPs and the FEPs and determine whether a special model for the FEPs is needed.

At many plants, a combination of approaches is used. For fires that don't necessitate control room evacuation, the EOPs are often used (and thus the Internal Events PRA is useable). Even in this case, some fire-specific actions may be taken as the result of the simultaneous use of other fire-specific procedures. For fires that result in control room evacuation (i.e., alternative shutdown), the operators are directed to exit the EOPs and enter the FEPs. Therefore, a dedicated model is often needed. In all cases, unique manual actions may need to be addressed and particularly for control room evacuation cases as well as ex-control room local actions, other equipment including instrumentation not typically addressed in the Internal Events PRA may also need to be added to the Fire PRA Model (see Task 2 about identifying equipment to be added to the component list and Task 12 about identifying new fire-related human actions).

5.3.2 Assumptions

This procedure assumes that the user is familiar with the PRA methodology and software employed at the nuclear power plant facility. The user should also be familiar with the procedures for quantifying the PRA model. This procedure assumes that the Internal Events PRA has sufficient fidelity to automatically propagate component-level failures through the system and sequence logic models using the PRA software.

⁴ Care should be taken when configuring the model as to which basic events fail (i.e., failure mode or event set to TRUE or 1.0 failure probability) as a result of the fire. The correct setting (TRUE or 1.0) may need to correspond to the timing of the failure mode (or event) relative to other possible failure modes or events, and/or whether the occurrence of the failure mode or event precludes the other failure modes/events.

5.4 Task Interfaces

5.4.1 Input From Other Tasks

This task uses the Internal Events PRA sequences and fire-induced initiating event information from Task 2, Fire PRA Components Selection, a list of unscreened fire compartments from Task 4, Qualitative Screening, the PRA equipment to be modeled from Task 2 as reflected in the Fire PRA Database developed in Support Task B, Fire PRA Database System, and a list of HRA events developed in Task 12, Post-Fire Human Reliability Analysis. Note that in order for the Fire PRA modeling process to be complete, the model needs to reflect the locations of the cables that will be recorded in the database from Support Task B (information supplied from the Task 3 cable selection process) so that the cable targets are associated with the appropriate compartments when analyzing fires in each compartment. There will be some iteration particularly on the PRA equipment and HRA events addressed in the Fire PRA Model due to more detailed analyses in other tasks as the analysis evolves.

5.4.2 Additional Plant Information Needed to Support this Task

The Internal Events PRA Model for the nuclear power plant facility is needed to support this task. The user should also have access to the software tools necessary to quantify the PRA model. The EOPs and FEPs and other fire procedures, as necessary, should be accessible to the user.

5.4.3 Walkdowns

No walkdown is needed to support this task.

5.4.4 Outputs to Other Tasks

This task provides the steps to configure the Internal Events PRA Model into becoming the Fire PRA Model, and support the quantitative screening task (Task 7) that, along with other task products eventually yields the final core damage and large early release estimates from postulated fire events.

5.5 Procedure

In this task, the Internal Events PRA Model, the unscreened fire compartments from Task 4, the PRA equipment and fire-induced initiating event information from Task 2 as reflected in the Fire PRA Database in Support Task B, and the HRA events developed in Task 12 are used to develop the plant model for the Fire PRA. This development is a phased and iterative process of implementing both temporary and permanent changes into the Internal Events PRA Model. In the early phases (i.e., during the early quantitative screening), temporary changes to the Internal Events logic models are implemented using surrogate events to simulate the impact of each fire. While the use of existing surrogate events in the model will be minimized during the early

phases, new surrogate events may have to be added to the logic models to capture the direct and indirect impacts of each fire. During the final quantification phases of the model development process, permanent changes are implemented to the logic models. In any case, the analyst always has the option of implementing permanent changes to the model and bypassing the phased approach. For plants that implement FEPs that deviate from the EOPs, new logic models will likely have to be developed since the Internal Events PRA Model may not be appropriate. When new FEP models are needed, the user should work closely with the analyst for Task 12 to ensure accurate modeling of operator responses in the FEPs.

It should be emphasized that as the Fire PRA Model is being developed, the analyst should verify that the PRA logic model reflects, as intended, the effects of fire-induced equipment failures. The Fire PRA Model may be refined during subsequent quantitative screening (see Task 7), and as additional information is made available from other tasks. However, during the latter stages of model refinement, and certainly by the time final quantification is undertaken, the proper function of the logic model should already have been verified. For instance, one fire scenario might be assumed to cause a total loss of offsite power to the plant vs. another fire scenario that leads to the failure of only one offsite power bus. The effects of these fires are clearly different. If it is decided that the Fire PRA will make the distinction between these two cases, it should be verified that the logic model appropriately captures the relevant functional and operational distinctions. Similarly, some components have more than one mode of failure that is of interest depending on the scenario conditions. For example, the spurious opening of a particular valve may be the failure mode of interest in one situation whereas the failure to open of the very same valve may be the failure mode of interest in another situation. In such cases, the events in the logic model need to capture each failure mode differently and tie each failure mode to the appropriate sequences. It is acceptable to neglect a rigorous treatment of such distinctions during the early stages of model development and initial screening calculations so long as the effects of all possible failure modes are conservatively bounded. For instance, during initial development, the model may reflect all failure modes of a component at the same time even though this is logically inconsistent (a valve cannot be both open and closed at the same time). As the analysis evolves and becomes less conservative and more realistic, it is imperative that the fire-induced component failure modes and effects are implemented in the model in as realistic a way as possible. Using the correct events in the model to capture these effects is vital to the model producing the most realistic, best-estimate CDFs and LERFs.

5.5.1 Step 1: Develop CDF/CCDP Model

In this step, the Internal Events PRA is modified to incorporate the model changes necessary to quantify fire-induced CDF/CCDP. The list of unscreened fire compartments from Task 4 and the Fire PRA Database developed in Support Task B from Task 2 are reviewed to identify those equipment and associated failure modes and effects of concern that need to be modeled in the Fire PRA.

5.5.1.1 Step 1.1: Select Appropriate Fire-Induced Initiating Events and Sequences and Verify against the Component List and Failure Modes

In this step, a fire-induced initiating event(s) is defined for each of the unscreened fire compartments identified in Task 4. The compartments and associated impacts should be documented (e.g., defined in the Fire PRA Database System), and the fire-induced initiating events should be incorporated into the PRA logic model in such a manner as to mimic the impact of the appropriate mapped internal initiating events. Note that Task 2 (particularly section 2.5.3, step 3 of that procedure) outlines the process of determining appropriate fire-induced initiating events and the appropriate mapping that is to be implemented in this procedure when constructing the Fire PRA Model. As stated in Task 2, not all compartments may have fire-induced initiating events assigned to them on the basis of the criteria presented in Task 2. Each fire-induced initiating event that is identified is mapped to the internal initiating event that closely reflects the impact of the fire-induced initiating event on the plant. For example, a fire in a compartment containing the motor-control center for the service water pumps should be mapped to the loss of service water initiating event. For CCDP calculations and during the early phases of the model development process, the model configuration setting function of the quantification tool (i.e., flag logic or rule-based logic) can be used during the quantification process to introduce temporary changes to the logic models. With this method, the mapped internal initiating event is temporarily assigned a value of 1.0, or TRUE. All other initiators are temporarily assigned a value of 0.0, or FALSE. For CDF calculations and during the final stages of the model development process, fire-induced initiating events can be explicitly incorporated into the logic models.

The Internal Events accident sequences are the primary source for developing fire-specific accident sequences in the Fire PRA Model. Much of the existing Internal Events PRA accident sequence logic can be used and fire-induced failures can be propagated through the existing logic structure. However, additional searches for new sequences to be modeled need to be conducted. This is because certain sequences were likely screened out of the Internal Events PRA or because of fire effects that represent unique challenges to the plant not covered in the Internal Events PRA (see Task 2 for more on this subject). For example, a cable room fire could cause:

- Plant trip,
- Loss of offsite power,
- Spurious PORV opening,
- Loss of RCP seal cooling,
- Loss of cooling water,
- Steam generator overfeed,
- Spurious safety injection causing a stuck open relief valve, etc.

Some of these effects can be directly modeled with the existing Internal Events PRA accident sequence logic. Others will need new logic in order to determine the fire-induced failure scenarios (e.g., Fire * PORV spurious operates * PORV block valve failure). The Fire PRA Database can be used to generate a list of PRA basic events for each fire compartment. For some PRA models, new fire-specific logic models will have to be developed. Conditional logic needs to be developed for each fire-induced initiating event.

For plants that have FEPs, special models may be needed to address deviations from the EOPs. Across the spectrum of plants, the following procedural responses to a fire are examples of what may be possible:

- The FEPs are entered and unprotected equipment is disabled to preclude spurious actuations. The EOPs are reentered after the plant is stabilized.
- The FEPs are entered and unprotected equipment is disabled to preclude spurious actuations. The EOPs are not reentered after the plant is stabilized.
- The FEPs are entered but unprotected equipment is not disabled to preclude spurious actuations. The EOPs are not reentered after the plant is stabilized. However, the FEP response is virtually identical to the EOP response.
- The FEPs are entered but unprotected equipment is not disabled to preclude spurious actuations. The EOPs are reentered after the plant is stabilized.

If special FEP models are needed, the following typical issues should be addressed (see Task 12 for more on this subject):

- Human actions to isolate unprotected equipment,
- Human actions to manually operate protected equipment,
- Human actions to transfer control from the control room to the alternate shutdown panel, and
- Human actions to establish safe shutdown.

It should be recognized that some of the above human actions could also induce new sequences not traditionally covered in the Internal Events PRA. For example, the appropriate closing of a pressurizer PORV block valve by the operator to preclude the effects of a possible spurious opening of the PORV may cause demands of the pressurizer SRV and subsequent sequences not modeled in the Internal Events PRA. New sequences to account for these effects may also need to be incorporated into the Fire PRA Model (see Task 2 for more on this subject).

Figure 5-1 provides an illustration of an FEP response model:

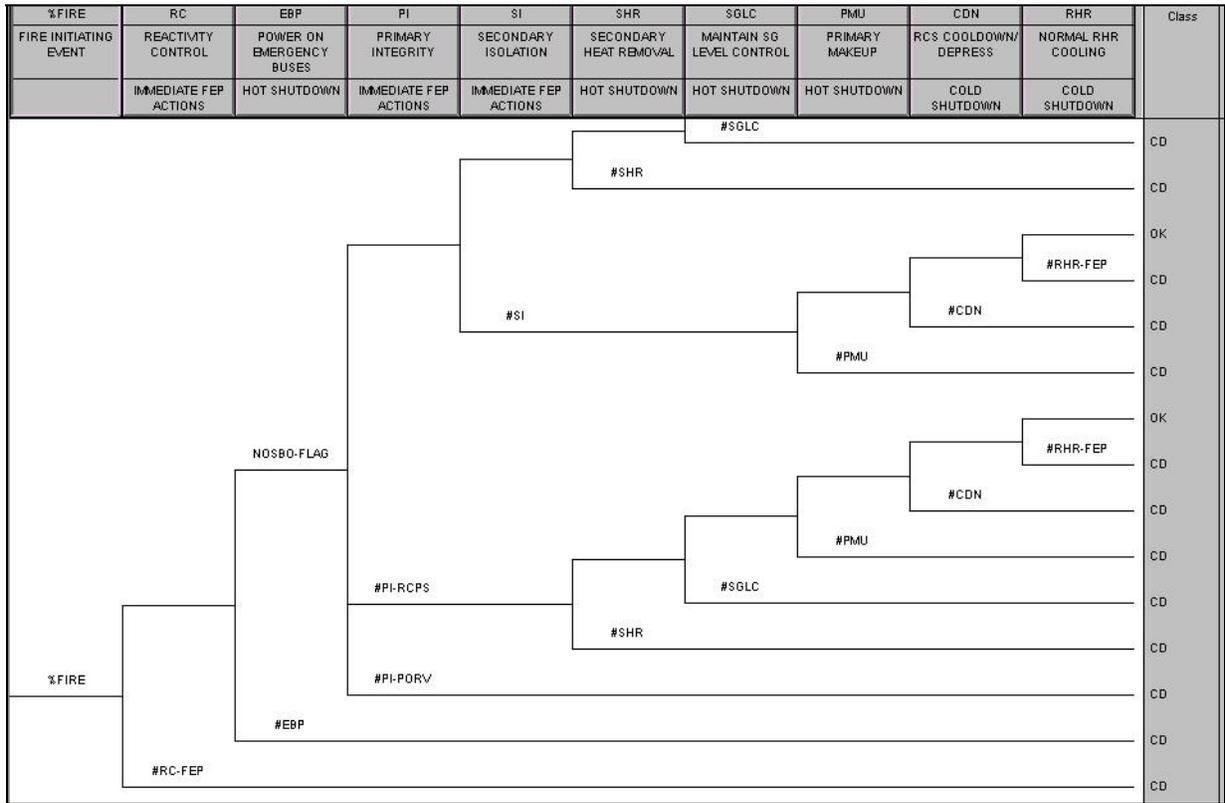


Figure 5-1
Illustration of a FEP Response Model

5.5.1.2 Step 1.2: Incorporate Fire-Induced Equipment Failures

In this step, fire-induced equipment failure modes are incorporated into the Internal Events Model. The Fire PRA Database is used to generate a list of failed equipment for each fire compartment. The following types of fire-induced equipment failures are addressed:

- Fire-induced equipment failures (including spurious operation) that directly disable or degrade systems, trains, and functions credited in the Fire PRA Model. In some cases, fire-induced cable failure modes may have to be addressed.
- Systems, trains, and functions that are not credited in the Fire PRA Model are assumed to be in a failed condition for all fires. Therefore, equipment associated with the non-credited systems, trains, and functions are assumed to be in a failed condition in the model for all fires.
- Fire-induced instrumentation failures (including spurious operation) that prevent the operators from performing a credited action.

- Fire-induced instrumentation failures (including spurious operation) that cause the operators to perform incorrect actions (e.g., reducing defense-in-depth by removing equipment from service).
- Manual actions specified in the FEPs may include actions to preclude or mitigate the effects of spurious operation, to address a degraded barrier, or to address a breaker coordination problem, as well as other fire-specific goals such as the verification of component status. Besides the issue of some actions potentially causing new sequences as addressed earlier in Section 5.5.1.1, manual actions may cause failure of a safe shutdown function or a subset of that functional response. For example, a proceduralized action may be to trip a power supply thereby disabling certain equipment in the plant. The effect of this action needs to be implemented in the Fire PRA Model considering the likely timing of the action and when the affected equipment is needed (see Task 2).

During the early phases of the model development process, the model configuration setting function of the quantification tool can be used to temporarily assign a value of 1.0 or TRUE for surrogate events in the model. During the final stages of the model development process, the fire impacts can be explicitly incorporated into the logic models. Note that as a special case of the use of 1.0 or TRUE, if the analyst will be performing the optional ICDP and ILERP calculations for addressing quantitative screening discussed in Task 7, the component assumed to be unavailable for purposes of each calculation is set to 1.0 or TRUE to account for the unavailability of that component for purposes of the calculation. This has nothing to do with the fire inducing the unavailability or any other fire-related effect; it is simply the means by which the ICDP/ILERP calculations are performed for that component.

Basic events for spurious operation are defined and included in the PRA logic model. The basic events for spurious operation should be incorporated into the PRA logic model in such a manner as to conditionalize the events with the associated fire. Again, when doing so, the analyst needs to take careful note of the fire and its effects to ensure the implementation of the effects in the logic model are as intended. For example, a fire initiating in a switchgear panel that immediately fails all power coming from the panel simultaneously prevents the possibility of spurious control signals whose power source is the same panel. Hence these spurious operations cannot occur under the presented circumstances and the effects of spurious operation should not be included in the logic model for that specific fire. When eliminating such a possibility, the expected timing of the fire scenario also needs to be considered, as best understood at the time of model development or during subsequent refinement of the model. In this same example, if the fire is expected to cause quick failure of the switchgear panel as a power source but it is possible that the flames could affect associated components' control cables before the switchgear power is lost, then the spurious events may still occur and need to be captured within the logic model. With the exception of spurious failure events, the fire scenario(s) associated with each fire compartment can directly fail the logic containing the associated basic events.

Table 5-1 provides a summary of methods for addressing equipment failures as a result of a fire.

5.5.1.3 Step1.3: Incorporate Fire-Induced Human Failures

In this step, fire-specific human failure events are defined and included in the PRA logic model (see Task 12). During the early phases of the model development process, the model configuration setting function of the quantification tool can be used to temporarily assign a value of 1.0 or TRUE for surrogate events in the model. Surrogate events are typically existing human failure events in the Internal Events logic model. New fire-specific human failure events may have to be added to the logic models based on actions specified in the FEPs.

During the final stages of the model development process, unscreened fire-induced human failure events will be explicitly incorporated into the logic models. The fire-induced human failure basic events will be conditional on the appropriate fires.

5.5.2 Step 2: Develop LERF/CLERP Model

In this step, the Internal Events PRA will be modified to incorporate the model changes necessary to quantify fire-induced LERF/CLERP. With the exception of the active containment systems (i.e., containment isolation, containment coolers, hydrogen igniters, and containment spray, etc.), many of the model changes needed to calculate LERF/CLERP are implemented in Step 1.

**Table 5-1
Summary of Methods for Addressing Fire-Induced Equipment Failures**

Equipment Category	Temporary Model Changes During Quantification	Permanent Model Changes
Fire-induced equipment failures (including spurious operation as well as fire procedure-directed operator actions that disable equipment) that directly disable or degrade systems, trains, and functions credited in the Fire PRA Model. This includes any cable failure modes for compartments containing a significant number of electrical equipment (e.g., switchgear room).	Use the model configuration setting function to assign a value of 1.0 or TRUE for surrogate events associated with the equipment failure. Surrogate events are typically existing equipment basic events in the Internal Events logic model. New surrogate events may have to be added to the logic models if an appropriate basic event is not already present.	Explicitly add fire events into the logic model to mimic the failure or degradation of systems, trains, and functions credited in the Fire PRA Model. For spurious actuation failures and operator disabling events, fire-specific basic events will have to be added to the logic model. The new events will be conditional on the appropriate fire scenario.
Equipment failures associated with systems, trains, and functions that are not credited in the Fire PRA Model	Use the model configuration setting function to assign a value of 1.0 or TRUE for surrogate events associated with failure of systems, trains, and functions that are not credited in the Fire PRA Model. Surrogate events are typically existing equipment basic events in the Internal Events logic model. New surrogate events may have to be added to the logic models if an appropriate basic event is not already present.	Explicitly add fire events into the logic model to mimic the failure of systems, trains, and functions not credited in the Fire PRA Model.

**Table 5-1
Summary of Methods for Addressing Fire-Induced Equipment Failures (Continued)**

Equipment Category	Temporary Model Changes During Quantification	Permanent Model Changes
<p>Equipment failures associated with unavailability of intact systems, trains, and functions that are unaffected by the fire. (used for incremental core damage probability (ICDP) and ILERP calculations only)</p>	<p>Use the model configuration setting function to assign a value of 1.0 or TRUE for surrogate events with unavailability of intact systems, trains, and functions that are unaffected by the fire. Surrogate events are typically existing equipment basic events in the Internal Events logic model. New surrogate events may have to be added to the logic models if an appropriate basic event is not already present. Setting the unavailability of the equipment to 1.0 or TRUE makes the equipment unavailable for purposes of calculating an associated ICDP/ILERP..</p>	<p>None</p>
<p>Fire-induced instrumentation failures (including spurious operation) that prevent the operators from performing a credited action.</p>	<p>Use the model configuration setting function to assign a value of 1.0 or TRUE for surrogate events associated with the failure of credited human actions. Surrogate events are typically existing human failure events in the Internal Events logic model. New fire-specific human failure events may have to be added to the logic models based on actions specified in the fire response procedures.</p>	<p>Explicitly add fire events into the logic model to mimic the failure of instrumentation that prevents the operators from performing a credited human action. For spurious actuation failures and the human failure events, fire-specific basic events will have to be added to the logic model. The new events will be conditional on the appropriate fire scenario.</p>
<p>Fire-induced instrumentation failures (including spurious operation) that cause the operators to perform incorrect actions (e.g., reducing defense-in-depth by removing equipment from service).</p>	<p>Use the model configuration setting function to assign a value of 1.0 or TRUE for surrogate events associated with the instrumentation failures that cause the operators to perform incorrect actions. Surrogate events are typically existing equipment failure events in the Internal Events logic model. New surrogate events may have to be added to the logic models if an appropriate basic event is not already present.</p>	<p>Explicitly add fire events into the logic model to mimic the failure of instrumentation that cause the operators to perform incorrect actions. For spurious actuation failures, fire-specific basic events will have to be added to the logic model. The new events will be conditional on the appropriate fire scenario.</p>
<p>Failure to implement manual actions specified in the FEPs to, for instance, preclude or mitigate the effects of spurious operation.</p>	<p>Model as a recovery event without explicitly including the human failure event in the logic models. See Task 12 for appropriate screening values to use.</p>	<p>Explicitly include human failure event in the logic models. See Task 12 for appropriate screening values and detailed analysis instructions.</p>

5.5.2.1 Step 2.1: Select Appropriate Fire-Induced Initiating Events and Sequences and Verify against the Component List and Failure Modes

The Internal Events accident sequences are the primary source for consideration in the Fire PRA model (see Task 2) and are used as a basis for defining fire-specific LERF/CLERP accident sequences. For most PRA models, the existing Internal Events LERF/CLERP accident sequence logic can be used and fire-induced failures can be propagated through the existing logic structure. The Fire PRA Database can be used to generate a list of PRA basic events for each fire compartment. For some PRA models, new fire-specific LERF/CLERP logic models will have to be developed and searches for new sequences need to occur as discussed in Section 5.5.1, Step 1. Conditional logic will have to be developed for each fire-induced initiating event.

As also discussed in Section 5.5.1, Step 1, special FEP models and fire-related manual action effects may have to be developed to address plant configurations and sequences that are outside the scope of the Internal Events PRA Model. The same discussions apply to the LERF/CLERP model development process.

5.5.2.2 Step 2.2: Incorporate Fire-Induced Equipment Failures

In this step, fire-induced equipment failure events are incorporated into the LERF/CLERP logic model. With the exception of the active containment systems (i.e., containment isolation, containment coolers, hydrogen igniters, and containment spray, etc.) many of the model changes needed to calculate LERF/CLERP are implemented in Step 1.2. The procedure provided in Step 1.2 can be used to address equipment specifically for the LERF/CLERP model.

5.5.2.3 Step 2.3: Incorporate Fire-Induced Human Failures

Fire-specific human failure events are defined and included in the LERF/CLERP logic model. With the exception of human failure events associated with the active containment systems (i.e., containment isolation, containment coolers, hydrogen igniters, and containment spray, etc.), many of the model changes needed to calculate LERF/CLERP are implemented in Step 1.3. The procedure provided in Step 1.3 can be used to address human failure events specifically for the LERF/CLERP model.

6

FIRE IGNITION FREQUENCIES (TASK 6)

6.1 Purpose

This section describes the procedure for estimating the fire-ignition frequencies associated with fire ignition sources. Generic ignition frequencies that can be specialized to plant conditions in terms of plant characteristics and plant fire event experience are provided. Uncertainties in the generic frequencies are also provided in terms of 5th, 50th, and 95th percentiles.

6.2 Scope

This work package addresses the following fire-ignition frequency related issues:

- Plant specific fire event data review and generic fire frequency update using Bayesian approach,
- Equipment (ignition source) count by compartment,
- Apportioning of ignition frequencies according to compartment-specific configurations, and
- Uncertainty considerations in the fire frequencies.

6.3 Background Information

6.3.1 General Task Objectives and Approach

This task estimates fire-ignition frequencies and their respective uncertainties for different compartments (e.g., main control room and RHR pump room) and ignition sources (e.g., CCW Pump A and three vertical segments of a motor control center (MCC)). A generic set of fire-ignition frequencies for various generic equipment types (ignition sources) typically found in certain plant locations was developed as a starting point. It should be noted that when analyzing historical event data it could not be determined whether or not electrical equipment (e.g., cables and electrical cabinets) employ thermoset or thermoplastic insulation and/or jackets. Therefore, all the events for any given ignition source type were combined and the resulting frequencies should be used for both types of cable insulation and jacket material.

The combination of locations and equipment types (ignition source) are referred to here as ignition frequency bins. Table 6-1 provides the list of these bins and their respective generic mean frequencies (i.e., the mean value of the uncertainty distribution) in terms of number of events per reactor year. A description and limitations of the equipment type of each bin is further discussed in Section 6.5.6 below. The operating mode (i.e., whether or not the plant is in power

operation) used for collecting the fire event data for each bin is also noted in that table. Appendix C provides a discussion of the basis of the frequencies and their derivation method. The two-stage Bayesian update method [6.1] was used to account for plant-to-plant variability among the plant. The 5th, 50th and 95th percentiles of the uncertainty distribution are also provided in Appendix C. The underlying fire event data was taken from EPRI's Fire Events Database (FEDB). Single stage Bayesian update method can be used to modify the generic frequencies to reflect the influence of plant specific fire event experience.

Different fire types can be postulated for some of the ignition sources. For example, the bin "plant-wide components/pumps" can refer to both electric and oil fires. In those cases, Table 6-1 provides a split fraction for each fire type. The split fraction was determined according to fire events in the FEDB. Continuing with the plant-wide-components/pumps example, the pump fire events in the database were reviewed and classified as oil or electrical fires. This classification serves as the basis for the split fraction.

The frequencies provided in Table 6-1 apply to all relevant equipment items within a unit. For example, in the case of "batteries," the mean frequency, 7.5E-04 per reactor year, applies to all battery sets of a unit that provides backup power to the DC buses. If there are two battery sets associated with one unit, the fire frequency per battery set would be 3.75E-04 per reactor year. If there are four battery sets in another one-unit plant, the mean frequency at that plant would be 1.87E-04 per reactor year for each battery set. This is an important feature of the fire frequency model employed in this fire risk methodology and reflects differences in plant design and construction. As the example illustrates, the per-item fire ignition frequency may vary from plant to plant due to the variations in the total population of a given equipment type present in the plant. Such variations are an inherent feature of the methodology presented in this report. The intent of the methodology is to preserve the plant-wide fire frequency for each ignition source type. The plant-wide frequency of, for example battery fires, is assumed to be the same for all units. However, due to variations in the number of battery sets, the fire frequency per battery set at one unit may differ from that of another unit.

In Task 7A, the quantification process needs the fire frequency associated with a compartment. Compartment level frequency is calculated from the sum of all frequencies $\lambda_{IS,J}$ associated with the ignition sources present in the compartment. The ignition source frequencies $\lambda_{IS,J}$ are estimated from the following equation:

$$\lambda_{IS,J} = \lambda_{IS} W_L W_{IS,J,L}$$

where:

λ_{IS} = Plant-level fire frequency associated with ignition source IS

W_L = Location weighting factor associated with the ignition source

$W_{IS,J,L}$ = Ignition source weighting factor reflecting the quantity of the ignition source type present in compartment J of location L.

Note that where multiple locations (e.g., control building and auxiliary building) are mentioned for the location designator, the bin frequency presented in Table 6-1 applies to all the fire compartments of those locations collectively.

Table 6-1
Fire Frequency Bins and Generic Frequencies

ID	Location	Ignition Source (Equipment Type)	Mode	Generic Freq (per rx yr)	Split Fractions for Fire Type					
					Electrical	Oil	Transient	Hotwork	Hydrogen	HEAF ¹
1	Battery Room	Batteries	All	7.5E-04	1.0	0	0	0	0	0
2	Containment (PWR)	Reactor Coolant Pump	Power	6.1E-03	0.14	0.86	0	0	0	0
3	Containment (PWR)	Transients and Hotwork	Power	2.0E-03	0	0	0.44	0.56	0	0
4	Control Room	Main Control Board	All	2.5E-03	1.0	0	0	0	0	0
5	Control/Aux/Reactor Building	Cable fires caused by welding and cutting	Power	1.6E-03	0	0	0	1.0	0	0
6	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power	9.7E-03	0	0	0	1.0	0	0
7	Control/Aux/Reactor Building	Transients	Power	3.9E-03	0	0	1.0	0	0	0
8	Diesel Generator Room	Diesel Generators	All	2.1E-02	0.16	0.84	0	0	0	0
9	Plant-Wide Components	Air Compressors	All	2.4E-03	0.83	0.17	0	0	0	0
10	Plant-Wide Components	Battery Chargers	All	1.8E-03	1.0	0	0	0	0	0
11	Plant-Wide Components	Cable fires caused by welding and cutting	Power	2.0E-03	0	0	0	1.0	0	0
12	Plant-Wide Components	Cable Run (Self-ignited cable fires)	All	4.4E-03	1.0	0	0	0	0	0
13	Plant-Wide Components	Dryers	All	2.6E-03	0	0	1.0	0	0	0
14	Plant-Wide Components	Electric Motors	All	4.6E-03	1.0	0	0	0	0	0

**Table 6-1
Fire Frequency Bins and Generic Frequencies (Continued)**

ID	Location	Ignition Source (Equipment Type)	Mode	Generic Freq (per rx yr)	Split Fractions for Fire Type					
					Electrical	Oil	Transient	Hotwork	Hydrogen	HEAF ¹
15	Plant-Wide Components	Electrical Cabinets	All	4.5E-02	1.0	0	0	0	0	0
16	Plant-Wide Components	High Energy Arcing Faults ¹	All	1.5E-03	0	0	0	0	0	1.0
17	Plant-Wide Components	Hydrogen Tanks	All	1.7E-03	0	0	0	0	1.0	0
18	Plant-Wide Components	Junction Boxes	All	1.9E-03	1.0	0	0	0	0	0
19	Plant-Wide Components	Misc. Hydrogen Fires	All	2.5E-03	0	0	0	0	1.0	0
20	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power	4.4E-02	0	0	0	0	1.0	0
21	Plant-Wide Components	Pumps	All	2.1E-02	0.54	0.46	0	0	0	0
22	Plant-Wide Components	RPS MG Sets	Power	1.6E-03	1.0	0	0	0	0	0
23a	Plant-Wide Components	Transformers (Oil filled)	All	9.9E-03	0	1.0	0	0	0	0
23b	Plant-Wide Components	Transformers (Dry)			1.0	0	0	0	0	0
24	Plant-Wide Components	Transient fires caused by welding and cutting	Power	4.9E-03	0	0	0	1.0	0	0

Table 6-1
Fire Frequency Bins and Generic Frequencies (Continued)

ID	Location	Ignition Source (Equipment Type)	Mode	Generic Freq (per rx yr)	Split Fractions for Fire Type					
					Electrical	Oil	Transient	Hotwork	Hydrogen	HEAF ¹
25	Plant-Wide Components	Transients	Power	9.9E-03	0	0	1.0	0	0	0
26	Plant-Wide Components	Ventilation Subsystems	All	7.4E-03	0.95	0.05	0	0	0	0
27	Transformer Yard	Transformer – Catastrophic ²	Power	6.0E-03	1.0 ³		0	0	0	0
28	Transformer Yard	Transformer - Non Catastrophic ²	Power	1.2E-02	1.0 ³		0	0	0	0
29	Transformer Yard	Yard transformers (Others)	Power	2.2E-03	1.0	0	0	0	0	0
30	Turbine Building	Boiler	All	1.1E-03	0	1.0	0	0	0	0
31	Turbine Building	Cable fires caused by welding and cutting	Power	1.6E-03	0	0	0	1.0	0	0
32	Turbine Building	Main Feedwater Pumps	Power	1.3E-02	0.11	0.89	0	0	0	0
33	Turbine Building	Turbine Generator Excitor	Power	3.9E-03	1.0	0	0	0	0	0
34	Turbine Building	Turbine Generator Hydrogen	Power	6.5E-03	0	0	0	0	1.0	0
35	Turbine Building	Turbine Generator Oil	Power	9.5E-03	0	1.0	0	0	0	0
36	Turbine Building	Transient fires caused by welding and cutting	Power	8.2E-03	0	0	0	1.0	0	0
37	Turbine Building	Transients	Power	8.5E-03	0	0	1.0	0	0	0

1. See Appendix M for a description of high-energy arcing fault (HEAF) fires.

2. See Section 6.5.6 below for a definition.

3. The event should be considered either as an electrical or oil fire, whichever yields the worst consequences.

Plant-level fire frequencies (i.e., λ_{IS}) are either taken directly from Table 6-1 or after a Bayesian update using plant-specific fire experience. Location weighting factor, W_L , adjusts the frequencies for those situations where a common location (e.g. turbine building) or set of equipment types are shared between multiple units. For example, if one turbine building serves two units, then 2.0 will be used for location weighting factor.

Ignition source weighting factor, in general terms, is the fraction of an ignition source type found in a specific compartment. As presented earlier, if there are two battery sets associated with a unit and one of them is in compartment J, 0.5 should be used for the ignition source weighting factor associated with the batteries found in compartment J. Therefore, to establish the ignition source weighting factors, it is necessary to obtain a count for each compartment of every relevant item (i.e., ignition sources). Also, the combination of the two factors (i.e., $W_L W_{IS,J}$) accounts for the fraction of ignition source types in a multiunit site found in a specific compartment of the unit being studied.

Compartment level fire frequency would then be calculated from:

$$\lambda_{J,L} = \sum \lambda_{IS} W_L W_{IS,J,L}$$

(Summed over all ignition sources IS in compartment J of location L)

In Task 11, the quantification process needs the ignition frequency associated with a fire scenario. Typically, a fire scenario in Task 11 is defined in terms of a fire starting from a specific ignition source and propagating to other combustibles and targets. To establish the ignition frequency associated with a specific ignition source, the equation on page 6-2 can be used.

The estimation of weighting factors for transient fires is treated differently when compared to the method previously used by EPRI in the Fire PRA Implementation Guide [6.2]. In this procedure, maintenance, storage, and occupancy characteristics are considered in estimating the factors.

6.3.2 Assumptions

The analysis model described in this task is based on the following assumptions.

- Fire ignition frequencies remain constant over time;
- Among the plants, total ignition frequency is the same for the same equipment type, regardless of differences in the quantity and characteristics of the equipment type that may exist among the plants;
- Within each plant, the likelihood of fire ignition is the same across an equipment type. For example, pumps are assumed to have the same fire ignition frequency regardless of size, usage level, working environment, etc.

6.4 Task Interfaces

6.4.1 Input from Other Tasks

This task needs the list of unscreened fire compartments generated in Task 4, Qualitative Screening.

6.4.2 Additional Plant Information Needed to Support this Task

Fire event records available at the plant may be used to update ignition frequencies using plant-specific data. The events may or may not have been included in EPRI's fire events database [6.3]. These fire event records may be categorized based on location, ignition source, and plant operating mode (i.e., power or low power).

6.4.3 Walkdowns

At least one walkdown of the entire plant or unit is recommended to identify ignition sources in each fire compartment identified in Task 1, map components to the frequency bins of Table 6-1, facilitate the equipment count and identify their locations. The analyst may elect to walkdown only those fire compartments that survive the first qualitative screening (Task 4). This approach may lead to a conservative count of the equipment in the per-component fire frequency context (i.e., an undercount) because components located in the screened out fire compartments would not be included in the equipment counts.

6.4.4 Outputs to Other Tasks

The fire ignition frequencies calculated in this task are used in Tasks 7A, 8, 7B, 11, 14 and 15. Also, ignition source listing by compartment is used in Task 8 for screening the ignition sources and in Task 11 for defining fire frequencies.

6.5 Procedure

This task is organized around the following eight steps:

1. Mapping plant ignition sources to generic sources
2. Plant fire event data collection and review
3. Plant specific updates of generic ignition frequencies
4. Mapping plant-specific locations to generic locations
5. Location weighting factors
6. Fixed fire ignition source counts
7. Ignition source weighting factors
8. Ignition source and compartment fire frequency evaluation

6.5.1 Step 1: Mapping Plant Ignition Sources to Generic Sources

The purpose of this step is to map all plant components that can initiate a fire (e.g., electrical equipment) to a corresponding bin as listed in Table 6-1. The mapping process may begin with a listing of all component types represented in the Fire PRA component list augmented by any additional equipment types known to the analyst. The mapping needs to be updated as more

information is collected from the plant and especially when a walkdown of all fire compartments is conducted. For each fire compartment, a review of all ignition sources should be conducted to verify that every ignition source can be mapped to one of the relevant bins in Table 6-1.

It is possible that unique ignition source types are identified that may not be reflected in the generic frequency model ignition source list (see Table 6-1). For example, some plants have gas turbine based emergency generators⁵. If an ignition source is identified with no matching bin, the following information should be gathered about that source:

- Characteristics of the source, such as type of ignition source (e.g., electrical, diesel powered), quantity of energy source (e.g., power, voltage, amount gasoline), presence of open flame or sparks, high temperature surfaces, etc.,
- Percentage of the time the ignition source is functioning when it has the potential of starting a fire,
- Any history of fire events in the plant associated with the specific ignition source, and
- History of fire events at locations other than this plant and other than the nuclear power industry.

If there have been fire events in the plant caused by a nonmatching source, the specific fire event data can be used to estimate the fire ignition frequency associated with that source. If there is no plant-specific history, the location of the ignition source may be reviewed to establish any likelihood of challenging plant safety. If it can be ascertained that plant safety would not be affected at all, a frequency evaluation of the ignition source can be omitted. Otherwise, the ignition frequency associated with the source should be developed and justified using such information sources as the vendor, other industries, or, ultimately comparing the source to others with known ignition frequencies.

6.5.2 Step 2: Plant Fire Event Data Collection and Review

The purpose of this task is to examine the fire events in the plant to make two determinations:

1. Are there any unusual fire occurrence patterns in the plant?
2. Is plant-specific fire frequency evaluation warranted?

In principal, the generic fire frequencies of Table 6-1 may be updated using plant-specific fire event data in all cases. However, to reduce the level of effort, the analysis team may decide to forego this option. Use of the generic fire frequency data is reasonable if an important condition is met: there are no unusual fire occurrence patterns in the plant. Note that the review and examination of plant-specific fire events is one way of comparing the fire protection and housekeeping practices in the plant against the industry experience reflected in the generic fire ignition frequency model.

⁵ Although some fire event history does exist with gas turbine based emergency generators, because of lack of sufficient knowledge about the number of such devices used in the industry, no attempt was made to estimate the fire frequency associated with gas turbines.

Plant fire event records are usually available from various sources. This is generally a plant-specific issue. However, often the fire brigade maintains a log of their activities that would include actual fire events. In addition, the maintenance and operations departments may have their logs or event descriptions. For collecting plant-specific information, the following approach is offered.

1. The plant-specific events may or may not include those used in the FEDB for generic fire frequency evaluation. All fire event data should be collected independent of FEDB records.
2. The operating modes associated with each fire ignition bin should be identified and the number of events that occurred only during the specified operating mode should be counted. Refer to Table 6-1 for the operating modes associated with each bin.
3. The number of reactor years is also related to the operating mode. If all operating modes are considered, the reactor years are simply equal to the number of years between commercial operation (or the start of data collection period) and end of the data collection period. If the operating mode is at power only, the number of reactor years is equal to total duration that the plant had been in operation during the data collection period. The duration may be obtained from plant operating records or by applying an average availability factor to the number of years in the data collection period.

The fire events should be classified by location, ignition source, and mode of operation using the information gathered in the preceding step and the generic ignition frequency model approach presented in Appendix C. The outcome of this effort should be the number of fire events in the plant and total reactor years of the plant associated with each bin. The total reactor years should be based on the operating modes considered in the generic frequency analysis of that bin.

A review of plant-specific fire event data may reveal the following potential conditions:

- There are fire events in the plant involving ignition sources that cannot be mapped to any of the ignition source bins of Table 6-1,
- There have been a large number of fire events for a specific ignition source bin, and
- There are only a small number of fire events in the plant being analyzed.

If there are any events that cannot be mapped to one of the ignition source bins of Table 6-1, Step 1 should be revisited to ensure those events are included in that analysis.

If plant fire event history reveals a repeated set of events associated with an ignition source bin, it is recommended that, for those bins, plant-specific fire frequencies be estimated. However, before this determination is made, the analysts may first investigate the severity of those events and attempt to identify any common causes. A common cause may indicate a problem specific to the plant being analyzed. If some of these fire events are potentially challenging (see Appendix C for the definition of this term), and there is a common-cause problem that has not been identified and corrected, a plant-specific fire frequency evaluation is recommended. If the common-cause problem has been identified and corrected, generic fire frequencies may be used. On the other hand, if no commonality could be identified as the root cause of the fires, it may be an indication of the large variations in reporting practices throughout the commercial nuclear power industry, rather than a problem in the plant being analyzed. The use of the generic frequency is warranted for this latter case.

If there are only a small number of fire events in the plant, use of generic fire frequencies is warranted. Otherwise, a plant-specific update of the fire ignition frequencies may significantly alter the fire frequencies. For example, if there were only one plant specific event associated with a frequency bin, the frequency of that bin would increase significantly if Bayesian update were employed. Typically a plant or a unit has less than 100 years of total experience and fire frequencies for each bin is smaller than once per 100 years. Therefore, with one event in the plant specific database the frequency would increase (after Bayesian update) significantly. The updated frequency in such cases can be considered as overly conservative based on the thought that since there is some small probability of occurrence, the event happened to occur at an earlier stage of the observation period. However, the same argument cannot be used if several events of similar characteristics had taken place. In that case, there could be an inherent condition that is much different from the overall industry conditions and generic fire frequencies should be considered as overly optimistic.

6.5.3 Step 3: Plant Specific Updates of Generic Ignition Frequencies

This step should be followed for those frequencies that will be based on plant-specific fire event data. After the plant-specific data has been collected and analyzed in Step 2, the generic bin frequencies can be updated using Bayesian approach [6.1]. The following equation can be used for this process:

$$\pi(\lambda|E) = \frac{L(E|\lambda)\pi_o(\lambda)}{\int L(E|\lambda)\pi_o(\lambda)d\lambda}$$

where

$\pi(\lambda|E)$ = The uncertainty distribution for plant-specific fire frequencies
(the posterior distribution)

$\pi_o(\lambda)$ = The uncertainty distribution attributed to the generic fire frequencies provided
in Appendix C (the prior distribution), and

$L(E|\lambda)$ = The likelihood function of plant-specific fire events.

The likelihood function in a Bayesian formulation usually captures the information provided by the collected plant specific data. The likelihood represents the quality of evidence available to estimate the frequency. In this formulation, the likelihood function is a Poisson probability distribution:

$$L(E|\lambda) = \frac{(\lambda T)^k e^{-\lambda T}}{k!}$$

This distribution answers the theoretical question of given a constant frequency; what is the probability of observing the specific number of fire events (k) that occurred in the specific number of reactor years (T)? The prior distribution (generic frequencies) provided in this procedure may be assumed to be lognormal using the 50th and 95th percentiles presented in Appendix C.

6.5.4 Step 4: Mapping Plant-Specific Locations to Generic Locations

Fire ignition source bin definition, in addition to equipment type, includes a plant location (see Table 6-1). This step maps plant-specific locations to generic locations. The following set of generic plant locations is used in defining ignition source bins:

- Battery Room,
- Containment (PWR),
- Control Room,
- Control/Auxiliary/Reactor Building,
- Diesel Generator Room,
- Plant-Wide Components,
- Transformer Yard, and
- Turbine Building.

These generic plant locations are derived based on variety of plant constructions and naming practices. In order to use the generic frequency model, the analyst should assign various plant locations to one of the above-listed generic locations. The ultimate goal of this effort is to map the compartments defined in Task 1 (and not screened in Task 4) to one of the above listed generic locations. Therefore, the final outcome of this task is a list of plant locations and their respective generic locations. Table 6-2 provides a description of each generic location category to facilitate the mapping process described in this step. Note that location weighting factor, W_L , is addressed in Step 3, below.

Generic mapping of areas raises a number of questions about the process, since plants are generally configured differently. The primary criterion used in mapping deals with the location of equipment that serve the same or similar function(s) as the one in the generic database. The premise here is that all plants (per unit) are made up of the same general components that perform the same functions, i.e., power control, inventory control, decay heat removal, on-site AC and DC power, etc. Some of these components are housed in similar locations in different plants (e.g., turbine generator in the turbine building); these are separated in the generic plant locations. Other components vary in their location from one plant to another, e.g., battery chargers and air compressors; these are grouped in a category called “Plant-Wide Components.”

Note that naming schemes varies from plant to plant for rooms and buildings containing similar components. For example, the room(s) where service water pumps are housed are referred to as the: service building, service water pump house, pump building, intake structure, etc. It is important to note that large control panels other than those in the Main Control Room (e.g., Radwaste Control Panel) may be mapped as a Main Control Board. In other words, the same frequency as that used for the Main Control Board of the Main Control Room may be assigned to those other large control panels as well.

**Table 6-2
Generic Plant Location Descriptions and Weighting Factor W_L**

Plant Location	Description/Clarification	Weighting Factor (W_L)
Battery Room	Plant location(s) where station batteries are located. Does not include other permanent or temporary batteries.	The number of site units that share a common set of batteries.
Containment (PWR)	PWR—The building that houses the reactor core and the rest of the primary system. Refueling floor may be part of this location in many U.S. plants.	The number of units in the site divided by the number of containment buildings.
Control Room	Plant location(s) where controls for normal and emergency plant operations are located. The control room envelope may include additional locations typically referred to as: <ul style="list-style-type: none"> • Auxiliary Electrical Room or Relay Room, where all plant relay logic circuits are located, • Computer room(s), and • Recreation room or kitchen connected to the control room. 	The number of units in the site divided by the number of control rooms per site.
Control/Auxiliary/Reactor Building	The combination of typically contiguous buildings that contain the emergency core cooling, auxiliary feedwater, emergency electrical distribution system, emergency control circuits, and other safe shutdown related systems. It would include the cable spreading room, emergency or safety related switchgear room, relay room, etc. It would not specifically include the containment where main reactor vessel is located and the fuel handling areas of the plant. Note: in BWRs, this location combination is typically referred to as the Reactor Building.	The number of units in the site divided by the number of shared control/auxiliary/reactor building considered as one structure.
Diesel Generator Rooms	Plant location where emergency diesel generators are located. This does not include temporary diesel generators.	The number of units in the site that share a common set of diesel generators.
Plant-Wide Components	All plant locations inside the fence other than the containment, fuel handling building, office buildings, maintenance yard, maintenance shop, etc.	The number of units per site.

Table 6-2
Generic Plant Location Descriptions and Weighting Factor W_L (Continued)

Plant Location	Description/Clarification	Weighting Factor (W_L)
Transformer Yard	The area of the yard where station, service, and auxiliary transformers and related items are located. This may also be referred to as the Switchyard.	The number of units in the site that share a common set of switchyards.
Turbine Building	Plant building that house turbine-generators, its auxiliary systems, and power conversion systems, such as main feedwater, condensate and other systems. Building generally consists of several elevations, including, basement, mezzanine, and turbine deck.	The number of units in the site divided by the number of turbine buildings.

6.5.5 Step 5: Location Weighting Factors

Location weighting factors, W_L , only apply to multiunit sites. For single-unit sites, $W_L=1.0$ should be used. However, if it is possible to obtain a separate equipment count for each unit in a multiunit site, the analyst can set $W_L=1.0$ and move to the next step. Otherwise, the location weighting factors should be evaluated per the approach provided in the third column of Table 6-2. The location-weighting factor is used to adjust the generic fire frequencies to account for locations and/or equipment shared among the units in multiunit sites. For example, a Main Control Room is shared between two units of this plant. The control room includes two main control boards (one per unit) and no other equipment. The fire ignition frequency for this control room would then be estimated as (to simplify the example, transient fires are not included):

$$\lambda_{\text{MCR}} = \lambda_{\text{MCB}} W_L$$

where:

$$\lambda_{\text{MCB}} = 2.5\text{E-}03 \text{ per reactor year (bin 4 in Table 6-1)}$$

$$W_L = 2.0$$

then:

$$\lambda_{\text{MCR}} = 2.5\text{E-}03 \times 2 = 5.0\text{E-}03 \text{ per reactor year}$$

In other cases, parts of a system may be shared among the units. In this case, it is recommended that the equipment of all units be counted. For example, assume a compartment houses 3 pumps of a system that is shared between two units (i.e., the system is shared between the units). The analysts have concluded that there are 53 pumps in both units combined. Assuming that there are no other ignition sources the fire ignition frequency of this compartment is estimated as (similar to the preceding example, transient fires are not included for simplification):

$$\lambda_{\text{PUMP ROOM}} = \lambda_{\text{PUMP}} W_L W_{\text{PUMP, PUMP ROOM,L}} = 2.5\text{E-}03 \times 2 = 5.0\text{E-}03 \text{ per reactor}$$

where:

$$\lambda_{\text{PUMP}} = 2.1\text{E-}02 \text{ per reactor year (bin 21 in Table 6-1)}$$

$$W_L = 2.0$$

$$W_{\text{PUMP, PUMP ROOM,L}} = 3/53 = 5.7\text{E-}02$$

then:

$$\lambda_{\text{PUMP ROOM}} = 2.1\text{E-}02 \times 2 \times 5.7\text{E-}02 = 2.4\text{E-}03 \text{ per reactor year}$$

Table 6-2 provides the method for calculating the location weighting factors for each generic location.

6.5.6 Step 6: Fixed Fire Ignition Source Counts

To establish an ignition source weighting factor, $W_{\text{IS},j}$, per compartment, it is necessary to obtain the total number of items per the equipment type defined in Table 6-1. If there are shared locations or systems among units, the equipment of the entire plant should be counted in this step. Otherwise, only the equipment of the unit being studied should be considered.

There are two principal approaches to counting equipment: visual examination (drawings and/or walkdown), or use of an electronic database. A combination of approaches may be used to achieve the objective of this step.

Plant walkdown and direct visual examination of equipment is the recommended approach for this step. Experience indicates that a knowledgeable individual (i.e., one knowledgeable in plant layout and equipment) can estimate the number of components within a reasonable timeframe. A computerized equipment location database may be used to crosscheck the results of a visual examination if such a database is available. Note that the safe shutdown equipment (e.g., Appendix R of 10 CFR Part 50) database may not cover all potential fire-ignition sources in a compartment.

Plant drawings may also be used for equipment counting. However, for some equipment, a plant walkdown is necessary to ensure an accurate count. This particularly applies to electrical cabinets, electrical panels, and breaker cubicles. It should be added that drawings may be the only available information source for plant areas with high radiation level limiting the time the analysts can remain in the area for walkdown observations.

An electronic equipment database may facilitate a precise equipment count. For example, the electronic database may provide accurate information about the number of electrical cabinet segments for each switchgear room. An electronic database, however, may not necessarily be more efficient than plant walkdown. It must be noted that it is recommended that all equipment counts, and especially electrical cabinet counts, be verified by a plant walkdown. Differences in equipment size (e.g., among pumps, compressors, or transformers) may not be clearly indicated in the database. Small-size components may be included in the database that the analyst may elect to ignore in fire risk evaluation.

In the following, a counting method is provided for each generic equipment type listed in Table 6-1.

- *Bin 1 – Batteries (Battery Room):* Each bank of interconnected sets of batteries located in one place (often referred to as Battery Room) should be counted as one battery set. Cells may not be counted individually.
- *Bin 2 – Reactor Coolant Pump (Containment; PWR):* The reactor coolant pumps (RCPs) are distinct devices in PWRs that vary between two and four, depending on primary loop design.
- *Bin 3 – Transients and Hotwork (Containment; PWR):* The ignition source weighting factor of transient fires is estimated using a ranking scheme that takes into account maintenance activities, occupancy level, and storage of flammable materials. See Step 7 for a description of the approach.
- *Bin 4 – Main Control Board (Control Room):* A control room typically consists of one or two (depending on the number of units) main control boards as the central element of the room. The control room may also include plant computers, other electrical cabinets containing plant relays, and instrumentation circuits, a kitchen type area, desks, bookshelves, and etc. Aside from the main control board, the ignition source weighting factors of the remaining ignition sources of the control room should be based on the approach specific to each ignition source.
- *Bin 5 – Cable Fires Caused by Welding and Cutting (Control/Auxiliary/Reactor Building):* Cables are present at all parts of a nuclear power plant. For this bin, it is assumed that all exposed cables (i.e., cables that are not in conduits or wrapped by noncombustible materials) have an equal likelihood of experiencing a fire caused by welding and cutting across the entire location. As noted earlier the effect of cable jacket material (i.e., thermoset or thermoplastic) on fire ignition frequency could not be established. Therefore, the ignition frequencies presented in this report should be assigned to both cable types. To establish the ignition source weighting factor for cables, the approach used in the FHA of the plant can be used. The cable quantity reported in the FHA for each compartment can be used to establish the ignition source weighting factor. In FHAs, cable quantity is often expressed in terms of total weight or total combustible load associated with cables per compartment. The FHA provides a rating for the amount of cables present in the compartment. However, since fire caused by welding and cutting is the focus of this bin, the final ignition source weighting factor is based on a combination of cable loading and transient fire rating of the compartment. See Step 7.2, below.
- *Bin 6 – Transient Fires Caused by Welding and Cutting (Control/Auxiliary/Reactor Building):* See Step 7 for the approach to establish the ignition source weighting factor for transients.
- *Bin 7 – Transients (Control/Auxiliary/Reactor Building):* See Step 7 for the approach to establish the ignition source weighting factor for transients.
- *Bin 8 – Diesel Generators (Diesel Generator Room):* Diesel generators are generally well-defined items that include a set of auxiliary subsystems associated with each engine. All diesel generators that are included in the electric power recovery model should be counted here. In addition to the normal safety related diesel generators, this may include the Technical Support Center diesel generators, Security diesel generators, etc. It is recommended that each diesel generator and its subsystems be counted as one unit. The

subsystems may include diesel generator air start compressors, air receiver, batteries and fuel storage, and delivery system. It is recommended that the electrical cabinets for engine and generator control that stand separate from the diesel generator be included as part of “Plant-Wide Components - Electrical Cabinets.” Control panels that are attached to engine may be counted as part of the engine.

- *Bin 9 – Air Compressors (Plant-Wide Components):* This bin covers the large air compressors that provide plant instrument air included in the Internal Events PRA Model. These compressors are generally well-defined devices. They may include an air receiver, air dryer, and control panel attached to the compressor. These items should be considered part of the air compressor. If portable compressors are part of the model, those compressors should also be included in the equipment count for this bin. Note that compressors associated with the ventilation systems are not part of this bin. Small air compressors used for specialized functions are also not part of this bin.
- *Bin 10 – Battery Chargers (Plant-Wide Components):* These are generally well defined items associated with DC buses. Each charger should be counted separately.
- *Bin 11 – Cable Fires caused by Welding and Cutting (Plant-Wide Components):* See the discussions for Bin 5. Note that for this bin, compartments that have been accounted for Bins 5 and 31 should be excluded.
- *Bin 12 – Cable Run (Plant-Wide Components):* The cable loading of each compartment should be established using the same approach as that for Bin 5, except that, in this case, all plant compartments should be taken into account.
- *Bin 13 – Dryers (Plant-Wide Components):* Clothes dryers are generally well-defined units.
- *Bin 14 – Electric Motors (Plant-Wide Components):* The electrical motors with power rating greater than 5hp associated with various devices, not including those counted in other bins, are included in this bin. This may include elevator motors, valve motors, etc⁶.
- *Bin 15 – Electrical Cabinets (Plant-Wide Components):* Electrical cabinets represent such items as switchgears, motor control centers, DC distribution panels, relay cabinets, control and switch panels (excluding panels that are part of machinery), fire protection panels, etc. Electrical cabinets in a nuclear power plant vary significantly in size, configuration, and voltage. Size variation range from small-wall mounted units to large walk-through vertical control cabinets, which can be 20’ to 30’ long. The configuration can vary based on number of components that contribute to ignition, such as relays and circuit cards, and combustible loading, which also affects the fire frequency. Voltages in electrical cabinets vary from low voltage (120 V) panels to 6.9 kV switchgears. Even though it is expected that these features affect the likelihood of fire ignition, from a simple analysis of the event data involving the electrical cabinets, it was determined that the variation by cabinet type did not warrant separate frequency evaluation. Therefore, one fire frequency was estimated for the electrical cabinets.

⁶ The bin “electric motors” was referred to as “elevator motors” in previous EPRI reports related to fire-ignition frequencies. In this version of the fire ignition frequency model, the bin not only includes elevator motors, but other types of electric motors as well.

The following rules should be used for counting electrical cabinets:

- Simple wall-mounted panels housing less than four switches may be excluded from the counting process,
- Well-sealed electrical cabinets that have robustly secured doors (and/or access panels) and that house only circuits below 440V should be excluded from the counting process,
- Free-standing electrical cabinets should be counted by their vertical segments, and
- To expedite the process, an average number of vertical segments may be used for such cabinets as motor control centers and DC distribution panels.

In this context, the term “well-sealed” means there are no open or unsealed penetrations, there are no ventilation openings, and potential warping of the sides/walls of the panel would not open gaps that might allow an internal fire to escape. “Robustly secured” means that any doors and/or access panels are all fully and mechanically secured and will not create openings or gaps due to warping during an internal fire. For example, a panel constructed of sheet metal sides “tack-welded” to a metal frame would not be considered well-sealed because internal heating would warp the side panels allowing fire to escape through the resulting gaps between weld points. A panel with a simple twist-handle latch mechanism would not be considered robustly secured because the twist handle would not prevent warping of the door under fire conditions. In contrast, a water-tight panel whose door/access panel is bolted in place or secured by mechanical bolt-on clamps around its perimeter would be considered both well-sealed and robustly secured. Also note that panels that house circuit voltages of 440V or greater are counted because an arcing fault could compromise panel integrity (an arcing fault could burn through the panel sides, but this should not be confused with the high energy arcing fault type fires).

- *Bin 16 – High-Energy Arcing Faults (Plant-Wide Components):* High-energy arcing faults are associated with switchgear and load centers. Switchyard transformers and isolation phase buses are not part of this bin. For this bin, similar to electrical cabinets, the vertical segments of the switchgear and load centers should be counted. Additionally, to cover potential explosive failure of oil filled transformers (those transformers that are associated with 4.16 or 6.9kV switchgear and lower voltage load centers) may be included in vertical segment counts of the switchgear.
- *Bin 17 – Hydrogen Tanks (Plant-Wide Components):* Hydrogen storage tanks are generally well-defined items. Multitank hydrogen trailers, because they are interconnected, should be counted as one unit.
- *Bin 18 – Junction Box (Plant-Wide Components):* The number of junction boxes in an area may be difficult to determine. The frequency can be apportioned based on ratio of cable in the area to the total cable in the plant. Therefore, the ignition source-weighting factor of the cables may be used for this bin, as well.
- *Bin 19 – Miscellaneous Hydrogen Fires (Plant-Wide Components):* This bin includes hydrogen fires in miscellaneous systems other than hydrogen cylinder storage, generator cooling, and battery rooms. It is not necessary to count the ignition sources related to this bin. If it becomes necessary to establish an ignition frequency associated with the components of this bin for a specific compartment or a pipe segment, the approach recommended below in Step 7 for large systems may be used.

- *Bin 20 – Off-Gas/H₂ Recombiner; BWRs (Plant-Wide Components):* Generally there are at least two recombinaer systems per BWR. Each recombinaer system should be counted as one unit. If there are risk significant cables and components located close to a recombinaer, in Task 11, the ignition frequency of a fire involving the recombinaer can be estimated by assuming equal probability of fire ignition across the length of the recombinaer system.
- *Bin 21 – Pumps (Plant-Wide Components) and large hydraulic valves:* For this methodology, it is assumed that above a certain size, fire ignition is the same for all pumps. Pumps below 5 hp are assumed to have little or no significant contribution to risk. Do not count small sampling pumps. The number of pumps in all plant locations defined as “Plant-Wide” should be estimated.

Due to a lack of sufficient statistical data, a separate bin was not defined for large valves that include hydraulic fluid powered mechanisms. It is recommended such valves (e.g. Main Steam Isolation Valves, and Turbine Stop Valves) be counted and included in the pump bin.

- *Bin 22 – RPS MG sets (Plant-Wide Components):* In PWRs, the RPS MG sets are well-defined devices. The electrical cabinets associated with the MG sets are not included as part of these items.
- *Bin 23 – Transformers (Plant-Wide Components):* All indoor transformers that are not an integral part of larger components are included in this count. Control power transformers and other small transformers, which are subcomponents in electrical equipment, should be ignored. They are assumed to be an integral part of the larger component. Examples of transformers accounted for in this bin include 4160/480 transformers attached to AC load centers, low-voltage regulators, and essential service lighting transformers. The large yard transformers are not part of this count. The analyst should develop a criterion for identifying those transformers that will be counted as part of this bin and those that will be ignored as insignificant fire frequency contributors. Clearly, if the criterion leads to the inclusion of a large number of transformers, the frequency per transformer will be small. Conversely, if the criteria screens too many transformers, the fire frequency of some fire compartments may be under-estimated. As final notes, the analyst should count wall-mounted transformers if they do satisfy other counting criteria and should not count small lighting transformers.
- *Bin 24 – Transient Fires caused by Welding and Cutting (Plant-Wide Components):* See Step 7 for the approach to establish ignition source weighting factors for transients.
- *Bin 25 – Transients (Plant-Wide Components):* See Step 7 for the approach to establish the ignition source weighting factor for transients.
- *Bin 26 – Ventilation Subsystems (Plant-Wide Components):* This category includes components such as air conditioning units, chillers, fan motors, air filters, dampers, etc. A fan motor and compressor housed in the same component are counted as one component. Do not count ventilation fans if the drive motor is 5 hp or less.
- *Bin 27 – Yard Transformer – Catastrophic:* The high-voltage power transformers typically installed in the yard belong to this bin. They include plant output power transformers, auxiliary-shutdown transformers, and startup transformers, etc. Isolation phase bus ducts are also included in this bin to simplify fire frequency analysis.

A catastrophic failure of a large transformer is defined as an energetic failure of the transformer that includes a rupture of transformer tank, oil spill and burning oil splattered a distance from the transformer. In this case the analyst should use the frequency and:

1) determine availability of offsite power based on the function of the transformer(s), and
2) consider propagation to adjacent (not nearby) building or components. A propagation path may be considered at the location of open or sealed penetrations, e.g., where a bus-duct enters from the Yard into the Turbine Building. Structural damage need only be considered only where appropriate shields are not present to protected structures and components against blast or debris.

- *Bin 28 – Yard Transformer – Non-Catastrophic:* Similar to Bin 27 this bin includes the high-voltage power transformers typically installed in the yard. However, isolation phase bus ducts are not included in this bin.

In a non-catastrophic transformer failure oil does not spill outside transformer tank and the fire does not necessarily propagate beyond the fire source transformer. Analyst can use all the frequency and assume total loss of the “Transformer/Switch Yard” or may split this frequency equally among the large transformers of the area and assume loss of each transformer separately. Loss of offsite power should be determined based on the function of the affected transformer(s).

- *Bin 29 – Transformer Yard, Others:* Items associated with yard transformers but not the transformers themselves (e.g., oil power output cables) are part of this bin. In the screening phase of the project, the analyst may conservatively assign the same frequency to all the items in this group. If the scenario would not screen out, the frequency may then be divided among the various items in this group. A relative ranking scheme may be used for this purpose. The ranking may be based on the relative characteristics of the items and analysts’ judgment.
- *Bin 30– Boiler (Turbine Building):* Boilers are generally well-defined items. All ancillary items associated with each boiler may be included as part of the boiler. Control panels that are installed separate from a boiler may be included in the “Electrical Cabinets (Plant-Wide Components)” bin.
- *Bin 31 – Cable Fires caused by Welding and Cutting (Turbine Building):* See the discussion for Bin 5.
- *Bin 32 – Main Feedwater Pumps (Turbine Building):* Main feedwater pumps are generally well-defined entities. If there are ancillary components associated with each pump, it is recommended to include those items as part of the pump.
- *Bin 33 – T/G Excitor (Turbine Building):* The turbine generator excitor is a well-defined item. Generally, there is only one excitor per unit.
- *Bin 34 – T/G Hydrogen (Turbine Building):* A complex of piping, valves, heat exchangers, oil separators, and often skid-mounted devices are associated with turbine generator hydrogen. Consider the entire complex as one system and assign the ignition frequency of this bin to that system. It is important to have a clear definition of system boundaries to ensure that, between this bin and Bin 19, all hydrogen-carrying items of the plant are properly accounted for. Similar to Bin 29, in the screening phase of the project, the analyst may conservatively assign the same frequency to all the items in this bin. If the scenario would not screen out, the frequency may then be divided among the various items using a relative ranking scheme. The ranking may be based on the relative characteristics of the items and the analysts’ judgment.

- *Bin 35 – T/G Oil (Turbine Building):* Similar to hydrogen, a complex of oil storage tanks, pumps, heat exchangers, valves, and control devices belong to this bin. It is recommended to treat the entire complex as one system and assign the ignition frequency of this bin to that system. Similar to the preceding bin and Bin 29, in the screening phase of the project, the analyst may conservatively assign the same frequency to all the items in this bin. If the scenario would not screen out, the frequency may then be divided among the various items using a relative ranking scheme. The ranking may be based on the relative characteristics of the items and analysts' judgment.
- *Bin 36 – Transient Fires caused by Welding and Cutting (Turbine Building):* See Step 7 for the approach to establish the ignition source weighting factor for transients.
- *Bin 37 – Transients (Turbine Building):* See Step 7 for the approach to establish the ignition source weighting factor for transients.

It must be added that the procedures described in Tasks 8 and 11 are focused on ignition sources. In Task 8, ignition sources of each compartment are screened based on their potential fire damage to surrounding items and in Task 11 fire scenarios are defined based on ignition sources. Therefore, it is very important that when identifying and counting ignition sources in this step, a list of ignition sources be developed for each compartment to facilitate the efforts in Tasks 8 and 11.

6.5.7 Step 7: Ignition Source Weighting Factors

Ignition source weighting factor, $W_{IS,J,L}$, is the fraction of ignition source (IS) that is present in compartment J. The $W_{IS,J,L}$ are evaluated for all the compartments identified in Task 1 and for all ignition sources identified in Step 1 of this task. The bins listed in the preceding section can be classified in three categories: countable items, transients, and large systems. A separate procedure is presented below for each type.

6.5.7.1 Countable Items

The ignition source weighting factor, $W_{IS,J,L}$, for countable items is calculated by dividing the number of each IS in compartment J by the total number in the generic locations obtained in Step 6. For example, if there are two pumps in the AFW pump room and there are 50 pumps counted for Bin 21 in Step 6, the ignition source weighting factor for the pumps in this room would be $2/50 = 0.04$. Note that $W_{IS,J,L}$ for ignition sources grouped in the "Plant-Wide Components" bin will need the total equipment count for the plant.

6.5.7.2 Transients

A relative ranking scheme is described here for estimating the ignition source weighting factors for ignition frequency bins involving transient combustibles or activities. This scheme applies to all transient fire related bins defined in Table 6-1; that is Bins 3, 5, 6, 7, 11, 24, 25, 31, 36 and 37. Note that a separate relative ranking analysis should be conducted for each bin. Occupancy level, storage of flammable materials, and type and frequency of maintenance activities in a compartment are the three most important influencing factors of the likelihood of fire ignition involving a transient combustible or activity.

It is assumed that transient fires may occur at all areas of a plant unless precluded by design and/or operation, such as inside a BWR drywell or torus during power operation. Administrative controls significantly impact the characteristics and likelihood of transient fires, but they do not preclude their occurrence, since there is industry evidence of failure to follow administrative control procedures.

Some areas of the plant, such as office areas (computers, cubicles, etc) and chemistry labs may have safe-shutdown cables. The fire frequency for these areas may be underestimated if the analysis consists mainly of counting plant components like electrical cabinets, pumps, etc., because these rooms do not contain plant-type sources. High-transient fire “influence factors” may be assigned to these areas in order to properly capture the fire risk.

The three influencing factors are described below:

1. Maintenance – The frequency and the nature of maintenance activities (preventive and/or corrective) in a compartment can impact the likelihood and characteristics of transient fires. This depends on the type of equipment in the compartment, maintenance and hot work procedures, and housekeeping practices. The number of work orders issued during power operation for different compartments of the plant during a specific time period can be used to establish the relative ranking associated with maintenance activities. The analyst should use engineering judgment to determine the maintenance factor of compartments with no work orders in the selected period of time. The judgment can be based on the characteristics of the compartment relative to compartments with work orders. If the work orders cannot be collected easily, the analyst may use engineering judgment based on personal experience or information gathered from the maintenance personnel of the plant. In this case, the analyst may ask the maintenance personnel to rate assign a rating number between 0 and 10 in terms of frequency of maintenance at a compartment and offer the two or three most typical maintenance activities (e.g., welding, pump overhaul, and electrical device replacement). A “0” rating can only be assigned to those compartments where no maintenance is possible or allowed during power operation.
2. Occupancy – Occupancy level, which includes traffic, of a compartment impacts both the likelihood of transient combustibles (within the limits specified by plant housekeeping program) present in the compartment and the likelihood of ignition. Engineering judgment may be used to determine the occupancy factor.
3. Storage – Temporary or permanent storage of combustible/flammable materials in racks, cabinets, and other forms can impact the frequency and characteristics of transient fires initiated in compartments where such storage racks/cabinets are placed. The amount, type, and frequency of the use of material maintained in these storage containers should be taken into account. Engineering judgment augmented with plant walkdowns may be used to determine the storage factor.

Assigning a rating level to each of the three influencing factor is an exercise in subjective judgment reflecting plant-specific layout and practices. It is recommended to use the following five rating levels.

1. No (0) – Can be used only for those compartments where transients are precluded by design.
2. Low (1) – Reflects minimal level of the factor.
3. Medium (3) – Reflects average level of the factor.
4. High (10) – Reflects the higher-than-average level of the factor.
5. Very high (50) – Reflects the significantly higher-than-average level of the factor (only for “maintenance” influencing factor).

Table 6-3 provides a brief description of these levels for each influencing factor. The following additional comments are noted.

- The influencing factor for maintenance should be based on the frequency and type of activities. The information obtained from work order counts or maintenance staff should be translated to the five levels defined here.
- If maintenance activity of a compartment includes liquid combustible/flammable material (e.g., diesel fuel, lubricating oil), the compartment should be rated as “high.” This exercise should consider all compartments affected by the maintenance activity. For example, if lube oil is staged in the turbine building for diesel generator oil change, both the turbine building and diesel generator room are considered affected by this maintenance activity.
- A low rating should be assigned to those compartments where administrative procedures prohibit welding and cutting during power operation.
- Areas requiring dosimetry may be assigned a low occupancy level, unless personnel needs walk through these areas to access other areas of the plant.

Since the different transient fire bins address different plant locations and activities, the influencing factors should be evaluated separately for each case. The following notes are provided for the various bins.

- For general transient fires (i.e., Bins 3, 7, 25 and 37), all three influencing factors should be evaluated.
- For transient fires caused by welding and cutting (i.e., Bins 6, 24, and 36), only the maintenance influencing factor should be evaluated. A “low” rating can be assigned to compartment for which administrative procedures prohibit welding and cutting during power operation.
- For cable fires caused by welding and cutting (i.e., Bins 5, 11, and 31), as in the other cases of welding and cutting, only the maintenance influencing factor should be evaluated.

Table 6-3
Description of Transient Fire Influencing Factors

Influencing Factor	No (0)	Low (1)	Medium (3)	High (10)	Very High (50)
Maintenance	Maintenance activities during power operation are precluded by design.	Small number of PM/CM work orders compared to the average number of work orders for a typical compartment.	Average number of PM/CM work orders.	Large number of (PM)/(CM) work orders compared to the average number of work orders for a typical compartment.	Should be assigned to plant areas that may experience significantly more (PM)/(CM) work orders compared to the average number of work orders for a typical compartment.
Occupancy	Entrance to the compartment is not possible during plant operation.	Compartment with low foot traffic or out of general traffic path.	Compartments not continuously occupied, but with regular foot traffic.	Continuously occupied compartment.	Not applicable
Storage	Entrance to the compartment is not possible during plant operation.	Compartment where no combustible/flammable materials are stored.	Compartments where all combustible/flammable material is stored in closed containers placed in dedicated fire-safe cabinets.	Compartments where combustible/flammable materials may sometimes be brought in and left in either open containers for a short time or in a closed container, but outside a dedicated fire-safe cabinet for an extended time.	Not applicable

As an overall approach, the numerical rating of the factors are added for each compartment and then normalized across all the compartments of the location. That is, the ignition source weighting factor for transients is calculated using the sum of the influencing factors.

For *general transients* (i.e., Bins 3, 7, 25, and 37), the following equation should be used to establish the ignition source weighting factor:

$$W_{GT,J,L} = (n_{m,J,L} + n_{o,J,L} + n_{s,J,L})/N_{GT,L}$$

$$N_{GT,L} = \sum (n_{m,i,L} + n_{o,i,L} + n_{s,i,L})$$

(summed over i, all compartments of location L).

where:

$n_{m,J,L}$ = Maintenance influence factor rating of compartment J of location L,

$n_{o,J,L}$ = Occupancy influence factor rating of compartment J of location L, and

$n_{s,J,L}$ = Storage influence factor rating of compartment J of location L.

In the case of *transient fires caused by welding and cutting* (i.e., Bins 6, 24, and 36), the following equation should be used:

$$W_{WC,J,L} = n_{m,J}/N_{WC}$$

$$N_{WC} = \sum n_{m,i,L}$$

(summed over i, all the compartments of location L).

For *cable fires caused by welding and cutting* (i.e., Bins 5, 11, and 31), the following equation should be used:

$$W_{CF,J} = n_{m,J} W_{Cable,J} / N_{CF}$$

$$N_{CF} = \sum n_{m,i,L} W_{Cable,i}$$

(summed over i, all compartments of location L),

where:

$W_{Cable,i}$ = Cable load of compartment i, based on the ratio of quantity of cables in compartment i over the total quantity of cables in the location.

Consider a plant that has two fire compartments within a generic location in the frequency model. The first compartment is one with a significant number of components requiring maintenance (therefore rated high for maintenance), is not continuously occupied but has regular foot traffic (rated medium for occupancy), and has permanent storage cabinets (rated high for storage). This area resembles the turbine deck area of a turbine building. The second compartment is one that has no components requiring preventive maintenance (rate low for maintenance) or is not a staging area for maintenance activity in other parts of the plant, the compartment does not have regular foot traffic or is not *en route* to other fire compartments (rated low for occupancy). There are no storage cabinets in the compartment (rates low for storage). Cable tunnels generally have such characteristics.

Using the rating system described above, the normalized rating for each compartment may be calculated as follows:

$$\text{Compartment 1: Rating} = 10+3+10 = 23 \quad \text{Normalized grade} = 23/(23+3) = 0.88$$

$$\text{Compartment 2: Rating} = 1+1+1 = 3 \quad \text{Normalized grade} = 3/(23+3) = 0.12$$

This result will generate a transient fire frequency for Compartment 1 that is nearly eight times higher than the transient fire frequency for Compartment 2.

6.5.7.3 Large Systems

Bins 19, 20, and 35 address a complex of components within the plant that have common characteristics. It should be noted that depending on analysts' definition, other bins may also fall into this category. The detailed fire analysis in Task 11 may need fire frequency estimation based on a small portion of the complex of components from the bin. The simplest approach would assume that there is equal likelihood across the complex of components. A geometric factor may be used to adjust bin frequency to the specific area of the plant where the components addressed in the bin could be risk-significant. The geometric factor refers to floor area ratio, or the ratio of the floor area where the fire will have the same impact. In place of a geometric factor, the analyst may count the various components of the complex and rate them by an *ad-hoc* scheme that discriminates by the relative likelihood of ignition. For example, for Bin 19, it may become necessary to estimate the ignition frequency associated with miscellaneous hydrogen piping in a specific compartment of the Auxiliary Building. In this case the analyst may estimate the fraction of the piping and components of this bin that are present in this specific compartment and use that fraction to adjust bin frequency to estimate the fire ignition frequency associated with hydrogen piping. If the hydrogen piping in this compartment is composed of only one pipe piece with no flanges, valves, or any other items attached to it, the analyst may use an adjusting factor smaller than the simple fraction suggested above. However, if the compartment houses a disproportionate fraction of pressure regulators, valves, and flanges, the analyst may elect to use an adjusting factor greater than the simple fraction.

6.5.8 Step 8: Ignition Source and Compartment Fire Frequency

The fire frequency (generic or plant-specific) for each ignition source, $\lambda_{IS,j}$, can now be calculated using the data quantified in the preceding steps with the equation presented on page 6-2. Note that when adding various ignition source frequencies to obtain compartment fire frequency, one should use the mean value of the uncertainty distributions for the various parameters of the summation. This will yield the mean value of compartment fire frequency. The uncertainty distribution of compartment fire frequency is not necessary in the screening steps for a Fire PRA. Propagation of the uncertainty distributions for the ignition sources is done in Task 18, Uncertainty and Sensitivity Analysis.

6.6 References

- 6.1 Kaplan, "On a 'Two-Stage' Bayesian Procedure for Determining Failure Rates from Experiential Data," *IEEE Transactions on Power Apparatus and Systems*, Volume PAS-102, 1983, pp. 195-202.
- 6.2 *Fire PRA Implementation Guide*, EPRI, TR-105928, 1995.
- 6.3 *Fire Event Database and Generic Ignition Frequency Model for U.S. Nuclear Power Plants*. EPRI, 2001. TR-1003111.

7

QUANTITATIVE SCREENING (TASK 7)

7.1 Purpose

This section describes the procedure for performing the following quantitative screening tasks:

- Task 7A–Quantitative Screening I
- Task 7B–Quantitative Screening II
- Task 7C–Quantitative Screening III (Optional)
- Task 7D–Quantitative Screening IV (Optional)

This procedure provides the user an approach to quantify the Fire PRA Model using the procedure provided in Task 5, and to screen out fire compartments based on quantitative criteria. This procedure develops the bases for the quantitative screening criteria and provides specific methods for implementing the screening process.

7.2 Scope

This procedure addresses the following steps for each of the major quantitative screening tasks.

- Step 1–Quantify CDF Model
- Step 2–Quantify LERF Model
- Step 3–Quantitative Screening

In Tasks 7A and 7B, the Fire PRA Model is quantified at the fire compartment level. In Tasks 7C and 7D, the Fire PRA Model is quantified at the fire scenario level. Although not recommended, the quantitative screening can be implemented for screening fire scenarios. Therefore, Tasks 7C and 7D are considered optional tasks in this procedure. The basis for the quantitative screening criteria is developed and an approach for implementing the screening process is provided. To address future use of the Fire PRA Model for risk-informed applications, quantitative screening criteria also consider the impact of equipment unavailability.

7.3 Background Information

7.3.1 General Task Objectives and Approach

The primary objective of this task is to provide the user an approach to quantify the Fire PRA Model developed in Task 5, and to screen out fire compartments based on quantitative screening criteria. It is emphasized that the screening criteria are meant to be applied as part of the Fire PRA Model building and quantifying process. The screening criteria are not the same, nor should

they be confused with, the acceptance criteria for applications of the Fire PRA Model. For example, the screening criteria herein are not directly correlated to the delta-CDF and delta-LERF criteria used in Regulatory Guide 1.174 [7.1] for the acceptability of making permanent changes to the plant. The screening criteria *are* intended to complement the RG 1.174 criteria and to allow for the use of fire PRA results in a RG 1.174 application, but they are also intended to serve the broader objectives of a typical fire PRA.

There are at least two different PRA modeling approaches that have evolved in the PRA field. These two models, in the evolution of PRA methodology development efforts have come to be known as the “Fault Tree Linking Approach” and “Event Trees with Boundaries Approach”. There are a number of different PRA software products available in the market designed around these two approaches. The approach described in this procedure is based on standard state-of-the-art PRA practices, and is intended to be applicable for any PRA methodology or software product.

This procedure allows the user to quantify CDF and LERF or CCDP and CLERP. The only difference is that the quantified values of the fire scenario frequencies are used for CDF and LERF calculations, while the fire scenario frequencies are set to 1.0 or TRUE for CCDP and CLERP calculations. The screening criteria also allow for future use of the Fire PRA Model for risk-informed applications in that the impact of equipment unavailability can be addressed through an option to calculate Incremental Core Damage Probability (ICDP) and Incremental Large Early Release Probability (ILERP) for components that might be routinely taken out-of-service. Use of this option ensures that sufficient elements of the model are treated in adequate detail to capture the risk effects of these unavailabilities for applications such as an on-line plant configuration assessment.

Quantitative screening is primarily focused on a fire compartment level (i.e., Tasks 7A and 7B). Quantitative screening on a fire scenario level (i.e., Tasks 7C and 7D) is presented as optional tasks in this procedure. Quantitative screening does not imply that the logic models for the screened out compartments are removed from the Fire PRA Model. The intent of the quantitative screening process is to limit the scope of detailed fire modeling and/or detailed circuit analysis by focusing on the significant fire compartments. All screened out compartments remain in the Fire PRA Model, albeit at reduced levels of analysis detail.

The quantitative screening criteria were developed with the intent of ensuring that the cumulative risk contributions (i.e., CDF and LERF) from the screened out fire compartments are small. Another goal of the quantitative screening criteria is to ensure that the cumulative incremental risk (i.e., ICDP and ILERP) from screened out compartments, when combined with equipment unavailability, is less than industry limits. For this reason, the procedure addresses quantitative risk screening criteria for CDF, LERF, ICDP (optional), and ILERP (optional). The criteria for ICDP and ILERP are optional measures that can be applied by users who choose to integrate the Fire PRA Model with risk-monitoring models. This approach is different from earlier fire compartment screening criteria, where the goal was to identify CDF risk vulnerabilities using a generic fixed compartment CDF screening criteria. This procedure addresses both single compartment risk screening criteria and cumulative compartment risk screening criteria (i.e., the sum of the risk contributions of all screened out compartments). The CDF/LERF cumulative compartment risk criteria are based on limiting the cumulative risk of screened out compartments to less than 10% of the total internal events risk (i.e., from the Internal Events PRA). The single compartment risk criteria (1.0E-07/year for CDF and 1.0E-08/year for LERF) are set at values

that are high enough to allow some screening, but sufficiently low that all risk-significant compartments should be retained and adequately analyzed in detail as part of the final quantification process. The single compartment risk criteria are adjusted downward, if necessary, to ensure that the cumulative compartment incremental risk criteria are met.

The ICDP/ILERP cumulative compartment incremental risk criteria are based on limiting the cumulative incremental probability of screened out compartments to less than 1.0E-06 for ICDP and to less than 1.0E-07 for ILERP. The single compartment incremental risk criteria start with an initial criterion based on limiting the single compartment incremental probability to less than 1.0E-07 for ICDP and to less than 1.0E-08 for ILERP. The single compartment risk criteria are adjusted downward, if necessary, to ensure that the cumulative compartment incremental risk criteria are met.

The quantitative screening criteria described in this procedure are intended to be minimum standards for focusing the detailed analyses on significant compartments while ensuring that the risk contribution of screened out compartments is minimal (thereby justifying their screening). While this quantitative screening procedure should be acceptable for most applications of the Fire PRA Model, users of this procedure may decide to impose more restrictive criteria to support other unique applications, such as on-line risk monitoring. For example, the user may decide to bypass the ICDP/ILERP screening process by reducing the CDF/LERF screening process. However, the user should confirm that the CDF/LERF screening criteria are sufficiently low to ensure that the cumulative incremental risk of screened out compartments is less than industry limits. The bases for the quantitative screening criteria are provided in Appendix D.

7.3.2 Assumptions

This procedure assumes that the user is familiar with the PRA methodology and software employed at the nuclear power plant facility. The user should also be familiar with the procedures for quantifying the PRA model.

7.4 Task Interfaces

7.4.1 Input From Other Tasks

Task 7A (Quantitative Screening I) uses input from Task 6, Fire Ignition Frequencies, Task 5, Fire-Induced Risk Model, and Task 12, Post-Fire HRA—the Screening portion. Task 7B (Quantitative Screening II) uses input from Task 8, Scoping Fire Modeling including any effects to the inputs used in Task 7A. Optional Tasks 7C and 7D use input from Task 9, Detailed Circuit Failure Analysis, Task 10, Circuit Failure Mode Likelihood Analysis and Task 11, Detailed Fire Modeling, including any effects to the inputs used in prior screening steps.

7.4.2 Additional Plant Information Needed to Support this Task

The Internal Events PRA model for the nuclear power plant facility is needed to support this task. The user should also have access to the software tools needed to quantify the PRA model.

7.4.3 Walkdowns

No walkdown is needed to support this task.

7.4.4 Outputs to Other Tasks

Unscreened fire compartments from Task 7A are input to Task 8, Scoping Fire Modeling. Unscreened fire compartments from Task 7B are used in performing Task 11, Detailed Fire Modeling and Task 12, Post-Fire HRA, the detailed analysis portion. Additionally, the insights from Task 7B, and in particular any limitations on the allowance of manual action credit within the analyses conducted in Task 9, are communicated to those analysts performing Task 9, Detailed Circuit Failure Analysis. Optional Tasks 7C and 7D are performed in parallel with detailed fire scenario analysis, and unscreened fire scenarios are input to Task 14, Fire Risk Quantification.

7.5 Procedure

The section describes the detailed procedure for performing the quantitative screening tasks (Tasks 7A-D) and preparing the Quantitative Screening Calculation Package. With the exception of the inputs and outputs, the implementation of the quantitative screening procedure is the same for all quantitative screening tasks. Table 7-1 summarizes inputs and outputs for each quantitative screening task. Since the steps for each of the quantitative screening tasks are essentially the same, this procedure is written in a generic fashion, with the differences delineated in Table 7-1. With the exception of Task 7A, an updated version of the Fire PRA Model developed using the Task 5 procedure, the updated HRA values provided in Task 12 (including any insights from the HRA dependency analysis), and/or an updated version of the fire scenario frequencies developed in Task 6, are used to quantify CDFs and LERFs for each fire compartment. The Task 5 procedure provides methods for implementing temporary or permanent changes to the Internal Events PRA logic models to calculate fire-induced CDF/CCDP and LERF/CLERP for each compartment. The compartment fire scenario frequencies provided in Task 6 are combined with the appropriate compartment CCDP and CLERP values to quantify compartment CDF and LERF values.

Alternatively, the compartment fire scenario frequencies provided in Task 6 and the initial/updated HRA values provided in Task 12 (including any insights from the HRA dependency analysis) may be immediately incorporated into the Fire PRA Model developed using Task 7. For this option, compartment CDF and LERF values may be calculated directly. Calculation of fire-induced CCDP and CLERP for each compartment will not be necessary.

It is noted that in concert with Task 5 and when setting fire-affected components to 1.0 or TRUE in the model during these screening evaluations, mutually exclusive failure modes are not necessarily handled at this stage of the analysis. For instance, a bus breaker spuriously opening as a failure mode may cause a loss of offsite power. The same breaker failing to trip (open) when necessary could cause subsequent failure of the emergency diesel generator to connect to the bus. Both failures cannot happen at the same time; yet if both failure modes are set to 1.0 or TRUE for the appropriate events in the model, the resulting quantified results will be conservative. Effectively, both failure modes are assumed to occur concurrently which, while logically impossible, is an acceptable simplification for the purposes of these early screening

steps. Such logical inconsistencies should be resolved as the screening evolves and becomes more sophisticated such as during Task 7B or beyond. During this process, the analyst may choose to be more discriminating so that only the appropriate failure modes and modeled events are affected by the fire of concern.

**Table 7-1
Quantitative Screening—Summary of Inputs and Outputs**

Task	Inputs	Outputs
Task 7A—Quantitative Screening I	<ol style="list-style-type: none"> 1. Initial Fire PRA Model developed using Task 5. At this stage of the quantitative screening process, all fire-induced failures are assumed to be in a failed state. 2. The compartment fire scenario frequencies provided from Task 6. 3. Screening HRA values from Task 12, as available, including any insights from the HRA dependency analysis. 	See list of outputs below
Task 7B—Quantitative Screening II	<ol style="list-style-type: none"> 1. Insights from Task 8 (Scoping Fire Modeling) are incorporated into the Fire PRA Model using Task 5. 2. Updates, if appropriate, to the fire scenario frequencies developed in Task 6 and used in Task 7A, should Task 8 insights affect the frequencies. 3. Revisions to the HRA values from Task 12 used in Task 7A, if/as appropriate, including any insights from the HRA dependency analysis, as a result of Task 8 insights affecting the HRA screening values. 	See list of outputs below
Task 7C—Quantitative Screening III (Optional)	<ol style="list-style-type: none"> 1. Insights from Task 9 (Detailed Circuit Failure Analysis) and Task 11 (Detailed Fire Modeling) are incorporated into the Fire PRA Model using Task 5. 2. Updates, if appropriate, to the fire scenario frequencies developed in Task 6 and used in prior screening steps, should Task 11 insights affect the frequencies. 3. Revisions to the HRA values from Task 12 used in prior screening steps, if/as appropriate, including any insights from the HRA dependency analysis, as a result of Task 9 or Task 11 insights affecting the HRA screening values (or subsequent detailed HRA values). 	See list of outputs below
Task 7D—Quantitative Screening IV	<ol style="list-style-type: none"> 1. Insights from Task 10 (Circuit Failure Mode Likelihood Analysis) are incorporated into the Fire PRA Model using Task 5 and as refined in the prior screening steps. 	See list of outputs below

Outputs

- 1) List of failed equipment for each fire compartment.
- 2) Model logic changes and/or temporary settings for fire each compartment. This includes a description of how HRA events were incorporated into the model and how surrogate events were used.
- 3) Calculated CDF, LERF, ICDP, and ILERP results (including cutsets) for each compartment, including truncation values.
- 4) List of screened out compartments, including basis for exclusion.
- 5) Documentation of technical approach, assumptions, and conclusions, and interfaces with other tasks.
- 6) Recommendations for reducing compartment frequencies.

7.5.1 Step 1: Quantify CDF Model

In this step, the initial/updated Fire PRA Model developed using the Task 5 procedure, the initial/updated HRA values provided in Task 12 (including any insights from the HRA dependency analysis), and the generic/updated fire scenario frequencies developed in Task 6 are used to quantify CDFs for each fire compartment. The Task 5 procedure provides methods for implementing temporary or permanent changes to the Internal Events PRA logic models to calculate fire-induced CDF/CCDP for each compartment. The initial/updated compartment fire scenario frequencies provided in Task 6 are combined with the appropriate compartment CCDP values to quantify compartment CDF values.

Alternatively, the generic/updated compartment fire scenario frequencies provided in Task 6 and the initial/updated HRA values provided in Task 12 (including any insights from the HRA dependency analysis) may be directly incorporated into the initial/updated Fire PRA Model developed in the Task 5 procedure. For this option, compartment CDF values may be calculated directly. Calculation of fire-induced CCDP values for each compartment will not be necessary, and Step 1.1 can be skipped. Table 7-1 summarizes inputs and outputs for each quantitative screening task.

7.5.1.1 Step 1.1: Quantify CCDP Model

In this step, the initial/updated Fire PRA Model developed using the Task 5 procedure and the initial/updated HRA values provided in Task 12 (including any insights from the HRA dependency analysis) will be used to quantify CCDP values for each fire compartment. The Task 5 procedure provides methods for implementing temporary or permanent changes to the Internal Events PRA logic models to calculate fire-induced CCDP for each compartment. In order to use the model for future applications, additional CCDP calculations may be performed to address the unavailability of one or more trains and/or systems that are unaffected by the fire (i.e., intact train and/or systems). The selection of equipment unaffected by the fire is plant-specific and can be determined by performing a set of sensitivity analyses to identify the most limiting case for equipment unavailability. The truncation limits used to perform CCDP quantification should be documented as part of this calculation package.

7.5.1.2 Step 1.2: Quantify CDFs

In this step, the generic/updated compartment fire scenario frequencies provided in Task 6 are combined with the appropriate compartment CCDP to quantify compartment CDF values. If the initial/updated compartment fire scenario frequencies provided in Task 6 and the initial/updated HRA values provided in Task 12 (including any insights from the HRA dependency analysis) were directly incorporated into the initial/updated Fire PRA Model using the Task 5 procedure, compartment CDF values can be calculated directly. In order to use the model for future applications, additional CDF calculations may be performed to address the unavailability of one or more trains and/or systems that are unaffected by the fire (i.e., intact train and/or systems). The selection of equipment unaffected by the fire is plant-specific and can be determined by performing a set of sensitivity analyses to identify the most limiting case for equipment unavailability. The truncation limits used to perform CDF quantification should be documented as part of this calculation package.

7.5.1.3 Step 1.3: Quantify ICDP Values (Optional)

In this step, the CDF values involving the unavailability of intact trains and/or systems are used to calculate the ICDP values. The ICDP values are quantified as the product of the CDF and a characteristic exposure time (e.g., maximum allowed outage time) associated with the most limiting case of unavailability of equipment unaffected by the fire. For example, if a fire in a compartment fails offsite power, the unavailability of a diesel generator may be the most limiting case. The maximum allowed outage time for a diesel generator would be the characteristic exposure time.

7.5.2 Step 2: Quantify LERF Model

In this step, the initial/updated Fire PRA Model developed in Task 5, the initial/updated HRA values provided in Task 12 (including any insights from the HRA dependency analysis), and the generic/updated fire scenario frequencies developed in Task 6 are used to quantify LERFs for each fire compartment. The Task 5 procedure provides methods for implementing temporary or permanent changes to the Internal Events PRA logic models to calculate fire-induced LERF/CLERP for each compartment. The generic/updated compartment fire scenario frequencies provided in Task 6 are combined with the appropriate compartment CLERP values to quantify compartment LERF values.

Alternatively, the generic/updated compartment fire scenario frequencies provided in Task 6 and the initial/updated HRA values provided in Task 12 (including any insights from the HRA dependency analysis) may be directly incorporated into the initial/updated Fire PRA Model developed in Task 5. For this option, compartment LERF values may be calculated directly. Calculation of fire-induced CLERP values for each compartment will not be necessary and Step 2.1 can be skipped. Table 7-1 summarizes inputs and outputs for each quantitative screening task.

7.5.2.1 Step 2.1: Quantify CLERP Model

In this step, the initial/updated Fire PRA Model developed in Task 5 and the initial/updated HRA values provided in Task 12 (including any insights from the HRA dependency analysis) will be used to quantify CLERP values for each fire compartment. The Task 5 procedure provides methods for implementing temporary or permanent changes to the Internal Events PRA logic models to calculate fire-induced CLERP for each compartment. In order to use the model for future applications, additional CLERP calculations may be performed to address the unavailability of one or more trains and/or systems that are unaffected by the fire (i.e., intact train and/or systems). The selection of equipment unaffected by the fire is plant-specific and can be determined by performing a set of sensitivity analyses to identify the most limiting case for equipment unavailability. The truncation limits used to perform CLERP quantification should be documented as part of this calculation package.

7.5.2.2 Step 2.2: Quantify LERFs

In this step, the initial/updated compartment fire scenario frequencies provided in Task 6 are combined with the appropriate compartment CLERP to quantify compartment LERF values. If the generic/updated compartment fire scenario frequencies provided in Task 6 and the

initial/updated HRA values provided in Task 12 (including any insights from the HRA dependency analysis) were directly incorporated into the initial/updated Fire PRA Model developed in Task 5, compartment LERF values can be calculated directly. In order to use the model for future applications, additional LERF calculations may be performed to address the unavailability of one or more trains and/or systems that are unaffected by the fire (i.e., intact train and/or systems). The selection of equipment unaffected by the fire is plant-specific and can be determined by performing a set of sensitivity analyses to identify the most limiting case for equipment unavailability. The truncation limits used to perform LERF quantification should be documented as part of this calculation package.

7.5.2.3 Step 2.3: Quantify ILERP Values (Optional)

In this step, the LERF values that involve the unavailability of intact trains and/or systems are used to calculate the ILERP values. The ILERP values are quantified as the product of the LERF and a characteristic exposure time (e.g., maximum allowed outage time) associated with the most limiting case of unavailability of equipment unaffected by the fire. For example, if a fire in a compartment fails offsite power, the unavailability of a diesel generator may be the most limiting case. The maximum allowed outage time for a diesel generator would be the characteristic exposure time.

7.5.3 Step 3: Quantitative Screening

In this step, quantified compartment CDF, LERF, ICDP (optional), and ILERP (optional) values are compared against the quantitative screening criteria provided in Tables 7-2 and 7-3. As stated earlier in Section 7.3.1, these screening criteria are meant to be applied as part of the Fire PRA Model building and quantifying process. The screening criteria are not the same, nor should they be confused with, the acceptance criteria for applications of the Fire PRA Model. Compartments that fall below all the criteria in Tables 7-2 and 7-3 are marked as screened out in the Fire PRA Database. The CDF, LERF, ICDP (optional), and ILERP (optional) criteria in Table 7-2 should be reduced, as necessary, to meet the criteria in Table 7-3. A list of screened out compartments, with the basis for exclusion, should be documented as part of this calculation package. In any case, screening decisions should always be in the conservative direction.

See Appendix D for bases for the quantitative screening criteria. The risk contribution for the screened out compartments can be neglected in subsequent screening steps and in the final fire risk quantification (i.e., the screened out and potentially conservative compartment CDFs/LERFs are not summed in with the remaining compartment CDFs/LERFs that are more detailed and hence more realistic estimated values). However, the logic models for the screened out compartments remain intact and the risk contribution for the screened out compartments can be restored by setting the frequencies back to nominal values. As a minimum, the sum of the screened out compartment CDFs and LERFs should be separately quantified in Task 14 and reported as part of Task 16 so that users/reviewers of the Fire PRA are aware of the potential residual risks from these screened out compartments.

Table 7-2
Quantitative Screening Criteria for Single Fire Compartment Analysis

Quantification Type	CDF and LERF Compartment Screening Criteria	ICDP and ILERP Compartment Screening Criteria (Optional)
Fire Compartment CDF	CDF < 1.0E-07/year <i>Note: This criterion should be reduced, as necessary, to ensure that the CDF criterion in Table 7-3 is met.</i>	
Fire Compartment CDF with Intact Trains/Systems Unavailable		ICDP < 1.0E-7 <i>Note: This criterion should be reduced, as necessary, to ensure that the ICDP criterion in Table 7-3 is met</i>
Fire Compartment LERF	LERF < 1.0E-08/year <i>Note: This criterion should be reduced, as necessary, to ensure that the LERF criterion in Table 7-3 is met</i>	
Fire Compartment LERF with Intact Trains/Systems Unavailable		ILERP < 1.0E-8 <i>Note: This criterion should be reduced, as necessary, to ensure that the ILERP criterion in Table 7-3 is met</i>

Table 7-3
Quantitative Screening Criteria for All Screened Fire Compartments

Quantification Type	Screening Criteria
Sum of CDFs for all screened out fire compartments.	< 0.1 * [Internal Event Average CDF]
Sum of LERFs for all screened out fire compartments	< 0.1 * [Internal Event Average LERF]
Sum of ICDPs for all screened out fire compartments	< 1.0E-06
Sum of ILERPs for all screened out fire compartments	< 1.0E-07

7.6 References

- 7.1 *An Approach for Using Probabilistic Risk Assessment In Risk-Informed Decisions on Plant-Specific Changes to the Licensing Basis*, U.S. NRC, Regulatory Guide 1.174, Revision 1, November 2002.

8

SCOPING FIRE MODELING (TASK 8)

Scoping fire modeling is the first task in the Fire PRA framework where fire modeling tools are used to identify ignition sources that may impact the fire risk of the plant. Screening some of the ignition sources in the room, along with the application of severity factors to the unscreened ones, may reduce the compartment fire frequency previously calculated in Task 6.

8.1 Purpose

This task has two main objectives:

- To screen out those fixed ignition sources that do not pose a threat to the targets within a specific fire compartment, and
- To assign severity factors to unscreened fixed ignition sources.

It must be noted that only those ignition sources should be considered in this task that were included in establishing the fire ignition frequency in Task 6. All other potential ignition sources that were screened out in Task 6 should neither be addressed in this task. With this task, the level of effort for detailed fire propagation analysis may be reduced. Furthermore, applying severity factors may reduce the compartment frequency calculated in Task 6, resulting in some compartments being screened before detail fire modeling studies are conducted.

8.2 Scope

This procedure contains instructions for identifying and screening fixed ignition sources. The procedure also provides some general notes on how to assign severity factor values for ignition sources included in the generic fire frequency model.

The procedure recommends two work forms: (1) the walkdown screening form, and (2) the zone of influence (ZOI) form. The walkdown screening form should be filled during the walkdown. It compiles information about the ignition sources relative to nearby equipment. The ZOI form specifies a zone of influence for ignition sources in a specific compartment.

The focus of this task is twofold.

1. Refine the information about fixed ignition sources. The direct fire effects on fire PRA components or circuits are not addressed. The basic assumption about loss of all fire PRA components (including cables) present in the fire compartment is still maintained in this task. That is, no equipment in the fire PRA component list is screened. Therefore, the location and specific characteristics of the cables carrying fire PRA component-related circuits are not needed for performing this task.
2. Application of severity factors to each ignition source. After applying the severity factor, the compartment fire frequencies calculated in Task 6 are reevaluated.

8.3 Background Information

8.3.1 General Task Objectives and Approach

This task is the first attempt at identifying fire scenarios in terms of ignition sources and propagation patterns. In the first quantitative screening task, the CDF for each compartment is calculated assuming that all the targets within the compartment would fail due to fire-generated conditions. In this task, the possibility of the fixed ignition sources causing the postulated damage is examined. Those that cannot cause target damage are screened out from further analysis. For the purpose of this task, a target can be considered:

1. The closest equipment (including cabinets and cables trays) to the fixed ignition source if no specific knowledge about target location in the compartment is currently available; or
2. Known fire PRA components (targets of interest to the analysis) in the compartment, if the specific target locations are known.

A set of conservative fire modeling calculations are performed for predicting fire conditions near a target in order to assess if target damage or ignition can occur. The analyst can then be confident that an ignition source can be screened out if no relevant targets receive thermal damage. Ignition sources that are part of the fire PRA components cannot be screened. For the ignition sources that do not screen out, the severity level of the fire needed to cause damage is established and the corresponding severity factor is estimated. The severity factor is used to adjust the fire frequencies for a second round of quantitative screening. Technical details on the determination of severity factors are provided in Appendix E.

In general terms, the direct impact of a fire on a target can be described with the following five mechanisms:

1. Engulfed in flames,
2. Within fire plume,
3. Within the ceiling jet,
4. Within the smoke layer, or
5. Within the flame irradiation zone.

Flame temperatures in typical enclosure fires are expected to be between 800°C and 1200°C. These temperatures are above piloted ignition temperatures for many combustibles, including cables. The time for ignition of solid combustibles in contact with flames will depend on its thermophysical properties and the heat flux generated at the flames. Any additional passive fire protection feature, such as barriers, shields, or retardant substances, can also affect the damage or ignition time.

A fire plume is a buoyant stream of hot gases rising above a localized area undergoing combustion into surrounding space of essentially uncontaminated air. Therefore, depending on the fire intensity and elevation of the equipment above it, targets located within this region are subjected to a distinct and relatively high level of thermal hazard.

The ceiling jet refers to the relatively rapid gas flows in a shallow layer beneath the ceiling surface that is driven by buoyancy of hot combustion products. Ceiling jets form when a fire plume impinges under a ceiling and hot gasses spread away. Temperatures in the ceiling jet are expected to be lower than in the fire plume. Still, as in the case of the plume, targets located within the ceiling jet are subjected to a distinct thermal hazard. Notice, however, that ceiling jet applications in nuclear power plants are limited due to the generally large number of cables, conduits, pipes, and structural members interfering with ceiling jet flows.

A smoke layer usually forms below the ceiling jet. Depending on the fire intensity, the smoke layer temperature may reach damage or ignition temperatures of many materials. The fire plume transports the heat and smoke generated in the combustion process into the smoke layer, which is affected by the air injected into or extracted from the compartment. The smoke layer temperature is usually lower than the ceiling jet temperature due to air entrainment.

Finally, diffusion flames usually irradiate heat to the surroundings. This irradiation is mainly emanated from the soot particles inside the flame. The intensity of this impinging heat flux decreases with distance. Therefore, there is a critical region near a flame where a target would be adversely affected by incident heat flux.

Table 8-1 recommends ZOIs and severity factors calculation methods for the ignition source bins in the frequency model. Note that the severity factor for all the frequency bins are not calculated based on fire modeling.

The type of exposure will depend on the location of the target with respect to the fire. Clearly, during the course of a fire event, a target may be exposed to more than one of the conditions listed above. However, for the purpose of this task, a target is assumed to be subjected to only one type of exposure with constant flammability and thermophysical characteristics. The fire ZOI is defined using fire models to determine the regions where fire conditions will cause target damage. Technical details on the determination of the ZOI are provided in Appendix F.

Note that transient combustibles are not screened in this task. This is because the characterization of transient fire sources, i.e., fire size, type, duration, and location, necessitate plant-specific considerations that demand level of effort beyond that anticipated for this task. Analysis of the impact of transient combustibles is discussed in Task 11, Detailed Fire Modeling, in order to avoid postulating them in rooms that may be screened in earlier tasks.

An important part of this task is a plant walkdown to ensure that the specific conditions of each fire compartment are obtained and included in the analysis. During the walkdown, the analysts may attempt to screen out some of the ignition sources based on clear indications that no targets could be damaged. If such qualitative screening is attempted, the analysts may need to adhere to the following:

Table 8-1
Zone of Influence and Severity Factor Recommendations

ID	Location	Ignition Source	Ignition Source Screening Approach	Recommended Method or Probability Distribution ¹ for Calculating Severity Factor
1	Battery Room	Batteries	Calculate ZOI using Figure F-2	Electric motors
2	Containment (PWR)	Reactor coolant pump	Do not screen in Task 8	Assume 1.0
3	Containment (PWR)	Transients and hotwork	Do not screen in Task 8	Assume 1.0
4	Control Room	Electrical cabinets	Calculate ZOI using Figure F-2	Applicable electrical cabinet
5	Control/Auxiliary/Reactor Building	Cable fires caused by welding and cutting	Do not screen in Task 8	Assume 1.0
6	Control/Auxiliary/Reactor Building	Transient fires caused by welding and cutting	Do not screen in Task 8	Assume 1.0
7	Control/Auxiliary/Reactor Building	Transients	Do not screen in Task 8	Assume 1.0
8	Diesel Generator Room	Diesel generators	Do not screen in Task 8	Assume 1.0
9	Plant-Wide Components	Air compressors	Do not screen in Task 8	Assume 1.0
10	Plant-Wide Components	Battery chargers	Calculate ZOI using Figure F-2	Electrical cabinets
11	Plant-Wide Components	Cable fires caused by welding and cutting	Do not screen in Task 8	Assume 1.0
12	Plant-Wide Components	Cable run (self-ignited cable fires)	Do not screen in Task 8	Assume 1.0
13	Plant-Wide Components	Dryers	Calculate ZOI using Figure F-2	Transients
14	Plant-Wide Components	Electric motors	Calculate ZOI using Figure F-2	Electric motors

1. Appendix E provides technical details for calculating severity factors.

Table 8-1
Zone of Influence and Severity Factor Recommendations (Continued)

ID	Location	Ignition Source	Ignition Source Screening Approach	Recommended Method or Probability Distribution ¹ for Calculating Severity Factor
15	Plant-Wide Components	Electrical cabinets	Calculate ZOI using Figure F-2	Electrical cabinets
16	Plant-Wide Components	High-energy arcing faults	Do not screen in Task 8	Assume 1.0
17	Plant-Wide Components	Hydrogen tanks	Do not screen in Task 8	Assume 1.0
18	Plant-Wide Components	Junction box	Calculate ZOI using Figure F-2	Electric motors
19	Plant-Wide Components	Miscellaneous hydrogen fires	Do not screen in Task 8	Assume 1.0
20	Plant-Wide Components	Off-gas/H ₂ recombiner (BWR)	Do not screen in Task 8	Assume 1.0
21	Plant-Wide Components	Pumps	Do not screen in Task 8	Assume 1.0
22	Plant-Wide Components	RPS MG sets	Calculate ZOI using Figure F-2	Electric motors
23a	Plant-Wide Components	Transformers (oil filled)	Do not screen in Task 8	Assume 1.0
23b	Plant-Wide Components	Transformers (dry)	Calculate ZOI using Figure F-2	Electric motors
24	Plant-Wide Components	Transient fires caused by welding and cutting	Do not screen in Task 8	Assume 1.0
25	Plant-Wide Components	Transients	Do not screen in Task 8	Assume 1.0
26	Plant-Wide Components	Ventilation subsystems	Calculate ZOI using Figure F-2	Assume 1.0
27	Transformer Yard	Transformer - catastrophic	Do not screen in Task 8	Assume 1.0
28	Transformer Yard	Transformer - noncatastrophic	Do not screen in Task 8	Assume 1.0
29	Transformer Yard	Yard transformers (Others)	Do not screen in Task 8	Assume 1.0
30	Turbine Building	Boiler	Do not screen in Task 8	Assume 1.0

1. Appendix E provides technical details for calculating severity factors

Table 8-1
Zone of Influence and Severity Factor Recommendations (Continued)

ID	Location	Ignition Source	Ignition Source Screening Approach	Recommended Method or Probability Distribution ¹ for Calculating Severity Factor
31	Turbine Building	Cable fires caused by welding and cutting	Do not screen in Task 8	Assume 1.0
32	Turbine Building	Main feedwater pumps	Do not screen in Task 8	Assume 1.0
33	Turbine Building	T/G excitor	Do not screen in task 8	Assume 1.0
34	Turbine Building	T/G hydrogen	Do not screen in Task 8	Assume 1.0
35	Turbine Building	T/G oil	Do not screen in Task 8	Assume 1.0
36	Turbine Building	Transient fires caused by welding and cutting	Do not screen in Task 8	Assume 1.0
37	Turbine Building	Transients	Do not screen in Task 8	Assume 1.0

1. Appendix E provides technical details for calculating severity factors.

- The fixed ignition source screening conducted in this task relies exclusively on thermal damage. Therefore, fixed ignition sources considered capable of high energy (explosive) events should not be screened in this task. Examples of such fixed ignition sources are:
 - High voltage transformers (480V or higher),
 - Switchgears (480V or higher) and diesel generator cabinets supplied with AC power by the running diesel generator (e.g., DG excitation cabinets, DG switchgear, and some DG control cabinets), and
 - Diesel generators.
- Because of their position on the electrical lineup, most motor control centers will have adequate breaker protection and may be screened out if they are not vented. However, analysts should consult plant drawings or knowledgeable plant personnel to ascertain whether exceptions exist.

8.3.2 Assumptions

The following is a list of assumptions used to develop the procedure for this task.

- Altered conditions of a fixed ignition source that may lead to a fire more severe than the most severe postulated fires are very unlikely to occur. The altered conditions of a fixed ignition source may be addressed as part of the transient combustible fire analysis.
- Equipment damage can only occur from exposure to fire generated temperatures exceeding a pre-defined threshold.
- No consideration is given to duration of exposure, i.e., a one-second fire exposure of 330°C (625°F) is as capable of damage as a 30-minute fire exposure of 330°C (625°F). As a screening task, this conservatism is acceptable. In detailed fire modeling, Task 11, the element of time should be included in the analysis, which generally includes a growing heat release rate profile and time to target heating.
- No credit is given to the possibility of suppressing a fire before damage. That is, the non-suppression probability is assumed to be 1.0.
- All targets are a part of the PRA equipment, and loss of a target would always lead to an initiating event or cause a failure modeled for CCDP calculations, or both.

8.4 Task Interfaces

8.4.1 Input from Other Tasks

The list of unscreened fire compartments from previous screening tasks and the fire PRA components from Task 2 are needed for this task.

8.4.2 Additional Plant Information Needed to Support this Task

The following documentation may support the walkdown recommended in this task:

- List of equipment in compartments,
- Equipment layout drawings, and
- Elevation drawings of rooms and equipment.

Information that an analyst can use to establish the characteristics of a credible fire associated with a specific ignition source is also needed in this task. The exact nature of the information will depend on the specific characteristics of the ignition source. The following is a sample of such information:

- Quantity of the oil maintained inside rotating machinery,
- Power and voltage of a motor,
- Power of electrical cabinets, and
- Quantity and nature of combustible and flammable materials maintained in an enclosure.

8.4.3 Walkdowns

At least one walkdown is needed to support this task. The purpose of the walkdown is to identify fixed ignition sources in each compartment that may be screened. The analyst should visit plant compartments in order to:

- review the location of ignition sources with respect to the targets,
- ascertain that no potential target exists within ZOIs of the screened fixed ignition source(s), and
- verify if proper assumptions were made in characterizing the compartment, the ignition source, and the target.

8.4.4 Outputs to Other Tasks

The output of this task can be summarized as follows:

- Revised compartment fire frequency after screened fixed ignition sources and application of severity factors. The revised compartment fire frequencies are used in future quantitative screening tasks.
- List of unscreened fixed ignition sources within each fire compartment and associated severity factors. This information is used in the detailed fire modeling (Task 11) for defining and quantifying fire scenarios.

8.5 Procedure

The following steps describe the procedure intended for this task.

Step 1: Preparation for walkdown

Step 2: Plant walkdown

Step 3: Verification of screened ignition sources

Step 4: Calculation of severity factors

Step 5: Calculation of revised compartment fire frequency

8.5.1 Step 1: Preparation for Walkdown

Prior to walkdown, the analyst should prepare a list of fixed ignition sources for each fire compartment that need to be examined for screening. This list may be obtained from the results of Tasks 2 and 6 should have been developed in Task 6, where the ignition frequency of each compartment is estimated. As noted earlier, only those ignition sources should be considered in this task that were included in establishing the fire ignition frequency in Task 6. All other potential ignition sources that may be present in the compartment but were screened out in Task 6 as insignificant should be ignored.

Once the fixed ignition source types are known (i.e., electrical cabinets, pumps with lubricating oil, etc.), a ZOI is calculated for each fixed ignition source type. Calculating ZOIs requires compartment information such as size and ceiling height that may be obtained from plant documentation prior to plant walkdown. The automated ZOI form can be used for determining the ZOI. In practice, it is expected that one form is necessary for each compartment.

Calculating ZOIs for fixed ignition source types requires bounding heat release rates and damage/ignition temperatures, as well as fire models to calculate damage/ignition distances. Experience has shown that some ignition sources can be screened out based on simplistic and conservative analysis. For example, ignition sources that are not near any targets can be screened out even when a very large heat release rate is assigned to those sources.

8.5.1.1 Step 1.1: Estimate Heat Release Rate for Fixed Ignition Source Screening

Heat release rate is a key parameter in establishing the characteristics of potential fire scenarios associated with an ignition source. The recommended heat release rate value for screening is the 98th percentile of the probability distributions for the different ignition sources listed in Appendix E or G.

The ability of a fixed ignition source to damage or ignite the first (i.e., closest) target is the main basis for screening ignition sources in this task. Therefore, if it can be ascertained that a potential fire initiated by an ignition source is capable of igniting an intervening combustible, the source may not be screened. This limits the need for any complicated analysis of multiple fires in this task. The heat release rate of electrical cables is not addressed in this task because it is assumed that self-ignited cable fire is possible. Therefore, cables should not be screened in Task 8.

8.5.1.2 Step 1.2: Target and Intervening Combustible Damage and Ignition Criteria

Information on damage criteria for nuclear plant components has been difficult to obtain.

The identification of nearest ignition and damage targets will most often involve identifying cables as both ignition and damage targets. Often the same cable will represent both targets. For cables, the ignition and damage criteria can be assumed to be the same. Heat flux and temperature criteria for damage and/or ignition are provided in Table 8-2. More detail on damage criteria is provided in Appendix H.

**Table 8-2
Damage Criteria for Cables [8.1]**

Screening Criteria to Assess the Ignition and Damage Potential of Electrical Cables		
Cable Type	Radiant Heating Criteria	Temperature Criteria
Thermoplastic	6 kW/m ² (0.5 BTU/ft ² s)	205°C (400°F)
Thermoset	11 kW/m ² (1.0 BTU/ft ² s)	330°C (625°F)

The following notes are provided for dealing with ignition sources and targets.

- Cables in conduit will be considered potential damage targets, but not ignition targets. Cables in conduit will not contribute to fire growth and spread. The conduit will be given no credit for delaying the onset of thermal damage.
- Cables coated by a fire-retardant coating will be considered as both thermal damage and fire spread targets. For the purposes of this screening task, no credit will be given to the coating for delaying or preventing the onset of damage and/or ignition.
- In identifying damage targets, do not include components directly within or associated with the fire ignition source itself. The fire ignition source will be assumed to be damaged given any fire involving itself as the source, so further evaluation of the components as damage targets is unnecessary.

Example: for an electrical panel fire, all equipment and components within the panel will be assumed to fail. Per the definitions for the counting process, a panel will be defined as a distinct vertical section in this context.

- If a scenario should arise involving solid-state control components as a thermal damage target, the failure criteria applied in screening are 3 kW/m² (0.25 BTU/ft²s) and 65°C (150°F) (See Appendix H on damage criteria). The criteria for ignition of the components will assume properties similar to thermoplastic cables (6 kW/m² and 205°C).
- Pipes and water tanks constructed of ferrous metal will be considered invulnerable to fire damage.
- For major components, such as motors, valves, etc., the fire vulnerability is assumed to be limited by the vulnerability of the power, control, and or instrument cables supporting the component.
- Passive components (e.g., flow check valves) will be considered invulnerable to fire.

In summary, if using the 98th percentile heat release rate value in generating the ZOI does not generate the temperatures or heat fluxes listed in the criteria above, the ignition source can be screened out.

8.5.1.3 Step 1.3: Develop Zones of Influence

Developing ZOIs necessitates use of a model that can calculate damage or ignition distances given heat release rate and damage/ignition temperatures. Numerous tools are available that are capable of estimating this behavior that range from simple hand calculations to zone models and computational fluid dynamic models. Some of these models include:

- Hand calculations (also referred as engineering calculations). For example, see References [8.2] and [8.3].
- Zone models. Examples of zone models are COMPBRN [8.4], CFAST [8.5] and MAGIC (by Electric de France).
- Computational fluid dynamics. For example, see Reference [8.6].

All the tools, except for hand calculations, are computer programs that employ sophisticated computational algorithms. The procedures described for this step are applicable to all these tools.

However, the fire modeling tools described in References [8.2] and [8.3] (hand or engineering calculations) may be sufficient for achieving the goals in this task. The use of zone and field fire models is not recommended for this screening task. A spreadsheet template has been created to perform these calculations. The compartment information, heat release rate, and damage/ignition data established at this step is used as input to the template to estimate the fire conditions at the target or intervening combustibles. It is recommended that the analyst be familiar with the calculations and use engineering judgment when interpreting the results, since most of the equations are semi-empirical correlations with specific limits of application.

Appendix F provides technical details on the development of the ZOI. Recommended walkdown forms can also be found in Appendix F.

8.5.2 Step 2: Plant Walkdown

A plant walkdown is recommended to (1) verify and add to the information gathered from paper and electronic documents and ensure as-built conditions of the plant are incorporated in the analysis, and (2) establish the basis for screening certain ignition sources.

It is important that the analysts test the approach adopted for conducting the walkdown to ensure that complete and pertinent information is collected. The analysts may perform a test walkdown, possibly even analyzing a compartment in detail, to ensure that the needed information will be collected.

A walkdown form is recommended in Appendix F to collect and analyze the information relevant to this task. The form is intended to contain information about the heat release rate of the ignition sources in the compartment, their damage criteria, and whether or not the source should be screened. The form also will contain information about the basis for screening or retaining a source.

The following notes about screening of ignition sources may need to be emphasized.

- If an intervening combustible or target is close to the ZOI of a fixed ignition source, the ignition source should not be screened out.
- Individual cubicles within a motor control center and switchgear should not be screened out, because the entire electrical cabinet is either connected to the same bus bar or internally connected to each other. The entire set of cubicles associated with the same bus bar should be combined as one bus bar.

- Control panel segments that are internally connected should be combined as one larger ignition source.
- No cables should be screened out in this task.

Note: For unscreened ignition sources, analysts should document the location of the equipment considered as a target. That is, document the distance from the ignition source to the target, and if the target is expected to be engulfed in flames, within fire plume, the ceiling jet, the smoke layer, or the flame irradiation zone. This information will be used later in this task to calculate severity factors.

Further information about conducting a walkdown may be found in the support task for plant walkdowns.

8.5.3 Step 3: Verification of Screened Fixed Ignition Sources

The non-propagating fixed ignition sources, identified at the end of this step, do not require detailed fire modeling and may be closed out here. However, before these components can be eliminated from further analysis, it is important to verify that fire damage to the ignition source itself is not risk significant. In particular, this concern needs to be carefully evaluated for components such as switchgear and MCCs.

The following provides instructions to ensure that loss of the ignition source alone does not result in a risk significant fire-induced sequence.

- Check if loss of the ignition source is included (as an accident initiator or equipment failure) in the Internal Events PRA Model. If the data used for equipment unavailability is based on historical events, it can be assumed that fire was one of the causes of isolated equipment failure. Based on this assumption it can be concluded that the Internal Events PRA already includes the fire-induced isolated loss of the ignition source and no further evaluation is needed. Otherwise, the following checks should be completed.
- If loss of the ignition source results in a trip (automatic or manual) but no equipment contributing to the CCDP are lost, compare the ignition source fire frequency with the random frequency of the trip it causes. (If recovery of the initiator is in the PRA, generally it should not be considered part of the random trip frequency since fire damage is often not recoverable.) If the ignition source fire frequency is much less, the ignition source can be screened. If the ignition source frequency is comparable or higher, add a fire-induced sequence using the ignition source fire frequency and the corresponding CCDP (from the Internal Events PRA) without recovery of the initiator.
- If loss of the ignition source results in both a trip (automatic or manual) and loss of one or more components contributing to the CCDP, add a fire-induced sequence using the ignition source fire frequency and the corresponding CCDP model with the damaged components set to fail.

8.5.4 Step 4: Calculation of Severity Factors

A severity factor is calculated for each unscreened fixed ignition source. In general, severity factors assigned in this task will range from 0.02 to 1.0 because the screening criteria is based on the 98th percentile of the probability distributions for heat release rate. That is, equipment can be screened if the heat release rate required for generating damage to the nearest intervening combustibles is lower than the 98th percentile of the distribution. In this task, the severity factor is the area under the probability distribution for the heat release rate to the right of the lowest heat release rate generating damage to the target. As an example, consider the case of a target within the damaging flame radiation illustrated in Figure 8-1. After calculating the lowest heat release rate required for damage \dot{Q}_{dam} , the corresponding probability distribution for the ignition source is selected for determining the severity factor. Readers are referred to Appendix E for further technical details on severity factors.

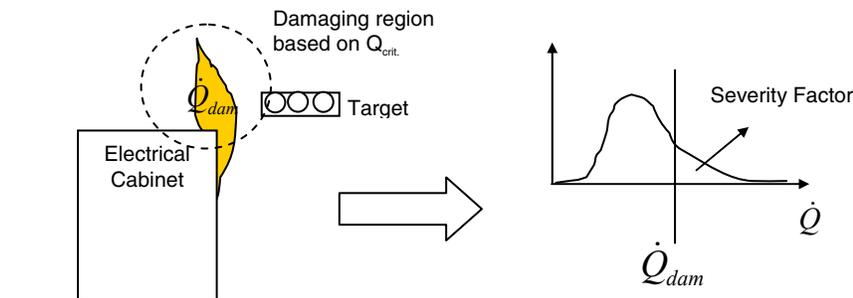


Figure 8-1
Conceptual Representation of the Process of Calculating Severity Factors in Task 8

At this point, the analyst should have a list of unscreened ignition sources with the respective distance to the target and fire condition affecting it, as indicated at the end of Step 2. For each ignition source in the list, the heat release rate necessary for damage is calculated and the severity factor is assigned based on the heat release rate. The hand calculations that can be used to determine the heat release rate necessary for damage are described in Appendix F.

8.5.5 Step 5: Calculation of Revised Compartment Fire Frequency

Revise the compartment fire frequencies, $\lambda_{j,IS}$, developed in Task 6 after removing the fixed ignition sources screened in Step 3:

$$\lambda_{j,L} = \sum_{i=1}^N \lambda_{IS,J} \cdot SF_{IS,J} ,$$

where $\lambda_{IS,J}$ is the compartment frequency calculated in Task 6, and $SF_{IS,J}$ is the severity factor for ignition source IS in compartment J. Notice that the multiplication of the generic frequency times the location and ignition source weighting factors is already available from Task 6, fire ignition frequency. Furthermore, notice that no credit is given to the non-suppression probability in this task.

Table F-1 describes how the walkdown, screening, and determination of severity factors is summarized and automated in a spreadsheet.

8.6 References

- 8.1 Inspection Manual Chapter 0609, Appendix F, “Fire Protection Significant Determination Process,” USNRC, February 2005 (available through the USNRC public website).
- 8.2 *Fire Modeling Guide for Nuclear Power Plant Applications*. Electric Power Research Institute, TR-1002981.
- 8.3 *Fire Dynamics Tools (FDT): Quantitative Fire Hazard Analysis Methods for the U.S. Nuclear Regulatory Commission Fire Protection Inspection Program*, U.S. NRC, NUREG-1805, November 2004.
- 8.4 *COMPBRN-III: An Interactive Computer Code for Fire Risk Analysis*, EPRI NP-7282, May 1991.
- 8.5 Peacock, R., Jones, W., Reneke, P., Forney, G. “CFAST, The Consolidated Model of Fire Growth and Smoke Transport,” NIST Technical Note 1299, February 1993.
- 8.6 McGrattan, K., Baum, H., Rehm, R., Hamins, A., Forney, G., *Fire Dynamics Simulator, Technical Reference Guide*, NISTIR-6467. January 2000.

9

DETAILED CIRCUIT FAILURE ANALYSIS (TASK 9)

9.1 Purpose

Conducting a Fire PRA in accordance with this methodology necessitates an analysis of fire-induced circuit failures beyond that typically conducted during original Fire PRAs. The circuit analysis elements of the project are conducted in three distinct phases:

1. Fire PRA cable selection (Task 3),
2. Detailed circuit failure analysis (Task 9), and
3. Circuit failure mode likelihood analysis (Task 10).

This chapter provides methods and instructions for conducting the second phase of circuit analysis—detailed circuit failure analysis (Task 9). The purpose of Task 9 is to conduct a more detailed analysis of circuit operation and functionality to determine equipment responses to specific cable failure modes. These relationships are then used to further refine the original cable selection by screening out cables that cannot prevent a component from completing its credited function. The output of this task supports the quantitative screening process under Task 7.

As discussed in Chapter 3, in most cases it is advantageous to perform some aspects of Task 9 along with the basic cable selection process of Chapter 3. Analysts are encouraged to screen out early in the cable selection/analysis process those cables that are readily identifiable as not posing a risk to the credited PRA function. A full and complete detailed circuit failure analysis can be time consuming and resource intensive. Accordingly, this level of analysis should be reserved for cases in which the quantitative screening demonstrates a clear need and advantage to fully developing a circuit's failure modes and response to fire-induced cable failures. Ultimately, each plant will need to find the most efficient balance point with respect to how much detailed circuit analysis is conducted coincident with the cable section.

9.2 Scope

Chapter 9 provides methods and technical considerations for identifying the potential response of circuits⁷ and equipment to specific cable failure modes associated with fire-induced cable damage. This task contains the following key elements:

⁷The term “circuit” and “cable” are often used interchangeably for fire-related circuit analyses. A circuit is comprised of electrical components, subcomponents, and cables/connection wire. Within the context of fire-induced equipment failures, it is understood that “circuit failure” or “circuit response” refers to the impact of “cable failure modes” that may affect the behavior of related components and subcomponents in a complete circuit.

- Determine the component response to postulated conductor/cable failure modes, and
- Screen out cables that do not impact the ability of a component to complete its credited function.

This task does not address implementation of plant-specific quality assurance and configuration control requirements that might apply to a Fire PRA. Nor is it intended that this procedure validate the accuracy of plant-specific data extracted from plant drawings, documents, or databases. Each plant should follow appropriate quality assurance, administrative, and configuration control procedures applicable to the work being conducted. The need to validate input source documents should be addressed as part of assembling the prerequisite information in Step 1.

9.3 Background Information

9.3.1 General Task Objectives and Approach

The cable failure modes of particular interest here include *shorts-to-ground* and *hot shorts*. Open circuit failures⁸, as the initial cable failure mode, will typically not be considered in this procedure. However, an open circuit condition resulting from the predictable operation of a circuit protection device (e.g., circuit breaker and fuse) in response to fire-induced short circuits will be considered with regard to its impact on the operation of the component(s) affected by the cable under consideration.

An *Equipment Failure Response Report*⁹ is a consolidated list of possible component responses resulting from fire damage to the cable. This aspect of the circuit analysis is fundamentally a deterministic study and does not include failure mode probabilities (the probabilistic analysis of circuit failure modes is covered in Chapter 10). However, the results of this task will serve as the basis for estimating the likelihood of specific equipment functional failures at a compartment or scenario level.

Development of the Equipment Failure Response Report involves three principal steps. Generic instructions for completing these steps are provided in this chapter. Figure 9-1 provides a summary of the task work flow. Before beginning this task, it is important to clearly define how various cable failure modes are handled.

⁸ Within the context of this procedure, “open circuit failure” refers to the loss of continuity due to direct physical damage to the conductor (e.g., melted wire).

⁹ The term “Equipment Failure Response Report” is used in the generic sense to depict a matrix-type listing of equipment failure modes correlated to the component’s circuit conductors/cables.

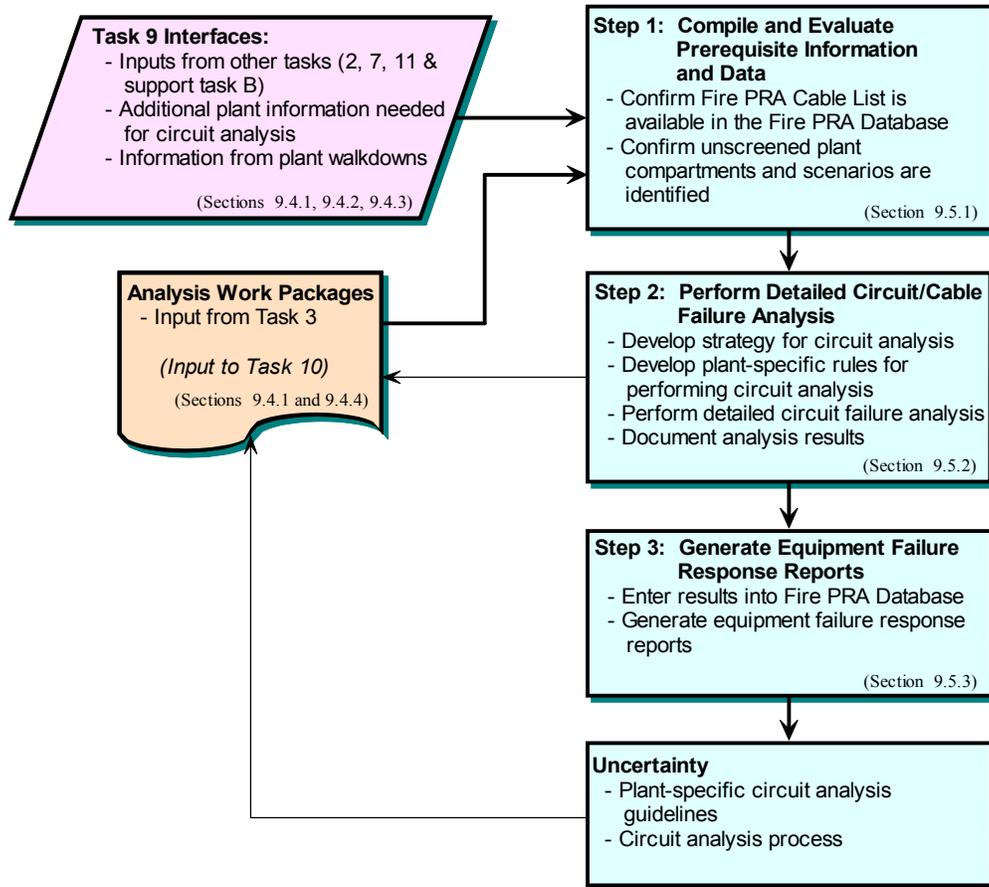


Figure 9-1
Detailed Circuit Failure Analysis Work Flow

9.3.2 Assumptions

The following assumptions form the basis for this task:

- An Appendix R analysis for the plant has been completed and documented, and is available for identifying equipment failure responses to specific cable failure modes. Additional effort will be necessary to address systems that are not part of the Appendix R analysis, and to address systems/trains for which the Appendix R analysis assumes failure without performing detailed circuit analysis.
- Component analysis packages have been assembled as part of the activities under Task 3, Fire PRA Cable Selection, and are available for use in this task.
- Equipment is assumed to be in its normal expected position or condition at the onset of the fire. Where the status of a component is indeterminate or could change as a result of expected plant conditions, the analysis assumes the worst-case initial conditions.
- Users of this procedure are knowledgeable and have experience with circuit design and analysis methods. Work under this procedure is assumed to be conducted by or supervised by personnel familiar with circuit failure analysis (i.e., Appendix R safe shutdown analysis or similar).

9.4 Task Interfaces

9.4.1 Input from Other Tasks

9.4.1.1 Fire PRA Components Selection (Task 2)

The detailed circuit failure analysis task needs, as a prerequisite, the Fire PRA Equipment List from Task 2, Fire PRA Equipment Selection. The Fire PRA Equipment List is used to verify that all Fire PRA cables located in the unscreened compartment(s) or raceway(s) are analyzed. In addition, the Fire PRA Equipment List provides the specific functional requirements for each component. Any discrepancies or inconsistencies should be discussed and resolved with the Fire PRA analysts as part of completing the detailed circuit failure analysis.

9.4.1.2 Fire PRA Cable Selection (Task 3)

This detailed circuit failure analysis task needs, as a prerequisite, the list of Fire PRA cables from Task 3, Fire PRA Cable Selection. The Fire PRA Cable List is used to identify Fire PRA cables routed within unscreened plant locations. In addition, the analysis packages assembled for each component during Task 3 provide the baseline documentation needed to complete the detailed circuit analyses.

9.4.1.3 Fire PRA Database System (Support Task B)

The Fire PRA Database System (database structure and relationships) is a prerequisite for Task 9. The database system provides a structured framework for maintaining Fire PRA data. The database is populated with the data and information generated by previously completed tasks, and, in part, will be used to establish the Fire PRA equipment and cable locations. The data structure and functional relationships established within the database system are specifically designed to provide the necessary sort and query capability to identify fire compartment contents.

9.4.1.4 Quantitative Screening (Task 7)

To maximize efficiency, an overall project objective is to minimize the number of components for which a detailed circuit failure analysis is conducted. Focusing the scope of the detailed circuit failure analyses is accomplished using the preliminary screening results from Task 7, Quantitative Screening.

9.4.1.5 Detailed Fire Modeling (Task 11)

An alternate way to identify the cables requiring detailed analysis is to provide a list of raceways affected by fire within a compartment. Such fire scenario-specific input would be generated from the output of Task 11, Detailed Fire Modeling.

9.4.2 Additional Plant Information Needed to Support this Task

9.4.2.1 Plant Appendix R Safe Shutdown Circuit Analysis

Given the substantial overlap between the Fire PRA Equipment List and Appendix R Safe Shutdown Equipment List, the Appendix R circuit analysis information should be used to the maximum extent possible to support this task. The approach and methods used for the Appendix R circuit analysis will possibly differ from that developed for the Fire PRA. Any differences should be well understood to ensure the Appendix R circuit analysis results are representative and as complete as necessary to meet Fire PRA objectives. The Appendix R circuit analysis might or might not inherently incorporate a “detailed” circuit failure analysis. Additionally, the Appendix R analysis may not contain detailed circuit failure analysis documentation for equipment that is not part of the Appendix R “protected train” for the fire area in question. This too, will need to be confirmed as part of using the Appendix R study results.

9.4.2.2 Other Information and Data

- Component elementary circuit diagrams
- Component cable block diagrams
- Component wiring/connection diagrams
- Electrical distribution system single-line diagrams
- Instrument loop diagrams and block diagrams
- Cable raceway schedules and routing drawings

9.4.3 Walkdowns

Plant walkdowns are not considered a fundamental part of this task. Rather, plant walkdowns should be considered on a case-by-case basis as a way of obtaining necessary information about cable and/or raceway locations.

9.4.4 Outputs to Other Tasks

The Target Equipment Response Reports are used principally as reference information for conducting additional quantitative screenings. Cables are screened based on their potential to impact the desired functionality of a component. Target Equipment Response Reports also serve as input into the probabilistic circuit failure mode likelihood analysis (Task 10).

9.5 Procedure

The purpose of Task 9 is to perform a deterministic failure analysis of the circuits located within each *unscreened* fire compartment/scenario in order to identify those circuits/cables that can adversely affect the credited functionality of essential equipment/components, and to document

the equipment responses to the possible cable failure modes induced by fire damage. This task differs from Task 3 in that the Fire PRA cable selection process is designed to identify and document all of the “important” cables associated with each Fire PRA component, whereas Task 9 further refines the analysis by determining the actual functional impact of the postulated cable failure modes.

The steps below provide methods for performing the detailed circuit analysis of essential cables. Although the instructions cover all aspects of the work, it is strongly recommended that additional plant-specific circuit analysis “rules” be developed before beginning work. As with the cable selection performed under Task 3, plant-specific rules are important to further customize the analysis methodology to fit the specific circumstances and needs of each plant.

9.5.1 Step 1: Compile and Evaluate Prerequisite Information and Data

This step ensures that prerequisite information and data is available before beginning the detailed circuit analyses. Beginning the process of circuit analysis without first having the prerequisite information will reduce efficiency and significantly increase the likelihood of rework.

9.5.1.1 Step 1.1: Confirm Fire PRA Cable List is Available in the Fire PRA Database

Confirm that the Fire PRA cables have been identified and input into the Fire PRA Database (outputs from Task 3, Fire PRA Cable Selection, and Support Task B, Fire PRA Database System). Consider the following factors in conducting the verification.

1. It is desirable that fire compartments be associated with plant raceways and, no less important, that plant cables be associated with raceways through which they are routed and endpoint designations to which they terminate. In some cases, cables might be correlated directly to compartments instead of indirectly via raceways, or might only have a correlation to fire areas. These factors can introduce inherent limitations on the ability to conduct compartment-level and scenario-level screening. As a minimum, cables should be correlated to plant fire areas.
2. The Fire PRA Cable List data should include a correlation to specific individual fire PRA equipment.

9.5.1.2 Step 1.2: Confirm Unscreened Plant Compartments and Scenarios are Identified

Determine the scope of equipment requiring a detailed circuit failure analysis.

1. Obtain a listing of unscreened fire compartments/scenarios (output from Task 7, Quantitative Screening). Generate a listing of affected components for each unscreened compartment/scenario (Target Equipment Location Reports).
2. For components requiring a detailed circuit failure analysis, ensure the Fire PRA Database includes equipment identifiers, attributes, normal status, and functional requirements (Output from Task 2, Fire PRA Components Selection).

This step focuses the scope of the detailed circuit analysis. Compartments, scenarios, and equipment not included on the list do not need a detailed circuit failure analysis.

9.5.2 Step 2: Perform Detailed Circuit/Cable Failure Analysis

This step performs a deterministic-based detailed circuit analysis for the Fire PRA cables of interest that are located in the unscreened plant locations.

9.5.2.1 Step 2.1: Develop Strategy for Circuit Analysis

The first step in conducting circuit analysis is to develop a comprehensive strategy and approach. The following factors should be considered.

1. Determine to what extent the Appendix R circuit analysis data can be used. To make this determination, it is necessary to fully understand the analysis approach used to create the original cable set for each component and compare this to the analysis criteria established for the Fire PRA. Particular attention should be paid to criteria/assumptions in the Appendix R analysis upon which cables have been eliminated as a concern. The assumptions and criteria for these decisions will possibly not fully align with the analysis criteria and cable failure modes to be considered for the Fire PRA. Determine the level of effort necessary to augment or modify the original analysis to conform to the Fire PRA criteria. Experience indicates that a hands-on review of several components is helpful in revealing differences that should be considered when developing a strategy.
2. Determine how the circuit failure analysis results will be documented. The requisite level of detail to be documented should be clearly established, including the rationale for selecting or excluding specific analysis methods. In addition, the specific types of equipment responses to cable failure modes that are to be documented (and possibly ranked) should be determined.
3. Note that the normal equipment status should be identified as part of the Fire PRA Components Selection (Task 2). If the normal status is indeterminate, the circuit failure analysis should assume the worst case initial conditions.
4. The Fire PRA Equipment List might list a component more than once if it has different functional requirements for different event sequences. In these cases, the detailed circuit analysis should address each case separately. Normally, only two cases will exist: open and closed for valves, running or stopped for pumps, and open or closed for breakers.

9.5.2.2 Step 2.2: Develop Plant-Specific Rules for Performing Circuit Analysis

Once a strategy and approach for conducting and documenting the detailed circuit analysis has been established, translate the approach into specific “rules” that will be used to govern the detailed circuit analysis methodology. The benchmark for these rules is that independent review by different analysts should identify identical circuit/equipment responses. In developing plant-specific circuit analysis rules, consider the following.

1. The following circuit failure modes and their effect on the circuit behavior/component response should be included in the circuit analysis evaluation.

Cable Failure modes:

- Shorts-to-Ground
- Hot Shorts

Effects on Circuit/Component:

- Spurious Operation
 - Loss of Power
 - Loss of Control
 - Erroneous Indication
 - Others as appropriate
2. Numerous subcases exist for the cable failure modes identified above. Based on engineering principles, test results, and operating experience, recommendations for disposition of certain cases of interest are provided below.

- Three-phase proper polarity hot shorts on AC power systems:

Case 1: Grounded AC system with thermoset-insulated cable¹⁰. Three-phase proper polarity hot shorts are evaluated as extremely low-probability events for grounded three-phase AC power systems. Based on observed characteristics and behavior of fire-induced cable failures, an estimated upper bound on the probability of occurrence for a three-phase circuit utilizing thermoset-insulated triplex cable (one 3-conductor cable) located in a typical cable tray or conduit is 5E-8/yr. This bound considers:

- The likelihood of multiconductor-to-multiconductor hot shorts for thermoset-insulated cable,
- The likelihood of concurrent and independent phase faults,
- The likelihood of phase faults of the proper polarity, i.e., phase rotation, and
- Typical fire ignition and severity frequencies and suppression failure probabilities.

On this basis, the three-phase proper polarity hot short failure mode is not considered risk-significant in accordance with the defined screening criteria of 1E-7/yr for “potentially high consequence equipment,” as defined by Section 2.5.6. It is recommended that this failure mode not be included in the Fire PRA cable selection process for grounded three-phase AC circuits involving thermoset-insulated cable.

¹⁰ Case 1 is considered to apply to impedance grounded systems (high and low) if the system overcurrent protection scheme is designed to initiate a protective device trip upon detection of a ground. If instead the overcurrent protection scheme only initiates an alarm signal, the system should be analyzed following the instructions for Case 2.

Case 2: Ungrounded AC system or thermoplastic-insulated cable. The evaluation of ungrounded systems and thermoplastic-insulated cable is less certain than the evaluation for Case 1 due to the scarcity of data. Nonetheless, with an understanding of the general principles and phenomena involved, it can be reasoned that the failure mode has a low probability, but not as low as that for grounded systems with thermoset cable. On this basis, it cannot be conservatively argued that the failure mode likelihood is below the $1E-7$ /yr screening criteria established for “potentially high-consequence equipment.” Accordingly, for these cases, it is recommended that three-phase proper polarity hot shorts be considered for high consequence equipment, as defined by Section 2.5.6.

Case 3: Armored cable or cable in dedicated conduit. Three-phase proper polarity faults are not considered credible for armored power cable or a single triplex cable in a dedicated conduit. The basis for exclusion is that multiconductor-to-multiconductor hot shorts are not plausible given the intervening grounded barrier (i.e., the armor or conduit).

- Open Circuits

Open circuits (a condition that is experienced when an individual conductor within a cable loses electrical continuity) need not be considered as a primary cable failure mode of concern when conducting the detailed circuit failure analysis. However, it is recognized that the effects on a circuit due to shorts-to-ground or hot shorts will likely cause circuit protective device actuation(s) that result in an “effective” open circuit condition (expected circuit state following overcurrent protective action). The effects of this resultant circuit condition should be considered in determining the functional impact on the equipment.

- Compatible polarity multiple hot shorts on ungrounded AC and DC circuits

Compatible polarity hot shorts for ungrounded AC and DC circuits are evaluated to be a low-likelihood event; however, sufficient data is unavailable to screen out this particular cable failure mode from consideration, based on the thresholds established in Section 2.5.6. Hence, the evaluation of hot shorts should in general consider this particular failure mode.

- Ground faults on ungrounded AC and DC control circuits

A single ground fault on an ungrounded AC or DC control circuit has no immediate functional affect. Thus, ground faults on ungrounded systems should be treated differently than for grounded systems. With respect to spurious actuations, multiple ground faults can potentially energize conductors via backfeed paths through grounded surfaces (tray, conduit, etc.). For this phenomenon to be viable, one or more energized conductors from the same power source as the circuit under analysis must also be susceptible to fire damage. In practice, unless the energized conductors (from the same power source) are located in the same raceway as the target cables/conductors, the likelihood of a viable conduction path through a grounded surface is extremely remote. (Note that this circuit failure mode does not exist for grounded circuits since the ground fault is presumed to trip the circuit’s overcurrent device.). For ease of analysis it is recommended that an existing, unspecified ground fault from the same power source be

assumed when analyzing ungrounded circuits. It is likely that over the course of a fire at least one conductor from each polarity of a circuit (positive and negative polarity) will eventually become grounded. Thus, the circuit analysis should not try to take credit for a circuit remaining functional simply because two conductors must short to ground to render the circuit inoperable (i.e., blow the fuse or trip the circuit breaker).

- Coincident independent hot shorts involving separate cables

In general, the analysis of individual components should only consider failures of the specific circuit conductors that are contained within the cable under evaluation. Other conductors making up the circuit, but contained in a separate cable, should be assumed to represent otherwise normal circuit paths (i.e., other cables connected to the cable under evaluation should be assumed to be unaffected by the fire).

This approach can be implemented using the “hot probe” analysis method. In this approach, the analyst assumes the presence of an energized conductor (the hot probe) capable of energizing the circuit conductor under consideration. The “hot probe” represents a single “source conductor” without reference to its circuit association (i.e., it could be an intra-cable source or inter-cable source). The hot probe is postulated to make contact with each individual conductor in the cable (separately or coincidentally). Experience with the hot probe analysis method for a broad range of circuit types confirms that this method of analysis generally bounds the case of multiple independent coincident hot shorts on separate cables (as applied to the circuit analysis of an individual component). However, for certain unique circuit configurations, this approach might not be appropriate. Consideration should be given to those (expectedly few) cases where two cables interfacing with a single circuit are exposed to the same fire, and where independent concurrent hot shorts on both cables is necessary to produce an undesirable circuit/component response. Such cable combinations should be flagged and incorporated into the analysis. Appendix I provides an example of such a case. Extending this consideration beyond two-cable combinations is not advised. Determining specific configurations that might warrant a more comprehensive analysis falls within the purview of the electrical analyst.

- Intra-cable and Inter-cable Hot Shorts for Multi-conductor Cables

When analyzing multi-conductor cables, energized conductors within the cable (intra-cable) and external to the cable (inter-cable) are considered viable source conductors for analyzing hot shorts. The source conductor(s) are considered capable of shorting to the cable’s conductors individually or concurrently. The likelihood of such failures (both individual and multiple) is addressed under Task 10, Cable Failure Mode Likelihood Analysis.

- Low-Voltage DC (1 VDC-48 VDC) Instrument Signals

These circuits are typically comprised of instrument signal cables for monitoring, protection systems, or control valve circuits (sensor to I/P converter). Shielded, grounded signal cables are typically used for these applications. Considerations in the analysis of these circuits include:

- Conductor-to-conductor shorts within an instrument signal cable or intermediate resistance grounds can produce false instrument signals that should be considered when determining equipment responses, including indicators.
- Many plant protection circuits have logic circuitry that needs multiple input signals in order to actuate (i.e., one out of two taken twice, two out of three, etc.). In these instances, multiple failures on instrument input signal cables (or, in some specific designs, multiple conductors within the same cable) could cause a fire-induced safety signal actuation. These failure modes are addressed qualitatively in the human factors analysis, as discussed in Volume 1, Chapter 2. The detailed circuit analysis should consider these interfacing circuits only to the extent specified in Section 3.5.1.1.
- If the cable design can be verified as one that employs a rugged grounded metallic shield (e.g., armor, braid, etc.)¹¹, then the analysis need only consider the effects of shorting between the conductors within the shield and shorting of the conductors to ground, i.e., the effects of shorts from external sources need not be considered.

3. General evaluation approaches for performing detailed circuit failure analyses include:

- Circuit failure evaluations should be performed with the components in their normal operating state. This demands that the devices making up the circuit be represented appropriately. For example, if relay contacts included as part of the circuit are closed in the normal operating state, the circuit should be analyzed assuming that those contacts are closed. The analysis should be performed using a marked-up circuit schematic that represents the normal operating condition of the circuit under review. If a component state is indeterminate (i.e., varies as a result of normal plant operation, e.g., two motors that are run for alternating periods to even out run time), the worst-case functional state should be selected for analysis.
- It may be insightful to extend the analysis to consider the possible effect of certain failure modes on the component, if the component's status is changed (or a change is attempted) while the fault is present. One example would be if the operator attempts to close a normally open valve following the onset of cable damage.
- During the process of identifying equipment responses to cable failure modes, a hot short circuit failure on the appropriate conductor(s) should conservatively be assumed to occur with sufficient electrical contact to impose full voltage on the "target conductor." For example, if a hot short between two conductors can produce a spurious actuation, the short is assumed to occur in a manner that permits sufficient energy transfer to cause the spurious actuation. This approach will ensure that a comprehensive population of cables is evaluated.
- The detailed circuit failure analysis is a deterministic "static" analysis. As such, dynamic aspects of the cable faults are not considered. Each cable fault should be evaluated for the possible equipment response it could elicit. Timing aspects and the ultimate circuit/equipment state are not factored into the criteria. For example, if a hot

¹¹ This criterion does not include the use of fragile shielding, for example, thin aluminized Mylar. Additionally, if the metal shield is not grounded appropriately, the combined effect of an external source shorting to the shield to which one or more of the internal conductors also shorts should be analyzed.

short between two conductors can produce a spurious opening of a solenoid valve, the analysis should identify “fail open” as an equipment response. How long the hot short will persist before the fault degrades to a ground fault and terminates the spurious operation is not a factor considered by the analysis.

- Plant-specific design features can preclude certain circuit failures from occurring. For example, the use of grounded, metallic, armored cable or dedicated conduit, shorting switches, or rugged (e.g., braided metal) shielding are considered in most cases to preclude external hot shorts from further consideration. Design and construction attributes such as these should be considered in the evaluation. These special conditions should be well documented so the basis for evaluation is readily apparent.
- Once a cable is analyzed for one fire compartment/scenario situation, the results of its circuit analysis are applicable for the same cable in any other compartment/scenario. Hence, each cable only needs to be analyzed once to satisfy the objectives of this procedure.
- Rules should be developed regarding the disposition of unforeseen or undefined component responses that the circuit analysis reveals as a possibility for a given failure mode(s).

9.5.2.3 Step 2.3: Perform Detailed Circuit Failure Analysis

This substep constitutes the critical element of Task 9. Inaccurate analysis of the circuit(s) associated with the cables can ultimately result in erroneous fire risk quantification determinations. Therefore, additional care is prudent in performing the activities described here.

Case 1: Incorporation of Existing Analysis:

If a previous analysis (e.g., Appendix R analysis) is to be incorporated in the calculation package, complete the circuit analysis process as follows.

1. Assemble applicable documentation, drawings, and database information as necessary.
2. Based on the circuit analysis rules established in Step 2.2, above, and with a clear understanding of the generic differences between the Appendix R analysis and Fire PRA criteria, identify the possible circuit failure modes and resulting equipment responses to be added or removed from the original analysis. Refer to the applicable sections in Case 2, below, if additional detailed analysis is required.
3. Document the changes in accordance with the methods established during the planning phase.
4. Depending on the requested input from the Fire PRA analysts, it may only be necessary to document one failure mode. For example, the analysis of a normally closed valve whose credited function is to remain closed, should generally focus on those cable faults that can cause a spurious opening. To minimize the volume of data to be managed, only the relevant information should be incorporated into the Fire PRA Database.

Case 2: New Circuit Analyses:

If the cable/circuit to be analyzed has no previous analysis, or if the previous analysis is based on substantially different criteria, complete the detailed circuit analysis as follows.

1. Collect and assemble plant drawings, documents, and data for each circuit. Make use of the analysis packages created under Task 3, if available.
2. Following the plant-specific rules established for the circuit analyses, identify the circuit/component responses (e.g., spurious operation, loss of power, loss of control, erroneous indications, etc.) directly associated with the following fire-induced cable failure modes:
 - Shorts to ground, and
 - Hot shorts

Note that the actual analysis is performed on a conductor-by-conductor basis. The final list of equipment responses for any one cable is a culmination of the responses for the individual conductors in the cable.

3. The analysis is most easily conducted by postulating individual faults on each conductor in the cable (i.e., the “hot probe” method).
 - Identify the equipment response to ground faults on each conductor contained in the cable.
 - Analyze hot shorts using the hot probe method of circuit analysis. In this approach, the analyst assumes the presence of an energized conductor (the hot probe) capable of energizing the circuit conductor under consideration. The hot probe is intended to represent a single source conductor without reference to its circuit association (i.e., it could be an intra-cable or inter-cable source). The hot probe is postulated to make contact with each individual conductor in the cable (separately or coincidentally) and the equipment response to the postulated hot short is determined (e.g., spurious operation, etc.). This analysis approach is a practical means of identifying the equipment failure modes for a majority of circuit types.

Appendix I provides a number of circuit analysis examples using the recommended method.

Note: If a more comprehensive method for evaluating a particular cable or specific damage scenario is desired, a more rigorous failure modes and effects criticality analysis can be conducted. One possible method for this type of analysis is discussed at some length in Reference [9.1]. An analysis of this type will help identify any unique dynamic affects that might be present, which may be useful in accessing certain human factors elements of the overall study.

4. In addition to performing the hot probe analysis, determine if the circuit contains any unique attributes that warrant an analysis of coincident hot shorts on separate cables.

5. In some cases, electrical cable failures will result in permanent damage to electrical or mechanical equipment that precludes certain types of recovery actions. For example, a spurious operation of a valve due to a hot short that bypasses the valve's torque switch might cause permanent binding of the valve. Cases of this nature should be documented and discussed with the systems analysts to ensure recovery actions accurately reflect the prevailing conditions.
6. Document the circuit and component response to each of the separate failure modes postulated in accordance with the methods established during the planning phase (see Step 2.1, above).

9.5.3 Step 3: Generate Equipment Failure Response Reports

1. Enter the information collected in the previous steps into the Fire PRA Database. This information establishes the possible equipment failure modes to the postulated cable faults. In entering the data into the Fire PRA Database, it is important to maintain the established data structure and relationships created for the database system. This will ensure that the essential database sort and query capability is achieved and that data integrity is maintained throughout the iterative process of conducting the evaluation.
2. Once the Fire PRA Database is populated with the equipment failure response data, generate Equipment Failure Response Reports. These reports are a listing by compartment of equipment and associated cables that are affected by fire in the compartment, along with the specific equipment responses that are possible as a result of fire damage to the cables. As discussed in Step 9.5.2.3, it might be desirable to track only the equipment responses of concern.

9.6 References

- 9.1 Circuit Analysis – Failure Mode and Likelihood Analysis, NUREG/CR-6834, USNRC, September 2003.

10

CIRCUIT FAILURE MODE LIKELIHOOD ANALYSIS (TASK 10)

10.1 Purpose

Conducting a Fire PRA in accordance with this methodology necessitates an analysis of fire-induced circuit failures beyond that typically conducted during original Fire PRAs. The circuit analysis elements of the project are conducted in three distinct phases:

4. Fire PRA cable selection (Task 3),
5. Detailed circuit failure analysis (Task 9), and
6. Circuit failure mode likelihood analysis (Task 10).

This task provides methods and instructions for conducting the third phase of circuit analysis – circuit failure mode likelihood analysis for Fire PRA cables. Task 10 estimates the probability of hot short cable failure modes of interest, which in turn can be correlated to specific component failure modes. As discussed in Section 3.3.2 of Volume 1, the methods and techniques for deriving circuit failure mode probability estimates are based on limited data and experience. Consequently, this area of analysis is not yet a mature technology, and undoubtedly further advances and refinements will come with time. Nonetheless, the methods and techniques presented in this chapter represent the current state of knowledge and provide a reasonable approach for establishing first-order circuit failure mode probability estimates, albeit with relatively high uncertainty tolerances.

10.2 Scope

Chapter 10 provides methods and technical considerations for assigning probability estimates to specific cable failure modes associated with fire-induced cable damage.

This task does not address the implementation of plant-specific quality assurance or configuration control requirements that might apply to a Fire PRA. Nor is it intended to validate the accuracy of plant-specific data extracted from plant drawings, documents, or databases. Each plant should follow appropriate quality assurance, administrative, and configuration control procedures applicable to the work being conducted. The need to validate input source documents should be addressed as part of assembling the prerequisite information in Step 1.

10.3 Background Information

10.3.1 General Task Objectives and Approach

Task 10 is intended to provide a probabilistic assessment of the likelihood that a cable will experience one or more specific failure modes (e.g., short-to-ground, intra-cable conductor-to-conductor short, inter-cable conductor-to-conductor short, etc.). The results of this assessment are entered into the Fire PRA Database, allowing generation of equipment failure reports, including the estimated likelihood of the failure modes of concern.

Estimating the likelihood of occurrence of specific cable failure modes involves three principal steps. Generic instructions for completing these steps are shown in Figure 10-1. An important element of this task is obtaining the necessary cable and configuration data needed to establish correlations to conditions for which cable failure data is available.

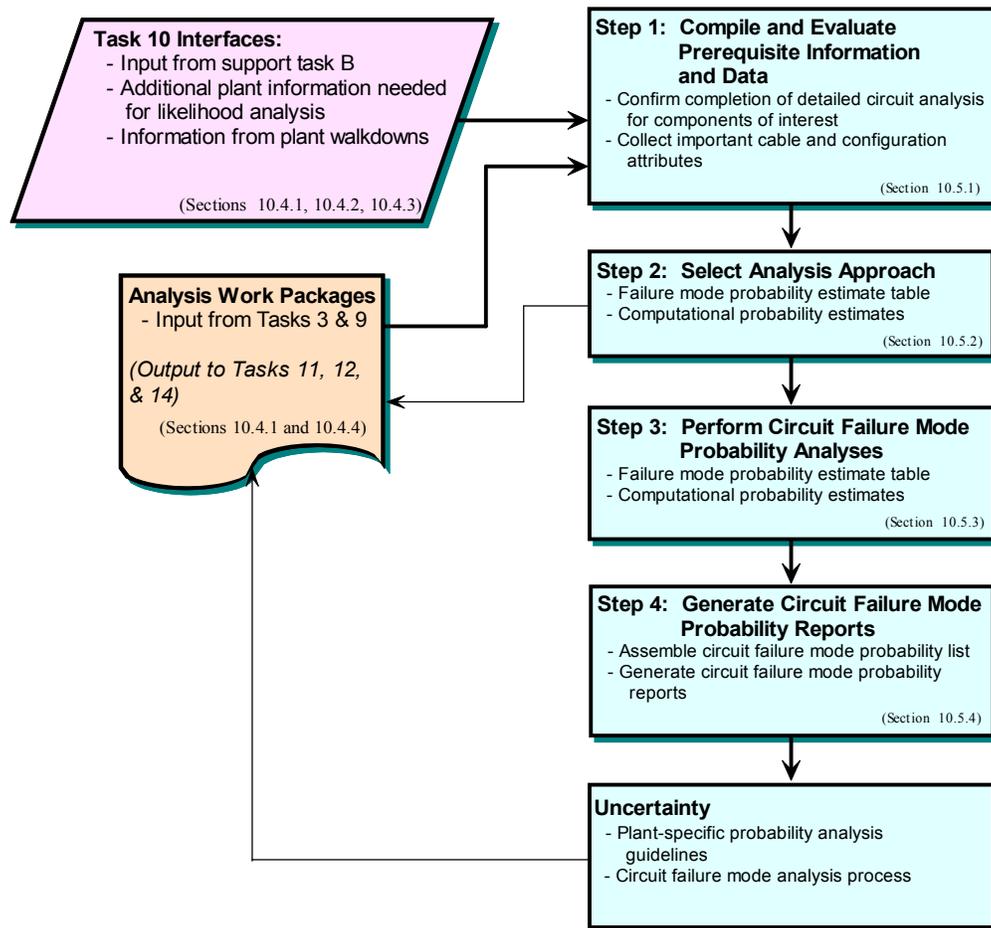


Figure 10-1
Circuit Failure Mode Likelihood Analysis Work Flow

10.3.2 Assumptions

The following assumptions form the basis for this task.

- Requisite cable and configuration attributes are available or can be determined as part of the analysis.
- The equipment is in its normal operating position or condition at the onset of the fire. Where the status of a component is indeterminate or could change as a result of expected plant conditions, the analyst should assume the worst-case initial conditions, consistent with the detailed circuit analysis conducted under Task 9.
- Users of this procedure are knowledgeable and have experience with circuit design and analysis methods and probability estimation techniques.
- The analysis methods presented here can be reasonably applied to multi-conductor cables that contain no more than 15 conductors. Multi-conductor cables with more than 15 conductors are considered to carry a substantially higher uncertainty.

10.4 Task Interfaces

10.4.1 Input from Other Tasks

10.4.1.1 Fire PRA Cable Selection (Task 3)

This circuit failure mode likelihood analysis task needs, as a prerequisite, the list of Fire PRA cables from Task 3, Fire PRA Cable Selection. The Fire PRA Cable List is used as the basis for identifying important cable and configuration attributes (e.g., insulation material, raceway type, fire barrier wraps (if any), target and source conductors, etc.) of the cables of interest within the compartments under evaluation.

10.4.1.2 Fire PRA Database System (Support Task B)

The Fire PRA Database System (database structure and relationships) is a prerequisite for Task 10. The database system provides a structured framework for maintaining Fire PRA data. The database system is populated with the data and information generated by previously completed tasks, and, in part, will be used to establish the Fire PRA equipment and cable routing locations. The data structure and functional relationships established within the database system are specifically designed to provide the necessary sort and query capability to identify fire compartment contents.

10.4.1.3 Detailed Circuit Failure Analysis (Task 9)

The basis for identifying circuit failure modes requiring a probabilistic assessment stems from the detailed analysis of possible failures conducted under Task 9, Detailed Circuit Failure Analysis. This information is essential in establishing a starting point for the probabilistic analysis.

10.4.1.4 Detailed Fire Modeling and Quantification of Fire Risk (Tasks 11 and 14)

Specific scenarios that need circuit failure mode likelihood analysis to refine equipment failure mode probabilities are identified by Task 11, Detailed Fire Modeling and Task 14, Quantification of Fire Risk. In general, the number of circuits requiring a failure mode likelihood analysis should be small compared to the total circuit population in the study.

10.4.2 Additional Plant Information Needed to Support this Task

- Component elementary circuit diagrams
- Component cable block diagrams
- Component wiring/connection diagrams
- Instrument loop diagrams and block diagrams
- Cable raceway schedules and routing drawings
- Cable and circuit attribute data:
 - Cable insulating material
 - Cable size and number of conductors
 - Number of normally energized conductors (source conductors) and number of conductors susceptible to failure modes of concern (target conductors)
 - Number of normally grounded conductors
 - Power source characteristics
- Configuration attributes:
 - Type of raceway (i.e., ladder tray or conduit)
 - Quantity and type of other cables contained in the raceway

10.4.3 Walkdowns

Plant walkdowns are not considered a fundamental part of this task. Rather, plant walkdowns should be considered on a case-by-case basis as a way of obtaining/confirming necessary information about cables and/or raceway configurations.

10.4.4 Outputs to Other Tasks

The circuit failure mode probability estimates are used principally as reference information for supporting Task 14, Quantification of Fire Risk. The primary objective is to assign probability values for equipment failure modes of concern and then reevaluate CCDP and CDF for acceptability with respect to compartment and/or scenario screening requirements. Equipment will be screened based on the likelihood of a fire-induced circuit failure causing a component failure mode of concern. The circuit failure probability estimates also serve as inputs to the detailed fire scenario quantification process (Task 11). The results of this task might also be used in Task 12 (Post-fire HRA).

10.5 Procedure

Task 10 performs an analysis of the circuits located within unscreened plant compartments/scenarios to assess the likelihood of specific cable failure modes that could adversely affect the credited functionality of Fire PRA equipment/components. The resulting probability estimates are documented for the various possible cable failure modes induced by fire damage.

Two options for calculating circuit failure mode probabilities are presented. Option #1 is based on the probability estimates resulting from industry fire tests [10.1, 10.3]. This option is best applied to cases where the configuration of interest reasonably conforms to or is bounded by the *Base Case* configurations included in the fire test program [10.1]. Option #2 involves a more rigorous accounting of circuit parameters and will take more effort to implement. Although Option #2 can be used for all cases, it is best suited for configurations that substantially deviate from the Base Case configurations.

The publications listed in Section 10.6 collectively contain the majority of information directly relevant to fire-induced cable failure modes and probability estimates. Analysts are encouraged to become familiar with these documents.

10.5.1 Step 1: Compile and Evaluate Prerequisite Information and Data

This step ensures that prerequisite information and data is available before beginning the circuit failure mode likelihood analyses. Not having the prerequisite information will reduce efficiency and significantly increase the likelihood of rework.

1. Confirm that a detailed circuit failure analysis has been completed and documented for the components of interest.
2. Collect data relevant to important cable and configuration attributes, including:
 - Cable insulation material,
 - Number of conductors in cable,
 - Raceway type or types (if more than one raceway is involved in the scenario),
 - Power source (i.e., CPT, inverter, battery, bus, etc.), and
 - Number of source and target conductors (applicable to Option #2 only).

10.5.2 Step 2: Select Analysis Approach

The first step in conducting the likelihood analysis is to decide which analysis option is best suited for conducting the evaluation.

1. Option #1: Failure Mode Probability Estimate Tables

Option #1 is well suited for configurations representing the surrogate circuits covered by the testing from which the EPRI/NEI failure mode probability estimates were derived. For example, the table of probability estimates would appropriately be used for cables that meet the following criteria:

- The circuit is of a grounded design (including impedance grounded systems with ground fault trip capability),
- The cable is part of the control circuit for a typical component (e.g., non-complex MOVs, SOVs, pumps),
- The cable is associated with a single component,
- The cable configuration is known and can be readily associated with one of the defined configurations in Tables 10-1 through 10-5, and
- The principal hot short failure mode of concern is a spurious operation of the component.

2. Option #2: Computational Probability Estimates

Option #2 is best suited for configurations that notably deviate from the Base Case test circuits [10.1, 10.2]. In particular, cases in which the number of source and target conductors is substantially different than the test samples (i.e., two source conductors and two target conductors within a single cable) are good candidates for Option #2. The probability estimate formulas are recommended for cases where:

- The circuit is ungrounded or is impedance grounded without ground fault trip capability,
- The cable is part of a relatively complex circuit or component,
- The cable is associated with or can influence the behavior of multiple components (e.g., safeguards actuation signal, bus shed scheme, etc.),
- The cable configuration is not easily categorized into one of the defined configurations contained in Table 10-1 through 10-5.

10.5.3 Step 3: Perform Circuit Failure Mode Probability Analyses

This step constitutes the critical element of Task 10. The general criteria listed in Step 2 provide direction on which analysis option is best suited for the case under consideration. In general, Option #1 is recommended whenever possible because it can be applied quickly and consistently. However, in most cases the results tend to be more conservative than those obtained from Option #2.

10.5.3.1 Option #1: Failure Mode Probability Estimate Table

1. Categorize the circuit of interest based on the configuration attributes collected in Step 1.
2. From the appropriate table (Table 10-1 to 10-5), select the probability estimates for the failure modes of concern.

3. If the cable failure mode can occur due to different cable interactions, the probability estimate is taken as the simple sum of both estimates. For example, if a particular thermoset cable failure mode can be induced either by an intra-cable shorting event ($P = 0.30$) or by an inter-cable shorting event ($P = 0.03$; mid-range of 0.01–0.05), the overall probability of that failure mode is estimated to be 0.33.

Table 10-1
Failure Mode Probability Estimates Given Cable Damage
Thermoset Cable with Control Power Transformer (CPT)

Raceway Type	Description of Hot Short	Best Estimate	High Confidence Range
Tray	M/C Intra-cable	0.30	0.10 – 0.50
	1/C Inter-cable	0.20	0.05 – 0.30
	M/C → 1/C Inter-cable	0.10	0.05 – 0.20
	M/C → M/C Inter-cable	0.01 – 0.05	
Conduit	M/C Intra-cable	0.075	0.025 – 0.125
	1/C Inter-cable	0.05	0.0125 – 0.075
	M/C → 1/C Inter-cable	0.025	0.0125 – 0.05
	M/C → M/C Inter-cable	0.005 – 0.01	

M/C: Multi-conductor cable

1/C: Single conductor cable

Intra-cable: An internally generated hot short. The source conductor is part of the cable of interest

Inter-cable: An externally generated hot short. The source conductor is from a separate cable

Table 10-2
Failure Mode Probability Estimates Given Cable Damage
Thermoset Cable without CPT

Raceway Type	Description of Hot Short	Best Estimate	High Confidence Range
Tray	M/C Intra-cable	0.60	0.20 – 1.0
	1/C Inter-cable	0.40	0.1 – 0.60
	M/C → 1/C Inter-cable	0.20	0.1 – 0.40
	M/C → M/C Inter-cable	0.02 – 0.1	
Conduit	M/C Intra-cable	0.15	0.05 – 0.25
	1/C Inter-cable	0.1	0.025 – 0.15
	M/C → 1/C Inter-cable	0.05	0.025 – 0.1
	M/C → M/C Inter-cable	0.01 – 0.02	

Table 10-3
Failure Mode Probability Estimates Given Cable Damage
Thermoplastic Cable with CPT

Raceway Type	Description of Hot Short	Best Estimate	High Confidence Range
Tray	M/C Intra-cable	0.30	0.10 – 0.50
	1/C Inter-cable	0.20	0.05 – 0.30
	M/C → 1/C Inter-cable	0.10	0.05 – 0.20
	M/C → M/C Inter-cable	0.01 – 0.05	
Conduit	M/C Intra-cable	0.075	0.025 – 0.125
	1/C Inter-cable	0.05	0.0125 – 0.075
	M/C → 1/C Inter-cable	0.025	0.0125 – 0.05
	M/C → M/C Inter-cable	0.005 – 0.01	

Table 10-4
Failure Mode Probability Estimates Given Cable Damage
Thermoplastic Cable without CPT

Raceway Type	Description of Hot Short	Best Estimate	High Confidence Range
Tray	M/C Intra-cable	0.60	0.20 – 1.0
	1/C Inter-cable	0.40	0.1 – 0.60
	M/C → 1/C Inter-cable	0.20	0.1 – 0.40
	M/C → M/C Inter-cable	0.02 – 0.1	
Conduit	M/C Intra-cable	0.15	0.05 – 0.25
	1/C Inter-cable	0.1	0.025 – 0.15
	M/C → 1/C Inter-cable	0.05	0.025 – 0.1
	M/C → M/C Inter-cable	0.01 – 0.02	

Table 10-5
Failure Mode Probability Estimates Given Cable Damage
Armored or Shielded Cable

Raceway Type	Description of Hot Short	Best Estimate	High Confidence Range
With CPT	M/C Intra-cable	0.075	0.02 – 0.15
Without CPT	M/C Intra-cable	0.15	0.04 – 0.30

3. When more than one cable can cause the component failure mode of concern, and those cables are within the boundary of influence for the scenario under investigation, the probability estimates associated with all affected cables should be considered when deriving a failure estimate for the component. In general, the probabilities should be combined as an “Exclusive Or” function, as shown:

$$P_{\text{Component failure}} = (P_{\text{Failure Cable A}}) + (P_{\text{Failure Cable B}}) - (P_{\text{Failure Cable A}})(P_{\text{Failure Cable B}})$$

4. Document the circuit failure mode probability estimate in accordance with the methods established during the planning phase.

10.5.3.2 Option #2: Computational Probability Estimates

Application of this calculational method is more complex and is only recommended for cases where Option #1 cannot reasonably be applied. The intent is to give the analyst a means of refining the estimated circuit failure mode probabilities based on the most important characteristics of the cable/circuit under study.

This computational method involves applying circuit failure mode probability estimation formulas. The formulas were reverse engineered from the fire test data [10.1, 10.2] to obtain an overall best fit of the available data. The following discussions provide only the minimum definition of the failure mode likelihood estimation formulas and their terms. For a complete discussion of the technical basis, detailed explanations, and examples of usage, please refer to Appendices J and K.

The probability of occurrence for a specific hot short failure mode (P_{FM}) is estimated by the formula:

$$P_{\text{FM}} = \text{CF} \times P_{\text{CC}}$$

Where:

P_{FM} = The probability that a specific hot short failure mode of interest will occur in a specific circuit given a fire of sufficient intensity to cause cable damage,

P_{CC} = The probability that a conductor-to-conductor short will occur prior to a short-to-ground or short to a grounded conductor, and

CF = A configuration factor applied to P_{CC} to account for the relative number of source conductors and target conductors. Target conductors are those conductors of a circuit that, if contacted by an electrical source of proper magnitude and voltage, will result in abnormal energization of the circuit, component or device of concern. Source conductors represent energized conductors that are a potential source of electrical energy.

1. Calculate P_{CC} as follows:

Cables in trays:
$$P_{CC} = (C_{Tot} - C_G) / [(C_{Tot} - C_G) + (2 \times C_G) + 1]$$

Cables in conduit¹²:
$$P_{CC} = (C_{Tot} - C_G) / [(C_{Tot} - C_G) + (2 \times C_G) + 3]$$

Ungrounded systems:
$$P_{CC} = (C_{Tot} - C_G) / [(C_{Tot} - C_G) + (2 \times C_G)]$$

Where:

C_{Tot} = The total number of conductors in the cable of interest (including spares), and

C_G = The number of grounded (or common) conductors in the cable of interest. The analyst should determine the number of grounded/common conductors based on the circuit configuration (contact positions, etc.) that represent the normal operating state of the component. If this information is unavailable or indeterminate, the worst-case conditions should be assumed.

Note: For ungrounded AC and DC systems, C_G represents the number of return conductors to the power source associated with the circuit of interest (e.g., the negative polarity conductors for an ungrounded 125 VDC circuit)

2. Calculate CF as follows.

Non-armored cables:
$$CF = \{C_T \times [C_S + (0.5 / C_{Tot})]\} / C_{Tot}$$

Armored cables:
$$CF = (C_T \times C_S) / C_{Tot}$$

Where:

C_S = The total number of source conductors in the cable under evaluation,

C_T = The total number of target conductors in the cable¹³, and

C_{Tot} = The total number of conductors in the cable, as before.

Note: CF should be ≤ 1.0 . If the calculated value of CF is greater than 1, then set $CF = 1$. In practical applications it is highly unlikely that the calculated value of CF will ever exceed 1. For this to occur, virtually all conductors in the cable would need to be either a source conductor or target conductor.

Note: The analyst should determine the number of target and source conductors based on the circuit configuration (contact positions, etc.) that represents the normal operating state of the component. If this information is unavailable or indeterminate, the worst-case conditions should be assumed.

¹² Armored and shielded cable should use the equation for conduit.

¹³ Target conductors are only those cable conductors capable of forcing the component or circuit into the undesired state or condition of interest. For example, the target conductors associated with causing a spurious operation of the component will likely differ from target conductors associated with causing a loss of control condition.

3. Calculate P_{FM} as follows:

$$P_{FM} = CF \times P_{CC},$$

where CF and P_{CC} are determined using the formulas discussed above.

4. When more than one cable can cause the component failure mode of concern, and those cables are within the boundary of influence for the scenario under investigation, the probability estimates associated with all affected cables should be considered in deriving a failure estimate for the component. In general, the probabilities should be combined as an “Exclusive Or” function, as shown:

$$P_{\text{Component failure}} = (P_{\text{Failure Cable A}}) + (P_{\text{Failure Cable B}}) - (P_{\text{Failure Cable A}})(P_{\text{Failure Cable B}})$$

5. Document the circuit failure mode probability estimate in accordance with the methods established during the planning phase.

10.5.4 Step 4: Generate Circuit Failure Mode Probability Reports

1. The information collected in the previous steps is entered into the Fire PRA Database, thereby establishing the circuit failure mode probability estimates. When entering the data into the Fire PRA Database, it is important to maintain the established data structure and relationships created for the database system. This will ensure that the essential database sort and query capability is achieved and that data integrity is maintained throughout the iterative process of conducting the evaluation.
2. Once the Fire PRA database is populated with the failure mode probability data, *Circuit Failure Mode Probability Reports* can be generated automatically. The reports are a listing by plant area (compartment, Fire Area, fire zone, etc.) of the probability estimates for the circuit failure modes of concern for the components of interest.

10.6 References

- 10.1 *Characterization of Fire-Induced Circuit Faults – Results of Cable Fire Testing*, December 2002. EPRI Report 1003326.
- 10.2 NUREG/CR-6776, Cable Insulation Resistance Measurements Made During Cable Fire Tests, June 2002.
- 10.3 *Spurious Actuation of Electrical Circuits Due to Cable Fires: Results of an Expert Elicitation*, May 2002. EPRI Report 1006961.
- 10.4 *Circuit Analysis - Failure Mode and Likelihood Analysis*, USNRC, NUREG/CR-6834, September 2003.

11

DETAILED FIRE MODELING (TASK 11)

11.1 Purpose

In the preceding tasks, the analyses were organized around compartments, assuming that a fire would have widespread impact within the compartment. In Task 11, for those compartments found to be potentially risk-significant (i.e., unscreened compartments), a detailed analysis approach is provided. As part of the detailed analysis, fire growth and propagation is modeled and possibility of fire suppression before damage to a specific target set is analyzed.

The detailed fire modeling process generally follows a common step structure, but the details of the analyses often vary depending on the specifics of the postulated fire scenario. This chapter provides separate procedures for three general categories of fire scenarios: fires affecting target sets located inside one compartment (discussed in Section 11.5.1); fires affecting the main control room (MCR; Section 11.5.2); and fires affecting target sets located in more than one fire compartment (multicompartment fire analysis; Section 11.5.3).

Task 11 provides final estimates for the frequency of occurrence of fire scenarios involving a specific fire ignition source failing a predefined target set before fire protection succeeds in protecting the target set. This result is combined in the final quantification steps that follow this task, with the CCDP/CLERP given failure of the target set to estimate the CDF/LERF contribution for each fire scenario. The CCDP/CLERP may include modified human error probabilities based on fire scenario specifics.

11.2 Scope

Detailed fire modeling encompasses an analysis of the physical fire behavior (i.e., fire growth and propagation analysis), equipment damage, fire detection, and fire suppression. The fire scenarios to analyze as part of this detailed analysis task are divided into three categories:

- *General single compartment fire scenarios.* This general category covers fire scenarios damaging target sets located within the same compartment, exclusive of those scenarios within or impacting the MCR. In general, in this category, the fire ignition source is in the same compartment as the target set. The majority of fire scenarios analyzed generally falls into this category. The procedures applicable to the analysis of these fire scenarios are presented in Section 11.5.1.
- *MCR fire scenarios.* This general category covers all fires that occur within the MCR. This category also covers scenarios involving fires in compartments other than the MCR that may force MCR abandonment. The MCR analysis procedures are presented in Section 11.5.2.

- *Multicompartment fire scenarios:* This general category covers all fire scenarios where it is postulated that a fire may spread from one compartment to another and damage target elements in multiple compartments. In this category of scenarios, damaging effects of a fire (e.g., heat) are assumed to spread beyond the compartment of fire origin. The multicompartment fire analysis procedures are presented in Section 11.5.3.

A detailed fire modeling analysis is performed for each fire scenario in each unscreened fire compartment. For many compartments, it may be appropriate to develop several fire scenarios to appropriately represent the range of unscreened fire ignition sources (i.e., scenarios that would not screen out in Task 8) that might contribute to the fire risk. Detailed fire modeling may utilize a range of tools to assess fire growth and damage behavior, and the fire detection and suppression response, for specific fire scenarios.

The ultimate output of Task 11 is a set of fire scenarios, frequency of occurrence of those scenarios, and a list of target sets (in terms of fire PRA components) associated with the scenarios. For scenarios involving the MCR, the possibility of forced abandonment is also noted. Note that a fire scenario represents a specific chain of events starting with ignition of a fire ignition source, propagation of the fire effects to other items, and possibility of damaging a set of items identified as target set before successful fire suppression.

11.3 Background Information

11.3.1 General Task Objectives

Task 11 encompasses the final stages of analysis of the physical fire behaviors associated with fire scenarios in unscreened compartments. A fire scenario in the Fire PRA context begins with initiation of a fire and ends with either safe shutdown of the reactor or a core-damage event. Task 11 is concerned only with the analysis of the physical fire scenario; that is, those aspects of the analysis related to the fire ignition, fire growth, propagation, target set damage, and fire detection and suppression.

In the preceding tasks, the analysis is organized around compartments. The fire initiation frequency, CCDP/CLERP given a fire, and all other parameters assumed that any fire in a compartment would damage all fire PRA components related items in that compartment. In this task, the focus is shifted towards specific fire scenarios within the compartment, and the objective is to estimate their frequencies of occurrence. All fire scenario frequencies can, in general, be represented by the following:

$$\lambda_k = \lambda_{i,k} \cdot W_{g,k} \cdot SF_k \cdot P_{ns,k}$$

where

λ_k = frequency of fire scenario k

$\lambda_{i,k}$ = fire ignition frequency of the ignition source i associated with fire scenario k

$W_{g,k}$ = Floor area ratio for transient fire scenario k. The floor area ratio is 1.0 for fixed ignition source fire scenarios.

SF_k = severity factor of fire scenario k

$P_{ns,k}$ = non-suppression probability of fire scenario k

These parameters are further defined in this task and the appendices addressing specific aspects of detailed fire modeling.

Prior tasks will likely have screened out many fire compartments as low risk contributors (i.e., in Tasks 4 and 7, Qualitative and Quantitative Screening respectively). Furthermore, a number of specific fire ignition sources in the unscreened compartments may be screened out as well (accomplished in Task 8, Scoping Fire Modeling). These screening steps will generally reduce the number of possible fire scenarios considered in this task.

11.3.2 General Approach

In Task 11, the analyst identifies one or more fire scenarios for each unscreened fire ignition source located in the unscreened compartments. The overall analysis process applied to each fire scenario is illustrated in Figure 11-1. A summary description of the steps defined in Figure 11-1 is provided below:

- Step 11.1: Characterize relevant features of the compartment:
 - Identify the fire compartment in which the fire scenario would be postulated (for multiroom scenarios, identify any adjacent compartments assumed to be involved in the fire scenario) and characterize compartment features relevant to fire propagation, target damage and operator actions. For multiple compartment fire scenarios, characterize the boundaries that separate all involved compartments.
 - Define general compartment characteristics of importance (e.g., size, construction, ventilation conditions, and adjacency features, if relevant).
 - Identify and characterize detection and suppression features and systems to be credited in the fire suppression scenario analysis.
- Step 11.2: Identify and characterize fire detection and suppression features of the compartment:
 - Identify fire detection and suppression features such as smoke and heat detectors, continuous fire watch, automatic and manual fixed suppression systems and fire brigade capabilities.
 - Characterize the operation the fire detection and suppression features in the compartment.
- Step 11.3: Identify and characterize fire ignition sources:
 - Identify and characterize fire ignition sources to be analyzed in terms of location within the compartment, type, size, initial intensity, growth behavior, severity/likelihood relationship, etc.
 - Estimate frequency of ignition for the ignition source.
- Step 11.4: Identify and characterize secondary combustibles:
 - Identify and characterize secondary combustibles. These are nearby fixed equipment such as cables that may be damaged by a fire in the selected ignition source. These combustibles will most likely be within the zone of influence of the ignition source.

- Step 11.5: identify and characterize target sets:
 - Identify the target set relevant to each fire ignition source considered in the fire growth and damage analysis. The locations of a target set in relation to the fire ignition source, target types, failure modes, failure criteria, and other relevant information are collected. If target sets will be treated progressively (e.g., progressive failure of one tray after another in a stack of cable trays), identify such progressions and determine which target subsets will be treated as unique sub-scenarios.
 - Identify secondary combustible fuel elements to be considered in the fire growth and damage analysis (locations relative to fire ignition source, material types, configuration, etc.).
- Step 11.6: Define fire scenarios:
 - Once the ignition source, secondary combustibles and targets have been identified and characterized, fire scenarios in the room can be defined. Fire scenarios should include transient and fixed ignition sources.
- Step 11.7: Conduct fire growth and spread analysis:
 - Select the appropriate fire modeling tool(s).
 - Analyze growth behavior of the initial fire source (if applicable).
 - Analyze fire spread (propagation) to secondary combustibles (as applicable).
 - Analyze growth of fire in secondary combustibles (as applicable).
 - Estimate the resulting adverse environmental conditions relevant to the assessment of target set damage (e.g., temperature, heat flux, smoke density).
 - Estimate time to target set damage (probability versus time).
- Step 11.8: Conduct fire detection and suppression analysis:
 - Assess fire detection timing (if applicable, detection triggers manual fire suppression response).
 - Assess timing, reliability, and effectiveness of fixed fire suppression systems (if applicable).
 - Assess manual fire brigade response (if applicable).
 - Estimate probability of fire suppression as a function of time.
 - Calculate conditional non-suppression probability for each ignition source/target set (or target subset) combination.

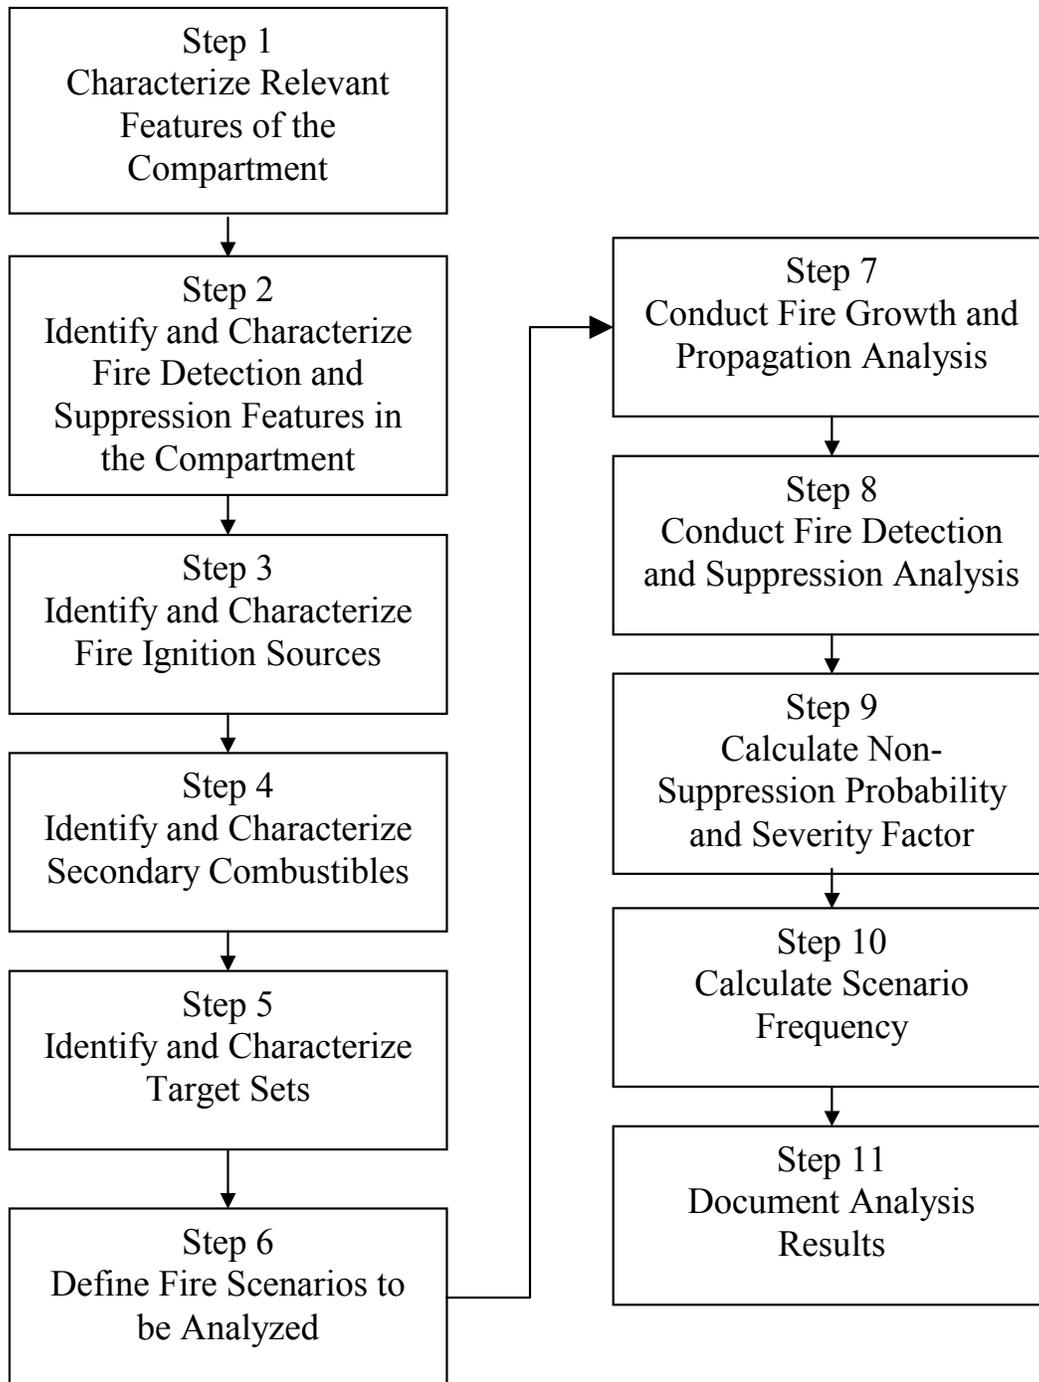


Figure 11-1
General Analysis Flow Chart for Task 11–Detailed Fire Modeling
11.3.4 Fire Growth and Spread Analysis

- Step 11.9: Calculate non-suppression probability and the severity factor:
 - Based on the results of fire growth and spread analysis, and stochastic distributions of various input parameters of the models, the conditional probability of the fire being of the postulated severity level is established.
 - Based on the operation of the detection and suppression fire protection systems in the room, and the calculated time(s) to target damage, non-suppression probability is calculated.
- Step 11.10: Calculate scenario frequency:
 - Using the fire ignition frequency, non-suppression probability, and severity factor of the scenario, the overall scenario occurrence frequency can be established. Additional factors (e.g., probability of control room abandonment) may need to be multiplied to obtain final scenario frequency.
- Step 11.11: Document the analysis results:

In conducting these steps, the analyst may select from a wide range of strategies to minimize the level of effort. Different strategies may be used for different fire scenarios or compartments. The following are a few examples:

- The worst possible fire severity may be assigned to an ignition source while using a severity factor equal to one. Based on this worst-case fire propagation, detection and suppression analysis is conducted and target damage is determined. This strategy may be useful if the CCDP associated with the target set is small.
- Detailed circuit analysis may be conducted before the severity factor and probability of non-suppression are estimated to verify that the postulated failure modes are possible. After target sets are identified, there could be an interaction between that step of this task and Tasks 9 and 10, where detailed circuit analysis is conducted. Under certain conditions or at certain segments of a circuit, some of the postulated failure modes may be impossible. With this strategy, the analyst can reduce the number of target set elements.
- Assuming worst-case circuit failure, the combination of severity factor and probability of non-suppression may be established first. This strategy may be used when the target set elements are far from the ignition source, which means that the severity factor and non-suppression probability may lead to a small fire scenario frequency.

11.3.3 Selecting Fire Ignition Sources

Each fire scenario identified in this task begins with fire ignition involving an ignition source. All fire ignition sources that did not screen out in Task 8 should be addressed in this task. The intent is to capture all fire ignition sources with the potential to contribute to fire risk. This should include fire ignition sources involving both fixed and transient fuel packages. Note that the ignition source also establishes the scenario initiation frequency, i.e., $\lambda_{i,k}$.

In some cases, it may be possible to simultaneously capture the contribution of a number of individual fire ignition sources through the analysis of a single fire scenario. This is possible if the fire conditions, including the relative proximity of other combustible fuels and the target set of interest, are essentially identical for all fire ignition sources in the set, and/or are conservatively bounded by the selected representative case.

As an example, consider a fire compartment where the PRA target set of interest is made of cables routed in cable trays. Further assume that a bank (or row) of electrical panels runs directly below the raceways containing the target cables. In this case, it may not be necessary to model each individual electrical panel as a unique physical fire scenario. Rather, it may be possible to represent the entire row of panels with a single physical fire scenario involving one particular panel as the fire ignition source. It would be appropriate to consider whether or not the all panels serve a similar purpose and contain roughly the same type of components. The relative proximity of the secondary fuels and target set cables to each of the panels should also be considered. Even if these factors vary somewhat across the length of the panel bank, it may still be possible to represent the panel bank using a single physical fire scenario whose assumed characteristics conservatively bound those of the individual panels in the set. This approach might also apply if the exact location of target cables in the compartment is unknown, and conservative assumptions regarding their location are made.

The objective of fire growth and spread analysis is to: (1) establish the possibility of the fire involving the ignition source adversely affecting the target set, and (2) estimate the target set damage time. Detailed fire modeling may consider the fire growth behavior within the initiating fire ignition source; that is, the development of fire within the initiating fuel package. The analysis also considers the potential for the spread of fire to other combustible materials and the subsequent fire behavior. As a result, the analyst should characterize both the initial fire source and those combustible materials to which the fire might spread. Note that in the fire modeling process, the intent is to capture the fire damage potential in the absence of fire suppression activities. Fire suppression likelihood is then captured as an explicit, but separate, step in the analysis process.

A wide range of tools is available for the analyst to conduct fire growth and spread analysis. A brief description of these tools is provided below, as in Section 11.5.1. The tools range from simple empirical equations to computerized, numerical, three-dimensional models. For each fire ignition source, or a collection of sources, a range of fire conditions may be postulated to reflect the uncertainty associated with fire growth and damage. In general, transient fuel fires and each unscreened fixed fire source present in the fire compartment should be considered. Note that, in the most general terms, because of the wide variability in the characteristics of ignition sources, a “typical fire cannot be easily defined.” Each fire has unique features and behaviors. Fire growth and spread are dependent on a range of scenario-specific features, and on random behaviors that occur during fire growth and spread. As a result, two fires involving the exact same fire ignition source may burn quite differently in the context of, for example, fire growth rate, peak fire intensity, and fire duration. The intent of the fire modeling process is to explicitly capture this behavioral uncertainty in the quantification process.

Care should also be exercised when extrapolating fire conditions from events in the fire event database directly to a specific fire scenario. For example, a fire occurring in one particular location in one particular plant might not represent a significant threat of fire spread or damage because of available separation and the lack of a potential fire spread path. However, that same fire occurring in a different location, or at a different plant, might be capable of spreading to other nearby combustibles and/or causing significant damage to plant components and cables. Furthermore, a fire event may not have led to substantial damage in a particular case because of prompt fire suppression intervention. That same fire, had it burned longer, might have caused substantial damage under the same plant conditions.

11.3.4 Severity Factor

Characterizing the fire ignition source will appropriately capture the uncertainty in fire intensity. That is, the fire ignition source characterization will generally include a recognition and characterization of the fire severity-likelihood relationship.

Any given fire ignition source could lead to fires of varying intensity. The variability in fire intensity for a given source results from both epistemic and aleatory uncertainties. For example, fire intensity will be impacted by factors related to the conditions that led to initiation of the fire (e.g. overheating component versus catastrophic failure of the same component). The current state of knowledge regarding the influence of such factors is imperfect at best. Fires are somewhat chaotic in nature, and, therefore, will exhibit a seemingly random variability in development and intensity regardless of the knowledge state.

In the development of the nominal fire ignition frequency values (i.e., Task 6), some concepts of fire severity have already been incorporated. In particular, the process of quantifying the frequencies presented in Task 6 included screening of reported fire events that did not, and could not, lead to a self-sustained or potentially damaging fire (labeled as non-challenging fires in that task). Furthermore, in Task 8, fire ignition sources that cannot damage any items nearby or cannot spread beyond the ignition source (even given that a self-sustaining fire of conservative intensity is ignited) are screened out. Hence, the postulated fires in Task 11 are self-sustaining, and intervention will be necessary to prevent fire spread to secondary fuels and/or cause fire-induced damage to PRA components and/or cables.

Application of severity factors has been a point of debate in past PRA approaches. This is in part because fire severity-likelihood relationships are heavily influenced by expert judgment. Severity factor approaches introduce a number of potential pitfalls. In particular, extreme care is needed to ensure that dependencies between fire severity factors, fire ignition frequencies, assumed fire conditions, and fire detection/suppression analysis are appropriately captured. The recommended fire ignition source characterization approaches have been explicitly integrated with both the fire frequency and fire detection/suppression analysis tasks to ensure a consistent approach.

The fire modeling activities of this Task 11 will consider a range of fire conditions that might be experienced involving the fire sources. That is, the analysis approach is not based on the analysis of only the most likely fire conditions; rather, it provides explicit treatment of less likely, but potentially more challenging, fires.

Table 11-1 lists the recommended methods for calculating severity factors for the different ignition sources in the frequency model.

Table 11-1
Recommended Severity Factors and Suppression Curves for Ignition Sources in the
Frequency Model

ID	Location	Ignition Source	HRR Probability Distribution for Calculation of Severity Factor	Suppression Curve
1	Battery Room	Batteries	Electric motors	Electrical
2	Containment (PWR)	Reactor coolant Pump	Pumps (Electrical)/Oil spills	Containment
3	Containment (PWR)	Transients and hotwork	Transients	Containment
4a	Control Room	Electrical cabinets	Applicable electrical cabinet	Control room
4b	Control Room	Main control board	See Appendix L	See Appendix L
5	Control/Auxiliary/Reactor Building	Cable fires caused by welding and cutting	See Appendix R of this report	Welding
6	Control/Auxiliary/Reactor Building	Transient fires caused by welding and cutting	Transients	Welding
7	Control/Auxiliary/Reactor Building	Transients	Transients	Transients
8	Diesel Generator Room	Diesel generators	Oil spills	Electrical/Oil
9	Plant-Wide Components	Air compressors	Electrical/Oil spills	Electrical/Oil
10	Plant-Wide Components	Battery chargers	Electrical cabinets	Electrical
11	Plant-Wide Components	Cable fires caused by welding and cutting	See Appendix R of this report	Welding
12	Plant-Wide Components	Cable run (Self-ignited cable fires)	See Appendix R of this report	Electrical

**Table 11-1
Recommended Severity Factors and Suppression Curves for Ignition Sources in the
Frequency Model (Continued)**

ID	Location	Ignition Source	HRR Probability Distribution for Calculation of Severity Factor	Suppression Curve
13	Plant-Wide Components	Dryers	Transients	Transients
14	Plant-Wide Components	Electric motors	Electric motors	Electrical
15	Plant-Wide Components	Electrical cabinets	Electrical cabinets	Electrical
16	Plant-Wide Components	High energy arcing faults	See Appendix M of this report	See Appendix M
17	Plant-Wide Components	Hydrogen Tanks	See Appendix N	Flammable gas
18	Plant-Wide Components	Junction box	Electric motors	Electrical
19	Plant-Wide Components	Miscellaneous hydrogen fires	See Appendix N	Flammable gas
20	Plant-Wide Components	Off-gas/H ₂ recombiner (BWR)	See Appendix N	Flammable gas
21	Plant-Wide Components	Pumps	Pump (Electrical)/Oil spills	Electrical/Oil
22	Plant-Wide Components	RPS MG sets	Electric motors	Electrical
23a	Plant-Wide Components	Transformers (Oil filled)	Oil spills	Oil
23b	Plant-Wide Components	Transformers (Dry)	Electric motors	Electrical
24	Plant-Wide Components	Transient fires caused by welding and cutting	Transients	Welding
25	Plant-Wide Components	Transients	Transients	Transients
26	Plant-Wide Components	Ventilation subsystems	Electric motors/Oil spills	Electrical/Oil/ Transients
27	Transformer Yard	Transformer - catastrophic	See section 6.5.6	Outdoor transformers

Table 11-1
Recommended Severity Factors and Suppression Curves for Ignition Sources in the
Frequency Model (Continued)

ID	Location	Ignition Source	HRR Probability Distribution for Calculation of Severity Factor	Suppression Curve
28	Transformer Yard	Transformer - noncatastrophic	See section 6.5.6	Outdoor transformers
29	Transformer Yard	Yard transformers (others)	See section 6.5.6	Outdoor transformers
30	Turbine Building	Boiler	Oil spills	Oil
31	Turbine Building	Cable fires caused by welding and cutting	See Appendix R of this report	Welding
32	Turbine Building	Main feedwater pumps	Pump (Electrical)/Oil spills	Electrical/Oil
33	Turbine Building	T/G excitor	See Appendix O	Turbine generator
34	Turbine Building	T/G hydrogen	See Appendix O	Turbine generator
35	Turbine Building	T/G oil	See Appendix O	Turbine generator
36	Turbine Building	Transient fires caused by welding and cutting	Transients	Welding
37	Turbine Building	Transients	Transients	Transients

11.3.5 Detection and Suppression Analysis

The primary objective of detection and suppression analysis is to estimate the time to fire control. It is assumed that by achieving fire control, the processes that would lead to target set damage slow down significantly so that no further damage would be experienced. The detailed fire-modeling task includes explicit treatment of the detection and suppression process. All fires are eventually suppressed. However, in the Fire PRA context, the critical factor is the likelihood that the fire will be suppressed *before* damage to the fire PRA target set occurs.

The detection and suppression analysis considers intervention by fixed fire protection systems and plant personnel, including the manual fire brigade or on-site fire department. Current modeling tools provide only a very limited capability for directly integrating fire detection and suppression. For example, some compartment fire models now allow for the simulation of a fire detector or a sprinkler head as a thermal target, and can, therefore, predict the approximate actuation time of such devices. Closed-form empirical correlations can also estimate detector or sprinkler response times. However, these capabilities address only a limited subset of the overall detection and suppression processes.

In general, the detection and suppression analysis is performed independently from the fire growth and damage modeling applications. However, the assumptions made in the development of fire scenarios can be relevant to the fire detection and suppression analysis. In particular, there are dependencies between screening of fire events in the fire frequency analysis, the fire

severity-likelihood relationship, the fire ignition source characteristics assumed in the fire modeling, and the detection-suppression analysis. These dependencies should be explicitly treated.

Appendix P describes detection and suppression analysis methodology. The analyst may choose a different approach, as long as it can properly model the likelihood of target set damage before successful suppression.

Results from the detection and suppression analysis are reflected in the probability of no suppression before target damage. Table 11-1 lists the manual suppression probability curves for the different ignition sources in the frequency model.

11.3.6 Assumptions

The following are key assumptions associated with the detailed fire-modeling task.

- The analysis is limited to considering a single fire occurring at any given time. The analysis does not consider the possibility of multiple, concurrent fires. Notice that a scenario involving fire propagation to adjacent compartments is still considered a “single fire”. The risk of such scenario is evaluated in the multi-compartment fire analysis.
- The analysis does not explicitly try to quantify the risk contribution of seismic-induced fires. Hence, the conditions that may be encountered during a post-earthquake fire are not considered in the discussions provided for fire modeling.
- If a fixed, water-based fire suppression system is available, actuation of that system is assumed to disrupt the process of fire growth and spread sufficient to achieve and maintain effective control of the fire so that additional damage to potential fire PRA targets will not occur.
- If a fixed, gaseous fire suppression system is available, actuation of that system is assumed to disrupt the process of fire growth and spread sufficient to achieve effective control of the fire. However, the duration of control is assumed to be the time period over which it has been demonstrated, by test or analysis, that a sufficient suppressant concentration, per applicable standards, can be maintained. If the suppressant concentration cannot be maintained for the prescribed sufficient time period, it should be assumed that the fire would reflash. In such cases, either a second discharge of the fire suppression system (if available) or intervention by plant personnel would be necessary to regain effective control of the fire.
- Core damage would occur if the control room operators are unable to use the main control board and no actions are taken from outside the control room.

11.3.7 Additional Supporting Documentation

Additional instructions on the definition and characterization of physical fire scenarios is provided in the appendices as identified in Table 11-2.

Table 11-2
Appendices Providing Additional Instructions on Technical Issues in Selecting, Characterizing, and Analyzing Physical Fire Scenarios

Appendix G	Heat release rates
Appendix H	Damage criteria
Appendix L	Main control board fires
Appendix M	High Energy Arcing Faults
Appendix N	Hydrogen fires
Appendix O	Turbine generator fires
Appendix P	Detection and suppression analysis
Appendix Q	Passive fire protection features
Appendix R	Cable fires
Appendix S	Fire propagation to adjacent cabinets
Appendix T	Smoke damage

11.4 Task Interfaces

11.4.1 Input From Other Tasks

The inputs to this task are a list of unscreened fire compartments (Task 7B, Quantitative Screening II) and fixed ignition sources in their respective locations generated in Task 8, Scoping Fire Modeling. In addition, information on all fire PRA components and cables that have been mapped into each unscreened fire compartment is used in this task. This information is derived during Tasks 2 through 4. This task will also draw on fire compartment characterization information documented in the fire PRA information database from Task 4. This task is also supported by plant walkdowns, as discussed in Support Task A.

In addition, the analyst conducting this task may need to interact with the analysts conducting Task 7 to establish the CCDP/CLERP associated with a specific target set and with the analysts for Tasks 10 and 11 for assessing the possibility of certain circuit failures.

11.4.2 Additional Plant Information Needed to Support this Task

The detailed fire modeling task utilizes information from a wide range of internal (i.e., plant) and external sources. Much of this information is summarized in Appendices G through T. For example, the analyst may need raceway and equipment layout drawings, various operating procedures, fire protection system description and related procedures, HVAC system descriptions, etc. Focused walkdowns of the unscreened compartments are an important part of the information gathering process. Focused walkdowns allow information gathering on site-specific configuration, especially with respect to the physical proximity of fire ignition sources

to other combustible materials and to fire PRA components and cables. In addition to focused walkdowns and detailed document review, it may be necessary to obtain information about actual fire event experience and fire experiments from external sources.

11.4.3 Walkdowns

This task, as it is noted in the preceding section, typically includes a focused walkdown of the plant. For the single compartment fire analysis, the unscreened compartments should be visited to gather information supporting the processes of selection and description of fire scenarios. The information needed for detailed fire modeling is best obtained through walkdowns of the compartments of interest.

For the MCR fire analysis, a walkdown would also be beneficial. Specifically, it is recommended for the analyst to inspect the backside of the control panels to gain an understanding of the wiring conditions, cable and wiring layout, separation barriers between panel sections, and overall density of the combustibles inside the panels.

The multicompartment fire analysis includes a complete walkdown of all plant locations where Fire PRA related components and cables might be present. In that walkdown, the analyst should identify the communication paths between compartments, the condition of the doors, penetration seals, ventilation openings, and any other features that may aid the propagation of hot gases between compartments.

The walkdown process is discussed in Support Task A, Fire PRA Walkdown Procedure.

11.4.4 Outputs to Other Tasks

The primary output of the detailed fire modeling task is a list of fire scenarios for each unscreened compartment; frequency of occurrence of each fire scenario; and a list of PRA components and associated failure modes. These results are carried forward into the final stages of quantitative screening (i.e., Tasks 13 and 15) and into the final risk quantification and uncertainty analysis task steps (i.e., Tasks 17 and 18).

In the course of conducting Task 11 steps, as shown in Figure 11-1, it may become necessary to interact with the detailed circuit analysis tasks (i.e., Tasks 9 and 10) and with the quantitative screening task (i.e., Task 7).

11.5 Procedure

Separate procedures are described below for the three general categories of fire scenarios:

1. Fires affecting target sets located inside one compartment,
2. Fires affecting the MCR,
3. Fires affecting target sets located in more than one fire compartment (multicompartment fire analysis).

11.5.1 Single Compartment Fire Scenarios

The procedure described in this section applies to the analysis of those physical fire scenarios that impact target sets located within a single compartment, exclusive of those fire scenarios impacting the MCR. Note that the steps applied to these types of scenarios are distinguished from others by an 'a' following the step identification number. Corresponding tasks associated with fire scenarios impacting the MCR and fire scenarios impacting multiple fire compartments will be designated with a trailing 'b' or 'c', respectively (see Section 11.5.2 and 11.5.3). The following steps and sub-steps are recommended for single compartment fire analysis.

Step 1.a: Identify and characterize compartment

Step 2.a: Identify and characterize fire detection and suppression features and systems

Step 3.a: Characterize fire ignition sources

Step 4.a: Identify secondary combustibles

Step 5.a: Identify and characterize target sets

Step 6.a: Define the fire scenarios to be analyzed

Step 7.a: Conduct Fire Growth and Propagation Analysis

Step 7.a.1: Selection of fire modeling tools

Step 7.a.2: Analyze growth behavior of the initial fire source (if applicable).

Step 7.a.3: Analyze fire spread to secondary combustibles (as applicable).

Step 7.a.4: Analyze growth of fire in secondary combustibles (as applicable).

Step 7.a.5: Estimate the resulting adverse environmental conditions

Step 7.a.6: Estimate time to target set damage

Step 8.a: Conduct fire detection and suppression analysis

Step 8.a.1: Assess fire detection timing

Step 8.a.2: Assess timing, reliability and effectiveness of fixed fire suppression systems

Step 8.a.3: Assess manual fire brigade response

Step 8.a.4: Estimate probability of fire suppression as a function of time

Step 9.a: Calculate conditional non-suppression probability and severity factor

Step 10.a: Calculate scenario frequency

Step 11.a: Document analysis results

Each step is discussed below in some detail. Note that in the conduct of the fire analysis, various analysis tasks may be performed during a single consolidated modeling activity. For example, Steps 7.a.2 through 7.a.6 are often included within the scope of a single consolidated compartment fire model. In such cases, separate analyses are not performed to address each individual step, as outlined below. However, the objectives established in these individual tasks should still be met.

11.5.1.1 Step 1.a: Identify and Characterize Compartment

The purpose of this step is to understand the specific features and related fire protection systems in the compartment of interest. To ensure consistency across all tasks, the compartments in which the fire is assumed to occur should be identified consistent with the Fire PRA Plant Partitioning under Task 1.

At this point, the following general information about each compartment may be collected:

- Compartment height, length, and width;
- Wall construction type and thickness;
- General information about compartment ventilation (e.g., forced ventilation or open doorways);
- Ceiling soffit or beam pocket features relevant to fire environment development (e.g., hot gas layer build up, ceiling jet behaviors, and detection/suppression response).

11.5.1.2 Step 2.a: Identify and Characterize Fire Detection and Suppression Features and Systems

In this step, the analyst characterizes the detection and suppression features and systems that will be credited when analyzing the fire scenarios. This may include any and all means of detection and suppression available for the compartment. Specific factors that should be documented depend to some extent on the type of feature or system being credited.

- For *fixed fire detection systems*, the type of fire detector should be identified (e.g., ionization smoke, photoelectric smoke, threshold heat detector, rate of rise heat detector, flame or flash detector, incipient fire detection system, Protectowire® or other similar features). Where appropriate (e.g., for heat detectors), a time constant or specific actuation set point may be established based on the characteristics of the specific device installed. Any relevant installation features should also be described (e.g., spacing, extent of coverage, mounting of detectors on a pendant-type structure below ceiling level, and features like beam pocketing and obstructions that may impact actuation) as related to the specific fire ignition source scenario being analyzed. The location where detection signals are sent should also be identified. Deviations between the as-installed system and the applicable code of record should be noted.
- For *fixed water-based fire suppression systems*, the type of sprinkler or spray heads used should be identified (e.g., open head deluge, closed fusible link sprinklers, fast action sprinklers, direct spray nozzles, etc). For fusible link sprinklers, the actuation set point and time constant should be established. Any specific requirements for system actuation should also be described (e.g., a preaction system that requires actuation of a cross-zoned fire detection system). Any relevant installation features should also be described (e.g., spacing, extent of coverage, use of drop pendants that place sprinkler heads substantially below ceiling level, and features like beam pocketing and obstructions that may impact actuation or effectiveness) as related to the specific fire ignition source scenario being analyzed. Deviations between the as-installed system and the applicable code of record should be noted.

- For *fixed gaseous fire suppression systems*, identify the type of fire extinguishing agent applied. The available quantity of suppressant should be determined. The design concentration of the suppressant should be specified. The logical/conditional requirements that initiate actuation of the system should be established and described. If the system has sufficient inventory for multiple discharges, the number and plant-specific basis for initiating a second (or third) discharge of the system should be described. For gaseous systems, the ability to maintain an adequate concentration of suppressant for an adequate soak period is necessary to ensure extinction of the fire. The available suppressant confinement time at the design concentration should be determined (either by test or analysis consistent with general system design practice).
- For the analysis of *manual detection* by plant personnel, the analyst should establish the extent to which personnel enter or occupy the compartment. For example, the space may be continuously manned; represent a regular passage route for personnel moving through the plant; occasionally occupied; subject to periodic security sweeps; or subject to a continuous or roving fire watch. These features will be used to determine the likelihood of manual fire detection.
- The *on-site manual fire brigade or fire department* can be credited for fire suppression in virtually all areas of the plant. However, the assessment of brigade response should consider accessibility of the compartment to fire fighters. Hence, fire brigade accessibility should be characterized for each compartment. The characterization may be defined by such features of a compartment as distance from main parts of the plant, radiation level, contamination level, and special access means (e.g., ladders and scaffolding). A review of plant training records may be appropriate to determine what the anticipated response time is to the compartment of interest. In this regard, the critical factor is the time necessary to initiate effective firefighting activities, not simply the response time for the first member of the fire brigade. Hence, the assessment should also consider plant practices regarding brigade response. For example, the plant may adhere to “two-in, two-out” response procedure. It is also appropriate to establish that proper fire fighting equipment will be available to support the brigade upon arrival at the compartment.

As evident from this list, the analyst should understand general fire detection and suppression strategies for the compartment. For the most part, fire suppression strategies in nuclear power plants include the use of fixed systems (manual or automatic) and the fire brigade. Fixed gaseous suppression systems require the rooms to be unmanned and closed for a specific period of time after discharge for effectiveness and life-safety reasons. Manually actuated gaseous systems may require fire brigade members to perform a visual inspection of the room before actuating the system. Answers to the following questions may help the analyst determine which fire protection feature can be credited at a specific point in time.

7. What happens immediately after detection? Usually the control room dispatches an operator to the room for verification of the alarm signal. The operator then reports back to the Control Room and the fire brigade is dispatched.
8. Will the fire brigade start manual suppression activities immediately upon arrival or actuate a manual fixed suppression system? This question may not have a single answer, since it may depend on the nature of the fire. Small fires are likely to be suppressed immediately with portable fire extinguishers.

9. Who authorizes the actuation of fixed suppression systems? How long does it take to obtain authorization? Will the fire brigade initiate suppression activities while authorization is obtained? These questions apply, for the most part, to rooms equipped with CO₂ systems where life safety in continuously manned adjacent rooms is a concern.

In addition, if a fixed, water-based suppression system is provided for the compartment or a water hose reel is available for the firefighters, it is appropriate to investigate the following so that when defining scenarios, a complete chain of events is considered.

- Verify that potentially vulnerable components are shielded from fire suppression water sprays. Where water from fire suppression efforts will likely enter a potentially vulnerable component (e.g., a panel with unsealed penetrations or an unshielded electrical motor), it is appropriate to include that component in the fire scenario damage set.
- Verify that adequate drainage has been provided to support firefighting activities and to prevent flooding of components.
- Verify that penetrations through the floor of a fire compartment under analysis are sealed to prevent water from firefighting activities from migrating into the compartment below. The presence of unsealed penetrations may indicate the need for analysis of a corresponding multiroom fire scenario.

11.5.1.3 Step 3.a: Characterize Fire Ignition Sources

This step characterizes the ignition sources of the compartment. The final product of this step is a list of ignition sources, their relevant characteristics (e.g., type, quantity, dimensions, and heat release rate profile), and fire ignition frequencies associated with each source.

List the ignition sources in the compartment and highlight their location on equipment layout drawings. Do not include ignition sources screened in Task 8. Transient combustibles should also be identified in this step. Areas of the compartment where transient combustibles could be found may be marked on the layout drawings. It is important to identify the characteristics of each ignition source in terms of such parameters as type, quantity, dimensions, location, normal operating temperature, etc. It is also important to fire propagation analysis to establish the heat release rate profile of the ignition source. Appendix G provides the heat release rates of several combustibles and equipment items typically found in a nuclear power plant.

In some cases, it may be more efficient to identify the target sets (Step 5.a, below) than the ignition sources. This is especially true for compartments with a small number of targets and a considerably higher number of ignition sources. Turbine Buildings are an example of such compartments.

Represent fires in any one of a bank of electrical panels by modeling fires involving one specific electrical panel in the bank. In this example, it would be appropriate to consider the relative proximity of the targets to the selected panel, compared to their proximity to the other panels in the bank. Similarly, it would be appropriate to ensure that the potential for fire spread from the selected panel to secondary combustibles (e.g., overhead raceways) bounds the potential fire spread should the fire occur in another panel.

The ignition source characterization will vary somewhat, depending on the nature of the ignition source.

- Oil or liquid spill fires are characterized by the material spilled, the quantity of material, and the surface area of the spill. The heat release rate and duration of the fire follow directly based on these factors.
- Transient fuel materials are characterized by the type and quantity of material, its assumed location in the room, and the assumed peak fire intensity.
- General fires involving electrical panels are characterized by the peak fire intensity anticipated and the anticipated burn duration. In some cases (e.g., the main control board), the assumed extent of potential fire spread may also be a limiting factor.
- Fire ignition source scenarios intended to capture energetic electrical faults in electrical components are characterized by an initial radius of mechanical and/or thermal damage, the potential breaching of containing structures (e.g., a panel), the ignition of combustibles within a predefined radius of the failed component, and the intensity of the ensuing fire (which is assumed to be fully developed with no period of fire growth within the fire ignition source itself).
- Oil or flammable liquid spray fires (i.e., fires resulting from a leak in a pressurized flammable liquid line) are characterized by the leak rate of the flammable liquid and the length of the fuel jet. The total inventory of flammable liquid in the system may also be a limiting factor.

As part of this step, the frequency of fire ignition is estimated. Frequency of fire occurrence involving the specific ignition source can be estimated using the approach recommended in Task 6.

11.5.1.4 Step 4.a: Identify Secondary Combustibles

Secondary combustible fuel elements that may become involved in the fire should be identified. Secondary fuels may include, for example, overhead raceways, cable air-drops, stored materials, electrical panels, construction materials, etc. The information provided should describe the relative proximity of the secondary combustibles to the fire ignition source and a general configuration of the secondary combustible. For example, if cables are present as a secondary fuel, it is appropriate to identify the following features of those cables: vertical cable trays vs. horizontal cable trays; existence of vertical air drops proximate to the fire ignition source; raceway stacking arrangements; raceway fill levels; total quantity of combustible materials present; cable type if known; distance (horizontal and/or vertical) between the cables; and the ignition source, etc.

The identification of secondary combustibles should include cascading fire spread. For example, in many cases, the fire in the initial ignition source fuel package may ignite one package of secondary fuels, which in turn ignites other secondary fuel packages, and so on. A common case would be a panel fire that ignites the first of a stack of trays overhead. The fire involving the combination of the panel and first tray may then ignite the second tray in the stack. The fire may then progress to additional fuel packages.

11.5.1.5 Step 5.a: Identify and Characterize Target Sets

This step identifies the various target sets that exist within a compartment for which fire damage scenarios will be postulated. Each target set should be a subset of the fire PRA components and circuits (i.e., cables) present in the compartment. The fire PRA components and circuits of the compartment should be reviewed and their locations identified on the equipment layout drawings. The raceways where fire PRA component-related circuits (i.e., power, control and instrumentation cables) are located should be specifically identified in relation to the ignition sources and secondary combustibles in the compartment.

Select subgroups of fire PRA components and related raceways may, based on conservative judgment, be exposed to a fire from a specific ignition source and secondary combustible combinations. The location of each subgroup is important. All members of each subgroup should be located within a well-defined volume above the ignition source. All fire PRA component-related items within the volume should be members of the subgroup. There should be no fire PRA component-related items between the volume and postulated ignition sources.

The subgroups are target sets within the compartment that a fire may cause risk significant damage. Identify these subgroups (target sets) on the equipment layout drawings to facilitate the fire scenario identification process discussed in later steps of this task.

Some recommendations statements about identifying the target sets within a compartment are provided below:

1. The subgroups of fire PRA components can be identified by examining the associated CCDP/CLERP. Those subgroups with very small CCDP/CLERP may be ignored as insignificant contributors to fire risk.
2. Interactions with the PRA and fire-modeling analyst should indicate if further work is necessary in describing the target sets. For example, in some cases, it is sufficient to know the location of a cable at a stack level. Other scenarios may require knowledge of the specific tray within a stack where the cable is located.
3. Interactions with the circuit analyst may be helpful in determining the importance of spurious actuations in determining the target sets. That is, target sets may not consist only of direct fire damage to equipment from more than one division. The analyst should determine if damage to cables from one division could cause spurious actuations that would render the other division unavailable. For example, a Division A valve may be located in a Division B flow path. If the Division A valve spuriously actuates, the flow path for Division B is unavailable.
4. Interactions with the circuit analysts may help in determining failure modes due to fire. That is, fire damage to cables may not mean failure of the equipment in the worst position, depending on the electrical circuit design and the progression of equipment damaged by the fire.

In the event that the physical locations of the targets within a compartment are poorly known, it is appropriate to justify the locations assumed in the analysis.

1. In some compartments, it may be impossible to verify, with reasonable confidence, whether or not the cables associated with a particular item on the Fire PRA Component List are located in the compartment of interest. In such cases, it is appropriate to assume that such cables are subject to fire-induced damage given fires in the compartment. The scenario description should also include the bases for assuming that the specific circuits (i.e., cables) are located in the compartment.
2. In some cases, the presence of a cable (or cables) in a compartment may be assumed, but not verified. In such cases, it is appropriate to make this distinction, and to explain the rationale for assigning an assumed location to that cable.
3. In some cases, it may be known that a particular cable passes through a compartment, but its specific location in the room may be unknown. In such cases, it is appropriate to make this distinction and explain the rationale for assigning an assumed location for that cable.

In addition to identifying the items that comprise the target sets and their locations, it is necessary to characterize the failure processes of each element. The characteristics of interest are the failure mechanism of interest (e.g., thermal damage, smoke, water spray, etc.) and the damage threshold or criteria (e.g., a failure temperature, etc.). In lieu of characterizing each individual target element, the analyst may select a single set of target characteristics to represent all elements of the target set. In this case, the selected characteristics should be based on the target element most vulnerable to failure given a particular failure mechanism.

11.5.1.6 Step 6.a: Define the Fire Scenarios to be Analyzed

The objective of this step is to define the fire scenarios that will be analyzed in this task. In order to define a scenario, the analyst should start with an ignition source, postulate potential growth and propagation to other combustibles, and damage to the closest target set that may be exposed to the specific fire. The process should be repeated for the next closest target set until all relevant target sets are exhausted for the same ignition source. Another ignition source is then selected and the process repeated until all target sets and ignition sources are considered. This process should yield all potential fire scenarios that may damage the various target sets identified in the preceding steps.

As part of the ignition source selection process, it may be necessary to identify the specific location or point within the ignition source fuel package assumed as the point of fire origin. For example, in the case of a bus-bar, ignition may occur at any one point along the length of the bus-bar. The ignition frequency may have to be adjusted to account for the specific ignition location.

If characterization of the fire ignition source will depend on specific features associated with the assumed fire ignition mechanism, these features should also be identified. For example, self-ignited cable fire or overheating component, for example, would generally involve fires that begin relatively small and grow over some period of time. In contrast, catastrophic failure of a high-energy electrical component, ignition of a flammable liquid pool or spray fire, or ignition of a combustible gas would indicate a fire that would almost instantaneously become a fully developed fire.

The list of postulated fire scenarios should include those involving fixed and transient ignition sources. The location of transient ignition sources within the room usually requires judgment. These ignition sources should be located near areas of the room where critical targets are located, including “pinch-points” where targets from two different safety divisions can be damaged by the same fire.

11.5.1.7 Step 7.a: Conduct Fire Growth and Propagation Analysis:

As a first step, the analyst should determine if the compartment effects are relevant. That is, the analyst should determine if the fire modeling analysis could be completed using simplified correlations that do not explicitly account for compartment feedback effects on the fire environment. Such feedback effects may result from impingement of a flame zone on compartment boundaries, development of a thermally significant hot gas layer, and potential concerns related to build up of a smoke layer (e.g., depth and density). If the compartment feedback effects are determined to be important, the more appropriate modeling approach is a consolidated compartment fire model.

In general, if all the items in the target set are located in the flame zone, directly in the fire plume or ceiling jet, or if the dominant mode of target exposure is direct flame-to-target thermal irradiation, full consideration of the compartment effects may not be necessary. Note that considering some aspects of the compartment geometry may still be necessary. For example, calculating a ceiling jet requires knowledge of the ceiling height. Compartment characteristics should be gathered commensurate with the needs of the fire modeling. If a determination is made that the use of simplified modeling tools is appropriate (e.g., hand calculations using closed-form solutions), it is appropriate to document the basis for this determination.

On the other hand, a full compartment definition is necessary if the scenario involves the need to consider hot gas layer temperatures, hot gas layer depth, wall temperatures (or wall losses), heat exchanges between different surfaces, and both natural and mechanical ventilation effects on fire-generated conditions. In such cases, the compartment should be defined with a more complete level of detail, again, commensurate with the model applied to the analysis.

11.5.1.7.1 Step 7.a.1: Selection of Fire Modeling Tools

The analyst should determine which fire modeling tool(s) will be applied in the analysis of the fire growth and spread for the physical fire scenario. There are many fire modeling tools that might be applied and each has its own distinct advantages, disadvantages, and limitations. This procedure is not intended to serve as a reference for the selection and/or evaluation of fire modeling tools. Nor is it the intent of this procedure to either exclude or endorse any one or more particular fire modeling tools. It is the responsibility of the analyst to select tools that are appropriate to the intended application.

The selection of fire modeling tools should consider the specific application being supported. For example, if the fire scenario involves the potential for spread to secondary combustibles, the tool should provide a mechanism for assessing the timing of secondary ignitions, the subsequent development of the fire in the secondary fuel package or packages (e.g., subsequent spread of the fire to additional secondary fuels), and the impact of the composite fire (involving both the fire ignition source and ignited secondary combustibles) on the exposure environment relative to the target set.

In the broadest context, fire models include any one of a wide range of tools used to characterize and analyze fire scenarios. Non-computational tools may include the following:

- **Rules of thumb.** Rules of thumb represent trade or field practices applied in a course evaluation of an engineering situation. In general, rules of thumb are undocumented and lack a strong technical basis. Hence, they are inappropriate for application in a Fire PRA. In Fire PRA, the applied fire modeling tools, assumptions, and data should be traceable to one or more published documents.
- **Empirical rule sets:** In some cases fire scenarios may be analyzed on the basis of empirically derived rule sets. Such rule sets generally consider operating experience, experimental data, and expert judgment. The application of rule sets in lieu of a computational fire model with an appropriate verification and validation (V&V) basis is recommended only where computational fire models do not provide the required analysis capability. Empirical rule sets described in this report include high energy arcing faults (HEAF), fire spread between cable trays, catastrophic loss of the turbine generator set, catastrophic hydrogen fires such as those in BWR hydrogen recombiners or hydrogen tanks, fire spread between electrical cabinets, smoke damage, aspects of the multi-compartment fire analysis, and the seismic/fire interaction analysis. The main control board (MCB) fire model described in Appendix L, while expressed in a statistical context, also displays many of the characteristics of an empirical rule set and is not a true computational fire model.

In a more limited context, the term ‘fire model’ is often associated with computational fire modeling tools. Computational fire models may include the following:

- **Closed-form empirical correlations.** Fire protection texts and handbooks provide a range of closed-form empirical correlations that may be applicable to the analysis of relatively simplistic fire growth and spread scenarios. For example, such correlations can be applied to the analysis of flame zone, radiant heat flux levels, plume temperature, ceiling jet temperature, detector response timing, and even hot gas layer response behaviors. However, such tools will typically exceed their limits of validity in more complex fire configurations. For example, if secondary combustible fuel packages ignite, or if room feedback effects become important, the simple closed form empirical correlations will typically fail.
- **Zone-type compartment fire models.** A range of zone-type compartment fire models are available both in the public and private domain. Zone models vary in their capabilities and limitations, but typically have common features and capabilities in many regards. Zone models are generally applicable to relatively simple fire/compartment configurations. They cannot, for example, explicitly address the impact of an L-shaped room versus a rectilinear room on fire development. Some models may also have difficulty dealing with multiple fire sources. The ability to predict target response (e.g., secondary ignitions and/or the response of a target) also varies. In general, zone models are commonly applied to the analysis of NPP fire scenarios in Fire PRAs.
- **CFD models:** A number of CFD models exist in both the public and private domain. CFD models represent the current pinnacle of fire model development efforts worldwide. They provide detailed information on fire conditions that includes spatial distributions of environmental parameters and effects. Currently, most CFD models provide only crude tools for the modeling of the fire itself. For example, the user needs to specify the rate of release of fire products in many CFD models (e.g., heat, smoke, products of combustion, etc.). CFD models also demand a high level of technical expertise.

11.5.1.7.2 Step 7.a.2: Analyze Growth Behavior of the Initial Fire Source (If Applicable)

This step is applicable where the initial fire ignition source is assumed to follow a fire growth profile based on a fire modeling application. In many cases, the fire ignition source will either be assumed to follow a prescribed growth profile, or to display constant fire intensity. In such cases, this step is not necessary.

If the fire growth profile is based on fire modeling results, the analysis is performed using the selected fire modeling tool. The results should be documented and reviewed for consistency with anticipated behavior. Note that the analysis should assess the impact of parameter uncertainty on the model predictions. Sensitivity studies to assess the importance of the critical modeling parameters may also be appropriate.

11.5.1.7.3 Step 7.a.3: Analyze Fire Spread to Secondary Combustibles (As Applicable)

It is important that the fire modeling analysis appropriately consider that a secondary combustible might ignite given a fire in the assumed fire ignition source. In some cases, it may be determined that a fire ignition source cannot ignite secondary combustibles. However, such a determination should include consideration of the uncertainty associated with the intensity of the fire ignition source. For example, in many cases, secondary fuels may ignite only if the intensity of the fire ignition source is relatively high. This factor will be explicitly accounted for in assessment of the severity/likelihood relationship for the fire ignition source.

In cases where, despite conservative assessments of fire severity, the ignition source is determined not to ignite secondary combustibles, it may also be appropriate to explore the margin between the worst-case fire conditions modeled in the analysis and the fire conditions that would lead to fire spread. This would, for example, be appropriate in the context of defining a limiting fire scenario under NFPA 805. If the margin between these cases is not large, some additional consideration should be given to the potential that the limiting fire conditions might be reached in practice (e.g., it may be appropriate to extend the severity/likelihood relationship to explicitly encompass the limiting fire conditions).

In this step, the analyst quantifies the fire ignition and spread properties associated with secondary combustible fuel elements. The analysis also identifies physical features that could substantially alter the fire spread behavior.

- In the case of cables, it is appropriate to establish piloted and non-piloted ignition thresholds. Piloted refers to ignition of a material in the presence of an external flame. In contrast, non-piloted refers to ignition of a material if no external flame is present. If the fire model being applied does not explicitly address cable fire spread, an approach for estimating fire spread rates should also be considered (see Appendix R for specific examples).
- Passive fire protection features that might prevent ignition of secondary combustible elements or limit flame propagation should be documented. Examples are fire breaks (e.g., spatial separation or a fire barrier installed within open raceways), solid-bottom trays or tray bottoms, tray covers, mastic coatings, and fire wraps. Other passive plant features that could prevent ignition and/or reduce the likelihood of fire spread could include HVAC ducts, internal compartment partitions, and radiant barriers or heat shields.

- In the case of electrical panels, the panel ventilation configuration and the latching configuration of the doors is important. If the panel contains open vents, either at the top or bottom of the pane, or if penetrations into the top or sides of the panel are not fire-sealed, fires can be assumed to be capable of spreading out of the panel to secondary combustibles. However, for unvented cabinets, fire spread may be less likely. Fire spread out of the panel may still occur, unless the panel doors are attached and anchored at multiple points. Simple twist-handle style top-and-bottom door latches are not sufficient to contain a fire within a panel. Substantial warping of the door face may occur due to the heat of the fire. This can allow gaps to open in an otherwise unvented panel. In contrast, fire spread is not considered likely given a weather-tight or waterproof cabinet construction where multiple mechanical fasteners secure panel access plates and where all penetrations into the panel are sealed.
- Flammable liquids stored in listed flammable liquid storage lockers are considered to be properly protected and can be assumed to be unaffected by an exposing fire. While such storage lockers may be relevant to the seismic-fire interaction analysis if not anchored, they are not considered in the development of fire scenarios in the general fire PRA risk quantification analysis.

11.5.1.7.4 Step 7.a.4: Analyze Growth of Fire in Secondary Combustibles (As Applicable)

It is important that the fire growth and propagation analysis consider the potential for cascading fire growth and spread. That is, given the ignition of one secondary fuel package, the effects of this secondary fire, in combination with the fire ignition source, on subsequent fire growth and spread should be examined. The ignition of additional combustible fuel packages as a result of the combined fire should also be considered.

11.5.1.7.5 Step 7.a.5: Estimate the Resulting Adverse Environmental Conditions

In this step, the analyst estimates the environmental conditions created by the composite fire scenario (the fire ignition source plus any and all ignited secondary combustible fuel packages). The fire environmental effect should be predicted consistent with the failure modes and thresholds of interest established in Step 5.a. Typically, the hot gas layer temperature profile, smoke density (if needed for assessing scenario impact on plant personnel), and room ambient temperature are evaluated.

11.5.1.7.6 Step 7.a.6: Estimate Time to Target Set Damage

In this sub-step, given the fire and environmental conditions estimated in the preceding sub-steps, the time-to-target set damage is estimated. The time-to-target set damage is defined as the time between fire ignition and damage to the last element of the target set. The fire damage analysis should consider, as a minimum, damage due to thermal exposures. In particular, the damage analysis should consider both temperature exposure (e.g., exposure of targets in the flame zone, fire plume, ceiling jet, and hot gas layer) and radiant heating exposures (e.g., radiant heating from direct exchange with the flame zone, or radiant heating from a hot gas layer to a target below the upper/lower layer interface level).

- Electrical cable damage is typically based on the exposure temperature (i.e., the temperature of the environment surrounding the cables), the exposure heat flux, or the temperature of the cable itself. Current understanding suggests that the temperature of the cable insulation material drives the failure behavior. That is, once the insulation reaches a temperature threshold, failure will occur. Hence, a direct analysis of the cable thermal response may provide the most accurate estimates of damage timing. However, in practice, the environmental exposure temperature and/or the incident heat flux may be used as surrogates for the insulation temperature. Using the environmental exposure temperature directly as an indicator of damage (i.e., if the environment reaches the damage threshold, damage is assumed to occur immediately) is considered a conservative practice. Considering the time delay associated with the thermal response of the cable can reduce and/or eliminate this conservatism. For example, if the exposure temperature is equal to the assumed damage threshold for the cable, a prolonged period may pass before failure occurs. Some fire models offer the capability of calculating surface temperature of the target. Appendix H provides experimental results that can also be used for estimating the lag time between environmental and surface temperatures.
- If the target is an integrated circuit device or a solid-state device, use of the environmental exposure conditions as a basis for failure is appropriate. Such components typically possess limited thermal mass and high surface area, so they will reach equilibrium with the thermal environment quickly.

Additional failure mechanisms may be relevant to specific types of target elements. This may include smoke exposure and water spray. For example, exposure to smoke is a known mode of failure for devices that rely on fine mechanical motions, such as a strip chart recorder, sensitive digital circuits, and some high-voltage components. Appendix T provides an approach on how to consider smoke impact on equipment and operators. Water sprays (e.g., from firefighting activities) may cause the failure of a range of electrical components. The current state of the art does not fully support a detailed evaluation of such failure mechanisms. If these failure modes are neglected in the analysis, the analyst should acknowledge this as a potential weakness. Where such additional failure mechanisms may be critical to risk quantification, the analyst may choose to incorporate such failure mechanisms using available tools and/or expert judgment. Such assessments may be incorporated in the risk quantification, or may be utilized in the context of sensitivity studies.

- If the fire scenario involves an electrical panel, it may be prudent to assume the smoke-induced failure of all digital or integrated circuit components within the originating fire panel regardless of the assumed fire size, intensity, or duration.
- In the event of a fire involving high-energy electrical components (e.g., MCC, breaker, switchgear, etc.), it may be prudent to assume the smoke-induced failure of components in adjoining panels or cubicles, especially if those cubicles or panels are connected by features like buss ducts or a common ventilation system.

The final outcome of this step is a probability distribution of time to target set damage, $p_{\text{damage}}(t)$. This distribution is a result of aleatory uncertainties in the heat release rate and other parameters determining the severity of a fire (see Appendix E for further discussions). As a result, the time to damage may span a wide range. To obtain this distribution, the analyst may need to conduct the fire growth, propagation, and damage analysis for several parameter values from the range

of possible values. Based on probabilities associated with the selected parameter values, the time to damage distribution may be concluded. This process is further discussed in Appendix E in the context of defining the severity factor of the fire scenario.

Note that when the target set involves more than one item, the analyst should choose what damage time to apply. In reality, the target set fails when all elements of the set have reached the damage threshold. However, care should be taken to ensure that one target remote from the fire does not inappropriately drive the damage time. In many cases, the analyst may choose to assume loss of the target set given loss of any target item in the set. This is certainly a conservative approach. This approach is often applied when the specific location of the target elements within the compartment is not well established. For example, the target cables may be within a stack of cable trays, but the exact position of the cables in specific trays may be unknown. In such a case, the analyst may conservatively assume that all target cables are located in the bottommost tray of the stack. If the position of the cables within different layers of a stack is known, the analyst may postulate multiple scenarios based on the number of cable trays affected, counting from the bottom. That is, if the target set involves cables in two separate cable raceways, one of which will be damaged sooner than the second, it may be appropriate to define two sub-scenarios; one involving loss of the first raceway only, the second involving loss of both the first and second raceways.

11.5.1.8 Step 8.a: Conduct Fire Detection and Suppression Analysis

This step estimates the detection and suppression time for each fire scenario. As defined earlier, the combined detection and suppression time represent that time after fire ignition when the fire is brought under control, meaning that no further damage may be experienced. The final outcome of this step is expected to be an aleatory probability distribution for detection and suppression time. The uncertainties represented by the distribution are mainly due to the aleatory uncertainties fire brigade actions, fire detection response, fixed fire suppression system response, etc.

The discussions provided in this step are in general terms. The analyst may elect to follow any methodology to establish the various detection and suppression times and related probability distributions. Appendix P provides an event-tree-based methodology for estimating the probability distribution. The methodology takes into account the interactions among prompt detection, prompt suppression, fixed suppression systems, and fire brigade response.

At this point of the analysis, the general fire protection strategy for the room has been identified. In this step, the analyst considers specific fire detection and suppression features of the scenario. Fire detection and suppression features, including passive systems to be credited in the analysis, should be identified and described.

- If a fixed fire detection system is being credited, it is appropriate to identify the type of detectors used, where alarm signals are transmitted to, and the coverage of the system (e.g., spot detection versus area or zone coverage).
- If a fixed fire suppression system is being credited, it is appropriate to identify the type of suppression system (e.g., wet-pipe sprinklers, gaseous system, deluge, directed spray, etc.) and the coverage of the system (e.g., spot suppression versus area or zone coverage).

To assess the effectiveness of manual fire detection and suppression, it may be appropriate to discuss the level of compartment occupancy. Occupancy features of potential interest may include a continuously occupied compartment; presence of fire watch; compartment use as a regular throughway for personnel entering or leaving areas of the plant; and compartment subjected to periodic passage of plant personnel for status.

11.5.1.8.1 Step 8.a.1: Assess Fire Detection Timing

The first step in the fire detection and suppression analysis is to assess the timing of fire detection. Fire detection is relevant, in particular, because it triggers the human response to the fire event. This includes any operator actions anticipated in response to the fire, and activation of the manual fire brigade.

The detection response analysis can consider both fixed detection systems and manual detection of fires. In many cases, one or the other may dominate the analysis.

- In continuously occupied spaces, human detection of a fire may be at least as effective as fixed detection. In such cases, it is appropriate to ensure that the ventilation system will not draw fire products away from the human occupants, reducing the likelihood of human detection (e.g., control panels may be used as a return air plenum for the ventilation system, reducing the likelihood of human detection).
- In spaces subject to a continuous fire watch, human detection of fires is likely to occur quickly.
- It is likely that fires ignited during hot work will be quickly detected if a fire watch has been posted.
- In unoccupied spaces protected by fixed detection, the response time of the fixed detection system will likely dominate the detection response. However, in such cases, the potential failure of the detection system should also be considered.

In assessing the response of a fixed fire detection system, the time constant of the fire detector should be considered. It is also appropriate to consider the configuration of the detection system, and the migration time of fire products to the detector. Fire modeling tools may be applied to this analysis if determined by the analyst to be appropriate.

Appendix P provides additional information on the analysis of fire detection timing, and in particular, the analysis of detection of fires by plant personnel, including fire watches.

11.5.1.8.2 Step 8.a.2: Assess Timing, Reliability, and Effectiveness of Fixed-Fire Suppression Systems

The analysis of fixed fire suppression response involves three primary factors: actuation timing, effectiveness, and reliability.

Timing involves the application of fire modeling tools to estimate the time required for the system to sense an appropriate actuation demand.

- A sprinkler head requires heat sufficient to break the fusible link in the head itself.

- A preaction system may require a valid detection signal before actuation is possible. In some cases (e.g., a cross-zone system), multiple detection signals may be required.
- Gaseous suppression systems typically require either a manual actuation or actuation of a cross-zone fire detection system. In addition, a predischARGE alarm will sound to allow time for personnel to evacuate. This will typically result in an actuation delay that should be included in the time analysis.
- A manually actuated fixed suppression system that is operated locally would require an individual with the authority to actuate the system to arrive on the scene, assess the situation, and actuate the system.
- A manually actuated fixed suppression system operated remotely (e.g., from the MCR) may require that personnel arrive on the scene, report back to the remote control station, and that someone at the remote location actuate the system. (Note that in such cases, a local actuation capability would likely be provided in addition to the remote capability.)

Reliability refers to the likelihood that given a valid actuation signal, the fixed suppression system will actually discharge suppressant consistent with the design intent. Systems may fail to actuate for a variety of reasons, and this should be accounted for in the analysis. The fallback position given failure of a fixed fire suppression system may involve either recovery of the failed suppression system, or manual fire suppression. Note that attempts to recover a fixed fire suppression system may delay subsequent manual fire suppression efforts (e.g., firefighters may be reluctant to enter a room if they know that attempts are being made to actuate a fixed suppression system).

For Fire PRA, it is generally considered appropriate to utilize system reliability estimates derived from generic data for general industrial/commercial applications. However, plant-specific experience should be considered. In particular, it is highly unlikely that the plant will have a sufficient experience base to justify an increase in system reliability above the generic values. However, plant-specific experience may indicate a need to reduce system reliability. For example, adverse experience with fire pump availability may indicate a higher likelihood of failure on demand for the supported firefighting water systems.

The final factor is effectiveness. This refers to the appropriateness of the fixed suppression system in the context of the specific fire ignition source scenario considered.

- A partial-coverage fire sprinkler system may provide highly effective protection for some fire ignition sources in a compartment, and virtually no protection for other sources, depending on their location relative to the zone of coverage.
- Obstructions may render a fire sprinkler system ineffective against fire ignition sources located below the obstructions.
- A gaseous fire suppression system may provide inadequate concentrations and/or inadequate soak times to ensure fire extinction. Hence, a reflash of the fire may occur, requiring either an additional discharge of suppressant (if available) and/or follow-up manual fire suppression.
- Fire sprinklers located near the ceiling or roof of a very tall enclosure may not actuate given a fire located near the floor of the compartment.

The assessment of fire suppression system effectiveness remains an exercise in the application of expert judgment. Compliance with all aspects of the code of record can nominally indicate system effectiveness. However, field verification of system effectiveness in the context of the specific physical fire scenario under analysis is appropriate.

Appendix P provides additional information to support the assessment and analysis of fixed fire suppression systems.

11.5.1.8.3 Step 8.a.3: Assess Manual Fire Brigade Response

The ultimate fallback response to fires in most areas of the plant is provided through the manual fire brigade. In this task, the timing of fire brigade response is assessed. If the manual fire brigade is not credited for suppression in the fire scenario, this step is skipped.

In this task, the analyst utilizes probability curves tailored to the type of fire scenario being analyzed that characterize the historical evidence regarding manual fire brigade response. In particular, the curves are derived from the FEDB and estimate the likelihood of manual fire suppression versus time. Appendix P provides additional detail on the recommended approach.

Note that the recommended approach is based on historical evidence, and as such, represents a relatively generic industry response model. While past practice has included methods based on plant-specific brigade response times, such methods are not recommended. Experience indicates that the brigade response methods provide no mechanism for assessing the likelihood of longer-duration fires. The experience-based approach directly accounts for longer-duration fires based on the fire event experience. It does not, however, provide a mechanism for updating the generic curves to reflect plant-specific experience. The plant specific brigade response time to the room where the fire is postulated is an input to the analysis. This input will influence the time available for suppression but does not alter the suppression time obtained from the suppression curves.

11.5.1.8.4 Step 8.a.4: Estimate Probability of Fire Suppression as a Function of Time

In this step, the analyst combines information from Steps 8.a.1 through 8.a.3 to develop a composite fire suppression probability curve. That is, information on fire detection, fixed fire suppression, and the response of the manual fire brigade are combined into a single curve reflecting the probability of fire suppression versus time. The final outcome of this step is the probability of failure to suppress before a given time t , which is generally expressed as:

$$P_{ns}(t) = \Pr(\text{suppression time} \geq t)$$

An event-tree-based methodology for estimating this probability distribution is provided in Appendix P for this purpose. Thus, in this step, the analyst develops a conditional non-suppression probability estimate for the fire scenario. Recall that in the Fire PRA context, the key question is whether or not the fire is suppressed before the target set is damaged. The probability of non-suppression is an estimate of the overall likelihood that given a fire in the postulated fire ignition source, damage to the target set will occur before the fire is suppressed.

11.5.1.9 Step 9.a: Calculate Severity Factor

Often, as discussed in Step 7, there are uncertainties in the heat release rate and other parameters that define the intensity characteristics of the fire that affect the time to target set damage. This leads to uncertainties in damage time, which is also expressed by the probability distribution, $p_{\text{damage}}(t)$. From this distribution, the severity factor may be defined. However, since the variation in damage time affects probability of non-suppression, the severity factor should be defined in combination with the non-suppression probability. Thus, the two factors, $SF_k \cdot P_{\text{ns},k}$, in Equation 11-1 can be evaluated simultaneously from:

$$SF_k \cdot P_{\text{ns},k} = \int_{\text{All } t} p_{\text{damage}}(t) P_{\text{ns}}(t) dt$$

Appendix E provides a simplified approach to evaluate this equation. The approach assumes that heat release rate is the only parameter representing fire severity.

11.5.1.10 Step 10.a: Calculate Scenario Frequency

The scenario frequency can now be calculated using the equation given in section 11.3.1. The ignition frequency, $\lambda_{i,k}$, is established in Step 3.a; the combined severity factor and non-suppression probability is established in Step 9.a. This frequency can be used in combination with the scenario CCDP/CLERP to estimate the CDF/LERF associated with the fire scenario. The scenario CCDP/CLERP is derived by setting the fire scenario target set (from step 5.a) to failure in the CCDP/CLERP model developed in task 5. The total compartment CDF/LERF is the sum of the risk of the individual scenarios postulated in that compartment.

11.5.1.11 Step 11.a: Document Analysis Results

The final step in the detailed fire modeling task is to document the analysis results. It is recommended that the analyst consider a two-tier documentation approach. The first tier is an overview of the analysis for each fire scenario. The first tier documentation should be sufficient in detail to allow for an independent reader to understand the scenarios postulated, the basis for their analysis, the tools utilized in the analysis and basis for selection, and the final results of the analysis.

The second tier documentation should provide the details of each individual analysis performed. This level of documentation would include details of scenario selection process, the fire modeling analyses performed, including details of the input parameters used, and the basis for their selection. All specific considerations and assumptions should be recorded clearly.

11.5.2 Analysis of Fire Scenarios in the Main Control Room

Because of the unique characteristics of the MCR, a separate procedure is provided here for analyzing its fire risk. Characteristics most relevant to fire risk include the following.

1. The control and instrumentation circuits of all redundant trains for almost all plant systems are present in the control room. Furthermore, redundant train controls may be installed within a short distance of one another. Therefore, small fires within control panels may be risk-significant.
2. The room is continuously occupied, which provides the capability of “prompt detection and suppression.”
3. Plant safety depends on the well-being of control room operators. A fire adversely affecting the operators may have severe safety implications. Therefore, evaluating control room abandonment conditions may be necessary. Abandonment refers to situations in which control room operators are forced to leave due to untenable fire generated conditions (temperature, toxicity, and visibility).

A review of Control Room fire events reveals that none of the fires affected items beyond the point of ignition. In all cases, the fire was discovered by Control Room personnel and extinguished using hand-held extinguishers.. If a fire affecting a large number of items inside the control room occurs, the principal impact would more likely be Control Room abandonment by the operators than wide-spread equipment damage. The fire brigade would remain in the control room and continue fighting the fire, which would most likely retard the fire spread. Therefore, it is recommended that fire risk analysts identify localized areas on the control boards where control and instrumentation damage may have some significant impact on core cooling after a reactor trip.

Target sets consist, for the most part, of control- and instrumentation-related components and wiring within one, adjacent, or nearby panels and cabinets. As opposed to other compartments, where targets are usually cables throughout the area are exposed to fire conditions, control room targets are cabinets controlling safe shutdown related functions. Cabinets in some control rooms are equipped with smoke detectors, which can reduce the fire detection time and indicate which specific cabinet is on fire. Although control rooms are equipped with smoke detector systems, usually no fixed suppression is available. Manual suppression is usually the extinguishing method used. Each of these characteristics will impact the risk analysis by influencing the non-suppression or abandonment probabilities.

Control room fire modeling is used to estimate the following:

1. Conditional probability of damage to a set of target items, and
2. Forced control room abandonment time.

The possibility of forced control room abandonment should be considered for all fire scenarios.

The approach described in this procedure for analyzing fire scenarios in the control room is similar to the one for single compartment fire risk analysis described above. However, since a small fire may affect a risk-significant set of components, the analysis here hinges on target sets, assuming a large number of possible fire scenarios may affect the same target set. In contrast, in single compartment fire analysis, the fire scenarios were identified starting with specific ignition sources.

The following steps are recommended for a control room fire analysis.

Step 1.b: Identify and characterize main control room features

Step 2.b: Estimate control room fire frequency

Step 3.b: Identify and characterize fire detection and suppression features and systems

Step 4.b: Characterize alternate shutdown features

Step 5.b: Identify and characterize target sets

Step 6.b: Identify and characterize ignition sources

Step 7.b: Define fire scenarios

Step 8.b: Conduct fire growth and propagation analysis

Step 9.b: Fire detection and suppression analysis and severity factor

Step 10.b: Estimate failure probability of using alternate shutdown features

Step 11.b: Estimate probability of control room abandonment

Step 12.b: Calculate scenario frequencies

Step 13.b: Document analysis results

Each step is discussed separately below.

11.5.2.1 Step 1.b: Identify and Characterize Main Control Room Features

This step gains an understanding of the specific features and related fire protection systems of the control room. The following general information may be collected:

- Control room height, length, and width;
- Location, shape, and dimensions of various control panels;
- Wall construction type and thickness;
- General information about compartment ventilation (e.g., in some cases, the ventilation is routed through the control panels);
- Other compartments considered part of the MCR proper; and
- Ceiling soffit or beam pocket features of the main ceiling. Height, construction materials, and specific features of the false ceiling. All openings in the false ceiling should be specifically noted as potential pathway for hot gases entering the area between the two ceilings.

11.5.2.2 Step 2.b: Estimate Control Room Fire Frequency

In this step, the overall MCR fire frequency is estimated using the following equation:

$$\lambda_{\text{MCR}} = W_{\text{L,MCR}}(\lambda_{\text{MCB}} + W_{\text{PWC,Elec.Cab,MCR}}\lambda_{\text{PWC,Elec.Cab.}} + W_{\text{transients,MCR}}\lambda_{\text{transient}} + W_{\text{welding,MCR}}\lambda_{\text{welding}})$$

where:

λ_{MCR} :	Main Control Room fire frequency
$W_{\text{L, MCR}}$:	Location weighting factor for the MCR
λ_{MCB} :	Main Control Board fire frequency (Table 6-1, bin 4)
$W_{\text{PWC, Elec. Cab, MCR}}$:	Ignition source weighting factor of Plant Wide Electrical Cabinets found in the Main Control Room.
$\lambda_{\text{PWC, Elec. Cab.}}$:	Fire frequency of Plant Wide Electrical Cabinets (applies to all electrical cabinets in the plant including those panels in the MCR that were not labeled as MCB.) (Table 6-1, bin 15)
$W_{\text{transients, MCR}}$:	Ignition source weighting factor of Control/Aux/Rx Bldg Transient Fire events that may occur in the MCR. This fraction should be computed using the same method as for transients for other parts of the location using the following influencing factors: - Maintenance – Low - Occupancy – High - Storage – High (reflecting large quantity of paper materials)
$\lambda_{\text{transient}}$:	Control/Aux/Rx Bldg Transient fire frequency (Table 6-1, bin 7).
$W_{\text{welding, MCR}}$:	If welding is allowed in the MCR during power operation, this ignition source weighting factor should be evaluated in the same way as that for transient fire using the following influencing factors: - Maintenance – Low - Occupancy – No - Storage – No
λ_{welding} :	Control/Aux/Rx Bldg, transient fires cause by welding frequency (Table 6-1, bin 6).

It must be noted that in this step the overall control room fire frequency is established. In the following steps, the analyst may need the occurrence frequency of a specific fire scenario involving a specific ignition source. For example, it is anticipated that in most fire PRAs the MCB will be analyzed separately in some level of detail. The analyst should then review the analysis conducted in this step and glean from it the frequencies relevant to the specific scenario.

11.5.2.3 Step 3.b: Identify and Characterize Fire Detection and Suppression Features and Systems

In this step, the analyst characterizes the detection and suppression features and systems that may be credited when analyzing the fire scenarios. This may include any and all means of detection and suppression available. The following specific features should be verified:

- Smoke detectors under the main ceiling,
- Smoke detectors inside the control panels,
- Presence, location, and characteristics of other detectors,
- Presence, location, and characteristics of detectors in the ventilation ducts,
- Presence of fixed fire suppression systems inside and outside the control panels,
- Location and characteristics of portable fire extinguishers, and
- Location and characteristics of the hose reels.

Note that the discussions provided in Step 2.a may apply to the Control Room as well.

11.5.2.4 Step 4.b: Characterize Alternate Shutdown Features

The ability to achieve safe shutdown from outside the MCR is known as alternate shutdown capability. The features of alternate shutdown capability vary widely among the nuclear power plants. In some plants, a control panel is installed at a location away from the control room where the operators can control and monitor key core cooling functions and parameters independent of the MCR. It is important to note that these panels in principle, are required to be electrically independent from the effects of circuit failures in the MCR panels. In other plants, alternate shutdown capability is achieved through a set of control points and control panels located at various points of the plant requiring coordinated actions of several operators.

It is necessary for the fire risk analysts to understand the alternate shutdown capability of the plant. The specific features of the capability may influence the fire scenarios identification process (Step 6.b, below). For example, the analyst may select safety-related target sets on the panel that are not backed up by an alternate shutdown control or instrumentation circuit.

11.5.2.5 Step 5.b: Identify and Characterize Target Sets

The target sets can be identified by systematically examining combinations of control and instrumentation items found on the control panels, electrical cabinets, wireways, and cable raceways inside the MCR. The analyst may examine the control panels from one end to the other, noting the various Fire PRA-related components. Groups of adjacent controls and instrumentation should be identified. Based on a cursory, conservative estimation of the CCDP/CLERP, the analyst should identify target sets that, if damaged by fire, may have a risk-significant impact.

Similar to target set identification process for single compartments, the analyst should assume that the elements of a set are located within the reach of a potential fire. Note that the fire may occur at any point of a control panel or electrical cabinet and may propagate at all directions. The analyst may also assume the possibility of an exposure fire affecting multiple cabinets. Identification of ignition sources is addressed in Step 6.b, below.

11.5.2.6 Step 6.b: Identify and Characterize Ignition Sources

This step characterizes the ignition sources that may affect the identified target sets. The approach provided in Step 3.a applies to the MCR as well. Similar to Step 3.a, the final product of this step is a list of ignition sources, their relevant characteristics (e.g., type, quantity, dimensions and heat release rate profile), and fire ignition frequencies associated with each source.

The main fixed ignition sources of the MCR are typically the main control board, other control panels, electrical cabinets, wireways, and cable raceways. Some control rooms may also include kitchen appliances and other electrical devices. As noted in the preceding step, assume that the fire might occur at any point on a control panel or an electrical cabinet.

Transient combustibles should also be identified in this step. Those areas of the MCR where transient combustibles could potentially be found may be marked on a layout drawing. Typical transient ignition sources in the control room are stacks of procedure binders, trashcans, chairs, etc. Any selected transient fire should be located so that the targets are challenged by the fire-generated conditions. Documentation of any program controlling the amount and location of transient combustibles throughout the control room may be helpful for identifying scenarios with transient ignition sources.

As part of this step, the frequency of fire ignition is estimated. Frequency of fire occurrence involving a specific ignition source can be gleaned from the information generated in Step 2b, above.

11.5.2.7 Step 7.b: Define Fire Scenarios

Control room fire scenarios can be categorized as:

- Fire inside one segment of the main control board or multiple adjacent segments of the main control boards that open into each other, impacting control- and instrumentation-related components within the affected segment;
- Fires affecting two adjacent segments of the main control boards that do not open into each other;
- Fires affecting two nonadjacent segments of the main control boards; and
- Transient fires.

Using the target sets identified in Step 5.b, a set of fire scenarios can be identified. The analyst for each target set, as in the case of single compartment fire analysis, may identify the fire scenarios in terms of an ignition source, growth within the ignition source, propagation to secondary combustibles, and finally damage to the target set. This approach may be used for transient fires and fire scenarios involving electrical devices other than control panels. For control panel fires, Appendix S provides a methodology where a large number of potential fire scenarios are analyzed simultaneously. In that methodology, the combined probabilities of non-suppression and fire intensity are estimated by postulating the fire ignition location and fire intensity as two random variables that follow certain probability distributions. In other words, a large number of fire scenarios are analyzed simultaneously.

11.5.2.8 Step 8.b: Conduct Fire Growth and Propagation Analysis

Fire Inside a Control Cabinet

One may attempt to model the fire spread from a point of origin to other combustibles inside a control panel. However, modeling such phenomenon is beyond the capabilities of current state-of-the-art analytical tools. In the absence of an analytical tool, a probabilistic model is presented in Appendix L that is based on information obtained from EPRI's Fire Events Database [11.1], and a series of cabinet fire experiments reported in NUREG/CR-4527 [11.2]. The probabilistic model estimates the likelihood that a set of targets separated by a predetermined distance would be affected by a fire. The likelihood is effectively a combination of severity factors and non-suppression probabilities integrated over all possible fire scenarios that may damage the postulated target set.

Two Adjacent but Separated Control Cabinets

Fire risk analysts may identify target sets located in two adjacent cabinets separated by a wall. The wall should not have any opening that may carry hot gases between the cabinets. Since there is a barrier between the cabinets, the approach described in the preceding section would not directly apply. The approach described in Appendix S for electrical cabinets may be used here with some modifications, as described below. It is also recommended that the analysts postulate transient combustible fires outside the control cabinets.

The following cabinet features may influence the fire impact on the postulated target set:

- Single wall separating two cabinets,
- Double walls with an air gap separating two cabinets, and
- Cabinets that may be open in the back.

Based on these conditions, four fire scenario situations can be envisioned:

1. Cabinets separated by a single wall and closed back,
2. Cabinets separated by a single wall and open back,
3. Cabinets separated by double walls and closed back, and
4. Cabinets separated by double walls and open back.

For cabinets separated by a single wall with back covers, the analyst may use the approach described in Appendix L to establish the likelihood of fires occurring in the exposing cabinet that could damage the wall. Per the approach recommended in Appendix S, it is assumed that the targets within the exposed cabinet would fail within 15 minutes of a fire impacting the wall between the two cabinets. A second non-suppression probability may be multiplied to the fire scenario frequency based on a 15-minute fire duration (per Appendix S), noted in the equation below:

$$\lambda_{Adjacent\ Cabinets}(d_a) = \lambda_{MCB}[SF \cdot P_{ns}](d_a) P_{ns}(15\text{ min}),$$

where

d_a = maximum distance between target elements and the separating wall inside the exposing cabinet.

The 15-minute delay criterion is an attempt to shortcut modeling the temperature rise inside the exposed panel.

For cabinets with double wall separated by an air gap and back covers, as suggested in Appendix S, it can be assumed that the fire would not propagate between the cabinets. However, the possibility of transient combustible fires should be considered. The methodology for fire growth and propagation analysis described for single compartment fires can be used to model transient combustible fire propagation and impact on the cabinets. To estimate the time to target damage, assume 15 minutes of continuous exposure after the farthest cabinet wall temperature reaches cable damage threshold.

For cabinets with an open back, the possibility of damage from a transient fire outside should be considered. The primary mechanism of damage would be radiative heat transfer from the exposing flames. For damage time, use the time that the temperature of the farthest target item reaches damage threshold.

Nonadjacent Cabinets

The likelihood of a fire internal to a control panel damaging a nonadjacent cabinet is very small. As noted in the preceding sections, all control room fire events experienced by the industry affected only a small area of the control panel. There are generally no high-energy devices in a typical control room, either. Therefore, the possibility of a control panel fire damaging a nonadjacent panel may be ignored.

Transient combustible fires are deemed the only credible fire scenarios that may cause damage to nonadjacent panels. The methods described for a single compartment fire may be used here. For damage criterion, the following is suggested.

- For closed back panels, assume 15 minutes of continuous exposure to the effects of the fire after panel wall temperature reaches cable damage threshold.
- For open back panels, if the exposing fire is behind the panel, calculate the time for the temperature of the farthest target to reach damage threshold temperature.
- For open back panels, if the exposing fire is in front of the panel, calculate the time that an area of the panel where the farthest target resides reaches cable damage threshold temperature and remains at that intensity for 15 minutes.

Transient Fires

The process of postulating transient fires in the main control room is identical to the process in other compartments like the cable spreading rooms. Transient fires should be located based on judgment near identified targets, where these targets are challenged by fire-generated conditions.

11.5.2.9 Step 9.b: Detection and Suppression Analysis and Severity Factor

For control panel fires, Appendix L provides a method for estimating the probability of non-suppression and the severity factor. In the case of other fires (e.g., transient fires), the methodology provided for single compartment fires may be used (see Appendix P - Detection and Suppression Analysis).

11.5.2.10 Step 10.b: Estimate Failure Probability of Using Alternate Shutdown Features

To eventually quantify main control room fire risk, the possibility of safe shutdown using the alternate shutdown means (i.e., safe shutdown from outside the control room) should be included in the analysis. Two different approaches may be followed.

1. An overall failure probability is estimated representing the failure of the alternate shutdown means.
2. The alternate shutdown procedure is integrated in the plant response model (i.e., the fault trees and event trees). The core damage sequences are adjusted to include failures associated with alternate shutdown means, and the human error probabilities are reevaluated based on the alternate shutdown procedures.

The first approach (that is, the use of an overall probability value) can be used if the probability value is evaluated conservatively and a proper basis is provided. This approach was used in several IPEEE submittals. For example, in many cases, 0.1 was used as a point value estimate for the probability [11.3].

For the second approach (i.e., integrating the alternate shutdown procedures in the plant response model), the following steps are suggested. The first step is to review the applicable procedures and associated documentation. This review should identify the preferred equipment for safe shutdown, and the operator actions necessary to actuate and control them. (If the procedure identifies backup equipment, the corresponding shutdown method should also be evaluated.) If a timeline is not provided in the procedure or other associated documents, a general timeline of key operator actions should be developed. The operator actions performed in the control room and automatic system actuations upon which the timeline is based should also be identified. This step, in effect, establishes the “design basis” or capability of alternate shutdown features.

The second step is to verify that alternate shutdown capabilities satisfy the potential accident sequences associated with the postulated target set damage. Both the available equipment and the timeline for planned actuation should be evaluated.

To evaluate the planned timeline, accident sequence timing modeled in the plant model (i.e., fault trees and event trees) should be compared with the alternate shutdown procedure timeline. The comparison should ensure that the planned operator action times upon which alternate shutdown procedures are based will be less than the operator actuation or recovery times postulated for the applicable fire-induced accident sequences.

Consideration should also be given to how the timeline might change under various failure conditions. For example, if the procedure assumes that auxiliary feedwater is available and actuated from the control room, the analyst may need to consider the possibility of a stuck-open safety relief valve, thus significantly changing the time available to recover failed auxiliary feedwater system. As another example, a fire in a portion of the main control board may cause a RCP seal LOCA in excess of normal makeup capability. Complicated operator actions are generally necessary to safely shut down the plant under such conditions. This is further complicated if the alternate shutdown procedure has to be implemented.

Clearly, the timelines and especially comparison of the timelines between those in the fault tree and event tree models and the alternate shutdown procedures should be used to establish the human error probabilities. Furthermore, if needed, those times can be used to quantify dynamic human actions or evaluate the feasibility of recovery actions, should random equipment failures occur.

11.5.2.11 Step 11.b: Estimate Probability of Control Room Abandonment

In addition to fires affecting selected targets, the control room analysis should evaluate the possibility of forced abandonment conditions. For all control room fire scenarios, the possibility of control room abandonment should be taken into account.

Abandonment is assumed to be solely dependent on habitability conditions of the control room. However, the analyst may postulate that the alternate shutdown procedure would be activated before conditions in the control room worsened. The time to activate the alternate shutdown procedure is suggested to be established based on plant operating procedures more than control room habitability conditions. The final decision to abandon the control room is assumed to depend on habitability conditions. To establish timing of this event, it is suggested that at least one of the following criteria be satisfied.

- The heat flux at 6' above the floor exceeds 1 kW/m² (relative short exposure). This can be considered as the minimum heat flux for pain to skin. Approximating radiation from the smoke layer as $q_r'' = \sigma \cdot T_{sl}^4$, a smoke layer of around 95°C (200°F) could generate such heat flux.
- The smoke layer descends below 6' from the floor, and optical density of the smoke is less than 0.3 m⁻¹. With such optical density, a light-reflecting object would not be seen if its more than 0.4 m away. A light-emitting object will not be seen if its more than 1 m away.
- A fire inside the main control board damaging internal targets 2.13 m (7') apart.

Zone models and field models are the recommended fire modeling tools for estimating the hot gas layer temperature, heat flux, descent rate, and obscuration. The following considerations should be taken into account:

- If the panels are open in the back or there are vent openings at the upper half of the panel, the analyst may assume that the fire has occurred in the open inside the control room.
- The possibility of transient combustibles leading to control room abandonment should be considered.
- Two possibilities should be taken into consideration; (1) the ventilation system is turned off, causing hot gases and smoke to accumulate inside the control room, and (2) the ventilation system is on smoke-purge mode. The conditional probabilities of entering each condition may be calculated based on operator error in initiating smoke-purge mode and equipment failure.

For the ventilation system on purge mode, the following should be investigated:

- Possibility of fire causing the ventilation system to trip, and
- Room purge rate as compared to the hot gas and smoke generation rate.

The analyses should estimate the time to forced abandonment of the control room. The non-suppression probability and severity factor should be multiplied to calculate the conditional probability of experiencing forced evacuation given a fire in the control room.

11.5.2.12 Step 12.b: Calculate Scenario Frequencies

The initial ignition source frequency for a control room fire is determined using the method described in Steps 2b and 6b. The scenario frequencies are then calculated by multiplying the ignition frequency with the combined non-suppression probability and severity factor. The influence of alternate shutdown procedures is included in the CCDP/CLERP, which is calculated using the plant model or as a simple single probability value.

11.5.2.13 Step 13.b: Document Analysis Results

Similar to Step 11.a, the final step of the control room fire modeling is to document the analysis results. As in Step 11.a, it is recommended that the analyst consider a two-tier documentation approach. The first tier may provide an overview of the analysis. The first-tier documentation should be sufficient in detail to allow an independent reader to understand the scenarios postulated, the basis for their analysis, the tools utilized in the analysis and basis for selection, and the final results of the analysis. The second-tier documents should provide the details of each individual analysis performed. This level of documentation would include details of scenario selection process, the fire modeling analyses performed (including details of the input parameters used and the basis for their selection). All specific considerations and assumptions should be recorded clearly.

11.5.3 Analysis of Fire Scenarios Initiated Outside the Main Control Room that May Impact MCR Functions or Habitability

There may be locations in a nuclear power facility, other than the main control room (MCR), that contain a sufficient set of cables for redundant components such that an uncontrolled fire can result in the need for ex-control room plant shutdown (i.e., reliance on alternate shutdown features). In most plants such locations are known in advance based on the plant post-fire safe shutdown analysis. These locations may also be identified as the result of task 3, cable selection and routing. One typical example of such a location is the cable spreading room. There may also be cases where smoke from a fire in a neighboring compartment might spread to the MCR causing issues with MCR habitability.

The analysis of fire scenarios in such locations should follow a combination of steps outlined in the previous two sections for analysis of single-compartment and main control room fire scenarios. Steps 1.a through 9.a described in Section 11.5.1 may be followed to select and analyze the fire scenarios in these compartments. At least one of the fire scenarios defined should reflect the conditions upon which ex-control room plant shutdown (alternate shutdown) would be required. Note that such conditions may be driven by loss of critical control functions or control room habitability (evacuation). The latter scenario should examine the potential for smoke migration into the main control room from the room of the fire origin.

Fire scenarios that require ex-control room plant shutdown should follow Step 10.b in Section 11.5.2 to estimate failure probability associated with reliance on alternate shutdown features. Other fire scenarios should follow Step 10.a in Section 11.5.1 to estimate scenario CCDP/CLERP.

11.5.4 Analysis of Fire Scenarios Impacting Multiple Compartments

Commercial nuclear power plants have numerous interconnected compartments that may be aligned horizontally or vertically. Connections between compartments usually include fire doors, stairways, unsealed penetrations, openings, gratings, etc.

NUREG 6738, *Risk Methods Insights Gained from Fire Incidents*, documents that “the only case of room to room fire propagation experienced to date in a commercial U.S. reactor is the 1975 Browns Ferry fire.” In this case, the spread of fire from the cable spreading room into the reactor building is directly attributable to the incomplete nature of the cable penetration seals at the time of the fire and the air pressure difference between the two sides of the wall. There are, however, other cases in which room-to-room smoke propagation did occur. Citing again NUREG 6738, “none of the cases in U.S. reactors led to significant damage or other adverse effects, although some hampering of operator actions is evident.” In some of these fires, smoke found its way into the control room, but no evacuation of operators occurred.

Considering the numerous interconnected compartments, and the detailed analysis necessary for evaluating fire-generated conditions in multicompartment scenarios, a screening process is recommended to reduce the number of detailed evaluations. That is, the recommended process emphasizes screening multicompartment combinations from the beginning before identifying fire scenarios.

Detailed fire modeling of multicompartment fires refers to the evaluation of fire-generated conditions in one compartment that spread to adjacent ones. The fire modeling assumptions and recommended steps of this task are similar to those described in Task 11a, Detailed Fire Modeling for single compartments. In general, the same analytical process is applied to evaluate target damage in adjacent compartments. A separate procedure is necessary primarily for describing how to reduce the number of multicompartment combinations requiring detailed analysis. Most of the procedure focuses on describing this process.

The purpose of this section is to provide an approach in screening and evaluating multicompartment fire scenarios using screening techniques and analytical fire modeling tools specifically developed for such scenarios. Specifically, an approach is provided for (1) screening multicompartment fire scenarios, and (2) evaluating target damage in multicompartment fire scenarios that are not screened.

It is strongly recommended that a single compartment fire analysis be performed before fire modeling for multicompartment is conducted to take advantage of the information and analysis already available.

The main objective of this task is to evaluate the risk associated with multicompartment fire scenarios. The risk is evaluated by performing a multicompartment screening and a detailed evaluation of fire scenarios in the unscreened compartments.

The following steps are recommended:

Step 1.c: Exposing and exposed compartments matrix

Step 2.c: First screening—qualitative

Step 3.c: Second screening—Low fire load exposing compartments

Step 4.c: Third screening—frequency of occurrence

Step 5.c: Fourth screening—CDF based

Step 6.c: Detailed analysis

Step 7.c: Document the analysis

Each step is discussed separately below.

11.5.4.1 Step 1.c: Exposing and Exposed Compartments Matrix

The objective of this task is to create a matrix of exposing and exposed compartments. Fire ignition occurs in the exposing compartment and propagates to the exposed compartments. The matrix would effectively present all potential multicompartment fire scenarios that start with an exposing compartment and propagate through a set of well-defined pathways into a set of exposed compartments. It is strongly recommended to develop this matrix as part of a plant walkdown.

The matrix should include the following information: exposing compartment identifier, exposed compartment identifier, means by which fire effects (primarily hot gases) would propagate from exposing to exposed compartment (i.e., propagation pathway), status or condition of the pathway, and characteristics of the pathway. There could be more than one pathway between two compartments. For example, there could be a personnel door and a ventilation opening near the ceiling. The analyst should note the dimension (especially the height) and status of the door (i.e., normally open or closed). The ventilation opening may have a spring-loaded fire damper in it that would close when a fusible link breaks open from high temperature conditions.

There could be more than one exposed compartment associated with an exposing compartment. For example, there could be one compartment to the East and another to the North of an exposing compartment. It is also possible that there could be openings in the ceiling, creating a pathway between an exposing compartment with an exposed compartment directly above it.

Communication through ventilation ducts may need to be reviewed and verified. There is a possibility of hot gas propagation through ventilation ducts to either the ventilation equipment room or to other compartments if the ventilation system is shut off. Clearly, for these scenarios, the probability of fire damper failures should be included in the analysis.

For each exposing compartment, the matrix should present a set of multi-compartment fire scenarios. The following rules are suggested to identify the multi-compartment scenarios:

- Postulate only one barrier failure (e.g., door left open or damper fails to close), unless the analyst observes conditions or has a basis to consider that simultaneous failure of both doors is a likely event.
- Assume smoke impact on equipment has minimal effect, and
- Allow the hot gas to travel to as many compartments as physically possible. Note however that fresh air is entrained as smoke migrates from room to room. This entrainment lowers the smoke temperature. Analysts should include multi-compartment combinations in which the migrating smoke is high enough to generate target damage.

For example, if exposing Compartment A is adjacent to Compartments B to the west and C to the east. In both cases, there is a normally closed door between the compartments. Two scenarios should be postulated. Scenario 1 would include a fire in Compartment A propagating to Compartment B through the door between them, assuming that the door is open (a failure mode). Scenario 2 would also start with a fire in Compartment A propagating to Compartment C, in this case through the door between them, again assuming that this second door is open. Propagation of the fire into all three compartments may be considered very unlikely unless the analyst observes conditions or has a basis to consider that simultaneous failure of both doors is a likely event.

If there are normally open pathways between compartments, the analyst should assume that the hot gas would travel among all exposed compartments regardless of the number of the affected compartments. In some cases, this may include a large part of the plant. If such a condition is encountered, it is recommended to collect compartments to be clearly identified and conduct a detailed analysis per Step 6.c, below. In Step 6.c, the analyst would postulate scenarios based on fixed and transient ignition sources, calculating the reach of the hot gas layer for each case.

11.5.4.2 Step 2.c: First Screening – Qualitative

The first screening of the scenarios can be based on the contents of the exposed compartments. A scenario may be screened if one of the two following criteria is satisfied:

- The exposed compartment(s) do not contain any fire PRA components or cables, or
- The fire PRA components and cables of the exposed compartment(s) are identical to those in the exposing compartment.

11.5.4.3 Step 3.c: Second Screening – Low Fire Load Exposing Compartments

Exposing compartments that do not include combustible loading sufficient for generating a hot gas layer in any of the exposed compartments can be screened out. The following steps may be followed.

Step 3.c.1: Determine a conservative heat release rate value for screening. For each exposing compartment, identify a combination of fixed ignition source and secondary combustibles (e.g., cable trays above, or pool fires) that produce the highest heat release rate.

- Use the information provided in Appendix G for HRR values. As a conservative practice, one may use the recommended 98th percentile of the HRR probability distribution.
- Add to the fixed ignition source any heat release rate from intervening combustibles such as cable trays, etc.

Step 3.c.2: Determine the HRR necessary for a damaging hot gas layer using hand calculations for room temperature and the cable damage temperature.

Step 3.c.3: Compare HRR values obtained above. Determine if a damaging hot gas layer can occur in the exposed and exposing compartments. Screen out those scenarios where a damaging hot gas layer cannot be generated.

11.5.4.4 Step 4.c: Third Screening – Frequency of Occurrence

Fire scenarios can be screened based on the likelihood of occurrence. In this step, the likelihood is established by multiplying the following three parameters:

1. Ignition frequency,
2. Combined severity factor and non-suppression probability, and
3. Barrier failure probability.

Using the results of the preceding step and the method described in Appendix E, the combined severity factor and non-suppression probability can be established. For non-suppression probability, the analyst may use conservative measures if the necessary information about fire brigade response has not been collected yet.

For scenarios that include failure of a barrier in the open position, barrier failure probability should be estimated. Generally, data on barrier failure probability is sparse, and what is available is subject to many limitations. Initially, the analyst may use a screening barrier failure probability of 0.1. For scenarios that do not screen out, a more realistic barrier failure probability may be used. [11.4] (NUREG/CR-4840) defines the three barrier categories listed in Table 11-3 and provides their respective failure probabilities.

For barrier failure probabilities, the following additional information is provided:

- For water curtains, use the availability, reliability, and effectiveness approach discussed in Appendix P, Detection and Suppression.
- In using the above-presented ‘generic’ barrier failure probabilities, the analyst should verify that there are no plant-specific barrier problems identified by the plant fire protection staff.

**Table 11-3
Barrier Types and Their Failure Probabilities**

Barrier Type	Barrier Failure Probability/Demand
Type 1 - fire, security, and water tight doors	7.4E-03
Type 2 - fire and ventilation dampers	2.7E-03
Type 3 - penetration seals, fire walls	1.2E-03

11.5.4.5 Step 5.c: Fourth Screening – CDF Based

Those scenarios that survive the preceding screening steps may be screened based on their CDF. The CCDP associated with the failure of all fire PRA components and cables present in the combination of exposing and exposed compartments should be estimated. Using the scenario frequency calculated in the preceding step, a conservative estimate of the CDF can be obtained.

11.5.4.6 Step 6.c: Detailed Analysis

Those scenarios that do not screen out in the preceding steps may be analyzed using the same methods for single compartments. The same set of steps may be followed. In this case, the target set should include items from the exposed compartments.

11.5.4.7 Step 7.b: Document Analysis Results

Similar to Steps 11.a and 12.b, the final step of multi-compartment fire analysis is to document the analysis results. In this case, it is important that the screening process be presented properly. It is recommended that the exposing and exposed compartments matrix be clearly presented and the screening decisions presented based on that matrix. If detailed analysis is conducted, the same approach should be employed as in the case of single compartment fire modeling.

11.6 References

- 11.1 *Fire Events Database and Generic Ignition Frequency Model for U.S. Nuclear Power Plants*, EPRI TR-1003111, Nov. 2001.
- 11.2 Chavez, J.M., Nowlen, S.P., *An Experimental Investigation of Internally Ignited Fires in Nuclear Power Plant Control Cabinets: Parts 1 & 2*, U.S. NRC, NUREG/CR-4527, 1987.
- 11.3 *Perspective Gained From the Individual Plant Examination of External Events (IPEEE) Program*, U.S. NRC, NUREG-1742, April 2002.
- 11.4 *Recommended Procedures for the Simplified External Event Risk Analyses for NUREG 1150*, U.S. NRC, NUREG/CR-4840, September 1989.

12

POST-FIRE HUMAN RELIABILITY ANALYSIS (TASK 12)

12.1 Purpose

This document describes the procedure for evaluating the impact of fire scenarios on the human actions addressed in the base PRA study (i.e., the Internal Events PRA or original Fire IPEEE analysis) used to create the Fire PRA Model, as well as how to identify and quantify new actions to be performed as part of the plant fire mitigation plans and procedures. Evaluating the reliability for these human actions supports the Fire PRA Model for calculating such metrics as CDF, CCDP, LERF, and CLERP for fire-induced initiating events. The initial quantification of these metrics makes use of screening probabilities for human failure events (HFEs) where appropriate. As necessary, more detailed best estimate analyses of some human actions will be needed to obtain more realistic assessments of fire risk.

12.2 Scope

Task 12 addresses a process for performing both screening and detailed analysis of post-fire human actions identified in accident sequences initiated by a fire. The main focus is to foster the process for assessing the impact of location-specific fires on the human actions taken in response to a fire-induced initiating event, thus preventing core damage and mitigating releases. This task procedure covers three essential elements of most human reliability analysis (HRA) studies.

- Identification of the HFEs to be included in the Fire PRA.
- The assignment of screening human error probabilities for the identified HFEs to assist in focusing the modeling and fire risk analysis to those scenarios and human actions most important to the overall risk results.
- Considerations for the detailed best-estimate quantification of the more important HFEs to properly consider the fire effects on human performance.

In covering the above scope, it is important to stress that this procedure focuses on those unique fire considerations that need to be included in performing a HRA for the Fire PRA using whatever method (e.g., ASEP [12.1], etc.) is chosen by the analyst. It is therefore equally important to stress what this procedure does not do. This procedure is not a handbook or a similar stand-alone manual for doing a Fire HRA, in that it does not attempt to duplicate all the typical activities in carrying out a HRA like that specified by the ASME Standard ASME-RA-S-2002 [12.2]. Nor does this procedure attempt to provide a new or particularly prescriptive method for assessing the HEPs in a Fire PRA, since introducing such a method would be a research project far beyond the intended boundaries and resources for producing these fire procedures. Use of this procedure and the unique fire-related considerations that it covers is expected to be used *in concert with* already-available HRA techniques and calculation tools by an experienced HRA analyst(s) to perform a defensible and realistic HRA for a Fire PRA.

Notably, the scope of this procedure does not include pre-initiator human failure events specifically related to fire systems, barriers, or programs. Undetected pre-initiator human failures such as improperly restoring fire suppression equipment after test, compromising a fire barrier, or incorrectly storing a transient combustible can all affect the fire risk. Tasks 6, 8, and 11 make use of industry-wide data that within it contains contributions from such human failures. Hence to that extent, these pre-initiator failures are treated within the Fire PRA. Nevertheless, no specific steps are provided here for performing a plant-specific review of the potential for such human failures and thus influencing the use of the industry-wide data. This does not preclude the expectation that pre-initiator human failure events from the Internal Events PRA (i.e., not specifically related to fires) should remain in the Fire PRA Model covering their contribution to component unavailability for safe shutdown systems within the PRA model structure.

12.3 Background Information

12.3.1 General Task Objectives and Approach

This task's primary purpose is to provide a process on how to include and quantify events representing human failures in the development and quantification of the Fire PRA Model.

In this task, the Internal Events HFEs are addressed to incorporate fire location scenario-induced changes in assumptions, modeling structure, and performance shaping factors. In addition, modifications to the models are made to address special actions to maintain acceptable plant configurations and safe shutdown given a fire in specific locations and the need to use procedures that are not modeled in the Internal Events PRA.

The procedure for implementing this task is based on three major steps typical of most HRAs:

1. Identifying the human actions and resulting HFEs to include in the Fire PRA, which necessitates the potential modification of existing Internal Events PRA HFEs, as well as adding new HFEs related specifically to fire scenarios.
2. Assigning screening HEPs as an aid in simplifying the Fire PRA Model and focusing analysis resources on those fire scenarios and associated equipment failures and operator actions most significant to the overall fire risk.
3. Providing detailed best estimate quantification of the more significant HEPs to overall fire risk.

In addition, documenting the HRA is briefly addressed.

12.3.2 Assumptions

The work performed under this procedure inherently assumes the following.

1. In general, a fire anywhere in the plant introduces new accident contextual factors and potential dependencies among the human actions beyond those typically treated in the Internal Events PRA that increase (mildly or significantly) the potential for unsafe actions during an accident sequence. These will be addressed in the procedure and include, for

instance, potential adverse environments (e.g., heat, smoke), possible accessibility and operability issues, use of fire procedures, potential spurious events associated with both diagnostic and mitigating equipment, and increased demands on staffing and their workload, among others.

2. For all fires modeled in the Fire PRA, the crew is aware of:
 - the fire location within a short time (i.e., within the first ~10 minutes of a significant indication of non-normal conditions such as fire alarms, multiple equipment alarms, an automatic trip, etc.),
 - the need for a plant trip (if it has not happened automatically),
 - the need to implement a fire brigade, and
 - the potential for unusual plant behavior as a result of the fire.
3. Even if one or more MCR persons are used to assist in ex-control room activities such as aiding the fire brigade, the minimum allowable number of operators remains available in the MCR to manage the safe shutdown of the plant, and the crew makeup is similar to that assumed in the Internal Events PRA.

12.4 Task Interfaces

12.4.1 Input from Other Tasks

This task provides input to and uses results from many of the other tasks in the fire analysis process. Many of these interactions will be iterative in nature; each iteration provides insights that will improve the implementation of this and the other tasks. In particular:

- Task 2, Fire PRA Component Selection, will identify scenario mitigating equipment and diagnostic indications of particular relevance to human actions modeled in the Fire PRA, and this task (Task 12) will identify human actions to include in the model that, in turn, may imply other equipment and indications that need to be added as part of Task 2. Note that these equipment and indications will involve (1) that needed for potential success of actions that are needed per the EOPs, FEPs, or similar fire response instructions, and (2) that whose failure (including spurious events) in a fire can either induce operators to isolate or reposition critical equipment into a less desirable position or add to the crew's workload and potential confusion.
- Task 5, Fire-Induced Risk Model, will provide human actions already in the Internal Events PRA for consideration of further treatment, per this task, in the Fire PRA. This task (Task 12) will, in turn, identify new actions to be added to the Fire PRA Model (Task 5) because of the implementation of FEPs or other fire response instructions.¹⁴
- Task 12 will provide screening human error probabilities (HEPs) that can be used in performing the quantitative screening per Task 7, Quantitative Screening. Task 7 will provide

¹⁴ This can be accomplished through interactions between the HRA analyst and the PRA/systems analysts after studying special fire procedures needed for a location-scenario.

feedback to Task 12 (based on the accident sequences or cutsets and accompanying CCDPs and other results from running the Fire PRA Model) as to those HFEs needing a more detailed best estimate analysis to obtain more realistic CDFs, etc.

- Knowledge from Tasks 3 (Fire PRA Cable Selection), 9 (Detailed Circuit Failure Analysis), and 10 (Circuit Failure Mode Likelihood Analysis) associated with cable and circuit analyses will prove useful in determining the potential for equipment failures, as well as spurious operations and indications that the operators may face in various fires. This information will establish which screening HEPs can be used as well as the best-estimate quantification of the more important HEPs. As part of the iterative nature of PRA, in some cases, it will be desirable to perform some of the more detailed tasks (i.e., Tasks 9 and 10) as input to Task 12 so as to establish the best screening HEPs to carry out Task 7 most efficiently.
- Knowledge from Task 8, Scoping Fire Modeling, and Task 11, Detailed Fire Modeling, will prove useful in determining aspects important to deciding what screening HEPs can be used, as well as the best-estimate quantification of the more important HEPs. For example, the potential for adverse environments and timing information relative to equipment damage comes from insights from these two tasks. As part of the iterative nature of PRA, in some cases, it will be desirable to perform portions of Tasks 8 or 11 as input to Task 12 so as to establish the best screening HEPs to carry out Task 7 most efficiently.
- Ultimately, the final products of Task 12, including the HFEs to be modeled, some screening HEPs, and best-estimate quantification of certain HEPs, are inputs into the final risk quantification performed under Task 14, Fire Risk Quantification.

12.4.2 Additional Plant Information Needed to Support this Task

The following will be useful in performing this task.

1. Plant Procedures (EOPs, ARPs, Fire Procedures, etc.),
2. Plant training documents and related information (particularly fire-related),
3. Fire PRA Database,
4. Internal Events PRA Model and adjustments thereto per other tasks,
5. Plant P&IDs and Electrical Diagrams as may be necessary to identify the system impacts of human action successes and failures,
6. Other plant drawings and documents, as necessary to resolve location, accessibility, and other issues, and
7. ASME Standard for Probabilistic Risk Assessment for Nuclear Power Plant Applications (ASME RA-S-2002) [12.2].

12.4.3 Walkdowns

Existing documentation will be adequate to perform most of this procedure. However, there may be times when a walkdown is needed to determine or verify certain information relevant to the modeled human actions, such as when addressing the performance-shaping factors like the environmental conditions, the conditions of the man-machine interface and equipment layout, etc. In such cases, this need for a walkdown should be planned to coincide with other task walkdowns for efficiency reasons. See Support Task A, *Plant Walkdowns*.

12.4.4 Outputs to Other Tasks

Information from Task 12 is used in the following ways:

- As noted above, Task 12 provides information needed in Tasks 2, 5, and 7, as well as final inputs for Task 14.
- Uncertainty information to be propagated or otherwise addressed as part of Task 15, Uncertainty and Sensitivity Analysis, comes from Task 12.
- Elements of the documentation task (Task 16–Fire PRA Documentation) will include the assumptions, judgments, analyses, and results from Task 12.

12.5 Procedure – Preparation of Post-Fire HRA Package

12.5.1 Step 1: Modifying and Adding Human Failure Events to the Model

This step involves the identification of the HFEs that need to be included in the Fire PRA Model.

12.5.1.1 Review Existing Internal Events HFEs

Identifying the needed HFEs will involve reviewing the appropriateness of HFEs already in the Internal Events PRA. This is done by examining EOPs, abnormal event/operating procedures (AEPs/AOPs), FEPs, alarm/annunciator response procedures, associated training material (particularly fire-related), etc., to determine the relevancy of the HFEs already in the Internal Events model. Since most of the internal events human failures are associated with either pre-initiator failures or post-initiator actions important for safe shutdown, regardless of the type of event (e.g., failure to use feed and bleed, failure to depressurize, etc.), they will remain relevant to the Fire PRA and, thus, remain in the model. Some existing HFEs may need modification due to the addition of the fire context, such as if the timing of a scenario could be considerably different or a different procedure is used so that the internal events HFE needs to be altered.

12.5.1.2 Add New HFEs

As mentioned in Section 12.4.1 concerning interactions with Task 2, a number of new human actions and associated HFEs will likely be identified because of the fire-specific procedures and related training. Identifying these new actions will primarily come from a review of these fire-related procedures. Many of these new actions will involve fire-related in-control room actions as well as local manual actions to be taken as a result of a fire. For example, because of a fire and the associated procedures, sometimes the operators may have to (1) clear a fire-induced ground fault by isolating a bus, (2) deenergize and energize certain buses and/or loads by operating breakers, or (3) shift control of the plant from the MCR to the safe shutdown panel or other areas used for ex-control room shutdown. Particular attention should be made to preemptive actions that are sometimes taken per the fire procedures to prevent spurious actuations of equipment and to protect safe shutdown equipment due to inadequacies in meeting Appendix R of 10 CFR Part 50 (item III.G.2). Including such actions and the corresponding HFEs in the model could lead to different accident sequence developments for possible success and failure paths.

Furthermore, new HFEs will likely be identified because fire-induced failures of equipment and/or instrumentation, including spurious operation/indication, could cause the operators to fail fire-related actions or to take actions that adversely affect safe shutdown (e.g., shutting down an operable pump as directed by procedure because of a spurious/faulty high motor temperature alarm/indication). These new HFEs will need to be postulated and defined as appropriate for the model, considering the impact of the HFEs consistent with the structure and level of detail in the model (e.g., does the HFE affect an entire function, system, specific component only, etc.).

12.5.1.3 Elements of the Identification Process

Whatever process is used to conduct these reviews and identify the HFEs to be modeled (it is assumed the analyst will use a process similar to that for the Internal Events PRA), it should include the elements listed below. Note that additional aids in identifying HFEs may include, for instance, the HLR-HR-E and HLR-HR-F requirements of the ASME Standard (ASME RA-S-2002) [12.2], the ATHEANA HRA method [12.3] that describes a search process for identifying important actions to include in PRA models, the SHARP1 methodology [12.4], and NRC's 'Good Practices' document [12.5]. Both the HRA and PRA analysts should work together on deciding the best way to define and implement each HFE into the Fire PRA Model. As part of this effort, the Task 5 procedure should be reviewed for an example model of how to specifically add new model actions based on procedures other than the traditional EOPs (i.e., the operators need to use FEPs or similar instructions).

For post-initiator actions:

1. Develop a description of the typical expected steps that operators take in response to a fire in specific compartments, including the specific procedure references.
2. Compare fire response actions to the base case actions used to model operator responses in supporting the safety functions modeled in the Internal Events PRA. Note what new actions need to be included in the Fire PRA or when modifications to Internal Events PRA modeled actions are necessary. Include HFEs for these actions in the model.
3. If available, consider fire-specific training, including simulator training or actual experience (e.g., fire school) to ensure the correct operator actions during fires so that appropriate HFEs are identified.
4. Understand the role of each crewmember during the fire scenario, how they will be communicating and interacting with one another, and how the various procedures will be implemented. This information is important for both MCR and local actions, and will be needed for the screening step (Step 2).
5. Identify any fire-specific informal rules that may be part of crew knowledge to support development of specific responses (e.g., "don't put water on electrical fires until power is disconnected"). These may be sources of possible new HFEs or considerations in the modifications to any existing internal events HFEs.

12.5.2 Step 2: Assigning Quantitative Screening Human Error Probabilities

A quantitative screening analysis of HFEs will, in part, allow the Fire PRA to focus on the important accident scenarios (simultaneously using other screening based on the circuit analysis and fire frequency/severity perspectives would also be useful). Described below is a method for assigning quantitative screening values to the HFEs modeled in the Fire PRA when performing Task 7, Quantitative Screening, and subsequent model refinement activities. Note, however, that because of the unique conditions created by fires, some level of analysis will be needed to determine which screening “set,” below, is applicable. If the needed analysis seems too demanding, analysts always have the option to initially assign screening failure probabilities of 1.0 to all HFEs.

The method supports assignment of screening values by addressing the conditions that can influence crew performance during fires, ensuring that the time available to perform the necessary action is appropriately considered (given the other activities ongoing in the accident sequence), and ensuring that potential dependencies among HFEs modeled in a given accident sequence are addressed. Note that the criteria are best applied on a fire scenario (or groups of similar scenarios) basis, in order to decide which criteria set applies for which fire(s). For a particular HFE(s), if an appropriate set of criteria (discussed below) cannot be identified or met, no screening value should be used (i.e., assign a 1.0 failure probability initially and/or do a more detailed analysis depending on whether the HFE becomes important after initial model quantification).

12.5.3 Method for Assigning Screening Values to HFEs (Sets 1, 2, 3, and 4)

In the first set of criteria described below (Set 1), the goal is to determine whether the fire conditions are such that the HFEs modeled in the Internal Events PRA can simply be assigned the Internal Events PRA values modified for general fire effects during screening. Hence, Set 1 criteria apply to only pre-existing HFEs in the Internal Events PRA. If the criteria can be met, analysts still need to ensure that potential dependencies across HFEs in the models are accounted for per the ASME Standard (ASME RA-S-2002) [12.2]. That is, that the fire effects and the addition of any new fire-related HFEs to the model do not significantly alter the dependencies among the internal events HFEs and their associated HEPs.

Set 2 addresses a special case for HFEs modeled in related scenarios in the Internal Events PRA, but that did not meet the Set 1 criteria. Set 3 addresses (1) new HFEs added to the Fire PRA to account for fire-specific effects, and (2) prior Internal Events PRA HFEs that had to be significantly altered/modified during Step 1 to reflect fire effects in the Fire PRA. Set 4 addresses actions involved with MCR abandonment and the abandonment decision. Each of the four sets of screening criteria and HEP screening values is presented in turn below.

12.5.3.1 Screening Values Under Set 1

Given that the criteria for Set 1 exist, the Internal Events PRA probability values for the applicable HFE(s), multiplied by a factor of 10 to account for effects not covered in the Internal Events HEP evaluation (such as fire brigade interaction and other minor increased workload and/or distraction issues), can be used as screening values for initial evaluations of the Fire PRA Model in Task 7 and beyond.

12.5.3.2 Set 1 Criteria

1. The fire can cause an automatic plant trip, or a forced and proceduralized manual trip, and could not cause significant damage to functional safe shutdown equipment or related instrumentation beyond that considered in the Internal Events PRA for which the HFE value(s) apply. This condition demonstrates that from the safe shutdown perspective, the challenge of the particular fire is not significantly worse (functionally or as to effects on equipment) than already considered in the Internal Events PRA for the applicable HFE(s).
2. Based on input from the cable/circuit analysis, no spurious behavior of instrumentation (e.g., false or lost indications) or spurious equipment actuations can occur in this fire beyond those with the following general characteristics. (1) The spurious events are not associated with safety-related equipment and instrumentation relevant to the critical safety functions, and hence will be only minor distractions, not immediate challenges to safe shutdown. (2) The operators can discern the events to be clearly attributable to the fire. (3) The events do not need immediate responses or corrective actions from the crew (e.g., to prevent damage to critical safety function equipment or damage to the core) while attempting to achieve safe shutdown.
3. One train/division of safe shutdown, related equipment and instrumentation is completely free of any spurious events or failures directly associated with the fire, allowing the crew to maintain the critical functions and reach safe shutdown per the EOPs (e.g., heat removal, RCS inventory, etc.).
4. Those members of the MCR crew most directly responsible for achieving and maintaining safe shutdown (i.e., the board operators responsible for controlling and monitoring plant status and the crew supervisor responsible for reading the procedures and directing crew actions, etc.) will not have significant additional responsibilities. That is, they will be able to remain in the EOPs (as when responding to an internal event) or, if they are to follow FEPs, those FEPs *closely* resemble the EOP actions (so that the Internal Events PRA HFEs can still be deemed relevant for their definition and quantification). One way to demonstrate this, for instance, would be if someone else is responsible for dealing with the fire-specific response procedures and the actions associated with those procedures do not significantly disrupt the above MCR members' responsibilities and actions related to reaching safe shutdown. The fire-specific actions also should not divert personnel normally needed to assist the MCR crew in reaching safe shutdown.
5. There is no significant environmental impact or threat to the MCR crew (e.g., no significant smoke, potential toxic gases, loss of lighting if not already part of the Internal Events PRA HFE, such as for station blackout, etc.).
6. There is no reason to suspect that the time available to diagnose and implement the action(s) being addressed would be significantly different than in the Internal Events PRA-related scenario(s) for which the HFE(s) apply.
7. A dependency assessment of the applicable HFEs in the Internal Events PRA has been performed per the ASME Standard [12.2] to ensure that the dependencies are accounted for in the Fire PRA. Potential dependencies created either by the fire effects or the associated introduction of new HFEs into the model need to also be addressed. If new HFEs related to the fire have been added to the model, these new actions should be shown to not create new dependencies among the HFEs in the accident sequence and that any likely strong dependencies have been accounted for during the screening, so that accident sequences/cut

sets are not artificially removed because of multiplying many supposedly independent HEPs together.

8. If any of the HFEs being modeled are local (i.e., ex-control room) manual actions that were originally modeled in relevant accident sequences in the Internal Events PRA, it should be shown that achieving the local actions will not be significantly affected by the presence of fire from an environment and accessibility perspective (e.g., no significant interference from smoke or toxic gases either in traveling to the location of the action or in executing that action; no loss of lighting; no new high radiation threat; etc.). It should also be demonstrated that the staff assumed to conduct the action will still be available, i.e., they will not be conducting other fire-related responses such as isolating electrical equipment or supporting the fire brigade, etc. Furthermore, other conditions assumed in evaluating the corresponding Internal Events PRA local action (i.e., need for special tools, communication capability, adequacy of procedures and training) should not be significantly different under fire conditions. (Note: If SCBAs are needed to carry out the local action, these Set 1 criteria are not met for that action).

If all of the conditions for Set 1 are met, the Internal Events PRA HEPs for the applicable HFE(s), multiplied by a factor of 10 to account for the effects of potential fire brigade interaction and other minor increased workload and/or distraction issues, can be used as screening values for initial evaluations of the Fire PRA model in Task 7 and beyond.

12.5.3.3 Screening Values Under Set 2

This set addresses a special case where the Set 1 criteria related to spurious events are not met, but a reasonable screening value can still be applied. The Set 2 criteria still apply only to HFEs that were previously modeled in the Internal Events PRA. If the Set 2 criteria are met, screening values of 0.1 or 10 times the Internal Events PRA values, *whichever is greater*, can be used, but potential dependencies across events in a scenario need to be examined (as discussed under Set 1) and the total joint probability of the HFEs in the scenario should be reasonable, as outlined by the ASME Standard [12.2].

12.5.3.4 Set 2 Criteria

If all of the Set 1 conditions are met except significant spurious electrical effects are likely occurring in one safety-related train/division (and one train/division only) of equipment and/or instrumentation important to the critical safety functions, and hence may need some corrective responses on the part of the crew, the HFEs from similar scenarios modeled in the Internal Events PRA may be assigned a Set 2 screening value as long as appropriate dependencies are considered. The point of this Set 2 condition is that in Set 1, the spurious effects are not in safety-related, critical function-related equipment, and do not need any immediate response from the crew. In Set 2, the crew might have to attend and respond to the spurious activity in the affected train/division to make sure it does not affect their ability to reach safe shutdown (e.g., causing a diversion of all injection). However, the crew would likely detect the spurious activity quickly and not be confused by it. They would still have at least one train/division of safe shutdown equipment unaffected, and they would still be likely to conduct the safe shutdown actions as indicated by the procedures without significant delays.

12.5.3.5 Screening Values Under Set 3

These criteria address (1) new HFES added to the Fire PRA or (2) prior Internal Events PRA HFES needing to be significantly altered or modified in Step 1 of this procedure because of fire conditions. In such cases, pre-existing Internal Events PRA HEPs either do not exist, or are not appropriate as a basis for the Fire PRA. Depending on the criteria, a screening value of either 1.0 or 0.1 may be used.

12.5.3.6 Set 3 Criteria

1. If the action being considered is either a MCR or local (i.e., ex-control room) manual action and it is to be performed within approximately 1 hour of the fire's initiation, set the HEP to 1.0 for screening. The 1-hour limit is both a reasonable limit for early response actions that will most likely be (or need to be) completed, as well as a time beyond which most plants can have additional personnel and any technical support group available at the plant site.
2. If the action is not necessary within the first hour, the fire can be assumed to be out and thus not continuing to cause delayed spurious activity and other late-scenario complicating disturbances, and that there is plenty of time available to diagnose and execute the action, set the HEP to 0.1 for screening. The analyst still needs to ensure that potential dependencies across HFES in the models and the joint probabilities of multiple HFES are accounted for per the ASME Standard (ASME RA-S-2002 [12.2]). That is, that the fire effects and the inclusion of the new actions in the model do not create significant new dependencies among the HFES (new and old) in the model. If unaccounted-for dependencies are likely to exist, a 1.0 screening value should be used, or dependencies accounted for in some other way as part of the quantification.

12.5.3.7 Screening Values Under Set 4

This criterion addresses HFES associated with the decision to abandon the MCR and all subsequent actions in reaching safe shutdown. Because of (1) the unique nature of the decision to abandon the MCR, (2) the wide variability on how and where plants implement safe shutdown when the MCR is abandoned, and (3) it is unlikely that it would be possible to screen such actions anyway, unless the applicable fire initiating frequencies are extremely low, a global screening value of 1.0 should be assigned for this entire set of actions. This acknowledges that more detailed analysis will likely be needed for these types of scenarios, and thus screening is not appropriate for these cases.

12.5.3.8 Set 4. Criterion

All HFES involved in MCR abandonment and reaching safe shutdown from outside the MCR, including HFES representing the decision to abandon the MCR, should be assigned screening values of 1.0. More detailed analysis is needed either before the screening runs of the fire model or afterward.

12.5.4 Basis for Quantitative Screening Values

It is acknowledged that the above set of screening values do not have a direct empirical basis. The values selected are based mainly on experience with the range of screening values traditionally used and accepted in HRA (e.g., in the HRAs performed for the NRC Individual Plant Examination Program); experience in quantifying HEPs for events in NPP HRAs; experience in applying a range of HRA methods and the values associated with those methods; and experience in performing HRA in Fire PRAs. Admittedly, the screening approach may be conservative for some cases. However, this is necessary to avoid being overly optimistic for potentially important and/or complex scenarios and associated HFEs.

12.5.5 Step 3: Performing Detailed Best-Estimate Analyses of the Important HFEs

After (1) identifying and incorporating the HFEs into the Fire PRA per Step 1, (2) assigning screening values for the HEPs per Step 2, and (3) performing Task 7, Quantitative Screening, and any other subsequent refinements of the model to determine the scenarios and operator actions most important to the fire risk, certain HFEs and their HEPs need to be reevaluated for their best-estimate values to obtain a more realistic assessment of fire risk (i.e., the screening HEPs should no longer be used).

There are numerous HRA methods and tools in common use for evaluating and quantifying human actions in a PRA model. While all have their respective strengths and weaknesses, and it is not the purpose of this procedure to direct the use of any particular approach, none provide explicit instructions for how to incorporate the effects of fire-related conditions on human performance. Yet, to adequately defend the final best-estimate HEPs in the fire model, the analysts need to account for these fire effects in deriving these best-estimate HEPs for the Fire PRA. This step covers effects that are to be considered in the best-estimate evaluations. How these effects are explicitly accounted for is up to the analyst and will depend in large part on the capability of the HRA method/tool being used to account for, either directly or indirectly, the fire-related effects on operator performance. For example, it may be desirable to use an expert elicitation approach because of the flexibility to treat additional effects not explicitly handled in methods with an established list of performance-shaping factors¹⁵. It may, instead, be desirable to use a method with a prescribed list of performance shaping factors (PSFs) but in a way that reasonably accounts for the fire effects, as discussed below. However it is done, the analysts should demonstrate how these fire effects have been accounted for when performing these best-estimate analyses.

To perform these analyses, a prerequisite for best-estimate HRA quantification is suggested, but not necessary, that goes beyond the typical HRA team makeup. The participation of an individual or individuals with experience in human behavior in fires (e.g., firefighter trainers, military trainers, or others familiar with how fires might influence crew behavior, etc.) might be helpful to the team during the detailed quantification phase. Individuals with such experience can help analysts make informed judgments about how a fire context might influence a particular set of crew or operator responses. They may help the analysts decide how to translate the fire effects into a factor the tool for quantification “understands” (e.g., workload, stress, complexity), or help

¹⁵ For example, see: Forester, J., Bley, D., Cooper, S., Lois, E., Kolaczowski, A., Siu, N., Wreathall, J. “Expert Elicitation Approach for Performing ATHEANA Quantification,” *Reliability Engineering and System Safety*, Vol. 83, No. 2: 202-220, February 2004.

identify appropriate adjustments to HEPs given the fire effects. If people with this experience are used, it should be recognized that the duties and environment of plant operators are different than firefighters. Thus this experience may only marginally apply or may only be helpful for local manual actions that have to be performed near heat or smoke conditions.

It is expected that performance of the best-estimate HRA for the Fire PRA will follow the same approach of any HRA as dictated in the ASME Standard [12.2], and that approach is not reproduced here (e.g., we do not discuss a need to conduct a sanity check at the end to make sure the relative HEPs seem reasonable). This procedure does address unique fire effects that need to be accounted for in the best-estimate evaluations. This is done by discussing a set of PSFs that should be addressed, with particular focus on those fire-related considerations to include when assessing the impact of the PSFs on quantifying the HEPs. Recognize that not all of the PSFs and related considerations will be relevant for all HFEs, and some may be more important than others, depending on the specific scenario context and action being analyzed.

12.5.5.1 PSFs and Fire Effects to Consider

This section addresses the PSFs and related fire effects that should be considered in performing the detailed HEP evaluations. As stated above, it is not the intent of this procedure to provide a prescribed method for treating each PSF as this will be HRA method/tool dependent based on the capabilities of the method/tool and what PSFs are already handled by the method/tool. It should be recognized that for specific actions in specific scenarios, some of the PSFs may not apply. Also, there may be HFEs and contexts for which some PSFs are so important, that others do not matter (e.g., time available is so short the action almost assuredly cannot be done regardless of the other factors). Consideration of the impact of the factors on the HEPs should be as plant- and accident sequence-specific as necessary. In addition, these PSF influences should be confirmed, where useful, by such techniques as talk-throughs, walkdowns, field observations, simulations, and examination of past events in order to be realistic. The overall goal should be that the factors seemingly most relevant to the HFE (either as positive or negative influences) and having the most impact on the HEP have been considered quantitatively.

There is a wide range of commonly used HRA methods and tools. Some methods utilize very few PSFs and provide associated quantitative guidance for assessing the HEP based on those PSFs. Others rely on elicitation techniques that allow for a wide flexibility in identifying the PSFs to be considered and in determining how the resulting HEPs are quantified. The guidance provided here focuses on the identification of fire-relevant PSFs. Whenever possible the same HRA method/tool used in the internal events PRA should be used to quantify the HEP taking into consideration the fire-related PSFs described in this procedure. For example, if the method/tool being used for the HRA analysis addresses staffing resources as a PSF and provides guidance for how to quantify the HEP considering a negative/neutral/positive finding about this PSF, then the fire-specific HEP evaluation should follow the same general approach. If it is not possible to directly match a PSF listed here with a PSF addressed by the method/tool being used, then the analyst should attempt to find a sufficiently close match, or a surrogate match, that will allow the evaluation to remain consistent with the general approach of the method/tool being used. For example, consider a method that is largely based on a time reliability correlation. In this case, the method/tool being used does not provide a means for directly accounting for the effect of insufficient staff resources, but does account for time available and time to take the

action. In such a case, the analyst could defend an assumption that the observation of insufficient resources will be manifested by the available crew taking longer than usual to conduct the action(s). Judging the increased time necessary and treating it within the method/tool being used could be accomplished using a surrogate PSF accounting for too few resources to perform the desired actions. For extreme cases where the method/tool used, for example in the internal events analysis, has no reasonable way to account for a PSF of the type described here, use of other methods/tools may be appropriate for the Fire PRA. Alternately, an expert elicitation or judgment process may be required (preferably with operator/trainer involvement).

Besides assessing the mean value for the HEP, many methods/tools provide some guidance for assigning an uncertainty distribution to the HEP. In assessing the uncertainties and particularly when assigning specific uncertainty distributions to the HEPs, the uncertainties should include consideration of the following:

- Epistemic (i.e., state of knowledge) uncertainties that may arise due to the lack of knowledge of the true expected performance of the human for a given context and in light of the associated set of PSFs. Some of the PSFs may lack a sufficient base of knowledge or understanding so as to quantify their impact on the related HEP (e.g., how time of day affects the bio-rhythm and hence, performance of operators).
- Combined effect of the relevant aleatory (i.e., random) factors *to the extent they are not specifically modeled in the PRA* and to the extent that they could significantly alter the context and PSF evaluations for the HFE, and thereby the overall HEP estimate.

Concerning the latter, it is best to specifically model the aleatory uncertainty factors in the PRA (i.e., those factors that are random and could significantly affect operator performance). For example, one potential source of an aleatory uncertainty is whether or not other nuisance alarms or equipment failures may co-exist with the more important failures in the sequence. A second example is whether a critical equipment failure occurs early in the sequence or late in the sequence. However, it is often impractical to explicitly quantify such uncertainties, and explicit treatment typically may not be done when it would make the PRA model excessively large and unwieldy. However, even if such factors are not treated explicitly, in assigning the mean HEP and uncertainty distribution analysts should reflect an additional contribution from random factors associated with the plant condition or overall action context. This can be done by considering the relevant aleatory (i.e., random) factors, their likelihoods of occurrence, and their effects on the HEP estimate.

To illustrate, consider a case where as a part of an accident sequence(s) it is judged that the human performance will be significantly affected by the number of “nuisance and extraneous failures.” That is, the HEP will be lower when no or few nuisance/extraneous failures exist. However, these two plant “states”, many versus few nuisance/extraneous failures, are not explicitly defined by the PRA model. Further, based on the analyst considering how the HEP is affected, a HEP value of P_0 would be estimated for when no or few nuisance/extraneous failures exist and a HEP value of P_1 would be estimated for when many do exist. Further, assume that the difference between P_0 and P_1 is significant (e.g., factor of 10). If the analyst can make a judgment as to the relative likelihood of many versus few nuisance alarms occurring, then a combined mean HEP can be determined and used in quantification. If, for example, it is judged that many nuisance/extraneous failures will occur about 50% of the time based on past experience, the resulting combined mean HEP value is $0.5P_0 + 0.5P_1$ considering this random factor. The overall

uncertainty about the combined mean HEP value should reflect the weighted epistemic uncertainties in P_0 and P_1 (such as by a convolution approach, via an approximation, or other techniques). While it is not expected that such a detailed evaluation be done for every random situation or for every HEP, the mean and uncertainty estimates for the most significant HEPs should account for any such perceived important aleatory factors that have not otherwise been accounted for. That is, if the aleatory factors, considering their likelihoods and effects on the HEP, are anticipated to have a significant impact on the resulting overall mean HEP then they should be accounted for.

Whatever uncertainty distributions are used, the shape of the distributions (log-normal, beta, etc.) are typically unimportant to the overall risk results (i.e., the PRA results are usually not sensitive to specific distributions). Further, typical uncertainties are expected to include values for the HEP that represent a factor of 10 to 100 or even more between the lower bound value and the upper bound value given the uncertainties associated with operator performance during fire situations. However, it should be noted that some distributions, e.g., log-normal, can give probabilities greater than 1.0 for HEPs that are relatively high and so may need to be adjusted, accordingly.

The PSFs that should be considered in the HEP evaluations for fire situations are provided below.

- Available staffing resources – Fire can introduce additional demands for staffing resources beyond what is typically assumed for handling internal events. These demands can take the form of needing to use and coordinate with more personnel to perform certain local (ex-CR) actions, as well as with the fire brigade and/or local fire department personnel. This latter issue will likely necessitate an operator(s) to be physically present with the firefighters, perhaps at the expense of the typical MCR staffing. The time of the fire (an aleatory uncertainty) could change the available staffing so that it needs to be addressed in the analysis (e.g., by explicitly modeling or assuming the worse-case staffing condition). Changes in the necessary/available staffing to achieve safe shutdown during a fire should also be addressed.
- Applicability and suitability of training/experience – The crew familiarity and level of training (e.g., types of scenarios, frequency of training or classroom discussions or simulations, etc.) for addressing the range of possible fires and potential actions to be performed may not be the same as for internal events (e.g., small LOCAs, loss of air). “Less familiarity” may need to be accounted for in assessing the impact of training.
- Suitability of relevant procedures and administrative controls – Depending on the fire, the operators may need to use other procedures or controls than those typically used in response to internal events. This could lead to less familiarity or even confusion with regards to implementing different or multiple procedures simultaneously. In some cases, especially for some ex-CR actions, some procedures might not exist or be readily retrievable, or ambiguous in some situations. Perform checks of the adequacy and availability of these other procedures that would be needed to address the fires modeled in the Fire PRA.
- Availability and clarity of instrumentation (cues to take actions as well as confirm expected plant response) – Fires can introduce multiple spurious events and indications unlike that expected in most internal events analyses. Tasks 2 and 5 specifically address the identification and modeling of spurious events in the Fire PRA. This can add confusion with

regard to the true plant status and the subsequent actions for operators to take as they sort out what is false from what is actually happening, as well as the need to address unwanted spurious events (e.g., spurious closing of an injection valve). This sorting out process can, at best, add to the time to perform necessary actions, and, at worst, cause the operators to not take appropriate actions at all or perform procedure-directed actions under the wrong circumstances or at the wrong time (e.g., by procedure, shutdown an otherwise operable pump because of a spurious high-temperature alarm). Consideration should be given to the spurious events and their effects that could happen with each postulated fire and how they may affect subsequent operator performance relative to the HFEs being analyzed.

- Time available and time needed to complete the act, including the impact of concurrent and competing activities – Many of the other PSFs may influence the overall estimate of the time available and needed to complete desirable actions. For example, spurious closure of a valve used in the suction path of many injection paths may need quick detection and response by the crew. Use of less familiar or otherwise different procedure steps and sequencing could change the anticipated timing of actions in response to a fire. Interfacing with the fire brigade may delay performing some actions. The desired actions may be more complex and necessitate an increased workload than for internal events response (e.g., disable an equipment item before repositioning it, as opposed to simply repositioning it during an internal event). Accessibility issues, harsher environments, the need for other special tools, etc., may also impact the overall timeline of how quickly actions normally addressed in response to internal events can be performed under fire conditions. Furthermore, potential fire growth and suppression could alter equipment failure considerations from those considered for internal events. The timing of important actions needs to be reconsidered with the fire and its effects.
- Environment in which the act needs to be performed – Fires can introduce new environmental considerations not normally experienced in the response to internal events. These include heat, smoke, the use of water or other fire-suppression agents or chemicals, toxic gases, and different radiation exposure or contamination levels. Any or all of these may affect the accomplishment of the desired action.
- Accessibility and operability of equipment to be manipulated – Fires and their effects (e.g., environment) could eliminate or at least delay the ability to take actions otherwise credited for internal events because the location is inaccessible. Additionally, fires can cause failure of equipment used in the desirable action (e.g., irreversible damage) so that it should be considered inoperable, even manually.
- The need for special tools (keys, ladders, hoses, clothing to enter a radiation area, etc.) – Fires may cause the need for special tools or clothing (e.g., breathing gear, protective clothing) not otherwise considered in response to internal events. The accessibility of these tools or clothing needs to be checked so that the desired actions can indeed be performed in a fire situation. Furthermore, the level of familiarity and training on using these special tools needs to be assessed.
- Communications – Necessary communications to carry out the desired actions may or may not be available in some fires. This needs to be checked, as does the level of familiarity and training to use any special communication devices.

- Team/crew dynamics and crew characteristics (degree of independence among individuals; operator attitudes, biases, rules; use of plant status checks; approach for implementing procedures, e.g., aggressive vs. slow and methodical, etc.) – The extent that typical crew dynamics may change as a result of responding to a fire instead of internal events, needs to be considered. For instance, if certain new or unique fire-related responsibilities have to be handled by a crewmember (e.g., interfacing with the fire brigade, directing the use of a FEP), that crewmember may no longer be available to perform the duties s/he usually performs in a plant trip as assumed in the Internal Events PRA. The use of plant status discussions by the crew may be delayed or performed less frequently, allowing less opportunity to recover from previous mistakes. To the extent the way the crew operates is different in a fire as opposed to internal events, these differences need to be accounted for, if significant. Such differences may be best determined by talk-throughs with operations staff, as well as observing simulated responses of fire scenarios.
- Special fitness needs – Should the fire and its effects cause the need to consider actions not previously considered under internal events, or changes to how previously considered actions are performed, checks should be made to ensure unique fitness needs are not introduced.

12.5.5.2 Special Case–MCR Abandonment

For fires that either directly cause an uninhabitable environment in the MCR or otherwise make plant monitoring and control extremely difficult from the MCR, the crew may need to leave the MCR and achieve safe shutdown wholly or in part from ex-CR locations. For the subsequent actions that need to occur, whether they involve using a remote shutdown panel (with, most likely, minimal controls and indications) or a number of local panels and equipment, all the above PSFs and related fire effects need to be considered when calculating best-estimate HEPs, as with all other HEPs in the model. However, it is likely that many of the PSFs may introduce more serious challenges to operator success, considering potential factors like less available instrumentation and controls; the need for organized involvement of many operators in various locations in the plant, including communications among the personnel; less familiar procedures and training; more time needed to reach the necessary locations and perform activities that in other situations could easily be done in the MCR; etc.

MCR abandonment also involves deciding “if and when” to leave the MCR, as well as new HFES, such as those involving isolation of MCR circuits, and perhaps more local and even sequentially important actions involving deenergizing and reenergizing equipment. In considering the decision to leave the MCR and performing the necessary subsequent actions, it is particularly important to consider as part of the PSF evaluations:

- the procedural/training approach and explicitness/clarity of the criteria for abandoning the MCR;
- the potential confusion about the need to evacuate the MCR, e.g., because of spurious signals and confusing indications;
- the potential impact of crew reluctance to abandon the MCR;
- the timeliness of the decision and, in particular, what kinds of problems related to reaching safe shutdown could arise because of delays in abandonment (for instance, (1) a conservative

assessment may be needed with regard to which actions may or may not have been taken in the Control Room before it is finally abandoned and (2) equipment potentially affected by the fire may have to be considered already failed or otherwise spuriously actuated before the Control Room is abandoned, depending on the expected fire growth and the timing of that growth);

- inappropriate abandonment of the MCR (i.e., incorrectly diagnosing the need to abandon the MCR) which could lead to a failure to reach safe shutdown;
- the general effects of crews no longer having access to all the information in the MCR;
- the number and complexity of the actions;
- the number of different locations to be visited;
- the extent to which multiple actions need to be coordinated or sequentially performed;
- the ability to communicate between different sites;
- the need to wear breathing apparatus or special clothing while performing the actions; and
- the adequacy of the human-machine interface at the remote shutdown and/or local panels.

12.5.5.3 Cases Where Little or No Credit Should be Allowed

When performing the best-estimate analyses for the more important HFEs, there are several cases in which credit for human actions should not be given or for which credit should be very limited. These include:

- Tasks needing significant activity and/or communication among individuals while wearing SCBAs. It is believed that communication under such conditions is very difficult, and until proven otherwise, where the levels of smoke, heat, or toxic gases are high enough to necessitate the use of SCBAs, the likelihood of success is assumed to be extremely low. Additionally, performing numerous and strenuous actions wearing SCBAs should also be given little credit for success and at least account for delays in carrying out the actions given the likely visibility and other similar difficulties.
- The fire could cause significant numbers of spurious equipment activations (and/or stops) and affect the reliability of multiple instruments. Actions that are based on such instruments and equipment should be assumed to fail, unless alternate sources of reliable information can be documented and a basis for using the alternate sources can be strongly supported. The additional time, complexity, availability of procedures, and other relevant PSFs contributing to identifying and using the alternate sources of information should be considered in determining the likelihood of success.
- Actions to be performed in fire areas or actions needing operators or other personnel to travel through fire areas should not be credited. Where alternate routes are possible, the demands associated with identifying such routes and any extra time associated with using the alternate routes should be factored into the analysis.
- Actions needing the use of equipment that could have been damaged such that even manual manipulation may be very difficult or unlikely to succeed (e.g., a hot short on a control cable has caused a valve to close and drive beyond its seat, possibly making it impossible to open, even manually) should not be credited. As typical of PRAs, repair-type recoveries should generally not be credited.

- Actions to be performed without the basic needs of procedure direction, training, special tools (if necessary), or sufficient time should not be credited.

12.5.6 Step 4: Documenting the Post-Fire HRA

The output of this entire task is a calculation package. In concert with the ASME Standard [12.2], this package should contain:

- all human actions and associated HFEs considered in the fire analysis,
- the description of the HFE and especially its context in the fire scenarios,
- the quantification method (screening or best-estimate), including the method/tools that were used,
- the basis for the derivation of the HEP with particular attention as to the evaluation of (1) dependency considerations and (2) the PSFs and related fire effects, the assigned HEP uncertainty values and their bases, and
- an assessment of the assumption's sensitivity in the HRA modeling and quantification to the PRA risk measures.

12.6 References

- 12.1 Alan D. Swain, *Accident Sequence Evaluation Program Human Reliability Analysis Procedure*, NUREG/CR-4772, SAND86-1996, Sandia National Laboratories, February 1987.
- 12.2 *Standard for Probabilistic Risk Assessment For Nuclear Power Plant Applications*, ASME RA-S-2002, American Society of Mechanical Engineers, April 5, 2002 and Addenda ASME RA-Sa-2003, December 5, 2003.
- 12.3 *Technical Basis and Implementation Guidelines for A Technique for Human Event Analysis (ATHEANA)*, U.S. NRC, NUREG-1624, Revision 1, May 2000.
- 12.4 *SHARPI - A Revised Systematic Human Action Reliability Procedure*, EPRI NP-7183-SL, December 1990.
- 12.5 *Good Practices for Implementing Human Reliability Analysis (HRA)*, U.S. NRC, NUREG-1792, 2005.

13

SEISMIC-FIRE INTERACTIONS ASSESSMENT (TASK 13)

13.1 Purpose

The Fire Risk Scoping Study [13.1] identified the following four seismic-fire interaction issues:

- 1.8. Seismically induced fires
- 2.9. Degradation of fire suppression systems and features
- 3.10. Spurious actuation of suppression and/or detection systems
- 4.11. Degradation of manual firefighting effectiveness

It is recommended that a Fire PRA include a qualitative assessment of these issues. In this procedure, a recommended approach is given.

This procedure does not provide a methodology for developing models and quantifying risk associated with fires caused by a severe seismic event. This is due to a combination of limitations in the state of the art, and the perceived low level of risk from these fires. The low risk is based on the low frequency of an earthquake that can initiate a challenging fire and degrade various plant fire protection defense-in-depth elements, and the general seismic ruggedness of the NPPs as part of their design basis. This procedure outlines a series of steps intended to verify this premise. If the verification steps outlined in this procedure do not preclude the risk significance, either a quantitative assessment or consideration of physical or procedural changes may follow.

13.2 Scope

Consistent with the recommendations of Reference [13.1] and those outlined in the EPRI FIVE [13.2] and Fire PRA Implementation Guide [13.3], recommended practice in the seismic fire interactions assessment utilizes a qualitative, walkdown-based approach, rather than quantitative methods to estimate associated risk. This task provides a stand-alone study of the effects of a fire due to an earthquake. This task is not intended to develop quantitative estimates of the risk associated with seismic-fire interactions.

13.3 Background Information

13.3.1 Seismically Induced Fires

There is a potential that a significant seismic event could trigger fires within or outside the plant. Postearthquake fires in typical urban and industrial settings are most often associated with pipes or storage tanks containing flammable gasses (e.g., natural gas, hydrogen) or liquids (such as gasoline, fuel oil, etc.). However, flammable liquids and gasses are not the only potential fire hazard.

There is also a potential for fires arising from the failure of electrical equipment during an earthquake, even though these fires tend to have significantly less consequence due to the absence of large amount of flammable and/or combustible material. Unrestrained or inadequately restrained electrical equipment may be physically displaced or tip over during a seismic event. This could cause electrical fires through physical damage to, in particular, electrical cables and connections feeding power to the components. Furthermore, firefighting response may also be compromised and/or complicated by the seismic event (as discussed in the context of the other three seismic-fire interaction issues), so that if a fire occurs as the result of an earthquake, it would have a greater potential for long duration than general plant fires.

A survey of over 100 plant and industrial facilities after 18 major earthquakes was conducted by EPRI in 1990 [13.4]. Reference [13.3] reviewed this study and reports that postearthquake fires in such facilities were not common. To date, no incidence of a post-earthquake fire impacting a NPP has been documented. Clearly, such events are rare, although no attempts have been made to estimate the likelihood of seismically induced fires in an NPP.

13.3.2 Degradation of Fire Suppression Systems and Features

Elements of the plant fire suppression systems may or may not be designed to withstand the effects of an earthquake. The seismically induced failure of fire suppression system components could lead to general unavailability of one or more fire suppression systems or to the discharge of fire suppressant into an undesired location. The second effect will be discussed in the context of the SO of fire protection systems. This section deals primarily with the potential that fire suppression systems may be unavailable following a seismic event.

As reported in References [13.1] and [13.3], a study by Brookhaven National Laboratory (BNL) concluded that fire suppression systems installed in accordance with nationally recognized codes and standards generally provide an adequate level of support for piping under seismic conditions [13.5]. The most significant potential vulnerability identified in the BNL study was inadequate lateral constraint that could allow for movement of, and damage to, sprinkler heads, should they impact other nearby objects. Reference [13.1] also identifies inadequate restraint of gaseous suppressant bottles as a potential concern. A final area of concern cited in Reference [13.1] was the use of cast-iron fire mains, given that cast iron is known to be seismically weak.

Reference [13.6] recommended the use of seismic category II-over-I design criteria for the installation of fire protection piping and components. Hence, depending on the specific plant design approach, it may be possible to demonstrate a reasonable level of assurance that fire suppression systems will be seismically robust.

In general, seismic design is more likely in areas prone to significant seismic activity. It is also likely that seismic restraints have been provided within the plant in cases where the rupture of the fire suppression system could compromise Class 1E safe shutdown equipment (e.g., the Seismic II/I designs). However, the seismic ruggedness of fire suppression systems should not be assumed without some review of plant-specific design practice.

Depending on where a failure occurs, one or more specific fire suppression systems or features may be compromised. (Systems could include local sprinkler systems, and features could include manual hose stations.) For example, ruptures in the firefighting water main piping system (e.g., the yard main) could render all water-based fire suppression (e.g., sprinklers and manual hose stations) unavailable until repair actions are taken to, e.g., isolate the ruptures. Even given successful isolation of the ruptures, portions of the firefighting water system could remain isolated pending major repairs.

13.3.3 Spurious Actuation of Suppression and/or Detection Systems

In the event of an earthquake, it is possible that one or more of the fixed-fire protection systems (detection and/or suppression) will actuate. It is also possible that fire suppressant may be released in unintended locations due to piping breaks.

Both ionization and photoelectrical smoke detectors are vulnerable to actuation from dust and/or steam. Note that systems designed to detect incipient fires may be relatively robust against such exposure, as they are designed specifically to filter out a potential false signal due to dust or steam. For example, the NFPA Fire Protection Handbook [13.7] provides information on laser-based light scattering devices and air-sampling type smoke detectors designed to detect incipient fires. Heat detectors might also be activated given a substantial steam release. During a seismic event, it is likely that enough dust will be lofted to actuate any vulnerable detector. Steam may also be released in significant quantities given any ruptures to steam lines or piping. Hence, multiple detection signals are possible, if not likely. Sorting out valid from spurious fire detection signals could complicate the postearthquake response. In particular, multiple spurious detection signals could mask valid signals.

Similarly, some fire suppression systems may be vulnerable to spurious operation, including discharge resulting from physical damage to piping and control components.

- Relay chatter in non-seismically qualified fire protection system control panels could result in system actuation.
- A pipe break in a water-based system could cause the release of water in an unintended location and from an unexpected direction. Hence, equipment protected from sprinklers may still be sprayed by water.
- Deluge system trip valves may not be seismically robust and may spuriously open (or jam shut).
- Fusible links in sprinkler heads (and ventilation dampers) may actuate given a steam release.
- Systems tied to smoke detection (including cross-zone smoke detection) may receive actuation signals based on spurious actuation of the detectors.

- Spurious discharge of a gaseous suppression system could render a fire area (or zone) uninhabitable (e.g., CO₂).

In the event of a severe seismic event, multiple spurious operations or suppressant discharges could lead to potential flooding problems (e.g., water piping breaks), spraying of equipment from unanticipated directions, and/or diversion of suppressants away from actual fires.

13.3.4 Degradation of Manual Firefighting Effectiveness

A severe seismic event could impact plant operations, including actions associated with manual firefighting. As discussed above, there may be one or more actual fires initiated within the plant boundaries; there may be multiple fire detection signals (most of which may be false signals); one or more fire suppression systems may discharge (likely leading to additional alarms); and some elements of the fire suppression systems and features may be disabled.

In the postearthquake environment, it will be necessary for plant staff to assess the fire protection situation, in addition to other earthquake response activities. Depending on how the plant fire brigade is staffed, there may be conflicting assignments (e.g., security and maintenance personnel may be called on to perform other duties). If an actual fire does occur, some manual response will be required. Potential actions that may be necessary following a seismic event include the following:

- Respond to fire detection signals and reset detection systems,
- Confirm whether any actual fires exist and execute appropriate attack measures,
- Assess the condition of the fire suppression systems,
- Secure damaged fire suppression systems (e.g., leaking or broken pipes), and
- Ensure required access for safe shutdown response actions.

13.4 Assumptions

No specific assumptions are made in the conduct of this task.

13.5 Task Interfaces

13.5.1 Input from Other Tasks

This task utilizes component and cable mapping information developed in support of the Fire PRA (Support Task B). In particular, the task will ask that, to the extent possible, components and cables credited in postearthquake safe shutdown are mapped to specific fire analysis compartments.

13.5.2 Additional Plant Information Needed to Complete this Task

Information relating to the plant seismic design basis, earthquake response procedures, and any seismic plant response analyses (as available) will be required to complete this task. Seismic plant response analyses of interest may include seismic margins analysis, seismic PRA, seismic IPEEE analysis, or other seismic response analyses, as available.

13.5.3 Walkdowns

The recommended approach is walkdown-based. Participants in the walkdown(s) should include staff knowledgeable of the plant fire protection systems and features; the results of the plant fire risk analysis, including the postulated fire growth and damage scenarios for key fire areas; and the plant's seismic design basis and the assessment of seismic restraints.

13.5.4 Output to Other Tasks

There is no direct output from this task to other tasks beyond documentation of the PRA findings (Task 16).

13.6 Assessment Procedure

The seismic-fire interaction assessment procedure includes the following seven steps.

Step 1: Identify key seismic-fire interaction analysis compartments

Step 2: Assess potential impact of seismically induced fires

Step 3: Assess seismic degradation of fire suppression systems and features

Step 4: Assess the potential impact of spurious fire detection signals

Step 5: Assess the potential impact of spurious fire suppression system actuations

Step 6: Assess the potential impact of a seismic event on manual firefighting

Step 7: Complete documentation

13.6.1 Step 1: Identify Key Seismic-Fire Interaction Analysis Compartments

- Determine what systems and components are credited for postearthquake safe shutdown. Information (such as Safe Shutdown Equipment List, SSEL) from plant Seismic Margin Assessment (SMA) or Seismic PRA may be used.
 - Review plant earthquake response procedures and identify key components and systems credited for safe shutdown.

- Review any supplemental seismic plant response analyses (as available) to further identify components and systems important to postearthquake safe shutdown.
- Identify any manual actions required to support postearthquake safe shutdown.
- To the extent possible, map the postearthquake safe shutdown systems and components to those circuits and systems credited in the Fire PRA Model.
 - Use the Fire PRA cable and component mapping information (developed under Tasks 2 and 3) and other plant cable and component mapping information, as available.
 - Consider additional cable and component routing efforts only if post-earthquake safe shutdown functions cannot be mapped to fire compartments with reasonable confidence.
- Identify key seismic-fire interaction compartments where seismic-fire interactions could be risk important.
 - Identify the fire compartments that house the components and cables credited for post-earthquake safe shutdown.
 - Identify fire compartments where local manual control or repair actions may be needed in response to an earthquake.
 - Identify access paths within the plant required to support safe personnel passage and/or safe access following an earthquake.

13.6.2 Step 2: Assess Seismically Induced Fires

- For each key seismic-fire interaction analysis compartment identified in Step 1, assess whether or not fire ignition sources unique to a seismic event exist. Assess the acceptability/adequacy of existing seismic restraints for electrical equipment, flammable gas piping, and liquid or gaseous fuel storage tanks.
- Assess the potential for seismically induced fires to compromise postearthquake shutdown capability. Fire ignition source screening and analysis tools may be applied to support this assessment. Specifically, an ignition source screened in Task 8 may be excluded from consideration.
- If potentially significant seismically induced fires are identified, i.e., a fire compartment with a possible source and targets (i.e., targets identified in Step 1 of this task), consider providing additional protection. Possible measures may include:
 - Additional or upgraded seismic restraints,
 - Additional fire protection for either the exposing fire source or exposed safe shutdown targets (e.g., cables),
 - Enhancement of existing plant response procedures, and
 - Supplemental plant response procedures.

13.6.3 Step 3: Assess Seismic Degradation of Fire Suppression Systems and Features

- Review general plant practice regarding seismic restraints provided for fire suppression systems and components.
- Conduct a walkdown to assess the seismic ruggedness of plant fire protection systems and features.
 - Assess the seismic ruggedness of support items that could lead to a common-cause failure of multiple fire suppression systems. This would include fire pumps, primary firefighting water piping systems, standpipes, and firefighting water storage tanks/basins.
 - Assess the seismic ruggedness of the fire suppression capability for each of the key seismic-fire interaction analysis compartments identified in Step 1.
- Identify potential points of physical vulnerability for fire suppression systems and assess their impact on the availability of fire suppression following an earthquake.
- If potentially vulnerable fire suppression systems are identified in compartment(s) with the potential for significant seismically induced fires (from Step 2), consider measures to address any identified points of physical vulnerability. Possible measures may include:

Upgrading the seismic ruggedness of key components in the fire suppression system(s),

- Providing supplemental guidance in existing procedures or new procedures to ensure that the fire suppression capability is assessed and that leaks are secured promptly following a significant earthquake,
- Providing a capability to isolate piping breaks,
- Ensuring that there is a seismically robust source of manual firefighting water to key areas of the plant (e.g., seismically robust hose stations and adequate hose supply to reach key fire areas). This includes any backup water supplies that are used in the event that local hose stations are compromised by the seismic event.

13.6.4 Step 4: Assess the Potential Impact of Spurious Fire Detection Signals

- Identify fire detection systems that may be vulnerable to spurious actuation during a seismic event.
- Review plant postearthquake response procedures and determine if provisions are made for dealing with multiple fire alarm signals.
- Consider potential enhancements to the existing procedures if such provisions are lacking.

13.6.5 Step 5: Assess the Potential Impact of Spurious Fire Suppression System Actuations

- Identify fire suppression systems for the key seismic-fire interaction analysis compartments identified in Step 1 that may be vulnerable to spurious discharge through actuation of the system, damage to discharge heads, or a rupture in system piping.

- Assess the potential for spurious fire suppressant discharge to compromise components and systems credited for postearthquake safe shutdown (from Step 1).
- If system is vulnerable to seismic actuation in a compartment with systems credited for postearthquake safe shutdown (Step 2), consider potential measures to reduce component vulnerability.

13.6.6 Step 6: Assess the Potential Impact of a Seismic Event on Manual Firefighting

- For each key seismic-fire interaction analysis compartment identified in Step 1, identify and assess manual firefighting access routes.
 - Identify potential features that could compromise these access routes (e.g., unsecured storage panels that might block an access route following an earthquake, doors that might jam closed following an earthquake, etc.)
 - Determine if alternate access routes are available.
- For each analysis compartment identified in Step 1, identify and assess those assets that may be needed to support manual firefighting.
 - Assess seismic robustness of hose stations.
 - Determine if an alternate source of firefighting water is available if the primary source is compromised.
 - Determine if sufficient length of hose is available to support use of an alternate firefighting water source.
 - Assess the seismic ruggedness of prestaged firefighting equipment storage (e.g., turnout gear storage racks, portable fire extinguishing equipment storage racks, fire fighting equipment “cages,” etc.).
- Review and assess plant seismic event response procedures for relevance to manual fire fighting activities.
- If the above examination leads to the conclusion that the ability of the fire brigade to perform in the event of a severe earthquake may be compromised, consider potential upgrades to enhance the seismic robustness of the post-earthquake manual firefighting capability.

13.6.7 Step 7: Complete Documentation

Document the results of the seismic-fire interaction assessment consistent with the level of detail afforded other aspects of the analysis.

13.7 References

- 13.1 *Fire Risk Scoping Study: Investigation of Nuclear Power Plant Fire Risk, Including Previously Unaddressed Issues*, USNRC, NUREG/CR-5088, January 1989.
- 13.2 *Fire-Induced Vulnerability Evaluation (FIVE)*, Electric Power Research Institute (EPRI), Rev. 1, September 1993. TR-100370.
- 13.3 *Fire PRA Implementation Guide*, Electric Power Research Institute (EPRI), 1995. TR-105928.
- 13.4 EPRI NP-6989, Electric Power Research Institute (EPRI), 1990.
- 13.5 Brookhaven National Laboratories, BNL/NUREG-25101.
- 13.6 USNRC, “Seismic Design Classification,” Regulatory Guide 1.29, Revision 3, September 1978.
- 13.7 *Fire Protection Handbook*, Chapter 2, Section 9, “Automatic Fire Detection,” National Fire Protection Association, FPH1897, Quincy, Mass., Eighteenth Edition, 1997.

14

FIRE RISK QUANTIFICATION (TASK 14)

14.1 Purpose

This section describes the procedure for performing fire risk quantification. This procedure provides the user a general method for quantifying the final Fire PRA Model to generate the final fire risk results.

14.2 Scope

This procedure addresses the following major steps for each of the major fire risk quantification tasks:

- Step 1–Quantify Final Fire CDF Model
- Step 2–Quantify Final Fire LERF Model
- Step 3–Conduct Uncertainty Analysis

In this task, the final Fire PRA model is quantified to obtain the final fire risk results. The final CDF and LERF models are quantified for each fire scenario.

Note that per Task 7, Quantitative Screening, it is expected that a number of fire compartments or fire scenarios will be screened out from the formal fire quantification results (i.e., not added into the calculated total plant fire-related CDF and LERF). It is expected that as a minimum, total plant CDF and LERF estimates will be provided by summing all the CDFs and LERFs for the unscreened fire compartments/scenarios. The significant contributors to the plant CDF and LERF should also be provided. In addition, it is also expected that the nature (e.g., type of sequences) of the screened out compartments/scenarios are at least identified and as a check of the cumulative screening criteria discussed in Task 7, it is recommended that the screened CDFs and LERFs also be summed separately to provide a perspective on the total residual risk from the screened compartments/scenarios. It should be emphasized that these screened portions of the results represent various levels of analysis (for instance, some may only involve fire scoping modeling; others may involve both detailed fire modeling and some detailed circuit analysis, etc.). Thus any ranking of these screened scenarios is not particularly appropriate and these screened summations of CDF/LERF are upper bounds of the residual risk and that in actuality, the residual risk is probably much less than these sums would indicate.

14.3 Task Interfaces

14.3.1 Input from Other Tasks

This task uses the plant response model (risk model) to quantify CDF and LERF. The model is initially developed in Task 5 (Fire Induced Risk Model), and modified in the quantitative screening done in Task 7. This task also requires input from Task 10 (Circuit Failure Mode Likelihood Analysis), Task 11 (Detailed Fire Modeling), and Task 12 (Post-Fire Human Reliability Analysis).

14.3.2 Additional Plant Information Needed to Support this Task

The Internal Events PRA model as modified for the Fire PRA of the NPP facility is needed to support this task. Additional information may be needed from the PRA model as insights are gained from quantifying the fire risk model. The Fire PRA analysts should also have access to the software tools required to quantify the PRA Model. Access to the ASME Standard for Probabilistic Risk Assessment for Nuclear Power Plant Applications (ASME RA-S-2002) [14.1], and particularly the accident sequence quantification and LERF requirements in the standard, may be beneficial, as well.

14.3.3 Walkdowns

No walkdown is required to support this task.

14.4 Background Information

14.4.1 General Task Objectives and Approach

This task provides a general approach for quantifying the Fire PRA Model and generates the final fire risk results. There are at least two different approaches for developing the Internal Events PRA Model (which also apply to the Fire PRA Model). These two models, in the evolution of PRA methodology development efforts have come to be known as the “Fault Tree Linking Approach” and “Event Trees with Boundaries Approach”. There are a number of different PRA software products available in the market designed around these two approaches. The approach described in this procedure is based on standard state-of-the-art PRA practices and is intended for any PRA methodology or software product. This procedure allows the user to quantify CDF and LERF or CCDP and CLERP. The only difference is that the quantified values of the fire scenario frequencies are used for CDF and LERF calculations, while the fire scenario frequencies are set to 1.0 or TRUE for CCDP and CLERP calculations.

14.4.2 Assumptions

This procedure assumes that the Fire PRA analyst is familiar with the PRA methodology and software employed at the NPP. The analyst should also be familiar with the procedures for quantifying the PRA Model. The analyst should be familiar with the ASME Standard for Probabilistic Risk Assessment for Nuclear Power Plant Applications (ASME RA-S-2002) [14.1] and should use the approach therein covering Sections 4.5.8 (for HLR-QU-A, B, C, D) and 4.5.9 (for HLR-LE-A, B, C, D, E, and F1) when quantifying the Fire PRA Model following the steps below.

14.4.3 Outputs to Other Tasks

This is the final task of the Fire PRA quantification process. The output of this task is used in Task 16 (Fire PRA Documentation). Note that Task 15 (Uncertainty Analysis) is addressed during preceding tasks and this task as well.

14.5 Procedure

The section describes the detailed procedure for performing the fire risk quantification. With the exception of fire-specific elements of the quantification, this procedure relies heavily on the approach provided in the ASME PRA Standard [14.1]. The Fire PRA Model developed in previous tasks is used to quantify CDFs and LERFs for each fire ignition event.

14.5.1 Step 1: Quantify Final Fire CDF Model

In this step, the Final Fire PRA Model developed in previous tasks is used to quantify CDFs for each fire scenario identified in Task 11. With the exception of fire-specific issues addressed in this procedure, the approach provided in the ASME PRA Standard should be used to implement the quantification process. The final Fire PRA model, the HRA values provided in Task 12 (including any insights from the HRA dependency analysis), and the fire scenario frequencies developed in Task 11 are used to quantify CDFs for each fire ignition event. The CCDPs can be quantified by setting the fire scenario frequencies to 1.0. The fire scenario frequencies are combined with the appropriate CCDP values to quantify CDFs.

Alternatively, the fire scenario frequencies and the HRA values (including any insights from the HRA dependency analysis) may be incorporated into the final Fire PRA Model. For this option, CDFs may be calculated directly. Calculation of fire-induced CCDPs will not be necessary and Step 1.1 can be skipped.

14.5.1.1 Step 1.1: Quantify Final Fire CCDP Model

In this step, the final Fire PRA Model and the HRA values provided in Task 12 (including any insights from the HRA dependency analysis) are used to quantify CCDPs for each fire scenario identified in Task 11. The mean values of the epistemic distributions should be used for all the variables for which uncertainties are quantified. The fire scenario frequencies are set to 1.0 during the quantification of CCDPs. With the exception of fire-specific procedures, the approach provided in the ASME PRA Standard [14.1] should be used to quantify CCDPs.

14.5.1.2 Step 1.2: Quantify Final Fire CDFs

In this step, the fire scenario frequencies provided in Task 11 are combined with the appropriate CCDPs to quantify CDFs for each fire scenario. If the fire scenario frequencies and the HRA values were incorporated into the final Fire PRA Model, CDFs may be calculated directly. Similar to the preceding substep, the mean values of the scenario frequencies should be used.

14.5.1.3 Step 1.3: Identify Main Contributors to the Fire CDF

Using the results of the preceding steps, the analysts may organize the minimal cut sets in terms of largest contribution to the CDF. The results can be organized in different ways to provide insights about fire risk. The cut sets can be organized by fire scenarios, by compartments where fire ignition occurs, by plant damage states, post-fire operator actions, etc.

14.5.2 Step 2: Quantify Final Fire LERF Model

In this step, the Final Fire PRA Model developed in previous tasks is used to quantify LERFs for each fire scenario. With the exception of fire-specific procedures, the approach provided in the ASME PRA Standard [14.1] should be used to implement the quantification process. Similar to CDF calculations in the preceding task, the final Fire PRA Model, the HRA values provided in Task 12, and the fire scenario frequencies developed in Task 11 are used to quantify LERFs for each fire scenario. The CLERPs can be quantified by setting the fire scenario frequencies to 1.0. The fire scenario frequencies are combined with the appropriate CLERP values to quantify LERFs.

Alternatively, the fire scenario frequencies and the HRA values may be incorporated into the final Fire PRA Model. For this option, LERFs may be calculated directly. Calculation of fire-induced CLERPs will not be necessary and Step 2.1 can be skipped.

14.5.2.1 Step 2.1: Quantify Final Fire CLERP Model

In this step, the final Fire PRA Model and the HRA values provided in Task 12 (including any insights from the HRA dependency analysis) are used to quantify CLERPs for each fire scenario. The mean values of the epistemic distributions should be used with all the variables for which uncertainties are quantified. The fire scenario frequencies are set to 1.0 during the quantification of CLERPs. With the exception of fire-specific procedures, the approach provided in the ASME PRA Standard [14.1] should be used to quantify CLERPs.

14.5.2.2 Step 2.2: Quantify Final Fire LERFs

In this step, the fire scenario frequencies provided in Task 11 are combined with the appropriate CLERPs to quantify LERFs for each fire scenario. If the fire scenario frequencies and the HRA values were incorporated into the final Fire PRA Model, LERFs may be calculated directly. Similar to the preceding substep, the mean values of the scenario frequencies should be used.

14.5.2.3 Step 2.3: Identify Main Contributors to the Fire LERF

Similar to Step 1.3, using the results of the preceding steps, the analysts may organize the minimal cut sets in terms of largest contribution to LERF. The cut sets can be organized by fire scenarios, compartments where fire ignition occurs, plant damage states, post-fire operator actions, etc.

14.5.3 Step 3: Propagate Uncertainty Distributions

Using the main contributors identified in Steps 1.3 and 2.3, the probability distributions representing epistemic uncertainties can be propagated through the CDF and LERF calculations using, for instance, Monte Carlo or Latin hypercube protocols. The final outcome will be probability distributions for CDF and LERF.

In this step, the impact on final results of various uncertainty issues addressed in each task using the approach provided in Task 15 will become apparent. In performing the uncertainty analyses, results may be reported on an individual issue basis (see Task 15) as well as in logical integrated groups, as appropriate. Thus, if two or more issues have a logical connection/interface such that their combined effects should also be noted, it is expected the combined results will be provided along with the individual issue effects. Where advisable, quantitative and qualitative results may be combined and discussed as a group. The analysts are encouraged to provide whatever perspectives are appropriate to make understanding the Fire PRA results more robust and to identify how the results might be different when considering individual as well as logical combinations of uncertainties.

14.5.4 Step 4: Sensitivity Analysis

In this step, the validity of the sensitivity cases identified in Task 15 are verified first, followed by a repeat of CDF and LERF calculations for each case.

14.5.4.1 Step 4.1 Identification of Final Set of Sensitivity Analysis Cases

In Task 15, a set of sensitivity analysis cases is identified. It is recommended that the Fire PRA group meet again to review those cases in light of the insights gained in the preceding steps of this task. A new set of sensitivity analysis cases may result.

14.5.4.2 Step 4.2 CDF and/or LERF Computations and Comparison

Mean CDF and/or LERF values should be computed for each sensitivity analysis case considered in the preceding substep. The results should be compared with the base-case considered in Steps 1 and 2. The comparison would yield insights that may lead to changes in the primary assumptions underlying the Fire PRA.

14.6 References

- 14.1 *Standard for Probabilistic Risk Assessment for Nuclear Power Plant Applications*, ASME RA-S-2002, April 5, 2002 and Addenda, ASME RA-Sa-2003, December 5, 2003.

15

UNCERTAINTY AND SENSITIVITY ANALYSES (TASK 15)

15.1 Purpose

This procedure describes the approach for identifying and treating uncertainties throughout the Fire PRA process and identifying sensitivity analysis cases. It also prescribes a review for the identified uncertainties among the Fire PRA analysts to establish an integrated approach of addressing the effects of these uncertainties on the results of the analysis. At this time, the procedure provides a general approach to be followed and does not provide a comprehensive list of specific uncertainties to be addressed. As pilot Fire PRAs and other studies are completed, this procedure may be revised accordingly.

15.2 Scope

This procedure covers the identification and treatment of uncertainties throughout the Fire PRA. As such, it provides: (1) background on the subject of uncertainty found in Appendix U, (2) classification of types of uncertainty, and (3) a general approach with regard to practical implementation of treating expected uncertainties in the Fire PRA, as described in Appendix V.

15.3 Background Information

15.3.1 General Task Objectives and Approach

Many of the inputs that make up CDF and LERF estimates are uncertain (e.g., fire frequencies, extent of fire growth, equipment failure probabilities, operator action probabilities, etc.). Since many of these inputs are commonly treated as the result of random processes in the PRA, the core damage events and large early release events are modeled as possible results of a set of interacting random processes, specifically, those involving a fire that causes a plant transient, the response of mitigating systems to the transient including fire effects, and the associated actions of human operators. Hence, the occurrences of core damage and large early release events are also, therefore, treated as random events.

The various fire-induced accident sequences and their frequencies modeled in the Fire PRA characterize the *aleatory* uncertainties (see Appendix U for a discussion on this type of uncertainty) associated with the occurrence of a fire and possible plant and operator responses. Each input of the modeled accident sequences (i.e., initiating event frequency, equipment failure probabilities, and human error probabilities) also includes *epistemic* uncertainties (see Appendix U) with regard to the frequencies and probabilities described by distributions. Sampling

techniques (e.g., Monte Carlo, Latin hypercube) are typically used to propagate the *epistemic* uncertainties to generate a probability distribution for each accident sequence frequency, and from that, CDF and LERF uncertainty distributions.

In light of this, it is important that users of the results of the Fire PRA understand the fundamental modeling assumptions underlying the analysis and the sources of uncertainty associated with the results. In particular, in the case of a PRA, it is important to understand how the analysis deals with uncertainties that arise because of issues not explicitly modeled or imperfect knowledge concerning issues that are modeled. Some uncertainties may be specifically included in the quantification of the results as described above; others may only be qualitatively addressed or not addressed at all. This understanding of what uncertainties are addressed and how, will affect how a user perceives and uses the analysis results in subsequent decision-making activities.

It is important that the uncertainties with the most significant effect on the accuracy and precision of the results be identified and their effects summarized. This procedure serves three purposes toward this overall goal; it: (1) provides background on the subject of uncertainty useful for the Fire PRA analysts, (2) offers a general approach on the identification and treatment of uncertainties for each respective task area, and (3) provides helpful notes and practices for a team of analysts when performing an integrated review of the uncertainties and making final decisions as to the treatment of the uncertainties.

15.3.2 Assumptions

The reader is referred to Appendix U for the underlying principles and theory upon which the identification and treatment of uncertainties, as espoused in this procedure, are based.

15.4 Task Interfaces

15.4.1 Input from Other Tasks

The analysts for Tasks 1 through 13 are expected to follow the overall approach provided in this procedure to articulate and quantify, when necessary, the uncertainties in their numerical results. For each affected task, the following information will be needed for uncertainty analysis:

- Sources of uncertainties, and
- Proposed approach for addressing each of the identified uncertainties.

This information has been developed in writing this procedure and the results are provided in Appendix V. It is expected that specific uncertainties worthy of uncertainty or sensitivity analyses will be identified during the performance of a plant-specific Fire PRA. To that extent, the issues addressed here should be modified to reflect the key uncertainties identified on a plant-specific basis.

15.4.2 Additional Plant Information Needed to Support this Task

None.

15.4.3 Walkdowns

Not applicable.

15.4.4 Outputs to Other Tasks

This procedure provides an overall approach to all the other tasks on suggested ways to address the uncertainties associated with each task in the Fire PRA process. In addition to uncertainty analysis, the identification of possible sensitivity analysis cases is addressed in this procedure. Once the integrated uncertainty review is performed and specific strategies for uncertainty analysis are identified and implemented, the results of those analyses should be reflected in the documentation of the Fire PRA (Task 16), including the overall results and conclusions of the PRA. Similarly, sensitivity analysis cases are proposed to be executed in Task 14.

As the Fire PRA process is carried out (as alluded to in Section 15.4.1), the level of analysis detail evolves and the results, including their significant drivers, will become clear. During this time, modifications of the uncertainties and their treatment may be appropriate. At whatever level of specificity, acknowledging the uncertainties and whether they are modeling or data uncertainties should be made part of the overall documentation of the Fire PRA. Therefore, this procedure may have to be revisited as Fire PRA task execution progresses, and as new information and results are collected or obtained. The intermediate task results may shed new light on the relative importance of various sources of uncertainty and sensitivity analyses.

15.5 Procedure

The following steps make up the procedure for addressing the uncertainties associated with each task in the Fire PRA process, and for identifying appropriate sensitivity analysis cases as part of the final analysis.

15.5.1 Step 1: Identify Uncertainties Associated with Each Task

The first step in performing uncertainty and sensitivity analyses is the identification of those issues (sources of uncertainty) that may make the product(s) of each task uncertain. For purposes of this procedure, these have been identified at a general level in Appendix V. These sources of uncertainty can be used as a starting point for creating a plant-specific and study-specific list for each task. From a practical implementation perspective, uncertainties can be generally categorized as being of two forms:

1. Modeling (logic as well as phenomenology, and including completeness issues) uncertainties; and
2. Data (parameter) uncertainties.

The outcome of this task should be a list of issues by task that, in the judgment of the analyst, lead to potentially important uncertainties in task products. The type of uncertainties (i.e., modeling or data) should also be noted.

15.5.2 Step 2: Develop Strategies for Addressing the Uncertainties

The strategies to address the uncertainties may vary from no action to explicit quantitative modeling. In each Fire PRA task procedure, the analyst is expected to identify strategies along with the general identification of issues leading to uncertainties (Step 1). Appendix V provides suggested strategies for some of the issues. When each task is carried out, these strategies should be reviewed and reconsidered in light of the possible strategies. As necessary, the strategies should be altered based on insights from the analysis as it evolves, practical implementation requirements, resources, etc. Whatever is finally decided as the specific means to address each task's uncertainties, these strategies should also become part of the overall documentation of the Fire PRA. Possible strategies include (illustrative only—not meant to be a complete list):

- For data uncertainties – explicit quantification of epistemic uncertainties using probability distributions, and propagation of probability distributions using techniques like Monte Carlo Sampling and Latin hypercube sampling;
- For modeling uncertainties – developing multiple models for an issue (e.g., degree of fire growth for a particular fire), assigning a probability that each model is the ‘correct’ model based on engineering judgment, and hence propagating, probabilistically, these modeling uncertainties in the overall results;
- For both modeling and data uncertainties – identifying a base case as the best estimate model with best estimate data values, performing sensitivity analyses where the models or parameters of interest are varied within a reasonably expected range, and documenting the quantitative effect on the overall results;
- For both modeling and data uncertainties – addressing the uncertainty in only qualitative terms (e.g., describing which scenarios would be affected and a qualitative judgment as to the effects);
- Particularly for modeling “correctness” as a potential uncertainty – addressing this issue through the use of a quality review process to ensure sufficient accuracy and a reasonable level of completeness (such as a review of the identified cables in a compartment to be sure none have been missed in the PRA model). Note this is not a traditional uncertainty, but instead represents a technical quality/accuracy issue; and
- For uncertainties that are not treated – providing a basis for excluding uncertainties that cannot, or by choice will not, be addressed.

In this task, the analyst for each Fire PRA task should propose strategies for each uncertainty issue identified in the preceding step. The bases for electing a certain strategy may be explicitly noted and may include the following considerations:

- The perceived importance of the uncertainty on the product(s) of the task and particularly on the overall results of the Fire PRA;
- Possible effects on future applications or other decision-making activities;
- The resources needed and available, including schedule constraints, to perform the strategy.

15.5.3 Step 3: Perform Review of Uncertainties to Make Final Decisions as to Which Uncertainties Will Be Addressed and How

An assembly of the task analysts and uncertainty analysis experts, as may be appropriate, is formed to review the uncertainty issues and strategies identified in the preceding two steps. The review team should include many of the analysts themselves who know the nature of the uncertainties the best, and the team should represent the multidisciplines involved in the Fire PRA so that a broad range of perspectives are included when the review is conducted. The review team should also be familiar with and follow the overall approach provided in this procedure and its appendices. This assembly should decide which uncertainties will be addressed and how (selected strategy). As part of this effort, sensitivity cases should be identified if appropriate. [Note: Once other pilot Fire PRAs or other studies are completed, it is expected that this document will be revised to incorporate the lessons learned on specific uncertainties to be addressed.]

It is anticipated that this step may be performed repetitively. Uncertainty analysis strategy review would be done in conjunction with the analysis taking advantage of the results of the Fire PRA at each iteration, and thus make use of insights into which uncertainties are likely to most significantly affect the results or the understanding of the results. Hence, since staying informed of the uncertainties as they are identified and developed is beneficial, this activity is likely to take place repeatedly until the end of the project.

Review of uncertainty analysis strategies will meet multiple objectives. These include the following:

- Identify those uncertainties that will not be addressed because they are expected to be unimportant, they are otherwise unworthy of being addressed, or they cannot be addressed (with reasons noted). In particular, it is not expected that uncertainty analyses will be performed on screened out portions of the model/results, or for issues that should have little impact on the results or anticipated future applications (but sensitivity analyses may be appropriate).
- Identify the uncertainties that will be addressed, as well as the strategy(ies) to be used to address each uncertainty considering the suggestions offered in this procedure.
- Identify which uncertainties will be grouped together into a single uncertainty assessment (i.e., the combined effects are to be determined) because of logical relationships among the uncertainties.
- Identify issues that will be treated in a sensitivity analysis and specify sensitivity analysis cases.
- Provide instructions to and work with individual task analysts to perform the necessary uncertainty/sensitivity analyses.

15.5.4 Step 4: Perform the Uncertainty and Sensitivity Analyses

Once the specific strategies regarding uncertainty have been decided upon in Step 3, the necessary analyses are performed. Depending on the strategy, these may involve manipulating the model to perform desired sensitivities, performing quantitative sampling analyses of certain input probability and frequency distributions, developing qualitative impacts on the results, etc. In each case, it should be made clear as to the following:

- the uncertainties being addressed,
- the strategy being followed to address the uncertainty,
- specific methods, references, computer programs, etc., used so that the analysis can be understood by an independent reviewer and potentially reconstructed,
- the results of the analyses including any conclusions or other key observations relative to the overall results of the Fire PRA (i.e., CDFs, LERFs, significant sequences, key insights...), and
- potential impacts on anticipated applications of the results.

In performing the uncertainty and sensitivity analyses, results should be reported on an individual issue basis as well as in appropriate logical integrated groups. Thus if two or more issues have a logical connection/interface such that their combined effects should also be noted, it is expected the combined effects will be assessed and reported along with the effects for individual issues. For example, if two different fire models are applied, and each predicts different environmental conditions for a given fire, and if these differences would impact the estimated reliability or nature of the related human responses, these two issues should be analyzed together as a collective effect. Quantitative and qualitative results can be combined and discussed as a group where it is logical to do so. The analysts are encouraged to provide whatever perspectives are appropriate to improve the understanding of the Fire PRA results, and to identify the difference in results when considering individual as well as logical combinations of uncertainties/sensitivities.

15.5.5 Step 5: Include the Results of the Uncertainty and Sensitivity Analyses in the Fire PRA Documentation

The analyses conducted under Step 4 need to be included with the documentation of the overall Fire PRA. Adequate documentation of the uncertainty and sensitivity analyses is as important as documentation of the baseline results. By including such documentation, users of the Fire PRA can consider the uncertainties as well as the “best-estimate” results, leading to improved decisions. Documentation of the Fire PRA is covered more fully in the Task 16 procedure.

16

FIRE PRA DOCUMENTATION (TASK 16)

16.1 Purpose

This procedure provides the general practice considered necessary for documenting the Fire PRA and its results.

16.2 Scope

This procedure covers the recommended documentation of the Fire PRA, including coverage of all the major tasks of the Fire PRA, as outlined in this document.

16.3 Background Information

16.3.1 General Task Objectives and Approach

The objective of this task is to ensure there is adequate documentation of the Fire PRA to allow review of the Fire PRA development and its results, as well as to provide a written basis for any future uses of the Fire PRA.

16.3.2 Assumptions

No assumptions were identified relevant to this documentation task.

16.4 Task Interfaces

16.4.1 Input from Other Tasks

There are specifically addressed or implied documentation recommendations in the prior tasks' procedure steps.

16.4.2 Additional Plant Information Needed to Support this Task

No additional plant information is required.

16.4.3 Walkdowns

No walkdowns are required to perform this task.

16.4.4 Outputs to Other Tasks

As this is the last task in the Fire PRA process, there are no outputs to other tasks.

16.5 Procedure

A recommended outline of the final Fire PRA report is provided in Table 16-1. The outline also identifies a set of supporting documentation items (Table 16-2) that will contain the results of individual tasks. The documentation should provide an adequate summary of the development of the Fire PRA, including the performance and results of all the previous tasks in this document and the results of the Fire PRA itself (with uncertainties, sensitivities, observations, etc.).

16.6 Uncertainty

This is not applicable to this task.

Table 16-1
Suggested Outline for Fire PRA Documentation (Main Fire PRA Report)

<p>Executive Summary</p> <p>I. Introduction Introductory statements, including purpose of the analysis, reasons for conducting the analysis, background information, other past fire risk analyses done for the facility, etc.</p> <p>II. Methodology Reference requantification procedure version being used. A discussion on deviations, if any, from requantification procedures.</p> <p>III. Fire CDF This section may be organized per analysts' judgment. The following are recommended to be addressed.</p> <p>Data Sources Used Provide a general discussion of the type of documents, electronic files, and industry and public domain information used. For issues that may have a profound impact on the results of the Fire PRA, provide a discussion. For example, status or availability of cable routing information may need to be discussed. Uncertainties arising from poor or lack of documentation may be discussed in this section.</p> <p>Plant Partitioning and Compartment Definition Summarize the plant partitioning effort and provide a list of compartments. Discuss criteria employed. Discuss deviations from the criteria. Provide in this section a set of plant architectural drawings that shows the boundaries of every compartment.</p> <p>Fire PRA Model Discuss the Internal Events PRA or other safe shutdown models available. Discuss the basis of the plant response model selected. Discuss changes made to the model and the process for selecting components. Reference supporting documentation for list of components.</p> <p>Circuit Analysis Discuss the circuit analysis done for different stages of the Fire PRA in terms of methodology employed, information sources, and results.</p> <p>Fire PRA Components and Fire Compartments Discuss fire compartments and Fire PRA components in them. Provide a list of compartments and a summary of Fire PRA components in them.</p>

Table 16-1
Suggested Outline for Fire PRA Documentation (Main Fire PRA Report) (Continued)

<p>Qualitative Screening Discuss qualitative process and provide a list of compartments, along with qualitative screening result and basis for screening. A list of screened fire compartments should be provided.</p> <p>Fire Ignition Frequency Discuss the fire ignition frequency analysis process and provide a list of frequency bins and frequency values. Provide a discussion on equipment counting process. Provide fire frequencies by compartment and frequency bin.</p> <p>Postfire HRA Discuss the HRA analysis process. Discuss major assumptions.</p> <p>Quantitative Screening-I Discuss first quantitative screening process. Provide (1) a list of unscreened compartments from qualitative screening, (2) quantitative values for screening, and (3) screening results in terms of fire compartments that are screened, including respective compartment CDFs and LERFs. Also include total CDF and LERF of screened fire compartments.</p> <p>Scoping Fire Modeling Discuss scoping analysis process.</p> <p>Quantitative Screening-II Discuss second quantitative screening process. Provide (1) a list of unscreened compartments from first quantitative screening, (2) quantitative values for screening, and (3) screening results in terms of fire compartments or fire ignition sources that are screened, including respective CDFs and LERFs. Also include total CDF and LERF of screened fire compartments.</p> <p>Detailed Fire Modeling-Single Compartment Discuss selected scenarios for detailed analysis; fire propagation modeling; fire suppression analysis process; and provide a summary of results.</p> <p>Detailed Fire Modeling-Main Control Room Discuss main control room analysis. List scenarios selected and basis for the selection.</p> <p>Detailed Fire Modeling-Multicompartment Discuss the multicompartment process. Provide a matrix of exposing and exposed compartments. Discuss analysis stages. Provide final results and basis for the results.</p> <p>Seismic Fire Interactions Discuss seismic fire interaction and scenarios considered. Provide basis for selecting scenarios to be analyzed. Provide results.</p> <p>Fire Risk Quantification Discuss final fire risk quantification process. Provide a list of scenarios by compartment, affected components, fire scenario frequency, CCDP, CDF, and LERF. Provide uncertainty distribution of the CDF. Also, provide the total CDF of screened fire compartments and fire scenarios along with their largest contributors.</p> <p>Fire LERF This section may address all those elements of the Fire PRA relevant to LERF and that were not discussed in the preceding sections.</p> <p>Uncertainty and Sensitivity Analyses Discuss issues and bases of sensitivity analyses. Provide results (CDF, LERF, etc.). Provide a discussion on insights gained from sensitivity analysis.</p> <p>Findings, Conclusions and Recommendations</p>

Table 16-2
Suggested Outline for Fire PRA Documentation (Fire PRA Supporting Documents)

<p>List of Documents, Files, and Data Sources Provide proper references of documents, electronic files, and industry/public domain information and data sources used.</p> <p>Walkdown Notes Provide a complete set of plant walkdown notes in support of various tasks.</p> <p>Plant Response Model Selected Fault and event trees of Fire PRA.</p> <p>List of Fire PRA Components Provide a complete list of components considered as Fire PRA components.</p> <p>Circuit Analysis Provide a complete list of components considered as Fire PRA components, failure modes of each component modeled in the risk model (include multiple failures), and probabilities of spurious actuation and other failure modes per compartment where quantified. Show which entries are not analyzed.</p> <p>Fire Ignition Frequency Provide equipment count tables.</p> <p>HRA Analysis Provide a list of HRA basic events of the response model. Provide applicable HEP and information relevant to HEP quantification.</p> <p>Scoping Analysis Provide all supporting documentation on scoping analysis.</p> <p>Detailed Analysis—Single Compartment Provide supporting documentation on detailed analysis one compartment at a time. Provide the following for each fire scenario: scenario description, fire ignition frequency breakdown, fire growth analysis results summary, fire suppression analysis event tree, and fire scenario frequency.</p> <p>Detailed Analysis—Main Control Room Provide supporting documentation on detailed analysis of the Control Room.</p> <p>Detailed Analysis—Multicompartment Analysis Provide supporting documentation on multicompartment analysis.</p> <p>Seismic Fire Interaction Provide supporting documentation on seismic fire interaction analysis.</p> <p>Final Fire Risk Quantification Provide fire risk quantification results in terms of compartments, scenarios, fire scenario frequencies, and the minimal cut set list of final fire risk quantification. Provide fire risk minimal cut sets. Provide a ranked list of screened fire compartments and fire scenarios (e.g., ranked by CDF), the basis of screening and total CDF and LERF of screened fire compartments and fire scenarios</p> <p>Sensitivity Analyses Provide full description of sensitivity analysis cases, changes to various risk parameters considered for each case, final results of each case, and related discussions, if warranted.</p>

17

PLANT WALKDOWNS (SUPPORT TASK A)

17.1 Introduction

Plant walkdown is defined as an inspection of local areas in an NPP where systems and components are physically located to ensure accuracy of procedures and drawings, equipment location, operating status, and environmental or system interaction effects on equipment during accident conditions. Plant walkdowns also supports plant partitioning under Task 1 by verifying credited partitioning features. It is critically important that several plant walkdowns be conducted as an integral part of Fire PRA. Paper and electronic documents are not sufficient to provide all the information needed for a proper Fire PRA. Subtle features of structural characteristics and equipment installations that may influence the outcome of a fire event are often not explicitly displayed on drawings or other documents. Housekeeping practices and various plant conditions can only be understood by on-site inspection. Also, often a wide range of paper documents need to be reviewed to select those that the analysts may need to use closely and retain as part of project documents. Such a selection process is often best conducted at the site where most up-to-date documents can be found.

Generally, several site walkdowns are conducted in support of a Fire PRA. The first walkdown is typically used for plant familiarization and identification of necessary plant documents. Later walkdowns are typically focused on specific topics. Even though the scope of the walkdowns may vary considerably, all walkdowns involve a common set of steps. In this appendix, those common steps are discussed first. The various walkdowns are discussed later and cross-referenced with the specific tasks of this fire risk quantification process. The types of analysts that should participate in a walkdown, duration, and schedule are also addressed.

17.2 Overall Walkdown Approach

All walkdowns are generally unique and the scope and agenda of a walkdown should be adjusted according to the specific needs of the analyst and the conditions of the plant. However, there are some common elements among the walkdowns that should enhance the efficient use of the analysts' and plant personnel time.

Even though it is obvious, it is important to stress that safe conduct and strict adherence to the safety and security rules of the plant supersedes all other needs and requirements of a walkdown.

All walkdowns consist of the following activities:

- Previsit planning and proper communication with plant staff and management to achieve the following:
 - Secure permission to enter the plant (if necessary) and visit various locations

- Ensure that certain members of plant personnel are available
- Develop a list of plant locations to be visited
- Develop a list of documents to be reviewed
- Develop the walkdown agenda
- Prepare a list of items to be taken to the plant
- An entrance meeting with plant staff and management to discuss the following:
 - Walkdown objectives
 - Locations the team will visit to identify any relevant requirements pertaining to access, radiological, and security controls
 - Securing a convenient work area where the team can review documents and conduct meetings
 - Document retrieval, control, and other relevant topics
 - Work hours
 - Permission to use a camera
- Walkdown activities:
 - Visit planned plant locations and take necessary notes and photographs (if permitted)
 - Interview plant personnel knowledgeable of the topics on the agenda
 - Review plant documents
 - Consolidate and review the notes to ensure that all the necessary information has been collected
- An exit meeting with plant staff and management (if the management so desires) to summarize the objectives of the walkdown, what was done, what was achieved (including any problems encountered), and to identify and clarify additional action items, as appropriate.

The optimal makeup of the walkdown team will depend on the extent to which compartment characterization or other information is desired. In general, it is recommended that the walkdown team include someone knowledgeable of the plant's fire protection program and someone with knowledge of the plant operating and support systems layout. Fire protection experts can provide enhanced information regarding potential fire sources, the fire barrier qualification status of credited partitions, and fire protection features. Plant systems/layout experts can assist in the identification of plant systems and components located in a given fire compartment. This knowledge will be needed as the analysis progresses. The initial confirmatory walkdown provides a convenient mechanism for gathering this information.

The walkdown team may use a standardized form to record its findings. Using such forms allows some level of standardizing the type of information collected by various analysts when working in parallel on the same task. It also creates a compendium of various key information items for each fire compartment¹⁶ that can facilitate retrieval of specific information items when

¹⁶ It is convenient to organize information by fire compartment. However, during the first walkdown, the team will need to verify the selection of fire compartments and their boundaries.

conducting the detailed fire scenario analysis. The standardized form may include the following topics for the analyst to address during the initial or later walkdown:

- Fire compartment identifier,
- Fire compartment name,
- Characteristics of the boundaries (i.e., fire walls, doors, etc.),
- Access points from other fire compartments and accessibility during power operation,
- Openings into adjacent fire compartments,
- Items typically present in the fire compartment,
- List of Fire PRA components (not including cables),
- Equipment count (per Task 6 instructions),
- Information regarding transient combustibles and transient ignition sources (e.g., possibility of conducting welding during power operation),
- Fire protection features (passive and active), and
- Other special features and characteristics relevant to fire risk analysis (e.g., addressing human performance factors under fire conditions).

The form may be updated every time a member of the analysis team visits the plant or a specific fire compartment.

17.3 Typical Walkdown Needs

During the course of a Fire PRA, it is necessary to visit the plant and walkdown specific locations at different stages of the analysis. In general, the following walkdowns have been found to be necessary:

- An initial walkdown to confirm the definition of fire compartments and establish the characteristics of each fire compartment. In the context of partitioning, the primary walkdown objective is to confirm the existence and integrity of credited partitioning features and elements. The walkdown may also identify secondary partitions that can be credited to further partition an initially identified compartment. A second walkdown objective is to gather information on the dominant features of each compartment. Information of interest includes a description of the credited partitions that define each compartment, identification of (and/or counting of) primary fuel and ignition sources, cataloging of fire protection features (e.g., detection, suppression, raceway fire barriers, etc.), and the identification of adjacent compartments (above, below, and horizontal adjacencies). Such walkdowns can also support mapping of plant components, systems, and cables to and within fire compartments:
- To confirm the location of a specific cable.
- In support of fire frequency estimation process (Task 6), it is necessary to count all the relevant ignition sources within each fire compartment. This can only be completed by visiting each fire compartment and confirming the counts made using paper documents.
- The scoping fire modeling (Task 8) requires direct observations at each fire compartment to confirm that no potential targets are within the zone of influence of a fixed ignition source.

- To verify the detailed fire scenario analysis by direct observations at the affected fire compartments.
- To conduct human reliability analysis interviews with plant operators and direct observations of affected plant fire compartments.
- To verify seismic fire interaction.

Each walkdown has some unique feature. These features are summarized in Table 17-1 in terms of specific walkdown actions, duration, schedule, and participants. A cross reference with the tasks of this fire risk quantification process is provided in Table 17-2.

**Table 17-1
Fire Risk Walkdowns**

Walkdown	Walkdown Actions	Duration	Minimum Team Participants	Plant Participants	Schedule
1. Initial	Confirmatory and familiarization plant walkdowns for Tasks 1 and 2 information. Visit every compartment in the plant that is possible to enter with reasonable preparation (i.e., may exclude high radiation areas). Take photographs (if permitted). Take notes about compartment characteristics in terms of ignition sources, fire protection features, Fire PRA components (Task 2), Openings to adjacent compartments.	3 to 5 days	Fire modeler, Fire PRA model developer	Fire hazard analysis and Appendix R of 10 CFR Part 50 experts	After the information identified in Tasks 1 and 2 are collected from paper and electronic documents
2. Cable routing confirmation	Confirmatory plant walkdown for verifying the fire compartment of specific cables. Only compartments where specific cables, cable trays or conduits need to be traced are visited. Typically, drawings are marked identifying fire compartment of the cable trays and conduits.	As necessary	Circuit analysis team members	Appendix R of 10 CFR Part 50 expert or electrical engineer from the electrical department	During execution of Task 3
3. Component count	Count number of equipment items in each ignition frequency bin. Enter the count in a matrix by fire compartment and ignition source type.	3 to 5 days	Fire modeler	Fire hazard analysis expert	As part of Task 6, after an initial count is completed using paper documents. May be conducted as part of the initial walkdown

**Table 17-1
Fire Risk Walkdowns (Continued)**

Walkdown	Walkdown Actions	Duration	Minimum Team Participants	Plant Participants	Schedule
4. Scoping fire modeling	Visit every fire compartment that has not been screened out in the preceding tasks, identify the fixed ignition sources and potential targets around them, establish whether or not target could be damaged, identify those ignition sources that cannot cause any target damage.	3 to 5 days	Fire modeler	Fire hazard analysis expert	As part of Task 8, after a catalog of ignition source types and potential zone of influence are put together
5. Detailed analysis	Visit those fire compartments for which detailed analysis will be conducted. Study the specific scenarios that are considered. Photograph the specific items (if permitted).	As necessary	Fire modeler	Fire hazard analysis expert	As part of Task 11, after an initial identification of all the detailed fire scenarios
6. Human reliability	Observe locations and assess relevant performance-shaping factors for operator actions to be credited, including interviews with plant operators as needed to fully understand the actions and the associated context.	As necessary	Human reliability analyst	Control Room and plant operators	As part of Task 12 when/as operator actions are identified. It is recommended, though not necessary, that this be done in conjunction with other task walkdowns (e.g., initial walkdown) just so that the number of interfaces with plant personnel and disruption of plant activities is minimized.

Table 17-1
Fire Risk Walkdowns (Continued)

Walkdown	Walkdown Actions	Duration	Minimum Team Participants	Plant Participants	Schedule
7. Seismic fire interaction	Visit all fire compartments that contain Fire PRA components or cables, large quantity of flammable materials, or other highly hazardous materials. Identify conditions that may arise from severe vibration or displacement of equipment leading to fire, explosion, or release of a highly hazardous material. Record the findings by fire compartment.	2 to 4 days	Fire and seismic modelers	Fire hazard analysis expert	As part of Task 13 effort, after an initial list of potential sources of hazard are identified

**Table 17-2
Fire Risk Tasks and Walkdown Needs**

Task	1. Initial	2. Cable routing Confirmation	3. Component count	4. Scoping fire modeling	5. Detailed analysis	6. Human reliability	7. Seismic fire interaction
Task 1–Plant boundary definition and partitioning	X						
Task 2–Fire PRA components selection	X						
Task 3–Fire PRA cable selection		X					
Task 4–Qualitative screening							
Task 5–Fire-induced risk model							
Task 6–Fire ignition frequencies	(1)		X				
Task 7–Quantitative screening							
Task 8–Scoping fire modeling				X			
Task 9–Detailed circuit failure analysis							
Task 10–Circuit failure mode likelihood analysis							
Task 11–Detailed fire modeling					X		
Task 12–Post-fire human reliability analysis						X	
Task 13–Seismic-fire interactions assessment	(2)						X
Task 14–Fire risk quantification							
Task 15–Uncertainty and sensitivity analysis							
Task 16–Fire PRA documentation							

(1) Equipment count may be conducted as Task 1-related information is being gathered.

(2) Seismic-fire related information might be gathered along with Task 1-related information.

18

FIRE PRA DATABASE SYSTEM (SUPPORT TASK B)

18.1 Purpose

A comprehensive Fire PRA project of this type requires an analysis of fire-induced circuit failures beyond that typically conducted during original Fire PRAs. Additional analytical tools are needed to support these *refined* electrical analyses. The tools of interest generally involve enhancements to an existing database system (e.g., plant cable and raceway system, Appendix R database, PRA database, etc.) or development of a new database that is structured to support the desired functionality. The purposes of this task are to:

- Identify the database functional capabilities necessary to support a Fire PRA project as outlined in this guide, including analysis, screening, and correlation of data; and
- Establish a framework and process for assessing existing plant database features and functionality, and implementing an enhancement plan to develop the necessary database functional capabilities. A Database Augmentation Plan is developed to ensure enhancements are implemented through a formal and structured process.

The ultimate objective is to develop a relational database that can quickly and accurately assess potential equipment failures for fire scenarios of interest. Scenarios may include, but are not limited to, total failure of all circuits in a Fire Area or plant compartment, failure of cables within a specific raceway, and failures based on specific equipment failure modes.

18.2 Scope

This chapter identifies the criteria and functional elements for an effective Fire PRA Database System¹⁷. It also provides a structured process for upgrading/supplementing existing CRS databases to achieve the necessary capabilities. Depending on specific plant circumstances, it is also possible that the Fire PRA Database functions may be accomplished by a combination of new and existing databases. This task is an adjunct effort associated with the other analysis tasks for the project.

¹⁷ The term “Fire PRA Database” is used generically throughout this document to represent the database system or systems used to support the Fire PRA Analysis, regardless of whether the system is part of an existing plant database, a newly developed database, or a combination of new and existing databases.

The scope of this task does not address implementation of software quality assurance or configuration control requirements that might be applicable for plant-specific work. Nor does this procedure address validating the accuracy of plant-specific information input into the database (e.g., equipment data, cable data, cable routing, etc.). This information should be confirmed as part of the interfacing task that generates the data of interest.

18.3 Background Information

18.3.1 General Task Objectives and Approach

This task is distinctly different from the other Fire PRA tasks in that it does not specify criteria and performance requirements for conducting the Fire PRA itself. Rather, it specifies the criteria and process for creating an analytical tool (i.e., Fire PRA Database) that will enable analysts to conduct the necessary analyses efficiently and accurately. Manual compilation is nearly prohibitive due to the low efficiency and human errors that can be introduced while repetitively manipulating large amounts of data.

The Fire PRA Database should support the following analytical tasks:

Task 1–Plant boundary definition and partitioning,

Task 2–Fire PRA Components Selection,

Task 3–Fire PRA Cable Selection,

Task 4–Qualitative Screening,

Task 7–Quantitative Screening,

Task 9–Detailed Circuit Failure Analysis, and

Task 10–Circuit Failure Mode Likelihood Analysis.

In satisfying the above analysis capabilities, the database serves as the primary location for information and data generated by the Fire PRA component and cable selection tasks, Tasks 2 and 3. Development of the Fire PRA Database includes four basic steps. Figure 18-1 shows a summary of the task work flow for developing the Fire PRA Database.

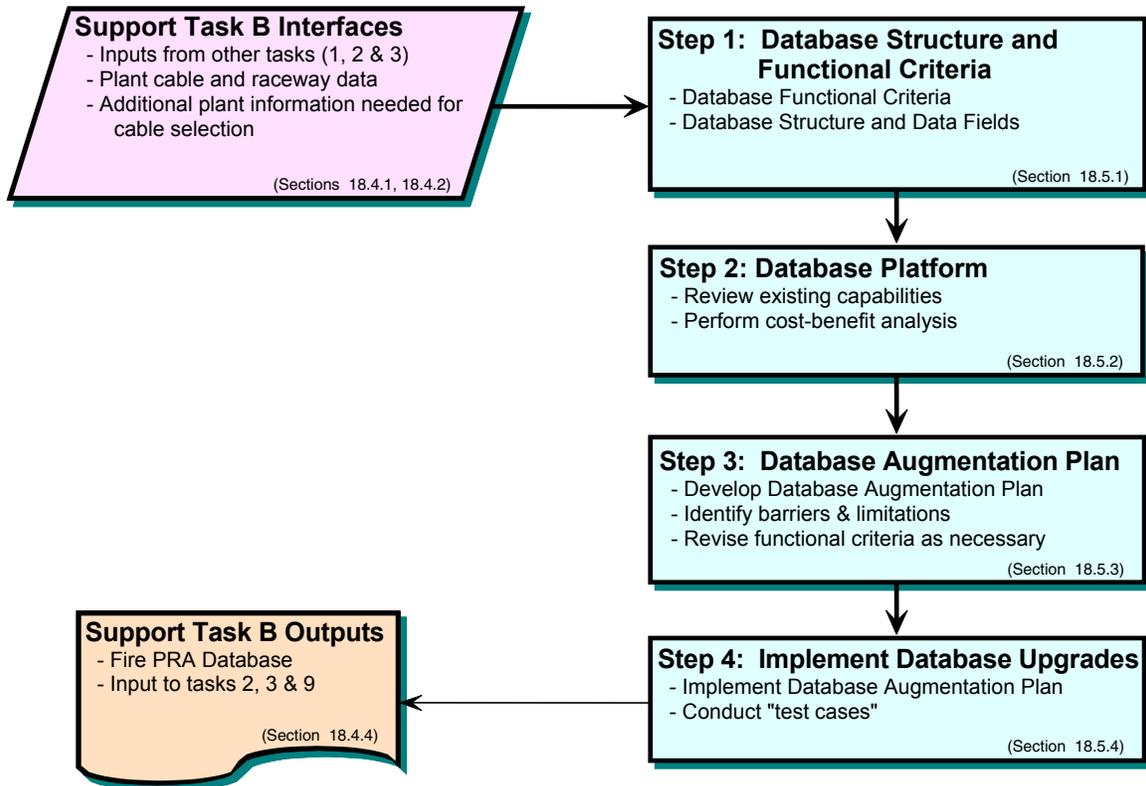


Figure 18-1
Fire PRA Database Structure–Equipment and Cables

18.3.2 Assumptions

The following assumptions form the basis for this task:

- A cable and raceway database system is in place and available to identify cable/raceway routings and relationships;
- Users of this procedure are knowledgeable and have experience with software development and analysis;
- Users are familiar with the plant’s existing cable and raceway database system, its content, and its inherent limitations; and
- Users are familiar with Appendix R circuit analysis and methods of storing and manipulating the circuit data using automated techniques.

18.4 Task Interfaces

18.4.1 Input from Other Tasks

18.4.1.1 Plant Partitioning Boundaries and Designations

This task needs the plant partitioning boundary definitions and fire compartment designations from Task 1, Plant Boundary Definition and Partitioning, as a prerequisite. The plant fire area/fire compartment information is input to the Fire PRA Database so that the database system can support queries requiring automated correlation to cable raceway locations.

18.4.1.2 Plant Cable and Raceway Data

This task needs basic cable and raceway information from the plant CRS or other available sources. This information may reside in the plant CRS or be uploaded into the Fire PRA Database. In either case, the database system should be able to support queries requiring automatic correlation of cables-to-raceways-to-locations (fire areas and/or fire compartments).

18.4.1.3 Fire PRA Equipment

A list of predefined descriptive options for the Fire PRA equipment is necessary to support data entry for the equipment. The use of predefined options fosters consistency in data entry, which is essential for developing sort and query functions by field attributes. The component information collected as part of Task 2, Fire PRA Components Selection, should map to data fields in the Fire PRA Database.

18.4.1.4 Fire PRA Cable Selection

A list of predefined cable attribute options is helpful to support data entry for the Fire PRA cables. The cable information collected as part of Task 3, Fire PRA Cable Selection, should map to data fields in the Fire PRA Database. It is important that the content and format for information collected as part of cable selection align with the specified data fields, so that the cables can be correlated to the Fire PRA Equipment List and raceway location information. This link is essential to automate the process of identifying the potential for equipment failures on a fire scenario basis.

18.4.2 Additional Plant Information Needed to Support this Task

The following additional source information should be considered:

1. Applicable software security and backup procedures and policies, and
2. Plant software development procedures.

18.4.3 Walkdowns

This task does not depend on walkdowns.

18.4.4 Outputs to Other Tasks

The Fire PRA Database is intended to support the analysis needs associated with Tasks 2, 3, and 9. Specific interfaces include:

- Task 2, Fire PRA Components Selection: The Fire PRA Database system establishes the framework for creating the Fire PRA Equipment List in a database format. The database system is populated with the Fire PRA equipment information as part of Task 2. The system can then be used to generate reports of the entire equipment list or subsets based on specified attributes.
- Task 3, Fire PRA Cable Selection: The Fire PRA Database system establishes the framework for creating the Fire PRA Cable List in a database format. The database system is populated with the Fire PRA cable information as part of Task 3. The system can then serve as the primary analytical tool for generating Target Equipment Location Reports, which are a complete listing of cables and equipment on a fire area, fire compartment, or raceway basis.
- Task 9, Detailed Circuit Failure Analysis: The detailed circuit failure information generated as part of Task 9 is input into the Fire PRA Database. The database system can then take advantage of relational attributes in the data to compile equipment failures for specific scenarios. This information serves as a direct input to the quantitative screening task, Task 7.

18.5 Procedure

The steps below outline a straightforward process for determining what database tools are needed and the viable options for developing and implementing these tools. Ultimately, each plant should weigh the pros and cons of the various options and determine the most prudent and cost-effective approach for developing the analytical tools to support the detailed data queries necessary to complete a comprehensive Fire PRA.

18.5.1 Step 1: Database Structure and Functional Criteria

18.5.1.1 Step 1.1: Database Functional Criteria

The first step in developing the Fire PRA Database is to specify the functional criteria. The functional criteria establish the data input and output criteria as well as basic functionality. Most importantly, the functional criteria set forth the output query, sort, and report features. These criteria will vary from plant to plant and depend on the specific nature and objectives of the Fire PRA Analysis. Each plant should consider the objectives of their program and tailor the functional criteria accordingly. That said, a basic set of functional criteria is provided below as a starting point for consideration.

18.5.1.1.1 Data Input Criteria

- Plant fire area and fire compartment information.
- Fire PRA equipment information—as constrained by plant-specific lookup table options and data integrity needs.
- Fire PRA cable and circuit information—as constrained by plant-specific lookup table options and data integrity needs.

- Source data information—as specified by lookup table options. The source data tables contain a listing of unique, predefined options for defined equipment and cable attributes.
- Source data information necessary to conduct queries, lookups, and sorts in support of specified output reports.

18.5.1.1.2 Output Criteria

- **Fire-PRA Equipment List**—A list of Fire PRA equipment, sortable by fire area, fire compartment, equipment type, and system. Report should include equipment identification, system designation, equipment type, and position information (i.e., normal, desired, loss of power, etc.).
- **Fire PRA Cable List**—A list of Fire PRA cables, sortable by fire area, fire compartment, raceway, cable identification, and equipment identification. Report should include associated equipment, cable function, and cable fault consequence.
- **Circuit Analysis Reports**—A summary of the circuit analysis for an individual component. Report should include equipment identification, power supply, Fire PRA cables, cable functions, and cable fault consequences.
- **Target Equipment Location Reports**—A listing by fire area, fire compartment, or raceway of Fire PRA equipment that is located within the specified enclosure or whose circuits are contained within the specified enclosure. Reports should include equipment identification, cable identification, cable function, and cable fault consequence.
- **Cable Routing Reports**—A report identifying the full routing of a specified cable or group of cables, sortable by cable identification or equipment identification. The report should include cable identification, associated equipment, raceways, fire areas, and fire compartments.

18.5.1.2 Step 1.2: Database Structure and Data Fields

The functional criteria cannot be fully specified without defining the necessary data fields and basic database structure. Appendix W contains a sample database structure that may be used as a generic template for a standalone system. The example is also helpful in understanding the typical data relationships that will need to be created if enhancing an existing system.

The basic elements to consider in designing the database system are:

- Database structure (tables and table relationships),
- Essential fields for database tables,
- Data relationships and constraints, and
- Logical constraints for data integrity.

Each of these elements is discussed further in the sample database structure presented in Appendix W.

18.5.2 Step 2: Database Platform

Once the functional criteria are established, a software platform should be selected for the Fire PRA Database. Options may involve developing a new standalone database platform or enhancing an existing database system. *(Note: Depending on specific plant circumstances, the Fire PRA Database functions may be achieved by a combination of databases. For example, the existing plant CRS might be used to conduct equipment and cable queries that are then downloaded to a new database for conducting specific Fire PRA analyses.)*

Considerations for selecting the database platform are listed below:

1. As part of selecting the best option for developing the essential database functionality, existing data and database capabilities should be reviewed.
 - Compare the functional criteria established in Step 1 against existing database capabilities to identify missing attributes.
 - Review the CRS and other sources of cable and raceway information to identify options for populating the Fire PRA Database with the necessary cable-to-raceway-to-compartment relationships.
2. Based on an understanding of existing database capabilities, consider the following factors in selecting a platform for the Fire PRA Database:
 - Long-term maintainability,
 - Ease of use,
 - Project-specific configuration control (software, data entry, database access),
 - Long-term configuration and control (e.g., incorporation of plant modifications),
 - Company/plant software and database policies and procedures,
 - Data redundancies,
 - Data security and integrity,
 - User groups, and
 - Budget, schedule, and resource restraints.
3. A cost/benefit analysis should be considered to help assess the tradeoffs of building the Fire PRA Database using a new database platform or enhancing an existing database system.

18.5.3 Step 3: Database Augmentation Plan

1. Based on the results of Step 2, develop a Database Augmentation Plan for creating, upgrading, or enhancing database capabilities to achieve the desired functionality. *(Note: In many cases, existing plant software development procedures satisfy the intent of the Database Augmentation Plan. These procedures should be followed in lieu of creating a separate plan.)*

2. Identify significant barriers and practical limitations associated with implementing database enhancements.
3. Revise functional criteria if practical limitations will prevent successful implementation of upgrades.

18.5.4 Step 4: Implement Database Upgrades

This step implements the Database Augmentation Plan developed in Step 3. This step is accomplished by:

1. Implementing the actions specified in the Database Augmentation Plan.
2. Conducting sample “test cases” to confirm the Fire PRA Database is functioning correctly and that the capabilities are adequate to support the three phases of analysis.

19

GLOSSARY

The following are the definitions of important terms used throughout the methodology. In recognition that multitude of other documents that define the same terms, such as the ASME Internal Events Standard, NFPA 805, Regulatory Guide 1.189, and NEI-00-01 an attempt was made at using consistent definitions.

Term	Definition
Accident sequence	A representation in terms of an initiating event followed by a sequence of failures or successes of events (i.e., such as system, function, or operator performance) that can lead to undesired consequences, with a specified end state (e.g., core damage or large early release). In the context of Fire PRA, the same definition applies. The initiating event may be induced by damages caused by a fire event (see definition for Fire Induced Initiating Event).
Aleatory uncertainty	An uncertainty due to inherent randomness or a stochastic process. Such uncertainties are irreducible in that no matter what the level of knowledge, some unpredictability in the variable of interest is still expected.
Associated Circuit	<p>The term “associated circuits” has specific meaning within the context of Appendix R of 10 CFR Part 50 safe shutdown analyses. For consistency, the same definition should be used in Fire PRA. An associated circuit is defined as any circuit that can, through adverse interaction, indirectly affect proper operation of equipment/systems due to a shared power supply, shared raceway, or spurious actuation. Associated circuits may result as a consequence of:</p> <ul style="list-style-type: none"> • Inadequate electrical coordination (common power supply associated circuit) • Inadequate circuit over-current protection (common enclosure associated circuit) • Undesired component actuation (spurious operation associated circuit)
Automatic trip	Reactor trip that is initiated by an automatic signal from plant reactor protection systems (RPS) in response to off-normal conditions (in the context of Fire PRA this could be a fire affecting certain plant equipment and or circuits.)
Cable	In the context of Fire PRA, the term cable refers to assemblies designed to conduct electrical current. Hence, a cable is an assembly of one (single-conductor cable) or more (multi-conductor cable) insulated electrical conductors (generally copper or aluminum) that may or may not be surrounded by an outer jacket. (This definition excludes fiber-optic type cables.)
Cable Failure	A condition whereby the affected (or failed) cable is no longer able to perform its intended function.

Glossary

Term	Definition
Cable Failure Mode	The mode by which a wire or conductor fails. Three principle failure modes are defined: open circuit, ground fault (short-to-ground), and hot short.
Conditional Core Damage Probability (CCDP)	The conditional core damage probability calculated by the Fire PRA Model. This probability is conditional on a specific fire scenario in a fire compartment postulated as a fire-induced initiating event and includes the likelihoods of the combinations of equipment failures (some may be directly induced by the fire itself) and operator failures that result in core damage. The CCDP for a given fire scenario times the frequency of the given fire scenario (see fire scenario definition below for the considerations that are captured within the context of a fire scenario) results in the Core Damage Frequency contribution for the given fire scenario.
Ceiling Jet	Refers to the relatively rapid gas flow in a shallow layer beneath the ceiling surface that is driven by the buoyancy of hot combustion products. Ceiling jets form when a fire plume impinges under a ceiling and hot gases spread away.
Circuit Analysis	The process of identifying cables and circuits that, if damaged by fire, could prevent a Fire PRA component from operating correctly.
Circuit <i>Failure</i> Mode	The manner in which a conductor fault is manifested in the circuit. Circuit failure modes include loss of motive power, loss of control, loss of or false indication, open circuit conditions (e.g., a blown fuse or open circuit protective device), and spurious operation.
Conditional Large Early Release Probability (CLERP)	The conditional large early release probability calculated by the Fire PRA Model in a fashion similar to CCDP but as applied to a large early release..
Common Enclosure Associated Circuit	A common enclosure associated circuit concern exists when a circuit protective device is not sufficiently rated to interrupt the possible fault current to which it might be subjected or the protective device is too large to prevent thermal damage to downstream cables. Either case has the potential to initiate a secondary fire.
Common Power Supply Associated Circuit	A common power supply associated circuit concern exists for a critical (i.e., important to the analysis) power supply when a feeder over-current protective device associated with a non-critical cable is not properly coordinated with upstream supply devices. Under these circumstances, a fault on the non-critical cable could result in an upstream over-current protective device tripping prior to the feeder device, thereby de-energizing the critical power supply and the critical loads it serves.
Compartment	A generic term used to represent a room defined by four walls, a floor and a ceiling. Is this always true? The boundaries may not be fire rated.
Conductor-to-Conductor Short	An abnormal connection (including an arc) of relatively low impedance between two conductors. A conductor-to-conductor short between an energized conductor of a grounded circuit and a grounded conductor results in a ground fault. A conductor-to-conductor short between an energized conductor and a non-grounded conductor results in a hot short. A conductor-to-conductor short between an energized conductor of an ungrounded circuit and a neutral conductor has the same functional impact as a ground fault.

Term	Definition
Controlled Manual shutdown	A planned reactor shutdown initiated and controlled by operators (i.e., not an automatic or manual plant trip) including those involving a limiting condition of operation (LCO). For the Fire PRA, it is not the intent that controlled manual shutdowns with limited effects on plant equipment due to an LCO condition be analyzed.
Core Damage Frequency (CDF)	Expected number of core damage events per unit of time.
Cable and Raceway System (CRS)	The CRS is a software-based schedule of raceways and cables for the plant. As a basic function, the CRS generally correlates cables to raceways and tracks basic cable and raceway attributes. Newer cable and raceway systems typically contain sophisticated database sort and query features.
Cue (in the HRA context)	A change in condition or signal that triggers the need for an action.
Epistemic uncertainty	An uncertainty due to a lack of, or weakness in knowledge. Such uncertainties can, theoretically, be reduced by obtaining more knowledge such as through observation of repeated trials of an event so as to learn the true value of the variable of interest.
Equipment Failure Consequence List	A composite listing of the types of circuit failures assumed to affect the cable supporting the equipment (component) and the resultant effect on the equipment for each failure assumed.
Equipment Failure Response Report	A brief summary of all potential equipment failures resulting from fire damage to its related power, control or instrumentation cable.
Field models	Types of fire propagation analysis models more generally known as computational fluid dynamic (CFD) models in other disciplines. In a field model, a space is subdivided into a very large number of cells, which may be in the tens of thousands. The conservation equations for mass, species, energy, and momentum are then applied to each cell along with appropriate initial conditions and boundary conditions for the calculations domain.
Fire Area	The portion of a building or plant that is separated from other areas by rated fire barriers adequate for the fire hazard (per U.S. NRC Regulatory Guide 1.189).
Fire Barrier	Components of construction (walls, floors, and their supports), including beams, joists, columns, penetration seals or closures, fire doors, and fire dampers that are rated by approving laboratories in hours of resistance to fire, that are used to prevent the spread of fire (per U.S. NRC RG 1.189) and restrict spread of heat and smoke.
Fire Compartment	A subdivision of a building or plant defined specifically for the purpose of Fire PRA. A fire compartment is a well-defined enclosed room, not necessarily with fire barriers. They generally fall within a fire area, and are bounded by non-combustible barriers where heat and products of combustion from a fire within the enclosure will be substantially confined. Boundaries of a fire compartment may have open equipment hatches, stairways, doorways or unsealed penetrations. This is a term defined specifically for fire risk analysis and maps plant fire areas and/or zones, defined by the plant and based on fire protection systems design and/or operations considerations, into compartments defined by fire damage potential. For example, the control room or certain areas within the turbine building may be defined as a fire compartment.

Term	Definition
Fire Frequency	A generic term used to represent the rate of occurrence of potentially challenging fire events (per reactor year).
Fire Ignition Frequency	The occurrence rate of a challenging fire involving a specific component or specific compartment of the plant under study.
Fire Induced Initiating Event	That initiating event assigned to occur in the Fire PRA Model for a given fire scenario.
Fire Intensity	Synonymous with Heat Release Rate
Fire Plume	Buoyant stream of hot gases rising above a localized area undergoing combustion into surrounding space of essentially uncontaminated air
Fire PRA	The collection of analyses, computer models and reports conducted and prepared for the purpose of estimating the risk associated with fire events in a nuclear power plant..
Fire PRA Database	The Fire PRA Database contains the essential information for conducting a Fire PRA. It provides the data structure and functional relationships necessary to correlate the various data elements and generate desired sorts and queries for assessing failures based on the Fire PRA Model. The database is populated with equipment, cable, raceway, fire compartment, and other relevant data needed to support Fire PRA, and provides a structured framework for maintaining the data.
Fire PRA Component	Equipment item, system component, structural elements and cables (power, instrumentation and control) included as affecting the potential for core damage or large early release in the Fire PRA Model.
Fire PRA Equipment	Synonymous with Fire PRA Component
Fire PRA Model	The Internal Events PRA Model modified to include fire initiating events and failures (equipment and operator) that may occur as a result of a fire event.
Fire Safe Shutdown Analysis	The deterministic analysis conducted often in the context of Appendix R of 10 CFR Part 50 to ensure safe shutdown capability during identified fire scenarios.
Fire Scenario	A set of elements that describes a fire event. The elements usually include one or more fire compartments, fire ignition source, available detection and suppression features, targets, and secondary or intervening combustibles to which fire may spread. Fire scenarios may be defined in varying levels of detail, depending on the analysis needs. For example, in the initial screening stages of Fire PRA, any fire inside a fire compartment is assumed to fail all Fire PRA Components present in that compartment.
Fire Scenario Frequency	Frequency of occurrence of a fire scenario. This frequency is estimated from fire ignition frequency modified to reflect credit for any one of more of several potential fire mitigation factors including fire severity, growth and damage, detection and suppression, fire barriers, etc. Fire scenario frequency evolves and is refined as the analysis process proceeds from initial screening stages to detailed modeling task.
Fire Zone	Fire zones are subdivisions of fire areas defined in the context of the fire protection program. A fire zone is not necessarily bounded by fire barriers. Zone divisions are often defined based on the fire suppression and/or detection systems designed to combat particular types of fires. A fire zone may contain one or more rooms. A fire compartment may contain one or more fire zones.

Term	Definition
Fixed Ignition Source	Piece of equipment permanently installed in a fire compartment that may cause a fire event.
Generic fire frequency	Fire frequencies that are estimated to apply to any commercial nuclear power plant in the U.S. of certain type.
Geometric factor	Fraction used to apportion the transient fire frequency in a particular scenario to a predetermined floor area in the compartment.
Ground Fault	A type of short circuit involving an abnormal connection between a conductor and a grounded conducting medium. The grounding medium refers to any conduction path associated with the reference ground of the circuit. This might include structural elements (tray, conduit, enclosures, metal beams, etc) or intentionally grounded conductors of the circuit (neutral conductor). A ground fault is characterized by an abnormal current surge (fault current) attributable to the lack of any significant circuit burden (i.e., load). A ground fault should trigger over-current protective action for a properly designed circuit.
Heat Release Rate (HRR)	The amount of heat generated by a burning object per unit time. It is usually expressed in kW. A heat release rate profile refers to the behavior of the heat release rate as a function of time (an HRR versus time plot). For example, a fire with a constant heat release rate has an intensity that does not change.
Horizontal Radial Distance	Horizontal distance measured from the centerline of the fire plume to the item or location of interest.
Hot Gas Layer	Refers to the volume under the ceiling of a fire enclosure where smoke accumulates and high gas temperatures are observed. It is the upper zone in a two-zone model formulation.
Hot Probe Method	A method of circuit analysis in which the analyst assumes the presence of an energized conductor (the hot probe) capable of causing spurious operation of the circuit under analysis. The hot probe approach postulates that this energized conductor might come into contact with other conductors associated with the circuit under analysis. This method is used to aid the analyst in quickly assessing the potential circuit fault modes that might thereby arise.
Hot Short	A conductor-to-conductor short in which an energized conductor (source conductor) shorts to a separate, ungrounded conductor (target conductor). A hot short is characterized by an abnormal connection between conductors that does not produce a high fault current because of inherent impedance in the connection path attributable to circuit components. A defining characteristic of a hot short is that it is not detectable by normal circuit protective devices and thus will not trigger an over-current protective action. A hot short has the potential to cause undesired energization of components connected to the target conductor (i.e., spurious actuation); however, the term hot short is not synonymous with the term spurious actuation.
Hot Short, External	A hot short in which the source conductor and target conductor are from separate cables. Synonymous with intercable hot short and cable-to-cable hot short.
Hot Short, Internal	A hot short in which both the source conductor and target conductor are of the same multi-conductor cable. Synonymous with intracable hot short.

Glossary

Term	Definition
Human Action	The motion(s), decision(s), or thinking of one or more people required to complete a mission defined by the context of an accident scenario.
Human Error	The failure of a human action modeled in a PRA that results in the failure of a plant function, system, or component. Excludes malevolent behavior.
Human Error Probability (HEP)	A measure of the likelihood that plant personnel will fail to initiate the correct, required, or specified action or response in a given situation or by commission performs the wrong action.
Human Failure Event (HFE)	A basic event in the Fire PRA or Internal Events PRA Model that represents a failure or unavailability of a component, system, or function that is caused by human inaction or inappropriate action.
Human reliability analysis (HRA)	A structured approach used to identify potential human error events and to systematically estimate the probability of those errors using data, models, or expert judgment.
Ignition Source	Piece of equipment or activity that causes a fire.
Ignition source weighting factor	Fraction used to translate generic fire frequencies for a generic location/ignition source to specific ignition sources within the plant location.
Incremental Core Damage Probability (ICDP)	The core damage probability with one or more intact trains and/or systems unavailable. ICDP is the product of CDF (with one or more intact trains and/or systems unavailable) and a characteristic exposure time (e.g., maximum allowable outage time).
Incremental Large Early Release Probability (ILERP)	The large early release probability with one or more intact trains and/or systems unavailable. ILERP is the product of LERF (with one or more intact trains and/or systems unavailable) and a characteristic exposure time (e.g., maximum allowable outage time).
Influence factor (maintenance)	Used in apportioning transient fire frequencies, this factor is used for taking into account the influence of preventive and corrective maintenance (PM/CM) operations in a specific plant location.
Influence factor (occupancy)	Used in apportioning transient fire frequencies, this factor is used for taking into account the influence of occupancy (continuous, temporary, etc) of specific plant locations.
Influence factor (storage)	Used in apportioning transient fire frequencies, this factor is used for taking into account the influence of the amount of stored combustibles in a specific plant location.
Intercable Conductor-To-Conductor Short Circuit	A specific subset of conductor-to-conductor short circuit cable failures wherein the short circuit formed involves the conductors of two or more separate cables.
Internal Events PRA Model	The logic model (could be in terms of event trees and fault trees) depicting the combinations of internal initiating events (as compared to external events such as tornados and seismic events), component failures (of causes internal to the components themselves), and human failure events that lead to core damage or large early release or other adverse event considered in a PRA.
Intervening combustibles	Materials that burn but are not ignition sources. These combustibles contribute to the propagation of the fire from the ignition source to the target and are usually located between the ignition source and the target.

Term	Definition
Intracable Conductor-To-Conductor Short Circuit	A specific subset of conductor-to-conductor short circuit cable failures wherein all conductors involved in a given short circuit are within a single multi-conductor cable.
Large Early Release Frequency (LERF)	Expected number of large early releases per unit of time.
Location weighting factor	The number of reactor units used to adjust fire ignition frequency for compartments or equipment types that are shared between units.
Lower layer	Refers to the volume near the floor of a fire enclosure where colder gases are observed. It is the lower zone in a two-zone model formulation.
Manual trip	A reactor trip that is initiated by the operators in response to an off-normal condition and in the absence of an automatic trip.
Mechanical ventilation	Gas flows that are forced in or out of a room, usually by a fan.
Mistake (in HRA context)	A human cognitive error typically stemming from failure of diagnosis, decision-making, or planning.
Modeling Uncertainty (for PRA)	Imprecision in the analyst's knowledge or available information about how well the analyst's model represents the actual state of that being modeled in the PRA. ¹⁸
Natural ventilation	Gas flows into or out of the room induced by density differences between the fluids. In enclosure fires, density differences are observed between colder fresh air and hot smoke.
Open Circuit	A loss of electrical continuity in an electrical circuit, either intentional or unintentional. As applied to wire and cable, open circuit faults may result, for example, from a loss of conductor continuity or from the triggering of circuit protection devices (e.g., a blown fuse or open circuit breaker).
Operator (in HRA context)	One of the shift operating personnel, or generally, any of a plant's personnel responsible for performing a desired action.
Parameter (Data) Uncertainty (for PRA)	Imprecision in the parameter values used as quantitative inputs to the models in a PRA and the resulting imprecision in the quantitative outputs of the PRA.
Performance Shaping Factor (PSF)	A factor that influences human error probabilities as considered in a PRA's human reliability analysis and includes such items as level of training, quality/availability of procedural guidance, time available to perform an action, etc. In the context of a Fire PRA, factors may include influences of environmental factors such as visibility, toxic fumes, and smoke.
Permanent Model Changes	Permanent changes to the logic models (i.e., Internal Events PRA Model or Fire PRA Model). Suggest we delete this one-Alan K.
Post-initiator human error	A human error committed during actions performed in response to an accident initiator.

¹⁸ In the Fire PRA, such imprecision includes, for instance, the treatment of accident sequences as random events, the prediction of fire growth and the resulting temperatures that are reached, the exact location of cables within a raceway and the relative location of conductors of one circuit within a cable, among many others. To establish extent of modeling uncertainty on the overall results of the PRA, typically, sensitivity analysis is used, where warranted.

Glossary

Term	Definition
Potentially Challenging (in the context of fire ignition frequency estimation)	A fire event in a nuclear power plant that did or could have presented a threat to nuclear safety.
Pre-initiator human error	A human error committed during actions performed prior to the initiating event (e.g., during maintenance or calibration activities) and that results in unavailability of equipment or systems that is not discovered until it is demanded during response to the initiator. This is also called a latent error, which is hidden or unknown.
Raceway	Any channel that is designed and used expressly for supporting or enclosing wires, cables, or bus-bar. Raceways consist primarily of, but are not restricted to, cable tray, conduit, duct banks, wire ways, flex, pull boxes, junction boxes (see also Via, Cable).
Recovery action (in HRA context)	A human action performed to regain equipment or system operability from a specific failure or human error in order to mitigate or reduce the consequences of the failure.
Recovery models	Types of Human Reliability Models that represent the act, process, or instance of recovering as a probability for use in a fault tree, event tree or cutset.
Response (in HRA context)	To react to a cue or symptom of an event using procedures to control a function or system.
Response models (in HRA context)	Represent post-initiator operator actions, following a cue or symptom of an event, to satisfy the procedural requirements for control of a function or system.
Risk	Probability and consequences of an event, as expressed by the “risk triplet” that is the answer to the following three questions: (1) What can go wrong? (2) How likely is it? (3) What are the consequences if it occurs?
Safe Shutdown (SSD) Systems and Equipment	Structures, systems, cables (power, instrumentation and control), equipment and components within the framework of 10 CFR 50 Appendix R of 10 CFR Part 50 identified to achieve and maintain sub-critical reactivity conditions in the reactor, maintain reactor coolant inventory, and maintain safe and stable shutdown conditions following a fire-initiated event.
Screening Analysis	A qualitative or quantitative analysis that eliminates items from further consideration based on their negligible contribution to the probability of a significant accident or its consequences.
Screening Criteria	The values and conditions used to determine whether an item is a negligible contributor to the probability of an accident sequence or its consequences.
Sensitivity Analysis	An analysis performed to investigate the sensitivity of the variability in model structure or data values on the products of the analysis (e.g., core damage frequency). While often done by changing the model or data value one-at-a-time and determining the change in the analysis products, it may be done changing groups of variables in a logical manner.

Term	Definition
Severity Factor	Severity factor is the probability that fire ignition would include certain specific conditions that influence its rate of growth, level of energy emanated and duration (time to self extinguishment) to levels at which target damage is generated. It can also be defined as the probability associated with a specific fire intensity.
Shield (in circuit analysis context)	A conductive sheath or wrap around an insulated conductor or group of conductors within a cable. A shield is typically formed of either a metallic foil or a braided sheath of metallic wires. Shields are commonly applied where electromagnetic interference is a potential concern (e.g., communications and instrument circuits).
Short Circuit (general)	An abnormal connection (including an arc) of relatively low impedance between two conductors or points of different potential. A short circuit might involve a ground fault or hot short, as applied to control circuit failures.
Short-to-Ground	Synonymous with Ground Fault
Smoke layer	Refers to the volume under the ceiling of a fire enclosure where smoke accumulates and high gas temperatures are observed. It is the upper zone in a two-zone model formulation (see also Upper Layer).
Source Conductor	The energized conductor of a hot short – the conductor representing the source of energy.
Spurious Operation	A circuit fault mode wherein an operational mode of the circuit is initiated (in full or in part) due to failure(s) in one or more components (including cables) of the circuit.
Surrogate Event	A PRA basic event used to simulate the impact of a fire induced initiating event including the resulting plant initiating event and/or component failures.
Target	May refer to fire damage targets and/or to an ignition target. A fire damage target is any item whose function can be adversely affected by the modeled fire. Typically a fire damage target is a cable or equipment item that belongs to the Fire PRA Component list. An ignition target would be any flammable or combustible material to which fire might spread.
Target Conductor (in circuit analysis context)	The non-energized conductor of a hot short – usually connected to one or more circuit components. A target conductor is the means by which energy is transferred from an energized conductor to a component in the event of a hot short.
Target Equipment Location Report	A compartment-by-compartment listing of equipment potentially affected by a fire in the compartment. The equipment is tagged as potentially affected by a fire in a compartment if it or any of its circuits (including associated circuits) are located in the compartment.
Temporary Model Changes	Temporary changes to the logic models (i.e., Internal Events PRA Model or Fire PRA Model) that are implemented during the quantification process. The integrity of the logic model is preserved after quantification.
Time Available (in HRA context)	The time period from the presentation of a cue for human action or equipment response to the time of adverse consequences if no action is taken.

Glossary

Term	Definition
Transient Combustibles	Combustible materials temporarily in a location that are usually associated with (but not limited to) maintenance or modifications involving combustible and flammable liquids, wood and plastic products, waste, scrap, rags, or other combustibles resulting from the work activity.
Transient Fire (ignition source)	A transient combustible burning.
Truncation Limit	The numerical cutoff value of probability or frequency below which results are not retained in the quantification of the PRA.
Uncertainty	A representation of the confidence in the state of knowledge about the parameter values and models used in constructing the PRA.
Uncertainty Analysis	The process of identifying and characterizing the sources of uncertainty in the analysis, and evaluating their impact on the PRA results. An uncertainty analysis includes developing a quantitative measure to the extent practical.
Upper Layer	Refers to the volume under the ceiling of a fire enclosure where smoke accumulates and high gas temperatures are observed. It is the upper zone in a two-zone model formulation (see also Smoke Layer).
Ventilation Rate	Amount of air, usually measured in m ³ /sec, injected or extracted by a mechanical ventilation system into or from a location, respectively.
Via, Cable	Synonymous with Raceway.
Walkdown	Inspection of local areas in a nuclear power plant where systems and components are physically located in order to ensure accuracy of procedures and drawings, equipment location, operating status, and environmental effects or system interaction effects on the equipment which could occur during accident conditions.
Zone Models	Refers to two-zone models. A model that divides a room into two thermodynamic control volumes or zones: an upper layer of buoyant gases and a lower layer of relatively fresh air that remains near the floor. Conditions within each zone are assumed uniform, and the zones are separated by a distinct interface. Mass, species, and energy conservation equations are applied to each zone to determine the average temperature and gas composition.
Zone of Influence (ZOI)	A volume surrounding an ignition source where all intervening combustibles and targets may be adversely affected by a fire initiated by the ignition source.

Appendix A

Appendix for Chapter 2, Technical Bases

A

APPENDIX FOR CHAPTER 2, TECHNICAL BASES

The Task 2 procedure determines the equipment to include in the Fire PRA. Information about the equipment is put into the Fire PRA Database (see Support Task B). The list of Fire PRA equipment is the source for performing the cable identification and location activity in Task 3, and is the basis for what will be included in the Fire PRA Model starting with Task 5, as modified in subsequent tasks. The procedure has inherently included three underlying bases in order to identify the Fire PRA equipment of interest. These three bases are described below.

A.1 Use of the Internal Events PRA and the Fire Safe Shutdown Analysis as the Primary Technical Inputs

The product of this task, the Fire PRA Component List, is developed on the basis of two primary technical inputs, and further modified by three important technical activities. These two primary technical inputs consist of (1) the Internal Events PRA and (2) the Fire Safe Shutdown Analysis. For the most part, the Fire PRA, and hence the Fire PRA Component List, will be based on the Internal Events PRA, as modified by the Fire Safe Shutdown Analysis and other considerations.

Caution about Limiting the Scope of the Fire PRA

If the analysts purposely choose to limit the scope of the Fire PRA to less than that covered in the Internal Events PRA plus fire effects (e.g., limit the scope to just Fire Safe Shutdown or Appendix R of 10 CFR Part 50 equipment), this may result in trading-off the effort to locate cabling for and performing the analysis of other systems in the PRA for a higher CDF/LERF, since not all the Internal Events PRA modeled equipment would be credited. By giving no credit to other systems or specific equipment items, the analyst is effectively assuming 1.0 failure of that system, train, or component. If the scope of the Fire PRA is limited, the following considerations (illustrated by an example) need to be included to ensure the resulting analysis is conservative.

Suppose it was decided that high pressure injection would not be included in the Fire PRA because it is not part of the Fire Safe Shutdown equipment. There is the potential to miss two possible effects on the fire risk. First, there may be a tendency to not consider, compartments that contain ONLY high-pressure injection equipment, or the high-pressure injection equipment may not be included as sources for various fires and the overall fire frequency for the plant, thereby underestimating the cumulative fire risk for the entire plant. Consistent with Tasks 4 and 6, such compartments should be considered and HPI-source fire frequencies developed, even though the HPI system is not going to be credited as a mitigation feature in the limited scope Fire PRA. Second, if it is possible that fire-induced equipment failures, or especially spurious actuations or indications associated with high pressure injection, could affect (a) other systems that are being

modeled (and credited) and/or (b) operator performance being modeled (and credited) in responding to the fire (e.g., spurious HPI operation could cause additional confusion and/or delay of appropriate credited responses), there may be a tendency to not identify such effects, thereby potentially underestimating the overall fire risk.

To address such concerns, the following should be done when limiting the scope of the Fire PRA so that portions of the Internal Events PRA are purposely not included.

1. The fire sources associated with the equipment not addressed in the Fire PRA and the resulting fire frequencies should be accounted for, especially if the fire frequencies are as high or higher than that assessed for many of the other fire sources/compartments.
2. There should be sufficient review of the equipment items that *are* being credited in the Fire PRA (by looking at their interfaces with other systems or equipment items and via associated circuits reviews) to ensure that failures and especially spurious events associated with those equipment items not being analyzed cannot introduce failures of the credited equipment items that are not already accounted for (this may have been adequately done already as part of the Fire Safe Shutdown analysis).
3. There should be at least a global (if not specific) accounting for the possible additional workload, potential distractions or confusion and associated delays in the operators taking action, as well as other possible effects on operator performance that might occur as a result of failures and/or spurious events associated with equipment items that are otherwise not credited/addressed in the Fire PRA. For instance, suppose HPI is not being modeled, yet spurious operations associated with this system (e.g., pumps starting and/or stopping, valves closing) could delay other credited operator actions (i.e., the actions included in the Fire PRA Model) because some time and effort will likely be expended dealing with the spurious HPI activity. Unless there is a way to specifically identify when and what spurious events may be particularly troublesome (such as by tracing down a limited number of cables on a limited number of HPI equipment to know which compartments present such problems), at least a global effect should be estimated and justified (e.g., affected human error probabilities for actions that are credited in the Fire PRA will be increased by a factor of five in an attempt to globally account for these undefined possible effects).

A.1.1 Basis

These two inputs provide the most useful and comprehensive building blocks available to the analyst to begin developing the Fire PRA Model and the associated Fire PRA Component List. From the perspective of the Fire PRA, the Internal Events PRA should satisfy much of what will be included in the analysis, since it already includes all the typical PRA considerations, assumptions, and other nuances associated with building any PRA model. Further, it is already best-estimate based, which is an underlying principle of the updated fire analysis. It also appropriately credits more than one train of equipment in the plant while properly accounting for the probability of failing any/all equipment included in the model. Finally, it determines success based on realistic and minimum needs (e.g., stable hot shutdown is most times sufficient), which is adequate in determining significant fire risks since the risks should be dominated by early responses during the fire event before the plant is restabilized.

The Internal Events PRA does, however, need to be modified to account for differences in performing a fire risk analysis as opposed to an analysis of internal events. Sequences not very relevant to fire scenarios may be eliminated on the basis of low probability of coincidental events; for example, a fire and a LOCA (due to pipe break) at the same time. While perhaps credible, such coincidental independent events should not dominate the fire risk, and hence can be eliminated early in the task. Additionally, and since the Fire Safe Shutdown Analysis represents another existing fire analysis of the plant, it is important that differences between it and the development of the Fire PRA be reconciled and, where appropriate, Fire Safe Shutdown Analysis considerations be added to the Fire PRA and the Fire PRA Component List.

Where the scope of the Fire PRA will not include all that is covered in the Internal Events PRA, it is important that the resulting analysis address the issues raised earlier when limiting the scope of the Fire PRA. The above text describes ways that the exclusion of certain equipment might actually lead to a nonconservative result. This is unacceptable when limiting the scope of the analysis, and steps should be taken to avoid an optimistic conclusion about the fire risk. The steps to be taken are specifically identified above, and will ensure the Fire PRA results are not optimistic because of the lack of analytical treatment.

A.2 Necessary Modifications/Additions to the Fire PRA Component List

Three additional and very important technical considerations should be included in the development of the Fire PRA Component List (including the consideration of possibly “new” sequences not in the Internal Events PRA).

- Equipment whose fire-induced failure could cause an automatic or forced manual trip of the plant.
- Equipment that either supports the success of safety functions or whose spurious actuation or other fire-induced failure modes could adversely affect the success of the safety functions credited in the Fire PRA, or both. In some cases, the same equipment might also cause an automatic or forced manual trip of the plant.
- Instrumentation or other diagnostic equipment that either supports successful operator actions or whose spurious operation or other fire-induced failure modes could induce inappropriate or otherwise harmful actions by the operator, or both.

A.2.1 Basis

The fire risk is expected to be dominated by fires that cause an initiating event followed by subsequent successes and failures of equipment and operator actions, some of which may be influenced by fire damage. It is not expected that accident sequences involving an independent initiator followed by a fire will be significant, since the exposure time for the fire is short (e.g., 24 hours) for the safe shutdown of the plant. The short exposure time makes such sequences less frequent than those involving a fire as the initiating event (with a yearly exposure time). For this reason, it is important to identify how fires can cause initiating events, the type of initiating event that is caused in each case (e.g., loss of offsite power, loss of service water, etc.), and the locations where fires can cause initiating events. A central part of this process is to identify equipment (and its associated cables) that can fail because of a fire that causes an automatic trip of the plant or a forced manual trip because of plant procedures. Hence, it is important that the

Internal Events PRA be expanded to include equipment important in the Fire PRA because this additional equipment can be the source of an initiating event. Without such an exercise, the initiating event potential for the Fire PRA could be incomplete and the Fire PRA results, therefore, too optimistic.

The search for this equipment is at least expected to define single equipment items (or group of equipment defined as a single entity, such as a “train” of equipment); for example, a single bus, single service water train, etc. If such losses will cause an automatic trip or a forced manual trip per procedure, such equipment needs to be on the Fire PRA Component List so that its locations, and the locations of associated cables, can be identified. Cases can be identified where it takes multiple equipment items to fail to cause an initiating event (e.g., it takes two buses to fail, or it takes one train of service water and one bus failure feeding the opposite train). To expand the search for these “multiple failures” can easily make the search unbounded and impractical. Hence, while the search for fire-induced initiators should not necessarily be limited to finding single failure cases, it is expected that the search for multiple failure initiating events account for those cases where it is already known, or can be easily discerned based on broad knowledge of what is in each plant compartment, that the multiple equipment items share common locations and are potentially susceptible to the same fire (e.g., two offsite power buses that individually would not cause a total loss of offsite power, but together cause loss of all offsite power). There is no technical basis for limiting the search to these considerations, other than it quickly becomes impractical and nearly intractable and would be well beyond the current state of the art and past common practices. Hence, while a limiting feature of the analysis, it is recognized as a practical limitation that makes the analysis incomplete and somewhat optimistic.

From the plant response point of view, fire has the unique characteristic to potentially affect multiple desired equipment functions, as well as causing spurious operation of equipment so that success of safety functions are jeopardized and/or operator response actions are affected by failing to take the desired action or inducing an unsafe action by the operator. As a result, it is also necessary to expand the Fire PRA Component List to explicitly include the above categories of equipment. Whereas spurious operation or failure of equipment in the Internal Events PRA may often be too low in probability to model, multiple fire-induced failures of this type may be sufficiently probable that they should be considered. Similarly, while the Internal Events PRA often does not explicitly model instrumentation needed or which could otherwise affect operator action, fire-induced failures of this instrumentation could significantly alter the success-failure probabilities of credited human actions in a fire, as well as induce undesirable or unsafe actions on the part of the operator. This equipment and their possible failure should therefore be explicitly accounted for when performing the Fire PRA.

A.3 Consideration of a Reasonable Number of Spurious Events

One element of this procedure is attempting to define a practical limitation on the number of fire-induced electrical-related failures considered during the search for spurious operation/failure of equipment within a single system or associated with a single operator action, that could either directly affect the success of a safety function or operator response during a fire accident sequence. There is no apparent, sound, technical basis that can set a specific limit; i.e., tests have shown that multiple failures, including “hot shorts,” are sufficiently probable, so multiple failures cannot be ignored. But there are considerations that can be included in the analyst’s thinking when considering how many simultaneous spurious events to include. These are discussed below.

A.3.1 Basis

It has been recognized on the basis of test data and analysis [A.1] that more than one simultaneous spurious event can occur during a fire with nontrivial probability (e.g., consensus opinions on the order of 0.3 chance of any one circuit spuriously operating). Hence, the fire analysis and this procedure consider multiple spurious events at the same time. Like the initiating event discussion above, the search for and inclusion of multiple equipment failures involving spurious events during a fire scenario can easily make the effort unbounded and impractical. Hence, the question becomes, how many should be considered?

Unfortunately, consensus opinions like the above do not allow a probabilistic argument to define a limit on how many multiple spurious events should be considered. The short answer is, consider as many as resources and other practical constraints will allow.

But there are considerations that can be included in the analyst's thinking when searching for simultaneous spurious events that should be included in the Fire PRA and thus the Fire PRA Component List. To the extent these considerations provide a strong argument for eliminating some equipment from consideration, they can help justify why certain simultaneous spurious events (and equipment) have not been included. Besides the criteria provided under Steps 4 and 5 of the Task 2 procedure, the list below provides additional considerations assuming that cable locations for the equipment are not yet known or cannot be quickly determined (so that arguments cannot already be made on the basis of nonshared locations). These are

- The results in NUREG/CR-6776 [A.2] suggest that thermoplastic cables are not very susceptible to prolonged (minutes) failures where voltage/current is continually applied to the circuit, allowing equipment to change state or instrumentation to fail in a "believable" and prolonged fashion. If it is known that the circuits involve thermoplastic cables, the analyst may consider eliminating such circuits from concern.
- The results in NUREG/CR-6776 [A.2] suggest that the failure durations are typically a few minutes to on the order of 10 minutes in length. The analyst may consider eliminating such circuits from concern if they can justify that these failure durations will preclude: (a) long term effects on system equipment; and (b) not cause the operator to take an unsafe/undesirable action or preclude the operator from taking a desirable action. For example, consider a fire-induced spurious operation of a circuit is such that: (a) it will only cause the component to be in an unsafe state during the time of the spurious actuation; (b) the component is without a latching circuit and will therefore return to its safe state once the spurious signal ceases to exist; and (c) no significant consequences result from the momentary unsafe status of the component. In such a case, a spurious event can be neglected and treatment of that component-failure mode can be eliminated. Similarly, for example, if a momentary failure of an instrument (on the order of 10 minutes) does not cause the operator to immediately shutdown a safe shutdown component or otherwise cause the operator to miss an important cue for an action within an acceptable timeframe, that instrument and its failure need not be treated in the analysis. In the case of these potential operator impacts, these should be discussed with an HRA analyst and/or operations staff member to ensure that the operator would not be adversely affected.

- For instrumentation, if it is known that a set bias exists such that the instrument would likely fail in an extreme high or low condition and thus be obviously determined by the operator to be erroneous, the analyst may consider eliminating such circuits from concern. This should be discussed with an HRA analyst and/or operations staff member for concurrence that the error would be obvious.
- Digital type circuits tend to either be good or the signal is lost (i.e., they do not tend to fail in a believable but degraded fashion). Hence, the analyst may consider eliminating such circuits from concern.
- In examining multiple spurious events, an advisable analytical technique is to assume that a single spurious event results in the adverse situation actually caused by multiple spurious actuations. If the single spurious event can be screened out on the basis of overall scenario probability (such as via running the model) and/or insignificant consequence arguments, there is no further need to investigate the multiple spurious situation(s).

A.4 References

- A.1 *Spurious Actuation of Electrical Circuits Due to Cable Fires: Results of an Expert Elicitation*, May 2002. EPRI Report 1006961.
- A.2 Wyant, F., and Nowlen, S.P., *Cable Insulation Resistance Measurements Made During Cable Fire Tests*, USNRC, NUREG/CR-6776, June 2002.

Appendix B

Appendix for Chapter 3, Example

B

APPENDIX FOR CHAPTER 3, EXAMPLE

This appendix contains a simple example of the Fire PRA cable selection process. The example includes two Fire PRA components. Prior to conducting the cable selection analysis, the analyst determines that these two components were not included in the Appendix R analysis, and thus need new component analyses (i.e., Step 2.3, Case 2). Furthermore, it is also discovered during the process of evaluating prerequisite information (Step 1) that the plant's cable routing database system contains location and raceway data related to both components.

The strategies and rules governing the cable selection process (Steps 2.1 and 2.2) are then developed and documented in a plant-specific procedure. Following the Case 2 methodology, the analyst collects applicable drawings and documents for each component. The analyst also assembles the information for each component into separate work packages. Figure B-1 shows the block diagrams for the two components (Pump 3CHS*P3A and Valve 3CCE*SOV37A). The pump has only one cable associated with it (Cable 3CHSAOH350), while the valve has two cables necessary for its operation (Cables 3CCEAOC611 and 3CCEAOX237).

The one-line diagrams are also reviewed to identify the power supplies for each of the two components (Step 3.1). A review of the relevant electrical coordination studies (Step 4) reveals that each component's branch circuit is sufficiently protected and coordinated with the feeder circuit. Hence, no associated circuits are identified for either of the components.

The analyst then uses the information in the CRS to determine the raceways and raceway routing associated with each cable. Table B-1 shows the resulting compilation of this data (Step 5.1).

As part of performing the activities of Step 6, the analyst generates the Fire PRA Cable List and the Target Equipment Location Reports on a compartment-by-compartment basis (see Table B-2). Finally, a summary table of component location vulnerabilities is developed. Table B-3 shows an example of the summary.

The analyst completes the evaluation by including in the 3CHS*P3A and 3CCE*SOV37A analysis packages the drawings, worksheets, tables and results generated during the process.

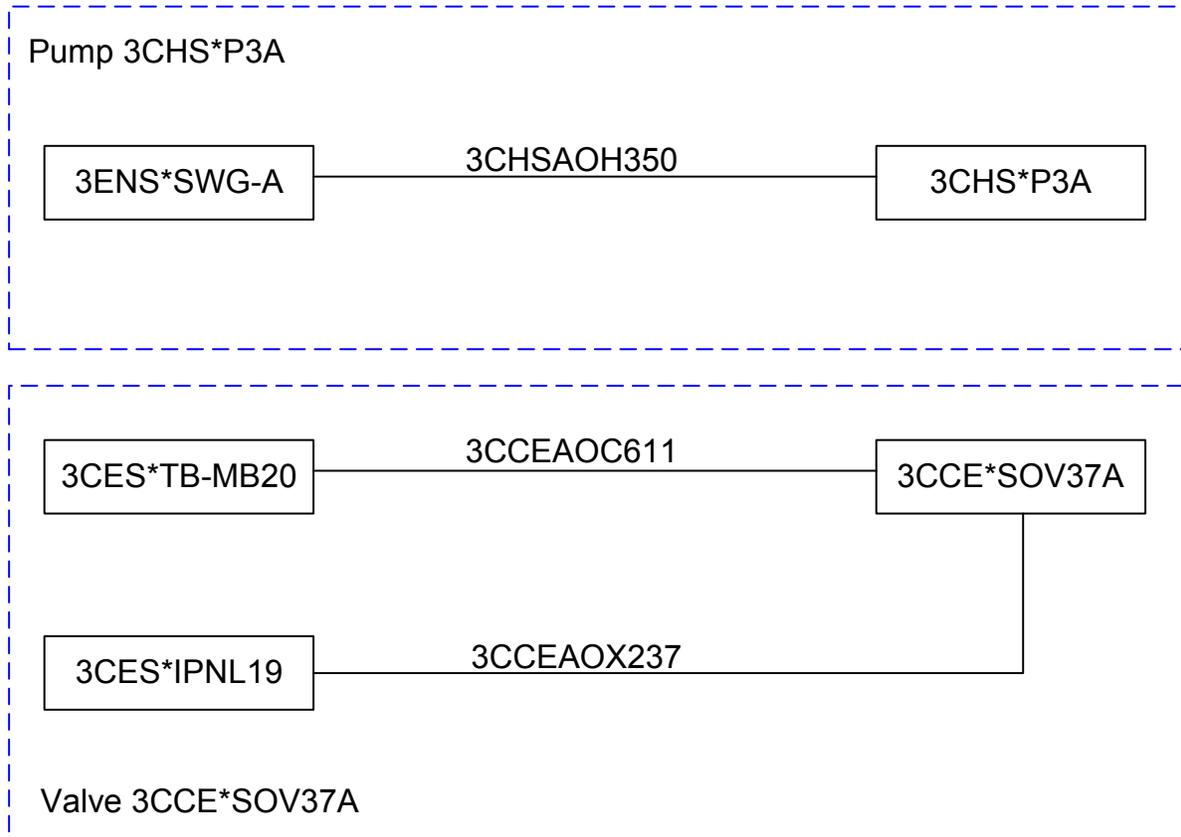


Figure B-1
Example Cable Block Diagrams

Table B-1
Example Fire PRA Cable Data

Equipment ID	Cable ID	Cable Function	Vias	Compartment	From	To
3CHS*P3A	3CHSAOH350	Power	3CH404OD	CB-2-X	3ENS*SWG-A	
			3TH404O	CB-2-X		
			3TH403O	CB-2-X		
			3TH402O	CB-2-X		
			3TH301O	SB-2		
			3TH302O	SB-2		
			3TH106O	AB-5-Y		
			3TH103O	AB-5-Y		
			3TH104O	AB-5-Y		
			3TH202O	AB-1-D		
			3CH202OA	AB-1-D		3CHS*P3A

Table B-1
Example Fire PRA Cable Data (Continued)

Equipment ID	Cable ID	Cable Function	Vias	Compartment	From	To
3CCE*SOV37A	3CCEAOC611	Control	3FC437O01	CB-11-A	3CES*TB-MB2O	
			3CC417OA	CB-8		
			3TC406O	CB-8		
			3TC419O	CB-2-X		
			3TC449O	CB-2-X		
			3TC303O	SB-2		
			3TC302O	SB-2		
			3TC301O	SB-2		
			3TC300O	SB-2		
			3TC103O	AB-5-Y		
			3WC211O02	AB-5-Y		
			3JB*2303	AB-1-D		
			3CC932OF	AB-1-D		3CCE*SOV37A
	3CCEAOX237	Instrument	3FX431O01	CB-11-A	3CES*IPNLI9	
			3CX950OG3	CB-8		
			3JB*4205	CB-8		
			3CX950OG4	CB-8		
			3JB*4300	CB-8		
			3CX400OA	CB-8		
			3TX400O	CB-2-X		
			3TX303O	SB-2		
			3TX301O	SB-2		
			3TX300O	SB-2		
			3TX106O	AB-5-Y		
			3CX106OL	AB-5-Y		
			3WX211O05	AB-1-D		
			3JB*2303	AB-1-D		
			3CX933OA	AB-1-D		3CCE*SOV37A

Table B-2
Example Target Equipment Location Reports

Fire Compartment: AB-1-D		
Equipment ID	Cable ID	Raceways
3CHS*P3A	3CHSAOH350	3TH202O, 3CH202OA
3CCE*SOV37A	N/A	(Component in compartment)
3CCE*SOV37A	3CCEAOC611	3CC932OF, 3JB*2303
3CCE*SOV37A	3CCEAOX237	3CX933OA, 3JB*2303, 3WX211O05

Fire Compartment: AB-5-Y		
Equipment ID	Cable ID	Raceways
3CHS*P3A	3CHSAOH350	3TH106O, 3TH103O, 3TH104O
3CCE*SOV37A	3CCEAOC611	3WC211O02, 3TC103O
3CCE*SOV37A	3CCEAOX237	3CX106OL, 3TX106O

Fire Compartment: SB-2		
Equipment ID	Cable ID	Raceways
3CHS*P3A	3CHSAOH350	3TH301O, 3TH302O
3CCE*SOV37A	3CCEAOC611	3TC300O, 3TC301O, 3TC302O, 3TC303O
3CCE*SOV37A	3CCEAOX237	3TX300O, 3TX301O, 3TX303O

Fire Compartment: CB-2-X		
Equipment ID	Cable ID	Raceways
3CHS*P3A	3CHSAOH350	3CH404OD, 3TH404O, 3TH403O, 3TH402O
3CCE*SOV37A	3CCEAOC611	3TC449O, 3TC419O
3CCE*SOV37A	3CCEAOX237	3TX400O

Fire Compartment: CB-8		
Equipment ID	Cable ID	Raceways
3CCE*SOV37A	3CCEAOC611	3TC406O, 3CC417OA
3CCE*SOV37A	3CCEAOX237	3CX400OA, 3JB*4300, 3CX950OG4, 3JB*4205, 3CX950OG3

Fire Compartment: CB-11-A		
Equipment ID	Cable ID	Raceways
3CCE*SOV37A	3CCEAOC611	3FC437O01
3CCE*SOV37A	3CCEAOX237	3FX431O01

Table B-3
Example Equipment Location Vulnerability Summary Report

Equipment ID	Cable ID	Plant Compartment					
		AB-1-D	AB-5-Y	SB-2	CB-2-X	CB-8	CB-11-A
3CHS*P3A	N/A	X					
3CHS*P3A	3CHSAOH350	X	X	X	X		
3CCE*SOV37A	N/A	X					
3CCE*SOV37A	3CCEAOC611	X	X	X	X	X	X
3CCE*SOV37A	3CCEAOX237	X	X	X	X	X	X

Appendix C

**Appendix for Chapter 6, Determination of
Generic Fire Frequencies**

C

APPENDIX FOR CHAPTER 6, DETERMINATION OF GENERIC FIRE FREQUENCIES

A generic set of fire frequency distributions were developed. The frequencies presented in this Appendix replace those documented in EPRI in TR-1003111 [C.1]. The new generic frequencies are based on the assumption that there is plant-to-plant variability in the likelihood of experiencing fires. The “Two-Stage Bayesian” methodology [C.2] was used to model the variability, which led to wider uncertainty ranges for the fire frequencies than those presented in [C.1]. This Appendix is intended to describe the fire event data analysis, methodology used to estimate the revised frequencies and present, in particular, the mean, 5th, 50th and 95th percentiles of related uncertainty distributions.

The generic frequency model utilizes fire location/ignition source bins to estimate fire ignition frequencies. Each bin represents a set of operating experience events at a particular location/ignition source in U.S. nuclear power plants (NPPs). Each record in the EPRI Fire Events Database (FEDB) was evaluated and included accordingly in the frequency model is assigned to a bin. Note that the location bins consider all major locations in U.S. nuclear power plants. An additional bin, plant wide components, is included to account for ignition sources that cannot be assigned to a particular plant location.

The classification of fire events is further divided into power and all operating modes. This classification is used to determine fire frequencies in location/ignition source bins that reflect relevant changes in terms of fire protection based on the mode of operation at the time. Only one frequency is estimated in location/ignition source bins where the hazards related to fire protection are similar during power and low-power operation. In this later case, the fire events at power and low-power operation are combined.

The location/ignition source bin approach in the frequency model is used to provide a better characterization of fires in the nuclear power plants. This provides a logical tie into modeling consequences of fires by distinguishing between various fires. In addition, characterizing the fire source is critical in risk-informed/performance-based applications and identifying opportunities to improve fire protection design and practice.

C.1 Methodology Summary

The methodology employed to estimate generic fire frequencies (λ_{is}) attempts to model the plant-to-plant variability that can be attributed to sources like the number of ignition sources, housekeeping practices, and fire event recording or reporting practices.

This approach is particularly important, since the FEDB is based on inconsistent recordkeeping and reporting practices. These inconsistencies, for the most part, are related to the quality of the data in terms of content and completeness. Completeness refers to the fires that were potentially unreported and therefore not included in the database. Content refers to the amount and accuracy of the information in the records provided by the data sources.

Regarding completeness of the database, the current version of the EPRI FEDB contains a wide range of fire reports from various U.S. commercial nuclear power plants ranging from 0.1 to over 6 fire reports per reactor-year, and covering fires in all different modes of operation. This variation can be attributed to two factors: fire event recording at each facility and its data collection process. Even with considerable effort and using multiple avenues for data collection, the process does not ensure that records of all fires in the industry are included in the EPRI FEDB. No attempt has been made to estimate the number of fires events that EPRI has been unable to collect. However, because of the requirement for challenging fires as described in Section C.2 below, it cannot be easily ascertained that the noted under-reporting has resulted in optimistic frequency estimations. The methodology employed for fire frequency estimation explicitly includes plant-to-plant variability, which in part may have captured some of the uncertainty due to under-reporting at some plants.

Regarding the content of data records, the amount and quality of information related to each fire event varies throughout the database. Institute for Nuclear Power Operations (INPO), NEIL, NRC, and the different utilities in the industry have different templates to document fire events, which consequently affects the consistency of the records. In some cases, details about fire events are collected from accident descriptions where fires are only a part of the larger objective of the recordkeeping effort. Variations in the personal styles in event reports also influence the level of information provided.

To capture the uncertainties associated with plant-to-plant variability in the generic fire frequency estimates, the data in FEDB was treated as if generated by non-homogeneous sources. In other words, each nuclear power plant is considered different in terms of recording and reporting fire events to appropriate organizations (NRC, etc.) and supplying recorded events to EPRI.

Using mathematical notation, according to the data treatment discussed above, the fire events in FEDB are classified as follows:

$$E = \{(k_i, T_i) \quad i = 1, \dots, N\},$$

where

- k = the number of fire events in a location or associated to an ignition source bin,
- T = associated number of reactor years,
- i = a specific NPP unit i , and
- N = total number of NPP units in the U.S.

This data is used as evidence in the calculation of a probability distribution for the generic fire frequency using two-stage Bayesian formulations.

C.2 Prior Distributions

In the two-stage Bayesian approach, it is assumed that there is uncertainty about the location (i.e., bulk of distribution) and spread of the uncertainty distribution. Therefore, a family of prior distributions are established to allow the calculations for the first stage to estimate the generic fire frequencies. The prior distributions represent the knowledge about fire frequencies before the evidence is available. The prior distributions were selected by a panel of experts experienced in the use of two-stage Bayesian approach and in estimating fire frequencies. Table C-1 provides the key parameters of the prior distributions selected by the expert panel.

Assuming lognormal distributions, the prior distributions were selected using the following three-parameter values:

- Smallest possible fire frequency represented by the 5th percentile of the lowest distribution,
- Largest possible fire frequency represented by the 95th percentile of the highest distribution, and
- The error factor¹⁹ of the distribution that can be called as the median distribution is 10.

In Table C-1, the “min” and “max” represent the absolute minimum and absolute maximum frequencies that the expert panel could assign to the items of the bin. These values were taken to be the 5th and 95th mentioned in the preceding bullets. The rest of the parameters in Table C-1 were obtained from the following formulations:

$$\text{“Median”} = \text{SQRT}(\text{“Min”} \times \text{“Max”})$$

$$\text{“Error Factor (EF) for Median”} = 10 \text{ (for all cases)}$$

$$\text{“EF”} = \text{SQRT}(\text{“Median”}/(10 \times \text{“Min”}))$$

$$\text{“EF of EF”} = \text{“EF”} \text{ (for all cases)}$$

Using the distributions defined by these parameters as non-homogeneous input variables, the uncertainty distributions for the fire frequencies of each bin were estimated using the computer program R-DAT [C.1].

¹⁹ Error factor is defined as the median divided by the 5th percentile or 95th divided by the median (assuming a lognormal distribution).

Table C-1
Summary of Prior Distributions used in R-DAT

ID	Location	Ignition Source	Prior Distribution		R-DAT Parameter		R-DAT Parameter	
			Min	Max	Median	Error Factor (EF) for Median	EF	EF for EF
1	Battery Room	Batteries	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0
2	Containment (PWR)	Reactor Coolant Pump	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0
3	Containment (PWR)	Transients and hotwork	1.0E-06	3.0E-01	5.5E-04	10	7.4	7.4
4	Control Room	Main Control Board	1.0E-06	3.0E-01	5.5E-04	10	7.4	7.4
5	Control/Auxiliary/Reactor Building	Cable fires caused by welding and cutting	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0
6	Control/Auxiliary/Reactor Building	Transient fires caused by welding and cutting	1.0E-06	3.0E+00	1.7E-03	10	13.2	13.2
7	Control/Auxiliary/Reactor Building	Transients	1.0E-06	3.0E+00	1.7E-03	10	13.2	13.2
8	Diesel Generator Room	Diesel generators	1.0E-06	3.0E+00	1.7E-03	10	13.2	13.2
9	Plant-Wide Components	Air Compressors	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0
10	Plant-Wide Components	Battery Chargers	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0
11	Plant-Wide Components	Cable run (Self-ignited cable fires)	1.0E-06	3.0E-01	5.5E-04	10	7.4	7.4
12	Plant-Wide Components	Cable fires caused by welding and cutting	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0

Table C-1
Summary of Prior Distributions used in R-DAT (Continued)

ID	Location	Ignition Source	Prior Distribution		R-DAT Parameter		R- DAT Parameter	
			Min	Max	Median	Error Factor (EF) for Median	EF	EF for EF
13	Plant-Wide Components	Dryers	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0
14	Plant-Wide Components	Electric motors	1.0E-06	1.0E+01	3.2E-03	10	17.8	17.8
15	Plant-Wide Components	Electrical cabinets	1.0E-06	1.0E+01	3.2E-03	10	17.8	17.8
16	Plant-Wide Components	High energy arcing faults	1.0E-06	3.0E-01	5.5E-04	10	7.4	7.4
17	Plant-Wide Components	Hydrogen Tanks	1.0E-06	3.0E-01	5.5E-04	10	7.4	7.4
18	Plant-Wide Components	Junction box	1.0E-06	3.0E+00	1.7E-03	10	13.2	13.2
19	Plant-Wide Components	Misc. Hydrogen Fires	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0
20	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0
21	Plant-Wide Components	Pumps	1.0E-06	3.0E+00	1.7E-03	10	13.2	13.2
22	Plant-Wide Components	RPS MG sets	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0
23	Plant-Wide Components	Transformers	1.0E-06	3.0E+00	1.7E-03	10	13.2	13.2

Table C-1
Summary of Prior Distributions used in RDAT (Continued)

ID	Location	Ignition Source	Prior Distribution		R- DAT Parameter		R- DAT Parameter	
			Min	Max	Median	Error Factor (EF) for Median	EF	EF for EF
24	Plant-Wide Components	Transient fires caused by welding and cutting	1.0E-06	1.0E+01	3.2E-03	10	17.8	17.8
25	Plant-Wide Components	Transients	1.0E-06	1.0E+01	3.2E-03	10	17.8	17.8
26	Plant-Wide Components	Ventilation Subsystems	1.0E-06	3.0E+00	1.7E-03	10	13.2	13.2
27	Transformer Yard	Transformer - Catastrophic	1.0E-06	3.0E-01	5.5E-04	10	7.4	7.4
28	Transformer Yard	Transformer - Non-Catastrophic	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0
29	Transformer Yard	Yard transformers (Others)	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0
30	Turbine Building	Boiler	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0
31	Turbine Building	Cable fires caused by welding and cutting	1.0E-06	3.0E+00	1.7E-03	10	13.2	13.2
32	Turbine Building	Main feedwater pumps	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0
33	Turbine Building	Turbine generator (T/G) Excitor	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0
34	Turbine Building	T/G Hydrogen	1.0E-06	1.0E+00	1.0E-03	10	10.0	10.0
35	Turbine Building	T/G Oil	1.0E-06	3.0E+00	1.7E-03	10	13.2	13.2
36	Turbine Building	Transient fires caused by welding and cutting	1.0E-06	1.0E+01	3.2E-03	10	17.8	17.8
37	Turbine Building	Transients	1.0E-06	1.0E+01	3.2E-03	10	17.8	17.8

C.3 Screening Events for Inclusion in the Calculation of Generic Fire Frequencies

Events contained in the FEDB were screened for inclusion into (or exclusion from) the basic or nominal fire event frequency calculation based on two general considerations. The first consideration is when and where the fire occurred. The second consideration is whether or not a given event either did or could have presented a threat to nuclear safety (potentially challenging fires).

C.3.1 Where and When a Fire Occurred

The fire PRA as described in these procedures considers the impact of fires occurring during normal power operations and excludes consideration of other modes of plant operation (e.g., shutdown). Hence, fires were included in the fire frequency calculation only if they occurred during power operations or low-power operations, such as plant start-up. Fires that had occurred during other modes of operation, including cold shutdown, construction, and refueling, were excluded from the fire frequency calculation.

A second criterion for event screening considered where the fire occurred. The fire risk quantification is concerned with fires that might impact plant safe operations through the failure of one or more plant components or functions. Hence, fires that have no potential to directly impact plant components or functions were eliminated. This would include fires that occur off-site, or on-site in areas that are not associated with either the nuclear or power generation blocks of the plant. Examples of excluded fires include, but are not limited to, those occurring in parking lots outside the protected area, strictly administrative areas or buildings, detached warehouses or storage facilities, offsite switchyards, or temporary structures associated with plant construction.

C.3.2 Potentially Challenging Events

The second stage of event screening considered whether or not a particular event did, or had the potential to, challenge plant nuclear safety. The intent of this step is to identify reported events involving an incipient fire, fire ignition event, or explosion event that had the potential to develop into a self-sustaining fire. Events that lack this potential were screened out from the fire frequency calculation.

It is vital to recognize that the event screening process is not based on assessing the actual severity of any given event, although this is a consideration in the screening process. Events that involved fires of low severity (in the classical sense of low fire intensity and/or minimal spread or damage) were included in the fire frequency calculation if they had the potential to become a challenging fire under other circumstances—hence the terminology, “potentially challenging.”

A common example is hot-work fires that are quickly suppressed by a fire watch. These events were retained in the fire frequency calculation for hot-work fires if the fire was self-sustaining and required active intervention by some means of suppression (e.g., the fire watch) in order to prevent further development of the fire. The likelihood that prompt suppression might occur given a hot-work fire was treated separately in the analysis of fire detection and suppression.

The criteria for identifying potentially challenging events includes objective and subjective elements. The objective criteria are based on reportable facts related to the means of fire suppression, the extent of fire growth and/or damage, fire duration, and other indicators. The objective criteria are applied in a mechanical manner—i.e., yes/no checkboxes. The subjective criteria involve the application of judgment. Factual information related to the objective criteria is often lacking in the event reports. Hence, the analysis should also use judgment to determine whether or not the event was potentially challenging, typically based on a review of the descriptive text provided for the event.

Each event was first classified as “potentially challenging,” “not challenging,” or “undetermined.” Events classified as not challenging are those where it can be determined with reasonable certainty that the criteria reflecting a potentially challenging event were not met. Events where the information was found insufficient to make a determination were classified as unknown.

The criteria for classifying fire events are provided in Section C.2.3.

C.3.3 Criteria for Classification of Fire Events

C.3.3.1 Objective Classification Criteria

A fire event was classified as potentially challenging if any one of the following is true.

- A hose stream, multiple portable fire extinguishers, and/or a fixed fire suppression system (either manually or automatically actuated) were used to suppress the fire.
- One or more components outside the boundaries of the fire ignition source were affected where the term “outside the boundaries of the fire ignition source” will depend to some degree on the specific ignition source (see further discussions below).
- Combustible materials outside the boundaries of the fire ignition source were ignited (with a similar use of the term “outside the fire ignition source” implied).

A fire event was also classified as potentially challenging if two or more of the following features are cited in an event report:

- Actuation of an automatic detection system,
- A plant trip was experienced,
- A reported loss of greater than \$5,000 (not including any lost business damages), or
- A burning duration or suppression time of 10 minutes or longer.

With regard to the term “outside the boundaries of the fire ignition source,” the intent is to establish the frequency of fires that might cause a threat beyond the boundaries of the ignition source. However, what exactly one means by the boundaries of the ignition source may need some use of judgment. This term is relatively obvious when applied to a familiar scale—i.e., to objects of an ordinary size. However, if applied with an excess of literal interpretation to very large (e.g., the turbine generator or a diesel generator) or very small objects (e.g., an individual resistor on a circuit card), the intent can be misconstrued. The following provides case-specific examples to illustrate the intent.

- For self-ignited cable fires: Any fire where the failure of, or an overload on, one cable caused at least one other cable to ignite and/or fail should be identified as potentially challenging.
- For heavy electrical equipment panels such as switchgear and breaker panels: Any fire in one cubicle that caused damage and/or ignition in a second cubicle or to overhead cables is potentially challenging. If the damage was confined to a single cubicle and has essentially no potential to spread beyond that cubicle, the fire can be classified as non-severe. However, care should be taken when fortuitous configuration factors contributed to the lack of fire spread or damage (e.g., the cubicle happened to be at the top of a stack of cubicles).
- For relay/control panels: For solid-state devices, any fire that caused the fire spread/damage beyond the initiating circuit card is potentially challenging. For electromechanical devices (e.g., control relays), consider fire damage or spread extending beyond the initiating component. For example, if an event report identifies a resistor on a circuit board as the ignition source and the fire self-extinguished without causing damage beyond that one circuit card, the ignition source should be considered the circuit card, and in this case the event would be classified as non-severe. A self-extinguished fire involving only a single electro-mechanical relay would also be classified as non-severe (the “smoked relay” case).
- For diesel generators: A manifold fire (very common) is potentially challenging if it spread to a secondary fuel or if the initial fuel source is continuous (i.e., an ongoing fuel or oil leak, rather than a glob of grease). In contrast, a fire that causes substantial damage to the diesel generator but does not damage or spread to any other components should be classified as potentially challenging.
- Hot-work fires: An event is classified as potentially challenging if some active intervention appeared necessary to suppress the fire (i.e., if the fire watch put it out quickly, but clearly a fire was started and had the potential to grow, this is a potentially challenging fire event). The use of a single fire extinguisher should not be the only indicator of a potentially challenging fire.

A final point is related to certain types of general electrical equipment fires. Care was taken in the classification of certain self-extinguished electrical fires. In particular, electrical fires may self-extinguish after plant personnel deenergize the impacted equipment. Deenergizing the electrical equipment is one mechanism of active intervention by plant personnel; hence, such events were generally classified as potentially challenging.

C.3.3.2 Subjective Classification Criteria

A fire was classified as potentially challenging if there are sufficient indications to determine that the fire was self-sustaining or that it might have affected components or led to ignition materials outside the fire ignition source. This judgment may be based on the general tone of the event report or on the observation of specific aspects of a fire event. In general, observations of the following features in an event report can be indicative of a potentially challenging fire.

- It is apparent that active intervention was needed to prevent potential spread.
- There are indications that heat was generated of sufficient intensity and duration to affect components outside the fire ignition source, had such been in close proximity to the ignition source.

- There are indications that flames or heat were generated of sufficient intensity and duration to cause the ignition of secondary combustibles outside the fire ignition source, had such been in close proximity to the ignition source.
- Substantial smoke was generated (e.g., a room was reported to be smoke-filled when first responders arrived on the scene, or the report includes a description such as “heavy” or “dense” smoke).

C.3.4 Implications of the Event Screening Process and Criteria

The practices and criteria used to identify potentially challenging fires have direct implications for the fire modeling and detection and suppression analysis tasks, as well as for the potential application of fire severity factors. These implications include the following:

- The criteria for potentially challenging fires has already eliminated those fire events that were self-extinguished with no potential to spread to or cause damage to objects outside the boundaries of the fire ignition source. Hence, no additional credit should be taken for self-extinguishing fires. The only exception is electrical fires that self-extinguish once actions are taken by plant personnel to deenergize the affected equipment.
- Potentially challenging fires include those where prompt suppression was effective at minimizing fire growth and damage. Hence, it is appropriate to independently credit means of prompt suppression. In practice, welding is the only place practicable to credit continuous fire watches since further use of continuous watches is very plant specific.
- The criteria for potentially challenging fires are somewhat dependent on the type of fire ignition source involved in the events. Hence, the nominal or minimal fire source intensity implied is also dependent on the fire ignition source. However, as a general rule, potentially challenging fires do reflect those that actually did or very well could have spread to secondary fuels and/or caused damage to targets outside the ignition source. Hence, the fire modeling assumptions should reflect this potential.
- The base or nominal fire frequencies reflect the occurrence frequency of fires that will need some active intervention by plant personnel to suppress. Hence, it should be assumed that the fires will indeed continue to burn, will grow to the extent that secondary combustible materials are available to support combustion, and will carry the potential to damage components outside the fire ignition source until and unless active intervention in the fire is affected.
- The method for calculating the base fire frequencies leaves the potential for the prudent application of an additional fire severity factor. That is, the method does not explicitly consider the potential that a given fire ignition source or fire ignition event will lead to a fire of any particular intensity or duration. Indeed, for various reasons, most of the fires classified as potentially challenging did not evolve into truly challenging fires. This can be reflected through the appropriate analysis of fire growth and damage potential, the appropriate analysis of detection and suppression, and/or potentially the appropriate application of a fire severity factor.

C.4 Additional Considerations

C.4.1 Event Counting Method

The calculation of location/ignition source frequencies calls for the fire events to be classified as follows:

- Location/ignition source,
- NPP unit name,
- Mode of operation (power and all operating modes), and
- Potentially challenging, not challenging, or undetermined.

The information provided in event reports may have deficiencies in NPP unit name, mode of operation, or severity of the fire (i.e., whether or not the fire is potentially challenging). Since excluding these events would potentially lead to non-conservatism in fire frequency estimation, an approach was developed to include them in the frequency estimation process.

Consider first the following def

N = total number of NPP units in the analysis

K = number of fire events with known information associated with a location/ignition source bin of a known NPP unit

$F_{\text{plant},i}$ = total number of fire events in the NPP unit involving location or ignition source bin i

i = location or ignition source bin

p = Probability that the NPP unit was in power operation mode

q = Probability that an undetermined fire event is potentially challenging

A = Number of events with no NPP unit name (all other parameters are known)

B = Number of events with unknown mode of operation (all other parameters are known)

C = Number of events with undetermined “challenging” level (all other parameters are known)

AB = Number of events with no known NPP unit name and unknown mode of operation (challenging level known)

AC = Number of events with no known NPP unit name and undetermined challenging level (mode of operation unknown)

- BC = Number of events with unknown mode of operation and undetermined challenging level (NPP unit name known)
- ABC = Number of events with no known NPP unit name, unknown mode of operation, and undetermined challenging level

To estimate p, the fraction of the events with known power operation mode that had occurred during normal power operation was used. Also, for q it was assumed that q = 0.5.

In general, once the events are classified per location/ignition source bin, they are further classified per NPP unit t, operating mode, and “challenging fire” categorization. Therefore, each fire event in the FEDB can be classified according to the combination of possibilities shown in Table C-2. Those fire events determined as non-challenging are not included in the statistical analysis. The multiplier shown in Table C-2 is used to adjust the number of fires. Fires with no associated known NPP unit name are distributed among all other plants. It should be noted that in the case of Main Control Board fires, there were three events that could not be ascertained whether or not the Main Control Board was affected directly from the fire. Those events were distributed equally between the Main Control Board and Plant Wide Components – Electrical Cabinets.

Table C-2
Fire Event Classifications and Frequency Estimation Action

Class. #	Information Deficiencies			Frequency Estimation Action	
	Known Plant	Known Op. Mode	Challenging Fire	Multiplier	Method of inclusion
1	Yes	Yes	Yes	1	As is
2	Yes	Yes	Undetermined	Q	As is
3	Yes	No	Yes	P	As is
4	Yes	No	Undetermined	Qp	As is
5	No	Yes	Yes	1	Distribute among units
6	No	Yes	Undetermined	Q	Distribute among units
7	No	No	Yes	P	Distribute among units
8	No	No	Undetermined	Qp	Distribute among units

Based on the eight possibilities shown in Table C-2, the following equation is used to calculate the number of fire events assigned to each power plant unit:

$$F_{\text{plant},i} = K_i + C_i \cdot q + B_i \cdot p + BC_i \cdot p \cdot q + A_i/N + (AC_i/N) \cdot q + (AB_i/N) \cdot p + (ABC_i/N) \cdot p \cdot q$$

A detailed description of each parameter in the equation follows.

As suggested by the above equation, the number of fires in a given location/ignition source bin with known information (i.e., Classification 1 in Table C-2) are counted and assigned to a respective plant (K_i). The events with unknown information are added to this term.

A/N: For those events where the plant name is not known but the mode of operation and “challenging” level is known (i.e., Classification 5 in Table C-2), the average number of events per plant is added to K_i .

B_i·p: The number of fires associated with a specific plant for which the challenge level is known, but the mode of operation is the only unknown is multiplied by the fraction p to adjust it for events that may have occurred during power operation. This applies to Classification 3 events, as defined in Table C-2.

C_i·q: The number of fires associated with a specific plant for which the mode of operation is known but the challenge level is the only unknown is multiplied by the fraction q to adjust it for events that may have been challenging. This applies to Classification 2 events, as defined in Table C-2.

(AB_i/N)·p: The number of fires for which the challenge level is known and the other two parameters (i.e., plant name and mode of operation) are unknown is first averaged over the entire population of plants and then multiplied by the fraction p to adjust it for events that may have occurred during power operation. This applies to Classification 7 events, as defined in Table C-2.

(AC_i/N) q: The number of fires for which the mode of operation is known and the other two parameters (i.e., plant name and challenge level) are unknown is first averaged over the entire population of plants and then multiplied by the fraction q to adjust it for events that may have been potentially challenging. This applies to Classification 6 events, as defined in Table C-2.

BC_i·p·q: The number of fires for which the plant name is known and the other two parameters (i.e., mode of operation and challenge level) are unknown is multiplied by the fractions p and q to adjust it for events that may have occurred during power operation and may have been challenging. This applies to Classification 4 events, as defined in Table C-2.

(ABC_i/N)·p·q: The number of events with no plant name, unknown mode of operation, and undetermined challenge level is first averaged over the entire population of plants and then multiplied by the fractions p and q to adjust it for events that may have occurred during power operation and may have been challenging. This applies to Classification 8 events, as defined in Table C-2.

C.4.2 Fire Events in Decommissioned Plants

EPRI has not made a systematic effort to collect fires in decommissioned plants. However, data collection has resulted in 11 fires that occurred after the plant’s decommission date (one of these fires occurred in a trailer). Five of these records indicate transient fires, four of which were caused by welding and cutting activities. The remaining five fires were classified as follows: two pump fires, one electrical cabinet fire, one dryer, and one fire in a junction box splice.

These records were included in the fire ignition frequency model as fires during low-power operation. They were not excluded because they occurred shortly after the decommission date or in a location (e.g., radwaste building) where plant configuration is likely to remain the same or similar. If the information indicates that plant configuration is significantly altered compared to its configuration prior to decommissioning, the event was excluded from the ignition frequency model.

C.4.3 Estimated Reactor Years of Power and Low-Power Operation

The number of reactor years for power operation is calculated by adding the years of operation for each plant during the period of analysis multiplied by the capacity factor. The capacity factor is the percentage of a year in which the reactor was in power operation. A capacity factor of 0.62 was assumed up to the end of calendar year 1993. From 1994 to 2000, the capacity factors for each plant listed in NUREG-1350 were used.

C.5 Event Counts and Generic Frequencies

The number of events for each location/ignition source bin was obtained using the described approach presented in Section C.4.1 above. For each unit the reactor years of operation and all operating modes were estimated based on the capacity factors presented in Section C.4.3 above. Using the prior distributions presented in Table C-1 and R-DAT computer program [C.3] the generic fire frequencies of each location/ignition source bin was estimated. The results are presented in Table C-3 in terms of the total number of fire events assigned to each location/ignition source bin and total number of reactor years. Note that the R-DAT input was in terms of number of fire events and reactors years per NPP unit in the U.S. The uncertainty distribution of the resulting frequencies is presented in terms of the 5th, 50th (median) and 95th percentiles of the distributions. The mean values are also provided since those are the most appropriate parameter to be used in point value computations because the mean is the conservative value, as compared to the median, for all the ignition frequency distributions. The standard deviation provides a measure of the spread of each distribution.

Table C-3
Generic Fire Ignition Frequency Model for U.S. Nuclear Power Plants

	Location	Ignition Source	# of Events	Total Reactor Years	RDAT Output				
					5%	50%	95%	Mean	St. Dev
1	Battery Room	Batteries	1.0	2486	2.0E-05	3.2E-04	2.4E-03	7.5E-04	2.2E-03
2	Containment (PWR)	Reactor Coolant Pump	6.5	1089	3.1E-04	3.6E-03	1.7E-02	6.1E-03	1.3E-02
3	Containment (PWR)	Transients and hotwork	2.4	1089	1.3E-04	1.1E-03	5.9E-03	2.0E-03	3.6E-03
4	Control Room	Main control board	5.5	2486	8.4E-05	1.2E-03	7.3E-03	2.5E-03	2.1E-01
5	Control/Auxiliary/React or Building	Cable fires caused by welding and cutting	2.0	1674	3.1E-05	6.4E-04	5.0E-03	1.6E-03	5.2E-03
6	Control/Auxiliary/React or Building	Transient fires caused by welding and cutting	12.6	1674	8.9E-05	2.4E-03	3.3E-02	9.7E-03	4.1E-02
7	Control/Auxiliary/React or Building	Transients	6.0	1674	1.6E-04	2.2E-03	1.1E-02	3.9E-03	9.2E-03
8	Diesel Generator Room	Diesel generators	49.5	2486	1.9E-03	1.2E-02	6.6E-02	2.1E-02	3.2E-02
9	Plant-Wide Components	Air compressors	5.0	2486	3.8E-05	9.0E-04	7.9E-03	2.4E-03	8.3E-03
10	Plant-Wide Components	Battery chargers	4.0	2486	7.6E-05	9.8E-04	5.4E-03	1.8E-03	4.2E-03
11	Plant-Wide Components	Cable fires caused by welding and cutting	3.0	1674	2.4E-05	6.8E-04	6.7E-03	2.0E-03	7.4E-03
12	Plant-Wide Components	Cable run	11.5	2486	2.6E-04	2.6E-03	1.3E-02	4.4E-03	2.4E-02
13	Plant-Wide Components	Dryers	5.5	2486	5.2E-05	1.1E-03	8.1E-03	2.6E-03	8.1E-03

**Table C-3
Generic Fire Ignition Frequency Model for U.S. Nuclear Power Plants (Continued)**

	Location	Ignition Source	# of Events	Total Reactor Years	RDAT Output				
					5%	50%	95%	Mean	St. Dev
14	Plant-Wide Components	Electric motors	10.0	2486	2.4E-04	2.7E-03	1.3E-02	4.6E-03	9.5E-03
15	Plant-Wide Components	Electrical cabinets	109	2486	6.5E-03	3.0E-02	1.28E-01	4.5E-02	5.5E-02
16	Plant-Wide Components	High energy arcing faults	3.5	2486	5.3E-05	7.5E-04	4.5E-03	1.5E-03	3.5E-03
17	Plant-Wide Components	Hydrogen tanks	4.0	2486	8.2E-05	9.4E-04	5.0E-03	1.7E-03	3.5E-03
18	Plant-Wide Components	Junction box	3.0	2486	1.5E-05	5.0E-04	6.1E-03	1.9E-03	8.4E-03
19	Plant-Wide Components	Miscellaneous hydrogen fires	5.5	2486	4.1E-05	9.6E-04	8.2E-03	2.5E-03	8.4E-03
20	Plant-Wide Components	Off-gas/H ₂ recombiner (BWR)	25.5	585	2.7E-03	2.5E-02	1.3E-01	4.4E-02	9.3E-02
21	Plant-Wide Components	Pumps	52.0	2486	2.8E-03	1.5E-02	5.9E-02	2.1E-02	2.5E-02
22	Plant-Wide Components	RPS MG sets	3.7	1674	9.6E-05	9.8E-04	4.7E-03	1.6E-03	3.3E-03
23	Plant-Wide Components	Transformers	23.0	2486	6.8E-04	5.9E-03	3.0E-02	9.9E-03	1.8E-02
24	Plant-Wide Components	Transient fires caused by welding and cutting	7.3	1674	6.9E-05	1.7E-03	1.7E-02	4.9E-03	1.7E-02
25	Plant-Wide Components	Transients	12.9	1674	1.4E-04	3.0E-03	3.4E-02	9.9E-03	3.6E-02

Table C-3
Generic Fire Ignition Frequency Model for U.S. Nuclear Power Plants (Continued)

	Location	Ignition Source	# of Events	Total Reactor Years	RDAT Output				
					5%	50%	95%	Mean	St. Dev
26	Plant-Wide Components	Ventilation subsystems	16.0	2486	2.7E-04	3.7E-03	2.3E-02	7.4E-03	1.8E-02
27	Transformer Yard	Transformer – catastrophic	10.0	1674	3.3E-04	3.6E-03	1.7E-02	6.0E-03	1.2E-02
28	Transformer Yard	Transformer – noncatastrophic	21.5	1674	1.3E-03	8.7E-03	3.4E-02	1.2E-02	1.7E-02
29	Transformer Yard	Yard transformers (others)	3.0	1674	4.2E-05	9.1E-04	6.7E-03	2.2E-03	6.8E-03
30	Turbine Building	Boiler	2.0	2486	6.5E-05	6.4E-04	3.2E-03	1.1E-03	2.1E-03
31	Turbine Building	Cable fires caused by welding and cutting	1.5	1674	1.9E-05	5.1E-04	4.9E-03	1.6E-03	6.1E-03
32	Turbine Building	Main feedwater pumps	15.5	1674	1.2E-04	3.2E-03	4.4E-02	1.3E-02	5.5E-02
33	Turbine Building	T/G excitor	6.5	1674	2.4E-04	2.5E-03	1.1E-02	3.9E-03	7.6E-03
34	Turbine Building	T/G hydrogen	10.5	1674	4.3E-04	4.2E-03	1.8E-02	6.5E-03	1.2E-02
35	Turbine Building	T/G oil	15.5	1674	6.8E-04	6.0E-03	2.8E-02	9.5E-03	1.6E-02
36	Turbine Building	Transient fires caused by welding and cutting	13.0	1674	4.0E-04	4.7E-03	2.5E-02	8.2E-03	1.7E-02
37	Turbine Building	Transients	10.5	1674	1.1E-04	2.3E-03	2.7E-02	8.5E-03	3.7E+00

C.6 Fire Event Classification

EPRI Fire Event Data Base was reviewed per the criteria described in this Appendix. The following was determined for event:

- Known plant and unit
- Location of the event
- Ignition source(s) involved
- Operating mode (i.e. power or low power)
- Challenging
- High energy arcing fault (electrical events only)

Table C-4 provides a complete list of the events considered. The incident number corresponds with the numbering scheme used in EPRI Fire Event Data Base. With the exception of two events, each event was assigned to a single location and ignition source. Events (incident number) 2167 and 2373 were treated differently since both events occurred in multiple locations in the plant. In particular, one electrical fault caused more than one ignition at different parts of the circuit, which were located in different parts of the plant.

C.7 References

- C.1 *Fire Event Database and Generic Ignition Frequency Model for U.S. Nuclear Power Plants*. EPRI, Palo Alto, CA: 2001. 1003111.
- C.2 Kaplan, “On a ‘Two-Stage’ Bayesian Procedure for Determining Failure Rates from Experiential Data,” *IEEE Transactions on Power Apparatus and Systems*, Volume PAS-102, 1983, pp. 195-202.
- C.3 “R-DAT and R-DAT Plus 1.5 User’s Manual”, Prediction Technologies, College Park, MD, 2002.

**Table C-4
Fire Event Classification**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
2	Plant-Wide Components	Cable Run	Power Operation	FALSE	TRUE	FALSE	FALSE
3	Plant-Wide Components	Cable Run	Power Operation	FALSE	TRUE	FALSE	FALSE
4	Plant-Wide Components	Cable Run	Power Operation	FALSE	TRUE	FALSE	FALSE
5	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
7	Containment (PWR)	Reactor Coolant Pump	Power Operation	FALSE	FALSE	FALSE	TRUE
8	Turbine Building	Main feedwater pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
9	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Low Power Operation	FALSE	TRUE	FALSE	FALSE
10	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
11	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
12	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
13	Plant-Wide Components	Air Compressors	Low Power Operation	FALSE	FALSE	TRUE	FALSE
14	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
16	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
17	Plant-Wide Components	Gas Turbines	Power Operation	FALSE	FALSE	TRUE	FALSE
18	Plant-Wide Components	Gas Turbines	Low Power Operation	FALSE	FALSE	TRUE	FALSE
20	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
21	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
22	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	FALSE	TRUE
23	Plant-Wide Components	Junction box	Low Power Operation	FALSE	FALSE	TRUE	FALSE
24	Turbine Building	Main feedwater pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
25	Transformer Yard	Transformer – Catastrophic	Low Power Operation	FALSE	TRUE	FALSE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
26	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
27	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
28	Plant-Wide Components	Battery Chargers	Power Operation	FALSE	FALSE	TRUE	FALSE
29	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	FALSE	TRUE
30	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
32	Plant-Wide Components	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE
33	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Low Power Operation	FALSE	TRUE	FALSE	FALSE
34	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	FALSE	TRUE
35	Turbine Building	T/G Oil	Power Operation	FALSE	TRUE	FALSE	FALSE
36	Turbine Building	T/G Oil	Power Operation	FALSE	TRUE	FALSE	FALSE
37	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
38	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	FALSE	TRUE
39	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	FALSE	TRUE
40	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
41	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	FALSE	TRUE
42	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
43	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
44	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	TRUE	FALSE
46	Turbine Building	Transients	Power Operation	FALSE	TRUE	FALSE	FALSE
47	Plant-Wide Components	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE
48	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
49	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
50	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
51	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
52	Containment (PWR)	Reactor Coolant Pump	Power Operation	FALSE	FALSE	FALSE	TRUE
53	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
54	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
55	Control/Aux/Reactor Building	Transients	Power Operation	FALSE	TRUE	FALSE	FALSE
56	Control/Aux/Reactor Building	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
57	Transformer Yard	Transformer - Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
58	Plant-Wide Components	Battery Chargers	Power Operation	FALSE	FALSE	TRUE	FALSE
59	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	TRUE	FALSE
60	Turbine Building	Main feedwater pumps	Low Power Operation	FALSE	TRUE	FALSE	FALSE
62	Turbine Building	T/G Oil	Power Operation	FALSE	TRUE	FALSE	FALSE
63	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	FALSE	TRUE
64	Turbine Building	T/G Oil	Power Operation	FALSE	FALSE	FALSE	TRUE
65	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
66	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	FALSE	TRUE
67	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
68	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
69	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
70	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	FALSE	TRUE
71	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	TRUE	FALSE
72	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
73	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
74	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
75	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
76	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	FALSE	TRUE
77	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	FALSE	TRUE
78	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
79	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	FALSE	TRUE
80	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
81	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
82	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
83	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	FALSE	TRUE
84	Plant-Wide Components	RPS MG sets	Power Operation	FALSE	FALSE	FALSE	TRUE
85	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
86	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
87	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	FALSE	TRUE
88	Containment (PWR)	Transients	Low Power Operation	FALSE	TRUE	FALSE	FALSE
89	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
90	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
92	Containment (PWR)	Reactor Coolant Pump	Power Operation	FALSE	FALSE	FALSE	TRUE
94	Containment (PWR)	Transients and Hotwork	Power Operation	FALSE	TRUE	FALSE	FALSE
95	Containment (PWR)	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
96	Containment (PWR)	Reactor Coolant Pump	Low Power Operation	FALSE	TRUE	FALSE	FALSE
97	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
98	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power Operation	FALSE	FALSE	TRUE	FALSE
99	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	FALSE	FALSE	TRUE
100	Turbine Building	T/G Hydrogen	Power Operation	FALSE	TRUE	FALSE	FALSE
101	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
102	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
103	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
104	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
106	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
107	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
108	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	FALSE	TRUE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
110	Turbine Building	Cable fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
111	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	FALSE	TRUE
112	Containment (PWR)	Reactor Coolant Pump	Low Power Operation	FALSE	FALSE	FALSE	TRUE
113	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
115	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
116	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	FALSE	TRUE
117	Turbine Building	Cable fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE
118	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
119	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
120	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	TRUE	FALSE
121	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	FALSE	TRUE
122	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
123	Turbine Building	Transients	Low Power Operation	FALSE	TRUE	FALSE	FALSE
124	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
125	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
126	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
127	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
128	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
129	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
130	Plant-Wide Components	Ventilation Subsystems	Low Power Operation	FALSE	FALSE	TRUE	FALSE
131	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
132	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
133	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	FALSE	TRUE	FALSE
134	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	TRUE	FALSE	FALSE
135	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	FALSE
137	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	TRUE	FALSE
138	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
139	Turbine Building	Boiler	Power Operation	FALSE	FALSE	FALSE	TRUE
140	Battery Room	Batteries	Power Operation	FALSE	FALSE	TRUE	FALSE
141	Battery Room	Batteries	Power Operation	FALSE	FALSE	TRUE	FALSE
142	Transformer Yard	Transformer - Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
143	Plant-Wide Components	Hydrogen Tanks	Power Operation	FALSE	TRUE	FALSE	FALSE
144	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	FALSE	TRUE
145	Plant-Wide Components	Pumps	Low Power Operation	FALSE	TRUE	FALSE	FALSE
146	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
147	Plant-Wide Components	RPS MG sets	Power Operation	FALSE	FALSE	TRUE	FALSE
148	Containment (PWR)	Transients	Low Power Operation	FALSE	TRUE	FALSE	FALSE
149	Turbine Building	T/G Hydrogen	Low Power Operation	FALSE	TRUE	FALSE	FALSE
150	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	FALSE	TRUE
151	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	FALSE	FALSE	TRUE
152	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
153	Transformer Yard	Transformer - Non Catastrophic	Low Power Operation	FALSE	FALSE	FALSE	TRUE
155	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	FALSE	TRUE
157	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	FALSE	FALSE	TRUE
158	Battery Room	Batteries	Power Operation	FALSE	TRUE	FALSE	FALSE
159	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
161	Plant-Wide Components	Hydrogen Tanks	Power Operation	FALSE	FALSE	TRUE	FALSE
162	Plant-Wide Components	Dryers	Power Operation	FALSE	TRUE	FALSE	FALSE
163	Control Room	Main control board	Low Power Operation	FALSE	TRUE	FALSE	FALSE
164	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
165	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
166	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	FALSE	TRUE
167	Containment (PWR)	Reactor Coolant Pump	Low Power Operation	FALSE	FALSE	FALSE	TRUE
168	Containment (PWR)	Reactor Coolant Pump	Power Operation	FALSE	FALSE	FALSE	TRUE
169	Containment (PWR)	Reactor Coolant Pump	Power Operation	FALSE	TRUE	FALSE	FALSE
170	Containment (PWR)	Transients and Hotwork	Power Operation	FALSE	FALSE	FALSE	TRUE
171	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
172	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
173	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
175	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
176	Plant-Wide Components	Electric motors	Low Power Operation	FALSE	FALSE	FALSE	TRUE
177	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
178	Containment (PWR)	Transients and Hotwork	Power Operation	FALSE	FALSE	FALSE	TRUE
179	Plant-Wide Components	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
180	Containment (PWR)	Reactor Coolant Pump	Power Operation	FALSE	FALSE	FALSE	TRUE
181	Plant-Wide Components	Cable Run	Low Power Operation	FALSE	TRUE	FALSE	FALSE
183	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE
185	Plant-Wide Components	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
186	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	TRUE	FALSE	FALSE
187	Plant-Wide Components	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
188	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
189	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
190	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
191	Control/Aux/Reactor Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
192	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
193	Plant-Wide Components	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
195	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
196	Plant-Wide Components	RPS MG sets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
197	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
198	Plant-Wide Components	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
199	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
201	Turbine Building	Main feedwater pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
202	Plant-Wide Components	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
203	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
204	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	FALSE	TRUE
205	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
206	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
207	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power Operation	FALSE	FALSE	TRUE	FALSE
208	Containment (PWR)	Transients and Hotwork	Power Operation	FALSE	FALSE	TRUE	FALSE
209	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
210	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
211	Plant-Wide Components	Transformers	Power Operation	FALSE	TRUE	FALSE	FALSE
212	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
214	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
215	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	FALSE	TRUE
217	Plant-Wide Components	RPS MG sets	Power Operation	FALSE	TRUE	FALSE	FALSE
219	Plant-Wide Components	Pumps	Low Power Operation	FALSE	TRUE	FALSE	FALSE
220	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	FALSE	TRUE	FALSE
221	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
222	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	TRUE	FALSE	FALSE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
223	Plant-Wide Components	Electric Motors	Power Operation	FALSE	TRUE	FALSE	FALSE
224	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
225	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
226	Containment (PWR)	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
227	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
230	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
231	Plant-Wide Components	Cable Run	Low Power Operation	FALSE	FALSE	FALSE	TRUE
232	Containment (PWR)	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
234	Turbine Building	T/G Excitor	Power Operation	FALSE	FALSE	FALSE	TRUE
235	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	TRUE	FALSE
236	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
237	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
238	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
240	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power Operation	FALSE	FALSE	FALSE	TRUE
241	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
242	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
244	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	FALSE	TRUE
245	Containment (BWR)	Transient fires caused by welding and	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
		cutting					
246	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
247	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
248	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
250	Turbine Building	T/G Hydrogen	Power Operation	FALSE	TRUE	FALSE	FALSE
251	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
252	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
253	Plant-Wide Components	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
254	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
255	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
257	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
258	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE
260	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	TRUE	FALSE	FALSE
261	Transformer Yard	Transformer - Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
262	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
263	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
264	Plant-Wide Components	Misc. Hydrogen Fires	Power Operation	FALSE	TRUE	FALSE	FALSE
265	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
266	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
268	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
269	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
270	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
272	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
274	Containment (BWR)	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
275	Plant-Wide Components	Dryers	Low Power Operation	FALSE	FALSE	TRUE	FALSE
276	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
277	Turbine Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
278	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
279	Turbine Building	Transients	Power Operation	FALSE	TRUE	FALSE	FALSE
281	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
282	Plant-Wide Components	Cable Run	Low Power Operation	FALSE	FALSE	FALSE	TRUE
283	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
284	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
285	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
286	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
287	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
288	Turbine Building	Main feedwater pumps	Power Operation	FALSE	FALSE	FALSE	TRUE
289	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power Operation	FALSE	FALSE	FALSE	TRUE
290	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
291	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
293	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
294	Plant-Wide Components	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
295	Turbine Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
296	Plant-Wide Components	Ventilation Subsystems	Low Power Operation	FALSE	FALSE	FALSE	TRUE
297	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
298	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
299	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
300	Plant-Wide Components	Transformers	Low Power Operation	FALSE	TRUE	FALSE	FALSE
301	Plant-Wide Components	Cable run	Low Power Operation	FALSE	FALSE	TRUE	FALSE
302	Plant-Wide Components	Ventilation Subsystems	Low Power Operation	FALSE	FALSE	TRUE	FALSE
303	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
304	Turbine Building	T/G Hydrogen	Power Operation	FALSE	TRUE	FALSE	FALSE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
305	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	TRUE	FALSE
306	Transformer Yard	Others	Power Operation	FALSE	FALSE	TRUE	FALSE
307	Plant-Wide Components	Air Compressors	Low Power Operation	FALSE	FALSE	TRUE	FALSE
308	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
309	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
310	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
311	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
313	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
314	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
315	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
316	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
319	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
322	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
323	Plant-Wide Components	Dryers	Power Operation	FALSE	TRUE	FALSE	FALSE
324	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
325	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
326	Turbine Building	T/G Excitor	Power Operation	FALSE	TRUE	FALSE	FALSE
327	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
328	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
329	Control Room	Main control board	Power Operation	FALSE	FALSE	TRUE	FALSE
330	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
331	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
333	Plant-Wide Components	Transformers	Power Operation	FALSE	TRUE	FALSE	FALSE
334	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
335	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
336	Containment (BWR)	Reactor Feed Pump	Low Power Operation	FALSE	FALSE	TRUE	FALSE
337	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
338	Plant-Wide Components	Junction box	Low Power Operation	FALSE	FALSE	TRUE	FALSE
339	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
340	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	TRUE	FALSE
341	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
342	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
343	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
344	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
345	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
346	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	TRUE	FALSE
347	Plant-Wide Components	Electric motors	Power Operation	FALSE	TRUE	FALSE	FALSE
348	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
349	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
350	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
351	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
352	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
353	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
354	Plant-Wide Components	Electric motors	Power Operation	FALSE	TRUE	FALSE	FALSE
355	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
356	Containment (PWR)	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
357	Plant-Wide Components	Battery Chargers	Power Operation	FALSE	TRUE	FALSE	FALSE
358	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
359	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
360	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
361	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
362	Turbine Building	Transients	Low Power Operation	FALSE	TRUE	FALSE	FALSE
363	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	FALSE	TRUE
364	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
365	Plant-Wide Components	Electric Motors	Power Operation	FALSE	FALSE	TRUE	FALSE
366	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
367	Plant-Wide Components	Misc. Hydrogen Fires	Power Operation	FALSE	FALSE	TRUE	FALSE
368	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
369	Plant-wide components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
370	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
371	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
373	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
374	Control Room	Main control board	Power Operation	FALSE	FALSE	TRUE	FALSE
375	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
376	Plant-Wide Components	Transformers	Low Power Operation	FALSE	FALSE	FALSE	TRUE
377	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
378	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
379	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
380	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
381	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
382	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
383	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
384	Turbine Building	T/G Excitor	Power Operation	FALSE	TRUE	FALSE	FALSE
385	Plant-Wide Components	Cable fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
386	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
387	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
388	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
389	Plant-Wide Components	Transformers	Low Power Operation	FALSE	TRUE	FALSE	FALSE
390	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
391	Plant-Wide Components	Cable fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
392	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
393	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
394	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
396	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	TRUE	FALSE	FALSE
397	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	TRUE	FALSE	FALSE
398	Plant-Wide Components	Cable Run	Low Power Operation	FALSE	FALSE	FALSE	TRUE
399	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
400	Plant-Wide Components	Dryers	Low Power Operation	FALSE	FALSE	TRUE	FALSE
401	Turbine Building	T/G Oil	Power Operation	FALSE	TRUE	FALSE	FALSE
402	Turbine Building	T/G Oil	Power Operation	FALSE	TRUE	FALSE	FALSE
403	Plant-Wide Components	Ventilation Subsystems	Low Power Operation	FALSE	TRUE	FALSE	FALSE
404	Battery Room	Batteries	Power Operation	FALSE	FALSE	TRUE	FALSE
405	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
407	Transformer Yard	Transformer - Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
408	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
409	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
410	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	FALSE	TRUE
411	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
412	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
413	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
415	Turbine Building	T/G Hydrogen	Power Operation	FALSE	TRUE	FALSE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
418	Plant-Wide Components	Battery Chargers	Low Power Operation	FALSE	TRUE	FALSE	FALSE
420	Turbine Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
421	Plant-Wide Components	Transformers	Low Power Operation	FALSE	TRUE	FALSE	FALSE
422	Plant-Wide Components	Electric motors	Low Power Operation	FALSE	FALSE	TRUE	FALSE
424	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
425	Control Room	Main control board	Low Power Operation	FALSE	FALSE	TRUE	FALSE
426	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
428	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	FALSE	TRUE
429	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
430	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
431	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
432	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
433	Plant-Wide Components	Hydrogen Tanks	Power Operation	FALSE	TRUE	FALSE	FALSE
434	Plant-Wide Components	Electrical cabinets	Power Operation	TRUE	FALSE	FALSE	TRUE
435	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	FALSE	TRUE
436	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
439	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	FALSE	TRUE	FALSE
440	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
441	Turbine Building	T/G Oil	Power Operation	FALSE	FALSE	TRUE	FALSE
443	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
444	Plant-Wide Components	Pumps	Undetermined	FALSE	TRUE	FALSE	FALSE
445	Transformer Yard	Transformer - Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
446	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
447	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
448	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
450	Control/Aux/Reactor Building	Transients	Low Power Operation	FALSE	TRUE	FALSE	FALSE
452	Plant-Wide Components	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
454	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	TRUE	FALSE	FALSE
455	Turbine Building	T/G Hydrogen	Power Operation	FALSE	TRUE	FALSE	FALSE
456	Plant-Wide Components	Air Compressors	Power Operation	FALSE	FALSE	TRUE	FALSE
457	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	TRUE	FALSE
459	Plant-Wide Components	Ventilation Subsystems	Undetermined	FALSE	FALSE	TRUE	FALSE
460	Plant-Wide Components	Gas Turbines	Power Operation	FALSE	FALSE	TRUE	FALSE
464	Control/Aux/Reactor Building	Transients	Undetermined	FALSE	TRUE	FALSE	FALSE
465	Turbine Building	T/G Hydrogen	Power Operation	FALSE	TRUE	FALSE	FALSE
466	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
467	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
468	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	TRUE	FALSE
469	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
470	Turbine Building	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
471	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
473	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
474	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
475	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
476	Turbine Building	Main feedwater pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
477	Turbine Building	Main feedwater pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
479	Plant-Wide Components	Air Compressors	Power Operation	FALSE	FALSE	TRUE	FALSE
480	Control Room	Main control board	Power Operation	FALSE	TRUE	FALSE	FALSE
481	Control Room	Main control board	Low Power Operation	FALSE	FALSE	TRUE	FALSE
484	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
485	Containment (PWR)	Reactor Coolant Pump	Power Operation	FALSE	TRUE	FALSE	FALSE
486	Plant-wide components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
487	Turbine Building	T/G Excitor	Power Operation	FALSE	TRUE	FALSE	FALSE
488	Plant-Wide Components	RPS MG sets	Power Operation	FALSE	FALSE	TRUE	FALSE
490	Plant-Wide Components	Electric motors	Undetermined	FALSE	FALSE	FALSE	TRUE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
491	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
492	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	FALSE	TRUE
493	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
494	Plant-Wide Components	Transformers	Power Operation	FALSE	TRUE	FALSE	FALSE
495	Plant-Wide Components	Pumps	Low Power Operation	FALSE	TRUE	FALSE	FALSE
496	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
498	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
499	Plant-Wide Components	Dryers	Undetermined	FALSE	FALSE	FALSE	TRUE
500	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	TRUE	FALSE
501	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
502	Containment (BWR)	Transients	Low Power Operation	FALSE	TRUE	FALSE	FALSE
505	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	FALSE	TRUE
506	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
508	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	TRUE	FALSE	FALSE
509	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
510	Plant-Wide Components	Cable Run	Power Operation	FALSE	TRUE	FALSE	FALSE
511	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
512	Plant-Wide Components	Misc. Hydrogen Fires	Power Operation	FALSE	TRUE	FALSE	FALSE
513	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	FALSE	TRUE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
514	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
515	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
516	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
517	Control/Aux/Reactor Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
518	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	FALSE	TRUE
519	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
522	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
524	Containment (BWR)	Reactor Feed Pump	Power Operation	FALSE	TRUE	FALSE	FALSE
525	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
526	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
528	Plant-Wide Components	Off-gas/H2 Recombiner (BWR)	Low Power Operation	FALSE	TRUE	FALSE	FALSE
529	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
530	Plant-Wide Components	RPS MG sets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
531	Turbine Building	T/G Oil	Power Operation	FALSE	TRUE	FALSE	FALSE
532	Plant-Wide Components	RPS MG sets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
534	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
535	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	TRUE	FALSE	FALSE
537	Control Room	Main control board	Low Power Operation	FALSE	TRUE	FALSE	FALSE
539	Containment (PWR)	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
540	Turbine Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
541	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
544	Plant-Wide Components	Ventilation Subsystems	Undetermined	FALSE	TRUE	FALSE	FALSE
545	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
551	Plant-Wide Components	Transformers	Power Operation	FALSE	TRUE	FALSE	FALSE
552	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
554	Turbine Building	T/G Oil	Power Operation	FALSE	TRUE	FALSE	FALSE
555	Plant-Wide Components	Pumps	Undetermined	FALSE	FALSE	TRUE	FALSE
556	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
557	Plant-Wide Components	RPS MG sets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
558	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	TRUE	FALSE
559	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	TRUE	FALSE	FALSE
561	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
562	Turbine Building	T/G Oil	Power Operation	FALSE	TRUE	FALSE	FALSE
566	Plant-Wide Components	Pumps	Low Power Operation	FALSE	TRUE	FALSE	FALSE
567	Plant-Wide Components	Transients	Power Operation	FALSE	TRUE	FALSE	FALSE
568	Turbine Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
569	Turbine Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
570	Plant-Wide Components	Hydrogen Tanks	Power Operation	FALSE	TRUE	FALSE	FALSE
571	Plant-Wide Components	Air Compressors	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
572	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
575	Transformer Yard	Transformer - Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
577	Turbine Building	Transients	Power Operation	FALSE	TRUE	FALSE	FALSE
578	Plant-Wide Components	Dryers	Low Power Operation	FALSE	FALSE	TRUE	FALSE
580	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
581	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
582	Turbine Building	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
583	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
584	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power Operation	FALSE	FALSE	TRUE	FALSE
586	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
587	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
588	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
589	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
590	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
591	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
592	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
594	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
596	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
597	Plant-Wide Components	Air Compressors	Low Power Operation	FALSE	FALSE	TRUE	FALSE
599	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
600	Control/Aux/Reactor Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
601	Turbine Building	T/G Oil	Low Power Operation	FALSE	TRUE	FALSE	FALSE
602	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	FALSE	TRUE	FALSE
604	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
605	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
608	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
609	Control/Aux/Reactor Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
610	Plant-Wide Components	Gas Turbines	Power Operation	FALSE	FALSE	TRUE	FALSE
611	Plant-Wide Components	RPS MG sets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
613	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
614	Plant-Wide Components	Transformers	Power Operation	FALSE	TRUE	FALSE	FALSE
616	Turbine Building	T/G Oil	Low Power Operation	FALSE	FALSE	TRUE	FALSE
617	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
618	Turbine Building	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
619	Turbine Building	Transients	Low Power Operation	FALSE	TRUE	FALSE	FALSE
620	Plant-Wide Components	Junction box	Low Power Operation	FALSE	FALSE	TRUE	FALSE
625	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	TRUE	FALSE	FALSE
626	Turbine Building	Boiler	Low Power Operation	FALSE	FALSE	FALSE	TRUE
628	Turbine Building	T/G Oil	Power Operation	FALSE	FALSE	TRUE	FALSE
629	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	TRUE	FALSE
630	Turbine Building	T/G Oil	Low Power Operation	FALSE	FALSE	TRUE	FALSE
631	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
632	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
633	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	TRUE	FALSE	FALSE
634	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
635	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
636	Turbine Building	T/G Oil	Power Operation	FALSE	TRUE	FALSE	FALSE
638	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
639	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
640	Containment (BWR)	Cable fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
641	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
642	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
643	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
644	Diesel Generator Room	Diesel generators	Undetermined	FALSE	TRUE	FALSE	FALSE
645	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	TRUE	FALSE
646	Plant-Wide Components	Battery Chargers	Power Operation	FALSE	FALSE	FALSE	TRUE
647	Containment (BWR)	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
648	Containment (BWR)	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
649	Containment (PWR)	Reactor Coolant Pump	Power Operation	FALSE	FALSE	TRUE	FALSE
650	Control/Aux/Reactor Building	Transients	Power Operation	FALSE	FALSE	FALSE	TRUE
651	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
653	Plant-Wide Components	Transients	Power Operation	FALSE	TRUE	FALSE	FALSE
654	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
656	Plant-Wide Components	RPS MG sets	Power Operation	FALSE	TRUE	FALSE	FALSE
658	Plant-Wide Components	Ventilation Subsystems	Low Power Operation	FALSE	FALSE	TRUE	FALSE
659	Plant-wide components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
660	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
661	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
662	Turbine Building	Main feedwater pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
663	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
665	Plant-Wide Components	Junction box	Low Power Operation	FALSE	TRUE	FALSE	FALSE
666	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
667	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
668	Turbine Building	T/G Oil	Power Operation	FALSE	FALSE	FALSE	TRUE
669	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
670	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
671	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
673	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
674	Plant-Wide Components	Electric motors	Power Operation	FALSE	FALSE	TRUE	FALSE
676	Turbine Building	T/G Excitor	Power Operation	FALSE	FALSE	FALSE	TRUE
677	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
678	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
679	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
680	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	TRUE	FALSE
681	Plant-Wide Components	Cable Run	Low Power Operation	FALSE	TRUE	FALSE	FALSE
682	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
683	Plant-Wide Components	Dryers	Low Power Operation	FALSE	FALSE	FALSE	TRUE
686	Control/Aux/Reactor Building	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
687	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
689	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	TRUE	FALSE
692	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
693	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
694	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
697	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
698	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
699	Plant-Wide Components	Electric motors	Low Power Operation	FALSE	FALSE	TRUE	FALSE
700	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
703	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
704	Plant-Wide Components	Dryers	Power Operation	FALSE	TRUE	FALSE	FALSE
705	Control/Aux/Reactor Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
708	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
710	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	TRUE	FALSE	FALSE
712	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
713	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
714	Plant-Wide Components	Pumps	Low Power Operation	FALSE	TRUE	FALSE	FALSE
715	Plant-Wide Components	Dryers	Power Operation	FALSE	TRUE	FALSE	FALSE
716	Plant-Wide Components	Cable Run	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
717	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
718	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
719	Transformer Yard	Transformer - Non Catastrophic	Low Power Operation	FALSE	TRUE	FALSE	FALSE
720	Plant-Wide Components	RPS MG sets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
722	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
724	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
726	Plant-Wide Components	Electric motors	Low Power Operation	FALSE	TRUE	FALSE	FALSE
729	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
730	Turbine Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
732	Transformer Yard	Transformer - Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
733	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
734	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
735	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
736	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
737	Turbine Building	Main feedwater pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
738	Transformer Yard	Transformer - Non Catastrophic	Low Power Operation	FALSE	FALSE	FALSE	TRUE
739	Turbine Building	Main feedwater pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
740	Plant-Wide Components	Transient fires caused by welding and	Low Power Operation	FALSE	TRUE	FALSE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
		cutting					
741	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
742	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
743	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
744	Turbine Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
745	Plant-Wide Components	Junction box	Power Operation	FALSE	TRUE	FALSE	FALSE
746	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
747	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
749	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	FALSE	TRUE	FALSE
751	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	TRUE	FALSE	FALSE
752	Turbine Building	T/G Oil	Power Operation	FALSE	FALSE	FALSE	TRUE
754	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
755	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
756	Plant-wide components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
760	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
761	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
762	Plant-Wide Components	Transformers	Undetermined	FALSE	FALSE	TRUE	FALSE
763	Transformer Yard	Transformer - Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
765	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	FALSE	TRUE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
770	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE
772	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
773	Plant-Wide Components	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
774	Plant-Wide Components	Electrical Cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
775	Control Room	Main control board	Power Operation	FALSE	FALSE	TRUE	FALSE
776	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
777	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
778	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	FALSE	TRUE
779	Containment (BWR)	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
780	Control Room	Main control board	Power Operation	FALSE	FALSE	TRUE	FALSE
781	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	FALSE	TRUE
782	Plant-Wide Components	RPS MG sets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
783	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
784	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
785	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
786	Plant-Wide Components	RPS MG sets	Power Operation	FALSE	FALSE	FALSE	TRUE
787	Plant-Wide Components	Ventilation Subsystems	Undetermined	FALSE	FALSE	TRUE	FALSE
788	Transformer yard	Transformer - Non Catastrophic	Low Power Operation	FALSE	FALSE	FALSE	TRUE
789	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	FALSE	FALSE	TRUE
790	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
792	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
793	Plant-Wide Components	Battery Chargers	Power Operation	FALSE	FALSE	TRUE	FALSE
794	Plant-Wide Components	RPS MG sets	Power Operation	FALSE	FALSE	FALSE	TRUE
795	Containment (PWR)	Reactor Coolant Pump	Power Operation	FALSE	FALSE	FALSE	TRUE
797	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
798	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
799	Plant-Wide Components	Electric Motors	Power Operation	FALSE	FALSE	TRUE	FALSE
800	Plant-Wide Components	RPS MG sets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
801	Plant-Wide Components	RPS MG sets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
803	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
804	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
805	Plant-Wide Components	Battery Chargers	Low Power Operation	FALSE	FALSE	FALSE	TRUE
806	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
808	Diesel Generator Room	Diesel generators	Undetermined	FALSE	FALSE	FALSE	TRUE
809	Turbine Building	T/G Oil	Power Operation	FALSE	TRUE	FALSE	FALSE
810	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
811	Diesel Generator Room	Diesel generators	Undetermined	FALSE	TRUE	FALSE	FALSE
812	Control Room	Main control board	Low Power Operation	FALSE	FALSE	TRUE	FALSE
813	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
814	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
815	Control Room	Main control board	Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
820	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	FALSE	FALSE	TRUE
821	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
823	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
824	Turbine Building	Main feedwater pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
825	Plant-Wide Components	Transformers	Low Power Operation	FALSE	FALSE	TRUE	FALSE
827	Turbine Building	T/G Hydrogen	Power Operation	FALSE	TRUE	FALSE	FALSE
828	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	TRUE	FALSE
829	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
830	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
831	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	FALSE	TRUE
832	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	FALSE	TRUE
833	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
835	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
837	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
838	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
839	Transformer Yard	Transformer - Non Catastrophic	Low Power Operation	FALSE	FALSE	TRUE	FALSE
840	Control/Aux/Reactor Building	Pumps	Low Power Operation	FALSE	FALSE	TRUE	FALSE
841	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
842	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	FALSE	TRUE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
843	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
844	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
845	Transformer Yard	Transformer - Catastrophic	Low Power Operation	FALSE	TRUE	FALSE	FALSE
846	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	FALSE	TRUE
848	Plant-Wide Components	Misc. Hydrogen Fires	Low Power Operation	FALSE	FALSE	FALSE	TRUE
849	Containment (PWR)	Transients	Low Power Operation	FALSE	TRUE	FALSE	FALSE
850	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
851	Turbine Building	T/G Hydrogen	Power Operation	FALSE	TRUE	FALSE	FALSE
852	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	FALSE	TRUE
853	Plant-Wide Components	Misc. Hydrogen Fires	Undetermined	FALSE	FALSE	FALSE	TRUE
855	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
856	Plant-Wide Components	Junction box	Power Operation	FALSE	FALSE	TRUE	FALSE
857	Control/Aux/Reactor Building	Transients	Power Operation	FALSE	FALSE	FALSE	TRUE
858	Plant-Wide Components	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
859	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	FALSE	TRUE
860	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	FALSE	FALSE	TRUE
862	Plant-Wide Components	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
863	Plant-Wide Components	Electrical Cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
864	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	FALSE	TRUE
865	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
866	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	FALSE	FALSE	TRUE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
867	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
869	Control/Aux/Reactor Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
870	Plant-Wide Components	Electric Motors	Power Operation	FALSE	FALSE	FALSE	TRUE
871	Plant-Wide Components	Transformers	Low Power Operation	FALSE	TRUE	FALSE	FALSE
872	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	FALSE	FALSE	TRUE
873	Plant-Wide Components	RPS MG sets	Power Operation	FALSE	FALSE	TRUE	FALSE
875	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	TRUE	FALSE	FALSE
876	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
877	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	FALSE	TRUE
878	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	FALSE	FALSE	TRUE
879	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	FALSE	FALSE	TRUE
880	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	TRUE	FALSE
881	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
882	Transformer Yard	Transformer - Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
883	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
884	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	FALSE	TRUE
886	Plant-Wide Components	Electrical Cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
887	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
888	Plant-Wide Components	Electric Motors	Power Operation	FALSE	FALSE	FALSE	TRUE
889	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	TRUE	FALSE
890	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
891	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
893	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
894	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
895	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
896	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	FALSE	TRUE	FALSE
897	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
898	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
899	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
900	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
901	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
902	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	FALSE	TRUE
903	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
904	Control Room	Main control board	Power Operation	FALSE	FALSE	TRUE	FALSE
905	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
906	Control Room	Main control board	Low Power Operation	FALSE	FALSE	TRUE	FALSE
907	Plant-Wide Components	Pumps	Low Power Operation	FALSE	TRUE	FALSE	FALSE
908	Plant-Wide Components	Cable Run	Power Operation	FALSE	TRUE	FALSE	FALSE
910	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
911	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
912	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
913	Control Room	Main control board	Power Operation	FALSE	FALSE	TRUE	FALSE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
914	Plant-Wide Components	Pumps	Low Power Operation	FALSE	TRUE	FALSE	FALSE
915	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
916	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	FALSE	TRUE
917	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
919	Transformer Yard	Others	Low Power Operation	FALSE	TRUE	FALSE	FALSE
920	Turbine Building	Main feedwater pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
922	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
926	Turbine Building	T/G Hydrogen	Power Operation	FALSE	TRUE	FALSE	FALSE
927	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
928	Control Room	Main control board	Power Operation	FALSE	TRUE	FALSE	FALSE
929	Turbine Building	T/G Hydrogen	Power Operation	FALSE	TRUE	FALSE	FALSE
933	Plant-Wide Components	Air Compressors	Power Operation	FALSE	FALSE	TRUE	FALSE
934	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	FALSE	FALSE	TRUE
935	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
938	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
939	Plant-Wide Components	Pumps	Undetermined	FALSE	FALSE	TRUE	FALSE
940	Turbine Building	T/G Oil	Power Operation	FALSE	TRUE	FALSE	FALSE
941	Transformer Yard	Transformer - Catastrophic	Low Power Operation	FALSE	TRUE	FALSE	FALSE
942	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
944	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
945	Diesel Generator Room	Diesel generators	Undetermined	FALSE	FALSE	FALSE	TRUE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
947	Plant-Wide Components	Electrical cabinets	Power Operation	TRUE	TRUE	FALSE	FALSE
949	Plant-Wide Components	Pumps	Low Power Operation	FALSE	TRUE	FALSE	FALSE
950	Control Room	Main control board	Power Operation	FALSE	FALSE	TRUE	FALSE
951	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
952	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
953	Containment (PWR)	Transients and Hotwork	Power Operation	FALSE	FALSE	TRUE	FALSE
954	Control Room	Main control board	Power Operation	FALSE	FALSE	TRUE	FALSE
955	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
956	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
957	Turbine Building	T/G Excitor	Power Operation	FALSE	TRUE	FALSE	FALSE
959	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
961	Turbine Building	Main feedwater pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
962	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
963	Containment (PWR)	Transients and Hotwork	Undetermined	FALSE	FALSE	FALSE	TRUE
964	Plant-Wide Components	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
965	Plant-Wide Components	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
966	Plant-Wide Components	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
968	Plant-Wide Components	Transients	Undetermined	FALSE	TRUE	FALSE	FALSE
969	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	TRUE	FALSE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
970	Containment (BWR)	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
971	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	FALSE	TRUE
972	Turbine Building	Transients	Undetermined	FALSE	FALSE	FALSE	TRUE
974	Plant-Wide Components	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
975	Plant-Wide Components	Pumps	Undetermined	FALSE	FALSE	FALSE	TRUE
976	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	TRUE	FALSE
977	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
978	Plant-Wide Components	Pumps	Low Power Operation	FALSE	TRUE	FALSE	FALSE
980	Control Room	Main control board	Undetermined	FALSE	TRUE	FALSE	FALSE
981	Plant-Wide Components	Transients	Undetermined	FALSE	TRUE	FALSE	FALSE
983	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
984	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	TRUE	FALSE
985	Plant-Wide Components	Ventilation Subsystems	Undetermined	FALSE	FALSE	TRUE	FALSE
990	Control/Aux/Reactor Building	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
991	Control Room	Main control board	Undetermined	FALSE	FALSE	TRUE	FALSE
992	Control/Aux/Reactor Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
993	Plant-Wide Components	Pumps	Undetermined	FALSE	FALSE	TRUE	FALSE
994	Plant-Wide Components	Transformers	Undetermined	FALSE	FALSE	FALSE	TRUE
995	Transformer Yard	Yard transformers (Others)	Low Power Operation	FALSE	FALSE	TRUE	FALSE
996	Plant-Wide Components	Transformers	Low Power Operation	FALSE	TRUE	FALSE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
997	Plant-Wide Components	Transients	Undetermined	FALSE	TRUE	FALSE	FALSE
999	Control Room	Main control board	Undetermined	FALSE	FALSE	TRUE	FALSE
1003	Plant-Wide Components	Pumps	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1004	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1005	Plant-Wide Components	Cable run	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1007	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1008	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	TRUE	FALSE
1009	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
1010	Plant-Wide Components	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
1011	Turbine Building	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
1012	Turbine Building	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
1014	Plant-Wide Components	Air Compressors	Undetermined	FALSE	TRUE	FALSE	FALSE
1015	Plant-Wide Components	Air Compressors	Undetermined	FALSE	FALSE	TRUE	FALSE
1016	Plant-Wide Components	Air Compressors	Undetermined	FALSE	FALSE	TRUE	FALSE
1017	Plant-Wide Components	Electric motors	Undetermined	FALSE	FALSE	FALSE	TRUE
1022	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
1023	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
1024	Turbine Building	T/G Excitor	Power Operation	FALSE	FALSE	FALSE	TRUE
1025	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1026	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
1028	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
1030	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
1031	Containment (PWR)	Reactor Coolant Pump	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1032	Transformer Yard	Transformer - Catastrophic	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1033	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
1034	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
1035	Transformer Yard	Transformer - Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
1036	Plant-Wide Components	Hydrogen Tanks	Power Operation	FALSE	TRUE	FALSE	FALSE
1037	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1038	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1039	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
1040	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1041	Containment (PWR)	Reactor Coolant Pump	Power Operation	FALSE	TRUE	FALSE	FALSE
1042	Turbine Building	T/G Oil	Power Operation	FALSE	TRUE	FALSE	FALSE
1043	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
1044	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1050	Turbine Building	Transients	Power Operation	FALSE	TRUE	FALSE	FALSE
1051	Turbine Building	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1052	Plant-Wide Components	Misc. Hydrogen Fires	Power Operation	FALSE	FALSE	FALSE	TRUE
1053	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
1054	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1060	Containment (PWR)	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1062	Turbine Building	T/G Oil	Power Operation	FALSE	FALSE	TRUE	FALSE
1094	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1095	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE
1096	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
1097	Plant-Wide Components	Ventilation Subsystems	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1098	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	FALSE	TRUE
1099	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1100	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	FALSE	FALSE	TRUE
1104	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
1106	Plant-Wide Components	Transients	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1108	Plant-Wide Components	Air Compressors	Power Operation	FALSE	FALSE	FALSE	TRUE
1109	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1110	Turbine Building	Main feedwater pumps	Power Operation	FALSE	FALSE	FALSE	TRUE
1111	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1117	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1119	Turbine Building	Transients	Power Operation	FALSE	FALSE	FALSE	TRUE
1120	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1121	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1123	Plant-Wide Components	Hydrogen Tanks	Undetermined	FALSE	FALSE	TRUE	FALSE
1124	Plant-Wide Components	Electric Motors	Undetermined	FALSE	FALSE	FALSE	TRUE
1125	Plant-Wide Components	Electric motors	Undetermined	FALSE	FALSE	TRUE	FALSE
1126	Plant-Wide Components	Transformers	Undetermined	FALSE	FALSE	TRUE	FALSE
1127	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
1128	Turbine Building	Transients	Power Operation	FALSE	FALSE	FALSE	TRUE
1129	Plant-Wide Components	Transformers	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1130	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
1132	Plant-wide components	Dryers	Undetermined	FALSE	FALSE	FALSE	TRUE
1133	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	FALSE	TRUE
1134	Plant-Wide Components	Transformers	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1135	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1136	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1137	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1138	Turbine Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1139	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	FALSE	TRUE
1140	Plant-Wide Components	Cable Run	Undetermined	FALSE	TRUE	FALSE	FALSE
1141	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	FALSE	TRUE
1142	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	FALSE	TRUE
1143	Plant-Wide Components	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
1144	Turbine Building	Transients	Undetermined	FALSE	FALSE	FALSE	TRUE
1145	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
1146	Plant-Wide Components	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
1147	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	FALSE	TRUE
1148	Plant-Wide Components	Pumps	Undetermined	FALSE	FALSE	TRUE	FALSE
1149	Turbine Building	Transients	Undetermined	FALSE	TRUE	FALSE	FALSE
1151	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1152	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	TRUE	FALSE
1153	Turbine Building	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1154	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
1155	Plant-Wide Components	Misc. Hydrogen Fires	Power Operation	FALSE	FALSE	FALSE	TRUE
1156	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
1157	Turbine Building	Transient fires caused by welding and	Low Power Operation	FALSE	FALSE	FALSE	TRUE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
		cutting					
1158	Containment (PWR)	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1159	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1160	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	TRUE	FALSE	FALSE
1161	Turbine Building	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
1162	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
1163	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	FALSE	TRUE
1164	Control/Aux/Reactor Building	Transients	Undetermined	FALSE	FALSE	FALSE	TRUE
1165	Turbine Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1166	Plant-Wide Components	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1167	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
1168	Control/Aux/Reactor Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1170	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1171	Turbine Building	Transients	Power Operation	FALSE	FALSE	FALSE	TRUE
1172	Control/Aux/Reactor Building	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
1173	Plant-Wide Components	Electric motors	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1175	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1176	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	FALSE	TRUE
1177	Containment (BWR)	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1178	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	FALSE	TRUE
1179	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1180	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1181	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	FALSE	TRUE
1182	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE
1183	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
1184	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	FALSE	TRUE
1185	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	FALSE	FALSE	TRUE
1186	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
1188	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
1189	Plant-Wide Components	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
1191	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power Operation	FALSE	FALSE	FALSE	TRUE
1192	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1193	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1194	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
1195	Turbine Building	Transients	Power Operation	FALSE	TRUE	FALSE	FALSE
1196	Plant-Wide Components	Dryers	Undetermined	FALSE	FALSE	TRUE	FALSE
1197	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
1198	Plant-Wide Components	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1199	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1200	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE
1201	Plant-Wide Components	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE
1202	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1203	Control/Aux/Reactor Building	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1204	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1206	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1208	Containment (BWR)	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1209	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1210	Containment (BWR)	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1213	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
1214	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1215	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
1216	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1218	Plant-Wide Components	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1219	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1221	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1222	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1223	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
1228	Plant-Wide Components	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
1229	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1230	Plant-Wide Components	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1231	Plant-Wide Components	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
1232	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE
1233	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
1234	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
1235	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1237	Plant-Wide Components	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
1238	Plant-Wide Components	Cable Run	Undetermined	FALSE	FALSE	FALSE	TRUE
1239	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	FALSE	TRUE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1240	Turbine Building	Main feedwater pumps	Power Operation	FALSE	FALSE	FALSE	TRUE
1241	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1242	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1243	Plant-Wide Components	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
1244	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
1245	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE
1246	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	FALSE	TRUE
1247	Plant-Wide Components	Transients	Undetermined	FALSE	FALSE	FALSE	TRUE
1249	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1250	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1251	Turbine Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1252	Plant-Wide Components	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
1253	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
1254	Plant-Wide Components	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE
1255	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	TRUE	FALSE
1257	Turbine Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1258	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	FALSE	TRUE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1259	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
1260	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1261	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	FALSE	TRUE	FALSE
1262	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1263	Turbine Building	Boiler	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1264	Plant-Wide Components	Electric motors	Power Operation	FALSE	FALSE	FALSE	TRUE
1265	Plant-Wide Components	Transformers	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1266	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
1267	Plant-Wide Components	Electrical Cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1269	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
1270	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
1271	Control Room	Main control board	Undetermined	FALSE	FALSE	TRUE	FALSE
1272	Turbine Building	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1273	Plant-Wide Components	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1275	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	TRUE	FALSE	FALSE
1276	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
1277	Plant-Wide Components	Electrical Cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
1278	Control/Aux/Reactor Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1289	Turbine Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1290	Plant-Wide Components	Electric motors	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1291	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1294	Plant-Wide Components	Ventilation Subsystems	Undetermined	FALSE	FALSE	TRUE	FALSE
1296	Turbine Building	T/G Hydrogen	Power Operation	FALSE	FALSE	TRUE	FALSE
1297	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE
1298	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
1299	Plant-Wide Components	Transients	Undetermined	FALSE	FALSE	FALSE	TRUE
1300	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
1301	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
1302	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
1303	Containment (PWR)	Transients and Hotwork	Undetermined	FALSE	FALSE	FALSE	TRUE
1304	Containment (PWR)	Transients and Hotwork	Undetermined	FALSE	TRUE	FALSE	FALSE
1305	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
1306	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
1307	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
1308	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
1309	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1310	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
1311	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1312	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1313	Control/Aux/Reactor Building	Transients	Undetermined	FALSE	FALSE	FALSE	TRUE
1314	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
1315	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	FALSE	TRUE
1316	Control/Aux/Reactor Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1317	Plant-Wide Components	Misc. Hydrogen Fires	Power Operation	FALSE	FALSE	FALSE	TRUE
1318	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1319	Control Room	Main control board	Power Operation	FALSE	FALSE	TRUE	FALSE
1321	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
1322	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
1324	Turbine Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1325	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
1327	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	FALSE	FALSE	TRUE
1328	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1329	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1331	Control/Aux/Reactor Building	Cable fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
1332	Turbine Building	T/G Hydrogen	Power Operation	FALSE	FALSE	FALSE	TRUE
1333	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	FALSE	TRUE
1334	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1335	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
1337	Plant-Wide Components	Ventilation Subsystems	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1338	Plant-Wide Components	Ventilation Subsystems	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1339	Plant-Wide Components	Ventilation Subsystems	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1340	Plant-Wide Components	Battery Chargers	Power Operation	FALSE	FALSE	TRUE	FALSE
1341	Plant-Wide Components	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
1343	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1344	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1345	Plant-Wide Components	Transients	Undetermined	FALSE	TRUE	FALSE	FALSE
1346	Plant-Wide Components	Pumps	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1347	Containment (PWR)	Transients and Hotwork	Undetermined	FALSE	TRUE	FALSE	FALSE
1348	Plant-Wide Components	Pumps	Undetermined	FALSE	FALSE	TRUE	FALSE
1349	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1350	Plant-Wide Components	Transients	Power Operation	FALSE	TRUE	FALSE	FALSE
1351	Turbine Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1352	Plant-Wide Components	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1354	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1355	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1356	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	FALSE	TRUE
1359	Plant-Wide Components	Electric motors	Undetermined	FALSE	FALSE	FALSE	TRUE
1360	Plant-Wide Components	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
1361	Containment (PWR)	Transients	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1362	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
1363	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
1364	Turbine Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1367	Plant-Wide Components	Transients	Power Operation	FALSE	TRUE	FALSE	FALSE
1369	Plant-Wide Components	Junction box	Power Operation	FALSE	TRUE	FALSE	FALSE
1371	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1375	Plant-Wide Components	Battery Chargers	Power Operation	FALSE	FALSE	TRUE	FALSE
1379	Plant-Wide Components	Ventilation Subsystems	Undetermined	FALSE	FALSE	TRUE	FALSE
1383	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1388	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1389	Plant-Wide Components	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1390	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
1392	Control/Aux/Reactor Building	Cable fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1397	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	FALSE	TRUE	FALSE
1398	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
1401	Plant-Wide Components	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1403	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1416	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	FALSE	TRUE
1419	Plant-Wide Components	Pumps	Undetermined	FALSE	TRUE	FALSE	FALSE
1420	Turbine Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1424	Plant-Wide Components	Transients	Undetermined	FALSE	FALSE	FALSE	TRUE
1427	Plant-Wide Components	Transients	Undetermined	FALSE	TRUE	FALSE	FALSE
1431	Plant-Wide Components	Ventilation Subsystems	Undetermined	FALSE	TRUE	FALSE	FALSE
1482	Turbine Building	Main feedwater pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
1483	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
1484	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
1485	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1486	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
1487	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	TRUE	FALSE	FALSE
1488	Containment (PWR)	Reactor Coolant Pump	Power Operation	FALSE	FALSE	FALSE	TRUE
1489	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1490	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	TRUE	FALSE
1491	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1492	Plant-Wide Components	Ventilation Subsystems	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1493	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	FALSE	TRUE	FALSE
1494	Plant-Wide Components	Battery Chargers	Power Operation	FALSE	FALSE	TRUE	FALSE
1495	Plant-wide components	Transformers	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1496	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
1497	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
1498	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1499	Plant-Wide Components	Transformers	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1500	Plant-Wide Components	Transformers	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1501	Plant-Wide Components	Transformers	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1502	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1503	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
1504	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	FALSE	TRUE
1505	Transformer Yard	Transformer - Non Catastrophic	Low Power Operation	FALSE	FALSE	TRUE	FALSE
1506	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
1507	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
1508	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	FALSE	TRUE
1509	Plant-Wide Components	Electric motors	Low Power Operation	FALSE	TRUE	FALSE	FALSE
1510	Plant-Wide Components	Transformers	Power Operation	FALSE	TRUE	FALSE	FALSE
1511	Plant-Wide Components	Ventilation subsystems	Power Operation	FALSE	TRUE	FALSE	FALSE
1512	Plant-Wide Components	Transformers	Low Power Operation	FALSE	FALSE	TRUE	FALSE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
1513	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
1514	Diesel Generator Room	Diesel generators	Power Operation	FALSE	TRUE	FALSE	FALSE
1515	Control/Aux/Reactor Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
1516	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power Operation	FALSE	TRUE	FALSE	FALSE
1517	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
1518	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
2100	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2102	Turbine Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2103	Control/Aux/Reactor Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
2106	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2108	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2110	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2111	Containment (PWR)	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2113	Control/Aux/Reactor Building	Cable fires caused by welding and cutting	Undetermined	FALSE	TRUE	FALSE	FALSE
2114	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
2115	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2116	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
2117	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2118	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2119	Plant-Wide Components	Air Compressors	Power Operation	FALSE	TRUE	FALSE	FALSE
2122	Turbine Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
2124	Turbine Building	T/G Oil	Power Operation	FALSE	TRUE	FALSE	FALSE
2126	Plant-Wide Components	Cable fires caused by welding and cutting	Undetermined	FALSE	TRUE	FALSE	FALSE
2127	Plant-Wide Components	Transformers	Undetermined	FALSE	TRUE	FALSE	FALSE
2128	Plant-Wide Components	Transformers	Undetermined	FALSE	FALSE	TRUE	FALSE
2129	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2130	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2131	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
2132	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2134	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2137	Transformer Yard	Transformer - Non Catastrophic	Undetermined	FALSE	FALSE	TRUE	FALSE
2138	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2139	Plant-Wide Components	Air Compressors	Undetermined	FALSE	FALSE	FALSE	TRUE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
2143	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	FALSE	TRUE
2145	Control/Aux/Reactor Building	Transients	Low Power Operation	FALSE	FALSE	FALSE	TRUE
2146	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2147	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2148	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2149	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2150	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2154	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2160	Plant-wide components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2161	Plant-Wide Components	Pumps	Low Power Operation	FALSE	FALSE	FALSE	TRUE
2162	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2163	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
2166	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2167	Control Room	Main control board	Power Operation	FALSE	FALSE	FALSE	TRUE
	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
2169	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
2171	Diesel Generator Room	Diesel generators	Undetermined	FALSE	FALSE	TRUE	FALSE
2172	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
2173	Turbine Building	Transients	Undetermined	FALSE	TRUE	FALSE	FALSE
2175	Plant-Wide Components	Electrical cabinets	Power Operation	TRUE	TRUE	FALSE	FALSE
2177	Transformer Yard	Transformer - Non Catastrophic	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2179	Plant-Wide Components	Pumps	Undetermined	FALSE	TRUE	FALSE	FALSE
2180	Plant-Wide Components	Pumps	Undetermined	FALSE	FALSE	TRUE	FALSE
2182	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2183	Turbine Building	Main feedwater pumps	Undetermined	FALSE	FALSE	FALSE	TRUE
2184	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2187	Plant-Wide Components	Pumps	Undetermined	FALSE	FALSE	TRUE	FALSE
2188	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	TRUE	FALSE	FALSE
2190	Plant-Wide Components	RPS MG sets	Undetermined	FALSE	FALSE	FALSE	TRUE
2191	Plant-Wide Components	Ventilation Subsystems	Undetermined	FALSE	TRUE	FALSE	FALSE
2192	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2193	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
2194	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
2196	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2197	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	TRUE	FALSE
2198	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2199	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2200	Plant-Wide Components	Electric motors	Undetermined	FALSE	FALSE	TRUE	FALSE
2201	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2202	Plant-Wide Components	Battery Chargers	Undetermined	FALSE	FALSE	TRUE	FALSE
2203	Containment (PWR)	Cable fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2207	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
2211	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
2212	Plant-Wide Components	Cable Run	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2213	Transformer Yard	Others	Power Operation	FALSE	TRUE	FALSE	FALSE
2215	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2216	Plant-Wide Components	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2219	Plant-Wide Components	Pumps	Undetermined	FALSE	FALSE	FALSE	TRUE
2220	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
2223	Containment (PWR)	Reactor Coolant Pump	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2224	Control Room	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
2227	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
2228	Plant-Wide Components	Battery Chargers	Power Operation	FALSE	TRUE	FALSE	FALSE
2229	Turbine Building	T/G Excitor	Power Operation	FALSE	TRUE	FALSE	FALSE
2232	Plant-Wide Components	RPS MG sets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
2233	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	TRUE	FALSE
2234	Turbine Building	T/G Excitor	Power Operation	FALSE	FALSE	TRUE	FALSE
2236	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
2237	Plant-Wide Components	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
2238	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2239	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	TRUE	FALSE	FALSE
2240	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	FALSE	TRUE
2241	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2242	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
2244	Containment (PWR)	Reactor Coolant Pump	Undetermined	FALSE	FALSE	TRUE	FALSE
2245	Turbine Building	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
2247	Turbine Building	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
2248	Containment (PWR)	Transients and Hotwork	Undetermined	FALSE	FALSE	FALSE	TRUE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
2250	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	TRUE	FALSE
2251	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
2252	Turbine Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
2253	Control/Aux/Reactor Building	Transients	Power Operation	FALSE	TRUE	FALSE	FALSE
2254	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	TRUE	FALSE
2255	Plant-Wide Components	Electric motors	Undetermined	FALSE	FALSE	FALSE	TRUE
2256	Containment (PWR)	Transients and Hotwork	Power Operation	FALSE	FALSE	TRUE	FALSE
2257	Control/Aux/Reactor Building	Transients	Undetermined	FALSE	TRUE	FALSE	FALSE
2258	Plant-Wide Components	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2259	Turbine Building	T/G Hydrogen	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2260	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2261	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
2262	Turbine Building	Transients	Power Operation	FALSE	TRUE	FALSE	FALSE
2265	Control/Aux/Reactor Building	Transients	Power Operation	FALSE	TRUE	FALSE	FALSE
2266	Control Room	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
2269	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
2270	Plant-Wide Components	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
2271	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2272	Plant-Wide Components	Transformers	Undetermined	FALSE	TRUE	FALSE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
2273	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	TRUE	FALSE	FALSE
2274	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	TRUE	FALSE
2275	Turbine Building	Main feedwater pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
2276	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
2279	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2281	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
2283	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	FALSE	FALSE	TRUE
2285	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
2286	Turbine Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2287	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2290	Control Room	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
2291	Control/Aux/Reactor Building	Transients	Undetermined	FALSE	TRUE	FALSE	FALSE
2293	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2294	Plant-Wide Components	Transformers	Undetermined	FALSE	FALSE	TRUE	FALSE
2296	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2298	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2299	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2300	Turbine Building	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
2301	Plant-Wide Components	Ventilation Subsystems	Undetermined	FALSE	FALSE	TRUE	FALSE
2302	Plant-Wide Components	Pumps	Undetermined	FALSE	FALSE	TRUE	FALSE
2303	Plant-Wide Components	Electric motors	Undetermined	FALSE	FALSE	TRUE	FALSE
2305	Plant-Wide Components	Air Compressors	Undetermined	FALSE	TRUE	FALSE	FALSE
2306	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2307	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2308	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
2309	Turbine Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
2311	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	FALSE	TRUE
2312	Plant-Wide Components	Off-gas/H ₂ Recombiner (BWR)	Power Operation	FALSE	FALSE	TRUE	FALSE
2313	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
2314	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
2319	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	FALSE	TRUE
2320	Transformer Yard	Transformer - Non Catastrophic	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2321	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
2323	Plant-Wide Components	Cable Run	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2324	Plant-Wide Components	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2326	Turbine Building	Transient fires caused by welding and	Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
		cutting					
2327	Plant-Wide Components	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2328	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	TRUE	FALSE
2329	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	TRUE	FALSE	FALSE
2330	Plant-Wide Components	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2331	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
2334	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	FALSE	FALSE	TRUE
2336	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
2337	Turbine Building	T/G Oil	Power Operation	FALSE	TRUE	FALSE	FALSE
2338	Plant-Wide Components	Transformers	Power Operation	FALSE	TRUE	FALSE	FALSE
2339	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
2340	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2341	Transformer Yard	Others	Power Operation	FALSE	TRUE	FALSE	FALSE
2342	Plant-Wide Components	Battery Chargers	Power Operation	FALSE	FALSE	TRUE	FALSE
2343	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
2344	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
2345	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	FALSE	TRUE
2347	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
2348	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
2349	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	FALSE	TRUE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
2351	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	FALSE	FALSE	TRUE
2352	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
2353	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	TRUE	FALSE	FALSE
2355	Diesel Generator Room	Diesel generators	Power Operation	FALSE	FALSE	TRUE	FALSE
2356	Plant-Wide Components	Misc. Hydrogen Fires	Power Operation	FALSE	TRUE	FALSE	FALSE
2358	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	FALSE	TRUE
2360	Plant-Wide Components	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
2361	Plant-Wide Components	Cable Run	Power Operation	FALSE	FALSE	FALSE	TRUE
2362	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	FALSE	TRUE
2363	Containment (BWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2364	Turbine Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
2365	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2367	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
2368	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	FALSE	FALSE	TRUE
2370	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	FALSE	TRUE
2371	Plant-Wide Components	Ventilation Subsystems	Power Operation	FALSE	FALSE	TRUE	FALSE
2372	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
2373	Control Room	Main control board	Undetermined	FALSE	FALSE	FALSE	TRUE
	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	FALSE	TRUE
2374	Diesel Generator Room	Diesel generators	Undetermined	FALSE	FALSE	FALSE	TRUE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
2375	Plant-Wide Components	Air Compressors	Power Operation	FALSE	TRUE	FALSE	FALSE
2376	Plant-Wide Components	Transients	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2377	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2378	Plant-Wide Components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
2379	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2380	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	TRUE	FALSE
2383	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
2384	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2385	Plant-Wide Components	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2386	Turbine Building	Transients	Power Operation	FALSE	TRUE	FALSE	FALSE
2387	Plant-Wide Components	Transformers	Power Operation	FALSE	FALSE	FALSE	TRUE
2388	Turbine Building	Main feedwater pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
2390	Transformer Yard	Others	Power Operation	FALSE	FALSE	TRUE	FALSE
2391	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
2393	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	FALSE	TRUE
2394	Control Room	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
2396	Control Room	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
2398	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2399	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE

Table C-4
Fire Event Classification (Continued)

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
2401	Control Room	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
2403	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2406	Turbine Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
2407	Transformer Yard	Others	Power Operation	FALSE	TRUE	FALSE	FALSE
2409	Plant-Wide Components	Transient fires caused by welding and cutting	Power Operation	FALSE	TRUE	FALSE	FALSE
2413	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Power Operation	FALSE	FALSE	TRUE	FALSE
2414	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2415	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
2416	Plant-Wide Components	Electrical cabinets	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2421	Plant-Wide Components	Fire Pumps	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2422	Turbine Building	Main feedwater pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
2423	Turbine Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2425	Plant-Wide Components	Cable Run	Power Operation	FALSE	TRUE	FALSE	FALSE
2426	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	TRUE	FALSE	FALSE
2427	Transformer Yard	Transformer - Non Catastrophic	Power Operation	FALSE	TRUE	FALSE	FALSE
2428	Plant-wide components	Pumps	Power Operation	FALSE	TRUE	FALSE	FALSE
2430	Diesel Generator Room	Diesel generators	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
2431	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	FALSE	TRUE
2433	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
2441	Plant-Wide Components	Pumps	Power Operation	FALSE	FALSE	FALSE	TRUE
2442	Plant-Wide Components	Ventilation Subsystems	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2444	Plant-Wide Components	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
2445	Plant-Wide Components	Pumps	Undetermined	FALSE	FALSE	FALSE	TRUE
2446	Turbine Building	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
2447	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	FALSE	TRUE
2448	Plant-Wide Components	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
2449	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	TRUE	FALSE
2450	Plant-Wide Components	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
2452	Plant-Wide Components	Dryers	Undetermined	FALSE	FALSE	TRUE	FALSE
2453	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	TRUE	FALSE
2455	Containment (PWR)	Transients and Hotwork	Undetermined	FALSE	FALSE	TRUE	FALSE
2456	Turbine Building	Main feedwater pumps	Power Operation	FALSE	FALSE	FALSE	TRUE
2458	Turbine Building	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
2459	Containment (PWR)	Transients and Hotwork	Undetermined	FALSE	FALSE	TRUE	FALSE
2460	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2461	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2462	Containment (PWR)	Transient fires caused by welding and	Low Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
		cutting					
2463	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
2464	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2465	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
2466	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2467	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	FALSE	TRUE
2469	Plant-Wide Components	Transient fires caused by welding and cutting	Undetermined	FALSE	TRUE	FALSE	FALSE
2470	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2471	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	TRUE	FALSE
2472	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2473	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2474	Plant-Wide Components	Pumps	Undetermined	FALSE	FALSE	TRUE	FALSE
2475	Plant-Wide Components	Transformers	Undetermined	FALSE	FALSE	TRUE	FALSE
2476	Plant-Wide Components	Ventilation Subsystems	Undetermined	FALSE	FALSE	FALSE	TRUE
2477	Turbine Building	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
2478	Plant-Wide Components	Pumps	Undetermined	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
2480	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2482	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2483	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2484	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2485	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2486	Turbine Building	Transient fires caused by welding and cutting	Undetermined	FALSE	FALSE	TRUE	FALSE
2487	Plant-Wide Components	Pumps	Undetermined	FALSE	FALSE	TRUE	FALSE
2488	Containment (PWR)	Transients and Hotwork	Undetermined	FALSE	FALSE	TRUE	FALSE
2489	Plant-Wide Components	Electrical cabinets	Undetermined	FALSE	FALSE	FALSE	TRUE
2491	Containment (PWR)	Transients and Hotwork	Undetermined	FALSE	FALSE	FALSE	TRUE
2492	Plant-Wide Components	Transients	Undetermined	FALSE	FALSE	TRUE	FALSE
2493	Containment (PWR)	Transients and Hotwork	Undetermined	FALSE	FALSE	TRUE	FALSE
2495	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2496	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2497	Containment (PWR)	Transient fires caused by welding and cutting	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2498	Plant-Wide Components	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE

**Table C-4
Fire Event Classification (Continued)**

Incident No.	Location	Ignition Source	Operating Mode	High Energy Arcing Fault	Challenging	Not Challenging	Undetermined
2499	Turbine Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
2501	Plant-Wide Components	Transients	Power Operation	FALSE	TRUE	FALSE	FALSE
2502	Control/Aux/Reactor Building	Transients	Power Operation	FALSE	FALSE	TRUE	FALSE
2504	Containment (PWR)	Transients	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2505	Control/Aux/Reactor Building	Transients	Low Power Operation	FALSE	TRUE	FALSE	FALSE
2510	Control Room	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE
2511	Control/Aux/Reactor Building	Transient fires caused by welding and cutting	Low Power Operation	FALSE	FALSE	TRUE	FALSE
2512	Plant-Wide Components	Electrical cabinets	Power Operation	FALSE	FALSE	TRUE	FALSE

Appendix D

Appendix for Chapter 7, Technical Bases

D

APPENDIX FOR CHAPTER 7, TECHNICAL BASES

The Chapter 7 procedure is used to perform quantitative screening of fire compartments and scenarios. The screening criteria applied in the procedure are intended to provide a practical method for quantitatively screening fire compartments and scenarios without sacrificing model accuracy and fidelity. It is inherently assumed that the Fire PRA Model will be used in future applications. The information below provides the technical bases for the quantitative screening criteria applied in the procedure.

1. The CDF screening criteria is based on the assumption that the total CDF for most nuclear power plants in the United States is on the order of $1.0E-05/\text{yr}$ or higher. Based on Figure 3 of Reference [D.1], a CDF change of less than $1.0E-06/\text{yr}$ is regarded as very small (Region III). Therefore, it is assumed that if the sum of the CDFs for all screened out fire compartments is less than 10% of the Internal Events average CDF, the effect of the change in CDF if one were to add in the cumulative contribution from screened out fires would be similarly very small, and so can be screened out. For individual fire compartments, it is assumed that if the CDF for a fire compartment is less than $1.0E-07/\text{yr}$ (which on an individual basis is about 1% or less of the total plant CDF), any residual risk significance not analyzed by screening out the compartment can be regarded as very small. However, the total CDF for all screened out fire compartments should still be less than 10% of the Internal Events average CDF so that the overall residual risk from all screened out compartments does not get too high.
2. The LERF screening criteria is based on the assumption that the total LERF for most nuclear power plants in the United States is on the order of $1.0E-06/\text{yr}$ or higher. Based on Figure 4 of Reference [D.1], a LERF change of less than $1.0E-07/\text{yr}$ is regarded as very small (Region III). Therefore, it is assumed that if the sum of the LERFs for all screened out fire compartments is less than 10% of the Internal Events average LERF, the effect of the change in LERF if one were to add in the cumulative contribution from screened out fires would be similarly very small, and so can be screened out. For individual fire compartments, it is assumed that if the LERF for a fire compartment is less than $1.0E-08/\text{yr}$ (which on an individual basis is about 1% or less of the total plant LERF), any residual risk significance not analyzed by screening out the compartment can be regarded as very small. However, the total LERF for all screened out fire compartments should still be less than 10% of the Internal Events average LERF so that the overall residual risk from all screened out compartments does not get too high.
3. The ICDP screening criteria of $1.0E-06$ is based on the temporary change risk criterion documented in Reference [D.2].
4. The ILERP screening criteria of $1.0E-07$ is based on the temporary change risk criterion documented in Reference [D.2].

D.1 References

- D.1 *An Approach for Using Probabilistic Risk Assessment In Risk-Informed Decisions on Plant-Specific Changes to the Licensing Basis*, U.S. NRC Regulatory Guide 1.174, Revision 1, November 2002.
- D.2 *PSA Applications Guide*, EPRI, August 1995. EPRI-TR-105396.

Appendix E

**Appendix for Chapters 8 and 11,
Severity Factors**

E

APPENDIX FOR CHAPTERS 8 AND 11, SEVERITY FACTORS

The severity factor is the probability that the postulated fire would include certain specific conditions that influence its rate of growth, level of energy emanated, and duration (time to self extinguishment) to levels at which target damage is generated. For example, in the case of electrical cabinets, the peak heat release rate varies among the fire events. The probability of the heat release rate being of certain level that, if not suppressed, could lead to target damage, is the severity factor of that fire scenario.

E.1 Severity Factor Determination

As noted in Chapter 11, there are uncertainties in the heat release rate and other parameters that define the intensity characteristics of the fire that affect the time to target set damage. This leads to uncertainties in damage time, which is also expressed by the probability distribution, $p_{\text{damage}}(t)$. From this distribution, the severity factor may be defined. However, since the variation in damage time affects probability of nonsuppression, the severity factor should be defined in combination with the nonsuppression probability. Thus, the two factors, $SF_k \cdot P_{\text{ns},k}$, in Equation 11-1 can be evaluated simultaneously from:

$$SF_k \cdot P_{\text{ns},k} = \int_{\text{All } t} p_{\text{damage}}(t) P_{\text{ns}}(t) dt$$

This equation can be simplified using discretized probability distributions.

$$SF_k \cdot P_{\text{ns},k} = \sum_{\text{All } i} P_{k,i} P_{\text{ns},k,i}$$

where:

$$P_{k,i} = \int_{T_{i,l}}^{T_{i,u}} p_{\text{damage},k}(t) dt$$

$T_{i,l}$ = Lower value of the discretized bin i

$T_{i,u}$ = Upper value of the discretized bin i

$$P_{\text{ns},k,i} = P_{\text{ns},k}(T_{i,l})$$

The process for calculating the combined probability using the discretized distributions is illustrated in Figure E-1. The following steps may be followed to arrive at the combined probability.

Step 1. Discretize the HRR distribution into a reasonable number of bins and obtain the corresponding probabilities (i.e., $P_{k,i}$) and midpoint values of HRR (i.e., $HRR_{k,i}$). (Note that in Section E.2, below, a set of discretized distributions is provided.)

Step 2. Using the specific conditions of the fire scenario, calculate the time to target damage ($t_{k,i}$) for each heat release rate point value (i.e., $HRR_{k,i}$) of the discretized distribution (e.g., those that are listed in tables E-2 to E-9).


Step 3. Create a discretized probability distribution for time to damage by assigning to each target damage time obtained in the preceding step (i.e., $t_{k,i}$) the probability value of the corresponding heat release rate (i.e., $P_{k,i}$).

Step 4. For each target damage time ($t_{k,i}$), estimate the probability of nonsuppression ($P_{NS,k,i}$) following the guidance provided in Appendix P. Recall that in Task 8, $P_{NS,k,i}$ is assumed to be 1.0.

Step 5. Calculate the combined probability of nonsuppression and severity factor of the fire scenario by first multiplying pairs of $P_{k,i}$ and $P_{NS,k,i}$ of each i , then some over all i .

E.2 Discretized Heat Release Rate Distributions for Fixed and Transient Ignition Sources

In this section, to facilitate the process of calculating combined probability of nonsuppression and severity factor, discretized versions of the heat release rate distributions provided in Appendix G are provided. Table E-1 provides a list of the heat release rate distributions. Tables E-2 through E-9 provide the discretized distributions. (Note: The original expert panel HRR values were cited in English units (BTU/s) so both SI and English units are indicated in all of the subsidiary tables below (E-1 through E-9).)

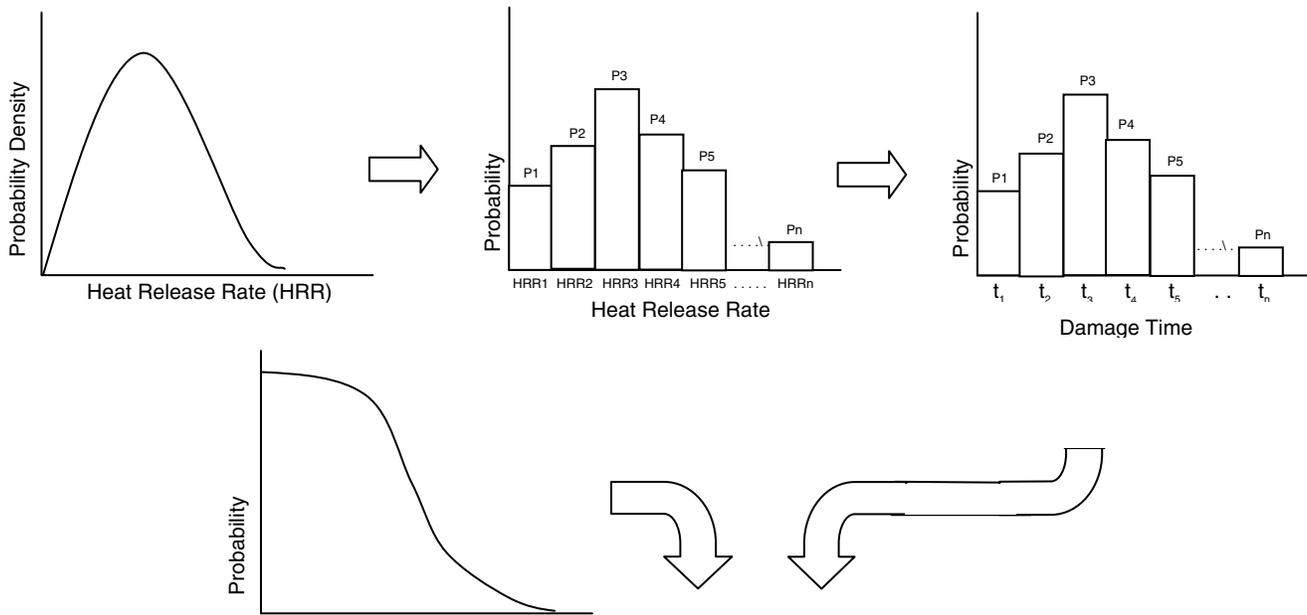

HRR Values	HRR1	HRR2	HRR3	HRR4	HRRn
Individual Severity Factor	$P_{k,1}$	$P_{k,2}$	$P_{k,3}$	$P_{k,4}$	$P_{k,n}$
Time to damage	$t_{k,1}$	$t_{k,2}$	$t_{k,3}$	$t_{k,4}$	$t_{k,n}$
Prob. of supp. after damage	$P_{NS,k,1}$	$P_{NS,k,2}$	$P_{NS,k,3}$	$P_{NS,k,4}$	$P_{NS,k,n}$
$[SF_k \cdot P_{ns,k,i}]$	$P_{k,1} \cdot P_{ns,k,1}$	$P_{k,2} \cdot P_{ns,k,2}$	$P_{k,3} \cdot P_{ns,k,3}$	$P_{k,4} \cdot P_{ns,k,4}$	$P_{k,n} \cdot P_{ns,k,n}$

Figure E-1
Severity Factor Estimation Process

Table E-1
List of Heat Release Rate Distributions

Case	Ignition Source	HRR kW (Btu/s)		Gamma Distribution		Reference
		75th	98th	α	β	
1	Vertical cabinets with qualified cable, fire limited to one cable bundle	69 (65)	211 (200)	0.84 (0.83)	59.3 (56.6)	Table G-1
2	Vertical cabinets with qualified cable, fire in more than one cable bundle	211 (200)	702 (665)	0.7 (0.7)	216 (204)	Table G-1
3	Vertical cabinets with unqualified cable, fire limited to one cable bundle	90 (85)	211 (200)	1.6 (1.6)	41.5 (39.5)	Table G-1
4	Vertical cabinets with unqualified cable, fire in more than one cable bundle closed doors	232 (220)	464 (440)	2.6 (2.6)	67.8 (64.3)	Table G-1
5	Vertical cabinets with unqualified cable, fire in more than one cable bundle open doors	232 (220)	1002 (950)	0.46 (0.45)	386 (366)	Table G-1
6	Pumps (electrical fires)	69 (65)	211 (200)	0.84 (0.83)	59.3 (56.6)	Table G-1
7	Motors	32 (30)	69 (65)	2.0 (2.0)	11.7 (11.1)	Table G-1
8	Transient Combustibles	142 (135)	317 (300)	1.8 (1.9)	57.4 (53.7)	Section G-4

Table E-2
Discretized Distribution for Case 1 Heat Release Rate (Vertical Cabinets with Qualified Cable, Fire Limited to One Cable Bundle)

Bin	Heat Release Rate – kW (Btu/s)			Severity Factor (P_i)
	Lower	Upper	Point Value	
1	0 (0)	26 (25)	11 (10.5)	0.446
2	26 (25)	53 (50)	38 (36)	0.219
3	53 (50)	79 (75)	64 (61)	0.129
4	79 (75)	106 (100)	92 (87)	0.078
5	106 (100)	132 (125)	118 (112)	0.048
6	132 (125)	158 (150)	145 (137)	0.030
7	158 (150)	185 (175)	171 (162)	0.019
8	185 (175)	211 (200)	197 (187)	0.012
9	211 (200)	237 (225)	224 (212)	0.007
10	237 (225)	264 (250)	250 (237)	0.005
11	264 (250)	290 (275)	276 (262)	0.003
12	290 (275)	317 (300)	303 (287)	0.002
13	317 (300)	343 (325)	329 (312)	0.001
14	343 (325)	369 (350)	356 (337)	0.001
15	369 (350)	Infinity	427 (405)	0.001

Table E-3
Discretized Distribution for Case 2 Heat Release Rate (Vertical Cabinets with Qualified Cable, Fire in more than One Cable Bundle)

Bin	Heat Release Rate – kW (Btu/s)			Severity Factor (P _i)
	Lower	Upper	Point Value	
1	0 (0)	90 (85)	34 (32.7)	0.506
2	90 (85)	179 (170)	130 (123)	0.202
3	179 (170)	269 (255)	221 (209)	0.113
4	269 (255)	359 (340)	310 (294)	0.067
5	359 (340)	448 (425)	400 (379)	0.041
6	448 (425)	538 (510)	490 (464)	0.026
7	538 (510)	628 (595)	579 (549)	0.016
8	628 (595)	717 (680)	669 (634)	0.010
9	717 (680)	807 (765)	759 (719)	0.006
10	807 (765)	897 (850)	848 (804)	0.004
11	897 (850)	986 (935)	938 (889)	0.003
12	986 (935)	1076 (1020)	1028 (974)	0.002
13	1076 (1020)	1166 (1105)	1118 (1060)	0.001
14	1166 (1105)	1255 (1190)	1208 (1145)	0.001
15	1255 (1190)	Infinity	1462 (1386)	0.001

Table E-4
Discretized Distribution for Case 3 Heat Release Rate (Vertical Cabinets with Unqualified Cable, Fire Limited to One Cable Bundle)

Bin	Heat Release Rate - kW (Btu/s)			Severity Factor (P _i)
	Lower	Upper	Point Value	
1	0 (0)	26 (25)	15 (14.2)	0.227
2	26 (25)	53 (50)	39 (37)	0.261
3	53 (50)	79 (75)	65 (62)	0.192
4	79 (75)	106 (100)	92 (87)	0.126
5	106 (100)	132 (125)	118 (112)	0.079
6	132 (125)	158 (150)	143 (136)	0.048
7	158 (150)	185 (175)	170 (161)	0.028
8	185 (175)	211 (200)	196 (186)	0.016
9	211 (200)	237 (225)	223 (211)	0.010
10	237 (225)	264 (250)	249 (236)	0.005
11	264 (250)	290 (275)	275 (261)	0.003
12	290 (275)	317 (300)	302 (286)	0.002
13	317 (300)	343 (325)	328 (311)	0.001
14	343 (325)	369 (350)	354 (336)	0.001
15	369 (350)	Infinity	414 (392)	0.001

**Table E-5
Discretized Distribution for Case 4 Heat Release Rate (Vertical Cabinets with Unqualified Cable, Fire in more than One Cable Bundle Closed Doors)**

Bin	Heat Release Rate - kW (Btu/s)			Severity Factor (P _i)
	Lower	Upper	Point Value	
1	0 (0)	53 (50)	36 (34)	0.082
2	53 (50)	106 (100)	80 (76)	0.213
3	106 (100)	158 (150)	131 (124)	0.224
4	158 (150)	211 (200)	184 (174)	0.177
5	211 (200)	264 (250)	235 (223)	0.122
6	264 (250)	317 (300)	288 (273)	0.077
7	317 (300)	369 (350)	341 (323)	0.046
8	369 (350)	422 (400)	394 (373)	0.027
9	422 (400)	475 (450)	446 (423)	0.015
10	475 (450)	528 (500)	499 (473)	0.008
11	528 (500)	580 (550)	552 (523)	0.004
12	580 (550)	633 (600)	603 (572)	0.002
13	633 (600)	686 (650)	656 (622)	0.001
14	686 (650)	739 (700)	709 (672)	0.001
15	739 (700)	Infinity	816 (773)	0.001

Table E-6
Discretized Distribution for Case 5 Heat Release Rate (Vertical Cabinets with Unqualified Cable, Fire in more than One Cable Bundle Open Doors)

Bin	Heat Release Rate - kW (Btu/s)			Severity Factor (P _i)
	Lower	Upper	Point Value	
1	0 (0)	137 (130)	42 (39.5)	0.638
2	137 (130)	274 (260)	197 (187)	0.155
3	274 (260)	411 (390)	337 (319)	0.081
4	411 (390)	549 (520)	475 (450)	0.047
5	549 (520)	686 (650)	612 (580)	0.029
6	686 (650)	823 (780)	749 (710)	0.018
7	823 (780)	960 (910)	886 (840)	0.011
8	960 (910)	1097 (1040)	1024 (971)	0.007
9	1097 (1040)	1234 (1170)	1162 (1101)	0.005
10	1234 (1170)	1372 (1300)	1299 (1231)	0.003
11	1372 (1300)	1509 (1430)	1436 (1361)	0.002
12	1509 (1430)	1646 (1560)	1573 (1491)	0.001
13	1646 (1560)	1783 (1690)	1710 (1621)	0.001
14	1783 (1690)	1920 (1820)	1847 (1751)	0.001
15	1920 (1820)	Infinity	2276 (2157)	0.001

Table E-7
Discretized Distribution for Case 6 Heat Release Rate (Pumps – Electrical Fires)

Bin	Heat Release Rate – kW (Btu/s)			Severity Factor (P _i)
	Lower	Upper	Point Value	
1	0 (0)	26 (25)	11 (10.5)	0.446
2	26 (25)	53 (50)	38 (36)	0.219
3	53 (50)	79 (75)	64 (61)	0.129
4	79 (75)	106 (100)	92 (87)	0.078
5	106 (100)	132 (125)	118 (112)	0.048
6	132 (125)	158 (150)	145 (137)	0.030
7	158 (150)	185 (175)	171 (162)	0.019
8	185 (175)	211 (200)	197 (187)	0.012
9	211 (200)	237 (225)	224 (212)	0.007
10	237 (225)	264 (250)	250 (237)	0.005
11	264 (250)	290 (275)	276 (262)	0.003
12	290 (275)	317 (300)	303 (287)	0.002
13	317 (300)	343 (325)	329 (312)	0.001
14	343 (325)	369 (350)	356 (337)	0.001
15	369 (350)	Infinity	427 (405)	0.001

**Table E-8
Discretized Distribution for Case 7 Heat Release Rate (Motors)**

Bin	Heat Release Rate – kW (Btu/s)			Severity Factor (P _i)
	Lower	Upper	Point Value	
1	0 (0)	7 (7)	5 (4.4)	0.132
2	7 (7)	15 (14)	12 (11)	0.227
3	15 (14)	22 (21)	18 (17)	0.205
4	22 (21)	30 (28)	25 (24)	0.153
5	30 (28)	37 (35)	33 (31)	0.105
6	37 (35)	44 (42)	40 (38)	0.069
7	44 (42)	52 (49)	47 (45)	0.043
8	52 (49)	59 (56)	55 (52)	0.027
9	59 (56)	66 (63)	62 (59)	0.016
10	66 (63)	74 (70)	70 (66)	0.010
11	74 (70)	81 (77)	77 (73)	0.006
12	81 (77)	89 (84)	84 (80)	0.003
13	89 (84)	96 (91)	92 (87)	0.002
14	96 (91)	103 (98)	99 (94)	0.001
15	103 (98)	Infinity	116 (110)	0.001

Table E-9
Discretized Distribution for Case 8 Heat Release Rate (Transients²⁰)

Bin	Heat Release Rate – kW (Btu/s)			Severity Factor (P _i)
	Lower	Upper	Point Value	
1	0 (0)	37 (35)	22 (21.2)	0.169
2	37 (35)	74 (70)	55 (52)	0.249
3	74 (70)	111 (105)	92 (87)	0.205
4	111 (105)	148 (140)	128 (121)	0.143
5	148 (140)	185 (175)	165 (156)	0.093
6	185 (175)	222 (210)	202 (191)	0.058
7	222 (210)	258 (245)	238 (226)	0.035
8	258 (245)	295 (280)	275 (261)	0.020
9	295 (280)	332 (315)	312 (296)	0.012
10	332 (315)	369 (350)	349 (331)	0.007
11	369 (350)	406 (385)	386 (366)	0.004
12	406 (385)	443 (420)	423 (401)	0.002
13	443 (420)	480 (455)	460 (436)	0.001
14	480 (455)	517 (490)	497 (471)	0.001
15	517 (490)	Infinity	578 (548)	0.001

²⁰ See guidance provided in section G.5 on the selection of the probability distribution for the heat release rate of transient combustibles.

E.3 Severity Factors in Oil Spill Fire Scenarios

The following steps are recommended for assigning the severity factor to scenarios involving oil spill fires.

1. Determine the amount of oil that can be spilled in the room.
2. Assign a severity factor of 0.02 to a scenario consisting of 98% or more of the amount of oil spilled and ignited.
3. Assign a severity factor of 0.98 to a scenario consisting on 10% of the amount of oil spilled and ignited.

E.3 Severity Factors in Fire Scenarios Involving other Ignition Sources

The first two sections of this appendix have provided methods for calculating severity factors for fixed and transient ignition sources, and oil fires. This section provides a discussion about severity factors in scenarios involving other types of ignition sources or postulated fires.

1. Cable fires caused by welding and cutting or self ignited cable fires: Appendix R of this report provides guidance on modeling cable fires. Given the unavailability of experimental data for heat release rates from cable fires, the methodology described in section E.1 may not be applicable.
2. High-energy arcing faults: As described in detail in Appendix M of this report, high-energy arcing faults are modeled assuming damage to a predefined zone of influence. The severity factor is 1.0 due to the assumption that the fire will propagate and/or damage equipment within the zone of influence.
3. Catastrophic transformer fires in the transformer yard: Section 6.5.6 describe the characteristics of catastrophic transformer fires. Based on those characteristics, the analysts should assume a severity factor of 1.0 for events involving damage to equipment near the transformer.
4. Non-catastrophic transformer fires in the transformer yard: Given the unavailability of experimental data for heat release rates from outdoor transformers, the methodology described in section E.1 may not be applicable. Based on their location (i.e., in the yard and away from safety related items), and event descriptions provided in the database of historical transformer fire events, the main consequence of such fires was a plant trip with no additional damage to safety related targets. Therefore, the severity factor may not be necessary for non-catastrophic fires in the transformer yard.
5. Other fires in the transformer yard: Other fires in the transformer yard may include electrical cabinets, oil filled breakers etc. Depending on the ignition source, the analyst may select an appropriate probability distribution or recommended practice from the ones listed in sections E.1 or E.2.

Appendix F

Appendix for Chapter 8, Walkdown Forms

F

APPENDIX FOR CHAPTER 8, WALKDOWN FORMS

Two walkdown forms have been designed; one for listing the fixed ignition sources in a compartment, and the other for providing zone of influence (ZOI) information for fixed ignition source screening. Both forms should be completed for each compartment under review.

The Fixed Ignition Source Form is intended for compiling a list of items that can initiate a fire in a compartment. Once the list is prepared, each ignition source is examined (usually during the walkdown) using the information summarized in the Fire ZOI Form for the respective compartment. The information provided in the Fire ZOI Form depends on the geometry of the compartment. Specific inputs are required in the electronic version of this form to calculate the required ZOI parameters.

The objectives of this appendix are to:

1. Provide a description of the forms used in the scoping fire modeling task, and
2. Provide instructions on how to use the forms before, during, and after the walkdown.

A detailed description of each form follows.

F.1 Fixed Ignition Source Form

Figure F-1 provides the Fixed Ignition Source Form. This form lists the fixed ignition sources in a compartment. For each unscreened compartment at this stage of the Fire PRA, a separate form should be completed. The fixed ignition sources listed on the form should be consistent with the number of sources counted in the compartment during Task 6, Fire Ignition Frequency.

Note that Task 6 requires only the total number of fixed ignition sources by type or category. In this form, the specific ignition sources are noted by type and tag number. Analysts may choose to collect this level of information during the counting process in Task 6, even though some of the compartments may be screened out before conducting Task 8.

F.1.1 Form Inputs

- Header: Enter the names and designating identification numbers for the plant, building, fire area, and compartment, including any other additional comments. Note that the same header is used in the Fire ZOI Form.

- **Equipment Identification:** Enter the name and tag number of each fixed ignition source in the compartment. The number of ignition sources per type should match the number used in Task 6 for the same type of ignition source. The ignition sources should be identified using the same labeling system as other tasks of the Fire PRA.
- **Heat release rate (HRR) probability density function (PDF):** Specify the case number (first column of Table F-1) of the heat release rate probability distribution for each item in the Equipment Identification column. The probability distributions are listed in the following table. Appendices E and G provide technical details on the distributions.

**Table F-1
Probability Distributions for Heat Release Rates**

Case	Ignition Source	HRR kW, (Btu/s)	
		75th	98th
1	Vertical cabinets with qualified cable, fire limited to one cable bundle	69, 65	211, 200
2	Vertical cabinets with qualified cable, fire in more than one cable bundle	211, 200	702, 665
3	Vertical cabinets with unqualified cable, fire limited to one cable bundle	90, 85	211, 200
4	Vertical cabinets with unqualified cable, fire in more than one cable bundle closed doors	232, 220	464, 440
5	Vertical cabinets with unqualified cable, fire in more than one cable bundle open doors	232, 220	1002, 950
6	Pumps	69, 65	211, 200
7	Motors	32, 30	69, 65
8	Transient Combustibles	142, 135	317, 300

- **Fire condition:** This is a walkdown input. The analyst should determine the location of the target within the ZOI. That is, which specific fire condition is affecting the target: flames, plume, ceiling jet, smoke layer, or flame radiation.
- **Distance to target:** This is a walkdown input. Once the location within the ZOI has been determined, the distance from the ignition source to the target should be measured according to the following description, illustrated in Figure F-2:
 - **Flames:** vertical distance from the base of the fire to the target.
 - **Plumes:** vertical distance from the base of the fire to the target.
 - **Ceiling Jet:** Horizontal distance from the centerline of the fire plume to the target. Target is assumed to be just below the ceiling.
 - **Smoke layer:** No distance is needed for targets immersed in the smoke layer.
 - **Flame radiation zone:** Horizontal distance between the centerline of the flames and the target.

- Calculated HRR: This value is calculated solving hand calculations based on the location within the ZOI and the distance from the ignition source to the target. A discussion of the hand calculations is provided later in this Appendix. These models are documented in FIVE-Rev1 [8.1] and NRR-FDT's [8.2].
- Critical 98th percentile HRR: This is the 98th percentile heat release rate corresponding to the assigned probability distribution in the second column of the table.
- Screen: This column compares the two previous columns and determines if the ignition source can be screened. If the calculated HRR is lower than the 98th percentile HRR, the ignition source cannot be screened.
- Severity factor: The severity factor is the area under the distribution to the right of the calculated heat release rate. A value of 0 is assigned if the equipment is screened.
- Task 6 λ : This is the ignition frequency for the equipment calculated in Task 6. It is calculated by multiplying the generic frequency times the location and ignition source weighting factors.
- Adjusted λ : This is the adjusted frequency, which considers the severity factor. The sum of this column is the new adjusted frequency for the compartment.

F.2 Fire Zone of Influence Form

Initially introduced in FIVE [8.1], the fire ZOI is defined as the region where a given target *is expected to be damaged* by fire generated conditions. In general, the ZOI consists of five distinct fire-generated hazardous regions: flame, flame irradiation region, fire plume, ceiling jet, and the hot gas layer. The critical values (usually distances) that define the ZOI are calculated using fire models listed in Appendix D of EPRI's Fire Modeling (TR-1002981) [Reference 8.1] which summarizes the hand calculations automated in FIVE-Rev1. Specifically:

1. Source Type: The form considers two types of fires: electrical, which includes cabinet and electrical motor fires, and flammable liquid fires, which includes confined and unconfined spills. These two fire types are further classified per location and combustible loading. Location refers to fires in the center, along a wall in the corner or a room. Combustible loading refers to the amount of cable or oil associated with the ignition source.
2. Target in Flame: A target should be considered inside a flame if a portion of it is located directly above the base of the fire and its distance from the base of the fire is less than the flame height. The flame height is calculated using Heskestad's correlation.
3. Target in the Flame Irradiation Region: A fraction of the heat released by the fire is irradiated from the flame to its surroundings. The intensity of this heat flux decreases as the radial distance from the fire increases. The critical distance, defined as the distance from the center of the flame, where the target would receive greater than its critical heat flux, is calculated using the point source fire irradiation model.
4. Target in the Fire Plume: Two distances are used to determine whether or not a target would be damaged when exposed to plume temperature: the target elevation above the fire, and the plume radius. The critical distance at which a target will be immersed in gas temperatures with a magnitude at least equal to its damage temperature is calculated using the Heskestad correlation for plume temperature. For the purpose of this task, the radius was calculated at the critical height above the base of the fire.

5. Target in the Ceiling Jet: A horizontal radial distance from the centerline of the fire plume is used to determine if a target in the ceiling jet will contact gases with temperatures at least equal to its damage temperature. This critical distance is calculated using Alpert's ceiling jet temperature correlation.
6. Target in the Hot Gas Layer: The heat release rate necessary to generate a hot gas layer with a temperature similar to the damage criteria of a target is estimated using the McCaffrey, Quintiere and Harkleroad (MQH) correlation. This correlation requires the specification of the room geometry and natural ventilation. For totally enclosed rooms, it is recommended to assume 0.5" high leakage paths below the openings.

Figures F-2 and F-3 illustrate the concept of ZOI and the Fire ZOI Form, respectively.

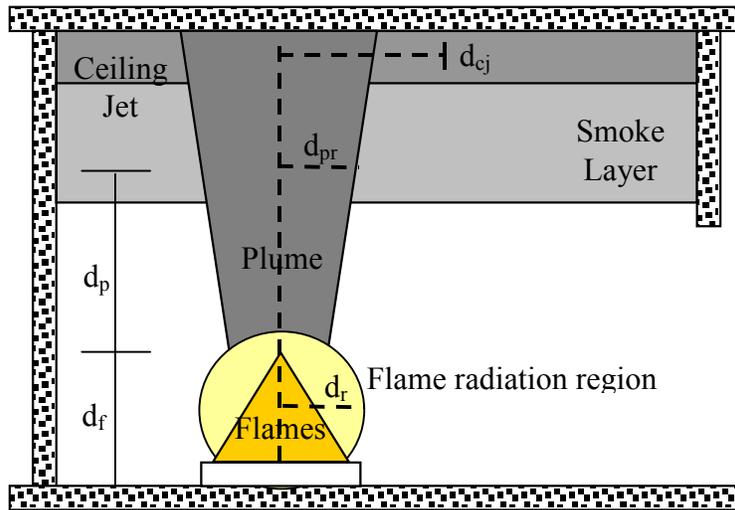


Figure F-2
Fire ZOI. d_p : Critical Distance for Targets in the Plume, d_{pr} : Radius of the Plume at the Critical Distance, d_f : Flame Height, d_{cj} : Critical Distance for Targets in the Ceiling Jet, d_r : Critical Distance for Targets Subjected to Flame Radiation

Plant _____
 Fire Area _____
 Compartment _____

Room Geometry

Opening area [m2]	2.0
Height of opening [m]	2.0
Room length [m]	32.0
Room width [m]	32.0
Room height [m]	6.4
Ambient temperature [C]	20

Material Concrete

Thermal conductivity [kW/mK]	0.001
Density [kg/m3]	2000
Specific heat [kJ/kg]	0.88
Wall thickness [m]	0.30

Damage Criteria	UQ	Q
Temperature [C]	205	330
Heat flux [kW/m2]	6	11

Ignition Source

Fire duration [sec]	600
Fire diameter [m]	0.60
Fire location factor	1.00
Fire elevation [m]	0.00
Radiated fraction	0.40

ZONE OF INFLUENCE

	Vertical cabinets with qualified cable, fire limited to one cable bundle	Vertical cabinets with qualified cable, fire in more than one cable bundle	Vertical cabinets with unqualified cable, fire limited to one cable bundle	Vertical cabinets with unqualified cable, fire in more than one cable bundle closed doors	Vertical cabinets with unqualified cable, fire in more than one cable bundle open doors	Pumps	Motors	Transient combustibles
PE/PVC Cable								
98th Per HRR (kW)	211	702	211	464	1002	211	69	317
Flames (m)	1.4	2.6	1.4	2.1	3.1	1.4	0.7	1.7
Plume (m)	2.2	3.9	2.2	3.2	4.6	2.2	1.2	2.7
Ceiling Jet (m)	0.1	0.2	0.1	0.1	0.3	0.1	0.02	0.1
Flame Radiation (m)	1.1	1.9	1.1	1.6	2.3	1.1	0.6	1.3
Smoke Layer (kW)	3198	3198	3198	3198	3198	3198	3198	3198

Qualified Cable

98th Per HRR (kW)	211	702	211	464	1002	211	69	317
Flames (m)	1.4	2.6	1.4	2.1	3.1	1.4	0.7	1.7
Plume (m)	1.6	3.0	1.6	2.5	3.6	1.6	0.8	2.0
Ceiling Jet (m)	0.03	0.10	0.03	0.07	0.14	0.03	0.01	0.04
Flame Radiation (m)	0.8	1.4	0.8	1.2	1.7	0.8	0.4	1.0
Smoke Layer (kW)	6938	6938	6938	6938	6938	6938	6938	6938

Figure F-3
 Fire Zone of Influence Form. Predetermined Values are Based on Listed Input Parameters. Analysts Should Verify that Inputs are Applicable to the Compartment Under Study

F.2.1 Form Inputs

- The header is identical to the Fixed Ignition Source Form.
- The compartment data section includes inputs used to calculate the Fire ZOI.
- Damage/Ignition Criteria: Default values are used in these columns. The values affect the calculated ZOI. These values may be changed to evaluate fixed ignition sources with characteristics different to the ones in the list.
- Fire ZOI: These columns provide the result of the calculations using the equations described above.
 - A target is in the flames if: (1) a portion of it is directly above the base of the fire, and (2) its elevation is less than the flame height calculated on the form.
 - A target is in the flame radiation region if its distance from the center of the fire is less than the one calculated on the form.
 - A target is in the plume damage region if: (1) its elevation is above the flames, (2) its elevation is below the height calculated on the form, and (3) its horizontal distance from the centerline of the plume is less than the radius calculated on the form.
 - A target is in the ceiling jet damage region if: (1) it is located within 10% of the ceiling height near the ceiling, and (2) its horizontal distance from the centerline of the plume is less than the distance calculated on the form.
 - Hot gas layer temperatures damage a target if the heat release rate from the fire is larger than the heat release rate calculated in the hot gas layer column of the form.

The form presented in Figure F-3 has a calculated ZOI for the specific conditions listed as inputs.

Appendix G

**Appendix for Chapters 8 and 11,
Heat Release Rates**

G

APPENDIX FOR CHAPTERS 8 AND 11, HEAT RELEASE RATES

This appendix includes:

- Background information on heat release rates,
- Recommended heat release rate values for typical fixed and transient ignition sources in nuclear power plants, and
- Technical basis for typical heat release rate values, including look-up tables of results for specific experiments.

G.1 Background

The heat release rate (HRR), measured in BTU/s or kW, is the rate at which the combustion reaction produces heat. The HRR is perhaps the most critical and difficult-to-predict parameter in determining consequences of a fire, because it is the driving parameter for estimating conditions in fire-induced flows such as plumes, ceiling jets, smoke layers, and radiation from flames.

In general, the HRR is calculated using flammability properties of the fuel. This approach is easily applied in the case of liquid and some plastic combustibles. These flammability parameters are the heat of combustion (ΔH_c , kJ/kg), and the specific burning rate (\dot{m}'' , kg/sec-m²). Using these two parameters, along with the burning area, the HRR by the fire is estimated as:

$$\dot{Q}_f = \Delta H_c \cdot \dot{m}'' \cdot A$$

Unfortunately, mathematical modeling of the physical and chemical transformations of materials as they burn is still the subject of research and, therefore, the heat output of a fire as a function of time cannot be calculated using the equation above for many combustibles under actual configurations and conditions. The most effective way to estimate the HRR profile of a combustible is probably by running fire tests, such as those designed to determine material flammability or large scale tests designed to predict HRR for preset configurations of combustible materials. However, both of these experiments are highly dependent on the geometry and the ventilation conditions of each test scenario and their proper application requires understanding the critical parameters affecting the phenomenology. The approach presented is based on using such tests and evaluating their applicability to the type of fire sources present in a U.S. nuclear power plant (NPP), as represented by events in EPRI's FEDB. In general, the parameters influencing the HRR are identified and it is recommended that the analyst verify these values are appropriate for the scenarios being analyzed.

In practical applications, the HRR vs. time curve, depicted in Figure G-1, is divided in stages of the fire. Mowrer [G.1] describes four stages: incipient, growth, fully developed, and decay. In the incipient stage, the fire burns at a low intensity (i.e., smoldering cigarette or a small trash can fire). The duration of this stage may vary from seconds to hours. With appropriate conditions, an incipient fire may grow in intensity to its peak HRR. Depending on the combustible and its layout, the growth to a fully developed stage will vary from seconds to minutes. A fully developed fire will burn depending on the amount of fuel and the amount of oxygen surrounding the combustion process. As the fuel is consumed, the HRR profile will be in its decay stage. The intensity of the fire will also decrease if there is not enough oxygen to support the reaction.

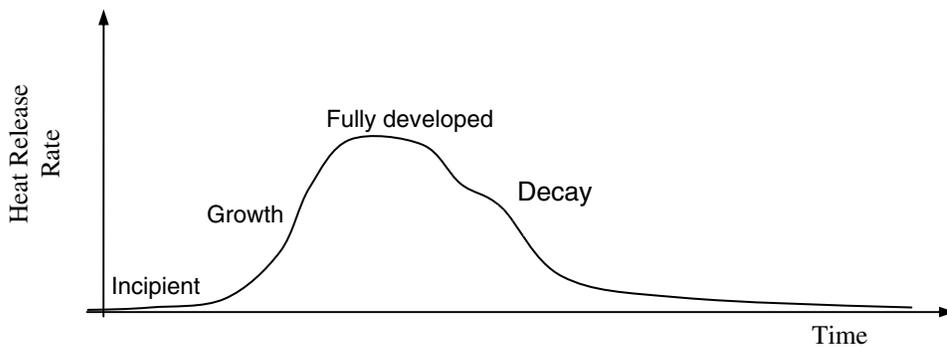


Figure G-1
Heat Release Rate Profile

These four stages are not observed in all fires and do not need to be included in every analysis, as long as the modeled fire conditions capture the fire hazards posed by the ignition source to the target. The following list provides a few general notes on developing HRR profiles.

1. The incipient stage is not usually included due to its uncertainty in duration and that it is not expected to generate thermal conditions that threaten the integrity of other targets in the room.
2. A fire may run out of fuel before reaching its peak HRR (steady burning stage). If the amount of combustible is known, the analyst may choose to model the growth stage until all the fuel is consumed.
3. Oxygen availability can affect the fire after it starts to grow. A fire may decay due to low oxygen concentrations. In contrast, an additional supply of oxygen to an already low oxygen concentration room may cause the fire to increase in intensity.
4. HRR profiles can be affected by combustible layouts in the room. Therefore, it is not always easy to develop or find a profile for a specific situation. If a constant HRR profile is selected, **the constant value should be the peak fire intensity.**
5. Temperature and heat flux results associated with the decay stage of the fire will, in general, suggest less hazardous conditions than the growth of the fully developed stage. Once the fire starts to decay, temperatures in the room will decrease to ambient conditions. As a result, and depending on the objectives of the simulation, modeling the decay stage of the fire usually does not provide critical information in support of risk decisions.

G.2 Recommended HRR Values

G.2.1 Overview

The recommended HRR values for typical ignitions sources in NPPs are listed in the following sections. The values are expressed as probability distributions in support of the severity factors approach. Technical basis for the selected fire intensities is also provided.

A gamma probability distribution was selected for modeling the uncertainty in the HRR. The gamma distribution was selected for two reasons: (1) it distributes probabilities among positive real numbers only (which is a limitation of the normal distribution for this application), and (2) uncertainty in the recommended HRR values is, for the most part, distributed in the same order of magnitude (which limits the application of a lognormal distribution).

G.2.2 Basis

The recommended HRR distribution profiles were developed based on expert judgment during a nonfacilitated meeting. The expert panel included those members of both the EPRI and NRC Fire Risk Requantification Study analysis teams with expertise in fire behavior/phenomena²¹. Information considered included existing fire PRA practice, qualitative insights from the nuclear power plant FEDB, practical experience involving similar fire sources in non-nuclear industrial applications, and experimental data.

During this meeting, the overall fire analysis approach was also finalized. The proposed approach involves an integrated and interdependent set of four analysis tasks; namely, fire frequency analysis, fire severity/likelihood characterization, fire growth/damage analysis, and fire detection/suppression analysis. One specific objective of the proposed approach was to ensure full treatment of the dependencies between these analysis tasks.

Substantial consideration was given to existing Fire PRA practice, particularly as documented in the EPRI FIVE methodology and the Fire PRA Implementation [Ref. 2.1]. Also considered were methodological insights derived by the NRC based on the IPEEE process. FIVE and the FPRAIG both recommend a single, fixed fire intensity level for any given fire ignition source. The values recommended were cited as the anticipated fire intensities.

One specific limitation of the IPEEE studies cited in the U.S. NRC insights work [Ref. 11.3] was the failure to consider the risk contribution of low-likelihood, high-intensity fires. Fire behavior is inherently chaotic, and in practice, no two fires will be exactly the same. It is possible that the risk contribution of a fire scenario may be dominated by a low-likelihood event where the fire is more intense than anticipated. The proposed method addresses this issue through use of the intensity distribution.

²¹ Panel members were: Bijan Najafi (SAIC), Francisco Joglar (SAIC), Steve Nowlen (SNL), Mardy Kazarians (Kazarians and Associates), and Matt Turgeon (SNL).

The first decision made was to assign a probability ranking to the fire intensity values recommended in FIVE and in the FPRAIG. That is, a decision had to be made as to where on the fire intensity distribution those particular values fell. Ultimately, the FIVE/FPRAIG values were taken as representative of the 75th percentile fire intensity. That is, 75% of the fires involving a given source would reach no greater than the cited fire intensity value (absent of any fire spread to secondary combustibles).

The second decision made was to establish an anticipated “high-confidence” fire intensity value expected to bound the vast majority of fires involving a given fire source. These values were ultimately assigned as the 98th percentile value for each source. The final distributions were established using a two-parameter distribution profile whose parameters could be derived given the 75th and 98th percentile values.

Note that as an initial cut, distributions were developed with the FIVE/FPRAIG fire intensity values assigned as the 50th percentile and the estimated high-confidence values as the 95th percentile. However, the panel unanimously agreed that this resulted in excessively conservative distributions. In particular, this led to fire likelihood/intensity values at the upper end of the distribution that were considered unreasonable. As a result, this led to the ultimate assignments, as described above. The result was judged reasonable by all participants in the panel, based in particular on consideration of the 1% fire intensity values implied by the resulting distribution.

Recommended HRR values for pool fires are not entirely based on experimental observations. Given that equation in section G.1 works perfectly for liquid fuels, and assuming known flammability properties, the HRR can be calculated if the size of the spill is also known. If the amount of liquid fuel is determined, the problem is reduced to determining the spill size. Areas of confined spills are easily determined. An empirical model is available for determining unconfined spill sizes. HRR for transient combustible fuel packages are also recommended. Recommendations are based on fire experiments.

Finally, separate appendices in Task 11 provide technical details on cable fires, hydrogen fires, high energy arcing faults, turbine generator fires, and main control board fires. These appendices provide, when appropriate, recommended HRR values and describe modeling alternatives in cases where traditional fire modeling tools are not suitable for the analysis.

G.3 HRRs for Fixed Ignition Sources

Table G-1 lists recommended probability distributions for fixed ignition sources. Fixed ignition sources include electrical cabinets, pumps, and motors.

Table G-1
Recommended HRR Values for Electrical Fires

Ignition Source	HRR kW (Btu/s)		Gamma Distribution	
	75th	98th	α	β
Vertical cabinets with qualified cable, fire limited to one cable bundle	69 ¹ (65)	211 ² (200)	0.84 (0.83)	59.3 (56.6)
Vertical cabinets with qualified cable, fire in more than one cable bundle	211 ² (200)	702 ³ (665)	0.7 (0.7)	216 (204)
Vertical cabinets with unqualified cable, fire limited to one cable bundle	90 ⁴ (85)	211 ² (200)	1.6 (1.6)	41.5 (39.5)
Vertical cabinets with unqualified cable, fire in more than one cable bundle closed doors	232 ⁵ (220)	464 ⁶ (440)	2.6 (2.6)	67.8 (64.3)
Vertical cabinets with unqualified cable, fire in more than one cable bundle open doors	232 ⁵ (220)	1002 ⁷ (950)	0.46 (0.45)	386 (366)
Pumps (electrical fires) ⁸	69 (65)	211 ² (200)	0.84 (0.83)	59.3 (56.6)
Motors ⁸	32 (30)	69 (65)	2.0 (2.0)	11.7 (11.1)
Transient Combustibles ⁹	142 (135)	317 (300)	1.8 (1.9)	57.4 (53.7)

1. Ref. G.2: Sandia experiments, average of vertical cabinet fire intensities with qualified cable.

2. Ref. G.3: VTT experiments with control cabinets.

3. Ref. G.2: Sandia experiments, average of two bench-board cabinet experiments with qualified cable.

4. The value is based on expert judgment. The expert panel assumes that the type of cable will only affect the ability of the cable to ignite. Therefore, once ignited, a single cable bundle is assumed to burn with similar intensity regardless of the cable qualification. A value of 85 BTU/s was selected as a conservative estimate for unqualified cables to represent a higher intensity at the 75th percentile when compared to qualified cable.

5. Ref. G.2: Sandia experiments, average of two vertical cabinet experiments with unqualified cable and closed doors.

6. Twice the intensity selected for the 75th percentile.

7. Ref. G.2: Sandia experiments, the highest heat release rate observed in cabinets with open door and unqualified cable.

8. No experimental evidence is available for assessing fire intensities for electrical fires in equipment other than electrical cabinets (or panels). Recommended values are considered conservative and are based on electrical cabinet (panel) fires experiments.

9. Distribution estimated based on the range of the tested transient fuel packages summarized in table G-7.

G.3.1 Growth of Electrical Cabinet Fires

Recommended values for electrical cabinets and other electrical equipment are based on the following two considerations:

1. Behavior of fires in electrical cabinets as observed in the experimental evidence available, and
2. Engineering judgment based on observations of the configuration on the combustibles (mainly cables) inside the cabinet.

Recommended values should be used with caution after determining if the cabinet in question meets the criteria for such values. A visual inspection of the cabinet internals should be very helpful for assessing the applicability of recommended fire intensities.

The recommended HRR profile for electrical cabinets is as follows

- The fire grows to its peak HRR in approximately 12 minutes.
- The fire burns at its peak heat release for approximately eight additional minutes.

This profile was obtained by averaging the growth times and steady burning durations of the Sandia cabinet experiments, listed in Table G-2.

**Table G-2
Recommended HRR Profiles for Electrical Cabinet Fires (See Table G-6 for Additional Detail of the Experiments)**

Test	Units in Minutes		
	Time to Peak	Steady Burning	Time to Decay
ST1	7	8	15
ST2	6	11	17
ST3	10	8	18
ST4	14	3	17
ST5	8	9	17
ST6	8	17	25
ST7	18	7	25
ST8	10	20	30
ST9	10	10	20
ST10	10	20	30
ST11	18	2	20
PCT1	11	10	21
PCT2	12	2	14
PCT3	13	14	27
PCT4a	16	0	16
PCT4c	16	0	16
PCT5	17	0	17
PCT6	11	0	11
Test 21	4	14	18

Table G-2
Recommended HRR Profiles for Electrical Cabinet Fires (See Table G-6 for Additional Detail of the Experiments) (Continued)

Test	Units in Minutes		
	Time to Peak	Steady Burning	Time to Decay
Test 22	9	2	11
Test 23	10	0	10
Test 24	12	0	12
Average	11.4	7.1	19

A t^2 function can be used for representing the growing phase of the fire. The t^2 function is of the form

$$\dot{Q}(t) = \text{Min} \left(\dot{Q}_{peak}, \dot{Q}_{peak} \cdot \left(\frac{t}{\tau} \right)^2 \right) \text{ (kW)},$$

where τ is the time to reach the peak HRR, \dot{Q}_{peak} is the peak HRR, and t is time.

G.3.2 Location of Electrical Cabinet Fires

The location of the fire is of particular importance because targets, such as cable trays, may be in close proximity to the cabinet. Visual observations of the cabinet internals may suggest where the fire is located. In some cabinets, however, this can be a challenging task if they contain numerous cable bundles in different orientations. Furthermore, any effort to determine the location of the fire should be consistent with the ability of analytical tools for using that information. That is, many fire models simply assume a point source of heat released at a given elevation. In addition, obstructions to plume flows like cabinet walls are not considered in the models. As a result, further details in describing the location of the fire may not increase the accuracy of a fire modeling prediction.

As a conservative practice, the fire should challenge the selected target set. That is, the source should be positioned in a location allowing fire-generated conditions to directly affect the target.

1. **Targets in the fire plume or ceiling jet:** Locating a source on top of a cabinet is usually conservative, since it assumes that cabinet walls will not affect fire-generated conditions. Furthermore, since the fire is located in the highest possible position, flames will be higher, and temperatures in the plume and ceiling jet will also be high.
2. **Targets affected by flame radiation:** The source should be located so that there is an unobstructed (assuming any passive fire protection system is not credited) view between the source and the target. A horizontal alignment between flame and target is the most conservative configuration. Analysts may need to assume cabinets with open or no doors in some scenarios.

3. **Targets engulfed in flames:** Flame height calculations should be performed to determine if the selected location will result in targets engulfed in flames. If the selected location cannot be altered (location not based on analysts judgment, but in a scenario configuration), a target engulfed in flames should be assumed damaged. Proper justification should be provided where the location of the fire is selected so that the target is out of the flames. For example, consider the case where the analyst locates the fire on top of an enclosed cabinet, resulting in a cable tray engulfed in flames. This is a conservative scenario, since the fire is expected to occur somewhere inside the cabinet. The analyst may choose to lower the fire position and ignore cabinet walls after a visual examination identifies the actual location of the combustibles.
4. **Targets immersed in the smoke layer:** The fire elevation will influence how far down the smoke layer will develop, although other important scenario characteristics will also be influential (See EPRI Fire Modeling). Notice that, with the exception of computational fluid dynamics (CFD) calculations, smoke layers are assumed to have uniform properties.

G.3.3 Fire Propagation in Electrical Cabinets

Openings and penetrations in cabinets are perhaps the most important factor in determining if a fire will propagate outside the cabinet. Typical cabinet openings and penetrations observed in the field are listed in Table G-3.

**Table G-3
Typical Electrical Cabinet Openings and Penetrations**

Vents	Louvers on the front, back and /or sides Grilles on the front, back, sides and/or top Open top Open top with shield Fans (typical on solid state equipment)
Penetrations	Air drop with flange and water seal Air drop with open conduit Air drop with rated fire seal (not common) Sealed conduit

Electrical cabinets that are not vented do not propagate a fire. Penetrations listed above are not considered vents. It is assumed that in the absence of other ventilation, penetrations will not allow sufficient air exchange to replace oxygen consumed by the fire, and an incipient fire will self-extinguish when there is no longer enough oxygen to support combustion.

If there are no vents in the cabinet and the only openings are penetrations of the kind listed above, combustion products from an incipient fire (carbon monoxide, carbon dioxide, soot) will accumulate inside the cabinet. The increasingly dense particulate matter will block radiative feedback, thus reducing external flux to the incipient fire (necessary to support combustion in qualified cable). In addition, as combustion products increase, the available oxygen will decrease. Buoyancy forces will cause warming air inside the cabinet to rise and try to exit through the top penetrations. Due to density differences, replacement air will compete with exiting air for access to the same opening. Therefore, air exchange through the top penetrations for typical NPP cabinet configurations listed above is not expected to be sufficient to support combustion.

One could postulate that hot gases accumulating at the top of the cabinet could ignite the penetrating cables, which could then afford a propagation path to overhead cable trays. SNL cabinet fire tests indicate that this does not occur in closed cabinets with qualified cable. NUREG/CR-4527: Part 1 reports the following results for tests with qualified cable and closed doors:

- Test ST7: cables at the top of the cabinet showed only slight deterioration and discoloration;
- Test ST8: heat damage to cables in the top of the cabinet was observed, but no ignition occurred.

Conditions in the SNL tests were less restrictive than the assumed configuration, in that the test cabinets had ventilation grills on top and bottom, and ignition was induced by a transient source rather than an electrical fault. Even so, only the cables near the ignition source burned in the two tests involving closed cabinets with qualified cable.

G.4 HRRs for Flammable Liquid Fires

Some of the fixed fire sources, such as pumps, diesel generators, main station transformers, and turbine generators, may contain combustible liquids as fuel or for lubrication. HRR values for the liquid fires associated with these fixed sources are calculated based on the flammability properties of the combustible and the size of the spill using the equation described in section G.1. The assumption of a constant HRR is reasonable, since flammable liquid fires are characterized by a rapid growth to its peak intensity. The duration of the fire can be estimated by dividing the mass (kg) of the fuel by the mass loss rate (kg/sec). Flammability properties for selected combustibles are provided in Table G-4.

Table G-4
Flammability Properties for Selected Combustibles

Fuels	Heat of Combustion MJ/kg	Ideal Mass Loss Rate kg/s-m ²	Density kg/m ³
Acetone	25.8	0.041	791
Benzene	40.1	0.085	874
Ethanol	26.8	0.015	794
Fuel oil, heavy	39.7	0.035	940-1000
Gasoline	43.7	0.055	740
Heptane	44.6	0.101	675
Hexane	44.7	0.074	650
JP-4	43.5	0.051	760
JP-5	43.0	0.054	810
Kerosene	43.2	0.039	820
Methanol	20.0	0.017	796
Transformer oil, hydrocarbon	46.4	0.039	760
Xylenes	40.8	0.09	870

Properties in Table G-4 are obtained from reference G.5.

The spill area is determined by first assessing if the spill is confined or unconfined. Some authors of the Fire Protection Engineering literature refer to confined spills as pool fires. Equipment enclosures and/or floor openings can confine the liquid fuel spills. For confined spills, use the confined area in the equation described in section G.1 for calculating the HRR.

The area of unconfined spills can be determined using the model described by Gottuk and White [G.4]. According to the authors, the first step in estimating the fire size from unconfined spills is to determine if the spill is static or continuous. In a static spill, the flames will spread across the fuel surface. For a continuously flowing spill fire, the flame may spread initially across the spill area, but later will be controlled by the spread of the fuel over the surface until steady-state burning conditions are established. In general, the initial momentum of the fluid, the fluid surface tension, and the surface characteristics onto which fuel is spilled, affect the unconfined spill size. Furthermore, experimental observations have suggested that the spill size can increase after the original spill is ignited.

The area of static unconfined spills should include an estimate of how much fuel contained in the equipment becomes exposed and involved in the fire. The exposed volume of the fuel should be estimated based on the amount of the fuel contained in the equipment and other factors that determine where and how the fuel may leak. The following model (Gottuk and White) may then be used to conservatively determine spill area. These values will yield the maximum spill area.

- For a fuel volume of 95 liter or less, assume a depth of 0.7 mm. This is equivalent to 0.8 m²/liter.
- For a fuel volume of more than 95 liter, assume a depth of 2.8 mm. This is equivalent to 0.05 m²/liter.

For a continuously flowing spill fire, after the original combustible area is consumed, the HRR can be estimated using the mass flow (kg/s) times the heat of combustion of the fuel, assuming steady-state conditions.

Assuming known flammability properties, different spill sizes should be used to calculate HRR values. These values are used for uncertainty analysis. The uncertain parameter is the amount of spilled fuel. Consult equipment documentation and maintenance practices for determining how much fuel can be both in the equipment, and in a replacement container in a given location at the same time.

In addition to oil spills, pressurized oil fires can also occur in NPPs. Table G-5 provides HRR values for such fires.

Table G-5
Information for Pressurized Oil Fires

Metric Units

Diameter of the nozzle used in test: 0.38mm

Fluid	Nozzle Pressure (MPa)	Mass Flow Rate m_f (g/s)	Chemical HRR Q_{ch} (kW)	Net Heat of Combustion ΔH_f (kJ/g)	Ave. Heat of Combustion ΔH_{ch} (kJ/g)	Combustion Efficiency x_{ch}	Visible Flame Height L_f (m)
Mineral Oil	6.9	5.71	255	46.0	44.6	0.97	2.18
	5.2	5.18	230	46.0	44.3	0.96	1.96
	3.5	4.45	202	46.0	44.1	0.96	1.91
	1.7	3.0	131	46.0	41.4	0.90	1.50

English Units

Diameter of the nozzle used in the test: 0.015in

Fluid	Nozzle Pressure (PSI)	Mass Flow Rate m_f (lb/s)	Chemical HRR, Q_{ch} (BTU/min)	Net Heat of Combustion ΔH_f (BTU/lb)	Ave. Heat of Combustion ΔH_{ch} (BTU/lb)	Combustion Efficiency x_{ch}	Visible Flame Height L_f (ft)
Mineral Oil	1000.9	1.3E-02	14515	9.6E-02	9.3E-02	0.97	6.89
	754.3	1.1E-02	13092	9.6E-02	9.3E-02	0.96	6.43
	507.7	9.8E-03	11498	9.6E-02	9.2E-02	0.96	6.27
	246.6	6.6E-03	7457	9.6E-02	8.7E-02	0.90	4.92

HRRs in Table G-5 are obtained from references G.6 through G.11.

G.5 Technical Basis for Recommended HRR for Transient Ignition Sources

Characteristics of transient fires should be determined by:

- Review of the maintenance and other activities performed in the area, and
- Review of past transient fire experience at the plant.

If the type and amount of combustible material that is expected or possible, based on this review, is bounded by the tested fuel package configurations in Table G-7, use Table G-1 for the recommended HRR probability distribution for transient fires and transient fires caused by hot work activities.

If not bounded by the fuel packages found in Table G-7, the HRR may be estimated using the characteristics of the combustible materials involved and heat of combustion from Table G-8. Note that this will result in a point value for the HRR. In this case the user should develop a representative distribution with adequate justification. An alternative approach is to use a single bounding HRR value with a severity factor of 1.0.

Liquid transient fires should be characterized similar to fixed oil fires, such as, pump oil fires as described in section G.4.

G.6 Supplemental Information: Experimental HRR Measurements

This section compiles the experimental information considered for developing the probability distributions of HRRs.

G.7 Supplemental Information: Examples of Determining HRRs for Typical Electrical Cabinets in NPPs

Electrical cabinets in a typical U.S. NPP cover a range of functions and configuration represented by the following:

- Switchgears; typical voltages are 6KV, 4KV and 480V,
- MCCs or Load Centers (LCs), typically 480 V,
- Control panels and cabinets,
- Main control boards,
- Inverters,
- Battery chargers,
- Distribution panels, and
- Relay Racks.

Table G-6
Summary of Electrical Cabinet Experiments Reported in NUREG/CR 4527

Test No.	Ignition Source Type	Cabinet Type	Cable Type	Load (MBTU)	Ventilation Method	Fire		Test	
						Peak HRR [kW]	Peak/Dur [min]	Objectives	Results
Qualified, Open									
ST1	Transient	Vertical	Q	0.11	No doors	24	7, 15	Single cable bundle. Evaluate if the transient ignition source could ignite the cable bundle and propagate a fire in it.	Cable bundle did not burn.
ST2	Transient	Vertical	Q	0.11	No doors	27	7, 17	Single cable bundle. Evaluate if the transient ignition source could ignite the cable bundle and propagate a fire in it.	The ignition source was not enough to ignite and propagate a fire through the cable bundle.
ST3	Transient	Vertical	Q	0.11	No doors	77	10, 18	Single cable bundle. Increased the source from ST1 and ST2 to ignite the cables and loosened up the bundle to allow additional air flow and flames through the cables.	The cable bundle ignited and fire propagated up the bundle. Entire bundle consumed
ST4	Transient	Vertical	Q	0.11	No doors	82	15, 17	Single cable bundle. Increased the source from ST1 and ST2 to ignite the cables. The bundle was even more loosened up compared to ST3.	The cable bundle ignited and burned quickly.
ST9	Transient	Vertical	Q	0.22	Doors open	132	11, 17	This test was conducted to investigate if internal horizontal barriers (e.g., strip chart recorders, mounting plates, etc.) would enhance the potential for the fire to propagate.	The fire did not propagate horizontally even with the partition. Peak HRR reached at about 10 min.
ST6	Transient	Vertical	Q	0.33	No doors. 2 - 19"*84" openings.	82	8, 25	Determine if fire in a corner cable bundle will propagate to another cable bundle in the cabinet.	No horizontal propagation of the fire in any cable bundles. It took about 8 minutes to reach the peak HRR.

**Table G-6
Summary of Electrical Cabinet Experiments Reported in NUREG/CR 4527 (Continued)**

Test No.	Ignition Source Type	Cabinet Type	Cable Type	Load (MBTU)	Ventilation Method	Fire		Test	
						Peak HRR [kW]	Peak/Dur [min]	Objectives	Results
PCT3	Transient	Vertical	Q	1	Doors open	56	11, 25	Although ST6 thru ST9 had shown a fire in qualified cable and vertical cabinet would not spread, this test was conducted to determine what effect a larger fuel loading of qualified cable in a vertical cabinet would have on ignition and propagation of a fire.	No propagation. Obscuration at 10 minutes. Peak HRR reached at about 10 minutes.
PCT6	Transient	Benchboard	Q	1.47	Doors open front grill	215	15, 35	This test was done to investigate how the fires propagate in benchboard cabinets with unqualified cables.	Propagation 1.22m up. Obscuration at 11 minutes. Peak HRR reached after 15 minutes.
Test 23	Transient	Benchboard	Q	1.47	Front ventilation grill & open backdoor	1235	11, 15	Configuration similar to PCT 5, except qualified and room ventilation at one room change/hr (800 ft ³ /min).	Obscuration of the room at about 9 minutes (at optical density of 1.83-m). Peak HRR reached at 10:45 minutes.
Qualified, Closed									
ST7	Transient	Vertical	Q	0.33	Doors closed	95	16, 25	Same as ST6 except doors were put on the cabinet. The doors each had two vent grills, one on the top of the door and one near the bottom.	Only the main bundle above the fuel was consumed. No horizontal propagation to other bundles. Peak HRR reached in 17 minutes.
ST8	Transient	Vertical	Q	0.55	Doors closed	93	11, 30	Similar to ST7, but fuel loading and configuration more representative of NPP control room cabinets (based on actual pictures).	The main cable bundle directly above the source burned. The cable bundle and plastic wireway to the left of the main bundle also burned. No other bundle burned. Peak HRR reached in about 10 minutes. The room did not fill with smoke.
Unqualified, Open									
ST5	Transient	Vertical	UQ	0.11	No doors	132	10, 17	Single cable bundle. Similar to ST3 and ST4, but with unqualified cables to evaluate the ability to ignite and propagate a fire through a single bundle.	Entire bundle consumed with peak HRR of 100 BTU/s in less than 9 minutes.

**Table G-6
Summary of Electrical Cabinet Experiments Reported in NUREG/CR 4527 (Continued)**

Test No.	Ignition Source Type	Cabinet Type	Cable Type	Load (MBTU)	Ventilation Method	Fire		Test	
						Peak HRR [kW]	Peak/Dur [min]	Objectives	Results
Unqualified, Open									
ST11	Transient	Vertical	UQ	0.58	Doors open	506	20, 20	Same as ST10, except the doors were left open to evaluate the effect of ventilation.	Propagated. All burned. The fire burned much quicker than ST10. The peak HRR of 480 BTU/s was reached at 19 minutes. It took longer than 5 minutes to reach 70 BTU/s. The smoke level quickly descended to the floor obscuring the cabinets in the enclosure.
Test25	Electrical	Vertical	UQ	1	Doors open	840		<i>In situ</i> fuel arrangement and amount the same as PCT2, except for electrical ignition source and room ventilation maintained at 8 room ch/hr (6400 ft3/min).	Smoke first visible (very small amount) from elect source 6 minutes before ignition at 15.5 minutes. In-cab detector activated at 10.5 minutes after ignition.
PCT2	Transient	Vertical	UQ	1	Doors open	995	12, 15	After PCT1, increased the loading (from 690,000 to 1000,000 BTU) and left the door open. As a result of discussions with NRC, this was considered representative of cabinets in operating plants.	Propagated. Flames out cabinet door in 5 minutes. Visual obscuration in 6 minutes with total obscuration of the cabinets 9 minutes after ignition. About 11 minutes to reach the peak HRR (took ~7 minutes from 99.5 to 995 BTU/s).
PCT5	Electrical	Benchboard	UQ	1.44	Doors open front grill	791	12, 20	This test was done to investigate how the fires propagate in benchboard cabinets with unqualified cables.	Ignition occurs 15.33 minutes after electrical ignition is turned on. Smoke was visible for approximately 4 minutes before ignition and obscured the view in the room at 9 minutes after ignition. Peak HRR at 30 min, 15 minutes after fire ignition.
Test 24	Electrical	Benchboard	UQ	1.44	Front ventilation grill & open backdoor	1300	13, 15	Similar configuration as PCT5. Room ventilation at 1 room ch/hr (800 ft3/min).	Complete obscuration at 6' level began in approximately 15 minutes and optical density of 1m-1 reached at 12 minutes after ignition. Smoke from electrical ignition was visible 1.5 minutes before ignition. Peak HRR reached at about 12.5 minutes after ignition.

**Table G-6
Summary of Electrical Cabinet Experiments Reported in NUREG/CR 4527 (Continued)**

Test No.	Ignition Source Type	Cabinet Type	Cable Type	Load (MBTU)	Ventilation Method	Fire		Test	
						Peak HRR [kW]	Peak/Dur [min]	Objectives	Results
Unqualified, Closed									
ST10	Transient	Vertical	UQ	0.58	Doors closed. Vent grills on door	280	10, 30	Same as ST8 except for unqualified (UQ) instead of qualified (Q) cable. Same as ST11 except the doors were left open to evaluate the effect of ventilation.	Propagated. All burned. Obscuration faster than PCT1 (11.66 min). Reached the first peak HRR (255 BTU/s) at ~11 minutes and the second (265 BTU/s) at ~28 minutes. It took longer than 5 minutes to reach 70 BTU/s.
PCT1	Transient	Vertical	UQ	0.69	Doors closed. Vent grills on door	185	11, 40	Similar to ST10. Higher total fuel loading due to larger cabinet floor area. Loading per square meter of the cabinet floor area was the same.	Propagation. Peak HRR and obscuration at ~12 minutes. Fire did not burn as fast as ST10.
Heptane Pool, Propylene Burner, No Circuits.									
Test 21	Gas burner	Benchboard	Propylene	N/A	Front ventilation grill and open backdoor.	516	5, 20	To provide data with known heat source and rate to use in validating enclosure inst, previous test results and fire models.	Peak HRR of 489 BTU/s was reached within 4 minutes.
Test 22	Gas burner	Benchboard	Propylene	N/A	Front ventilation grill and open backdoor.	1000	10, 14	Same as test 21, except the burner was programmed to grow to 1000 kw in 8 minutes.	Peak HRR of 948 BTU/s was reached within 8 minutes.
PCT4	Heptane	Vertical	Heptane	N/A	Doors open	1900	15, 25	This test was done to evaluate the effect of a very large fire on room and adjacent cabinet temp. Since it was impractical (and unrealistic) to put twice as many cables as PCT2, 15 gallon of heptane with surface area of 10 ft ² was used.	(a) Radiation from the cabinet walls to adjacent cabinet dominates, (b) single cabinet will burn differently than a cabinet with adjacent cabinets, (c) cabinets with a single wall (as opposed to double with air gap) result in damaging temperature in adjacent cabinet.

**Table G-7
Transient Ignition Sources**

Test	Fuel Package	Composition	Peak HRR	Total Heat Content	Comment
SNL - Nowlen Test #5	12" x 16" x 12" cardboard box (.395 kg) 3" stack folded computer paper (6.8 kg) Crumpled paper (.680 kg)	Total 7.9 kg (17.4 lb) 5% cardboard 86% folded paper 9% crumpled paper	26 kW (25 BTU/s)	12,350 (BTU)	Very little of the folded paper burned.
SNL - Nowlen Test #6	12" x 16" x 12" cardboard box (.395 kg) 3" stack folded computer paper (6.8 kg) Crumpled paper (.680 kg)	Total 7.9 kg (17.4 lb) 5% cardboard 86% folded paper 9% crumpled paper	21 kW (20 BTU/s)	9,500 (BTU)	Very little of the folded paper burned.
LBL - Von Volkinburg, 3 airline trash bags	Three 11 gal. polyethylene trash bags (.035 kg, estimated) 36 polystyrene cups (.21 kg, estimated) 51 paper cups (.45 kg, estimated) Paper towels (2.73 kg)	Total 3.5 kg (7.7 lb) 3% polyethylene 6% polystyrene 13% paper cups 78% paper towels	351 kW (333 BTU/s)		One of four tests used as the basis for FIVE's recommended HRR for transient fires.
LBL - Von Volkinburg, 2 airline trash bags	Two 11 gal. polyethylene trash bags (07 kg, estimated) 24 polystyrene cups (.14 kg, estimated) 38 paper cups (.30 kg, estimated) Paper towels (1.82 kg)	Total 2.3 kg (5.2 lb) 3% polyethylene 6% polystyrene 13% paper cups 78% paper towels	297 kW (282 BTU/s)	70,678 (BTU)	One of four tests used as the basis for FIVE's recommended HRR for transient fires.

**Table G-7
Transient Ignition Sources (Continued)**

Test	Fuel Package	Composition	Peak HRR	Total Heat Content	Comment
LBL - Von Volkinburg, 1 airline trash bag	11 gal. polyethylene trash bag (.035 kg, estimated) 12 polystyrene cups (07 kg, estimated) 17 paper cups (.15 kg, estimated) Paper towels (.91 kg)	Total 1.2 kg (2.6 lb) 3% polyethylene 6% polystyrene 13% paper cups 78% paper towels	159 kW (151 BTU/s)	45,941 (BTU)	One of four tests used as the basis for FIVE's recommended HRR for transient fires.
SNL - Nowlen Test #8	5 gal. polyethylene trash can (.771 kg) Polyethylene liner (.035 kg) Cotton rags (.46 kg) Paper (.34 kg)	Total of 1.6 kg (3.5 lb) ~50% polyethylene ~28% cotton rags ~21% paper	24 kW (23 BTU/s)	23,911 (BTU)	Fire developed quickly in the crumpled paper packing. This caused melting of the plastic wastebasket and eventual development of a fairly steady plastic pool fire.
SNL - Nowlen Test #7	5 gal. polyethylene trash can (.771 kg) Polyethylene liner (.035 kg) Cotton rags (.46 kg) Paper (.34 kg)	Total of 1.6 kg (3.5 lb) ~50% polyethylene ~28% cotton rags ~21% paper	12 kW (11 BTU/s)	53,200 (BTU)	The trash can overturned during the test and approximately 1/2 the paper and packing material spilled out. It was primarily this material which actually burned during the test.
SNL - Nowlen Test #3	2.5 gal polyethylene bucket (.788 kg) 16 oz box of Kimwipes (.562 kg) 1 qt acetone (.747 kg) Polyethylene wash bottle (.079 kg)	Total 2.2 kg (4.8 lb) 40% polyethylene 26% tissue paper 34% acetone	145 kW (138 BTU/s)	23,750 (BTU)	During Test 3, the acetone spilled from the bucket approximately 6 minutes after ignition, resulting in a large flash of burning acetone. This type of behavior was not observed in Test 4, or any of the cabinet fire tests (Chavez) which used this ignition source. When this spike in the HRR is removed (See NUREG/CR-4679, Figure 50b), the peak HRR is about 34 kW (32 BTU/s).

**Table G-7
Transient Ignition Sources (Continued)**

Test	Fuel Package	Composition	Peak HRR	Total Heat Content	Comment
SNL - Nowlen, Test #2	12" x 16" x 12" cardboard box (.395 kg) 16 oz box of Kimwipes (.562 kg) 1 qt acetone (.747 kg) Polyethylene wash bottle (.079 kg)	Total of 1.78 kg (3.9 lb) 22% cardboard 32% tissue paper 42% acetone 4 % polyethylene	109 kW (104 BTU/s)	35,150 (BTU)	
SNL - Nowlen, Test #1	12" x 16" x 12" cardboard box (.395 kg) 16 oz box of Kimwipes (.562 kg) 1 qt acetone (.747 kg) Polyethylene wash bottle (.079 kg)	Total of 1.78 kg (3.9 lb) 22% cardboard 32% tissue paper 42% acetone 4 % polyethylene	97 kW (92 BTU/s)	45,600 (BTU)	
SNL - Nowlen Test #4	2.5 gal polyethylene bucket (.788 kg) 16 oz box of Kimwipes (.562 kg) 1 qt acetone (.747 kg) Polyethylene wash bottle (.079 kg)	Total 2.2 kg (4.8 lb) 40% polyethylene 26% tissue paper 34% acetone	34 kW (32 BTU/s)	46,550 (BTU)	
SNL - Chavez Screening Test #5	2.5 gal polyethylene bucket (.788 kg, estimated) Polyethylene wash bottle (.079 kg, estimated) 16 oz box of Kimwipes (.455 kg) 1 qt acetone (.747 kg, estimated)	Total 2.1 kg (4.6 lb) 40% polyethylene 22% tissue paper 36% acetone	32 kW (30 BTU/s)	68,500 (BTU)	Chavez performed five screening tests involving two fuel packages. Only the HRR for Test #5 is reported in the reference document. HRRs for the other tests are reported to be less severe than test #5.

**Table G-7
Transient Ignition Sources (Continued)**

Test	Fuel Package	Composition	Peak HRR	Total Heat Content	Comment
SNL - Chavez Screening Test(s)	Computer paper box (.395 kg, estimated) 16 oz box of Kimwipes (.455 kg) 1 qt acetone (.747 kg, estimated)	Total 1.6 kg (3.5 lb) 25% cardboard 28% tissue paper 47% acetone	<32 kW (<30 BTU/s)	29,200 (BTU)	This fuel package may also contain a polyethylene container for the acetone. Chavez performed five screening tests involving two fuel packages. Only the HRR for Test #5 is reported in the reference document. HRRs for the other tests are reported to be less severe than test #5.
LBL - Von Volkinburg 30 lb wood crib	Wood pieces, White fir (13.65 kg) Wood excelsior, shredded and fluffed (.45 kg) Absolute ethyl alcohol (.118 l) (~.75 kg, estimated)	Total ~14.9 kg, estimated (32.8 lb) 92% wood 3% excelsior (wood shavings) 5% ethyl alcohol	327 kW (311 BTU/s)	30,811 (KCal)	The wood pieces were 1-1/4" x 1-1/4" x 15" in size. The precise arrangement of the sticks is not reported. The wood excelsior was spread on the floor under the wood crib and soaked in alcohol to provide a uniform ignition source for the wood.
LBL - Von Volkinburg 20 lb wood crib	Wood pieces, Douglas fir (9 kg) 100 cc (.95 qt) JP-4 (~.75 kg, estimated)	Total 9.75 kg (21.5 lb) 92% wood 8% JP-4	217 kW (206 BTU/s)	26,752 (KCal)	The wood pieces were 1-1/4" x 1-1/4" x 15" in size, arranged in eight layers of five sticks each.
LBL - Von Volkinburg, 14 lb wood crib	Wood pieces, Douglas fir (6.36 kg) 100 cc (.95 qt) JP-4 (~.75 kg, estimated)	Total 7.1 kg (15.6 lb) 90% wood 10% JP-4	186 kW (177 BTU/s)	17,590 (KCal)	The wood pieces were 1-1/4" x 1-1/4" x 14" in size, arranged in eight layers. The two bottom layers have two sticks each, and the other six layers have four sticks each.
NBS - Lee, Clothing	4.5 kg clothing	4.5 kg (9.9 lb) 100% textile	60 kW (57 BTU/s)	N/A	Clothing piled .3 m high on the floor. Lee notes that this HRR is low compared to fuel packages with similar packing densities. He states: "The reason for this low rate was that fire penetration into the piles of clothes and fabrics was limited by the pile height of 0.3 m. Consequently, pyrolysis of the combustibles at depths greater than 0.3 m, which certainly happened for the other trash fires [i.e., Cline and Von Volkinburg] could not occur and contribute to these fires."

Table G-7
Transient Ignition Sources (Continued)

Test	Fuel Package	Composition	Peak HRR	Total Heat Content	Comment
NBS - Lee, fabric	2.7 kg fabric	2.7 kg (5.9 lb) 100% textile	50 kW (48 BTU/s)	N/A	Fabric piled .3 m high on the floor. See comment about HRRs for Lee, clothing.
SNL - Nowlen Test #9	30 gal. polyethylene trash can (3.6 kg) Polyethylene liner (.035 kg) Paper (1.5 kg)	Total of 6.4 kg (14.1 lb) 57% polyethylene 23% paper	50 kW (48 BTU/s) during the first 15 minutes when the fuel was paper, cotton, and plastic. 113 kW (107 BTU/s) in the last 40 minutes when the fuel was primarily a liquid plastic pool	192,000 (BTU)	Within 15 minutes of ignition, the waste basket had melted away almost entirely leaving a pile of burning paper, cotton, and plastic. . . Shortly thereafter, this pile of burning material toppled resulting in a surge in fire intensity. As the packing material burned away a liquid plastic pool fire became the dominant mode of burning. This pool fire continued to burn for an additional 40 minutes, flaring up to high intensities twice during that period.
LBL - Von Volkinburg, Rubbish bag	Straw and grass cuttings (1.55 kg) Eucalyptus duff (2.47 kg) 32 gal polyethylene trash bag (.04 kg)	Total 4.1 kg (9 lb) 38% straw and grass cuttings 61% eucalyptus duff >1% polyethylene	343 kW (325 BTU/s)	93,000 (BTU)	One of four tests used as the basis for FIVE's recommended HRR for transient fires.
SNL - Cline Test #4	Rags (11.4 kg) Paper towels (7.7 kg) Plastic products (gloves and tape) (5.9 kg) Methyl alcohol (5.9 kg) Two 40 gal. polyethylene trash bags (.07 kg, estimated)	Total of ~31 kg (68 lb) ~37% rags ~25% paper towels ~19% plastic products ~19% methyl alcohol <1% polyethylene	119 kW (113 BTU/s)	N/A	Contents divided equally between the two trash bags. See comment for Cline Test #3.
SNL - Cline Test #11	Rags (11.4 kg) Paper towels (7.7 kg) Plastic products (gloves and tape) (5.9 kg) Methyl alcohol (5.9 kg) Two 40 gal. polyethylene trash bags (.07 kg, estimated)	Total of ~31 kg (68 lb) ~37% rags ~25% paper towels ~19% plastic products ~19% methyl alcohol <1% polyethylene	119 kW (113 BTU/s)	N/A	Contents divided equally between the two trash bags. See comment for Cline Test #3.

**Table G-7
Transient Ignition Sources (Continued)**

Test	Fuel Package	Composition	Peak HRR	Total Heat Content	Comment
SNL - Cline Test #3	Crumpled computer paper (9.1 kg) 2 polyethylene trash bags (.07 kg, estimated)	Total 9.2 kg (20 lb) 99% paper 1% polyethylene	109 kW (104 BTU/s) See comment.	N/A	Nowlen says that Cline's HRRs are unreliable. "The data gathered and reported as a part of the Ignition Source Fire Tests [Cline] included the oxygen depletion levels in the test enclosure. However, subsequently identified problems with the test setup have indicated that these values are in significant error. The oxygen concentration values reported by Cline are considered to significantly underestimate the actual levels of oxygen depletion during these tests. [Low oxygen depletion values would result in underpredicted HRRs.] It is therefore inappropriate to attempt to use these values to estimate the HRRs of the test fires." (Nowlen, NUREG/CR-4679)
SNL - Cline Test #5	Crumpled computer paper (13.6 kg) Two 50 gal. plastic trash cans (15 kg)	Total 28.6 kg (63 lb) 48% paper 52% plastic	109 kW (104 BTU/s)	N/A	See comment for Cline Test #3.
SNL - Cline Test #10	Crumpled computer paper (13.6 kg) Two 50 gal. plastic trash cans (15 kg)	Total 28.6 kg (63 lb) 48% paper 52% plastic	109 kW (104 BTU/s)	N/A	See comment for Cline Test #3.

**Table G-7
Transient Ignition Sources (Continued)**

Test	Fuel Package	Composition	Peak HRR	Total Heat Content	Comment
<p>LBL - Von Volkinburg,</p> <p>6.6 liter wastebasket</p>	<p>6.6 liter polyethylene trash container (.23 kg)</p> <p>12 quart size paper milk cartons coated with polyethylene (.45 kg)</p>	<p>Total .68 kg (1.5 lb)</p> <p>34% polyethylene</p> <p>66% poly-coated paper</p>	64 kW (61 BTU/s)	N/A	<p>Half the milk cartons were opened and stacked upright in the trash container to form tubes. The other half were torn into pieces and placed within the tubes formed by the upright milk cartons. This datum was discarded for the same reasons as LBL - Von Volkinburg 121 liter wastebasket. If this datum had not been discarded, it would have been classified as "human occupancy trash." It's omission does not significantly change the HRR profile for that bin.</p>
<p>SNL - Cline</p> <p>Test #9</p>	<p>Crumpled computer paper (4.6 kg)</p> <p>Folded computer paper (31.8 kg)</p> <p>Two polyethylene trash bags (.07 kg estimated)</p>	<p>Total 36.5 kg (80 lb)</p> <p>13% crumpled paper</p> <p>87% folded paper</p> <p><.5% polyethylene</p>	40 kW (38 BTU/s)	N/A	See comment for Cline Test #3.

Table G-8
Properties of Selected Materials

Fuels	Heat of Combustion MJ/kg	Ideal Mass Loss Rate kg/s-m ²	Combustion Efficiency	HRR kW/m ²
Solid Fuels				
Cardboard boxes	18	0.014	0.7	176
Polyethylene (PE)	43.4	0.026	0.88	993
Polypropylene	43.2	0.024	0.89	923
Polystyrene	39.8	0.034	0.69	934
Polyurethane	23-28	0.025	0.65	–
Plyvinyl Chloride (PVC)	16.4	0.016	0.35	92
Wood (Typical values)	18	0.011	0.7	139
Stored Commodities				
Wood pallets	per m of height			2250
Wood or PMMA				
Vertical surface	per m ² of surface			250
Horizontal surface	per m ² of surface			750
Polystyrene (Solid)				
Vertical surface	per m ² of surface			650
Horizontal surface	per m ² of surface			1350
Polypropylene (Solid)				
Vertical surface	per m ² of surface			450
Horizontal surface	per m ² of surface			800
Cardboard cartons				
Compartmented	stacked 4.6 m high			1700-4200
w/PE bottles	stacked 4.6 m high			6200-7600
w/PS bottles	stacked 4.6 m high			14000-20900
w/PVC bottles	stacked 4.6 m high			3400-7000
Metal lined	stacked 4.6 m high			2800
Polyurethane board	stacked 4.6 m high			1900-3200

Properties in Table G-8 are obtained from references G.12 and G.13.

This section provides examples of the applied recommended HRR values for the different types of electrical cabinets in commercial NPPs. The information in these examples may be used for assessing the applicability of the recommended values. Visual observations of representative cabinet types in the plant of study are recommended.

- 4160V Switchgear: The switchgear cabinet in Figures G-2 through G-5 is vertically divided into three compartments separated by metal partitions that cover the height of the cabinet but are not airtight. The back compartment contains the busbar and power cable. The primary combustible is the insulation on the power cables. The center compartment contains little combustibles. The control circuits are located in the front compartment. The control wiring is tightly bundled on one side of the front compartment. Because of the single bundle control wiring and separation of the control and power cables in separate compartment, the fire in the switchgear will remain confined to a single bundle and the distribution with 65 kW and 200 kW as the 75th and 98th percentiles can be assumed if the cables are qualified.
- 480V MCC: Figures G-6 and G-7 show a typical MCC. This MCC consists of “buckets” that contain the electrical components and a single wireway that runs through the right side of this MCC from top to bottom. The cables in the wireway are mostly bundled with single wires coming off and feeding individual components in the bucket. The main combustibles are confined to the tightly bundled cables in the wireway. Therefore, the MCCs of this type with qualified cable are considered to satisfy the criteria established for a 65 kW HRR as the 75th percentile. In contrast, if the cabinet has unqualified cable, and assuming a closed door, a value of 220 kW would be assigned as the 75th percentile.

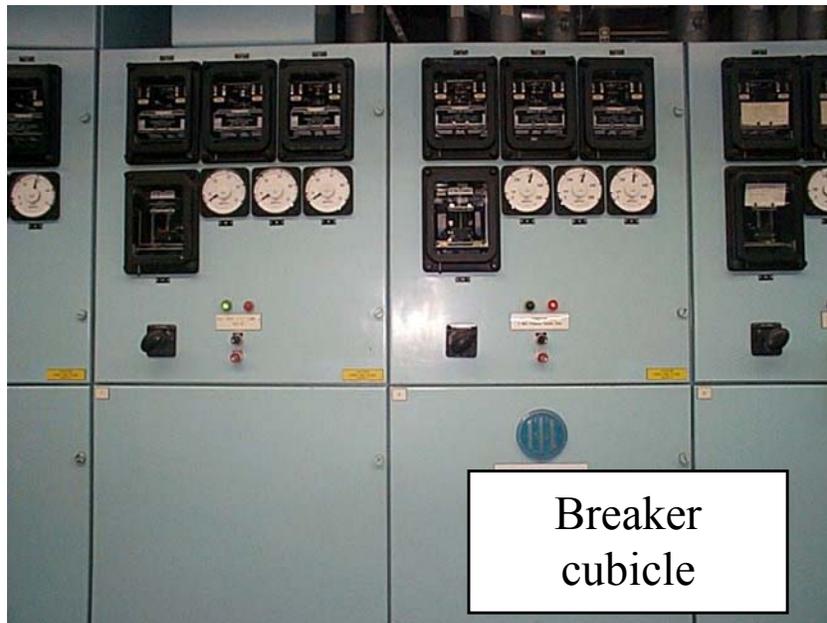


Figure G-2
4.16 kV Switchgear (Front)

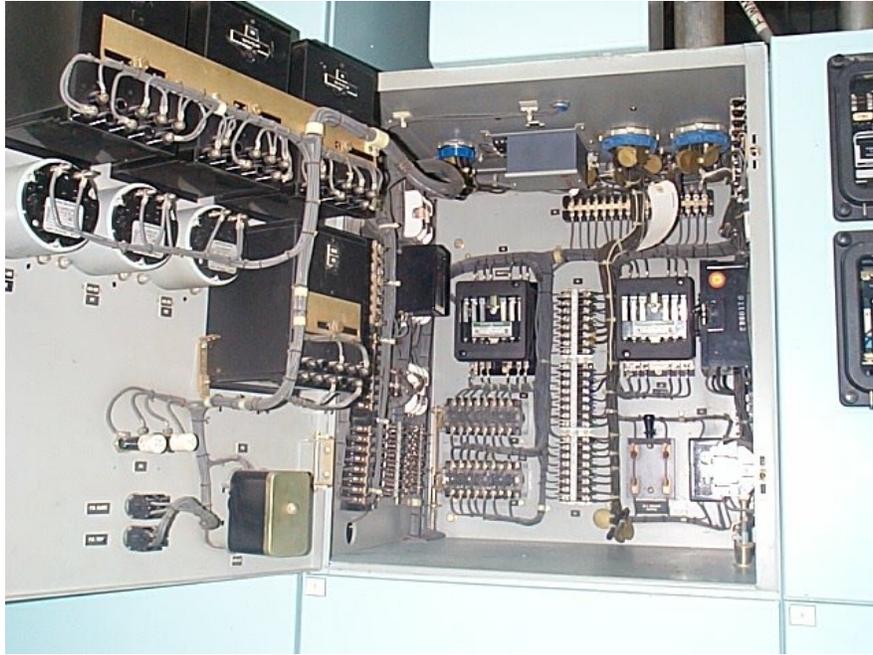


Figure G-3
4.16 kV Switchgear (Front Panel, Open)

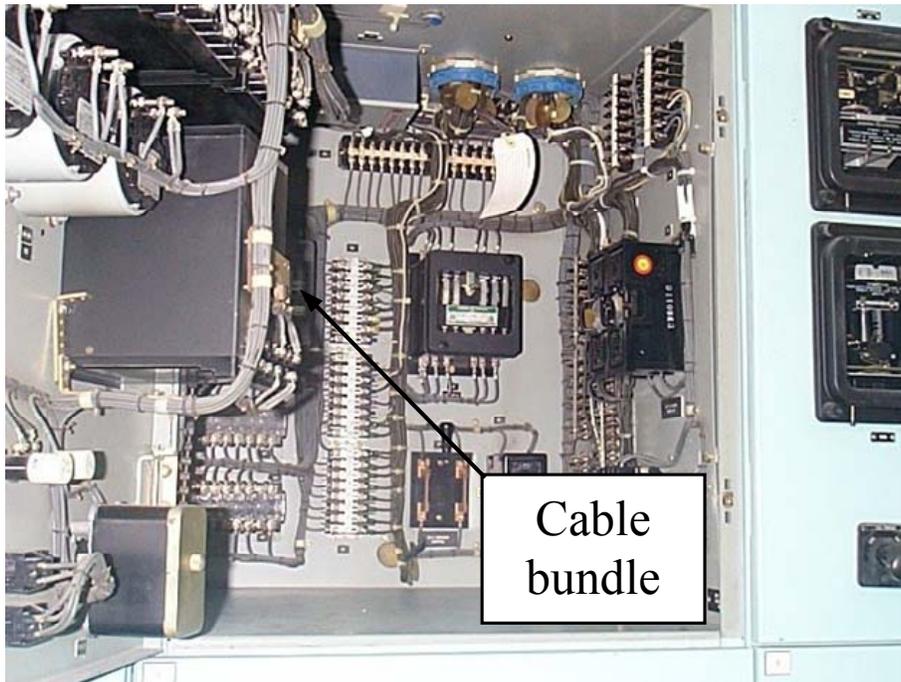


Figure G-4
4.16 kV Switchgear (Front Panel, Open)



Figure G-5
4.16 kV Switchgear (Rear Panel)



Figure G-6
480 V MCC (Front)

- Distribution Panel: Figures G-7 and G-9 illustrate a free-standing cabinet with low combustible loading in two bundles one on either side of the cabinet. The breaker box located in the center of the cabinet separates the bundles. The breakers are installed inside a metal casing. The bundles exit the top of the cabinet through separate penetrations. However, a few cables do mix from the two bundles at the top of the cabinet. The distribution panel of this configuration with qualified cable is considered to satisfy the criteria established for a 65 kW as the 75th percentile HRR because of separation of the two tightly bundles by more than 3' and low combustible loading.

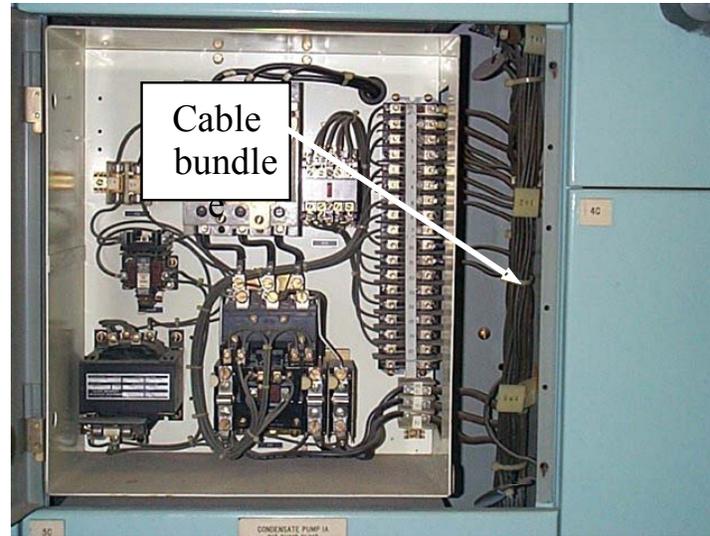


Figure G-7
480 V MCC (Open)



Figure G-8
Distribution Panel (Front)



Figure G-9
Distribution Panel (Front)

- **480V Switchgear:** The configuration of the 480V switchgear (Figures G-10 through G-13) is similar to the 4KV switchgear in that the power and control sections are separated. The control section is similar to the 4KV switchgear in that the control wiring is tightly bundled on one side of the front compartment. Most of the sources of ignition (i.e., relays and switches) are located in the control side of the switchgear. The power in the rear compartment runs through cables that are bundled and separated. Since there are sources of ignition in this rear panel (contacts, etc), and two qualified cable bundles are observed (Figure G-13), a value of 200 kW is recommended as the 75th percentile. A value of 220 kW as the 75th percentile would have been assigned for this close cabinet with unqualified cable.
- **Inverter:** The inverter (Figures G-14 and G-15) was selected for this category as the limiting configuration since they are more likely to contain multiple bundles. This inverter is a medium-sized cabinet, which contains low amount of combustibles. Control wiring is limited and more bundled, but does traverse horizontally. The cabinet is vented on the top. The cabinet also contains breakers, switches and instruments. The configuration of this inverter is not similar to any of the tested configurations in the Sandia or VTT tests. Horizontal cables may help propagation of fire inside the cabinet where vented top prevents formation of hot gases. The inverter, however, could exhibit HRR in excess of 65 kW if fully involved. Based on the overall approach described in this section, a value of 200 kW as the 75th percentile is recommended if cables are qualified.



Figure G-10
480 V Switchgear (Front)



Figure G-11
480 V Switchgear (Rear Panel)



Figure G-12
480 V Switchgear (Rear Panel)

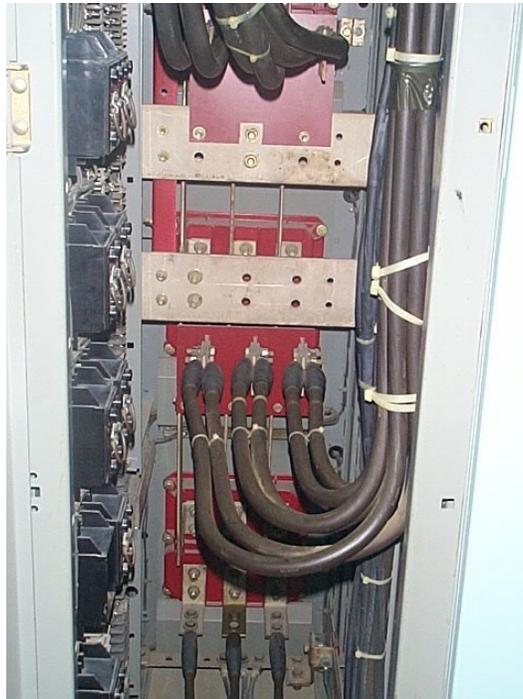


Figure G-13
480 V Switchgear (Rear Panel)



Figure G-14
Inverter (Front)



Figure G-15
Inverter (Inside Front Panel, Top Portion)

- Control panel: There are generally three different sizes of control cabinets:
 - Small, wall-mounted cabinets that are fully enclosed. These are located throughout the plant as local controllers for one or more pieces of equipment. They contain little combustibles and are screened as nondamaging ignition sources.
 - Medium-size cabinets that can be enclosed or vented. These cabinets are the most typical of the floor-based control cabinets. Some of these cabinets contain a single bundle of cables located at one side of the cabinet. Others contain two bundles of cables, one on each side of the cabinet (separated by 3' or more). A small number of wires, however, may traverse throughout the cabinet for connections to the components. The panel generally has a vent near the top of the cabinet, which will prevent accumulation of hot gases at the top of the cabinet and ignition of the other bundle. Therefore, the fire will remain confined to one bundle, which allows the use of 65 kW for the 75th percentile with qualified cable.
 - Large walk-through control cabinets. Figures G-16 through G-19 show the Waste Disposal Control Panel as a sample of such cabinets. These cabinets are generally vented and may contain two or more bundles of cables distributed throughout the cabinet. It is assumed that a fully involved fire inside one of these panels can generate a HRR in excess of 65 KW (e.g., 190 KW).

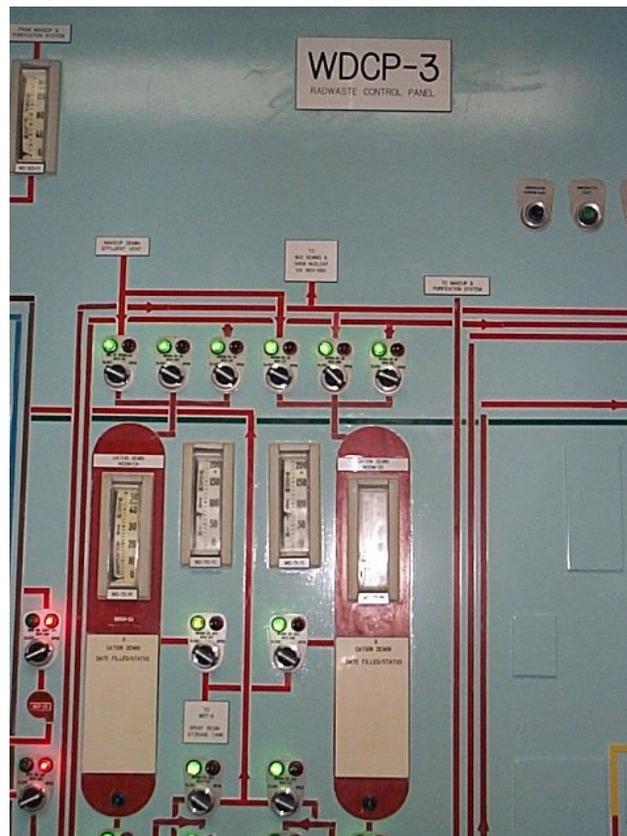


Figure G-16
Control Panel (Front)

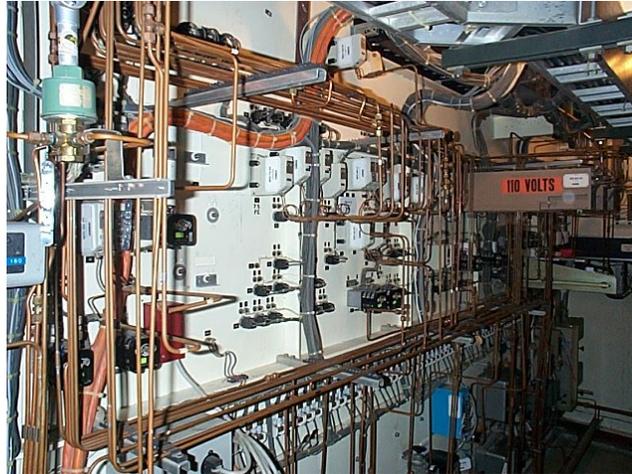


Figure G-17
Control Panel (Inside the Front Panel)

Another example of relatively large walk-through control cabinets in the main control board, which has a geometry similar to the benchboard cabinets tests reported in NUREG/CR 4527. Figure G-20 shows an example of a main control board.

- Relay Rack: Figures G-21 and G-22 depict a sample of relay cabinets. This cabinet contains two tightly bundled wires, one on each side of the cabinet, with terminal boards mounted on each side of the cabinet. Wires run between the bundle and the terminal board. Wires traversing across the rack from one side to another are kept at a minimal. The bundles are about 5' apart. The cable bundles, however, do come together at the top and bottom of the cabinet. The configuration of the selected relay rack does not preclude involvement of both cable bundles and those at the top, and thus precludes use of 65 KW.



Figure G-18
Control Panel (Rear Access)

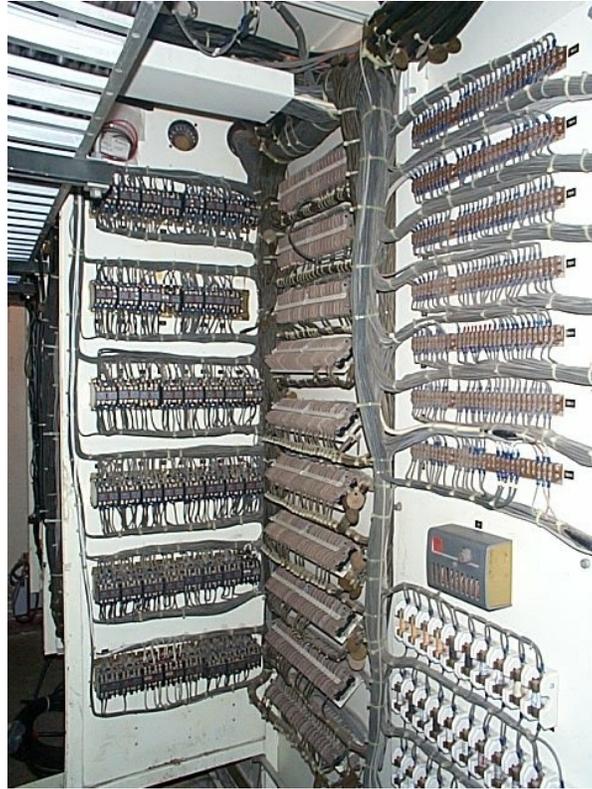


Figure G-19
Control Panel (Back of the Rear Face)



Figure G-20
Example of a Main Control Board



Figure G-21
Relay Rack (Front)



Figure G-22
Relay Rack (Cable Bundles)

G.8 References

- G.1. Mowrer, F. "The Right Tool for the Job," *Fire Protection Engineering*. Winter 2002, Issue No. 13. Page 39.
- G.2. NUREG/CR 4527 "An Experimental Investigation of Internally Ignited Fires in Nuclear Power Plant Control Cabinets" Volumes 1 & 2.
- G.3. Mangs, Johan and Keski-Rahkonan, Olavi, *Full Scale Experiments on Electronic Cabinets, Technical Research Center of Finland*. VTT Publications 186 and 269, Espoo, Finland, 1996.
- G.4. Gottuk, D, White, D., "Liquid Fuel Fires," Chapters 2-15, *SFPE Handbook of Fire Protection Engineering*, 3rd Edition.
- G.5. Babrauskas, V., "Burning Rates," Section 3, Chapter 3-1, *SFPE Handbook of Fire Protection Engineering*, 3rd Edition, National Fire Protection Association, Quincy, Massachusetts, 2002.
- G.6. Altman, G., Pfiffer, R., "Fire Protection Aspects of Transformers in Electrical Plants" *Siemens Power Engineering VI* (1984), pp. 194-198.
- G.7. Khan, M.M., Characterization of Liquid Fuel Spray Fires: Factory Mutual Research Corporation Norwood, Massachusetts, HTD-Vol. 223, Heat and Mass Transfer in Fire and Combustion Systems, The Winter Annual Meeting of ASME, Anaheim, California, Nov. 8-13, 1992.
- G.8. Alber, Friedrich, Altman, Gerhard, and Pfiffer, Richard, "Fire Behavior of Liquid-Immersed Distribution Transformers," *Siemens Power Engineering & Automation*, Vol. 8, no. 3, May-Jun. 1986, pg. 198-204.
- G.9. Przybyla, Leon, Gandhi, Pravinray, "Flammable Liquids in Plastic Containers," *Fire Journal (Boston)*, Vol. 84, no. 3, May-Jun. 1990, pg. 38-39, 41-43.
- G.10. Tewarson, A., Pion, R.F., "Flammability of Plastics. I. Burning Intensity," *Combustion and Flame*, Vol. 26, pg. 85-103.
- G.11. Cote, Arthur E. (editor), Linville, Jim L. (Editor), *Fire Protection Handbook 16th Edition*, NFPA, Quincy, MA, 1986, pg. 5-120.
- G.12. Babrauskas, V., "Free Burning Fires," *Fire Safety Journal*, 11 (1986), 33 to 51.
- G.13. Tewarson, A., "Generation of Heat and Chemical Compounds in Fire," *SFPE Handbook of Fire Protection Engineering*, P. DiNenno, ed., 1988, 1-179 to 1-199.

Appendix H

**Appendix for Chapters 8 and 11,
Damage Criteria**

H

APPENDIX FOR CHAPTERS 8 AND 11, DAMAGE CRITERIA

This appendix provides damage and/or ignition criteria for targets typically considered in nuclear power plant fire scenarios.

H.1 Electrical Cables

The different damage and/or ignition criteria for cables are described in the following sections.

H.1.1 Generic Cable Damage and Ignition Criteria

The identification of nearest ignition and damage targets will most often involve the identification of cables as both ignition and damage targets. Often the same cable will represent both targets. For cables, the ignition and damage criteria will be assumed to be the same.

Generic heat flux and temperature criteria for damage and/or ignition are identified in Table H-1. The criteria are specified for two major cable types, thermoset (TS) and thermoplastic (TP). These generic criteria are appropriate for use in the initial screening analysis and when the actual cable type is not known. In the case of a cable raceway housing a mixture of TP and TS cables, the damage criteria for thermoplastic should be applied. (This presumes that ignition of a thermoplastic cable would quickly compromise co-located thermoset cables).

Table H-1
Damage Criteria for Electrical Cables – Generic Screening Criteria for the Assessment of the Ignition and Damage Potential of Electrical Cables [See Ref 8-1]

Cable Type	Radiant Heating Criteria	Temperature Criteria
Thermoplastic	6 kW/m ² (0.5 BTU/ft ² s)	205°C (400°F)
Thermoset	11 kW/m ² (1.0 BTU/ft ² s)	330°C (625°F)

Additional rules for application in the target identification task are:

- Cables in conduit will be considered potential damage targets, but not ignition targets.
- Cables in conduit will not contribute to fire growth and spread. The conduit will be given no credit for delaying the onset of thermal damage.

- Cables coated by a fire-retardant coating will be considered as both thermal damage and fire spread targets. No credit is given to the coating for delaying or preventing the onset of damage and/or ignition. However, coatings may be assumed to slow the subsequent spread of fire.
- When identifying damage targets, do not include components directly within or associated with the fire ignition source itself. The fire ignition source will be inherently assumed damaged given any fire involving itself as the source, so further evaluation of the components as damage targets is unnecessary.
 - Example: For an electrical panel fire, all equipment and components within the panel will be assumed to fail. Per the counting methodology, a panel will be defined as a distinct vertical section in this context.
 - Example: Given a self-ignited cable fire, all cables in the initiating raceway will be assumed to fail immediately on fire ignition (time zero).

H.1.2 Mixed Cable Insulation/Jacket Type Configurations

There are cables formulated with a thermoset insulation and a thermoplastic jacket, and, potentially, vice-versa. Armored cables may have a bare metal armor exposed, or either a thin thermoset or thermoplastic covering over the metallic armor. For such cases, some special consideration is needed.

In the assessment of whether to treat a cable as a thermoset or thermoplastic, the weakest link will dominate. For example, a cable with a thermoset insulation and a thermoplastic jacket will be treated using the failure criteria of a thermoplastic cable to reflect the reduced resistance to ignition of the jacket material. A cable with a thermoplastic insulation and a thermoset jacket will also be treated as a thermoplastic, due to the likelihood of melting of the insulation material.

Table H-2 provides a decision matrix for the selection of which failure/ignition property set to apply to a given cable.

H.1.3 Thermoplastic Jacketed, Thermoset Insulated Cables

In the specific case of a cable with TS insulation and a TP jacket or cover, a decision should be made as to which ignition/damage criteria should apply. The decision will hinge on whether or not a TP fire might develop in the immediate vicinity of the cables themselves.

The decision matrix in Table H-2 assumes that for a mixed material configuration, the TP material will be the limiting factor. If the insulation is TP, then melting of the insulation will cause failure. If the jacket is TP, then ignition of the jacket may lead to flames engulfing the cable and to a rapid failure of the TS insulation. Hence, for the general case, the failure criteria for TP materials apply for mixed configurations.

Table H-2
Cable Properties Decision Matrix for Mixed Cable Insulation/Jacket Configurations
[See Ref 8-1]

Cable Construction/Configuration		Ignition/Damage Parameter Set to be Used
Insulation Type	Jacket/Covering Type	
TS	TS	TS
TS	TP	See Sect. H.1.3
TP	TS	TP
TP	TP	TP
Armored – TS	TS, or No Cover	TS
Armored – TS	TP Cover	See Sect. H.1.3
Armored – TP	TS, TP, or No Cover	TP

However, in some circumstances, it may be appropriate to apply the TS failure criteria. This would be appropriate only in cases where the analyst can reasonably presume that a thermoplastic fire cannot form in the immediate vicinity of the cables themselves. TP materials are unique from TS materials in that TP materials melt on heating whereas TS materials do not melt. For a TS material, the likely fire behavior will involve melting of the material and formation of a burning pool of liquid material. Flames will linger at the melt front of the TS material as well, but the predominant fire will be the burning pool. In contrast, TS materials burn in place.

Given this behavior, if the cable configuration is such that the melting TP material cannot form a burning pool in the immediate vicinity of the cables, then the presumption that direct flame impingement on the cable would quickly compromise the TS insulation would not apply.

Configurations that would be considered conducive to formation of a fire near the cables would include any of the following:

- A cable tray with a substantial load of cables (i.e., at least one full layer of cables).
- Solid bottom cable trays or cable routing ducts regardless of cable loading. This would include a case where the tray bottom is vented (e.g., slotted or louvered).
- Cable trays with bottom covers (e.g., flame shields or a thermal barrier). This includes cases where the bottom cover is vented (e.g., slotted or louvered).
- Cable trays where a cable tray directly below has a top cover (even if that top cover is vented). For this configuration, distance to the cover of the lower tray is a consideration (is the tray within the flame zone of the pool fire?).

- Cable trays where a cable tray directly below contains a substantial load of cables (such that melt material might collect on top of these cables). For this configuration, distance to the top of the cables in the lower tray is a consideration (is the tray within the flame zone of the pool fire?).
- Cables routed directly above an electrical panel where a pool of burning plastic might form on top of the panel and impinge on the tray. For this configuration, distance to the top of the panel is a consideration (is the tray within the flame zone of the pool fire?).
- Cables in a conduit (TP material can burn within the conduit even though no external flame spread is assumed).
- A cable tray with several cables routed in direct contact with each other or as a tightly packed cable bundle.
- A cable air-drop (assuming a pool might form at the bottom of the air-drop).

Configurations that would not be considered conducive to formation of a fire near the cables include the following:

- A ladder-back cable tray with a sparse load of cables (less than a single layer and with significant gaps between and among the cables present).
- A ladder-back cable tray with maintained spacing of installed cables (maintained gaps between cables and cables in no more than a single layer).

Use of the TP damage/ignition criteria is conservative and does not require specific justification. If the analyst chooses to apply the TS criteria for a mixed configuration, a justification should be provided.

H.1.4 Specific Data for Specific Cable Types

A range of test data exists characterizing failure criteria for specific materials and for some specific cable brands.²² Most of the available data applies to thermoset materials rather than thermoplastic. For further information on this subject, NUREG/CR-6834 Appendix A [H.1] provides an annotated bibliography of fire tests where cable failure behavior was monitored. Material and product specific data may be applied when available.

Application of cable-specific data necessitates knowledge of the cable types located in the target raceway. If a raceway includes a mixture of cable types, the ignition/damage criteria for all cables in the raceway should be based on the limiting cables – that cable with the lowest damage/ignition threshold. The basis for this approach is similar to that discussed in Section H.1.3 relating to raceways or cables with mixed cable types. Ignition of the limiting cables will lead to rapid degradation and failure of any co-located cables.

²² Note that cable ignition and failure thresholds were reported in a series of EPRI reports published during the late 1970s through 1980s, and in various related and subsidiary publications by Factory Mutual Research Corporation through the mid 1990s. These values are no longer considered valid due errors in the data extrapolation methods applied. Examples include EPRI NP-1200, EPRI NP-1767, EPRI NP-1881, and other similar and related reports. While the raw measured data remain valid, the extrapolated “critical heat flux” and “critical temperature” values should not be applied in any fire PRA analysis or application. For further information see SAND88-2161C [H.4].

Tables of material and product specific cable failure thresholds have been published in SAND92-1404C [H.2]. These are reproduced below as Tables H-3 and H-4.

H.1.5 Damage Time Considerations

Sections H.1.1 through H.1.4 present the current data on cable damage thresholds in terms of both temperature and external heat flux. These values characterize the minimum exposure conditions leading to electrical failure for electrical cables. However, it is well known that a cable exposed at the threshold condition may survive for some time before the onset of electrical failure. As the exposure conditions become more severe, the time to damage will decrease. If the exposure conditions are especially severe, electrical failure may occur within less than a minute.

For some applications, it may be desirable to consider the time to electrical failure rather than simply the threshold behavior. This subsection describes current practices for estimating the time to cable damage. Two approaches are discussed. The first approach involves the direct application of fire modeling tools. The second is an empirical approach based on the application of time to damage tables derived from the available experimental data.

H.1.5.1 Direct Fire Modeling of Cable Thermal Response

One approach to assessing cable damage times involves the direct application of fire modeling tools. Some fire models are capable of estimating the transient temperature response of a thermal target such as a cable. Given application of an appropriately validated model of this type, the results can be directly correlated to the time of cable failure. Various computer fire models are known to provide target thermal response modeling capabilities. However, efforts to either catalogue or assess the existing models in this regard are beyond the scope of the Fire Risk Re-quantification Study.

When using the direct modeling approach, it is recommended that the cable failure threshold temperatures described in the preceding sections be interpreted as the cable insulation temperature at which electrical failure will occur. That is, if the cable insulation reaches the failure threshold temperature, failure of the cable should be assumed. Given this interpretation, the time to cable failure equals the time required for the cable insulation to reach the failure threshold temperature.

The input parameter values needed to support the calculations will vary from model to model, but will typically include the thermal characteristics of the target (e.g., thermal emissivity, thermal conductivity, thermal mass, mass thickness, specific heat, etc.) as well as spatial orientation information (e.g., relative proximity to the fire source, elevation of the target in the fire enclosure, line-of site factors that might impact radiant heating, etc.).

Table H-3
Summary of General Material Specific Cable Thermal Damage Criteria as Reported in
Table 6 of Reference H.2

Cable Insulation Material	Reported Failure Temperature Range (°C)	Number of Tested Samples	Recommended Failure Threshold (°C)
Cross-Linked Poly Olefin (XLPO) <i>including</i> the specific subclass Cross-Linked Polyethylene (XLPE)*	299-388	13	299
* for the specific subclass XLPE:	320-388	12	320
Ethylene Propylene Rubber (EPR)	370-400	16	370
Silicone Rubber	396-400	2	396
Kerite FR	372-382	2	372
Polyimide or Kapton	399	1	399

Note: All failure temperatures are based on a failure criterion of less than 100 ohms insulation resistance over 100 meters of cable (100Ω/100m). If a more stringent failure criterion would apply to a given circuit, refer to NUREG/CR-5655 [3] for additional data.

Table H-4
Failure Temperatures for Specific Cable Products as Reported in Table 5 of Reference H.2

Cable Manufacturer	Description of Cable Tested	Failure Threshold (°C)
Brand Rex	Cross-linked polyethylene (XLPE) Insulation, Chlorosulfonated Polyethylene (CSPE) Jacket, 12 AWG, 3-Conductor (3/C), 600 Volt (V)	385
Rockbestos	Firewall III, Irradiation XLPE Insulation, Neoprene Jacket, 12 AWG, 3/C, 600 V	320-322
Raychem	Flamtrol, XLPE Insulation, 12 AWG, 1/C, 600 V	385-388
Samuel Moore	Dekoron Polyset , Cross-Linked Polyolefin (XLPO) Insulation, CSPE Jacket, 12 AWG, 3/C and Drain	299-307
Anaconda	Single Conductors Removed From: Anaconda Y Flame- Guard Flame Retardant (FR) Ethylene Propylene (EP), Ethylene Propylene Rubber (EPR) Insulation, Chlorinated Polyethylene (CPE) Jacket, 12 AWG, 3/C, 600 V	381
Anaconda	Anaconda Flame-Guard EP, EPR Insulation, Individual CSPE Jacket, Overall CSPE Jacket, 12 AWG, 3/C, 1000 V	394
Okonite	Okonite Okolon, EPR Insulation, CSPE Jacket, 12 AWG, 1/C, 600 V	387
Samuel Moore	Dekoron Dekorad Type 1952, Ethylene Propylene Diene Monomer (EPDM) Insulation, Individual CSPE Jackets, Overall CSPE Jacket, 16 AWG, 2/C Twisted-Shielded Pair (TSP), 600 v	370-372
Kerite	Kerite 1977, FR Insulation, FR Jacket, 12 AWG, 1/C, 600 V	372-382
Rockbestos	RSS-6104/LE Coaxial Cable, 22 AWG, 1/C Shielded	278
Rockbestos	Firewall Silicone Rubber Insulation, Fiberglass Braided Jacket, 16 AWG, 1/C, 600 V	396
Champlain	Polyimide (Kapton) Insulation, Unjacketed, 12 AWG, 1/C	399
BIW	Bostrad 7E, EPR Insulation, Individual CSPE Jackets, Overall CSPE Jacket, 16 AWG, 2/C TSP, 600 V	384

Note: All failure temperatures are based on a failure criterion of less than 100 ohms insulation resistance over 100 meters of cable (100Ω/100m). If a more stringent failure criteria would apply to a given circuit, refer to NUREG/CR-5655 [H.3] for additional data.

While the individual materials that make up a typical cable (copper, aluminum, the various polymers, etc.) are generally well characterized, information regarding the thermal characteristics of cables as a composite thermal media is relatively limited. Much of the available information has been developed through studies of cable self-heating and the assessment of cable ampacity limits (or the current carrying capacity of cables). A recently completed review of raceway fire barrier ampacity derating issues and techniques [H.5] provides the following insights:

- Typical practice assumes that cables have relatively high surface emissivity. Typically cited values in the literature range from 0.85 to 0.95. (In the context of thermal heating response, a higher value would increase the rate of temperature risk and would therefore be more conservative.)
- Experiments were conducted to measure the net thermal conductivity (k) of a tightly-bundled cable mass (tightly packed cables with no significant air gaps). Two cable types/sizes were tested. As expected, the cable bundle with the higher percentage of copper (versus polymeric insulation and jacket material) displayed a moderately higher thermal conductivity. The measured values are summarized as follows:
 - 12 AWG, 3-conductor cables: $k = 0.15 \text{ W/m}^{\circ}\text{K}$
 - 8 AWG, single-conductor cables: $k = 0.18 \text{ W/m}^{\circ}\text{K}$

The direct modeling approach presents analytical challenges that, to the knowledge of the current authors, have not been fully addressed. Most fire models that incorporate a target response capability provide only a relatively rudimentary treatment of the target's thermal behavior. This is especially true given the potentially complex features of a cable raceway. Limitations that should be considered include the following:

- Cable installation conditions can vary widely, and those conditions will impact thermal response. Total cable loading, cable packing density, and the extent of air gaps between and among the cables can vary substantially. Simple factors such as the extent of air flow through a cable tray can profoundly impact the thermal behavior of the cables given that fire environments tend to be highly convective.
- Cable raceway features such as top and bottom covers, or solid bottom raceways will not typically be incorporated into the fire modeling tools.
- The location of a specific target cable within a raceway will not typically be known (e.g., the cable of interest may be located on top of a cable tray load, on the bottom, near the center, etc.). In reality, cable position will influence the damage time; however, given the uncertainty a conservative treatment is recommended (i.e., assume cable placement so as to maximize the exposure severity).
- The effect of conduits on cable heating has not been investigated to any great depth. In general, it is recommended that cables in conduits be treated as if they were in the open unless a detailed validation of an alternative approach is provided.

- The initial conditions used in the fire modeling should consider cable self-heating effects for normally energized cables. That is, cable ampacity is limited to prevent cable overheating under normal operating conditions. Most cables used by the U.S. nuclear industry are rated for continuous operation at a maximum cable temperature of 90°C. Actual operating temperatures can vary widely depending on installation conditions and actual current loads. When modeling the thermal response of a normally energized cable, it may be appropriate to assume initial conditions that reflect the cable's normal operating temperature. Reference H.5 provides additional discussion of cable self-heating effects.

H.1.5.2 An Empirical Approach

As an alternative to the direct modeling approach, an empirical approach has been developed. The approach was developed originally for use in the NRC's Fire Protection Significance Determination Process (SDP) [H.6]. Given appropriate treatment of the fire exposure conditions, the same approach might also find application in more general fire PRA.

The primary limitation of this empirical approach is that it assumes steady-state fire exposure conditions. That is, given a constant and continuous fire exposure condition, expressed as either an exposure temperature or an external heat flux, the time to failure for an electrical cable can be estimated. Hence, the method is especially well suited to cases where empirical correlations are being used to characterize fire exposure conditions; for example, where a steady-state plume model is used to predict the temperature at the location of a cable target located in the fire plume. The approach is not well suited to cases where the exposure environment itself varies with time; for example, where a compartment fire model has been used to predict the exposure environment so that exposure conditions vary over time.

A second limitation is that time to damage values have only been developed generically for two broad classes of electrical cable insulation materials; namely, thermoset and thermoplastic.

For thermoset cables, time to damage estimates were based primarily on the data reported in NUREG/CR-5546 for cross-linked polyethylene (XLPE) insulated cables (the Rockbestos Firewall® III product). The data for XLPE cables was compared to the data available for a range of other thermoset cable types. For many cable types, the available data is limited to estimates of the thermal damage threshold with little information on time to damage. It was determined that XLPE bounded the vast majority of thermoset products and was considered reasonably representative of the thermoset class. Polyset® was the one thermoset material identified with potentially lower damage thresholds and times. XLPE was also noted as "the most popular single product used in the U.S. nuclear industry."

For thermoplastic cables, time to damage estimates were based primarily on the data reported in NUREG/CR-5384 for polyethylene (PE) insulated cables. Again, these data were compared to other available data for primarily PE and polyvinyl chloride (PVC) cables, the two predominant thermoplastic materials. In the case of the thermoplastic cables, there was considerable scatter in the data. In particular, very short damage times are reported in some studies even at the lowest exposure temperatures. The reasons for this scatter are not clear. The final values are based on an analysis of the data considered most reliable and do exclude some of these data outliers.

Given the SDP analysis, tables were developed for the time to damage versus exposure temperature and time to damage versus external heat flux for both thermoset and thermoplastic cables. These values are reproduced in Tables H-5 through H-8.

Table H-5
Failure Time-Temperature Relationship for Thermoset Cables
(Table A.7.1 from Reference H.6)

Exposure Temperature		Time to Failure (min.)
°C	°F	
330 ≤ T < 335	625 ≤ T < 634	28
335 ≤ T < 340	634 ≤ T < 642	24
340 ≤ T < 345	642 ≤ T < 651	20
345 ≤ T < 350	651 ≤ T < 660	16
350 ≤ T < 360	660 ≤ T < 680	13
360 ≤ T < 370	680 ≤ T < 700	10
370 ≤ T < 380	700 ≤ T < 716	9
380 ≤ T < 390	716 ≤ T < 735	8
390 ≤ T < 400	735 ≤ T < 752	7
400 ≤ T < 410	752 ≤ T < 770	6
410 ≤ T < 430	770 ≤ T < 805	5
430 ≤ T < 450	805 ≤ T < 840	4
450 ≤ T < 470	840 ≤ T < 880	3
470 ≤ T < 490	880 ≤ T < 915	2
T ≤ 490	T ≥ 915	1

Table H-6
Failure Time-Temperature Relationship for Thermoplastic Cables
(Table A.7.2 from Reference H.6)

Exposure Temperature		Time to Failure (min)
°C	°F	
205 ≤ T < 220	400 ≤ T < 425	30
220 ≤ T < 230	425 ≤ T < 450	25
240 ≤ T < 245	450 ≤ T < 475	20
245 ≤ T < 260	475 ≤ T < 500	15
260 ≤ T < 275	500 ≤ T < 525	10
275 ≤ T < 290	525 ≤ T < 550	8
290 ≤ T < 300	550 ≤ T < 575	7
300 ≤ T < 315	575 ≤ T < 600	6
315 ≤ T < 330	600 ≤ T < 625	5
330 ≤ T < 345	625 ≤ T < 650	4
345 ≤ T < 355	650 ≤ T < 675	3
355 ≤ T < 370	675 ≤ T < 700	2
T ≥ 370	T ≥ 700	1

Table H-7
Failure Time-Heat Flux Relationship for Thermoset Cables (Table A.7.3 from Reference H.6)

External Heat Flux		Time to Failure (minutes)
BTU/ft ² s	kW/m ²	
<1.0	<11	No damage
1.0	11	19
1.2	14	12
1.4	16	6
1.6	18	1
1.75 or greater	20 or greater	1

Table H-8
Failure Time-Heat Flux Relationship for Thermoplastic Cables (Table A.7.4 from Reference H.6)

External Heat Flux		Time to Failure (minutes)
BTU/ft ² s	kW/m ²	
<0.5	<6	No damage
0.5	6	19
0.7	8	10
0.9	10	6
1.0	11	4
1.25	14	2
1.4 or greater	16 or greater	1

H.2 Other Equipment

For major components such as motors, valves, etc., the fire vulnerability will be assumed to be limited by the vulnerability of the power, control, and/or instrument cables supporting the component. For other cases, the following is recommended:

- If a scenario should arise involving solid-state control components as a thermal damage target, the failure criteria to be applied in screening are 3 kWm² (0.25 BTU/ft²) and 65°C (150°F). The criteria for ignition of the components will assume properties similar to thermoplastic cables (0.5 BTU/ft² and 400°F).
- Pipes and water tanks constructed of ferrous metal will be considered invulnerable to fire damage.
- Passive components (e.g., flow check valves) will be considered invulnerable to fire.

H.3 References for Appendix H

- H.1 LaChance, J.L., Nowlen, S.P., Wyant, F.J., Dandini, V.J., *Circuit Analysis - Failure Mode and Likelihood Analysis*, NUREG/CR-6834, SAND2002-1942P, USNRC, Sept. 2003.
- H.2 Nowlen, S.P. and M.J. Jacobus, “The Estimation of Electrical Cable Fire-Induced Damage Limits,” SAND92-1404C, presented at Fire and Materials 1st International Conference and Exhibition, Sept. 24-25, 1992, Washington DC.
- H.3 M. J. Jacobus, G. F. Fuehrer, *Submergence and High Temperature Steam Testing of Class 1E Electrical Cables*, NUREG/CR-5655, SAND90-2629, Sandia National Laboratories, May 1991.
- H.4 Nicolette, V.F., and Nowlen, S.P., “A Critical Look at Nuclear Qualified Electrical Cable Insulation Ignition and Damage Thresholds”, SAND88-2161C, published in Conference Proceedings of the Operability of Nuclear Systems in Normal and Adverse Environments, ANS/ENS, September 1989.
- H.5 Nowlen, S., *Ampacity Derating and Cable Functionality for Raceway Fire Barriers*, U.S. NRC, NUREG/CR-6681, Sandia National Laboratories, SAND2000-1825, August 2000.
- H.6 U.S. NRC, Inspection Manual Chapter 0609, Appendix F, “Fire Protection Significance Determination Process,” February 2005. (Available through the USNRC public website)

Appendix I

**Appendix for Chapter 9, Examples of
Component Circuits Analyses**

I

APPENDIX FOR CHAPTER 9, EXAMPLES OF COMPONENT CIRCUITS ANALYSES

Appendix I demonstrates the circuit analysis procedure for a number of circuits, each with particular and, in some cases, unique features or characteristics. The examples discussed below include the following types of circuits:

- A typical ungrounded DC solenoid operated valve (SOV) control circuit,
- A typical motor operated valve (MOV) control circuit,
- A control circuit employing double-pole isolation switches,
- An ungrounded AC MOV control circuit with contacts on the downstream leg and normal contract arrangement,
- An ungrounded AC MOV control circuit with normal contract arrangement, and
- A MOV with redundant main contactors and fully independent control circuits,
- An ungrounded three-phase power circuit,
- A SOV with alternate contact arrangement.

I.1 Typical SOV Control Circuit

Figure I-1 shows the block diagram for the component SOV. The valve has three cables associated with it; Cables A, B, and C. Figure I-2 shows a schematic of the control circuit for the SOV in its normal operating state (i.e., deenergized, open, with the red status indication lit). The conductors contained within each cable are also noted on the schematic—P00, N00, R00, G00, SV0, SV1, and SV2.

Prior to conducting the circuit analysis, the analyst determines that there were three possible component failure responses of interest:

- Loss of control over the valve (LOC)
- Erroneous status indication (EI)
- Spurious closure of the valve (SO-Close)

The analyst evaluates this circuit on a cable-by-cable basis assuming an energized source (the hot probe) comes into contact with each conductor in the particular cable under study. For example, the hot probe analysis of Cable B is accomplished by first assuming the source conductor comes into contact with conductor P00, then N00, etc. In each case, the analyst determines the logical

response of the circuit when contacted by the postulated source conductor (i.e., hot probe). Contact of a +125 VDC source to P00 has no consequence (“NC”) on the behavior or functionality of the circuit or valve. On the other hand, contact of the +125 VDC source to N00 would likely cause the “-125VDC” fuse to blow, causing a loss of circuit power and thus a LOC condition. Similarly, the hot probe contact with R00 causes no immediate effect on the circuit or valve, but contact with G00 causes the green lamp to light up, thereby resulting in an EI condition. Hot probe contacts with SV1 do not impact the functionality of the SOV because of the isolation provided by the hand switch and the valve position contacts. Contact with SV0, however, energizes the solenoid and causes the valve to close spuriously (SO–Close).

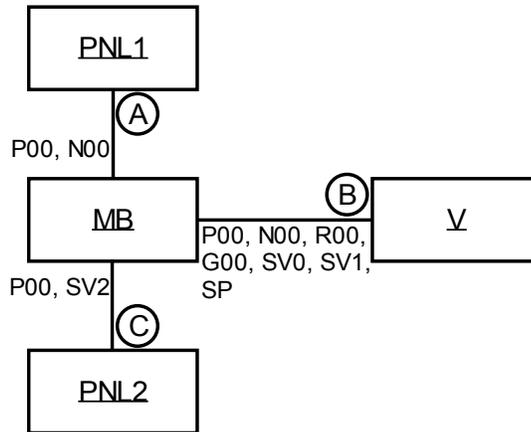


Figure I-1
Block Diagram for Typical SOV Circuit Analysis Example

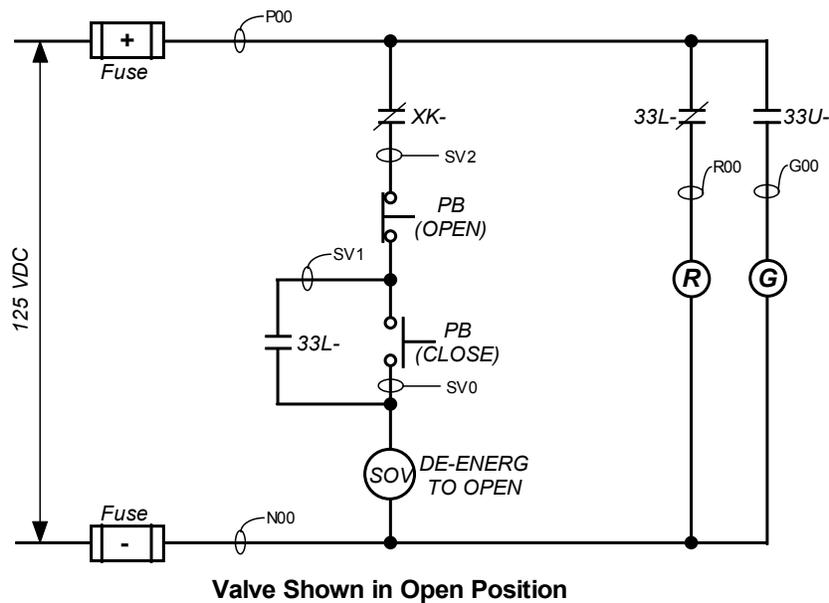


Figure I-2
Electrical Schematic for Typical SOV Circuit Analysis Example

Observe in this case that postulating combinations of hot shorts or hot shorts and grounds within the cables under evaluation does not change the analysis results from a static analysis perspective, and thus the hot probe method is suitable.

Table I-1 shows the results obtained from the hot probe analyses of each cable in the circuit. Note that the scope of this analysis included the investigation of a negative (-125 VDC) energized source as well.

Table I-1
SOV Failure List

Cable	+125 VDC Hot Probe	-125 VDC Hot Probe
A	LOC	LOC
B	LOC, EI, SO - Close	LOC
C	NC	LOC

I.2 Typical MOV Control Circuit

For this example, the MOV control circuit involves only two cables of interest, Cables A and B (see Figure I-3). Assume the failure modes of interest are the same as given for Example I.1, above. Further assume that the initial valve position is open. Note that the power cable for the valve operator (labeled as P) is not a concern, since the valve does not require repositioning. Figure I-4 shows the electrical schematic for the MOV control circuit. Note that the control circuit is a grounded 120 VAC circuit. Thus, the analyst performs the hot probe analysis by assuming a 120 VAC source conductor interacts with each conductor in the cables under study, then by assuming an external ground source does the same.

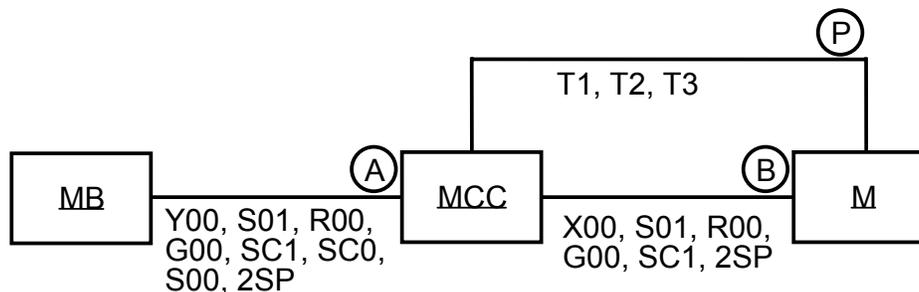


Figure I-3
Block Diagram for Typical MOV Circuit Analysis Example

In the same manner as the analysis of the SOV circuit, the analyst assumes that the 120 VAC source probe contacts the conductors in each cable. For Cable A, contact of the hot probe with Y00 may not have any immediate effect on the circuit, yet it effectively renders the circuit nonfunctional in that should the operator attempt to close the valve, the contactor coil will not operate, because there is no driving potential across it (i.e., 120 VAC on the “upstream” side as well as 120 VAC on the “downstream” side of the operating coil). Interaction of the postulated

120 VAC source conductor with S01 has no immediate impact on the circuit or functionality of the valve. Contact of R00 with the hot probe also has no immediate effect. Touching the hot probe to G00 will induce an erroneous status indication by causing the green lamp to light up. If SC1 becomes energized by the 120 VAC source, no immediate effect is evident; however, if the operator attempts to close the valve, then the valve motor would remain energized until it stalled or a protective device operated (e.g., the overloads). A spurious closure of the valve and subsequent continued motor operation in the close direction occurs if the hot probe contacts SC0. Finally, if S00 is energized, the valve motor would drive continuously in the open direction until it stalled or a protective device operated.

A 120 VAC probing of the conductors in Cable B yields a LOC designation by contact with either S01 or SC1 since the valve would not operate normally due to the limit switches being bypassed. An EI designation results from contact with G00.

Similar to the SOV in Example I.1, postulating a combination of hot shorts or hot shorts and grounds within the cables under evaluation does not change the analysis results from a static analysis perspective; thus, the hot probe method is suitable.

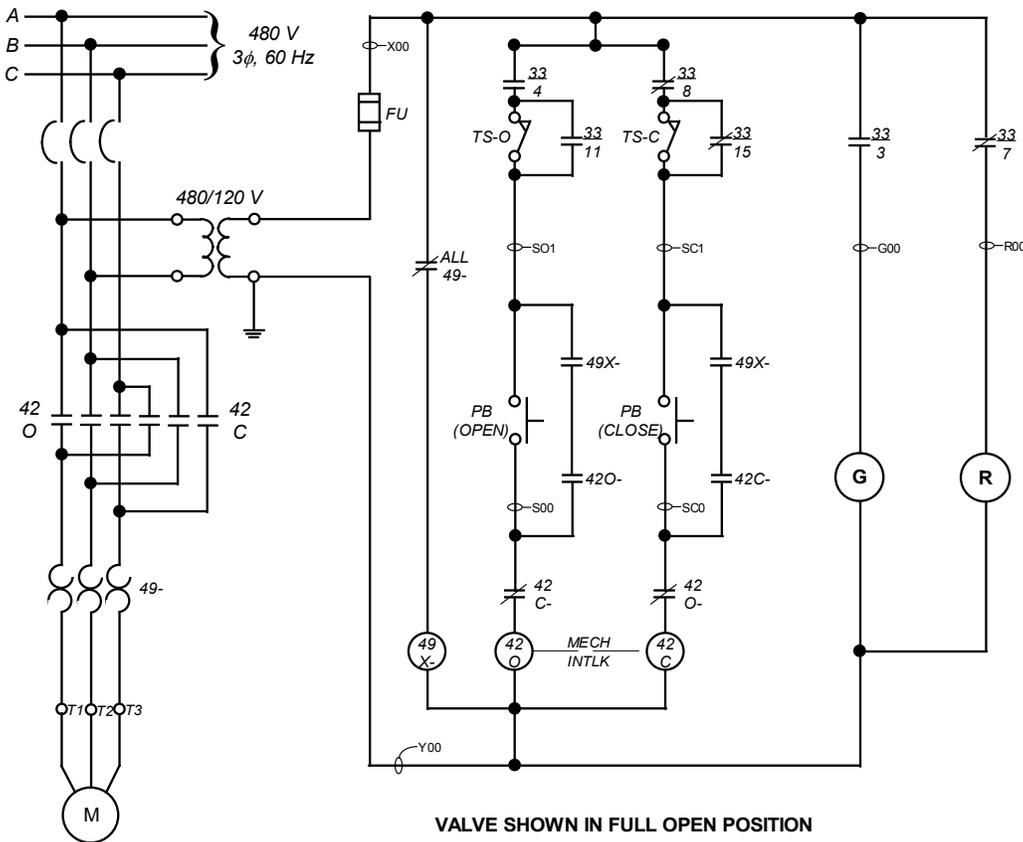


Figure I-4
Electrical Schematic for Typical MOV Circuit Analysis Example

For the grounded probe case, both Cables A and B could result in a LOC situation when the ground touches conductors X00, R00, SC1, S01, S00, or SC0 (Note that the LOC failure for Conductors S01, S00, and SC0 are manifested only when attempting to operate the valve). Table I-2 shows the results of the hot probe analyses for the typical MOV control circuit.

**Table I-2
MOV Failure List**

Cable	120 VAC Hot Probe	Grounded Probe
A	LOC, EI, SO - Close	LOC
B	LOC, EI	LOC

Also note for this valve that certain circuit failures bypass the valve’s limit and torque switches, thereby removing mechanical protection for the valve. Depending on the valve and valve operator design, permanent valve damage or binding could result from the cable failures. Accordingly, the circuit analysis should flag this possibility for consideration when assessing possible recovery action.

I.3 Control Circuit with Double-Pole Isolation Switches

A less common control circuit design is shown in Figures I-5 and I-6. Here, the motor is isolated from the power conductors by a succession of isolation switches. In this case, the motor is used to position a speed control valve on a steam turbine. In normal operation, the operator increases (raises) the speed or lowers it by manipulating a momentary switch. The motor can be operated remotely from the control room or locally at the turbine. Remote or local operation is determined by the position of a manual control transfer switch (Device 43) and the contact positions of a control relay. In either case, the momentary control switch closes two sets of contacts for a “raise” or “lower” command.



**Figure I-5
Block Diagram for Double-Pole Isolation Circuit Example**

The block diagram shows two cables, A and B, associated with the motor. Both of these cables allow for remote operation only. Cable routings for local control are of no interest in this analysis, since all of the cables are local to the equipment. As Figure I-6 indicates, control power is supplied from a ±48 VDC source; thus, the hot probes assumed for analysis of this circuit will consist of one +48 VDC probe and one -48 VDC probe.

For Cable A, contact of the positive hot probe with P01 has no effect on the circuit or functionality of the motor. Putting the +48 VDC probe in contact with N01 disables the motor (LOC) by either initiating overcurrent protection within the ±48 VDC power supply or by negating the driving potential across the motor. By employing the -48 VDC hot probe on P01, the motor is again disabled for the same reason as given above. There is no consequence if it

I.4 Ungrounded AC MOV Control Circuit with Contacts on the Downstream Leg and Normal Contact Arrangement

The block diagram for this ungrounded control circuit is shown in Figure I-7; Figure I-8 shows the circuit schematic. As noted in Figure I-8, the control switches are located on the low side of the operating coils. There is also an interface between the control room panel (MB) and the remote (or alternative) control panel (RSP) through a set of transfer switches (Device 43) located in the transfer switch panel (TSP). Since there is no reference ground, the hot probe analysis will assume sources from both the high (or fused) side of the 120 VAC control power transformer and the low (or return) side.

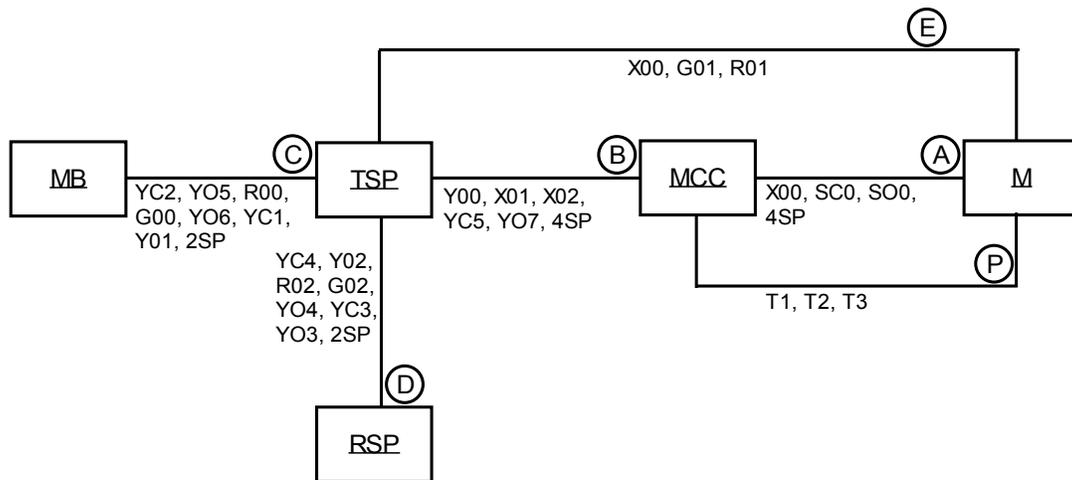


Figure I-7
Block Diagram for Ungrounded, Inverted MOV Control Circuit Example

The block diagram shows five control cables, A through E, associated with the valve motor. In a manner similar to the processes described in the previous examples, the analyst assumes that a source conductor (the 120 VAC high side, for example) makes contact with each conductor in the cable under study, and notes the expected circuit/equipment response. Table I-4 provides the results for this circuit analysis technique for different positions of the transfer switch.

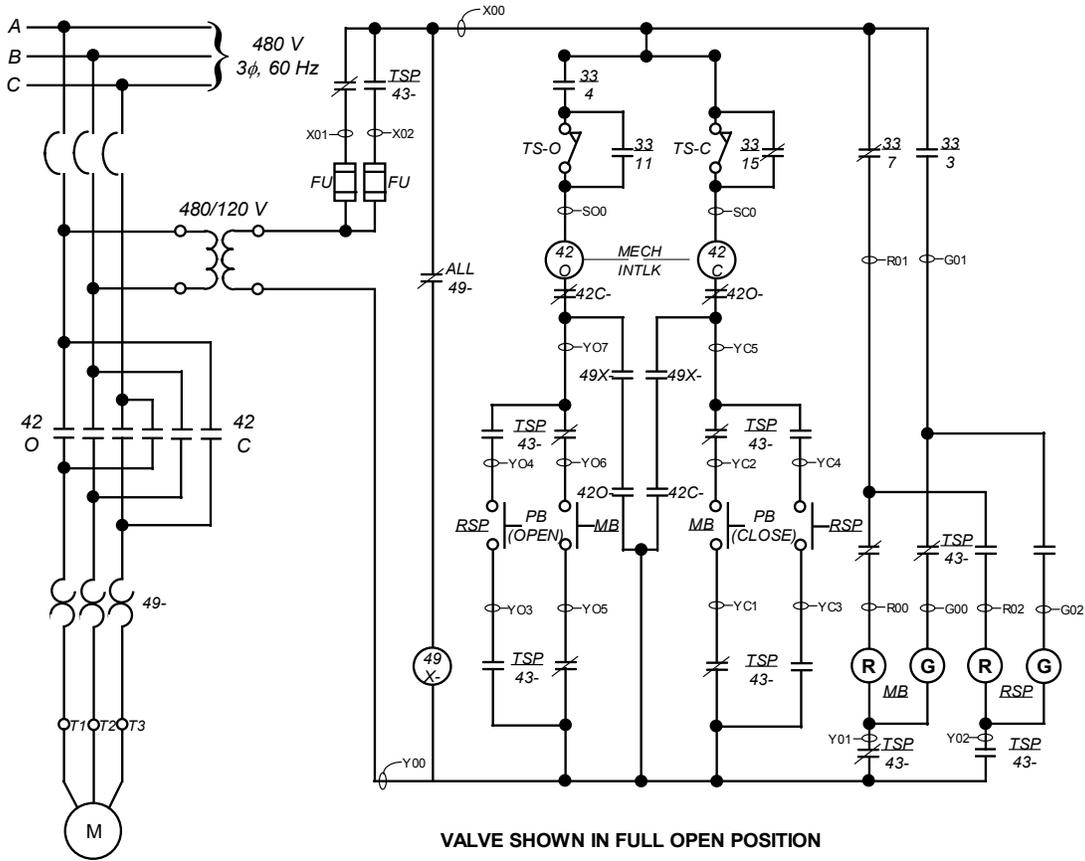


Figure I-8
Electrical Schematic for Ungrounded, Inverted MOV Control Circuit Example

Table I-4
Ungrounded, Inverted MOV Failure List

Cable	Normal Operation		RSP Operation	
	120 VAC (High) Hot Probe	120 VAC (Low) Hot Probe	120 VAC (High) Hot Probe	120 VAC (Low) Hot Probe
A	NC	LOC	NC	LOC
B	LOC	LOC, SO - Close	LOC	LOC, SO - Close
C	LOC, EI	LOC, SO - Close	NC	NC
D	NC	NC	LOC, EI	LOC, SO - Close
E	EI	LOC	EI	LOC

I.5 Ungrounded MOV Control Circuit with Normal Contact Arrangement

Here, the MOV control circuit involves five cables of interest, A through E (see Figure I-9). The cable labeled P is the power cable to the valve motor and is not considered in the circuit analysis for the valve because the example assumes that power is not needed to accomplish the desired function, i.e., the valve is normally closed and desired closed. Figure I-10 shows the electrical schematic for the MOV control circuit. Note that the control circuit is an ungrounded 120 VAC

circuit, thus the analyst will perform the hot probe analysis by assuming sources from first the high (or fused) side of the 120 VAC control power transformer and then the low (or return) side. In this example, the valve is shown in its normally closed position and there is no status indication of the valve position. The principal failure modes of concern are a spurious opening of the valve and a loss of valve control.

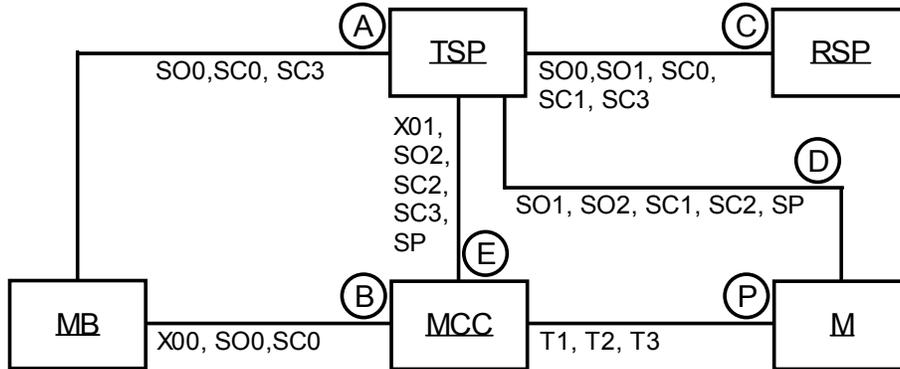


Figure I-9
Block Diagram for Ungrounded MOV Circuit Analysis Example

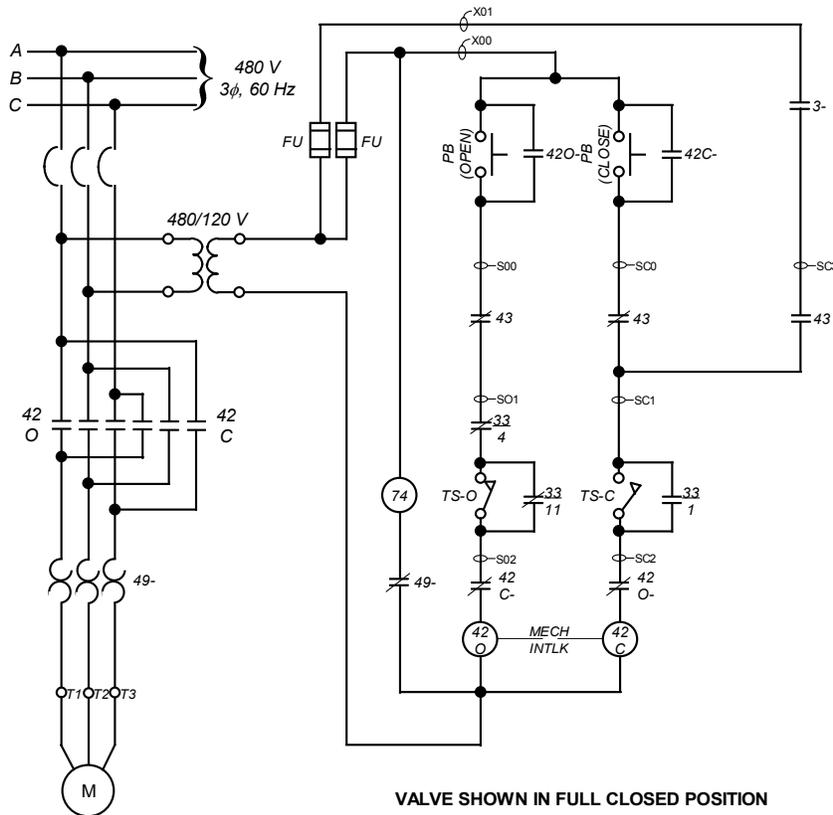


Figure I-10
Electrical Schematic for Ungrounded MOV Circuit Analysis Example

Using the same analysis approach as employed for the ungrounded MOV circuit in Figure I-4, the analyst assumes that the high-side 120 VAC source probe contacts the conductors in each cable. For Cable A, contact of the hot probe with S00 causes the valve to open, contact with SC0 has no immediate effect but can cause the valve to reclose if the operator opens it,²³ and 120 VAC contact with SC3 has no effect. In Cable B, contact of the hot probe with S00 causes the valve to open, contact with SC0 has no immediate effect but can cause the valve to reclose if the operator opens it, and contact with X00 has no effect. Interaction of the 120 VAC source with S01 in Cable C will also cause the valve to open, and contact of the hot probe with SC1 causes the valve to reclose if opened. The remaining conductors in Cable C (S00, SC0, and SC3) behave as discussed previously. Cable D contains conductors S01, SC1, S02, and SC2. A hot probe contact with S01 or S02 causes the valve to open, and contact with SC1 or SC2 causes a reclosing response. In Cable E, probing X01 with the 120 VAC source has no effect, and contact with SC3 will also have no effect; but contact with S02 opens the valve and contact with SC2 forces the valve to reclose.

Touching the low-side 120 VAC hot probe to S00, S01, or S02 (in Cables A, B, C, D, or E) will cause the X00 fuse to blow if the operator attempts to open the valve. Such a circuit response effectively results in a LOC of the valve since the primary control circuit will then be unpowered. Touching the low-side 120 VAC hot probe to X00 or X01 will immediately blow the respective fuse. Table I-5 lists the possible failure modes based on these hot probe analyses for each of the cables for this MOV example. Note that even though this circuit is ungrounded, it is not necessary to postulate multiple concurrent hot shorts to identify the possible failure modes. This is the case because the circuit does not contain double pole control switches as did the circuit of Example I-3.

**Table I-5
Ungrounded MOV Failure List**

Cable	120 VAC (High) Hot Probe	120 VAC (Low) Hot Probe
A	LOC ¹ , SO - Open	LOC
B	LOC ¹ , SO - Open	LOC
C	LOC ¹ , SO - Open	LOC
D	LOC ¹ , SO - Open	LOC
E	LOC ¹ , SO - Open	LOC

¹ Indicates loss of valve control due to unintended reclosing of the valve if opened by the operator, not resulting from a loss of circuit power (i.e., blown fuse).

²³ For the purposes of this example, the unintended reclosing of the valve is being identified as a LOC failure response, as differentiated from the usual “blown fuse” cause for LOC.

I.6 MOV with Redundant Main Contactors and Independent Control Circuits

Figure I-11 shows the block diagram for this valve and Figure I-12 shows its electrical schematic. This configuration is somewhat unique in that the operator must first actuate the permissive circuit (the upper control circuit in Figure I-12) to provide control power to the primary valve control circuit. These two control circuits are routed in two different cables, as indicated in the block diagram (Figure I-11). Similar to the previous MOV examples, the power cable (labeled P) is not of interest. The control circuit is a grounded 120 VAC circuit; thus, the analyst performs the hot probe analysis by first assuming a 120 VAC source conductor interacts with each conductor in the cables under study, then by assuming an external ground contacts each conductor in turn.

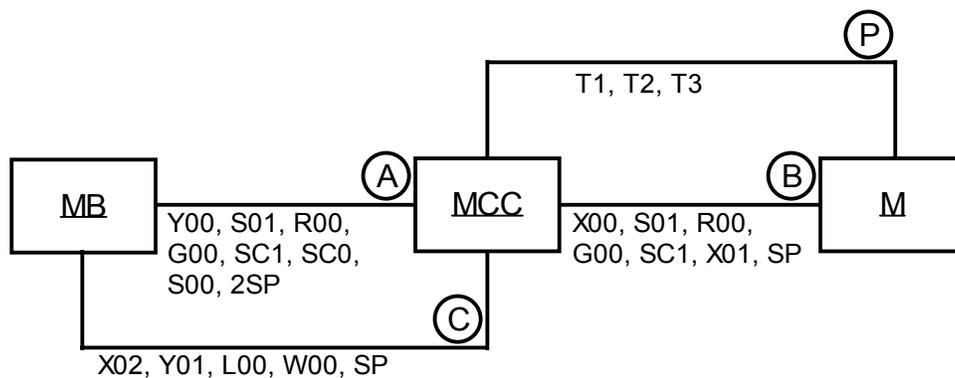


Figure I-11
Block Diagram for MOV with Independent Control Circuits Example

For Cable A, contact of the hot probe with Y00 may not have any immediate effect on the circuit, yet it effectively makes the circuit nonfunctional in that, should the operator attempt to close the valve, the contactor coil will not operate, since there is no driving potential across it (i.e., 120 VAC on the upstream side as well as 120 VAC on the downstream side of the operating coil). Interaction of the 120 VAC source conductor with S01 has no immediate impact on the circuit or functionality of the valve. Contact between R00 and the hot probe also has no immediate effect. Touching the hot probe to G00 induces an EI by causing the green lamp to light. If SC1 is energized by the 120 VAC source, no immediate effect is evident; however, if the operator were to close the valve, the valve motor will remain energized until it stalled or a protective device operates (e.g., the overloads) or the operator opens the key switch (KS) in the permissive control circuit. No spurious operation of the valve in the closed direction occurs if the hot probe comes into contact with SC0, since the Device 42 contactors on the power leads to the valve motor remain open. However, the possibility of such a spurious operation will be documented along with the caveat that it needs the concurrent actuation of the Device 42 in the companion permissive circuit to be realized. Similarly, if S00 is energized, the valve motor does not operate unless the permissive circuit coil (42-) is also actuated. Grounding SC0 or SC1 makes the valve inoperable, and ground contact on R00 immediately causes the fuse to blow and disables power to the primary circuit.

An energized hot probe making contact with X00 or X01 in Cable B has no effect. The response of the other conductors (S01, R00, G00, and SC1) is the same as described for Cable A. The grounding probe causes an immediate LOC (by blowing the fuse) if it contacts X00, X01, or R00. Contacting SC1 with the ground probe makes the valve inoperable.

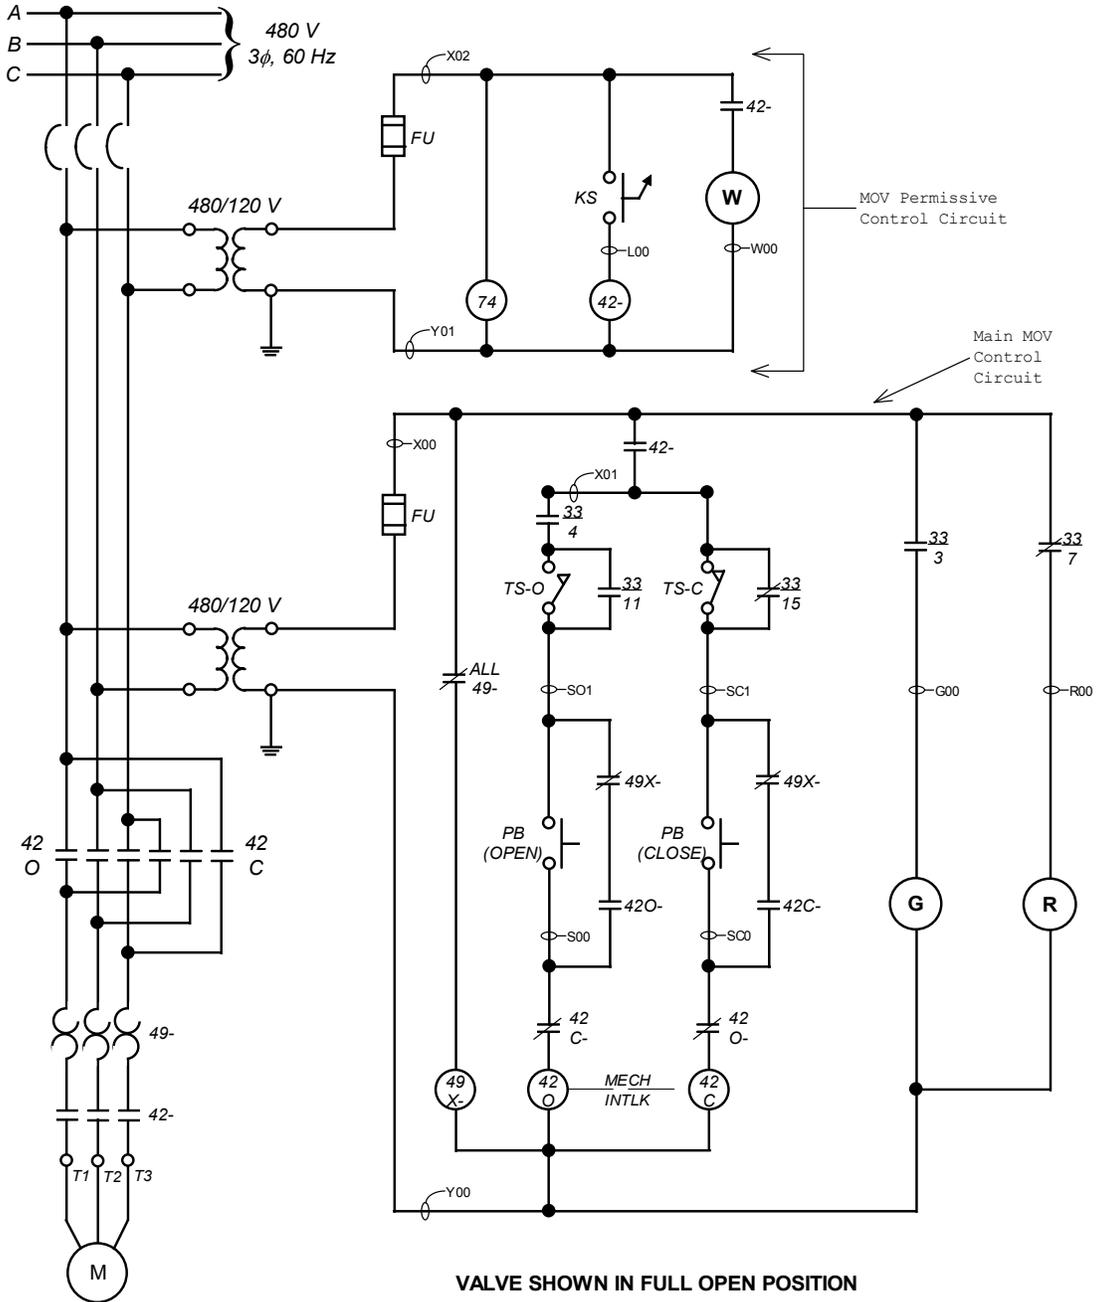


Figure I-12
Electrical Schematic for MOV with Independent Control Circuits

Cable C causes the permissive circuit fuse to blow if X02 is grounded. The circuit becomes inoperable since the 42- device permissive can no longer be activated. A ground on L00 will yield the same outcome if the operator actuates the KS key switch. A hot probe contact with L00 causes the 42- coil to actuate; however, this in and of itself will not cause the valve to spuriously open.

Table I-6 shows the results of the hot probe analyses for this particular MOV control circuit. Observe that concurrent hot shorts are considered for this analysis.

Table I-6
MOV with Independent Control Circuits Failure List

Cable	120 VAC Hot Probe	Grounded (Hot) Probe
A	LOC, EI, SO - Close ¹	LOC
B	EI	LOC
C	LOC, EO, SO ²	LOC

¹ Requires the concurrent actuation of the permissive circuit coil (Device 42) in order to occur.

² Spurious operation of the Device 42 contactor coil only, not a spurious operation of the valve.

I.7 Ungrounded Three-Phase Power Supply

Figure I-13 shows an example of an ungrounded three-phase power supply to a motor. For the purpose of this example, the function of the motor is not important. It is assumed that this equipment is determined to be within the scope of the detailed circuit analysis on the basis that the motor has been classified as a “high-consequence” component by the systems analysts. It is determined that the circuit breaker for this motor is locked open in order to prevent a control circuit failure from causing inadvertent operation. However, as shown in the figure, if an energized power source (another three-phase cable, for example) shorts to the motor’s power cable such that the phases are correctly matched, then the motor is subject to spurious operation. The analysis is no more extensive than recognizing the possibility of this unique situation and “flagging” it for consideration by the PRA analysts.

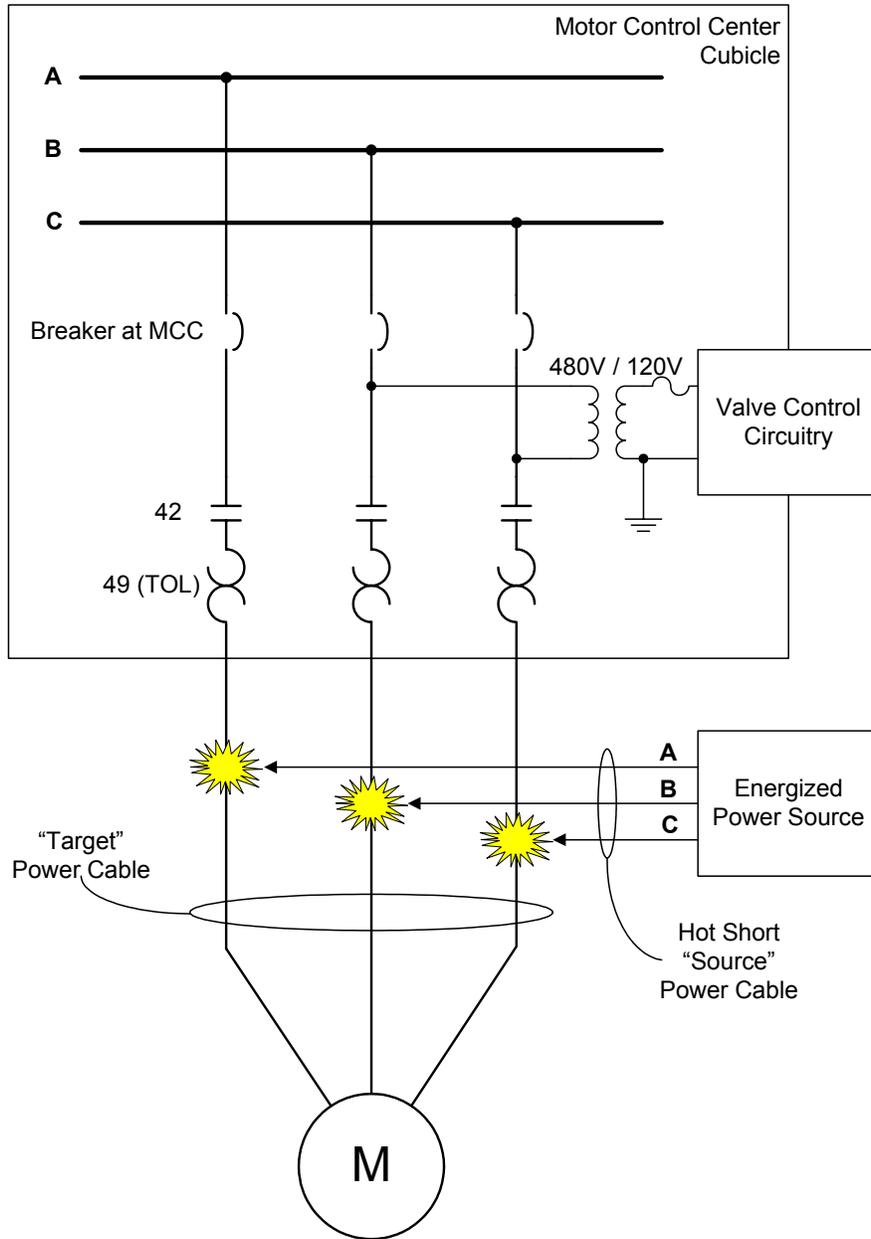


Figure I-13
Ungrounded Three-Phase Motor Power Supply

I.8 Simple SOV Circuit with Alternate Contact Arrangement

Figure I-14 shows a simple SOV circuit with the valve position contacts downstream of the position indication lamps. Here the only cable of concern contains the three conductors S1, R1 and G1. The valve is shown in its normal, de-energized position. For this example, the only circuit failure of interest is a spurious valve energization. By applying the hot probe method to this circuit, the analyst determines the only means for causing a spurious operation is by applying a positive DC voltage (here assumed to be +125 V) to the S1 conductor.

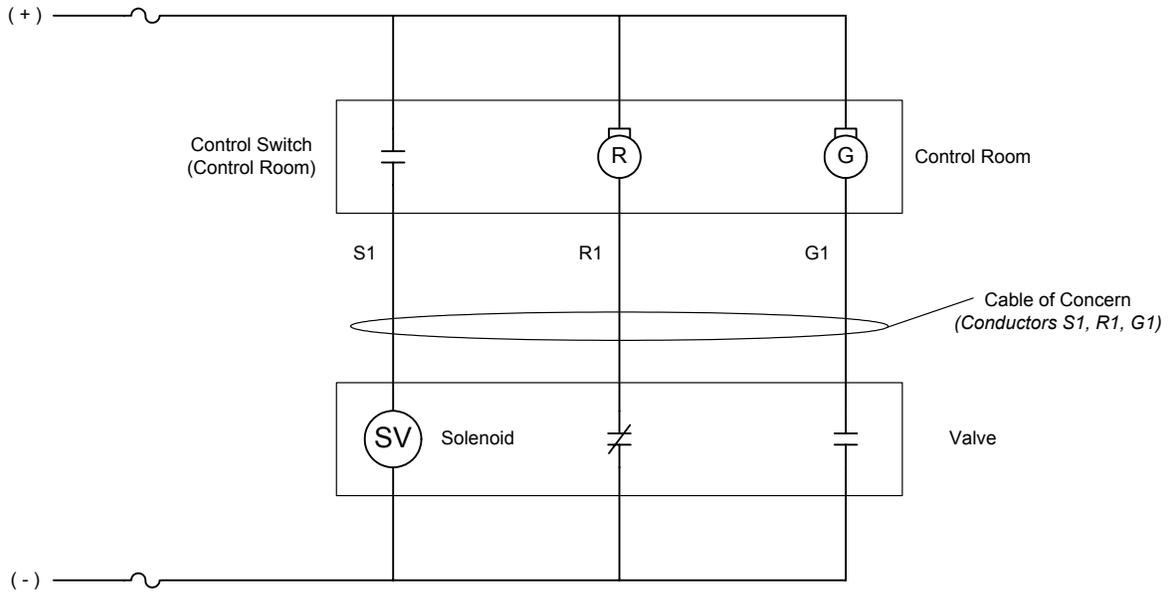


Figure I-14
Simple SOV Circuit with Alternate Contact Arrangement

Table I-7 shows the results of the hot probe analyses for this particular MOV control circuit. Observe that concurrent hot shorts are not required to produce a spurious actuation for this circuit since the control switch is a single-pole design.

Table I-7
MOV with Independent Control Circuits Failure List

Cable	+125 VDC Hot Probe	-125 VDC Hot Probe
A	SO – Open, EI	LOC, EI

Appendix J

**Appendix for Chapter 10, Technical Basis for
Circuit Failure Mode Likelihood Equations**

J

APPENDIX FOR CHAPTER 10, TECHNICAL BASIS FOR CIRCUIT FAILURE MODE LIKELIHOOD EQUATIONS

J.1 Computational Probability Estimates

This method involves application of the Circuit Failure Mode Probability Estimation Formulas. The likelihood of occurrence for a specific failure mode (P_{FM}) is estimated by using the formula

$$P_{FM} = CF \times P_{CC}$$

Where:

- P_{FM} = The probability that a specific hot short failure mode of interest will occur in a specific circuit given a fire of sufficient intensity to cause cable damage,
- P_{CC} = The probability that a conductor-to-conductor short will occur prior to a short-to-ground or short to a grounded conductor, and
- CF = A configuration factor applied to P_{CC} to accounts for the relative number of source conductors and target conductors. Target conductors are those conductors of a circuit that, if contacted by an electrical source of proper magnitude and voltage, will result in abnormal energization of the circuit, component, or device of concern. Source conductors represent energized conductors that are a potential source of electrical energy.

J.1.1 Estimating P_{CC}

P_{CC} is a probability factor that accounts for the likelihood of conductor-to-conductor faults occurring before a conductor-to-ground fault. A conductor-to-ground fault could be a short directly to a grounded surface (e.g., conduit, tray, steel member, etc.), or a short to an intentionally grounded conductor (i.e., the neutral or common conductor of a circuit). The predicted outcome is the same in either case. For an energized conductor, fault current will flow, causing a circuit overcurrent protective device (circuit breaker or fuse) to actuate. For a non-energized conductor, the ground fault places the grounded conductor in a benign state, since any subsequent fault to an energized conductor will behave as a short-to-ground, as described above²⁴.

²⁴ This argument is not strictly true for ungrounded systems because earth ground does not provide a free return path for fault current to the reference ground. A dead short only develops when an energized conductor touches a reference ground conductor of the ungrounded system.

P_{CC} is calculated as follows:

For cables in trays:
$$P_{CC} = (C_{Tot} - C_G) / [(C_{Tot} - C_G) + (2 \times C_G) + 1].$$

For cables in conduit²⁵:
$$P_{CC} = (C_{Tot} - C_G) / [(C_{Tot} - C_G) + (2 \times C_G) + 3],$$

Where:

C_{Tot} = The total number of conductors in the cable of interest (including spares), and

C_G = The number of grounded (or common) conductors in the cable of interest.

The bases for the P_{CC} formulas are as follows.

1. The probability factor is based on a ratio of grounded and ungrounded conductors. Intuitively, the likelihood of a hot short increases as the number of grounded conductors decreases. Conversely, the likelihood of a short-to-ground increases as the proportion of grounded conductors in a cable increases. In electrical terms, the effective ground plane is increased as the proportion of grounded conductors increases.
2. The formulas are based on the number of conductors in an individual cable. In other words, the formulas do not consider inter-cable shorts. The rationale for considering only intra-cable faults in this factor is as follows.
 - The NEI/EPRI and SNL test data [10.1, 10.2] clearly indicate that, for multi-conductor cables, intra-cable faults generally occur before inter-cable faults, especially with thermoset cable. This is not to say that inter-cable faults (i.e., cable-to-cable faults) will not occur, only that they will most likely occur after intra-cable faults.
 - The test data also indicates that inter-cable faults are at least an order of magnitude less likely than intra-cable faults for thermoset cable. Thus, they have at best a secondary or tertiary effect.
 - Since P_{CC} is a ratio of conductors, it is reasonable to assume that external cables surrounding the cable of interest will have conductor ratios similar to the cable of interest. Hence, even if these cables were specifically accounted for, it is unlikely that the overall ratio would be significantly changed.
 - In practice, it is not feasible to characterize which cables are next to each other throughout a raceway.
3. Grounded conductors are given a weighting factor of 2. This factor accounts for the observed bias that exists for grounded conductors. Energized conductors have a stronger affinity to the grounded conductors because they represent the path of least resistance for the electrical energy as it strives to achieve its most stable state. The factor of 2 was chosen based on judgment and appears to agree with the available data.

²⁵ Armored and shielded cable should use the equation for conduit.

4. Cable trays and conduits represent a ground return path for circuits in which the reference ground is tied to earth ground. The formulas treat these short-circuit paths as simply additional grounded conductors. The fire test data [10.1, 10.2] shows that the external ground plane becomes an increasingly insignificant ground path as the number of conductors in a multi-conductor cable increases. A conservative factor of 1 is used for cable tray. The NEI/EPRI and SNL test data showed a stronger influence of the ground plane for cable in conduit. Thus, a factor of 3 has been selected for cables in conduit. For ungrounded AC and DC systems (e.g., typical Class 1E 125 VDC safety system), these factors should be omitted from the formulas as shown in the below equation since the ground plane does not provide a current return path:

$$P_{cc} = (C_{Tot} - C_G) / [(C_{Tot} - C_G) + (2 \times C_G)],$$

Where C_G represents the number of return conductors to the power source associated with the circuit of interest (e.g., the negative polarity conductors for an ungrounded 125 VDC circuit).

- The formulas are not dependent on the insulating material. The test data reveals distinctive differences in the behavior of the cables based on insulation type; however, none of the observable differences influence this factor.
- Note that the formulas work for a single conductor as well as for multi-conductor cable. For example, P_{cc} for a seven-conductor cable routed in tray with one (1) grounded conductor is:

$$P_{cc} = (7 - 1) / [(7 - 1) + (2 \times 1) + 1]$$

$$P_{cc} = 6 / 9$$

$$P_{cc} = 0.67$$

Table J-1 gives P_{cc} for several different cable configurations and internal ground conductors. This table is intended to give a general “feel” for the values; it is not by any means all-inclusive. As expected, the calculated probability of the first failure being a conductor-to-conductor fault increases with the number of conductors in the cable and decreases as the number of grounded conductors increases.

Table J-1
P_{cc} Probability Factors

Cable Parameters		P _{cc}	
Total Conductors (C _{Tot})	Grounded Conductors (C _G)	Tray	Conduit or Armored Cable
1	0	0.50	0.25
2	1	0.25	0.17
3	1	0.40	0.29
5	1	0.57	0.44
	2	0.38	0.30
7	1	0.67	0.55
	2	0.50	0.42
8	1	0.70	0.58
	2	0.55	0.46
	3	0.42	0.38
9	1	0.73	0.62
	2	0.58	0.50
	3	0.46	0.40
15	2	0.72	0.65
	3	0.63	0.57
	5	0.48	0.44

J.1.2 Calculating CF

Not all conductor-to-conductor hot shorts result in a spurious operation (presumed failure mode of interest). A conductor-to-conductor fault might cause an indicating light to falsely illuminate; the fault might be to a spare conductor, and thus cause no effect; or it might cause the circuit to fail in the desired state. Only a certain combination of conductors have the ability to initiate a particular circuit failure mode (e.g., spurious actuation). The CF adjusts P_{cc} to account for the combinations of conductors with the potential to initiate a specific failure mode.

The conductors of interest for this factor are the source conductors and target conductors. Source conductors are those conductors expected to be energized at the onset of the event. They possess sufficient electrical energy to cause a spurious actuation should one of these conductors make electrical contact with a target conductor. A target conductor is the conductor(s) of the circuit of interest that, if contacted by a source conductor, will transmit the electrical energy to the device or component of concern, thus causing the component or device to become energized. This spurious energization results in an undesired change in position or state of the component.

CF is calculated as follows:

$$\text{For non-armored cables: } CF = (C_T \times [C_S + (0.5 / C_{Tot})]) / C_{Tot}$$

$$\text{For armored cables: } CF = (C_T \times C_S) / C_{Tot}$$

Where:

C_S = The total number of source conductors in the cable under evaluation,

C_T = The total number of target conductors in the cable²⁶, and

C_{Tot} = The total number of conductors in the cable.

Note: CF should be ≤ 1.0 . If the calculated value of CF is greater than 1, then set $CF = 1$. In practical applications it is highly unlikely that the calculated value of CF will ever exceed 1. For this to occur, virtually all conductors in the cable would need to be either a source conductor or target conductor.

The bases for the CF formula are as follows:

1. The formulas offer a simplistic means of accounting for differences in the proportion of conductors within a cable that pose a concern, either because they are a source conductor or a target conductor.
2. The term $(0.5/C_{Tot})$ for non-armored cable accounts for external source cables that could initiate a spurious actuation due to inter-cable shorting. Although the NEI/EPRI test data shows that inter-cable shorts do occur, their statistical significance for a spurious actuation appears to decrease rapidly as the number of conductors in a cable increases. Thus, this term has been defined so that it has a fairly significant impact for 1-conductor cable, and then decreases in significance as the total number of conductors in the cable of interest increases.. For armored or shielded cables, it is not considered credible that external source cables could reach a target cable without first grounding to the armor and thus this factor is omitted.
3. Several different formulas were tested for correlation with the test data. The formulas presented above appear to work reasonably well in the overall P_{FM} equation to predict the number of hot shorts observed in the NEI/EPRI test data. As an example, the CF for a seven-conductor, non-armored cable with two source conductors and two target conductors is:

$$CF = (2 \times [2 + (0.5 / 7)]) / 7$$

$$CF = 0.59$$

²⁶ Note that, for this application, target conductors are defined as only those cable conductors capable of forcing the component or circuit into the undesired state or condition of interest. For example, the target conductors associated with causing a spurious operation of the component will likely differ from target conductors associated with causing a LOC condition.

Table J-2 gives CF for several different cable configurations. As before, the table is intended to give a general feel for the values and is not all-inclusive. Experience indicates that the number of target conductors in a single cable is most always one. The number of source conductors varies, but it, too, is generally a low fraction of the overall number of conductors in the cable.

**Table J-2
Configuration Factors (CF)**

Cable Parameters			CF	
Total Conductors (C _{Tot})	Source Conductors (C _S)	Target Conductors (C _T)	Non-armored Cable	Armored Cable
1	0	1	0.50	0.00
2	1	1	0.63	0.50
3	1	1	0.39	0.33
5	1	1	0.22	0.20
	2	1	0.42	0.40
7	1	1	0.15	0.14
	2	1	0.30	0.29
	2	2	0.59	0.57
9	1	1	0.12	0.11
	2	1	0.23	0.22
	3	1	0.34	0.33
	2	2	0.46	0.44

J.1.3 Calculating PFM

Recall the formula for calculating P_{FM} is:

$$P_{FM} = CF \times P_{CC}$$

where CF and P_{CC} are determined using the formulas discussed above.

The obvious question at this point is “How well does the formula predict the test data?”

The EPRI/NEI fire test results showed for the seven-conductor cable 31 spurious actuations out of a sample population of 80 (tests in which cable damage occurred [10.1]). This yields an experimental probability of spurious operation (SO) of 38.8%, given cable damage. Using the equations derived above,

$$P_{SO} = CF \times P_{CC} = 0.59 \times 0.67 = 39.5 \%$$

At a global level, the predicted value of P_{SO} appears to match well with the experimental results.

Note that P_{SO} represents the probability of a specific hot short failure mode (i.e., spurious operation in this case) while P_{FM} is intended to represent a generic hot short failure mode probability. Other specific failure mode probabilities of interest might include loss of power (P_{LOP}), loss of control (P_{LOC}), loss of indication (P_{LOI}), and erroneous indication (P_{EI}).

For the single-conductor cables in the EPRI/NEI fire tests, there were 11 out of 44 possible spurious actuations for those tests in which cable damage occurred. This yields an experimental probability of spurious action of 25%, given cable damage. Using the equations derived above,

$$P_{SO} = CF \times P_{CC} = 0.5 \times 0.5 = 25\%.$$

The predicted value of P_{SO} again matches well with the experimental results. It is not unexpected that the formulas produce probability estimates that match well with the test data given that the formulas were reverse engineered from the test data.

A real-world case is helpful. The seven-conductor test circuit is a good representation of a typical MOV circuit. However, in practice, spurious actuation of the MOV in only one direction is of concern. Thus, only one target cable would exist. On that basis, the probability of a SO of an MOV given fire damage to the MOV's control cable is:

$$\text{Cable in tray: } P_{SO} = CF \times P_{CC} = 0.30 \times 0.67 = 20\%;$$

$$\text{Cable in conduit: } P_{SO} = CF \times P_{CC} = 0.30 \times 0.55 = 16.5\%.$$

Overall, the formulas yield results that match reasonably well with the experimental data. However, for certain cases the formulas predict values significantly different than those contained in the lookup tables. As discussed in Section 3.3.2 of Volume 1 this area of analysis is not yet fully developed and further improvements and refinements are expected. The weakness with these equations, as well as any other approach used to predict P_{FM} , is that the test data covers only a limited number of cases and configurations. Thus, assumptions are inevitably made in extrapolating the results to those cases not tested.

It is important to note that the probability of spurious actuation calculated here does not consider any factors associated with timing or the likelihood of a fire causing cable damage.

Also note that, unlike Task 9 in which the circuit analysis results apply to all fire scenarios, the circuit failure mode probability estimate analyses of Task 10 rely on certain design and construction characteristics that likely change during a cables routing through the plant (e.g., going from conduit to cable tray). These changes will affect the likelihood estimates of a particular failure mode occurring, thus requiring a review and evaluation of the cable conditions for each fire scenario affecting the cable of interest. In other words, the results might well differ from one fire scenario or compartment to the next.

Appendix K

**Appendix for Chapter 10, Examples
of Component Circuit Failure Mode
Likelihood Analyses**

K

APPENDIX FOR CHAPTER 10, EXAMPLES OF COMPONENT CIRCUIT FAILURE MODE LIKELIHOOD ANALYSES

This appendix demonstrates the procedure for estimating the likelihood of specific hot short cable failure modes for a number of circuits, each with particular and (in some cases) unique features or characteristics. The examples presented here correspond to the examples provided for detailed circuit analysis (Appendix I) and include:

- A typical ungrounded DC SOV control circuit
- A typical MOV control circuit
- A control circuit employing double-pole isolation switches
- An ungrounded AC MOV control circuit with contacts on the downstream leg and normal contract arrangement
- An ungrounded AC MOV control circuit with normal contract arrangement
- An MOV with redundant main contactors and fully independent control circuits

K.1 Typical SOV Control Circuit

Figure K-1 shows a block diagram for the component SOV with the specific cables of interest highlighted. The cable of interest for this analysis is identified as Cable B. Figure K-2 shows an overall schematic diagram of the control circuit for the SOV in its normal operating state (i.e., deenergized, open, with the red status indication lit). The conductors contained within Cable B are also noted on the schematic—P00, N00, R00, G00, SV0, and SV1.

As a result of the detailed circuit analysis during Task 9 activities, it was determined that there were three possible component failure responses: Loss of control, erroneous status indications, and spurious closure of the valve. These equipment responses correspond to the component failure codes LOC, EI, and SO, respectively.

The analyst should first note the characteristics of the cable and circuit: A seven-conductor thermoset cable associated with an ungrounded DC circuit without a CPT and with one common conductor (N00) and three energized conductors (P00, R00, and SV1). For the purpose of this example, it is assumed that the cable is routed in an open cable tray with other multi-conductor cables.

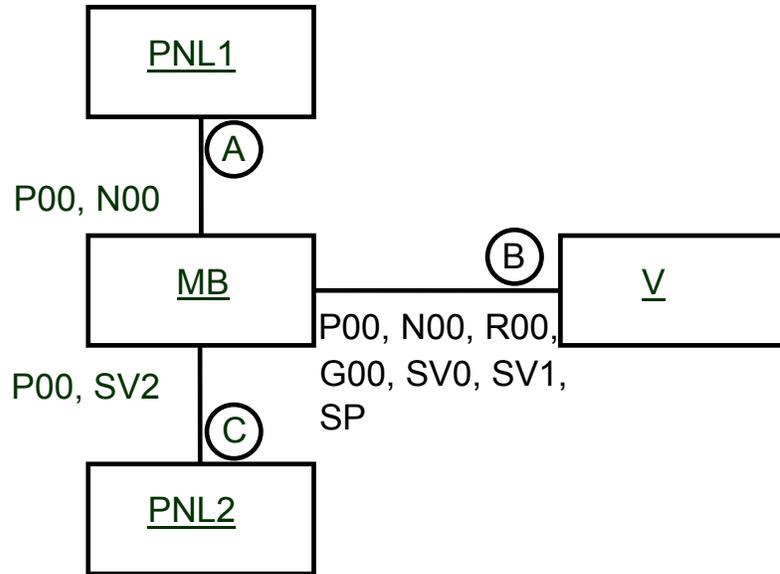


Figure K-1
Highlighted Block Diagram for Typical SOV Circuit Example

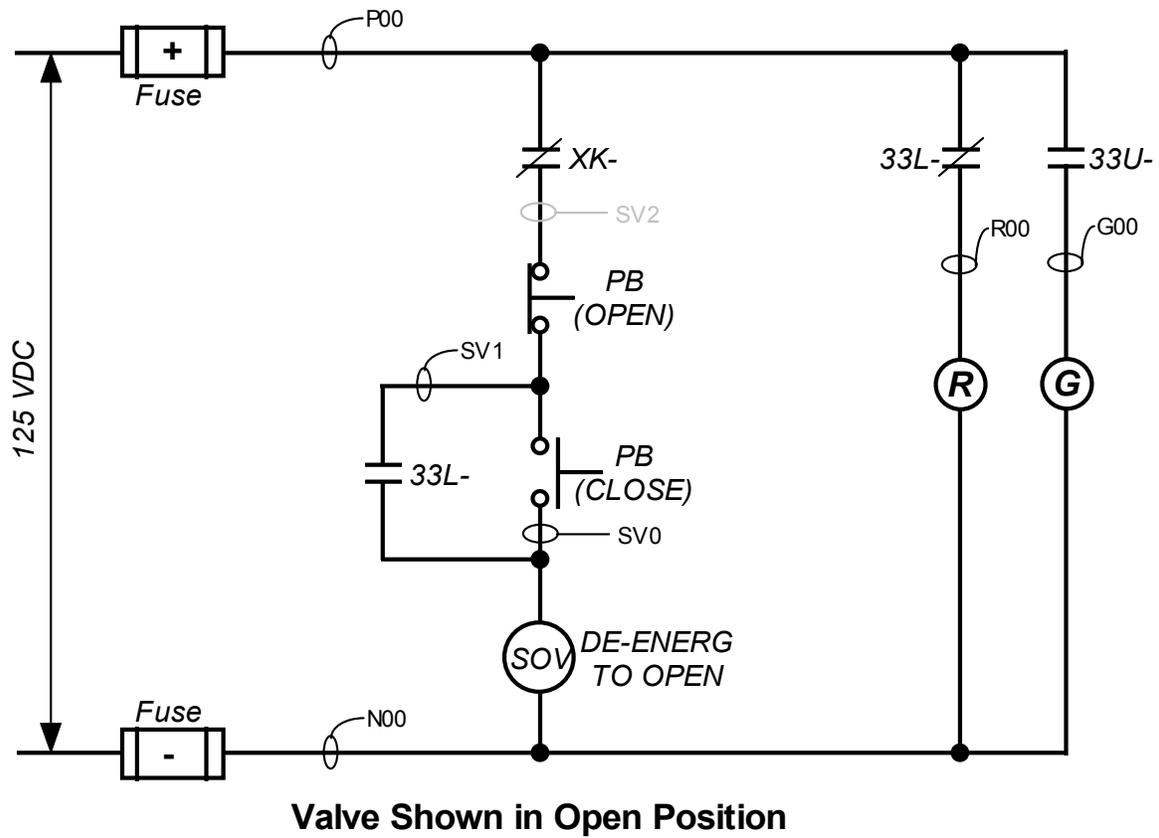


Figure K-2
Electrical Schematic for Typical SOV Circuit Example

Employing Approach #1, the analyst uses Table 10-2 to estimate the hot short failure mode probabilities for an erroneous indication and spurious closure of the valve. The estimated failure probability in each case is obtained by adding the probability of an intra-cable hot short ($P = 0.60$) to the probability of an inter-cable hot short ($P = 0.06$, nominal value between 0.02 and 0.1). The high confidence range for these estimates are all 0.2 – 1.0.

If the analyst determines the need to refine the estimated failure mode probabilities, Approach #2 should be used. The first step is for the analyst to calculate the probability of a conductor-to-conductor short (P_{CC}), since this value will be used to estimate the probability for each failure mode of concern.

$$P_{CC} = (C_{Tot} - C_G) / [(C_{Tot} - C_G) + (2 * C_G)]$$

$$P_{CC} = (7 - 1) / [(7 - 1) + (2 * 1)]$$

$$P_{CC} = 6 / [6 + 2]$$

$$P_{CC} = \underline{0.75}$$

In estimating the probability of an immediate EI circuit response, the analyst sees that a short which energizes G00 is the only means of occurrence. Thus, the cable configuration factor for loss of control (CF_{EI}) is based on the presence of one target conductor (G00) and three source conductors (P00, R00 and SV1).

$$CF_{EI} = \{C_T * [C_S + (0.5 / C_{Tot})]\} / C_{Tot}$$

$$CF_{EI} = \{1 * [3 + (0.5 / 7)]\} / 7$$

$$CF_{EI} = 3.071 / 7$$

$$CF_{EI} = 0.44$$

In this case, the estimated probability for an EI circuit response is

$$P_{EI} = P_{CC} * CF_{EI}$$

$$P_{EI} = 0.75 * 0.44$$

$$P_{EI} = \underline{0.33}$$

Next, for estimating the probability of an SO of the valve to the closed position, a short which energizes SV0 is the only means of occurrence. Thus, the cable configuration factor for a SO (CF_{SO}) is based on the presence of one target conductor (SV0) and three source conductors (P00, R00 and SV1).

$$CF_{SO} = \{C_T * [C_S + (0.5 / C_{Tot})]\} / C_{Tot}$$

$$CF_{SO} = \{1 * [3 + (0.5 / 7)]\} / 7$$

$$CF_{SO} = 3.071 / 7$$

$$CF_{SO} = 0.44$$

In this case, the estimated probability for a spurious valve closure is:

$$P_{so} = P_{cc} * CF_{so}$$

$$P_{so} = 0.75 * 0.44$$

$$P_{so} = \underline{0.33}$$

The circuit failure mode probability estimates are summarized in Table K-1.

Table K-1
SOV Cable B Failure Response Probabilities

Failure Code	Estimated Probability (Calculated)	Estimated Probability (From Table 10-2)
EI	0.33	0.66
SO (Closed)	0.33	0.66

K.2 Typical MOV Control Circuit

For this example, the MOV control circuit involves only one cable of interest; Cable A (see Figure K-3). Figure K-4 shows the electrical schematic for the MOV control circuit with the conductors located within Cable A identified. Note that the control circuit is a grounded 120 VAC circuit employing a control power transformer and, for the purpose of this example, the cable is assumed to be a nine-conductor thermoset cable routed in a cable tray with other multi-conductor cables.

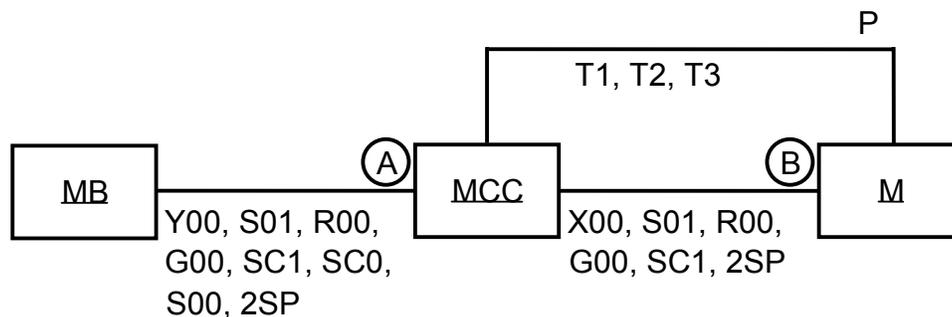


Figure K-3
Highlighted Block Diagram for Typical MOV Circuit Example

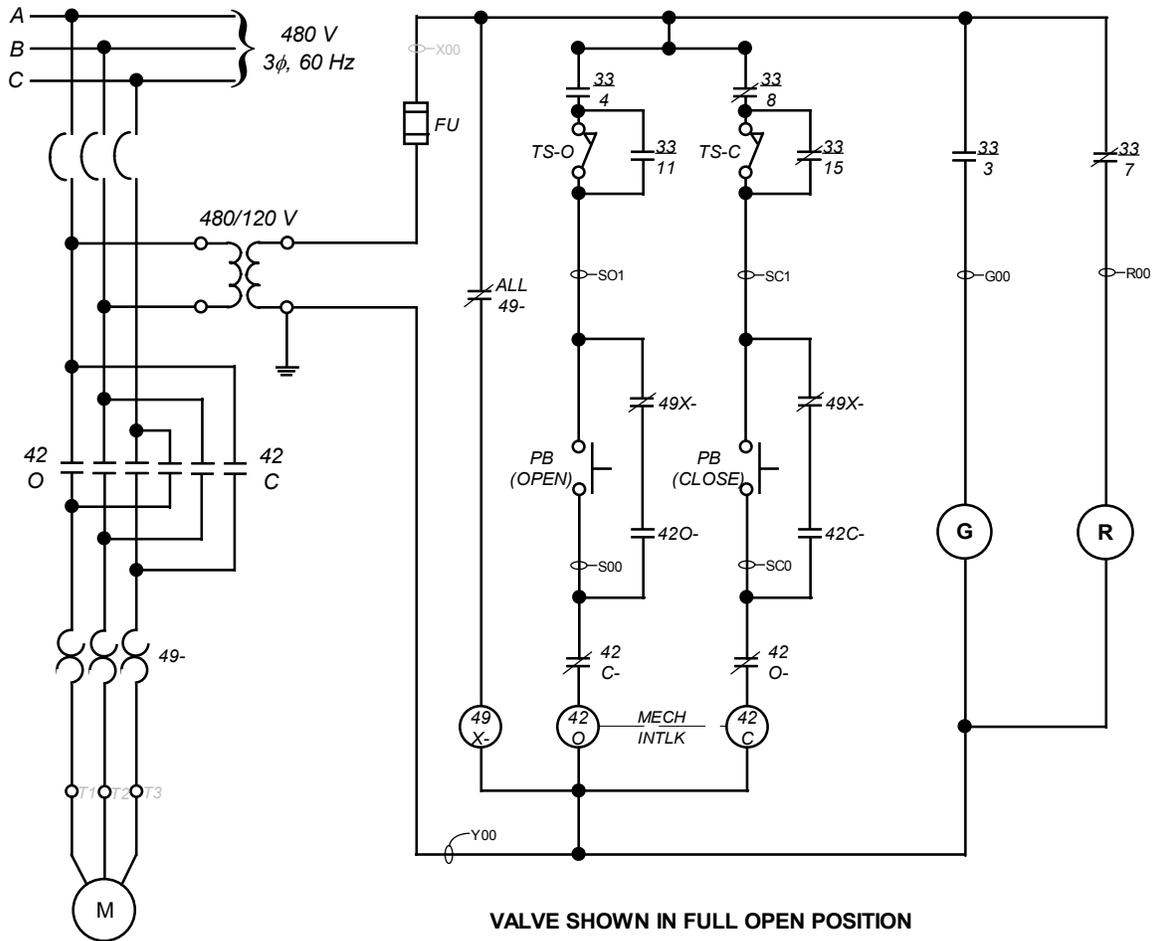


Figure K-4
Electrical Schematic for Typical MOV Circuit Example

From the results of the detailed circuit analysis (Task 9), it was determined that fire damage to Cable A could result in three failure modes of the valve: LOC, EI, and SO to the closed position. In this case the only failure mode of concern is a spurious closure of the valve.

In the same manner as the analysis of the SOV circuit (previous example), the analyst first determines the failure probability from Table 10-1. Again, the failure mode can result from either an intra-cable short or an inter-cable short. Thus, the best estimate probability obtained from Table 10-1 is 0.33 (0.30 + 0.03).

By way of comparison, the formula method is also demonstrated. The conductor-to-conductor shorting probability (P_{CC}) is determined to be:

$$P_{CC} = (C_{Tot} - C_G) / [(C_{Tot} - C_G) + (2 * C_G) + 1]$$

$$P_{CC} = (9 - 1) / [(9 - 1) + (2 * 1) + 1]$$

$$P_{CC} = 8 / [8 + 2 + 1]$$

$$P_{CC} = \underline{0.73}$$

where conductor Y00 is the only grounded conductor contained within Cable A.

For estimating the probability of a SO of the valve to the closed position, the analyst sees that a short that energizes SC0 is the only means of occurrence. Thus, the cable configuration factor for SO (CF_{SO}) is based on the presence of one target conductor (SC0) and two source conductors (R00 and SC1).

$$CF_{SO} = \{C_T * [C_S + (0.5 / C_{Tot})]\} / C_{Tot}$$

$$CCF_{SO} = \{1 * [2 + (0.5 / 9)]\} / 9$$

$$CCF_{SO} = 2.056 / 9$$

$$CCF_{SO} = 0.23$$

In this case, the estimated probability for a spurious valve closure is:

$$P_{SO} = P_{CC} * CF_{SO}$$

$$P_{SO} = 0.73 * 0.23$$

$$P_{SO} = \underline{0.17}$$

The circuit failure mode probability estimates are summarized in Table K-2.

Table K-2
MOV Cable A Failure Response Probabilities

Failure Code	Estimated Probability (Calculated)	Estimated Probability (From Table 10-1)
SO (Closed)	0.17	0.33

K.3 Control Circuit with Double-Pole Isolation Switches

A double-isolated control circuit design is shown in Figures K-5 and K-6. Here, the motor is isolated from the power conductors (ungrounded ± 48 VDC) by a succession of isolation switches. In this case, the motor is used to position a speed control valve on a steam turbine. In normal operation, the operator increases (raises) the speed or lowers it by manipulating a momentary switch. The motor can be operated remotely (e.g., the control room) or locally at the turbine. Remote or local operation is determined by the position of a manual control transfer switch (Device 43) and the contact positions of a control relay. In either case, the momentary control switch closes two sets of contacts for a raise or lower command.


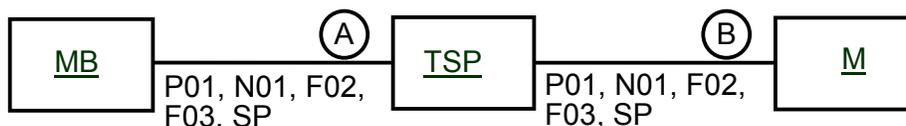


Figure K-5
Highlighted Block Diagram for Double-Pole Isolation Circuit Example

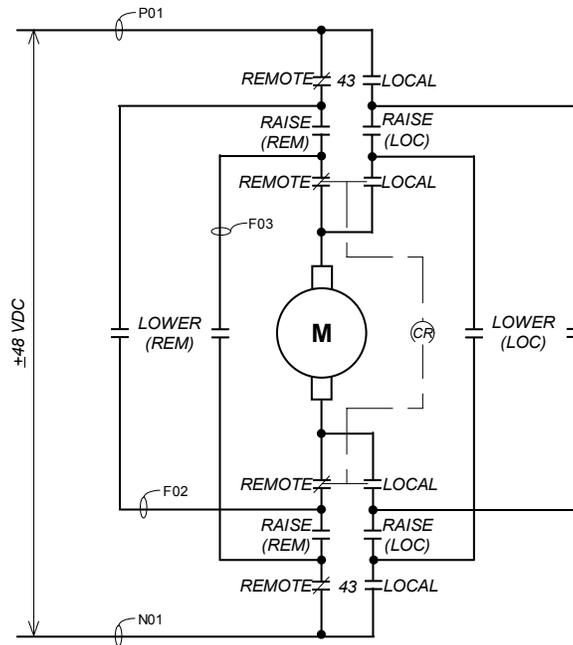

Motor Shown in Remote Operating Mode

Figure K-6
Electrical Schematic for Double-Pole-Isolation Circuit Example

The block diagram shows two cables, A and B, associated with the motor. Both of these cables allow for remote operation only. Both cables will be assessed for the possible hot short failure modes identified in Task 9 (LOC and SO). Note from the block diagram that these two cables are virtually identical, so only one needs to be evaluated. For this example, we will assume that both cables are a five-conductor thermoplastic cable routed in an open cable tray with other thermoplastic multi-conductor cables.

Because of the double-pole isolation feature of this circuit, SO of the motor can only result from the application of a dual-polarity hot shorting event. The motor will “raise” if F03 is biased by the positive source at the same time F02 is made negative, and the motor will spuriously operate in the “lower” direction if the polarities are reversed. In either case, the second hot short is dependent on the first having occurred. The method for handling this dependency will be demonstrated in the formula calculations for this circuit.

Table 10-4 is used to determine the failure mode probabilities using Option #1. For the LOC failure mode, the probability is calculated as before by combining the inter-cable and intra-cable shorting probabilities ($P = 0.6 + .06 = .66$). The SO probability is determined in a similar manner. However, two independent hot shorts must occur to produce a spurious actuation, and hence the likelihood of a SO is determined as follows:

$$P_{\text{Hot Short 1}} = 0.66 \text{ and } P_{\text{Hot Short 2}} = 0.66$$

$$P_{\text{SO}} = P_{\text{Hot Short 1}} * P_{\text{Hot Short 2}}$$

$$P_{\text{SO}} = \underline{0.44}$$

The calculational method for this example also considers the affect of the dual-polarity hot short. With N01 identified as the only common conductor, the value of P_{CC} is calculated:

$$P_{CC} = (C_{Tot} - C_G) / [(C_{Tot} - C_G) + (2 * C_G)]$$

$$P_{CC} = (5 - 1) / [(5 - 1) + (2 * 1)]$$

$$P_{CC} = 4 / 6$$

$$P_{CC} = \underline{0.67}$$

An immediate LOC condition will occur if P01 shorts to N01 or F02 shorts to F03. Delayed LOC failures in one motor direction or the other can occur by other shorting combinations. In this case, it is assumed there are two target conductors and two source conductors. This provides a LOC cable configuration factor of:

$$CF_{LOC} = \{C_T * [C_S + (0.5 / C_{Tot})]\} / C_{Tot}$$

$$CF_{LOC} = \{2 * [2 + (0.5 / 5)]\} / 5$$

$$CF_{LOC} = 4.2 / 5$$

$$CF_{LOC} = 0.84$$

Thus, the overall probability of loss of motor control is:

$$P_{LOC} = P_{CC} * CF_{LOC}$$

$$P_{LOC} = 0.67 * 0.84$$

$$P_{LOC} = \underline{0.56}$$

To determine the probability for a SO of the motor, two concurrent shorting events need to occur: (1) P01 shorts to F03 and N01 shorts to F02 to cause a SO of the motor in the Raise direction, or (2) a short of P01 to F02 and N01 to F03, to cause the motor to spuriously operate in the Lower direction. In both cases, the probability of the second short occurring depends on the occurrence of the first shorting event. Therefore, two separate CFs should be calculated as follows:

$$CF_{SO1} = \{C_T * [C_S + (0.5 / C_{Tot})]\} / C_{Tot}$$

$$CF_{SO1} = \{1 * [1 + (0.5 / 5)]\} / 5$$

$$CF_{SO1} = 1.1 / 5$$

$$CF_{SO1} = 0.22$$

and

$$CF_{SO2} = \{C_T * [C_S + (0.5 / C_{Tot})]\} / C_{Tot}$$

$$CF_{SO2} = \{1 * [1 + (0.5 / 3)]\} / 3$$

$$CF_{SO2} = 1.17 / 3$$

$$CF_{SO2} = 0.39$$

Note: Notice that the total number of conductors for the second hot short is reduced to three (3) because of the dependency of CF_{SO2} on CF_{SO1} . The first hot short removes two of the conductors from consideration in the second hot short.

Since both shorts must occur concurrently to initiate the SO of the motor, the overall probability is calculated as follows:

$$P_{SO} = P_{CC} * (CF_{SO1} * CF_{SO2})$$

$$P_{SO} = 0.67 * (0.22 * 0.39)$$

$$P_{SO} = 0.06$$

The circuit failure mode probability estimates are summarized in Table K-3. In this case, the table lookup method and formula method yield significantly different probabilities for the SO failure mode. The highly penalizing factor for non-CPT circuits is a primary contributor to the difference.

Table K-3
Double-Pole Isolated Motor Failure Response Probabilities (Cables A and B)

Failure Code	Estimated Probability (Calculated)	Estimated Probability (From Table 10-4)
LOC	0.56	0.66
SO ¹	0.06	0.44

¹ SO of the motor requires concurrent dual-polarity hot shorts on F02 and F03.

K.4 Ungrounded AC MOV Control Circuit with Contacts on the Downstream Leg and Normal Contact Arrangement

The highlighted cable block diagram for this ungrounded control circuit is shown in Figure K-7, and Figure K-8 shows the circuit schematic with the conductors of interest identified. As noted in the figure, the control switches are located on the low side of the operating coils. The circuit configuration is shown with the valve in its fully open position and control available at the main board.

The block diagram shows that control Cables B and C need failure mode probability analysis for this example. In a manner similar to the processes described previously, the analyst determines that both cables are nine-conductor thermoset cables, and further discovers that Cable B is routed in a tray, whereas Cable C is routed in conduit. The primary failure mode of concern for Cables B and C is a SO. The analyst also observes that Cable C is able to cause an EI response in the control circuit.

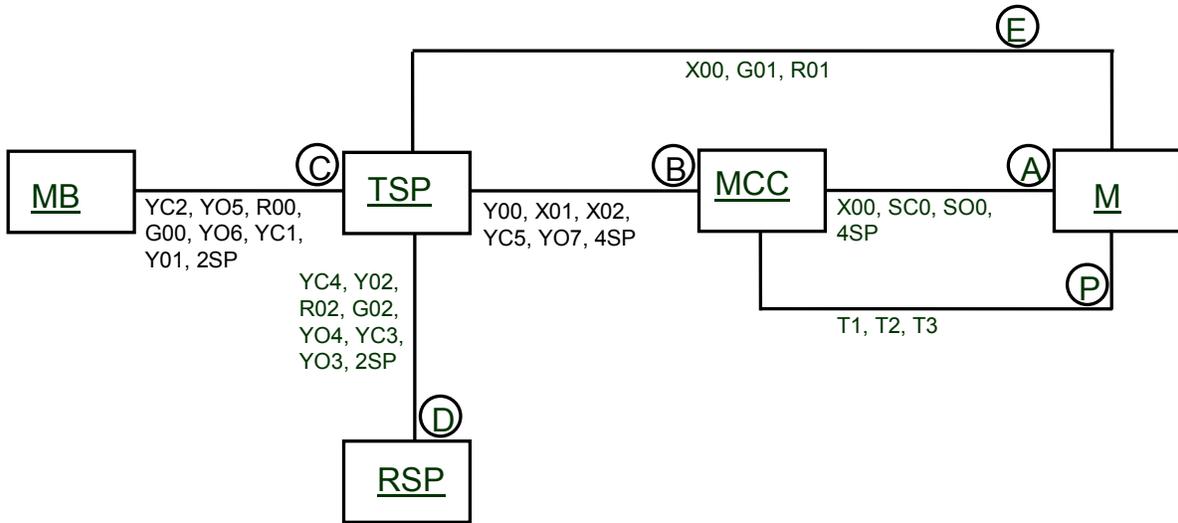


Figure K-7
Highlighted Block Diagram for Ungrounded, Inverted MOV Example

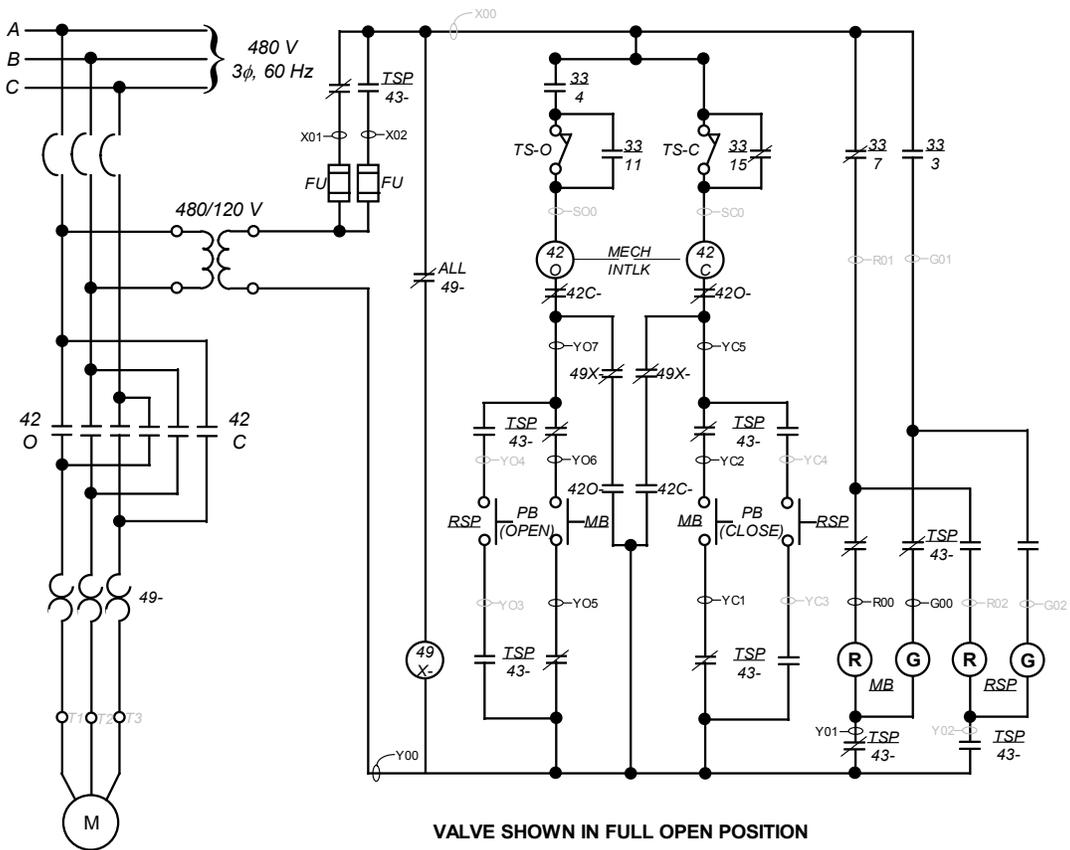


Figure K-8
Electrical Schematic for Ungrounded, Inverted MOV Example

Using Table 10-1, the SO probability for Cable B is determined to be 0.33, the combined probability estimates for intra-cable and inter-cable shorting events. For Cable C, the table provides a failure probability of 0.08, which represents the simple summation of the best estimate value for intra-cable shorts of thermoset cable routed in conduit (0.075) plus the mid-range estimate for inter-cable shorting (0.0075).

Probability estimates are also calculated using the formula method. The analyst determines that there is one common conductor, Y00, in Cable B and, using the appropriate formula calculates the value of P_{CC} for Cable B to be:

$$P_{CC(B)} = (9 - 1) / [(9 - 1) + (2 * 1)]$$

$$P_{CC(B)} = 8 / 10$$

$$P_{CC(B)} = \underline{0.80}$$

In a similar fashion, the analyst determines the value of P_{CC} for Cable C, knowing that YO5, YC1, and Y01 are all ground conductors.

$$P_{CC(C)} = (9 - 3) / [(9 - 3) + (2 * 3)]$$

$$P_{CC(C)} = 6 / 12$$

$$P_{CC(C)} = \underline{0.50}$$

To estimate the probability of SO of the MOV due to failure of Cable B, the valve can be forced to spuriously close only by contact between the source conductor Y00 and the target conductor YC5. Thus,

$$CF_{SO} = \{1 * [1 + (0.5 / 9)]\} / 9$$

$$CF_{SO} = 1.056 / 9$$

$$CF_{SO} = 0.12$$

The estimated probability for spurious operation is then:

$$P_{SO(B)} = 0.80 * 0.12 = \underline{0.10}$$

In a like manner, the analyst estimates the likelihood for an EI and SO due to Cable C damage. For determining CF for erroneous indication, there is one target conductor and one source. Thus:

$$CF_{EI} = \{1 * [1 + (0.5 / 9)]\} / 9$$

$$CF_{EI} = 1.056 / 9 = 0.12$$

and

$$P_{EI(C)} = 0.50 * 0.12 = \underline{0.06}$$

Finally, to estimate the probability of SO of Cable C, there are three target conductors and one source conductor, resulting in a SO probability of:

$$CF_{SO} = \{3 * [1 + (0.5 / 9)]\} / 9$$

$$CF_{SO} = 3.167 / 9 = 0.35$$

$$P_{SO(C)} = 0.50 * 0.35 = \underline{0.18}$$

Table K-4 provides the results for the circuit response probability estimates for Cables B and C.

Table K-4
Ungrounded, Inverted MOV Failure Response Probabilities

Cable	Failure Mode	Estimated Probability (Calculated)	Estimated Probability (From Table 10-1)
B	SO	0.10	0.33
C	EI	0.06	0.08
	SO	0.18	0.08

K.5 Ungrounded MOV Control Circuit with Normal Contact Arrangement

This MOV control circuit is unusual in that all five control cables, A through E (see Figure K-8), were capable of causing an SO of the valve. Consequently, the analyst decides to focus the analysis and determine the probability of SO for each cable. Assuming all of the control cables are thermoset cables routed in trays, Table 10-1 provides a value of 0.33 as the best estimate for SO occurrence due to fire damage of each cable.

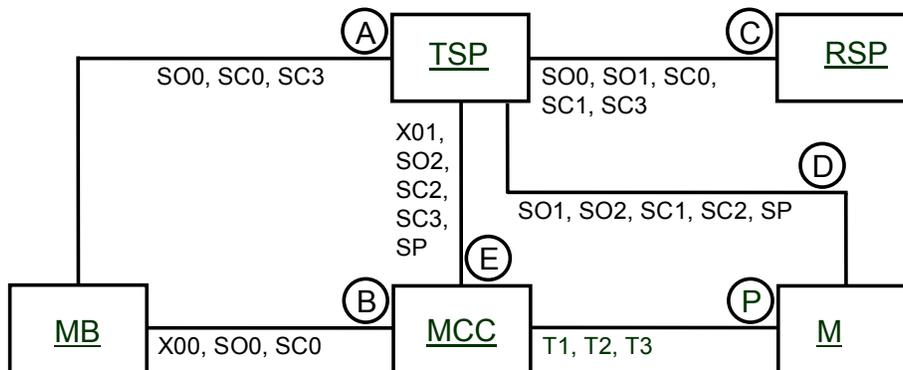


Figure K-9
Highlighted Block Diagram for Ungrounded MOV Circuit Analysis Example

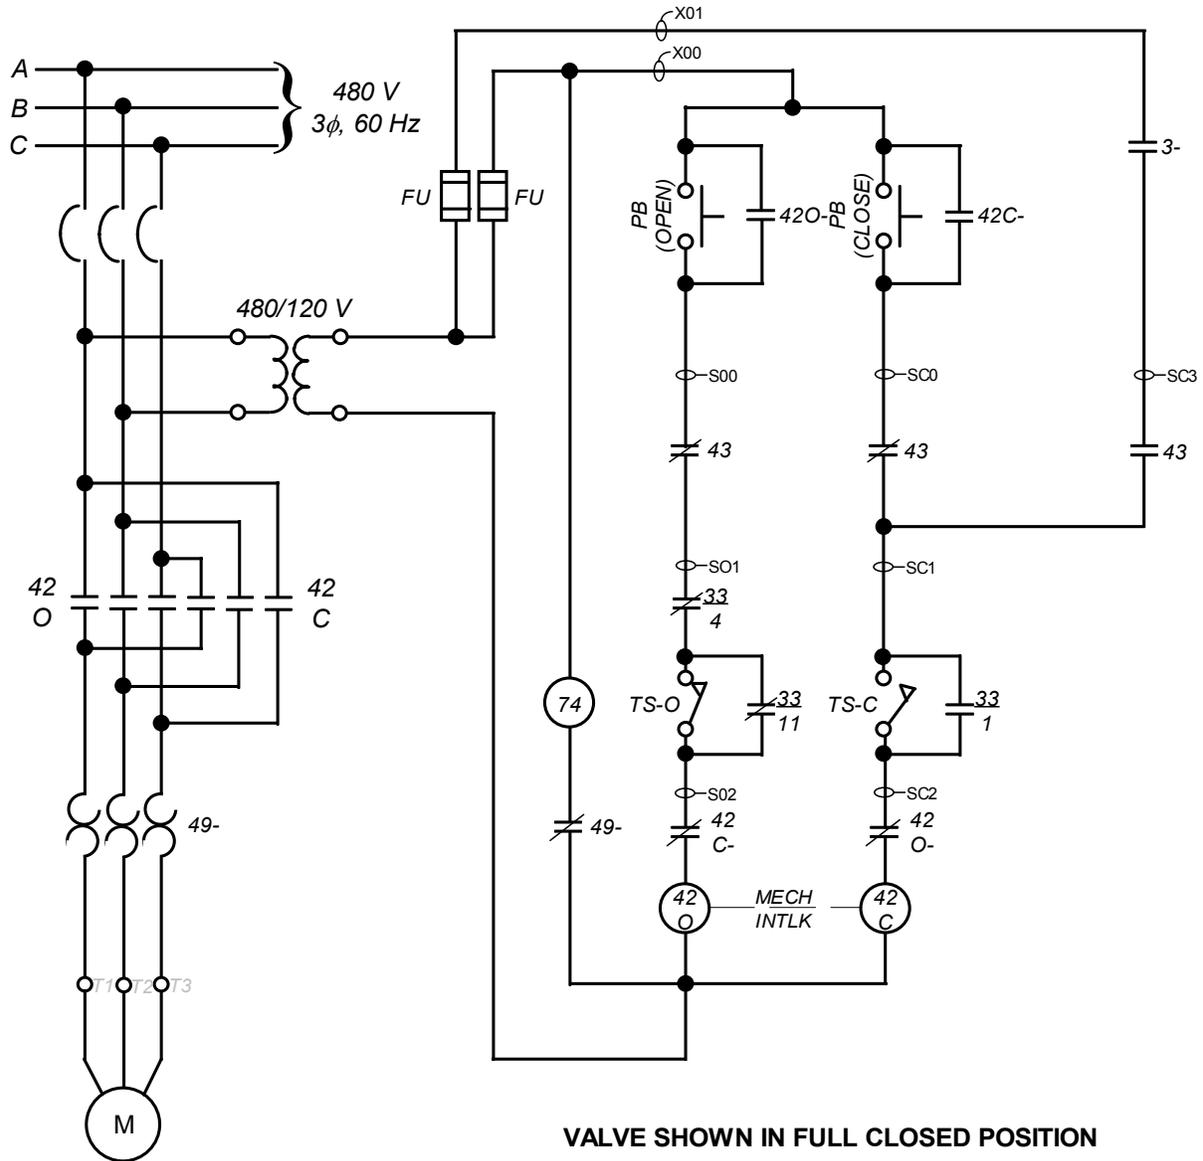


Figure K-10
Electrical Schematic for Ungrounded MOV Circuit Analysis Example

Employing the formula for determining the conductor-to-conductor shorting probability for each cable, the following values are obtained. (Note that none of the conductors in any of the five cables is directly connected to the low side of the control power transformer.)

$$P_{CC(A)} = (3 - 0) / [(3 - 0) + (2 * 0)] = 3 / 3 = 1.0$$

$$P_{CC(B)} = (3 - 0) / [(3 - 0) + (2 * 0)] = 3 / 3 = 1.0$$

$$P_{CC(C)} = (5 - 0) / [(5 - 0) + (2 * 0)] = 5 / 5 = 1.0$$

$$P_{CC(D)} = (5 - 0) / [(5 - 0) + (2 * 0)] = 5 / 5 = 1.0$$

$$P_{CC(E)} = (5 - 0) / [(5 - 0) + (2 * 0)] = 5 / 5 = 1.0$$

The analyst then determines the cable configuration factor for each cable by identifying the appropriate targets and sources that would result in an SO of the valve.

For Cable A, conductor S00 is the target, but none are source conductors.

$$CF_{SO(A)} = \{1 * [0 + (0.5 / 3)]\} / 3 = 0.17 / 3 = 0.06$$

In Cable B, conductor S00 is the target and X00 is the source.

$$CF_{SO(B)} = \{1 * [1 + (0.5 / 3)]\} / 3 = 1.17 / 3 = 0.39$$

Conductors S00 and S01 are the targets in Cable C, but again, there are no source conductors.

$$CF_{SO(C)} = \{2 * [0 + (0.5 / 5)]\} / 5 = 0.20 / 5 = 0.04$$

S01 and S02 are the Cable D target conductors and there are no sources.

$$CF_{SO(D)} = \{2 * [0 + (0.5 / 5)]\} / 5 = 0.20 / 5 = 0.04$$

Cable E provides one source conductor (X01) and one target (S02).

$$CF_{SO(E)} = \{1 * [1 + (0.5 / 5)]\} / 5 = 1.10 / 5 = 0.22$$

Since P_{CC} for all of the cables is unity, the estimated probability for SO due to fire damage is equal to the CF for each particular cable. Table K-5 provides the results of this probability analysis for this ungrounded MOV control circuit.

Table K-5
Ungrounded MOV Failure Response (SO) Probabilities

Cable	Estimated SO Probability (Calculated)	Estimated SO Probability (From Table 10-1)
A	0.06	0.33 ¹
B	0.39	0.33
C	0.04	0.33 ¹
D	0.04	0.33 ¹
E	0.22	0.33

¹ Since Cables A, C, and D do not have any internal source conductors, it is reasonable to use the inter-cable hot short probability of 0.03 from Table 10-1 for these cables, in lieu of 0.33.

K.6 MOV with Redundant Main Contactors and Independent Control Circuits

Figure K-11 shows the block diagram for this valve and Figure K-12 shows its electrical schematic. This configuration is somewhat unique in that the operator must first actuate the permissive circuit (the upper control circuit in Figure K-12) in order to provide control power to the primary valve control circuit. Both circuits control the closure of contactors on the power leads to the motor.

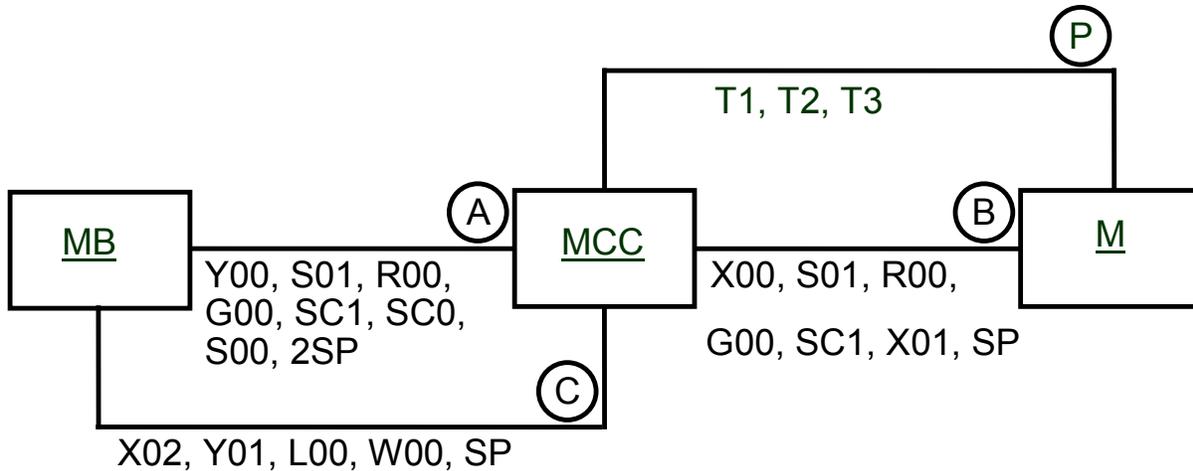


Figure K-11
Highlighted Block Diagram for MOV with Independent Control Circuits Example

For Cable A, note that it is a nine-conductor thermoset cable in a tray with one ground wire (Y00). The P_{CC} is thus:

$$P_{CC(A)} = (9 - 1) / [(9 - 1) + (2 * 1) + 1] = 8 / 11 = 0.73$$

An erroneous indication condition will occur if R00 contacts G00. The CF for this case is:

$$CF_{EI(A)} = \{1 * [1 + (0.5 / 9)]\} / 9 = 1.06 / 9 = 0.12$$

SO of the valve to close requires closure of the Device 42- contactors on the power leads to the motor, while R00 or SC1 is in contact with SC0 (i.e., one target and two sources), in which case the CF will be:

$$CF_{SO(A)|(42-)} = \{1 * [2 + (0.5 / 9)]\} / 9 = 2.06 / 9 = 0.23$$

The corresponding probabilities are calculated to be:

$$P_{EI(A)} = P_{CC(A)} * CF_{EI(A)} = 0.73 * 0.12 = \underline{0.09}$$

$$P_{SO(A)|(42-)} = P_{CC(A)} * CF_{SO(A)|(42-)} = 0.73 * 0.23 = \underline{0.17}$$

Where the “|(42-)” notation indicates the condition that Device 42 in the permissive control circuit is actuated.

The results from the detailed circuit analysis of this MOV indicated that only an EI can be induced by failure of Cable B. Cable B is a seven-conductor thermoset cable routed in a tray. None of the conductors are directly connected to the circuit ground. Two normally energized conductors, R00 and X00, can cause the inadvertent actuation of the green status indication by contact with G00.

$$P_{CC(C)} = (5 - 1) / [(5 - 1) + (2 * 1) + 1] = 4 / 7 = 0.57$$

where the cable is a five-conductor thermoset cable routed in a tray. The cable configuration factor for this cable is:

$$CF_{SO(C)} = \{1 * [1 + (0.5 / 5)]\} / 5 = 1.1 / 5 = 0.22$$

The corresponding failure probability is:

$$P_{SO(C)} = P_{CC(C)} * CF_{CC(C)} = 0.57 * 0.22 = \underline{0.13}$$

Remember that the probability of SO due to failure of Cable C only refers to the operation of the Device 42 in the permissive circuit. It is *not* the estimated probability of spurious operation of the MOV to the closed position.

Table 10-1 provides a best estimate value of 0.33 for each of the possible failures associated with these cables. Table K-6 shows the results of the calculated hot short failure mode estimates.

**Table K-6
MOV with Independent Control Circuits Failure Response (SO) Probabilities**

Cable	Failure Mode	Estimated Probability (Calculated)	Estimated Probability (From Table 10-1)
A	EI	0.09	0.33
	SO ¹	0.17	0.33
B	EI	0.26	0.33
C	SO ²	0.13	0.33

¹ Requires the concurrent actuation of the permissive circuit coil (Device 42) in order to occur.

² SO of the Device 42 contactor coil only, not a spurious operation of the valve.

Appendix L

**Appendix for Chapter 11, Main Control
Board Fires**

L

APPENDIX FOR CHAPTER 11, MAIN CONTROL BOARD FIRES

L.1 Introduction

This appendix describes the process for estimating the conditional probability of damage to a set of target items inside the main control board (MCB). Plant design practice regarding the placement of electrical components directly associated with the main control functions varies substantially. This variability presents a challenge to the Fire PRA methodology. Uniform treatment of the fire frequency and fire characteristics for fire areas associated with these main control functions is desired.

The procedure outlined in this appendix represents a statistical model of the conditional probability that given an MCB fire, a specific segment of the MCB will be damaged (based on the maximum distance between the targets of interest). Underlying the statistical model are assumptions relating to; 1) the peak heat release rate distribution profile for control panel fires, 2) the damage limits for MCB components, 3) a simple correlation for fire plume temperature (Alpert's correlation), 4) an assumed t-squared transient fire growth profile, and 5) the statistical estimates of MCR fire suppression response times.

It must be acknowledged that neither the MCB model itself nor the underlying submodels (Alpert's correlation in particular) have been subjected to verification and validation (V&V) beyond the internal team verification that the cited final results (presented in the form of a graph) do reflect our intent regarding the model formulation. Indeed, it is the view of the technical development team that a formal V&V for this model is currently not feasible because there is no experimental, experience-based, or statistical data against which to validate the results.

This statistical model is presented and recommended for use only because (1) there is currently no computational fire modeling tool that has been verified and validated for use in a MCB fire and no V&V studies for such a model are currently underway or foreseen in the near future, and (2) the main control board is a potentially important consideration to a Fire PRA and some structured and consistent framework for the treatment of these scenarios is needed. Pending the availability of computational analysis tools with an appropriate V&V basis for this application, the statistical model presented here is recommended as best current practice. While the model has not been subject to a formal V&V, the view of the technical development team is that the results will provide a reasonable method for the analysis of MCB fires that will provide a meaningful weighing of the MCB fire scenarios against each other, and against other fire risk contributors. The model is intended exclusively for use in the analysis of MCB fires, and it should not be extended to other types of fire scenarios.

At most plants, there is a designated MCB, although the actual contents of the MCB may vary from plant to plant. If the plant under analysis does not have a designated main control board, the Fire PRA should be able to easily designate that set of MCR panels that represents, in effect, the MCB using the information provided here.

The primary point of design variability arises from the placement of control relays and signal conditioning equipment (e.g., printed circuit cards associated with signal processing). Some or all of these components may be found within the MCR itself (typically in the “back panels” of the control room), or in a separate plant compartment or fire area. Common examples of separate compartments are signal conditioning equipment rooms, auxiliary electrical equipment room, relay rack rooms, or other similar areas. In the experience of the authors, such compartments have been observed directly adjacent to the MCR, in an area above or below the MCR, integrated within the cable spreading room, and in compartments associated with the switchgear fire areas.

This appendix is specific to analysis of fires in the MCB and the MCB only. This appendix does not cover other main control room (MCR) electrical panels, nor those panels associated with the main control functions that may be located outside the MCR as described above. Those MCR or MCR-related electrical panels outside the MCB are treated within the context of other plant-wide electrical cabinets, even if those panels are physically located within the MCR.

- The MCB is defined as the collection of control panels inside the MCR of a nuclear power plant from which operators control the plant on a day-to-day basis.
- The MCB would typically include the front face of the “horse shoe” (a typical configuration in most plants), other control or instrumentation display panels that are typically placed in full view of the areas where control room operators are expected to spend most of their time, and other panels in the control room proper that contain control switches or instrumentation displays that are used for plant control or emergency shutdown.
- The MCB would typically not include the back panel of the main board (if such exist).
- The MCB would also not include those electrical panels devoted primarily to housing control relays, printed cards (such as signal conditioning cards), or all other devices that the operators do not directly use to maintain plant control or safe shutdown.

One aspect of the treatment of MCB fires was the need to identify some set of fire events as being associated with the MCB so that a fire frequency could be estimated.

A review of Control Room fire events in the Fire Event Database (FEDB) [L.1] reveals that none of the Control Room fires affected items much beyond the point of ignition. In all cases, the fire was discovered by Control Room personnel and extinguished using hand-held extinguishers. Since the Control Room is occupied at all times, it is expected that the likelihood of a very large fire affecting a large number of items inside the main control board is very low. If such a fire should occur, the principal impact would be Control Room abandonment by the operators rather than widespread equipment damage. The fire brigade would remain in the Control Room and continue fighting the fire, which would most likely retard the fire spread. Therefore, it is recommended for the fire risk analysts to identify localized areas on the control boards where control and instrumentation damage may have some significant impact on core cooling after a reactor trip. For each localized area, the analyst should identify specific target items. The largest distance between these target items is used in the methodology described below as the main measure for the severity of fire needed to cause a significant damage.

A wide range of fire scenarios may impact the same set of target items. The difference between the fire scenarios would lie in their point of origin, items burning, and distance to the target set. For the methodology described below, it is assumed that all fires start inside the control panel and there is a uniform distribution of ignition sources and combustible materials attached to the backside of the control board's front panel.

Unfortunately, modeling fire spread through the combustible materials inside a main control board is beyond the capabilities of current state-of-the-art analytical tools. In the absence of an analytical tool, a probabilistic model based on information obtained from EPRI's FEDB [L.1], and a series of cabinet fire experiments reported in NUREG/CR-4527 [L.2] has been developed. The probabilistic model estimates the likelihood that a set of targets separated by a predetermined distance would be affected by a fire.

The analysis leading to damage likelihood is based on the following assumptions:

- All control panel fires have an opportunity to grow and damage the postulated target set.
- The combustible materials are evenly distributed along the entire width and height of the control boards with no interruption and barriers separating subgroups of items and electrical wiring.
- A fire igniting at any point of the control board can affect targets above and below the point of fire origin.

As part of the first assumption, it is also assumed that a fire starting above a target set has the potential to cause damage. This assumption is not unreasonably conservative because in control panel fire experiments, it was observed that as fire grows upward, burning materials may separate from the panel and drop down on the floor or other items within the board and cause additional fires below the original fire level.

L.2 Probability of Target Damage

The frequency of damage to target set i can be estimated using the same formulations as those presented in Task 11. Assuming that a set of fire scenarios may lead to the postulated damage, the frequency of damage can be written as:

$$\lambda_i = \lambda_{MCB} \cdot \sum SF_i \cdot P_{ns-i}$$

where

- λ_i = frequency of damage to target set i
- λ_{MCB} = fire initiation frequency of the main control board
- SF_i = severity factor for the postulated fire scenario i
- P_{ns} = nonsuppression probability for the postulated fire scenario i

To simplify the analysis, all target sets are defined in terms of the distance d between the targets corresponding to a calculated $ccdp$. Using this definition, the frequency of damage can be written as a function of d as:

$$\lambda(d) = \lambda_{MCB} [SF \cdot P_{ns}](d)$$

Where $[SF \cdot P_{ns}](d)$, a function of d , is the overall likelihood of damage to a target set with maximum internal distance d among its elements. That is, the likelihood of an unsuppressed severe fire inside the MCB. Figure L-1 depicts the final numerical values of $[SF \cdot P_{ns}](d)$ as a function of d . The integration over all fire scenarios leading to the graphs in Figure L-1 is described below.

L.3 Calculating Scenario Frequency

To estimate the frequency of target set damage, the analyst should use the following steps.

1. Identify the largest distance, d , between the elements of the target set.
2. Determine whether or not the cables and wire insulations are qualified per IEEE-383.
3. Obtain the likelihood value, $[SF \cdot P_{ns}](d)$, from Figure L-1.

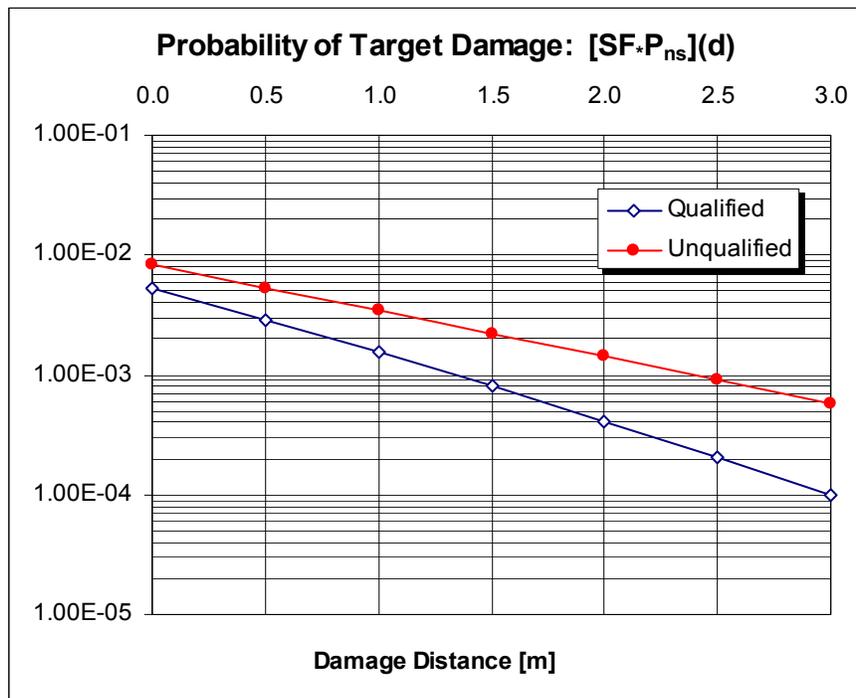


Figure L-1
Likelihood of Target Damage Calculated as the Severity Factor Times the Probability of Nonsuppression for MCB Fires

4. Multiply the likelihood value from Step 3 with fire ignition frequency for main control board, λ_{MCB} , obtained in Task 6. The analyst should apportion the generic frequency for control room/electrical cabinets to the MCB (or any other cabinet in the MCR) using the location and ignition source weighting factors.

$$\lambda(d) = \lambda_{MCB} [SF \cdot P_{ns}](d)$$

L.4 Model Description

The probabilistic fire growth model for the MCB (or fire growth inside any electrical cabinet) was developed based on (1) the nonsuppression probability curve for the MCR (described in Appendix P), and (2) fire intensities in control cabinets measured in a series of experiments reported in NUREG/CR-4527 [L.2]. As described in Appendix P, the fire durations reported in [L.1] were used to estimate the mean time to suppress a fire for the main control room. Cabinet fire experiments described in [L.1] were used as a basis for developing probability distributions for the heat release rate for control cabinets with qualified and non-qualified cables (see Appendix G).

Target damage is assumed if the fire-generated temperature around a target item reaches the damage threshold. In the absence of an analytical fire model for cabinet configurations, this temperature is conservatively estimated using an axy-symmetric plume temperature correlation. This correlation estimates gas temperature at the distance r above the fire. To better describe this assumption, consider a set of two targets inside the main control board a distance d from each other. A fire is assumed to start in any of the two targets. The second target is assumed to be subjected to plume temperatures calculated a distance d from the fire origin, regardless of the geometrical orientation between the two targets (horizontal, vertical, or other).

A number of plume temperature correlations are available in the Fire Protection Engineering literature. All of them are appropriate for this application. Alpert's correlation for plume temperature [L.3] offers the simplest model in terms of required inputs. The Alpert correlation for plume temperature can be expressed as:

$$\Delta T = 16.9 \left(\frac{(k\dot{Q})^{2/3}}{r^{5/3}} \right)$$

where

- ΔT = plume temperature rise to target damage threshold temperature,
- k = location factor (dimensionless),
- Q = heat release rate,
- r = distance from the fire origin to the farthest target.

Since the postulated fires are assumed to occur behind the control panel, the location factor $k = 2$ is used representing fire plume conditions along a wall.

To conduct the integration over the entire range of fire scenarios, it is postulated that a fire may initiate at any point on the control panel. Figure L-2 illustrates the front surface area of a main control board and two targets (represented by the symbol “o”) separated by a distance d . The distance between bottom-left corner of the rectangle (coordinates 0,0) to the farthest target item can be approximated as follows, assuming the two targets are aligned with the diagonal (dashed line):

$$r(d, w, h) = \frac{d}{2} + \sqrt{w^2 + h^2}$$

The term $r(d, w, h)$ represents the distance between the origin of the fire and the farthest target. That is, a fire starting in a given origin will need to generate a damaging plume temperature a distance $r(d, w, h)$ in order for the target set to be considered damaged.

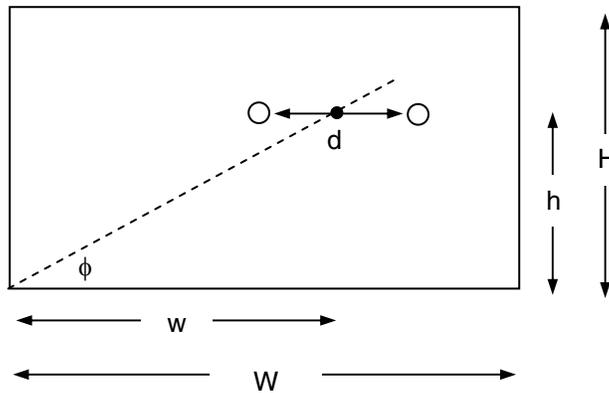


Figure L-2
A Representation of the Front of a Control Panel with Two Target Elements

To estimate temperature rise around the farthest target, $r(d, w, h)$ is used in Alpert’s correlation. This is certainly a conservative practice, because, as mentioned earlier, it disregards the orientation of the fire initiation point with respect to the target set. As noted above, because burning materials may drop on lower elements of the panel, the level of conservatism is expected to be less than otherwise. Also, accumulation of hot gases inside the cabinet is not modeled (another nonconservative aspect of the model).

Alpert’s correlation can be solved for the heat release rate:

$$Q(d, w, h) = \frac{1}{k} \left[\frac{\Delta T \cdot r(d, w, h)^{5/3}}{16.6} \right]^{3/2}$$

The time to damage can be estimated from the heat release rate profile. A hypothetical case is presented in Figure L-3. The initial rise in heat release rate follows a t^2 growth profile, reaching the peak in about 12 minutes. Twelve minutes is the average fire growth of the electrical cabinet fire experiments documented in NUREG/CR-4527 (see Appendix G for more details). The time to damage is then estimated as:

$$t_{Dam}(d, w, h) = 12 \left(\frac{Q(d, w, h)}{Q_{Peak}} \right)^{0.5}$$

where Q_{Peak} is a random variable following a gamma probability distribution as described in Appendix E. Therefore, the time to damage, t_{dam} is also a random variable. The time to damage is used in the following equation to estimate the probability of nonsuppression:

$$P_{NS}(d, w, h) = e^{-\lambda \cdot t_{Dam}(d, w, h)}$$

where λ is the parameter of the exponential distribution characterizing the applicable suppression curve (see Appendix P for more details). Notice that P_{NS} is also a random variable. Of all the parameters used in establishing the probability of nonsuppression, only the uncertainty in Q_{Peak} is quantified in this procedure. From that uncertainty distribution, $f(Q_{Peak})$, the distributions for t_{dam} and P_{NS} can be obtained by transformation of the gamma distribution. The severity factor, $SF(d, w, h)$, can be established as described in Appendix E. The severity factor is the probability of Q_{Peak} being greater than $Q(d, w, h)$ obtained using Alpert's correlation or:

$$SF(d, w, h) = 1 - \int_0^{Q(d, w, h)} f(Q_{Peak}) dQ_{Peak}$$

Finally, the likelihood of damage to a target set separate by distance d can then be calculated using the following integral:

$$[SF \cdot P_{ns}](d) = \frac{1}{H \cdot W} \int_0^H \int_0^W SF(d, w, d) \cdot P_{ns}(d, w, d) dw dh$$

Notice that all possible fire origin locations with respect to the target set are accounted for in the integral analysis. The results of the integral analysis are provided above in Figure L-1. Specifically, Figure L-1 provides the likelihood of target set damage for two cable types. The two graphs in Figure L-1 are based on the following:

- The width and height of a typical control board were assumed to be $W = 60'$ and $H = 10'$.
- Damage threshold temperature for qualified cables was assumed to be $\Delta T = 330^\circ\text{C}$ (625°F) and for nonqualified cables $\Delta T = 205^\circ\text{C}$ (400°F) (see Appendix H on damage criteria).

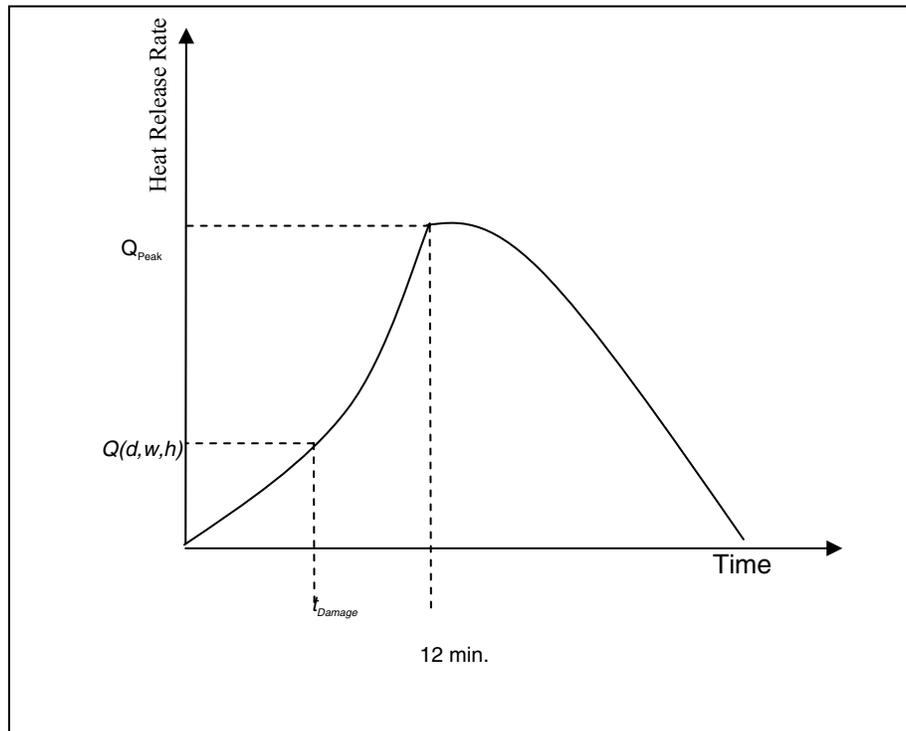


Figure L-3
Heat Release Rate Profile

- From Appendix G, the probability distributions for peak heat release rate are:
 - Gamma (0.7, 204) for fires involving qualified cable,
 - Gamma (0.45, 366) for fires involving nonqualified cable.
- The probability of no-suppression curve is $e^{-\lambda \cdot t}$, where λ is calculated parameter for the Main Control Room fires = 0.33 (see Appendix P for more details).

L.5 Example

The control cables for two motor-driven auxiliary feed water (AFW) pumps are located 1 m (3'-7") apart inside the MCB. The MCB has IEEE 383 qualified cables. From Figure L-1, the probability of failing the two targets is approximately 1.6 E-3.

From Task 6, the generic frequency for main control room/electrical cabinets is 2.1 E-3. Assuming this is a shared control room for two units, the frequency of an unsuppressed challenging fire in the MCB is calculated as:

$$\lambda_c = 2.1E-3 \times 2 \times 1.6 E-3 = 6.7 E-6$$

L.6 References

- L.1 *Fire Event Database and Generic Ignition Frequency Model for U.S. Nuclear Power Plants*, EPRI, Palo Alto, CA: 2001. 1003111.
- L.2 Chavez, J.M., and S. P. Nowlen, *An Experimental Investigation of Internally Ignited Fires in Nuclear Power Plant Control Cabinets – Part II, Room Effect Tests*, NUREG/CR-4527, USNRC, November 1988.
- L.3 *Handbook of Fire Protection Engineering – 2nd Edition*, Society of Fire Protection Engineers, Bethesda, Maryland, 1995.

Appendix M

**Appendix for Chapter 11, High Energy
Arcing Faults**

M

APPENDIX FOR CHAPTER 11, HIGH ENERGY ARCING FAULTS

M.1 Introduction

Switchgear, load centers, and bus bars/ducts (440V and above) are subject to a unique failure mode and, as a result, unique fire characteristics. In particular, these types of high-energy electrical devices are subject to high-energy arcing fault (HEAF). This fault mode leads to the rapid release of electrical energy in the form of heat, vaporized copper, and mechanical force. Faults of this type are also commonly referred to as high energy, energetic, or explosive electrical equipment faults or fires. Similar failure modes can occur in large oil filled transformers. However, this appendix does not address modeling HEAF events on oil filled transformers. Task 6 provides information on dealing with oil filled transformer events.

The arcing or energetic fault scenario in these electrical devices consists of two distinct phases, each with its own damage characteristics and detection/suppression response and effectiveness. The first phase is a short, rapid release of electrical energy followed by ensuing fire(s) that may involve the electrical device itself, as well as any external exposed combustibles, such as overhead exposed cable trays or nearby panels, that may be ignited during the energetic phase. The second phase, i.e., the ensuing fire(s), is treated similar to electrical cabinet fires described elsewhere in this procedure, with one distinction. Any closed electrical cabinet subject to a HEAF is opened to a fully ventilated fire. In dealing with postulated switchgear and load center fires, both phases should be considered.

This appendix describes only the damage characteristics and detection/suppression aspects of the energetic phase of the HEAF fires. Frequencies for both HEAFs and general electrical cabinet fires can be found in the procedure for Task 6, Fire Ignition Frequencies.

The damage and detection/suppression behavior of the energetic phase of the HEAFs described in this appendix is based on the U.S. commercial nuclear industry experience.

M.2 High Energy Electrical Arcing Phenomena

A high current arcing fault in a high-energy electrical device is a phenomenon that can occur and, in some instances, may eventually produce a catastrophic event often described as “explosive” or an “exploding fault.”

An arc is a very intense discharge of electrons between two electrodes that are carrying an electric current. Since arcing is not usually a desirable occurrence, it is described as an “arcing fault.” The arc is created by the flow of electrons through charged particles of gas ions that exist as a result of vaporization of the conductive material.

The two main components of an arc are the arc column and the arc root. Arc columns are conductive, high-temperature gases (fumes, vapors) known as plasma. Plasma can develop when the electrodes reach temperatures sufficient to cause rapid vaporization of the conductive materials, thus putting ions in the atmosphere and forming the conductive path between the electrodes. Temperature will affect the conductivity of the arc column significantly, and temperatures of 6000K in open arcs and 25000K in high-power circuit breakers at maximum current have been observed [M.1]. The arc roots are high electric fields with an elevated temperature gradient consisting of the anode and cathode roots, which appear on the electrodes. The anode root cannot emit the positive ions needed for arcing, and is lesser in character forming of the two. Therefore, the cathode roots have been studied in great detail. These originate from a region on the negative electrode. Specifically, for high-energy electrical devices, the electrodes normally use a low melting point metal such as copper (1356K), and copper and similar materials serving as electrodes in an arc are susceptible to ‘cold cathode’ arcs.

The arcing fault can reach the unstable conditions that may drive it the point to where the exploding wire phenomena can occur. This event described here is the “energetic electrical fault.”

M.3 U.S. Nuclear Power Plants Operating Experience

There are a number of components in a nuclear power plant (NPP) that are susceptible to a high-energy event followed by a fire. This is seen in the U.S. NPPs [M.1]. These high-energy events are the result of mechanical (diesel generator crankcase), chemical (hydrogen), or electrical (arcing) faults. The discussion in this appendix is limited to the examination of the high-energy electrical arcing faults. Even though these arcing faults have occurred in large outdoor transformers, they are not covered in this appendix. For these high-voltage transformers, damage to the transformer itself and other equipment within 50 feet that is not shielded by structural wall should be assumed. The risk associated by these events, however, is likely to be the same as or lower than those from loss of offsite power.

The review and characterization of the damage and detection/suppression behavior for the energetic phase of high-energy-arcing faults is based on the examination of 11 incidents that occurred in U.S. nuclear power industry between 1979 and 2001. A summary of these events is shown in Table M-1.

Following are some of the observations from the HEAFs in the U.S. commercial nuclear industry, which form the basis for characterizing the damage and suppression as the result of the energetic phase.

1. Indications of heavy smoke in the area, which may delay identification of the fire origin and whether the fire is still burning.
2. In many cases, these events report detection by plant personnel. However, due to quick smoke release, particularly with events that are severe enough to cause external damage, it is likely to activate smoke detection systems very early into the event.
3. In nearly all of these events, the HEAF initiates in the feed breaker cubicle. This is because this is where most of the electrical energy in a high-energy cabinet resides.

4. The HEAFs in switchgears occur with more damage in the non-emergency (non class 1E), rather than class 1E emergency switchgears. Of the 12 events involving HEAF, four are known to occur in non-1E switchgears. The description of the remaining eight events does not specify the type of switchgear. However, as many as three may have occurred in 1E switchgears because they are 480V. The four non-class-1E HEAFs are the most severe of such events. In fact, these are the only events, from the 12, that caused external damage beyond the switchgear and required 10 minutes or more to extinguish the ensuing fire(s). All other events with known duration and/or suppression time required significantly less time to extinguish and were more benign.

This difference may be attributed to the following factors.

- Higher-energy loads are fed from the non-1E (e.g., Reactor Coolant/Feed Pump) than from 1E switchgears where the largest loads are RHR pumps.
 - The feed breakers in a 1E switchgear run near full current during power operations, while non-1E switchgear current varies with plant operating modes.
 - Testing and maintenance practices differ between 1E and non-1E switchgears. Class 1E switchgears typically get more preventative maintenance on breakers and thermography of the cabinets and bus bars. This observation is, however, not quantified at this time. Further review of these events and tie-in to the bases, such as those listed above, would be necessary.
5. HEAFs occurring in 480V switchgears did not report damage beyond the switchgear itself, but some resulted in the cabinet opening.
 6. Manual firefighting operations may be delayed due to uncertainty in the specific location of the fire.
 7. Initial use of fire extinguishers may be ineffective in severe HEAF events regardless of the extinguishing agent (CO₂, Halon, or dry chemical). The fires were eventually suppressed with water by the fire brigade.
 8. No conclusions can be made regarding the effectiveness of fixed fire suppression systems. Only one event was successfully suppressed with an automatic Halon system.
 9. Durations of the fires involving HEAF range from minutes to over an hour. The short durations generally reflect events that do not result in large ensuing fire(s), either in the device itself or external fires.
 10. Sustained fires after the initial HEAF involve combustible materials (cable insulation, for the most part) near the cabinet.
 11. Damage may extend to cables and cabinets in the vicinity of the high-energy electrical cabinet.
 12. Damage to cabinet internals and nearby equipment (if observed) appears to occur relatively early in the event.
 13. In about half of these events, the damage is limited to the electrical device.

Table M-1
Summary of the High-Energy Arcing Faults for Switchgears and Load Centers in the U.S. Nuclear Power Industry:
1979 through 2001

	Event	Initiating Electrical Component	Summary of the Event¹	Notes on Zone of Influence
1	FEDB INO = 175 Date = 11/27/79 Loc = Aux Bldg SWGR Ext. = Self-ext. Duration = 39 min Supp time = N/A No LER Not included in HEAF frequency	480V Switchgear/ bus (1E?)	A loud noise and alarms came from the control room and the reactor was manually tripped. A flash was observed at the base of the 480V No. 1 switchgear. The flame self-extinguished and the fire brigade confirmed only smoke was present.	The description of the event does not mention damage external to the cabinet.
2	FEDB INO = 434 Date = 08/02/84 Loc = Turb. Bldg SWGR Ext. = Auto halon Duration = 1 min Supp time = 1 min LER (Yankee Rowe) Included in the HEAF frequency as an undetermined (counted as 0.5 of an event)	480V Switchgear (1E?)	During normal operation in Mode 1, a fault occurred in the 480 V supply ACB to bus 4-1 that resulted in 4-1 Bus isolation, fire detection initiation, and halon discharge. The fire brigade responded as required to verify that fire was out. The cause of the fault was attributed to high resistance in the main disconnecting contacts of the center phase of the ACB which caused an arc to propagate to the outside phases.	From the description, it may be inferred that the damage to the switchgear was substantial (scram, 13-day outage, and \$50-100K loss). Enough smoke to activate an automatic system. The description of the event does not mention any damage external to the switchgear.
3	FEDB INO = 498 Date = 12/03/85 Loc = Turb. Bldg SWGR Ext. = De-energized Duration = 10 min Supp time = N/A LER no. 85 028 00 (Crystal River 3) Not included in HEAF frequency	6900V Switchgear (non-class 1E)	A serviceman near the breaker suffered first and second degree burns. No evidence of a sustained fire found. The room contained large volumes of smoke, so ventilation of the room was started using portable smoke ejectors. Damage was limited to the breaker cubicle.	The cubicle door was blown open and a fire door nearby was scorched and opened. The switchgear was opened, damage within ZOI observed.

Table M-1

**Summary of the High-Energy Arcing Faults for Switchgears and Load Centers in the U.S. Nuclear Power Industry:
1979 through 2001 (Continued)**

	Event	Initiating Electrical Component	Summary of the Event¹	Notes on Zone of Influence
4	<p>FEDB INO = 947 Date = 01/03/89 Loc = Turb. Bldg SWGR Ext. = Fire Brigade Duration = 59 min Supp Time = 46 min LER no. 269 89 002 (Oconee 1)</p> <p>Included in the HEAF frequency</p>	6900V Switchgear (non-class 1E)	CO ₂ fire extinguishers were used for the first time around 15 minutes after the fire brigade was dispatched. The fire was not suppressed. Dry chemical extinguishers were used 8 minutes after the CO ₂ extinguishers. The fire was not suppressed. Eighteen minutes after the dry chemical extinguishers were used, the fire brigade decided to use water fog on the fire. Fire reported out 15 minutes later. Internal components in the switchgear caught fire. Cables near the switchgear fire caught fire. The event lasted around 60 minutes.	<p>The event shows significant damage to the breaker cubicle (blown-off door on the back). With regards to horizontal damage, even though no target was located directly in the sight of the breaker cubicle, it is evident from the debris that any target within 1.04 m (3-5') would have been affected by the high-energy event. It is not clear what the functional failure would have been if a cabinet was located 1.04 m (3-5') in the back of the breaker cubicle.</p> <p>Smoke damage was observed in the adjacent cubicles. Fire in internal components and nearby cables evidenced the possibility of a sustained fire after the high-energy arcing fault.</p> <p>The switchgear was opened, damage within ZOI observed.</p>
5	<p>FEDB INO = 678 Date = 03/02/88 Loc = Turb. Bldg SWGR Ext. = De-energized, Self Ext. Duration = N/A Supp Time = N/A LER no. 305 88 001 (Kewaunee)</p> <p>Not included in HEAF frequency</p>	Bus bar/Bus duct	A 10' section of the bus bar running from the main auxiliary transformer to the bus switchgear (1-1 and 1-2) was damaged due to installation failure and a subsequent fault. The differential current protection functioned as designed and opened all breakers on the affected protection zone. This deenergized the affected bus and terminated the fire. During normal operations, a combination of insulation failure, debris accumulation, and possibly water resulted in an electrical fault in a main (4000 amp) power bus bar. In addition to damage to the affected bus, "several non-safety related cables located in a cable tray adjacent to the bus experienced insulation failure."	<p>Damage to cables in a tray adjacent to the bus bar. The distance between the bus bar and the cable tray is unclear.</p> <p>Damage within ZOI observed.</p>

Table M-1
Summary of the High-Energy Arcing Faults for Switchgears and Load Centers in the U.S. Nuclear Power Industry:
1979 through 2001 (Continued)

	Event	Initiating Electrical Component	Summary of the Event¹	Notes on Zone of Influence
6	FEDB INO = 922 Date = 07/10/87 Loc = Turb. Bldg SWGR Ext. = De-energized Duration = N/A Supp Time = 3 minutes LER no. 305 87 009 (Kewaunee) Not included in HEAF frequency	4160V Bus bar (non 1E?)	Insulation on a 4160 V bus bar, located in the Turbine Building, failed. This condition resulted in a phase to ground fault which caused extensive damage to the bus bar and a fire. The bus fire terminated once the transformer was deenergized. A smaller fire was extinguished by the equipment operator when rags and rubber goods on a maintenance cart were ignited by the falling aluminum slag. Equipment damage was limited to a 30' section of the bus-bar from the main auxiliary transformer to buses 1-3, 1-4, 1-5, and 1-6. There was no other equipment damage as a result of this event. Bus bar is a 1/2" by 4" flat aluminum bar, full round edge, and rated at 3000 amps. All three phases of the bus work is insulated with flame retardant insulation and supported on molded flame retardant glass polyester supports. (LER)	Falling aluminum slags igniting transient combustibles. The distance is not clear from the description. Potential damage within ZOI.
7	FEDB INO = 1510 Date = 07/10/87 Loc = SWGR Ext. = Self Ext. Duration = < 5 minutes Supp Time = N/A no LER Not included in HEAF frequency	4160V Switchgear/ transformer	Operator found smoke from the 4160 switchgear. Further inspection discovered that the smoke was coming from the potential transformer cubicle. The transformer was found to have a hole in the top of it. The fault was localized to transformer itself. No damage to any other component was observed.	Damage was limited to the transformer cubicle. The transformer was on fire. All other components in the switchgear were in good condition. The switchgear was opened, no damage within ZOI reported.
8	FEDB INO = 2175 Date = 06/10/95 Loc = Turb. Bldg Ext. = Fire brigade Duration = N/A Supp Time = 57 min (from LER) LER event (Waterford 3) Included in the HEAF frequency	4160V Switchgear (non-class 1E)	An operator notices smoke in the TGB switchgear. Twenty-nine minutes after operator notices smoke, a fire is reported above the A2 switchgear. The fire brigade attempted to extinguish the fire using Halon, CO ₂ , and dry chemical extinguishers. 43 minutes after the initial attempt to extinguish the fire with fire extinguishers, the offsite Fire Department applies water to the insulation above the A2 bus.	Major damage to two cubicles. 3 m (10') of feeder cable destroyed. External heat damage to jackets of four of 15 feeder cables. Burnt marks on cable conduits.

Table M-1
Summary of the High-Energy Arcing Faults for Switchgears and Load Centers in the U.S. Nuclear Power Industry:
1979 through 2001 (Continued)

	Event	Initiating Electrical Component	Summary of the Event ¹	Notes on Zone of Influence
			<p>The degree of damage to the breaker and surrounding equipment indicates that the fault energy of the breaker was extremely high. Due to the extent of the damage during this failure, evidence normally utilized to evaluate the conditions of the circuit breaker was not available. The arc chutes were destroyed, the contact structures were damaged extensively, and the breaker frame and cubicle were also damaged. The main bus and bus compartment experienced severe arcing damage. The center phase (A phase) of the breaker sustained the worst damage. The right phase (B phase, looking at the front of the breaker) arcing contact was hardly damaged, the middle phase arcing contact was totally destroyed, and the left one (C phase) was partially destroyed. The main contacts on all the phases were destroyed.</p>	<p>The switchgear was opened, damage within ZOI observed.</p>
			<p>The fire caused major damage to the #1 & #2 cubicles and destroyed approximately 10' of the feeder cables. Cubicle #1 contained the 4160 volt feeder from the Unit Auxiliary Transformer (UAT) and Cubicle #2 contained the Potential Transformer and associated relays and components. There was general smoke and slight heat damage to the exterior of the remaining cubicles in the A2 bus. In addition, there was external heat damage to the jackets of four of the 15 feeder cables from the Start Up Transformer (SUT) to the A2 bus. There were also burn marks on the conduit of the cables, which supply 6.9 KV to RCP 1A and 2A motors.</p>	

Table M-1
Summary of the High-Energy Arcing Faults for Switchgears and Load Centers in the U.S. Nuclear Power Industry:
1979 through 2001 (Continued)

	Event	Initiating Electrical Component	Summary of the Event ¹	Notes on Zone of Influence
			Although the heat release rate was undoubtedly large (estimated to be much larger than in most switchgear fires), severe damage was limited to two cubicles on the A2 bus and the cables in the UAT A to A2 bus duct. Minor damage occurred to the SUT A to A2 bus duct and adjacent A2 and A1 switchgear cubicles. The B train of offsite power (SUT B to B2 and its bus duct tie to B3) was not affected. The two trains of offsite power are well separated; the bus ducts are physically separated by about 20' and a concrete block radiant shield separates the switchgear cubicles themselves.	
9	FEDB INO = 2197 Date = 04/12/94 Loc = Switchgear Rm Ext. = Self Ext. Duration = N/A Supp Time = N/A no LER Not included in HEAF frequency	4160V Switchgear	4Kv breaker failed with fireball and smoke. The fire apparently was self-extinguished. (EPRI FEDB) During an attempted start of a pump in Unit 1, a breaker opened due to a fault, which resulted in a flash of fire and smoke. There was no continuing fire. The bus bar/stab connections had arced and sparked, and were found to be badly discolored, pitted, and deformed. Some corrosion was also found. (Plant FPE)	Not enough information for developing a ZOI.
10	FEDB INO = 2336 Date = 08/22/90 Loc = Switchgear Rm Ext. = Portable extinguishers Duration = 0-5 minutes Supp Time = N/A no LER Not included in HEAF frequency	480V MCC?	Incident Report Number 1-90-52. While removing Clearance 594741 on HS-P-1B places MCC pan back on bus, closed cubicle door and turned line starter on. At the local pump controller the operator noted the green 'off' light flickering. When the control switch was placed to the "on" position, a loud explosion was heard. Smoke and flames were seen at MCC 1-12 Cubicle B (located in normal switchgear room in the control building). Cubicle door had blown open, MCC had tripped, and Control Room noted loss of "F" 480 volt substation. A CO ₂ fire extinguisher was used by the operator to extinguish the fire. MCC inspection revealed what appears to have been shorted bus-bars. Motor was cool to the touch. Both MCC supply breaker and substation feeder breaker tripped on overcurrent. It is suspected that a piece of foreign material (possibly broken stab spring) was jarred loose when contactor on MCC pan was pulled in resulting in a phase-to-phase short.	The MCC was opened, no external damage is mentioned.

Table M-1

**Summary of the High-Energy Arcing Faults for Switchgears and Load Centers in the U.S. Nuclear Power Industry:
1979 through 2001 (Continued)**

	Event	Initiating Electrical Component	Summary of the Event¹	Notes on Zone of Influence
11	FEDB INO = 2489 Date = 07/13/90 Loc = Switchgear Rm Ext. = Self Ext. Duration = 0-5 minutes Supp Time = N/A no LER Not included in HEAF frequency	4KV Switchgear	While discussing the installation of an additional current transformer on the bus side of a 1200 amp breaker in a 5KV breaker cabinet in Unit 2, one of the electricians contacted energized 4KV feed cables with his left arm and right side of his chest. An explosion resulted which killed the electrician, and injured three others. The only fires that resulted were on the electrician that was killed, and another electrician standing nearby. The fires were extinguished with a fire extinguisher. (Plant FPE)	Not enough information for developing a ZOI. It is unclear how close the serviceman was to the breaker or how the injuries occurred.
12	FEDB = 2424 ² Date = 02/03/01 Loc = Switchgear Rm Ext. = Fire brigade, portable ext. Duration = 136 min Supp Time = N/A LER event (San Onofre 3) Included in the HEAF frequency	4160V Switchgear (non-class 1E)	<p>The event was caused when a breaker faulted and started a fire within the breaker cubicle. Ionized gases and smoke diffused through cable passages between adjacent cubicles and entered the Reserve Auxiliary Transformer feeder breaker cubicle. The fire consumed much of the breakers nonmetallic parts and caused substantial melting of current carrying components. Five cabinets in the bus were replaced/rebuilt. This includes replacement of electrical equipment and cables that were either burned directly or damaged by the fire.</p> <p>Fire brigade is dispatched after the alarm. Three minutes later there is knowledge about the room location of the fire. Seven minutes after the alarm, the fire brigade arrives at the scene. Four minutes after the fire brigade arrives it is determined that the fire is in the switchgear cabinet. Two minutes later, fire extinguishers were used. Suppression appears not to be effective. Around two hours later, the cabinet was opened and flames were observed inside. Fire extinguishers were used again, but they were ineffective. Two minutes later, water was applied and fire was finally extinguished.</p>	<p>Damage to the entire bus.</p> <p>Evidence of a sustained fire burning internal combustibles and cable trays above.</p> <p>Back wall of the cabinet was blown open.</p> <p>Damage to a front cabinet 1.4 m (4.5') away. Not clear how and when this cabinet ignited.</p> <p>Ignition of trays 0.6, 1.8, and 2.3 m (2', 6', and 7.5') above cabinet. Not clear when lowest tray ignited.</p>

Table M-1
Summary of the High-Energy Arcing Faults for Switchgears and Load Centers in the U.S. Nuclear Power Industry:
1979 through 2001 (Continued)

	Event	Initiating Electrical Component	Summary of the Event ¹	Notes on Zone of Influence
			<p>The back cabinet wall was blown open. Three trays above the cabinet were damaged primarily due to the ensuing fire. The trays were located 2', 6', and 7'-6" above the top of the cabinet.</p> <p>A front cabinet, 4'-6" away was also damaged. Damage included doors, and protective relays. This cabinet required breaker overhaul. Smoke penetration and cleaning required in other cabinets.</p>	
13	<p>FEDB = 1030 Date = 05/24/95 Loc = Turbine building Ext. = Self-extinguished Duration = < 5 min Supp Time = N/A</p> <p>Not included in HEAF frequency</p>	MCC	<p>On May 24, 1995, at 12:49 p.m. Unit 2 was manually tripped from 100% power due to the lose of five out of six circulating water pumps (CWP) that resulted from a ground fault inside a non-safety-related motor control center (MCC). The root causes of this event were: (1) plant equipment improperly restored to service; and (2) the assessment of the potential risk to plant personnel and equipment safety was less than adequate. This event did not result in any significant nuclear or personnel safety consequences. Corrective actions included repair and restoration of the affected MCC, inspection of similar MCCs, strengthened expectations and work practices to increase personnel safety, reduced equipment hazards, and trip potentials.</p>	<p>Not enough information for developing a ZOI. No damage external to the MCC cubicle is reported.</p>

Table M-1
Summary of the High-Energy Arcing Faults for Switchgears and Load Centers in the U.S. Nuclear Power Industry:
1979 through 2001 (Continued)

	Event	Initiating Electrical Component	Summary of the Event ¹	Notes on Zone of Influence
			<p>At the time of the event, a plant Control Electrician was performing an independent pre-job walkdown evaluation (i.e., nonintrusive visual inspection) of a previously identified deficiency concerning missing mounting screws from a bus cover inside the back of MCC 208. The inner bus cover is secured in place with two bottom screws. He opened the main door on the back of Cubicle 14 (the rear of the cubicle has three entrances: a hinged door in the center, and outer cover plates at the top and bottom), looked into the upper section, and observed the inside bus cover plate out of its normal position, angled away from the bus bar. In order to get a clearer look at the inner cover plate, the Control Electrician retrieved a 4' step-ladder, removed the upper cover plate, and set it on the floor. He climbed up the ladder (keeping his flashlight outside the cubicle) and looked into the upper section for about 10 seconds. He saw the inner cover plate start to shift, heard a loud explosion, and found himself standing on the floor. He was not injured. He was wearing a hard hat and safety glasses. The safety glasses aided in preventing a potential eye injury, which involved metal splatter from the resultant electrical arc. The Control Electrician contacted his Assistant General Supervisor (AGS) reporting his near miss incident and the electrical explosion at MCC 208. The AGS dispatched supervisory personnel to MCC 208 and informed the Control Room of the incident.</p>	

Notes

1. The notes are based on additional information obtained from the plant in the form of internal plant fire event documentation (e.g., condition report) or/and communication with plant fire protection professionals.
2. This event is not included in the generic frequency calculation or the suppression curve because it occurred after the cutoff date of 12/31/2000.

M.4 Damage Characterization During the Energetic Phase (Zone of Influence)

The ZOI for HEAF events during the energetic phase is based on the reports mentioned above, particularly those events involving ensuing fires. The ZOI is intended to capture the damage generated by the energetic phase of a HEAF scenario.

M.4.1 General Room Heat Up

In general, the energy released from an energetic (or explosive) arcing fault does not contribute to considerable room heat-up. This energy can be estimated in a few ways. One of the more conservative methods is to multiply the operating voltage of the component (circuit breaker, switch, etc.) by the maximum available fault current, also multiplied by the duration of the energetic event. For example, if a 4160 V circuit breaker is located in a switchgear panel that coordination studies have shown to have a maximum available fault current of 5000 amperes, and the rapid disassembly of the circuit breaker occurs over a period of 100 ms, the conservative estimate of potential energy released to the compartment/room from the explosive failure of the breaker is conservatively estimated as

$$Q = (4160 \text{ V}) \cdot (5000 \text{ A}) \cdot (0.100 \text{ s}) = 2 \text{ MJ}.$$

The energy release determination calculated above is very conservative, in that it assumes the arc characteristics remain constant over the duration of the event, which is not likely to be the case. For example, in the method provided here, the arc voltage is assumed to be equal to the service voltage of the circuit breaker. However, the true voltage drop across the arc can be an order of magnitude or more lower than the operating voltage of the switchgear. The increase in compartment/room temperature from the energy released from the arcing fault is conservatively determined by assuming the volume of air in the room as a single body and calculating the expected temperature rise by

$$\Delta T = Q / (m_a \cdot C_p),$$

where m_a is the product of the mass density of the air in the compartment and the volume of the compartment, and C_p is specific heat capacity of air. Each of these quantities should be determined for the temperature and pressure conditions existing in the compartment immediately prior to the event. Thus, for the 2MJ energy deposition estimated above, the corresponding temperature increase of a 1000 cubic meter compartment will be

$$\Delta T = 2\text{E}6 \text{ J} / [(1000 \text{ m}^3) \cdot (1.225 \text{ kg/m}^3) \cdot (998 \text{ J/kg-K})] = 1.6 \text{ K} (1.6^\circ\text{C}).$$

The example calculation of room temperature rise due to the energetic phase of the HEAF event discussed above suggests that the temperature rise in the room is in the order of less than 10°C, and therefore negligible as a fire hazard. That is, the room will remain near its ambient temperature immediately after the arcing fault. As a result, any ensuing fire should be modeled in accordance with the approach provided in Task 11 and related appendices.

M.4.2 High Energy Zone of Influence

In the case of electrical cabinets of the type mentioned above, the fault is initiated as the result of electrical arcing either between one phase and ground, or phase-to-phase. The fault typically occurs on the feed side of the equipment (i.e., in the electrical sense, that side of the component where power feeds into the device rather than the output side of the device). Fire growth and damage for the arcing fault fire is characterized by the following features/assumptions.

- The initial arcing fault will cause destructive and unrecoverable failure of the faulting device, e.g., the feeder breaker cubicle, including the control and bus-bar sections.
- The next upstream over-current protection device in the power feed circuit leading to the initially faulting device will trip open, causing the loss of all components fed by that electrical bus. This fault may be recoverable if the initial faulting device can be isolated from the feeder circuit.
- The release of copper plasma and/or mechanical shock will cause the next directly adjoining/adjacent switchgear or load center cubicles within the same cabinet bank and in all directions (above, below, to the sides) to trip open.
 - If the first adjoining cabinet section is essentially empty, then the next adjoining cabinet section will be assumed to trip open (e.g., the central sections of a switchgear bank often include a cross-tie cabinet section that is essentially empty).
 - The cabinet or cabinet section in which the initial arcing fault occurs will be blown open by the initial energy release.
- The subsequent (or enduring) cabinet fire will continue to burn consistent with a fire intensity and severity described in Appendices E and G of the Detailed Fire Modeling procedure, respectively.
- Any unprotected cables that drop into the top of the panel in an open air-drop configuration will ignite.
 - Cables in conduit or in a fire wrap are considered protected in this context. In other words, if cables are protected (i.e., not exposed) by conduit or fire wrap, they are assumed damaged, but not ignited, and they do not contribute to the fire load.
 - Armored cables with an exposed plastic covering are considered unprotected in this context.
- Any unprotected cables in the *first* overhead cable tray will be ignited concurrent with the initial arcing fault provided that this first tray is within 1.5 m (5') vertical distance of the top of the cabinet. The cable tray fire will propagate to additional trays consistent with the approach provided for the treatment of cable tray fires elsewhere in this document, assuming that the time to ignition of the first tray is zero rather than the normal 5 minutes.
 - This applies to any cable tray located directly above the panel.
 - This applies to any cable tray above the aisle way directly in front of, or behind, the faulting cabinet, provided some part of that tray is within 0.3 m (1') horizontally of the cabinet's front or rear panel.
 - Cables in conduit or in a fire wrap are considered protected in this context.
 - Armored cables with an exposed plastic covering are considered unprotected in this context.

- Any vulnerable component or movable/operable structural element located within 0.9 m (3') horizontally of either the front or rear panels/doors, and at or below the top of the faulting cabinet section, will suffer physical damage and functional failure.
 - This will *include* mobile/operable structural elements like fire dampers and fire doors.
 - This will *include* potentially vulnerable electrical or electromechanical components such as cables, transformers, ventilation fans, other cabinets, etc.
 - This will *exclude* fixed structural elements such as walls, floors, ceilings, and intact penetration seals.
 - This will *exclude* large components and purely mechanical components such as large pumps, valves, major piping, fire sprinkler piping, or other large piping (1" diameter or greater).
 - This may *include* small oil feed lines, instrument air piping, or other small piping (less than 1" diameter).
- Exposed cables, or other exposed flammable or combustible materials or transient fuel materials located within this same region (0.9 m (3') horizontally) will be ignited.

In the case of bus ducts, the following equipment should be assumed damaged and/or ignited.

- The entire length of the bus duct.
- Any cable (damage or ignition) or combustibles (ignition only) immediately adjacent to the bus duct.
- Equipment connected to the bus duct.
- If there are fire barriers along the length of the bus duct, these can be credited to limit damage and/or ignition. It may be assumed that the damage and/or ignition from a arcing fault in the bus duct is limited to one side of the fire barrier, except when analyzing multicompartiment fire scenarios that account for failure of the fire barrier(s).

Figure M-1 is a pictorial depiction of the damage ZOI during the energetic phase of a HEAF for a switchgear or load center.

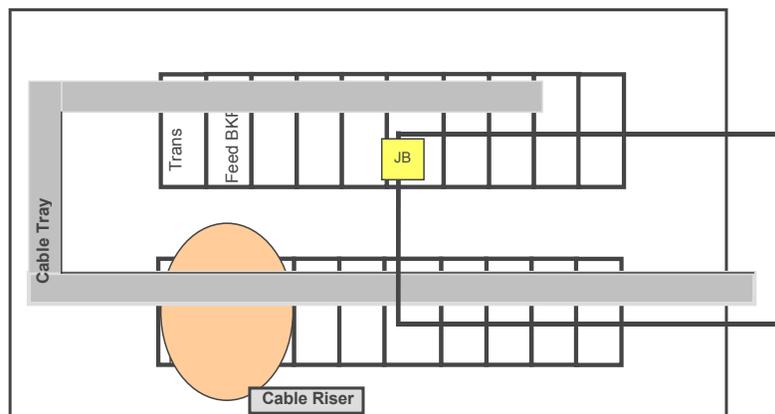


Figure M-1
ZOI for the Energetic Phase of a HEAF

M.5 Characterization of Detection/Suppression During the Energetic Phase

Suppression of a fire that begins with a HEAF introduces a number of unique challenges. The review of such events in the U.S. nuclear power industry, documented in Section M.2 of this appendix, lists some of these challenges.

The following approach may be used in crediting suppression involving HEAFs.

The energetic phase of such events occurs so fast that neither automatic nor manual suppression systems can prevent against damage and ignition within the ZOI (Section M.3).

- The amount of smoke from any damaging HEAF event expected to activate any smoke detection system in the area.
- Manual suppression by plant personnel and the fire brigade may be credited to control and prevent damage outside the initial ZOI from ensuing fires. Separate suppression curves are developed for these fires documented in Appendix P to the Fire Modeling procedure.

M.6 Modeling High-Energy Arcing Faults in the Fire PRA

The following steps are recommended when modeling a HEAF in a Fire PRA.

1. Identify the equipment in the room where a HEAF can be generated. As indicated earlier, this equipment includes, for the most part, 4160 V and 480 V switchgear cabinets, load centers, and bus bars.
2. Two types of initiating events should be postulated for each identified equipment:
 - a. A HEAF event with an ensuing fire, and
 - b. A regular equipment fire (no HEAF).

M.6.1 Risk Quantification of High-Arcing Fault Events

The two phases of the HEAF events should be analyzed as follows.

- For the energetic phase (Phase 1):
 - Assign a generic frequency for HEAFs listed in Task 6, and apportion it with the location and ignition source weighting factors to the equipment under analysis. Note that this frequency is calculated using events in which an ensuing fire was observed. Table M-1 indicates which events were included in the fire frequency.
 - Assume targets in the ZOI are damaged at time zero.
 - The probability of no manual suppression for the targets in the ZOI is 1.0.
 - The severity factor for a scenario consisting of targets in the ZOI only is 1.0. Note that the generic frequency was calculated using those events in which an ensuing fire was observed and there was immediate damage in the vicinity of the cabinet (ZOI).

- For the ensuing fire after the energetic phase (Phase 2):
 - Assign a generic frequency for HEAFs listed in Task 6, and apportion it with the location and ignition source weighting factors to the equipment under analysis.
 - The probability of no manual suppression for targets outside the ZOI can be calculated using the detection suppression event tree described in Appendix P, with the HEAF manual suppression curve.

In summary, the risk of a HEAF scenario can be estimated as:

$$CDF_i = \lambda_g \cdot W_L \cdot W_{is} \cdot P_{ns} \cdot ccdp_i,$$

where:

λ_g = the generic frequency for HEAFs,

W_L = the location weighting factor,

W_{is} = the ignition source weighting factor,

$ccdp$ = the CCDP for a scenario including targets in the ZOI only,

P_{ns} = the probability of no suppression. If all targets are inside the ZOI, a value of 1.0 should be assumed. If there are postulated targets outside the ZOI, the probability of no suppression can be calculated following the approach provided in Appendix P using the manual suppression curve for HEAFs.

M.6.1.1 Example

Consider a HEAF scenario consisting of a switchgear cabinet affecting two targets. A stack of three cable trays is above the cabinet. The first tray in the stack is 0.9 m (3') above the cabinet. It has been determined that one of the targets is in the first tray. The other target is in the third tray.

According to the approach provided in Section M.3, the first target is assumed ignited at the time of the HEAF. The second target is damaged at time 7 minutes (4 minutes for fire propagation from the first to the second tray, and 3 minutes for fire propagation from the second to the third tray).

The CDF associated with a scenario involving damage only to the first target is calculated as $CDF_i = \lambda_g \cdot W_L \cdot W_{is} \cdot CCDP_i$, where the CCDP calculation assumes only the first target damaged. A CDF for a scenario involving the two targets damaged can be calculated as $CDF_i = \lambda_g \cdot W_L \cdot W_{is} \cdot P_{ns} \cdot CCDP_i$, where the probability of no suppression before damage to the second target is calculated as described in Appendix P and the CCDP calculation assumes both targets are damaged.

M.6.2 Risk Quantification of Regular Cabinet Fires

The quantification of scenarios involving regular fires (no high energy phase) in equipment that can produce HEAFs follows the process described in Tasks 6 and 11. The CDF is calculated as

$$CDF_i = \lambda_g \cdot W_L \cdot W_{is} \cdot SF \cdot P_{ns} \cdot CCDF_i,$$

where the severity factor and the probability of no suppression are calculated using the probability distribution for heat release rate and suppression curve developed for electrical cabinets.

M.7 References for Appendix M

- M.1 J.W. McBride and P.M. Weaver, *Review of Arcing Phenomena in Low Voltage Current Limiting Circuit Breakers*, IEE Proc.-Sci. Meas. Technol., Vol. 148, No. 1, January 2001.

Appendix N

Appendix for Chapter 11, Hydrogen Fires

N

APPENDIX FOR CHAPTER 11, HYDROGEN FIRES

This appendix describes the characteristics of hydrogen fires and explosions based primarily on observations gleaned from the fire event database [N.1]. Empirical rule sets for the development of hydrogen fire scenarios are also provided. This appendix does not extend the discussion to the selection and application of computational fire modeling tools given that verification and validation efforts were outside the scope of this program (as noted previously). While the application of computation fire modeling tools may be desirable, the selection of appropriate tools is left to the analyst.

The discussions in this appendix are based on the assumption that the compartment or area of the plant where a hydrogen source has been identified could not be screened out, requiring some detailed analysis of the hydrogen fire and its consequences in terms of potential damage to the plant equipment needed for post-fire shutdown.

To perform a detailed analysis of fires and explosions involving hydrogen gas, the following steps may be followed:

- Hydrogen source characterization,
- Scenario postulation,
- Estimation of potential damage level, and
- Probability assessment of postulated scenarios.

Each element of this overall approach is discussed separately in Sections N.2 and N.3. Some background information on the characteristics of hydrogen, areas of typical nuclear power plants (NPPs) where hydrogen can be found, and hydrogen fire and explosion incidents that have occurred in the U.S. nuclear power industry are provided in Section N.1.

N.1 Background

Hydrogen is a colorless, odorless, tasteless gas and has no known toxic properties for humans. It is highly flammable and explosive, and burns with a colorless, invisible flame. Hydrogen may ignite when exposed to heat, flame, or oxidizers. The recommended approach to fight hydrogen fire is to stop the flow and extinguish the flame only when it is absolutely necessary [N.2]. Formation of a flammable gas cloud is the primary concern of this recommended fire fighting approach. Some relevant properties of hydrogen gleaned from various sources in the public literature are summarized in Table N-1.

It is important to note that even though the auto-ignition temperature of hydrogen is relatively high (in relation to other flammable gases), one cannot conclude that the probability of ignition, in the absence of an ignition source, should be low. Catalytic effects of metals and other materials that may be present in the release area can lower the auto-ignition temperature significantly, leading to a high probability of ignition. Hydrogen can also be ignited by very low energy ignition sources that would not generally be expected to ignite other flammable materials. Hydrogen also has an extremely wide range between the upper and lower flammability limits as illustrated in Table N-1. That means that virtually any hydrogen/air mixture one might encounter in practice may be assumed to be ignitable. When allowed to mix with air before burning, hydrogen also displays a propensity towards deflagration and/or detonation with the associated transient pressure pulse effects.

**Table N-1
Some Properties of Hydrogen (Gleaned from [N-2 through N-6])**

Parameter	Value ⁽¹⁾
Molecular weight	2.02
Specific gravity Gas Liquid	0.07 (air=1) 0.07 (water=1)
Boiling temperature	-253°C
Freezing point	-259°C
Auto-ignition temperature	560°C
Flammability limits, volume % Lower Higher	4.1% 74%
Heat of combustion	119,950 kJ/kg
Latent heat of vaporization	0.45 kJ/mole
Specific Heat Ratio	1.41
Critical Conditions Abs. Pressure Abs. Temp.	13.0 bar 33.3°K

N.1.1 Hydrogen in Nuclear Power Plants

Pure or high-concentration hydrogen can be found in the following areas of a nuclear power plant:

- Main generator (hydrogen is used as a coolant),
- Volume Control Tank (VCT) of PWRs (hydrogen is used as a cover gas),
- Hydrogen water chemistry installation of some BWRs (hydrogen is fed into the system),
- Hydrogen storage tanks (main source of hydrogen gas to the various applications in a plant),

- Battery rooms (hydrogen may be released during battery charging process),
- Waste Gas System of PWRs, and
- Offgas Recombiner System of BWRs.

The quantity, concentration, temperature, pressure, and other conditions of hydrogen vary significantly among these applications or systems.

Hydrogen is delivered to a plant either in a bank of large horizontal cylinders fastened to a tractor-trailer that stays on site until empty, or in a tanker truck that unloads its cargo into a stationary vessel. Hydrogen is stored either as pressurized gas or as cryogenic liquid. In the latter case, an evaporator is used to generate hydrogen gas. Hydrogen gas is typically piped from the storage tanks to the main generator and other large users. Therefore, pressurized hydrogen piping may be found in a typical Turbine Building and sometimes in the Auxiliary Buildings of PWRs.

Hydrogen may be generated during battery charging process. Generally, the concentration of hydrogen would not reach its flammable or explosive level. However, as it is experienced in nuclear power and other industries, under abnormal conditions (e.g., improper venting or failure of mitigative equipment), an explosive mixture may be realized. Similarly, the waste gas system in PWRs and offgas system in BWRs may contain a sufficient amount of hydrogen to form, also under abnormal conditions, explosive mixtures.

N.1.2 Hydrogen Fire and Explosion Experience

A number of hydrogen fire and explosion events have occurred in U.S. NPPs. From a review of event descriptions provided in [N.1], the following observations were noted:

- Forty-four hydrogen fires and explosions occurred in the Offgas System of BWR plants in the U.S. Of these, 36 were labeled as challenging or undetermined events (see definition under Appendix C) with potential risk implications. The following comments regarding these events is in order.
 - There is considerable decline in the frequency of BWR Offgas System fires in the U.S. industry. Of the 36 events contributing to the frequency of such fires and explosions, 27, six, and three occurred in the 1970s, 1980s and 1990s, respectively.
 - Several BWR Offgas System explosions involved a wide range of damage and injury levels. Generally component failures or operational upsets led to such events.
 - Hydrogen leaks from BWR Offgas Systems were sufficient to cause an explosion and fire.
 - In a few cases, hydrogen explosion within a BWR Offgas System had sufficient energy to blow out doors and cause damage outside of system boundaries.
 - In one case, an event report indicated that the building was demolished.
 - When removing a sump cover, in one of the reported incidents related to a BWR Offgas System, a hydrogen explosion injured several people.
 - An explosion occurred in a valved-off part of the Offgas System because of a leaking isolation valve.

- Fourteen hydrogen fires involving the main generator were reported in the industry, 12 of which were labeled as challenging with one as undetermined.
 - Given the presence of hot surfaces nearby, it seems that, in several cases, hydrogen ignited upon release to the atmosphere.
 - In one case, hydrogen exploded and damaged the excitor housing, but not the excitor itself or the main generator.
 - Manual control of a drain tank level caused hydrogen gas to escape from the generator, which then ignited and caused a fire.
- Six fires were reported involving the hydrogen storage tanks. Three of these fires were labeled as challenging. All three fires occurred outdoors in hydrogen storage facilities, or tank farms.
 - Static electricity caused by the escaping hydrogen was suspected to be the cause of ignition for leaking hydrogen from a storage cylinder in the plant yard.
 - A hydrogen storage tank relief valve opened while a delivery truck was unloading into the tank. The hydrogen exploded and caught fire. Apparently, the relief valve failed to reseal. Plant personnel decided that the best course of action was to allow the fire to burn itself out.
- Battery-related hydrogen fires and explosions have also been reported.
 - An explosion was experienced inside two battery cells as a result of a mishap during a battery test.
 - A maintenance-free battery exploded because of hydrogen buildup inside it.
- Hydrogen found in the radwaste gas system has also led to explosions and fires. In one case, the gas exploded, broke open a bolted man-way, and released radioactive gas into the atmosphere.
- Hydrogen piping and related apparatus in the Auxiliary Buildings and Turbine Buildings have led to fires from events like coupling leaks, welding activity, or improper routing of the hydrogen gas (valving or spool connection errors).

N.2 Evaluation of Fires Involving Hydrogen

As in the case of some fire scenarios, where computer models may not provide the best alternative to determine fire growth and damage, in the case of hydrogen fires the options are (1) theoretical formulations supported by experiments, or (2) empirical models derived from historical evidence. The second approach is recommended, because of the weaknesses in the availability of the tests relevant to the type of hydrogen uses common to NPPs.

The fire initiation frequencies provided in Task 6 include the hydrogen-related categories (bins) listed in Table N-2.

Event descriptions leading to the frequencies presented in Task 6 provide important information about the types of scenarios and potential levels of damage that may typically be experienced in a hydrogen fire and explosion event. To fully benefit from the information contained in those event descriptions, the analysis of hydrogen fire and explosion scenarios is organized around these categories. For each unscreened compartment or plant area that includes hydrogen, the analyst should identify the hydrogen fire category according to the above list. In some cases, a quantitative screening analysis may have already been completed. In those cases, the fire initiation frequencies, and therefore the applicable categories associated with hydrogen, would already be established.

Table N-2
Fire Ignition Frequencies, From Task 6

Category	No. of Challenging/ Undetermined Events
Turbine/Generator–Hydrogen	13 (including one undetermined)
BWRs–Hydrogen Recombiner	36 (including 15 undetermined)
Plant-Wide Components–Hydrogen Tanks	4 (all challenging)
Plant-Wide Components–Miscellaneous Hydrogen Fires	8 (including five undetermined)

N.2.1 Turbine/Generator Hydrogen Fires

The fires in this category only apply to the turbine generator set, the excitor, and associated hydrogen cooling and supply system. It does not apply to the hydrogen piping or vent system, which are covered in the “Plant-Wide Components–Miscellaneous Hydrogen Fires” category. These fires are discussed in Appendix O, Turbine Generator Fires.

N.2.2 Boiling Water Reactors–Hydrogen Recombiner

Fire events in this category apply to the Recombiner Systems in BWRs. The impact of 90% of the events was limited to system internals and did not cause any damage to items outside. The remaining 10% of events reported some damage outside. Observations from these events are provided below.

- An explosion occurred while an elevated release point sump cover was being removed. One person received major burns while five others received some minor exposures.
- Due to a faulty flow indicator and buildup of ice inside system piping, an explosion occurred in the off-gas building from hydrogen buildup. The building was demolished.
- A hydrogen explosion led to a fire in the filter house. The fire was extinguished with no apparent structural damage to the filter house. However, the hatch cover hinges were bent from the explosion. It was suspected that hydrogen gas leaked from the system and ignited from an arc of a relay contact.
- The blast from an explosion in the off-gas recombinder blew out a door from the building and caused injury.

Since, generally, safety-related equipment and cables are not placed or routed near the recombiners, detailed analysis of recombiner explosion may not be necessary (i.e., no ZOI developed here). However, if such a need does arise, the analyst may start the analysis by adjusting the mean frequency to reflect events that had an effect outside the system (i.e., 10% of BWRs Hydrogen Recombiner Frequency). Further probability reduction factors may be introduced based on the location of target equipment and cables with respect to the size of the system and other features such as areas where an explosion may be more likely than other areas of the system.

N.2.3 Plant-Wide Components—Hydrogen Tanks

Typically, plant hydrogen is supplied from storage tanks placed in the yard. The storage tanks may be located close to the Turbine Building or other plant structures. The hydrogen, as noted earlier in this appendix, may be stored as pressurized gas or as cryogenic liquid. In both cases, the storage tanks are maintained at a high pressure. All four events in the database involved a hydrogen leak from tanks that ignited almost immediately and formed a jet flame. Three of the tanks were located outdoors and one in a hydrogen storage area in the warehouse. Delayed ignition took place in none of the cases.

The objective of modeling fire scenarios involving hydrogen storage tanks is to estimate the probability of damage to target equipment and cables in the vicinity and damage to a structure that may lead to damaged safety-related equipment and cables.

The most severe of such events may be used to define a damage zone (or ZOI) for fires involving outdoor hydrogen tanks. The following is a summary of this event (LER: 333-99-001).

On January 14, 1999, at 12:56 hours, with the plant operating at 100 percent power, a fire was reported in the Hydrogen Storage Facility. The fire was reported to the control room by a non-licensed operator who saw the fire start after he had aligned valves at the hydrogen storage facility in preparation for putting the hydrogen injection system into service. The plant's fire brigade was dispatched and offsite fire fighting assistance was requested. Upon reaching the scene, the plant's fire brigade personnel reported seeing a *large volume hydrogen-fueled fire* in the vicinity of the hydrogen tube trailer unit. The heat of the fire potentially endangered the nearby hydrogen storage tanks. The plant fire brigade with offsite fire fighting support fought the fire until the hydrogen supply was exhausted and the fire was declared out approximately six hours later.

The most damage occurred inside the hydrogen control panel, the apparent location of the initial fire. The control panel doors were severely bent from the extreme heat and direct flame impingement. A series of tube banks run north/south on the concrete platform enclosure west of the control panel. Damage to the active bank adjacent to the control panel was severe, some due to direct flame impingement. Damage dropped drastically further away from the control panel. A tube tank trailer was located directly south, within feet, of the active bank. The fire affected the end of the trailer. The damage in this area was caused by flame impingement and radiant heat from the south side of the control panel. A galvanized fence runs behind (east) the control panel. A hole was burned in the fence. The damage was caused by flame impingement resulting from rupture of an excess flow valve on the control panel that releases hydrogen in the direction of the fence.

Based on an interpretation of event description, fire events involving H₂ storage tanks are recommended to assume damage to and ignition of combustibles within 3-4.6 m (**10-15 ft**) of the tank or outer limits of the tank farm whichever is larger.

Another option is the use of analytical methods to analyze the following types of scenarios that may contribute to damage caused by a hydrogen tank fire:

- Jet flame (immediate ignition),
- Storage tank explosion, and
- Vapor cloud explosion (delayed ignition).

N.2.3.1 Jet Flame

Pressurized gas release from a small opening and immediate ignition would lead to jet flame²⁷. Pressurized gas release may occur as a result of:

- A relief valve opening prematurely,
- A relief valve opening under excess pressure caused by an exposure fire or delivery truck driver error,
- Leaking valve packing, and
- Leaking flange.

Since most storage-tank-related fire events led to jet flame conditions, a large fraction of hydrogen storage tank fire frequency should be assigned to jet flame scenarios. A review of the literatures suggests that the adverse effects of a hydrogen jet flame are limited to its flame hazard zone; hence, the analyst may assign a conditional probability to account for the orientation of the jet flame relative to potential damage targets. In some cases, the orientation will be limited to the direction of the opening. For example, in the case of relief valves, the direction of the jet can easily be determined. To establish damage potential, one may conservatively assume that all structural elements, equipment, and cables within the flame hazard zone would fail.

N.2.3.2 Storage Tank Explosion

Storage tank explosions may occur because of an exposure fire augmented by relief valve failure to properly relieve the excess pressure. The latter may be experienced if the relief valve fails to open (e.g., an isolation valve upstream of the relief valve is closed²⁸) or the intensity of an exposure fire overwhelms relief valve capacity. An exposure fire may occur in case of a vehicle fire (a vehicle parked very close to the tanks), equipment fire (only equipment that is installed

²⁷ In case of delayed ignition, a vapor cloud explosion would occur first that would flashback to the source, leading to a jet flame. Vapor cloud explosions, should have a much larger hazard zone than a jet flame. Therefore, the formation of jet flame as a result of delayed ignition is not addressed here.

²⁸ It can be assumed that all spring-loaded relief valves may eventually open before tank pressure reaches its burst threshold.

close to the storage tanks), vegetation, fire or a transient combustible fire. In all cases, frequency of occurrence is very small. The frequency may be estimated based on plant-specific conditions and general industry data (if available).

Storage tank explosions, in addition to the shock wave, may throw projectiles in every direction. Although attempts have been made to estimate the size and energy of projectiles in an accidental explosion of vessels and rockets, the level of uncertainty in the results remains significant. Since the likelihood of an exposure fire leading to a storage tank explosion is deemed to be very small for all U.S. NPPs, it is recommended that a worst-case damage level be assumed for storage tank explosions.

N.2.3.3 Jet Vapor Cloud Explosion

A cloud of hydrogen formed by a release with no immediate ignition has the potential for exploding. Two conditions may be taken into account: (1) explosion in the open air outside the buildings, and (2) hydrogen migration into a building and explosion inside.

A review of the entire set of hydrogen fire events indicates that in a few cases, in addition to fire, an explosion took place as well, indicating accumulation of hydrogen gas and delayed ignition. In the case of hydrogen storage tank fire events, an explosion was reported in one of the four events. In that specific case, since there was no report of personnel injury or damage to surrounding equipment or structures, it was deemed that the resulting overpressure was small.

A vapor cloud explosion in the open (i.e., in the yard area) would lead to overpressure conditions impacting nearby structures. The public literature should be consulted for method to estimate the overpressure level at a distance from the center of the gas cloud, and for overpressure damage criteria. The likelihood of occurrence of this scenario is deemed to be small because if ignition does not occur upon release, hydrogen gas would rise immediately. Based on a conservative interpretation of the event data, one of the four events (25%) involved delayed ignition.

There are generally no ignition sources directly above the storage tanks. A gas dispersion analysis may be conducted to estimate the concentration of the gas as it rises and pushes forward by the wind (again, consult the public literature for appropriate tools). The concentration contours obtained from a dispersion analysis can be used to determine whether or not an ignition source will be engulfed by the gas cloud at a concentration greater than half²⁹ the lower flammability limit of hydrogen.

If ignition is possible, the analyst may estimate the time for the gas to reach the ignition source. If the time is sufficiently long, the analyst may introduce the probability of isolating a hydrogen leak or other mitigative actions that may reduce the impact of explosion. Also, the probability of wind direction and atmospheric conditions that should be within a certain range (to make it possible for the gas cloud to reach the ignition source) may be included in the analysis.

²⁹ It is common to use half the LFL concentration to account for uncertainties and variations that may be experienced within a vapor cloud.

In addition to vapor cloud explosion, the analyst may need to investigate the possibility of hydrogen gas being drawn into a ventilation system and igniting inside a building. A review of buildings and the location of their ventilation system intake openings may be conducted to establish the possibility of hydrogen intake into a building. If such a possibility exists, it is recommended to assume that ignition would occur at the worst position within the ventilation system and all equipment and cables within the affected compartments would be damaged. If this assumption leads to overly conservative results, the analyst may follow an approach similar to that described above for vapor cloud explosion in the open. The concentration of the hydrogen gas cloud at the ventilation intake point may be estimated using dispersion analysis. A ventilation system mixing ratio may also be included in the analysis to determine the conditions under which the lower flammability limit may be reached inside the ducts. Also, the position of possible ignition sources within the ventilation system and within building compartments may be considered to identify the position of the ignition point and compartments affected by an explosion.

N.2.4 Plant-Wide Components–Miscellaneous Hydrogen Fires

This category of hydrogen fires covers the hydrogen carrying equipment, valves, and piping that are not part of the previous three categories. This category also includes the hydrogen piping inside the turbine building that carries hydrogen to the generator. Note that since this category may involve several compartments within the plant, the overall frequency of “miscellaneous hydrogen fires” needs to be partitioned to establish compartment-specific frequencies. The discussions provided in this appendix are based on the assumption that the partitioning has already been completed, and a specific compartment has not screened out in previous qualitative and quantitative screening steps requiring some level of detailed analysis.

There were eight fire events in the database [N.1] in this fire initiation category that involved the following (one other event was labeled as nonchallenging to risk and excluded).

- A hydrogen explosion took place inside the radwaste gas decay tank, causing failure of a bolted manway and some welds. This is the only fire event in this category that indicates an explosion (i.e., one of the eight events, about 10%) and had an impact beyond the initial source.
- A fitting on a hydrogen carrying tubing leaked and caught fire.
- Hydrogen escaped from a valve on an RCS gas processing system and caught fire.
- Venting hydrogen ignited and caught fire.

In none of the cases was a pipe break reported.

The following characterization of a hydrogen fire involving hydrogen pipes inside plant boundaries may be used based on these events.

- Assume loss of hydrogen supply to the destination point.
- Assume that 10% of the “Plant-wide-component/Miscellaneous hydrogen fires” may lead to a damaging fire. This is based on one of eight events that reported an explosion and external damage.
- In case of an isolated hydrogen leak, of the right mixture of hydrogen and air leading to a large fire, explosion, and damage to circuits and components cannot be precluded. It is

expected that such conditions are more likely in smaller rooms. In compartments (excluding large, open areas inside a building; for example, Containment, Turbine Building, Reactor Building of a BWR, and Radwaste Building) assume room-wide damage. In larger volumes, use a 10 m ZOI as a conservative estimate. This is based on engineering judgment and supported, in part, by the fact that nothing near this range was reported in any of the eight fire events recorded in the U.S. industry.

Another alternative is to use analytical methods. In that case, the following scenario types may be considered:

- Jet flame,
- Explosion confined to the compartment of origin, and
- Multicompartment explosion.

Each scenario type is discussed below.

N.2.4.1 Jet Flame

The majority of the events (about 90%) are expected to be of this type. It can happen due to a pipe break, flange leak, valve connection leak, or any other small opening in the system. The analyst may review the equipment, piping, and valves within a compartment and postulate the most likely locations of such leaks. The damage zone of a jet flame is assumed to be limited to equipment and cables on one side of the release point within the distance defined by twice the flame length.

N.2.4.2 Explosion Confined to the Compartment of Origin

About 10% of “miscellaneous hydrogen fires” involved an explosion are of this type. The analyst may need to partition this fraction between explosions confined to the compartment of origin and multicompartment explosions. The partitioning may be done by taking into account the possibility of hydrogen gas migrating to other parts of the plant via openings in the ceiling, ventilation ducts, and openings in the wall. For a single compartment explosion, it is recommended to assume that all equipment and cables within the compartment where explosion has occurred would fail. In the case of the Turbine Building, since the building could be much larger than the volume of the exploding vapor cloud, the analyst may elect to apply vapor cloud explosion formulations to estimate the quantity of hydrogen needed to impart the postulated target damage. Again, the analyst should consult the public literature and select the appropriate modeling tools.

N.2.4.3 Multicompartment Explosion

Multicompartment explosions may be analyzed as part of the multicompartment fire analysis task. For compartments where hydrogen equipment and piping are present, a review of the ventilation system characteristics and openings between compartments may be necessary to determine the possibility of hydrogen migration among adjacent compartment. Assuming that a set of interconnected compartments is identified as potentially risk-significant, the following steps may reduce the level of conservatism in damage frequency.

- Estimate the minimum hydrogen quantity needed to have explosive mixtures in every compartment or ventilation duct within the compartments;
- Estimate the length of time needed to release the minimum quantity into the affected compartments; and
- Conduct an analysis of equipment failure and human error probabilities to estimate the probability of failure to isolate the leak given the available time.

N.3 Modeling Hydrogen Fire and Explosion

A large body of literature exists in the public domain related to thermodynamic and empirical models for fires and explosions caused by flammable gases and the impact of such phenomena on its surroundings. As noted previously, it is not the role of this report to cite or recommend any particular model as suitable to the needs of a fire PRA, nor to provide for the verification and validation of any models that might be selected by the analyst. However, a cursory review of the public literature did reveal a range of simple models and supporting data. Several references were noted from source such as the Federal Emergency Management Agency, the U.S. Environmental Protection Agency, and the American Institute of Chemical Engineers. As always, it is the responsibility of the analyst to ensure that the selected models are appropriate to the intended application.

N.4 References

- N.1 *Fire Event Database and Generic Ignition Frequency Model for U.S. Nuclear Power Plants*, EPRI, Palo Alto, CA: 2001. TR-1003111.
- N.2 “Hydrogen,” Material Safety Data Sheet, Air Liquide Corporation, http://www.airliquide.com/safety/msds/en/067A_AL_EN.pdf, Paris France, July 31, 2002.
- N.3 “Risk Management Program Guidance for Offsite Consequence Analysis,” U.S. Environmental Protection Agency, EPA 550-B-99-009, April 1999.
- N.4 “Guidelines for Evaluating the Characteristics of Vapor Cloud Explosions, Flash Fires, BLEVEs,” Center for Chemical Process Safety (CCPS), American Institute of Chemical Engineers, New York, New York, 1994.
- N.5 “Guidelines for Chemical Process Quantitative Risk Analysis”, Center for Chemical Process Safety (CCPS), American Institute of Chemical Engineers, New York, New York, 1989.
- N.6 *Handbook of Chemical Hazard Analysis Procedures*, FEMA, 1990.

Appendix O

**Appendix for Chapter 11, Turbine
Generator Fires**

O

APPENDIX FOR CHAPTER 11, TURBINE GENERATOR FIRES

A characterizing of the fire event is necessary for estimating consequences of fires involving the turbine generation. This characterization includes defining the fire size, severity, and duration of the fire event. This information is then used to determine consequence of such events using fire modeling tools as described in the main body of Chapter 11, or through definition of zone of influence (ZOI) (in this appendix) for scenarios where fire modeling tools are not appropriate, e.g., scenarios that may involve a combination of oil, hydrogen, and/or blade ejection.

O.1 Fire Events Involving Turbine-Generator System

Some of the most severe fires recorded in the nuclear power industry have involved the turbine-generators (T/G). The large quantity of turbine lubricating oil and hydrogen coolant in the generator, combined with the enormous rotational energy of the T/G are the primary reasons of the severe fire events experienced by the industry. The EPRI Fire Event Database (FEDB) [O.1] includes 40 fire event reports involving T/G that occurred during power operation. Of these fires, three are considered severe. Other severe T/G fire events have occurred at nuclear power plants (NPPs) worldwide that have some relevance to the fire risk in U.S. NPPs [O.2]. A brief synopsis of these events is provided in Table O-1.

Turbine blade failure leading to lube oil line rupture is the root cause of the most severe fires involving T/G (e.g., Salem, Vandellos, Maanshan, and Narora). In some cases, in addition to oil spill, hydrogen was released and contributed to the damage (e.g., Vandellos and Maanshan). Fort St. Vrain and Muhleberg involved a leak in the oil system that eventually led to a large fire. In two cases (Armenia and Chernobyl 2), the offsite power grid could not be disconnected from the main generators. Power back-feed into the generator caused bearing failure, lubricating oil spills, and fire in the turbine building.

These incidents illustrate that the consequences of a fire involving T/G can be substantial in terms of the number of equipment damaged and size of damage. It can also lead to heavy smoke generation and propagation to other areas, and can threaten structural integrity of the building itself. However, these events also illustrate that few of such fires could present a significant challenge to nuclear safety. For example, while the Vandellos fire caused extensive damage and ultimately led to permanent closure of the plant, the fire presented few nuclear safety challenges. In contrast, the Narora fire illustrates that T/G fires can, under different circumstances, present a severe challenge to nuclear safety.

**Table O-1
Major Fires Involving T/G System in U.S. and International NPPs**

Plant	Event Date	Duration	Comments
Rancho Seco (PWR, U.S.)	19-Mar-84	14 min	Equipment malfunction caused hydrogen leak into the turbine building and hydrogen explosion and fire. Even though the fire duration was short, there was extensive damage from the explosion and ensuing fire.
Fort St. Vrain (HTGR, U.S.)	3-Oct-87	16 min	Valve hydraulic oil system failure caused oil spray onto hot surfaces and fire. The fire dimension at its largest point was estimated to be about 19 sq. ft at its base and covered a 53' by 35' area 17' above the base. Smoke migrated into the Control Room in this event.
Salem, Unit 2 (PWR, U.S.)	9-Nov-91	15 min	Equipment malfunction led to turbine over-speed and blade ejection. Seal failure led to hydrogen leak. Oil piping was severed. Both caught fire. Extent of fire damage was limited because of fixed suppression system activation and prompt fire brigade response.
Muhleberg (BWR, Switzerland)	21-Jun-71	2:07 hrs:min	Turbine oil leaked, caught fire on hot surfaces. The fire damaged cables, electrical equipment needed for safe operation, and structural elements of the Turbine Building. The fire caused smoke damage at areas adjacent to the Turbine Building.
Beloyarsk, Unit 2 (LWGR, Russia)	31-Dec-78	17:05 hrs:min	Lubrication oil piping failure released oil onto hot surfaces. The fire propagated to adjacent Control Building and caused extensive plant damage. Turbine building roof was damage extensively. The control room and cable spreading room were affected.
Armenia (VVER, Armenia)	15-Oct-82	6:05 hrs:min	The cascading events of a severe cable tunnel fire, augmented by equipment failure and operator error led to Turbine Building fire among many other damaging events that had a more severe effect on nuclear safety than the Turbine Building fire.

Table O-1
Major Fires Involving Turbine/Generator System in US and International NPPs (Continued)

Plant	Event Date	Duration	Comments
Maanshan (PWR, Taiwan)	1-Jul-85	10 hrs	A turbine blade ejection led to oil and hydrogen release. Both caught fire, leading to severe damage in the Turbine Building.
Vandellos (PWR, Spain)	19-Oct-89	3:51 hrs:min	A turbine blade ejection severed several turbine oil supply piping and release of hydrogen from the generator. Burning oil cascaded to lower elevations of the building and caused damage to the rubber expansion joint of a major water pipe, causing flooding of the lowest elevation of the Turbine Building and another adjacent building.
Chernobyl, Unit 2 (RBMK, Ukraine)	11-Oct-91	3:31 hrs:min	Grid backfeed into a tripped generator led to a severe fire that caused structural damage to the Turbine Building.
Narora (PWR, India)	31-Mar-93	1:30 hrs:min	Turbine blade ejection led to a severe oil fire that caused extended station blackout and control room abandonment (smoke effects).

O.2 Modeling Fires Involving Turbine-Generators

As a first step of T/G fire modeling, the analyst should decide whether scenarios that involve turbine blade ejection, which may include fire and explosion caused by oil piping failure and hydrogen release, would be analyzed as part of the Fire PRA or a separate external event topic. It may be assumed that scenarios involving blade ejection, as well as severe oil and hydrogen fires, are covered by the catastrophic T/G event defined below. The frequency is reflective of the potential for such events in U.S. nuclear power industry.

T/G fires, in the fire ignition frequency analysis, have been divided into three categories: excitor fires, hydrogen fires and explosions, and oil fires. Fire impact modeling should take into account these three categories and specific features of the T/G under study. From a review of the fire events, two severity levels were concluded: limited and severe. Limited fires affected items close to the ignition point. Severe fires affected a large area around and above the T/G. Conditional probabilities of the two severity levels were estimated from the fraction of fire events within each T/G fire category. Table O-2 lists the T/G categories, severity levels, and associated conditional probabilities.

O.2.1 Excitor Fires

Excitor fire events were found, in all cases, to be limited to the ignition source area or the excitor itself. Generally, the excitor is a separate device in the Turbine Building with no other equipment or cables nearby. Therefore, no attempt was made to estimate the conditional probability of a severe fire associated with the exciters. It is recommended to assume that excitor fires would have a damage zone limited to the excitor itself.

O.2.2 Hydrogen Fires

Of the 13 events in the FEDB [0.1] that were labeled as hydrogen fires originating from the T/Gs, two events (at Rancho Seco and Salem) were considered severe (Table O-1). In both cases, damage occurred from fire and explosion caused by hydrogen release from the generator and related equipment. In the case of small fires, the hazard zone of the hydrogen fire was limited to the leak area. In almost all cases, hydrogen leaked through the seals at the turbine or excitor side. In a few cases, hydrogen leaked from other points of the generator. In all the cases labeled as small fire, the extent of damage was limited to the area near the generator. Therefore, it is recommended that for small hydrogen fire event scenarios, the analysts assume the hazard zone of the fire is limited to a few feet away from the generator.

For severe fires, the analyst may assume that a severe fire may damage all those Fire PRA cables and equipment within the line of site of the generator and its bearings (above and below).

O.2.3 Oil Fires

Of the 20 T/G oil fires in the FEDB (challenging and undetermined), one event (at Ft. St. Vrain) was labeled as severe.

Table O-2
Fire Categories, Severity Level, and Conditional Probability

Categories	Severity	Conditional Probability ¹	Comments
Excitor	N/A	1	Fire can be assumed to be localized to the excitor area.
Hydrogen Fire	Limited	0.83	Fire affects an area close to the generator.
	Severe	0.17	Fire and explosion may occur with effects further away from the T/G. No widespread damage inside the building, potential damage to the adjoining buildings, or to the structural integrity of the building.
Oil fire	Limited	0.95	Fire affects an area near the turbines and oil carrying piping.
	Severe	0.05	A very severe fire may occur affecting structural elements and items away from the turbines. The ZOI should be estimated based on a 20' oil spill (Ft. St. Vrain, 1987) at the most likely location of a leak. No widespread damage inside the building, potential damage to the adjoining buildings, or to the structural integrity of the building.
T/G fires involving H ₂ , oil, and possibly blade ejection	Catastrophic	0.025	Widespread damage inside the building, potential damage to the adjoining buildings, and to the structural integrity of the building.
		(5E-4/yr)	Suppression can prevent these consequences.
		(1E-5/yr)	

¹ Conditional probability given fire ignition

In case of the nonsevere fires, damage is assumed to be limited to the T/G systems and any components in the vicinity of the T/G. Using the information on Ft. St. Vrain event (Table O-1), damage in case of a severe T/G oil fire may be analyzed as an oil fire from a 20 ft² oil spill. This is equivalent of a 3-4 MW oil fire.

The analyst should consider the following possibilities when modeling T/G oil fires of such magnitude:

- Oil run down to lower elevations of the Turbine Building,
- Potential release of the entire contents of oil reservoirs because of the inherent features of the control elements of the oil pumping system,
- Possible structural failures above the oil fire, causing additional damage, and
- Migration of heavy smoke into the control room or other areas of the plant where operators may need to be present to achieve safe plant shutdown and core cooling.

O.2.4 Catastrophic Fires Involving T/G System

As evident from Table O-1, there have been few fires in the international experience that resulted in widespread damage within the Turbine Building, including a few that resulted in structural damage. These events involve a combination of turbine blade ejection, hydrogen, and oil fires. Domestically, only one event came close to involve all of these elements (Salem, 1991). This event caused minor damage due to existence of an automatic suppression system and prompt fire brigade response. This indicates that both automatic fire suppression systems and fire brigade should be credited to prevent catastrophic consequences observed internationally.

As a first, conservative step, the analyst may assume that the conditional probability of a T/G fire involving turbine blade ejection, hydrogen, and oil fires is 1 over 38 events (all challenging and undetermined T/G fires) or 0.025. With successful suppression, damage would be limited to the T/G system, as was the case in Salem. In case of failure of all suppression, automatic and manual, the analyst may assume loss all Fire PRA cables and equipment in the Turbine Building as a screening estimate.

O.3 References

- O.1 *Fire Event Database and Generic Ignition Frequency Model for U.S. Nuclear Power Plants*, EPRI, Palo Alto, CA: 2001. 1003111.
- O.2 *Risk Methods Insights Gained from Fire Incidents*, NUREG/CR-6738, August 2001.

Appendix P

**Appendix for Chapter 11,
Detection and Suppression Analysis**

P

APPENDIX FOR CHAPTER 11, DETECTION AND SUPPRESSION ANALYSIS

The Fire PRA postulates a potential for widespread fire damage during the early stages of analysis, up to and including Scoping Fire Modeling (Task 8). In this context “widespread” generally implies the loss of all thermal damage targets located in a fire analysis compartment. All fires in U.S. NPPs to date have been controlled and extinguished before such widespread physical fire damage could occur. This observation is based on over 1400 documented fire events of varying magnitude, and likely reflects the incorporation of defense in depth fire protection features. Yet, the experience of non-NPP sites in the U.S. and NPPs outside the U.S. include fire events that did lead to widespread damage. Hence, the potential for such fires cannot be entirely discounted for U.S. NPPs, although such fires are considered unlikely due to the level of defense in depth fire protection. The purpose of the detailed fire modeling task, and in particular the detection and suppression analysis, is to assess the likelihood that a fire will burn long enough to cause the extent of fire damage defined by the Fire PRA scenario. This may involve fire scenarios ranging from limited damage to widespread damage.

The decision of crediting detection and suppression systems in a given fire scenario is usually based on the following considerations:

- It is suspected that time to detection and suppression is less than the calculated time to target damage obtained from modeling the scenario considering detection and suppression, and
- The detection and/or suppression system is designed, installed, and maintained according to applicable standards, or an evaluation from a fire protection engineer, which indicates that the system is expected to protect the selected target from fire-generated conditions.

Once the decision of crediting a fire protection system is made, the analyst should specify the type of system selected for the scenario. This includes:

- Fire detection: fire watch, smoke, heat detectors, or high sensitivity detection systems, and
- Fire suppression: fire watch, automatically or manually activated fixed systems, and fire brigade.

The detection and suppression features in a fire scenario are ultimately represented in the risk analysis as the non-suppression probability before target damage occurs. A method is provided on how to obtain this probability for the different detection-suppression options typically available in nuclear power plants using an event tree. An example application is discussed at the end of the appendix.

P.1 Calculating the Non-Suppression Probability

The non-suppression probability is calculated in four steps.

1. Identifying the fire protection features (detection and suppression) applicable to the scenario under analysis.
2. Determining the effectiveness of the credited detection-suppression system in controlling the fire before a given target is damaged. This analysis is based on code review, fire protection engineering judgment, and time to detection and damage calculations.
3. Solving the detection-suppression event tree, which provides the answer to the question of “how likely is the failure of fire detection and suppression to establish and maintain control of the fire before target damage in a given scenario.” A generic event tree is described in this appendix.
4. Addressing dependency issues in the fire protection systems.

The following sections discuss these steps in detail.

P.1.1 Identification of Fire Protection Features

The analyst should select which fire protection features are applicable to the scenario under analysis. These features may include (but are not limited to):

- Detection Systems
 - Smoke detectors
 - Heat detectors
 - High sensitivity detectors
 - Fire watch
- Suppression Systems
 - Automatic sprinklers
 - Gaseous suppression systems (typically halon and CO₂)
 - Manual suppression, including fire watch and fire brigade

Plant documents and drawings describing the operation of credited systems may be necessary for completing future steps in the detection/suppression analysis.

P.1.2 Effectiveness of Fire Detection and Suppression Systems

The effectiveness of a fire detection and suppression systems in performing its intended functions is evaluated based on the following two considerations:

1. System design with respect to applicable code(s) of record and fire protection engineering judgment, and
2. The specific characteristics of the fire event in terms of time to target damage vs. time to suppression.

Although fire protection systems are usually designed in compliance with an applicable code of record, a fire scenario could be postulated in a way that a given system may not be effective due to geometrical configuration of combustibles. Fire protection engineering judgment is recommended for evaluating if a given system can control or suppress a postulated exposure. Depending on the postulated fire scenario, fire modeling could be used for calculating time to target damage and system activation calculations.

Manual suppression actions are also affected by the characteristics of every scenario in terms of tenability and accessibility to affected rooms. The effectiveness of manual actions is reflected in the risk analysis in terms of time. That is, how long the suppression operations are delayed due to fire generated conditions, accessibility to the room of fire origin, etc.

P.1.3 Solving the Detection-Suppression Event Tree

The event tree illustrated in Figure P-1 has been developed for modeling detection and suppression features credited in a given fire scenario. Table P-1 lists the outcome of each sequence. Analysts should provide proper justification for cases in which the event tree needs to be altered to address a specific scenario. The event tree has seven detection-suppression actions listed in three detection categories: prompt detection, automatic detection, and delayed detection.

**Table P-1
Event Tree Outputs**

Sequence	Detection	Suppression
A	Prompt detection by	Prompt suppression
B	<ul style="list-style-type: none"> Continuous fire watch Continuously occupied 	Fire suppression by an automatically actuated fixed system
C	<ul style="list-style-type: none"> High sensitivity detectors 	Fire suppression by a manually actuated fixed system
D		Fire suppression by the fire brigade
E		Fire damage to target items
F	Automatic detection by	Fire suppression by an automatically actuated fixed system
G	<ul style="list-style-type: none"> Heat detectors Smoke detectors 	Fire suppression by a manually actuated fixed system
H		Fire suppression by the fire brigade
I		Fire damage to target items
J	Delayed detection by	Fire suppression by an automatically actuated fixed system
K	<ul style="list-style-type: none"> Roving fire watch Control room verification 	Fire suppression by a manually actuated fixed system
L		Fire suppression by the fire brigade
M		Fire damage to target items
N	Fire damage to target items	

Prompt detection should be only credited when a continuous fire watch is assigned to an operation, or a high-sensitivity smoke detection system is installed. If a high-sensitivity smoke detection system is credited, the failure probability of the system should be considered. If in-cabinet smoke detection devices are installed in the electrical cabinet postulated as the ignition source, the analyst should assume that the fire will be detected in its incipient stage. This incipient stage is assumed to have a duration of 5 minutes. In order to account for these 5 minutes, the analysts should add them to the time to target damage (or, equivalently, add them to the time available for suppression).

Prompt suppression refers specifically to suppression actions by a fire watch, and can be credited following prompt detection in hot work fire scenarios only.

Automatic detection refers to cases where a smoke or heat detection system is available. Similar availability considerations apply to automatic suppression systems including water-based sprinklers, CO₂, Halon, etc. Note that at this point, automatic detection and suppression systems are assumed effective for detecting and controlling the postulated fire.

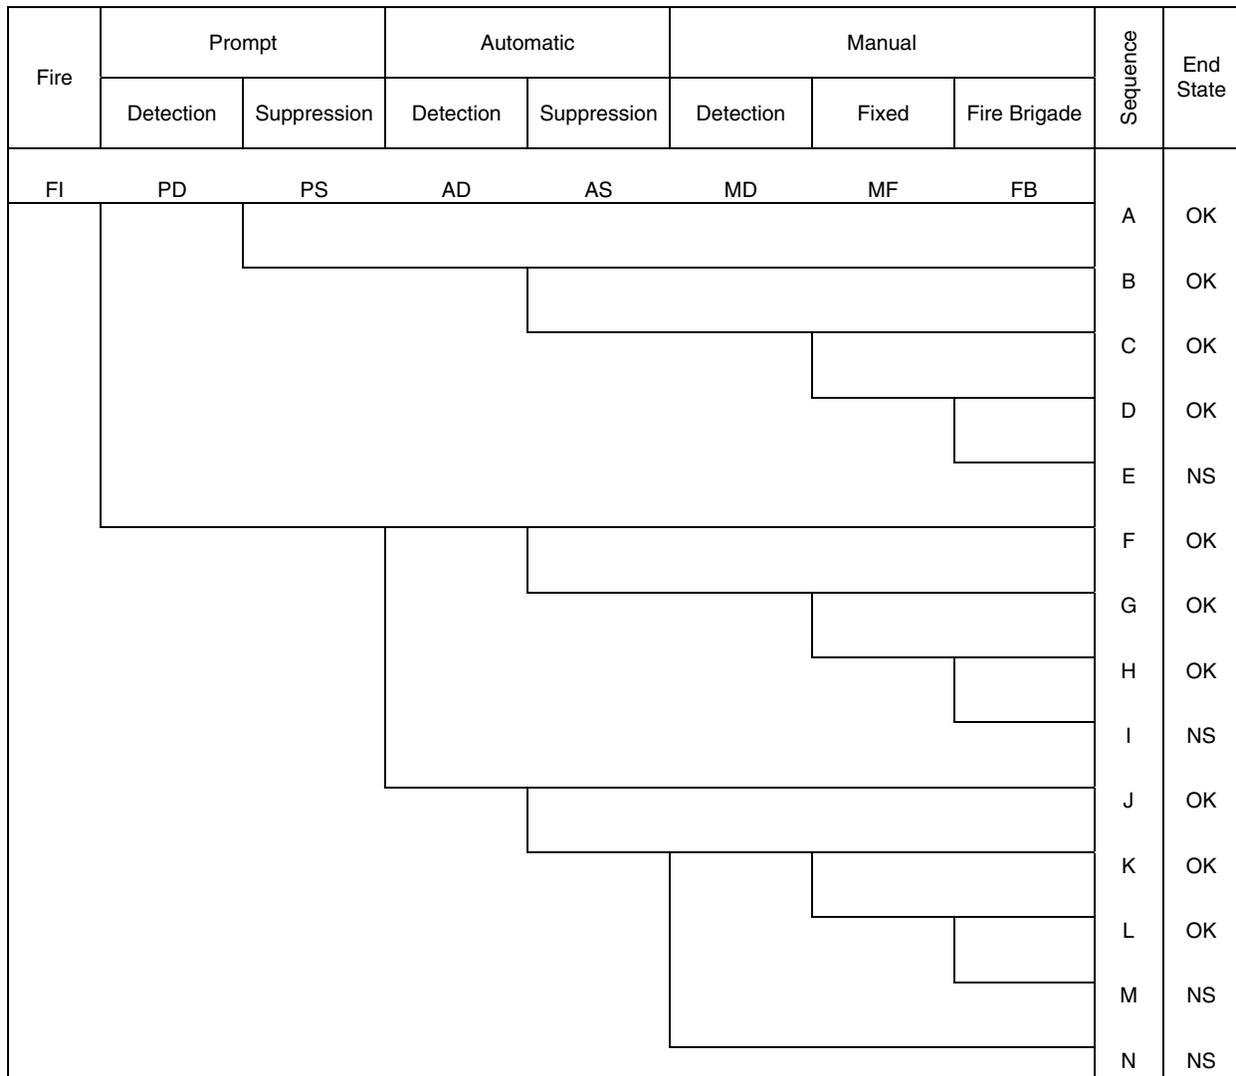


Figure P-1
Detection Suppression Event Tree NS – Failure of Suppression Activities
OK – Success of Suppression Activities

The concept of delayed detection applies to scenarios in which no prompt or automatic detection is credited or automatic detection fails. Consider the following scenario as an example of delayed detection.

- The control room receives a failure signal on the board. An operator is dispatched to the compartment where the failure occurs. Upon arrival, the operator notices fire-generated conditions in the room and informs the control room of his findings. At this point, the control room dispatches the fire brigade. Notice that in this example, the control room did not respond to a fire alarm, but to a signal related to an equipment failure.

Successful manual actuations of fixed fire suppression systems should include (1) plant personnel to accurately assess fire conditions in the compartment and successfully operated the system, and (2) the availability and reliability of the fixed system. That is, a human reliability analysis is necessary to determine the likelihood of a system being manually actuated by plant personnel, and an availability analysis similar to the one recommended for automatic fixed fire protection systems.

Finally, the fire brigade actions include the manual actuation of fixed systems, removal of fuel sources, and deenergizing systems, in addition to other manual suppression actions, like using portable fire extinguishers and hose streams.

Plant-specific conditions for a given fire scenario will determine which events in the overall event tree are relevant. Analyst interpretation of each event in the event tree is required. The following three examples illustrate this aspect of the event tree approach.

- **Pre-action (or Dry-Pipe) Automatic Sprinkler System Installed:** A pre-action sprinkler system requires two actuation signals to succeed; namely, the automatic detection signal which triggers the pre-action valve and activation of the fusible link on the sprinkler head itself coupled to successful operation of other parts of the system (e.g., the fire pumps). Hence, the success/failure of automatic detection is relevant to system actuation success and timing. For this case, end state 'F' reflects fully automatic system success and actuation. End states 'G' and 'H' indicate success of the detection signal, but failure of the suppression function (perhaps due to random failures elsewhere in the system). For these cases, the automatic detection time remains relevant to subsequent manual brigade response timing. End state 'J' might not be a valid for this case given that failure of the automatic detection signal would preclude automatic system operation. Manual actuation of the fixed system (e.g., end state 'K') may remain a viable option.
- **Wet Pipe Sprinkler System Installed:** Wet-pipe sprinklers require no pre-action signal to succeed. Rather, activation of the fusible link at the sprinkler head coupled with proper operation of other parts of the system (e.g., the fire pumps) discharges water. End states 'F' and 'J' are essentially identical – the fixed system succeeds and no manual suppression is needed. Success/failure of automatic detection has no impact on sprinkler performance, but does impact the fire brigade response for end states 'G', 'H', 'K', and 'L' where the fixed system fails to function (e.g., random failure).
- **No Fixed Fire Suppression System Installed:** If there is no fixed fire suppression available, then suppression by the fire brigade is required. In this case, those events related to success of automatic suppression and manual actuation of a fixed suppression system are irrelevant and end states 'B', 'C', 'F', 'G', 'J', and 'K' are invalid. The various paths to detection (i.e., prompt, automatic, delayed manual) are all relevant to the timing of brigade response, and may lead to end states with unique transition times (e.g., end states 'D', 'H', and 'L').

The following values or calculations are recommended for determining the split fraction probabilities in the detection-suppression event tree.

- Pr(Prompt det): The probability of prompt detection can be assumed to have a value of 1.0 in cases where a continuous fire watch is present or in-cabinet detectors are credited for an in-cabinet initiated fire. Note that the probability of failure of the in-cabinet detectors should be considered. Use a value of 0 for cases where only automatic or delayed detection is credited.
- Pr(failure prompt supp): The probability of prompt suppression can be obtained using the welding suppression curve at the estimated time to target damage, since prompt detection assumes a negligible time to detection. As mentioned earlier, prompt suppression should only be credited in hot-work fire scenarios. In scenarios where fires have propagated to secondary combustibles, requiring suppression actions beyond the fire watch, other suppression curves (transients, cables, oil, etc.) may be used, depending on the secondary combustible type.
- Pr(failure auto det): The analyst must first determine that automatic detection will actuate prior to the predicted time to fire damage or else auto detection fails. The probability of random failure of smoke detector systems is assumed to be no larger than 0.05. This is the unreliability of halon suppression systems reported in NSAC 179L. For the purpose of this procedure, it is assumed that the unreliability of smoke detector systems is no worse than the recommended value for halon systems, because halon systems usually depend on a smoke detection signal for activation.
- Pr(failure auto supp): The analyst must first determine that automatic suppression will actuate prior to the predicted time to fire damage or else auto suppression fails. This also includes the probability of random failure of the fixed suppression system. For the case of automatic suppression systems actuated by a signal from the smoke detectors, the probability of automatic detection failure should be also considered. NSAC 179L [P.1] recommends the following unreliability values for automatic systems:
 - Carbon dioxide = 0.04,
 - Halon systems = 0.05,
 - Wet pipe sprinkler systems = 0.02, and
 - Deluge or preaction sprinkler systems = 0.05.

These values provide realistic estimates of system unreliability. However, the estimates do not include maintenance contributions to unavailability, credit for manual actuation of the system, dependent failures, and plant specific data.

- Pr(Delayed det): The probability of delayed detection is assumed 1.0 for cases where no prompt or automatic detection is credited (or fails) only if the estimated time for manual detection is lower than the time to target damage.
- Pr(failure man act of fixed supp): The probability of failing to manually actuate a fixed fire protection system in a timely manner (i.e., before target damage) should be calculated considering the probabilities of failure of the equipment and the operator action.

- Pr(failure fire brigade): The probability of the fire brigade failing to suppress the fire is estimated with suppression probability curves developed using the suppression time reported in FEDB. Fire events before 1/1/1981 were excluded from the manual suppression probability curves. This is the date when Appendix R of 10 CFR Part 50 was issued. The curves were developed using events where manual suppression was involved and suppression time information was available. Events including self-extinguished fires, supervised burnouts, and fires extinguished with automatic fire suppression systems were excluded from the curves. If the time to suppression was unavailable, the reported duration of the event was used instead. The following suppression probability curves are available.
 1. Transients: A total of 24 transient events are considered. Twenty-two out of the 24 events were labeled as transient for the frequency model. The remaining two events were labeled as plant-wide components-dryers in the frequency model. These fires involved cloth or other transient combustibles on fire.
 2. Welding: Welding events are usually labeled “Transient fires caused by welding and cutting,” or “Cable fires caused by welding and cutting.” A total of 19 events are included in this curve. Only two of those events had durations larger than 20 minutes. This curve should be used for calculating the probability of prompt suppression.
 3. Electrical: This data set contains events involving panels, electric motors, indoor transformers, and junction boxes, among other electrical equipment. Electrical events in the Control Room, Transformer Yard, and T/G Excitor bins were excluded. Note that events including overheated electrical equipment, such as bearings due to lack of lubricating oil, were included in this list. Finally, events labeled as high-energy arcing faults were not included in this curve.
 4. Cable: This category refers to cables in raceways. Extension cord-related fires were included in the Transient data set. Events describing wiring or cable fires inside cabinets or other electrical equipment were included in the electrical data set. Records with insufficient details, simply reporting a “cable/wiring” fire, were included in this cable data set.
 5. Oil: The oil data set includes all the events in which a lubricating substance was ignited.
 6. Flammable gas: This data set includes only events involving hydrogen fires. Fires and explosions in the Off-Gas/H₂ Recombiner are also included.
 7. Transformer yard: This data set includes events labeled as Transformer Yard. As mentioned above, events suppressed by fixed fire suppression system only were excluded. Events in which the fire brigade decided to let the fire burn out were also excluded from the set.
 8. Containment PWR: A separate curve is developed for the Containment PWR at power operation. It is considered that fire brigade access to the building in the event of a fire is relatively different than other locations in the plant. Events in this data set include all the ignition source bins in the Containment (PWR) location.
 9. Control room: Events in this bin are the ones labeled Control Room/Electrical Cabinets. This curve was developed using the total event duration instead of the time to suppression.
 10. Turbine Generator: Events in this set include the ones labeled as T/G Oil, T/G Hydrogen, and T/G Excitor. Some of the T/G Hydrogen events were excluded from the data set because they were suppressed with an automatic system.
 11. High-energy arcing faults: Includes events labeled as high-energy arcing faults.

12. All events: This data set includes all events that were not considered as “prompt suppression” cases. The purpose of this data set is to generate a generic suppression time probability curve that may be used for those cases where the analyst cannot find a proper match from the above list of categories.

The data for analysis consists of reported fire durations in commercial U.S. NPPs. These times are treated as being generated by an underlying probabilistic model. The final output of interest is the suppression curve, which gives the probability that a fire lasts longer than a specified time. If T is the random variable describing when the fire is suppressed, and $\lambda(t)$ is the rate at which the fire is suppressed (possibly time-dependent), this probability of non-suppression is given by

$$\Pr(T > t) = \exp\left(-\int_0^t \lambda(s) ds\right).$$

In this equation, $\lambda(t)$ is a function of the parameters of the probabilistic model chosen for T . The simplest model for T is the exponential distribution, whose probability density function is

$$f(t) = \lambda e^{-\lambda t}.$$

In this model, λ is estimated directly and is not a function of time, giving

$$\Pr(T > t) = e^{-\lambda t}.$$

The non-suppression probability is calculated using the above equation, usually selecting t as the time to target damage. The uncertainty in λ gives rise to a corresponding uncertainty in the suppression probability. This will be expressed graphically by showing a mean suppression curve, along with lower and upper bound curves. Tables P-2 and P-3 list the estimated λ for each suppression curve and the numerical results for each curve as a function of time. The curves are plotted in Figures P-2 and P-3.

Table P-2
Probability Distribution for Rate of Fires Suppressed per Unit Time, λ

Suppression Curve	Number of Events in Curve	Total Duration	λ Mean	5 th Per	50 th Per	95 th Per
T/G fires	21	749	0.03	0.02	0.03	0.04
Control room	6	18	0.33	0.15	0.32	0.58
PWR containment	3	23	0.13	0.04	0.12	0.27
Outdoor transformers	14	373	0.04	0.02	0.04	0.06
Flammable gas	5	195	0.03	0.01	0.02	0.05
Oil fires	36	404	0.09	0.07	0.09	0.11
Cable fires	4	11	0.36	0.12	0.33	0.70
Electrical fires	112	937	0.12	0.10	0.12	0.14
Welding fires	19	99	0.19	0.13	0.19	0.27
Transient fires	24	199	0.12	0.08	0.12	0.16
High energy arcing faults	5	118	0.04	0.02	0.04	0.08
All fires	250	3260	0.08	0.07	0.08	0.08

The manual suppression probability curves described in the previous section represent the suppression time of applicable fire events. As such, the curves do not account for the time to detection and the response time of the fire brigade. The time available for manual suppression is

$$t_{ms} = t_{dam} - t_{fb} - t_{det}$$

where t_{ms} is the time available for manual suppression, t_{dam} is the time to target damage, t_{fb} is the response time of the fire brigade, and t_{det} is the time to detection.

The time available for manual suppression, t_{ms} , is the input time to the manual suppression probability curves. Recall that for the case of electrical cabinet fires, if in-cabinet smoke detectors are installed in the cabinet postulated as the ignition source, the analyst should add 5 minutes to the time available for detection. This will reduce the time to detection, t_{det} , by 5 min.

**Table P-3
Numerical Results for Suppression Curves**

Time (min)	T/G fires	High energy arcing faults	Outdoor transformers	Flammable gas	Oil fires	Electrical fires	Transient fires	PWR containment	Welding	Control room	Cable fires	All fires
0	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00
5	0.87	0.94	0.83	0.88	0.64	0.55	0.55	0.52	0.38	0.19	0.30	0.68
10	0.76	0.88	0.69	0.77	0.41	0.30	0.30	0.27	0.15	0.04	0.09	0.46
15	0.66	0.83	0.57	0.68	0.26	0.16	0.16	0.14	0.06	0.01	0.03	0.32
20	0.57	0.78	0.47	0.60	0.17	0.09	0.09	0.07	0.02	0.00	0.01	0.22
25	0.50	0.73	0.39	0.53	0.11	0.05	0.05	0.04	0.01	*	0.00	0.15
30	0.43	0.69	0.32	0.46	0.07	0.03	0.03	0.02	0.00	*	*	0.10
35	0.37	0.64	0.27	0.41	0.04	0.01	0.01	0.01	0.00	*	*	0.07
40	0.33	0.61	0.22	0.36	0.03	0.01	0.01	0.01	*	*	*	0.05
45	0.28	0.57	0.18	0.32	0.02	0.00	0.00	0.00	*	*	*	0.03
50	0.25	0.53	0.15	0.28	0.01	0.00	0.00	0.00	*	*	*	0.02
55	0.21	0.50	0.13	0.24	0.01	0.00	0.00	*	*	*	*	0.01
60	0.19	0.47	0.11	0.21	0.00	*	*	*	*	*	*	0.01
65	0.16	0.44	0.09	0.19	0.00	*	*	*	*	*	*	0.01
70	0.14	0.42	0.07	0.17	0.00	*	*	*	*	*	*	0.00
75	0.12	0.39	0.06	0.15	0.00	*	*	*	*	*	*	0.00
80	0.11	0.37	0.05	0.13	*	*	*	*	*	*	*	0.00
85	0.09	0.34	0.04	0.11	*	*	*	*	*	*	*	0.00
90	0.08	0.32	0.03	0.10	*	*	*	*	*	*	*	0.00
95	0.07	0.30	0.03	0.09	*	*	*	*	*	*	*	*
100	0.06	0.29	0.02	0.08	*	*	*	*	*	*	*	*

* A value of 1E-3 should be used

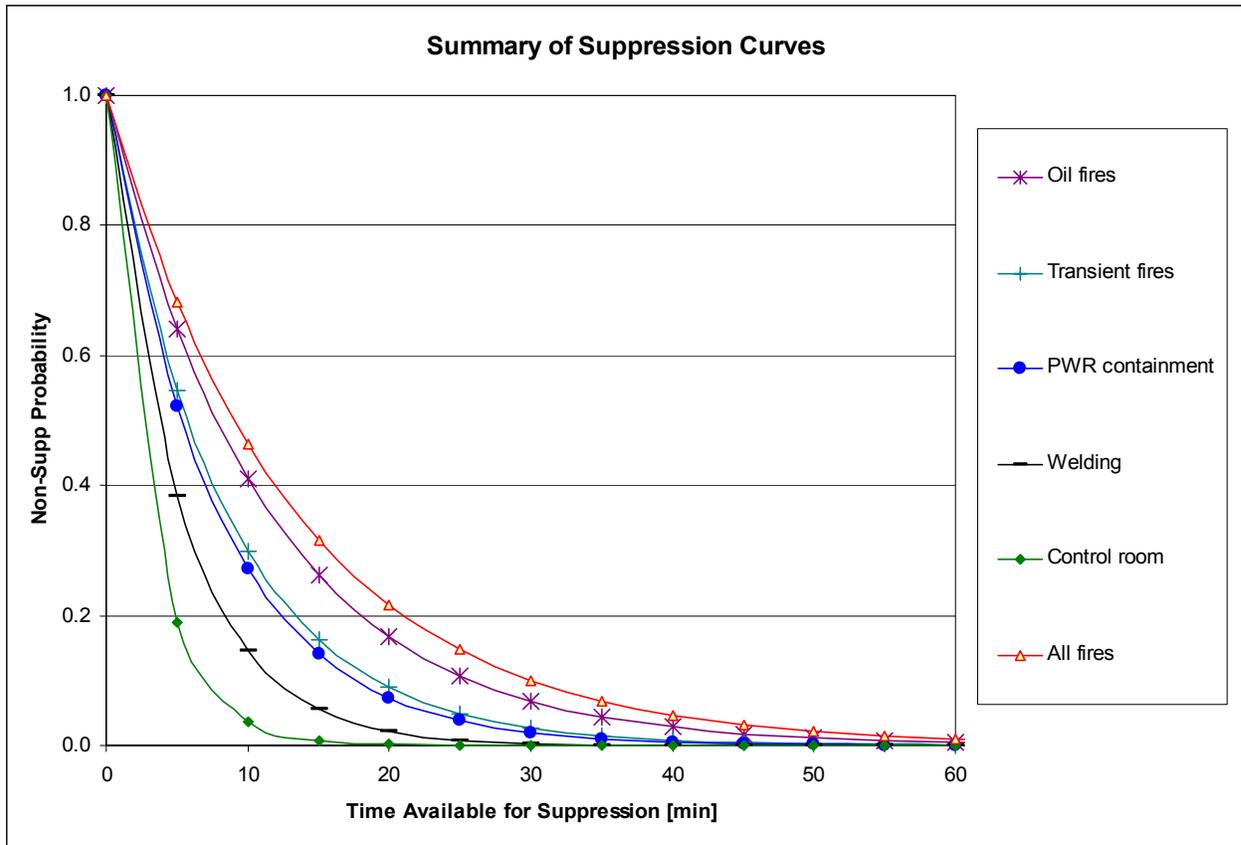


Figure P-2
Summary of Suppression Curves

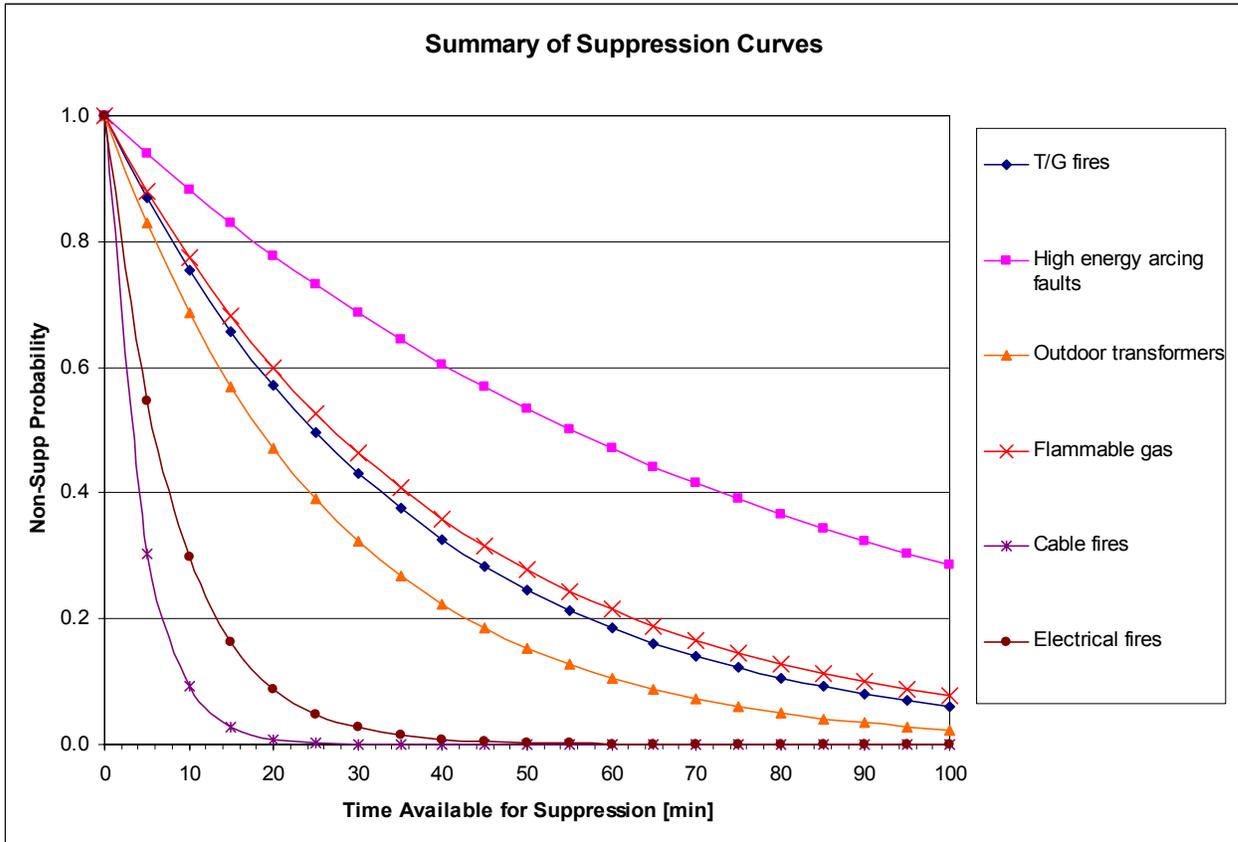


Figure P-3
Summary of Suppression Curves

Table P-4 at the end of the appendix list all the events included in the development of the suppression curves.

P.1.4 Dependency Analysis

The overall reliability for individual plant fire protection systems was determined in NSAC-179L to be high. When redundant systems are considered as a whole, however, the analyst sometimes identifies common elements. Failure of a common element may not be significant to an individual system's reliability, but it might be very significant to the failure of more than one fire protection capability. Therefore, it is important to evaluate the impact that such dependencies, or common elements, have on the overall reliability of suppression.

The best example of a dependency is the fire protection control panel for a gaseous suppression system. That panel detects a fire, actuates automatic suppression, and closes a damper. Consequently, if certain circuits in the panel fail, both automatic detection and suppression might fail. If other circuits fail to close the damper, suppression may be ineffective and a fire barrier may fail. While the individual circuit failures are unlikely (especially since the panels are designed to continuously indicate if trouble exist), the results could be significant to a fire risk estimate.

This recommended approach evaluates dependencies in fire protection systems by focusing on the common element, namely suppression. The following dependencies in suppression analysis could be important:

- between automatic detection and suppression,
- between actuated barriers and automatic suppression,
- between safe shutdown capability and automatic suppression,
- between manual and automatic suppression, and
- between manual (human) fire detection and suppression actions

The first two types were illustrated above. The second two types are best illustrated using the firefighting water system as an example. Plant IPEs sometimes credit firefighting water for core injection, heat removal, or secondary heat removal. At many plants, EOPs identify under what conditions plant operators should attempt to align firefighting water to the vessel, an isolation condenser, or the steam generators.

A dependency analysis is necessary if:

- credit has been taken in the IPE for these uses of firefighting water,
- that action applies to the compartment, and
- an automatic water suppression system is the compartment or use of manual hose stations is credited.

The first step in the analysis is to determine if firefighting water can serve each function simultaneously. This may require an evaluation of total system flows. Even if a fully functional firefighting water system can succeed, under certain conditions, such as a single operating fire pump, the system may be incapable.

Next, if the system is incapable under any condition, a human reliability analysis may be necessary to determine the feasibility and reliability of operator actions to manage the system for both system uses. A quick review of procedures or discussion with operators may allow using a simple conservative assumption. If more detailed analysis is necessary, the analyst should consider whether other types of detailed analysis are more efficient, e.g., more detailed fire modeling.

The third step in the analysis is to evaluate dependencies in the hardware portion of the system. If fault tree analyses were available for the firefighting water system in the IPE, they may serve as a valuable source of information for this evaluation.

Dependencies among human actions associated with fire suppression activities should be considered when estimating human error probabilities for the different actions in the general suppression strategy for each compartment. That is, the human error probabilities included in the detection-suppression event tree model should include all the dependencies related to previous detection/suppression related actions in the sequence, deteriorating fire conditions, the arrival of the fire brigade, etc.

P.1.5 Non-Suppression Probability

The non-suppression probability is calculated by summing the probabilities of Sequences E, I, M and N in the detection/suppression event tree. These four branches (or sequences) represent scenarios where the fire is not suppressed by the fire brigade. In the case of sequence N, no suppression results from the failure of manual detection, such that the brigade does not even attempt to suppress the fire. Notice that the probability assigned to the fire brigade refers to failure to suppress the fire at a given time, and is obtained from the manual suppression curves.

P.2 Example

In this example, the non-suppression probability for a fire scenario in an emergency switchgear room during power operation is calculated. The room is equipped with a smoke detection system and a manually activated gaseous suppression system. The scenario consists of an MCC fire affecting a cable tray away from the ignition source, and, therefore, is expected to be affected by smoke layer temperatures. The following information is necessary before proceeding with the analysis.

- Based on fire modeling analysis, the estimated time for smoke detection is 1 minute.
- Based on fire modeling analysis, the estimated time to target damage is 15 minutes.
- From fire drills records, the brigade response time is 7 min.
- From fire drills records and plant procedures, it is estimated that the time to manually activate the gaseous system is 10 minutes.

Figure P-4 illustrates the solution of the detection and suppression event tree. Notice that Sequences A to E have a value of 0.0 because the first event is prompt detection, which is not credited in this scenario.

The first credited system for Sequences F to I is automatic detection, which has a failure probability of 0.05. The probability of failure to activate the gaseous system on time is 0.15. This value is estimated as the sum of the probability of human error activating the system and the unreliability of the system (assumed as 0.1 and 0.05, respectively, for this example). The probability of failure for the fire brigade is calculated using the electrical suppression curve at time $15 - 1 - 7 = 7$ minutes as $EXP(-\lambda_{\text{electrical}} \cdot t) = EXP(-0.12 \times 7) = 0.43$.

If the automatic detection fails, delayed detection is credited. Sequences J to N refer to this situation. Assuming a time to delayed detection of 15 min, the fire brigade has no time to suppress the fire before target damage.

According to Section P.1.5, the non-suppression probability is the sum of Sequences E, I, M and N, which is $0.0 + 6.1E-2 + 8.0E-3 + 0.0 = 6.9E-2$.

P.3 References

- P.1 W. Parkinson, et al, Automatic and Manual Suppression Reliability Data for Nuclear Power Plant Fire Risk Analyses, NSAC-179L, February 1994.

Fire	Prompt		Automatic		Manual			Sequence	End State	Pr(non-suppression)
	Detection	Suppression	Detection	Suppression	Detection	Fixed	Fire Brigade			
FI	PD	PS	AD	AS	MD	MF	FB			
1.0	0.0	0.0						A	OK	
		1.0		0.0				B	OK	
				1.0		0.85		C	OK	
						0.15	0.62	D	OK	
							0.38	E	NS	0.0E-00
	1.0		0.95	0.0				F	OK	
				1.0		0.85		G	OK	
						0.15	0.57	H	OK	
							0.43	I	NS	6.1E-02
			0.05	0.0				J	OK	
				1.0	1.0	0.85		K	OK	
						0.15	0.0	L	OK	
							1.0	M	NS	8.0E-03
					0.0			N	NS	0.0E-00
								Total		6.9E-02

Figure P-4
Solution of the Detection-Suppression Event Tree for Example in Section P-2
 NS – Failure of Suppression Activities
 OK – Success of Suppression Activities

Table P-4
List³⁰ of Fire Events Included in the Development of the Suppression Curves

Incident No.	Mode of Operation	Suppression Curve	Value [min]
398	Low Power Operation	Cable	2
510	Power Operation	Cable	10
681	Low Power Operation	Cable	5
2361	Power Operation	Cable	2
2425	Power Operation	Cable	2
485	Power Operation	Containment (PWR)	15
1041	Power Operation	Containment (PWR)	6
1488	Power Operation	Containment (PWR)	2
537	Low Power Operation	Control Room	1
659	Power Operation	Control Room	1
756	Low Power Operation	Control Room	1
928	Power Operation	Control Room	1
980	Undetermined	Control Room	2
2160	Low Power Operation	Control Room	10
238	Power Operation	Electrical	5
269	Power Operation	Electrical	1
352	Power Operation	Electrical	5
357	Power Operation	Electrical	2
388	Power Operation	Electrical	4
418	Low Power Operation	Electrical	10
469	Low Power Operation	Electrical	1
484	Power Operation	Electrical	15
490	Undetermined	Electrical	11
493	Power Operation	Electrical	1
498	Power Operation	Electrical	10
505	Low Power Operation	Electrical	36
513	Low Power Operation	Electrical	6
516	Low Power Operation	Electrical	6
518	Low Power Operation	Electrical	1
522	Low Power Operation	Electrical	10
529	Power Operation	Electrical	1
541	Power Operation	Electrical	5
544	Undetermined	Electrical	12
551	Power Operation	Electrical	1
557	Low Power Operation	Electrical	10
572	Power Operation	Electrical	3

³⁰ The list includes events from 1/11981 to 12/31/2000 and event 2424 (high energy arcing fault in 2001). In addition, self-extinguished fires, supervised burn outs and fires extinguished with automatic systems only were excluded.

Table P-4
List of Fire Events Included in the Development of the Suppression Curves (Continued)

Incident No.	Mode of Operation	Suppression Curve	Value [min]
608	Low Power Operation	Electrical	1
611	Low Power Operation	Electrical	12
614	Power Operation	Electrical	3
625	Power Operation	Electrical	1
642	Power Operation	Electrical	45
644	Undetermined	Electrical	10
654	Power Operation	Electrical	1
656	Power Operation	Electrical	25
665	Low Power Operation	Electrical	10
667	Low Power Operation	Electrical	7
673	Low Power Operation	Electrical	2
708	Low Power Operation	Electrical	3
726	Low Power Operation	Electrical	3
735	Power Operation	Electrical	2
745	Power Operation	Electrical	5
755	Power Operation	Electrical	2
792	Power Operation	Electrical	10
821	Power Operation	Electrical	20
876	Low Power Operation	Electrical	6
914	Low Power Operation	Electrical	20
922	Power Operation	Electrical	3
942	Power Operation	Electrical	6
977	Low Power Operation	Electrical	9
978	Low Power Operation	Electrical	2
1034	Power Operation	Electrical	10
1053	Power Operation	Electrical	7
1097	Low Power Operation	Electrical	95
1100	Power Operation	Electrical	5
1124	Undetermined	Electrical	4
1129	Low Power Operation	Electrical	1
1133	Undetermined	Electrical	5
1135	Low Power Operation	Electrical	24
1137	Low Power Operation	Electrical	1
1139	Power Operation	Electrical	3
1141	Undetermined	Electrical	5
1142	Power Operation	Electrical	10
1160	Undetermined	Electrical	5
1163	Undetermined	Electrical	5
1173	Low Power Operation	Electrical	12
1213	Power Operation	Electrical	5
1262	Low Power Operation	Electrical	3
1264	Power Operation	Electrical	1

Table P-4
List of Fire Events Included in the Development of the Suppression Curves (Continued)

Incident No.	Mode of Operation	Suppression Curve	Value [min]
1270	Power Operation	Electrical	1
1276	Power Operation	Electrical	35
1335	Power Operation	Electrical	7
1337	Low Power Operation	Electrical	9
1339	Low Power Operation	Electrical	29
1487	Power Operation	Electrical	2
1489	Low Power Operation	Electrical	2
1491	Low Power Operation	Electrical	2
1501	Low Power Operation	Electrical	2
1504	Low Power Operation	Electrical	10
1509	Low Power Operation	Electrical	1
1511	Power Operation	Electrical	2
2127	Undetermined	Electrical	2
2161	Low Power Operation	Electrical	2
2179	Undetermined	Electrical	22
2190	Undetermined	Electrical	45
2191	Undetermined	Electrical	2
2211	Power Operation	Electrical	10
2219	Undetermined	Electrical	2
2227	Power Operation	Electrical	2
2236	Power Operation	Electrical	10
2251	Power Operation	Electrical	10
2255	Undetermined	Electrical	2
2269	Power Operation	Electrical	2
2272	Undetermined	Electrical	10
2273	Undetermined	Electrical	2
2276	Power Operation	Electrical	10
2281	Power Operation	Electrical	10
2305	Undetermined	Electrical	2
2311	Power Operation	Electrical	2
2313	Power Operation	Electrical	2
2314	Power Operation	Electrical	10
2319	Undetermined	Electrical	2
2329	Power Operation	Electrical	2
2336	Power Operation	Electrical	2
2339	Power Operation	Electrical	10
2349	Power Operation	Electrical	10
2351	Power Operation	Electrical	2
2353	Power Operation	Electrical	2
2375	Power Operation	Electrical	2
2377	Low Power Operation	Electrical	2
2378	Power Operation	Electrical	10

Table P-4
List of Fire Events Included in the Development of the Suppression Curves (Continued)

Incident No.	Mode of Operation	Suppression Curve	Value [min]
2387	Power Operation	Electrical	2
2416	Low Power Operation	Electrical	10
2426	Power Operation	Electrical	22
2428	Power Operation	Electrical	22
2441	Power Operation	Electrical	2
2445	Undetermined	Electrical	2
2447	Undetermined	Electrical	2
2476	Undetermined	Electrical	10
433	Power Operation	Flammable gas	46
512	Power Operation	Flammable gas	9
528	Low Power Operation	Flammable gas	60
1516	Power Operation	Flammable gas	20
2356	Power Operation	Flammable gas	60
947	Power Operation	High Energy Arcing Faults	46
2175	Power Operation	High Energy Arcing Faults	57
2424	Power Operation	High Energy Arcing Faults	136
260	Low Power Operation	Oil	1
262	Power Operation	Oil	8
263	Power Operation	Oil	1
266	Power Operation	Oil	15
296	Low Power Operation	Oil	40
476	Power Operation	Oil	10
477	Power Operation	Oil	3
495	Low Power Operation	Oil	20
508	Low Power Operation	Oil	1
524	Power Operation	Oil	9
535	Low Power Operation	Oil	3
559	Low Power Operation	Oil	4
566	Low Power Operation	Oil	25
662	Power Operation	Oil	60
710	Low Power Operation	Oil	27
736	Power Operation	Oil	15
737	Power Operation	Oil	3
765	Low Power Operation	Oil	3
811	Undetermined	Oil	1
824	Power Operation	Oil	15
875	Low Power Operation	Oil	1
961	Power Operation	Oil	11
1023	Power Operation	Oil	10
1108	Power Operation	Oil	4
1110	Power Operation	Oil	5
1263	Low Power Operation	Oil	6

Table P-4
List of Fire Events Included in the Development of the Suppression Curves (Continued)

Incident No.	Mode of Operation	Suppression Curve	Value [min]
1482	Power Operation	Oil	10
1483	Power Operation	Oil	10
1485	Low Power Operation	Oil	10
1506	Power Operation	Oil	2
1507	Power Operation	Oil	2
1514	Power Operation	Oil	2
2183	Undetermined	Oil	45
2345	Power Operation	Oil	2
2388	Power Operation	Oil	10
2422	Power Operation	Oil	10
368	Power Operation	Outdoor transformers	1
405	Power Operation	Outdoor transformers	40
407	Power Operation	Outdoor transformers	120
734	Power Operation	Outdoor transformers	2
860	Power Operation	Outdoor transformers	27
934	Power Operation	Outdoor transformers	120
1033	Power Operation	Outdoor transformers	20
1035	Power Operation	Outdoor transformers	15
2283	Power Operation	Outdoor transformers	2
2285	Power Operation	Outdoor transformers	10
2331	Power Operation	Outdoor transformers	2
2341	Power Operation	Outdoor transformers	2
2407	Power Operation	Outdoor transformers	2
2427	Power Operation	Outdoor transformers	10
323	Power Operation	Transient	20
464	Undetermined	Transient	5
567	Power Operation	Transient	4
577	Power Operation	Transient	5
650	Power Operation	Transient	1
653	Power Operation	Transient	10
704	Power Operation	Transient	8
968	Undetermined	Transient	8
997	Undetermined	Transient	5
1050	Power Operation	Transient	5
1119	Power Operation	Transient	1
1128	Power Operation	Transient	10
1164	Undetermined	Transient	10
1171	Power Operation	Transient	1
1176	Power Operation	Transient	25
1195	Power Operation	Transient	1
1345	Undetermined	Transient	7
2253	Power Operation	Transient	2

Table P-4
List of Fire Events Included in the Development of the Suppression Curves (Continued)

Incident No.	Mode of Operation	Suppression Curve	Value [min]
2257	Undetermined	Transient	2
2262	Power Operation	Transient	45
2291	Undetermined	Transient	2
2386	Power Operation	Transient	10
2393	Power Operation	Transient	2
2501	Power Operation	Transient	10
304	Power Operation	Turbine generator	10
326	Power Operation	Turbine generator	30
384	Power Operation	Turbine generator	18
401	Power Operation	Turbine generator	2
402	Power Operation	Turbine generator	1
487	Power Operation	Turbine generator	30
531	Power Operation	Turbine generator	3
554	Power Operation	Turbine generator	95
562	Power Operation	Turbine generator	45
636	Power Operation	Turbine generator	6
668	Power Operation	Turbine generator	217
809	Power Operation	Turbine generator	4
851	Power Operation	Turbine generator	15
926	Power Operation	Turbine generator	14
929	Power Operation	Turbine generator	160
940	Power Operation	Turbine generator	16
1024	Power Operation	Turbine generator	2
1042	Power Operation	Turbine generator	9
2124	Power Operation	Turbine generator	60
2229	Power Operation	Turbine generator	10
2337	Power Operation	Turbine generator	2
242	Power Operation	Welding	2
257	Power Operation	Welding	3
294	Undetermined	Welding	0
319	Power Operation	Welding	2
413	Power Operation	Welding	0
474	Power Operation	Welding	3
700	Power Operation	Welding	10
751	Undetermined	Welding	10
1095	Power Operation	Welding	2
1200	Power Operation	Welding	1
1201	Power Operation	Welding	0
1231	Undetermined	Welding	1
1232	Power Operation	Welding	0
1275	Undetermined	Welding	27
2126	Undetermined	Welding	2

Table P-4
List of Fire Events Included in the Development of the Suppression Curves (Continued)

Incident No.	Mode of Operation	Suppression Curve	Value [min]
2143	Undetermined	Welding	2
2188	Undetermined	Welding	2
2237	Power Operation	Welding	22
2469	Undetermined	Welding	10

Appendix Q

**Appendix for Chapter 11, Passive
Fire Protection Features**

Q

APPENDIX FOR CHAPTER 11, PASSIVE FIRE PROTECTION FEATURES

In contrast with fire detection and suppression activities, which involve active efforts for detecting, controlling, and suppressing fires by manual or automatic means, passive fire protection refers to fixed features put in place for reducing or preventing fire propagation. Such features include coatings, cable tray barriers, fire stops, dampers, penetration seals, doors, and walls. State-of-the-art fire modeling tools offer limited capabilities for modeling the effectiveness of these features, particularly if the equipment is in a degraded condition. For example, effectiveness of a fire wall could be evaluated. However, effectiveness of the same fire wall with cracks or unsealed penetrations could not.

In addition to analytical models, experimental observations can provide insights on the performance of passive fire protection systems under fire conditions. For cases in which no analytical or empirical tool can adequately estimate the system performance, purely probabilistic techniques could be formulated.

Seven types of passive fire protection features are discussed in this appendix: doors, walls, coatings, cable tray barriers, fire stops, dampers, and penetrations seals. The method in which each feature is credited in the PRA depends on the fire scenario and the available modeling.

In this appendix, the techniques relevant to fire PRA analysis in the commercial nuclear industry are described. The passive fire protection features listed above are generally classified in this appendix according to a modeling technique. However, this classification should not limit the analysts to the recommended technique for a given feature.

Q.1 Analytical Modeling of Passive Fire Protection Features

Analytical modeling refers to the use of fire modeling tools for evaluating the effectiveness of barriers. Theoretically, the temperature rise in materials can be estimated as a function of time if its thermophysical properties, orientation, and the incident heat flux are known. The process of calculating this temperature rise can be divided in two steps that are coupled together: a fire modeling analysis for estimating incident heat flux, and a heat transfer analysis for estimating temperature within the thickness of the material. The incident heat flux would be the boundary condition that changes as a function of time as the fire develops.

Estimating fire-induced incident heat fluxes is relatively simple. State-of-the-art zone and field models are capable of estimating incident heat fluxes in different locations in the compartment. Hand calculations also provide very good heat flux estimates, provided that the location of the target relative to the fire is known.

On the other hand, estimating the temperature of a material subjected to an incident heat flux is more challenging. Although there are highly sophisticated analytical techniques for addressing this problem, the biggest challenge in nuclear power plant applications is in obtaining accurate thermophysical properties for the material. Provided that those properties are known, analysts can obtain them from rather conservative surface temperature approximations using hand calculations to detailed temperature profiles as a function of time and length within the material.

In practice, doors and walls are the passive fire protection features whose effectiveness could be evaluated with analytical tools. Thermophysical properties for concrete and steel are usually readily available. The most common application of fire modeling tools to evaluate the effectiveness of doors and walls would be (1) calculating the surface and internal temperature of the door and wall, and (2) analyzing the effects of the wall or door in preventing smoke migration through rooms.

Modeling degraded doors or walls depends on the type of degradation that needs to be evaluated. Consider the following situations.

1. A particular fire rating of a door or wall in question—a three-hour vs. a two-hour wall, for example. Given postulated fires of different intensities and locations, zone or field models can be used to estimate temperature profiles within the wall as a function of time. With this information, fire protection engineers can determine if the wall can provide the necessary compartmentation.
2. A fire door may remain open or can be opened during a fire event. In this case, zone and field models can be used to determine smoke flows through doors as a function of time, and locations where the smoke will migrate. Models may not be effective at predicting flame spread through openings.
3. Cracks are found in a wall, or a penetration is not appropriately sealed. Fire models may not be used for these cases. Although small openings could be modeled in doors and walls, fire models would only consider them when estimating temperature in the room and smoke flow through them. Temperature increases in the wall due to cracks will not be estimated.
4. A gap between a fire door and wall of a particular size is found. Zone and field models are appropriate if the goal of the analysis is to predict smoke migration through openings. As mentioned above, openings of any size and orientation can be described within surfaces. Models may not be effective at predicting flame spread through openings.

Q.2 Empirical Modeling of Passive Fire Protection Features

The two passive fire protection features that can be credited using purely experimental results are coatings and cable tray barriers, including fire stops.

Q.2.1 Coatings

SNL performed tests to evaluate the effects of cable coatings in:

- reducing the flammability of cable material,
- preventing or delaying the spread of fire, and
- preventing fire-induced cable failures.

Thirty-three full-scale tests were performed using trays loaded with either qualified or nonqualified cables. The cable tray configurations included both a single cable tray and a two-tray stack. Exposure fires included either a gas burner or a diesel fuel pool fire.

Five coatings were evaluated; however, because the names of manufacturers were withheld, use of the data is limited. Flammability was evaluated by measuring time to ignition, time to maximum heat release rate, and cumulative heat release at various times after initiation of the exposure fire.

The diesel fuel pool fire was selected because the exposure fire was more intense, and therefore, conservative. More importantly, aspects of the gas burner tests were less representative of conditions typical of the most likely ignition sources. A barrier was placed between the two trays during the gas burner test, thereby preventing exposure of both trays.

The gas burner operated five minutes 'on' and five minutes 'off,' whereas the diesel fuel pool fire burned continuously for approximately 13 minutes. Consequently, the diesel fuel fire tests are indicative of the actual response of a coated two-tray stack to a relatively severe exposure fire that bounds the heat release rate for most ignition sources found in an area containing important cables. The results of those diesel fuel tests are presented in Table Q-1.

For application of the proposed approach, assume coated, nonqualified cables will not ignite for at least 12 minutes, and coated, nonqualified cables will not be damaged for at least 3 minutes for large exposure fires, and for cable tray fires, more likely about 10 minutes.

**Table Q-1
Summary of Principal Two-Tray Diesel Fuel Fire Cable Fire. Retardant Coatings Tests Involving Nonrated 3-Conductor Cables**

Coating	Time to Ignition (min)	Time to Damage (min)
Lower Tray Response		
FlameMaster 71A	13	10
FlameMaster 77	13	6
Vimasco #1A	12	3
Carboline Intumastic 285	No	10
Quelcor 703B	12	11
Upper Tray Response		
FlameMaster 71A	No	11
FlameMaster 77	No	11
Vimasco #1A	12	7
Carboline Intumastic 285	No	19
Quelcor 703B	12	11

Q.2.2 Cable Tray Barriers and Fire Stops

Cable tray fire barrier tests were also performed by SNL. Thirteen tests were conducted in a manner identical to that used in the single tray and two-tray gas burner cable coating tests. The same cable types and the same gas burner exposure fire sources were used. Six potential fire barrier systems were tested:

1. Ceramic wool blanket wrap,
2. Solid tray bottom covers,
3. Solid tray top cover with no vents,
4. Solid tray bottom cover with vented top cover,
5. One-inch insulating barrier between cable trays, and
6. Fire stops.

The barrier test findings are as follows. Propagation of the fire to the second tray was prevented in each case. That is, each barrier prevented ignition of a cable tray when exposed to a cable tray fire in a lower tray. Barriers seem to substantially delay cable damage for qualified cable. However, the barriers did not delay cable damage for nonqualified cable. For application to the Fire PRA, the barrier test findings are considered most appropriate to exposure fires with smaller heat release rates and to cable trays in a stack threatened by fires in lower trays. In these cases, each barrier prevents cable tray ignition until well after the fire brigade reaches the scene (i.e., greater than 20 minutes), and damage in *qualified* cable with solid tray bottom covers until well after the fire brigade reaches the scene.

Q.3 Probabilistic Modeling of Passive Fire Protection Features

Dampers and penetration seals are passive fire protection features that may need probabilistic treatment in the Fire PRA. Recall that probabilistic approaches are used for crediting important aspects of fire scenarios that cannot be analytically described.

Q.3.1 Dampers

Fire and/or smoke dampers are commonly found in commercial nuclear plants in ventilation ducts and wall penetrations. Typically, they are listed for fire applications. However, the effectiveness of a damper in a given fire scenario may not be determined solely in its capacity to survive intense heat or prevent smoke or flame from propagating to adjacent locations, but in its availability/unavailability. This is, the probability that the damper will be fully functional and operate accordingly to its intended function. In that perspective, dampers are assumed effective if they are available.

Dampers are inspected on a regular basis in commercial nuclear plants. From inspection records, analysts may be able to obtain average unavailability values. Analysts, for example, can review records from the last n number of inspections, then divide the number of dampers found not operating by the total number of inspected dampers. This calculated probability would apply to all dampers credited in fire scenarios. If a damper is credited in a fire scenario, this average availability/unavailability can be used in an event tree sequence similar to the one described in Appendix P for calculating the probability of target damage.

Q.3.2 Penetration Seals

The approach for modeling penetration seals is similar to the one discussed above for dampers. This is, nuclear plants inspect a certain number of penetrations seals every few months. Typical findings from these inspections may include degraded seals and new penetrations with no seal. If seals are assumed effective when installed and maintained appropriately, the results of the inspections could be used to develop a failure probability of the seal.

Appendix R

Appendix for Chapter 11, Cable Fires

R

APPENDIX FOR CHAPTER 11, CABLE FIRES

Cables are probably the most common combustible in nuclear power plants. In a postulated fire scenario, they can be an ignition source, intervening combustible, and/or part of the target set. This appendix describes technical approaches to model cable fires, as well as cable response to fire conditions according to the scope of a selected fire scenario.

To date, no generalized analytical theory is available to accurately model fires in all possible configurations in commercial nuclear plants. Most of the information compiled for this appendix is in the form of flammability parameters derived from experiments or correlations also developed from experimental data. Therefore, the analytical methods described are limited to conditions similar to experimental setups. Cable flammability and thermo-physical properties obtained from tests sponsored by individual plants may also be used for estimating fire intensity, flame spread and generated fire conditions.

The amount of experimental evidence and analytical tools available to model cable tray fires is, relatively small when compared to the vast number of possible fire scenarios that can be postulated for NPPs in the U.S. In most cases, the scenario has to be simplified in order to use available modeling methods. The challenge to fire-modeling analysts is selecting and describing scenarios that can be modeled without compromising the technical validity of the results in representing the fire conditions.

Cables are broadly classified as unqualified or IEEE-383 qualified (or qualified cable). Unqualified cable usually has PE/PVC (polyethylene/polyvinyl chloride) insulation. Qualified cable, on the other hand, refers to cable types that pass the IEEE-383 flammability test [R-1]. In the IEEE-383 fire test, a 0.3m wide, 2.4m high vertical rack supports the cables. The cables are positioned in the center six inches off the rack and spaced one-half cable diameter apart. A 0.25m burner fueled with an air-propane mixture ignites the cable with a 21 kW fire. The burner is positioned 0.61m above the floor. Nine to twelve inches of cable are exposed to the direct flames for 20 minutes. Cables on which flame extends above the top of the 2.4m rack fail this test.

Cables in nuclear power plants are usually located in either single tray or stack of trays. Single cable trays can have vertical, horizontal, or diagonal orientations. Similar orientations apply to cable tray stacks. Furthermore, some cable tray arrangements are a combination of horizontal, vertical, and diagonal trays.

This appendix describes methods for modeling cable fires in postulated fire scenarios. Other methods may also be available for modeling cable fires. No verification and validation (V&V) has been conducted for the correlations included in this appendix.

R.1 Modeling Cable Fires in a Fire PRA

Two types of cable fires are described in Task 6 as part of the frequency model: self-ignited cable fires, and cable fires caused by welding and cutting.

Self-ignited cable fires should be postulated in rooms with unqualified cables only or a mix of qualified and unqualified cables. The intensity of the initial fire can be determined using the equation described in section R.3. As a recommended practice, the burning area of the initial fire may be assumed as the square of the tray width. A similar approach is recommended for the case of cable fires caused by welding and cutting.

In addition, analysts can characterize each postulated cable fire using a cable mass ratio. The cable mass ratio for a specific scenario can be calculated dividing the initial cable mass on fire by the total mass of cable in the room. Notice however that the cable mass ratio does not necessarily need to be consistent with the burning area used for calculating heat release rate. The following example clarifies this last statement.

Consider a stack of two trays with unqualified cables. Assume that the trays are 0.6 m wide. The trays run parallel to each other along the length of the room. For the purpose of simplifying the example, assume that the only target in the room is in the top tray of the stack. A self-ignited cable fire is postulated in the bottom tray. Consistent with the recommended practice described above, the initial burning area is 0.4 m². The cable mass ratio however is the mass of cable in the first tray over the mass of cable in the room, assuming that a fire at any location throughout the length of the tray will have the same effects on the tray above. If instead of two parallel trays, the trays are perpendicular with different elevations, and cross each other creating a “pinch point”, the cable mass ratio would be calculated as the mass of cable in the bottom tray in the pinch point over the cable mass in the room.

Postulating and analyzing fire scenarios in rooms with large number of pinch points can be a challenging task considering that in some of these rooms, the location of specific targets is difficult to identify. In such cases, the fire risk of a room is not expected to be much lower than the one calculated in earlier screening tasks assuming all the targets in the room are damaged by fire.

R.2 Cable Tray Ignition

The first step in analyzing cable fires is determining cable ignition.

- If trays are stacked, calculate the flame height, plume temperature, and heat flux at the height of the above tray. Assume ignition of the above tray if it is immersed in flames, or the plume temperature or heat flux are higher than the levels required for ignition. Figure R-1 provides a conceptual representation of the recommended analysis. Notice how the cable tray stack is immersed in the fire plume. If the plume heat fluxes can ignite the first tray, the evaluation process continues until the number of trays involved can be determined.

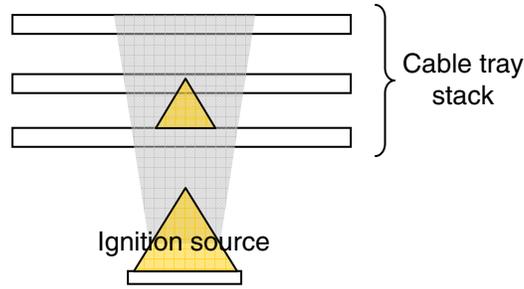


Figure R-1
Ignition Evaluation of a Cable Tray Stack

- If trays are affected by an unobstructed ceiling jet, correlations for ceiling jet temperature and heat flux can be used to determine ignition. Figure R-2 illustrates a scenario involving trays exposed to ceiling jet flows.

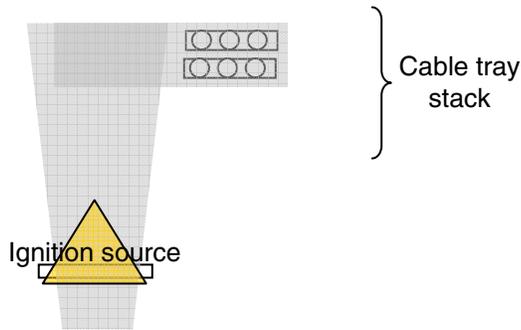


Figure R-2
Ignition Evaluation of a Cable Tray Stack in the Ceiling Jet

- If trays are adjacent, ignition could occur by flame radiation. Calculate the radiated heat flux from the flames to the adjacent tray and compare it with the critical heat flux of the cables. Assume ignition if the calculated heat flux is higher than the critical heat flux.. Figure R-3 provides a conceptual representation of the recommended analysis. Notice how in this illustration, the first tray is affected by direct flame radiation.

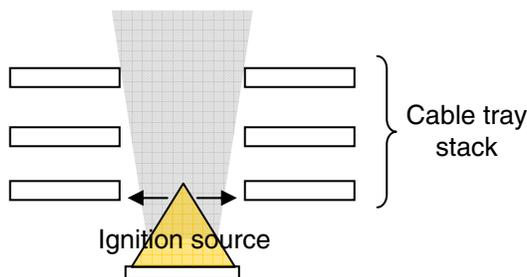


Figure R-3
Ignition Evaluation of Adjacent Cable Trays

- Cable trays immersed in the hot gas layer (relatively far from the ignition source) can be damaged or ignited if the gas temperature reaches the damage or ignition temperature respectively. Three analytical options are available to calculate hot gas layer temperature:
- Hand calculations: semi-empirical models for calculating hot gas layer temperature are available. Hand calculations only provide an average room temperature, due to the energy added to the room by the fire.
- Zone models: Zone models have capabilities for calculating smoke layer position, temperature, and oxygen concentration as a function of time. Notice that zone model allow the analyst to determine if a tray is immersed in smoke; if the smoke temperature is high enough to cause damage to the cables; and if there is enough oxygen in the smoke to support a cable fire.
- Field models: Field models will provide similar output variables as zone models. However, field models can evaluate complex geometries and offer detailed spatial results. Field models analyses are recommended when the selected scenario presents characteristics that can't be addressed by zone models, or the level of detail in the output variables is important. For example, the analyst may be interested in the temperature of one section of the room, instead of an overall average temperature.

R.3 Heat Release Rate from Cable Tray Fires

A useful correlation for estimating the heat release rate generated by a burning cable tray is available in the fire protection literature [R-2], and in NUREG-1805 [R-3], which specifies state-of-art fire dynamic equations and correlations for performing fire hazards analysis for the NRC inspection program. This correlation was developed by Lee, 1985, who showed that the peak full-scale HRR can be predicted according to the bench-scale HRR measurements. The mathematical expression for the correlation is:

$$\dot{Q}_{ct} = 0.45 \cdot \dot{q}_{bs} \cdot A \text{ (kW)}$$

In this correlation, \dot{q}_{bs} is an experimental bench scale HRR value (kW/m²), and A is the burning area of the tray. Table R-1 lists \dot{q}_{bs} values. If the cable under analysis is not listed in Table R-1, analysts may select the highest bench scale heat release rate.

The burning area is usually calculated assuming the width of the tray times the burning length.

Table R-1
Bench Scale HRR Values Under a Heat Flux of 60 kW/m², q_{bs} [R-4]

Material	Bench Scale HRR [kW/m ²]
XPE/FRXPE	475
XPE/Neoprene	354
XPE/Neoprene	302
XPE/XPE	178
PE/PVC	395
PE/PVC	359
PE/PVC	312
PE/PVC	589
PE, Nylon/PVC, Nylon	231
PE, Nylon/PVC, Nylon	218

R.4 Flame Spread and Fire Propagation

A distinction is made between flame spread and fire propagation in this appendix. This distinction is necessary due to the different methods available for modeling fire growth in cable trays. Flame spread refers specifically to a flame from progressing along the length of a single cable tray. Fire propagation refers to a fire involving different cable trays as it continues to grow.

With this distinction, the different models available for predicting flame spread and fire propagation between cable trays are described.

R.4.1 Flame Spread

Flame spread occurs in trays of any orientation. In general, it can be estimated by dividing the fuel distance heated by the flames by the time to ignition. Mathematically, this is represented as [R-5, R-6]:

$$v = \frac{4(\dot{q}_f'')^2 \delta_f}{\pi(k\rho c)(T_{ig} - T_{amb})^2},$$

where

\dot{q}_f'' = the incident heat flux from flames to the fuel surface [kW/m²],

δ_f = the heated fuel distance [m],

$k\rho c$ = the thermal inertial of the fuel [(kW/m²K)²s], and

T_{ig} = the ignition temperature of the fuel [°C].

For the case of vertical flame spread, δ_f can be assumed the length of the flame as illustrated in Figure R-4. At the beginning of the flame-spread process, references R-6 and R-7 suggest that the length of the flame can be expressed as a function of the heat release rate per unit area of the burning material and the burning length of the burning region of the material as follows:

$$z_f = x_p \cdot (k_f \dot{Q}'' - 1)$$

where k_f is a constant with a value of 0.01 m²/kW [R-7], and x_p is the length of the burning region of the material. Values for \dot{Q}'' are listed in Table R-1 for different cables under a radiant heat flux of 60 kW/m².

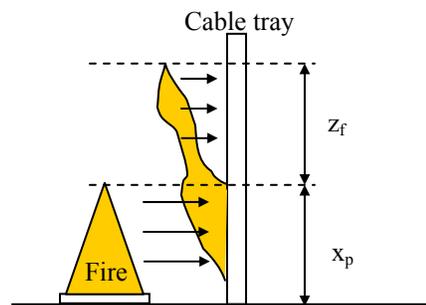


Figure R-4
Pictorial Representation of the Beginning of the Flame Spread Process

Quintiere [R-6] suggests a value of 25 kW/m² for flame heat flux in fires with $x_p < 1.4$ m. Mowrer [R-7], and Fernandez-Pello [R-8] have also used 25 kW/m² for the incident heat flux from flames to a vertical fuel when applying this method. Notice that x_p can be approximated as the flame height of an ignition source heating the cables.

For the case of horizontal flame spread, δ_f may be in the order of 1 to 2 mm. However, the heat flux from flames may be in the order of 70 kW/m² (from [R-6] for downward spread).

Note: Assumptions for flame-spread calculations do not consider developing fire conditions in the room. Flame spread rates may increase if fire conditions in the room deteriorate.

R.4.1.1 Material Properties

The material properties for PVC cables are [R-7]:

$$K = 0.000192 \text{ kW/m K}$$

$$\rho = 1380 \text{ kg/m}^3$$

$$C_p = 1.289 \text{ kJ/kg K}$$

$$T_{ig} = 218^\circ\text{C}$$

The material properties for XPE cables are [R-7]:

$$K = 0.000235 \text{ kW/m K}$$

$$\rho = 1375 \text{ kg/m}^3$$

$$C_p = 1.390 \text{ kJ/kg K}$$

$$T_{ig} = 330^\circ\text{C}$$

R.4.1.2 Recommended Values for Flame Spread in Horizontal Cable Trays

Consider a single vertical cable tray ignited at the bottom. Assume a heating distance of 2 mm and an incident heat flux of 70 kW/m^2 .

- Flame spread for PVC cable = 0.9 mm/sec
- Flame spread for XPLE cable = 0.3 mm/sec

R.4.1.3 Calculating Flame Spread in Vertical Cable Trays

As an example consistent with Figure R-4, consider a 70 kW fire with a diameter of 0.5 m heating a vertical cable tray. Using Heskestad's correlation for flame height, the estimated flame height of this fire is 0.78 m . This is assumed to be the pyrolysis distance, x_p . Assuming the cable tray has XPE cables, the inputs to the equation for calculating flame spread are provided in Table R-2.

Table R-2
Inputs for Flame Spread Analysis

Parameter	Value
Ambient temperature [C]	20
Flame heat flux [kW/m^2]	25
Pyrolysis distance [mm]	0.78
Ignition temperature[C]	330
Thermal conductivity [kW/mK]	0.000235
Density [kg/m^3]	1375
Specific heat [kJ/kg]	1.39

From Table R-1, the heat release rate for XPE cable is 178 kW/m^2 . Using these inputs, the estimated flame spread becomes 11 mm/sec .

Assuming the cable tray has PVC cables, the inputs to the equation would be those provided in Table R-3.

**Table R-3
Inputs for Flame Spread Analysis**

Parameter	Value
Ambient temperature [C]	20
Flame heat flux [kW/m ²]	25
Pyrolysis distance [mm]	0.78
Ignition temperature[C]	205
Thermal conductivity [kW/mK]	0.000192
Density [kg/m ³]	1380
Specific heat [kJ/kg]	1.29

Again, using Table R-1, the flame spread results can be obtained. See Table R-4 for a list of the results.

**Table R-4
Flame Spread Estimates for PVC Cable**

Material	Bench Scale HRR [kW/m ²]	Flame Spread Rate [mm/s]
PE/PVC	395	156
PE/PVC	359	137
PE/PVC	312	112
PE/PVC	589	258

R.4.1.4 Flame Spread in Cable Trays with Other Geometries

For fires spreading upwards in a diagonal tray, it is expected that the flame spread rate will increase as the angle between the floor and a horizontal cable tray increases to 90 degrees (vertical orientation). As a conservative estimate, assume the tray is in a vertical position.

No flame spread can be assumed for armored cables with thermo-set insulation and no coating.

R.4.2 Fire Propagation

An empirical model for upward fire propagation in a cable tray stack assumes the angle for horizontal spread from tray level to tray level is 35 degrees to either side [R-10]. The assumption of the 35-degree angle of fire propagation is based on results from a fire test involving 14 filled horizontal cable trays in a two-tray-wide by seven-tray-high array. Cable trays were filled with 3-conductor XPE cable. These 14 cable trays were separated by 0.2 m horizontally and by 0.27 m vertically. A 5-minute exposure to one of the lowest trays produced a fully developed fire within that tray. During this 5-minute period, a barrier was used to shield the remaining trays from the fire. The ignition source was then extinguished and the barrier removed. The fire eventually propagated through the cable trays.

It was determined, using infrared thermography, that the fire grew primarily in an upward direction, spreading horizontally only as it progressed from level to level. The rate of fire spread was observed to accelerate as the fire progressed. The angle of this spread was determined to be around 35 degrees. Figure R-5 illustrates this model.

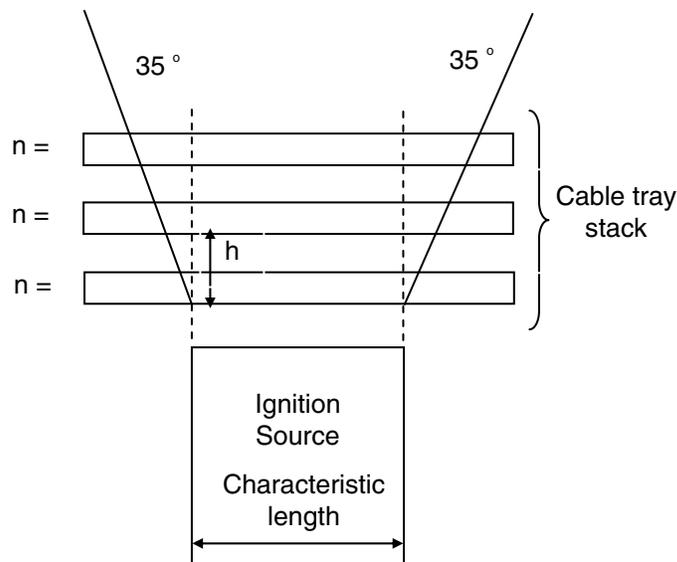


Figure R-5
Model for Fire Propagation in a Cable Tray Stack

R.4.2.1 Heat Release Rate

The lowest tray in the stack has a burning area of the characteristic length of the fire base times the cable tray width. Cable trays in U.S. NPPs are typically 0.6 to 0.9 m wide. The characteristic length of the fire depends on the ignition source. If the ignition source below the trays is an electrical cabinet, the characteristic length will be the cabinet's length. For pool fires, such as oil spills, the spill diameter can be selected as the characteristic length. Once the burning length of the lowest tray has been determined, the length of the trays above is calculated using the following equation:

$$L_{n+1} = L_n + 2(h_{n+1} \tan(35^\circ)),$$

where L is length, n is the cable tray index, and h is the tray elevation measured from the bottom of the lowest tray (See Figure R-3). Again, the burning area is L times the tray width. The heat release rate generated from each tray can be calculated as discussed above using:

$$\dot{Q}_{ct} = 0.45 \cdot \dot{q}_{bs} \cdot A,$$

where A is the burning area.

R.4.2.2 Timing

The exposed tray on the first level was observed to be burning intensely, though in a very localized region, after the 5-minute burning exposure. Within approximately 5 minutes of the barrier's removal, the second and third trays appeared to be involved in the fire. The fourth-level trays were involved around 10 minutes after the removal of the barrier. The sixth-level trays were involved in approximately 18 minutes.

For modeling purposes, the following approach is recommended:

Assuming that the first cable tray in a stack of horizontal cable trays is within the zone of influence of a given fire ignition source, the spread of fire within the stack will be assumed to spread as follows:

- Exposure source to first tray: tray ignites at time to damage/ignition using the plume temperature correlation
- First tray to second tray: 4 minutes after ignition of first tray
- Second tray to third tray: 3 minutes after ignition of second first tray
- Third tray to fourth tray: 2 minutes after ignition of third tray
- Fourth tray to fifth tray: 1 minute after ignition of fourth tray
- Balance of trays in stack: 1 minute after ignition of fifth tray

Spread to adjacent trays:

- If there is a second stack of cable trays next to the first stack, spread to the first (lowest) tray in the second stack will be assumed to occur concurrent with spread of fire to the third tray in the original stack (i.e., 7 minutes after ignition of the first tray in the first stack).
- Subsequent spread of fire in the second stack will mimic the continued growth of fire in the first stack (e.g., the second tray in the second stack will ignite within 2 minutes of the first tray in the second stack - at the same time as the fourth tray in the first stack.)
- Fire spread will occur at the same rate to stacks on either or both sides of the original tray stack.

The above model intends to capture the growing and accelerating nature of fires. Analysts should determine if the first tray will be ignited using fire modeling tools. In high-energy arcing fault scenarios, ignition of the first tray will occur immediately after the blast if the tray is within the ZOI described in Appendix F.

R.5 References

- R.1 IEEE-383, “IEEE Standard for Type Test of Class IE Electric Cables, Field Splices and Connections for Nuclear Generation Stations”.
- R.2 Babrauskas, V., “Heat Release Rates,” *SFPE Handbook of Fire Protection Engineering*, Third Ed., Chapter 3-1.
- R.3 NUREG-1805, *Fire Dynamics Tools (FDT)^s Quantitative Fire Hazard Analysis Methods for the U.S. Nuclear Regulatory Commission Fire Protection Inspection Program*, Volume 1, November, 2004.
- R.4 Tewarson, A., et. al., “Categorization of Cable Flammability, Part 1: Laboratory Evaluation of Cable Flammability Parameters,” EPRI Research Project 1165-1, NP-1200, Part 1.
- R.5 Quintiere, J., “Surface Flame Spread,” *SFPE Handbook of Fire Protection Engineering*, Third Ed., Chapter 2-12.
- R.6 Quintiere, J., “A Simulation Model for Fire Growth on Materials Subject to Room Corner Test,” *Fire Safety Journal*, 20, 1993, pp 313-339.
- R.7 Mowrer, F., and Williamson, R., “Flame Spread Evaluation for Thin Interior Finish Materials,” *Fire Safety Science*, Proceedings of the Third International Symposium, p 237-247.
- R.8 Fernandez-Pello, C., “A Study of the Fire Performance of Electrical Cables,” *Fire Safety Science*, Proceedings of the Third International Symposium, p 689-698.
- R.9 Taylor, R.E., Groot, H., and Ferrier, J., Thermophysical Properties of PVC, PE and Marinite, Thermophysical Properties Research Laboratory, Inc., West Lafayette, IN, Report TPRL 2958, 16 pp., April 2003.
- R.10 Nowlen, S.P., *A Summary of Nuclear Power Plant Fire Safety Research at Sandia National Laboratories 1975-1987*, USNRC, NUREG/CR-5384, Dec. 1989.

Appendix S

**Appendix for Chapter 11, Fire Propagation
to Adjacent Cabinets**

S

APPENDIX FOR CHAPTER 11, FIRE PROPAGATION TO ADJACENT CABINETS

Fire models were not designed to apply to all types of fire propagation and damage scenarios. A particularly important scenario that fits this category is the effect of an electrical cabinet fire on adjacent cabinets. However, electrical cabinet fire tests conducted at SNL [S-1] and VTT [S-2] offer some insights regarding (1) fire propagation between cabinets, and (2) fire-induced damage in adjacent cabinets. In this appendix, these fire tests are evaluated and specific recommendations are provided for their evaluation.

Note: This appendix applies to vertical cabinets only.

S.1 Fire Propagation to Adjacent Cabinets

Fires may either damage or, possibly, propagate to adjacent cabinets. With regard to fire propagation, some limited, but important insights can be drawn from the fire tests.

1. Fire spread to an adjacent cabinet was prevented if the cabinets were separated by a double wall with an air gap.
2. Fire spread was delayed by 15 minutes, even when there was no internal barrier between the cabinets.

In Case 2, the cabinet design in the SNL tests was such that hot gases collected in a plenum area at the top of the cabinet. A hot gas layer formed and contributed to cable ignition in the second cabinet. A diagonal cable bundle also appeared to contribute to fire spread. That is, a cable bundle ignited low in the initial cabinet and climbed slowly until it reached the adjacent cabinet.

Based on these results, the recommended approach for Fire PRA is as follows

- Assume no fire spread if either:
 1. Cabinets are separated by a double wall with an air gap, or
 2. Either the exposed or exposing cabinet has an open top, *and* there is an internal wall, possibly with some openings, *and* there is no diagonal cable run between the exposing and exposed cabinet.
- In the 3 experiments conducted at VTT, two cabinets (the fire and an adjacent cabinet) were separated by a single metal door 1.5 mm thick. Measured gas temperatures in the fire cabinet for the three experiments were above 600°C. Cables in the adjacent cabinet, in direct contact with the separating metal wall ignited in 11 min in test 1 and 16 min in test 3-2. No ignition was observed in test 2. Ignition of a cable separated from the dividing wall was observed only in test 3-2 at 20 min. Based on these measurements and observations: If fire spread cannot be ruled out, or cabinets are separated by a single metal wall, assume that no significant heat

release occurs from the adjacent cabinet for 10 minutes (rounding the experimental results from VTT experiments in test 1), if cables in the adjacent cabinet are in direct contact with the separating wall, and 15 minutes (from SNL experiments) if cables are not in contact with the wall.

There may also be other conditions for which the fire protection engineer is aware of applicable tests, analytical results, or other insights. Engineering judgment should be applied to consider other configurations not favorable for propagation. A visual examination of the cabinet internals is recommended to identify cables passing through cabinet walls or unsealed penetrations or openings between cabinets. If such characteristics are present, fire propagation between cabinets may not be ruled out.

S.2 Damage to Adjacent Cabinets

The fire test data also provide insights regarding damage to components or cables in adjacent cabinets. The test results implied that damage could only be prevented by a double wall and an air gap. Even these cases were not definitive with regard to sensitive electronics.

Tests did indicate the following results for the adjacent cabinet. There were:

- no electrical shorts, and
- switches and meters functioned.

Because other tests (NUREG/CR-4356) showed that relays had about the same damage criteria as switches and meters, relays should function in adjacent cabinets.

However, temperatures, in some cases, did appear to exceed limits for sensitive electronic equipment. Specifically, for a vertical cabinet with unqualified cable, the peak temperature in the adjacent cabinet was 82°C, slightly higher than the 65°C damage criteria for sensitive electronics reported in Appendix H.

The time to reach this temperature was somewhat delayed. The test enclosure and the adjacent cabinet temperatures peaked at least 5 minutes after the peak heat release rate occurred in the exposing cabinet. The temperature inside the adjacent cabinet further lagged the test enclosure by 7 minutes. Consequently, damage to sensitive electronics should not occur for at least 10 minutes after the peak heat release rate.

This conclusion requires two qualifications. The only test for qualified cable showed temperatures lower than the damage criteria and a further delayed peak temperature in the adjacent cabinet. However, the test occurred in a cabinet with the door open. It is not clear whether the open door decreased the effect of the adjacent fire or increased the effect of the test enclosure temperature. Nevertheless, based on the test data available, it seems unlikely that no damage would occur to sensitive electronics in the adjacent cabinet if the exposing cabinet contained qualified cable.

Fire modeling tools can be used to model fire conditions in compartments with different geometrical characteristics than that of the test enclosure.

The following approach is recommended for the Fire PRA.

- Assume loss of function in an adjacent cabinet if there is not a double wall with an air gap.
- Assume no damage in the second adjacent cabinet occurs until after the fire propagates to the adjacent cabinet. Assume damage can occur earlier if there are large openings in a wall and plenum areas in which a hot gas layer is likely to form.
- Assume no damage to an adjacent cabinet if:
 - there is a double wall with an air gap, and
 - there are no sensitive electronics in the adjacent cabinet (or the sensitive electronics have been “qualified” above 82°C).
- Assume damage to sensitive electronics occurs at 10 minutes if there is a double wall with an air gap.

Assume damage to sensitive electronics can be prevented before 10 minutes if the fire is extinguished and the cabinet is cooled, e.g., by CO₂ extinguishers.

S.3 References

- S-1 NUREG CR-4527, “An Experimental Investigation of Internally Ignited Fires in Nuclear Power Plant Control Cabinets”
- S-2 Mangs, J. & Keski-Rahkonen, O. “Full Scale Fire Experiments on Electronic Cabinets”. VTT Technical Research Centre of Finland, Publication 186. 1994.

Appendix T

Appendix for Chapter 11, Smoke Damage

T

APPENDIX FOR CHAPTER 11, SMOKE DAMAGE

T.1 Introduction

Circuit bridging faults associated with airborne smoke appear to involve two somewhat distinct classes of behavior; one related to lower voltage components, including, in particular, instrument and control components, and one related to higher voltage power components.

With regard to the lower voltage circuits, test results have clearly shown that circuit bridging can damage these components. Data also show that smoke-induced circuit bridging results from a combination of airborne and deposited smoke. These behaviors have not been fully explored, but appear to be associated with moderate- to high-smoke exposure densities. It would appear reasonable, in the near term, to base Fire PRA smoke damage assessments on estimates of the airborne smoke density to which the component is exposed. That is, airborne smoke exposure and time of exposure will largely determine the deposition behaviors, so in the near term, airborne smoke concentration may reasonably be used as a surrogate for both modes of damage; airborne, and deposited smoke. Protection measures such as encapsulation or use of conformal coatings are effective against this damage mechanism.

For the higher voltage components, including, in particular, power distribution components like breakers and switchgear, there is some limited fire experience that indicates these components may be vulnerable to failure from sufficiently dense smoke exposure. In both events reviewed here, the faults were manifested as arcing faults that ultimately led to component tripping and, in one case, secondary fires. Limited tests performed in support of this review appear to bear out this potential. Intermittent and continuous arcing of a high voltage test apparatus was observed when exposed to smoke. The extent of the arcing was found to depend on the separation distance between the energized plates and on the fuel load (smoke density) used in the tests. Voltage was not varied, but is also likely an important factor.

In the near term, Fire PRAs could easily include bounding assessments of the potential for damage to high-voltage components by airborne smoke. However, given the current state of knowledge, the assessments would require the application of considerable expert judgment. For example, the analyst would have to presume that fires of a sufficient intensity would damage high voltage equipment, and would then have to relate “sufficient intensity” to the postulated fire scenarios. Based on experience, the damage would likely be limited to components exposed through a direct path for smoke spread from the fire source to the exposed component. That is, in both cases cited above, smoke spread through connecting bus ducts apparently led to the tripping of exposed equipment. Thus, a Fire PRA analysis could examine the connections between the postulated fire source (e.g., one switchgear cubical) and, using judgment, assess the damage potential for other exposed components that shared some physical connection to the source (e.g., where housed in the same bank of switchgear or where connected by unsealed bus ducts). Given this approach, the PRA results will retain considerable uncertainty.

T.1.1 Contact Fouling

With the contact fouling damage mode, the potential concern is that smoke particulate deposition onto the surfaces of an open contact pair might inhibit the electrical function of the contacts (i.e., induce high contact resistance) upon closing. This mechanism of damage has potential application to devices like hand switches and relays. There is currently very little information available regarding the potential for smoke to foul contact pairs sufficiently to degrade or compromise component function. What little information that is available derives from U.S. NRC sponsored tests at SNL during the early- to mid-1980s [T.1].

In these tests, five relays and 24 hand switches were exposed to smoke during four separate electrical control panel fire tests (two tests at SNL and two at Factory Mutual Research Corporation (FMRC)). Of the tested components of this type, only two of the relays were actually operated during the fire exposures. Both of these relays were designed with covers (plastic or glass) that protected the contacts from direct smoke exposure. Two of the relays and two hand switches were provided with an electrical energizing potential across an open contact pair to simulate the conditions of an actual in-service component. Again, for both relays, covers protected the contacts from direct smoke exposure.

The results of the tests did illustrate that smoke was deposited onto open contact pairs, in some cases in significant quantities. In this context, the switches with openly exposed contacts are of primary interest. The energized open contact pairs in particular were observed to develop “soot bridges” that connected the two contacts. These results are also consistent with more recent tests that show that soot will preferentially deposit onto areas of high electrical bias (such as a pair of circuit traces with a significant voltage potential between them) [T.2]. However, for the relay and switch tests, in no case was significant leakage current across open contact pairs noted.

With the open contact pairs on the switches, for example, some electrical contact degradation was observed upon initial closing of the switch (a high-contact resistance). However, cycling of the contact pairs under a modest voltage potential loading (even as low as 15 VAC) cleared the connections. Under a voltage load, a closing switch inevitably generates a very modest electrical arc upon closing. Presumably, this arcing was sufficient to clear the contacts in combination with the physical motion of the switches. In all such cases, the switches were relatively large and designed to operate at current levels of 5 amp or greater.

Some lower amperage switches were also tested, but these were smaller and better sealed units (typically pushbutton switches, often with integral indicating lights). These smaller switches experienced no similar problems. It was also noted that for the relays tested, little or no soot penetration was observed in the relay casing.

In summary, there is some evidence that fouling of open contact pairs due to soot deposition may degrade the electrical performance of the contacts upon initial closure. However, cycling of the contacts under voltage was found sufficient to mitigate the damage and restore full electrical function. In no case was such fouling found sufficient to render a set of contact pairs inoperable. Hence, these tests found little basis for substantial concern over contact fouling as a significant mode of smoke damage. The tests all involved relatively modest smoke exposure conditions (modest fires in a large room with high ventilation rates). The tests did not explore exposures at higher smoke loading conditions. However, based on this evidence, it would appear that contact fouling is of little potential risk significance.

T.1.2 Binding of Mechanical Movement

Binding of mechanical movement is a mode of smoke damage wherein component failures are the result of smoke deposited onto a device that interferes with mechanical movement. This mode of damage was first noted during U.S. NRC-sponsored testing at SNL during the early-to mid-1980s. This particular test series included exposure of several different devices to secondary fire effects (i.e., devices were not within the immediate zone of influence (ZOI) of the fire, but were exposed to hot layer effects). These tests were conducted in conjunction with the U.S. NRC/SNL Cabinet Fire Test Program [T.3] and are documented in a separate test report [T.1]. Devices tested that were dependent on mechanical movement included relays, strip chart recorders, and meters. Only one other known test program has investigated the impact of smoke on devices that rely on mechanical movement. This program is a very recent U.S. NRC-sponsored study at SNL that exposed computer hard disk drive (HDD) units to smoke [T.4].

T.1.2.1 Relays

A total of five relays were tested during two cabinet fire tests. The test specimens were all control type relays with 120 VAC coils. The tests were performed in a large-scale test enclosure at FMRC facilities under subcontract to SNL. The two tests in question are identified in Reference [T.1] as Tests 4 and 5 or as FM4 and FM5. These correspond to Tests 24 and 25 as identified in Reference [T.3]. Recall that the nominal fuel to air volume ratio for these two tests was 30 g/m^3 and 7 g/m^3 , respectively.

Relays are dependent on some limited mechanical movement. An electromagnet or solenoid acts on a pivoted contact support arm that rotates through a small angle (a few degrees of arc at most). The outer tip of the contract arm needs to move only a small distance (typically on the order of one to a few tenths of an inch) in order to close the electrical contacts. In general, the driving forces associated with the movement of a relay are substantial, and the required range of motion is quite limited. There was some potential that smoke deposits and/or corrosion might inhibit movement through an attack on the contact arm pivot structures.

During cabinet fire test exposures, no relay failures were noted. Relays were tested in three operational configurations: contacts energized but coil not operated; contacts energized and coil operated regularly through the test; and nonenergized, nonoperated. All relays were tested after the exposure to assess operability. The relays came with plastic covers that protected the internal parts of the relay. Most were tested with the covers in place, although one relay was tested with the cover removed. While this last relay did experience some corrosion damage, the damage was insufficient to prevent the relay's operation. One relay was also exposed to a high humidity environment for 12 hours following the fire test (no cleaning of the relay) and tested for operability. Again, no functional failure was noted.

Note that Reference [T.1] also describes a series of thermal exposure tests in which two types of relays were tested to failure. These tests did not involve any smoke exposure. Rather, they were performed in an air-oven under thermal exposure conditions only. Hence, they are not of direct interest to the current study.

Based on this evidence, it would appear that relays are not particularly vulnerable to short-term smoke damage due to binding of the required mechanical movement. The relay actuator provides a substantial driving force, which is capable of overcoming significant resistance to movement at the contact support arm pivot structure. The smoke deposited on the relays was unable to induce sufficient binding force to overcome the movements driving force. Similar findings would likely be observed for other devices including switchgear, breakers, and motor control centers (MCCs). The movement force of these devices is substantial, and appears sufficient to overcome smoke binding. Over an extended period, corrosive attack might ultimately lead to binding of this movement.

T.1.2.2 Strip Chart Recorders

Another of the components tested during the large-scale electrical control panel fire tests was pen-type strip-chart recording devices. These devices operate by moving one or more pen tips along a one-dimensional guide bar with the pen position proportional to an input voltage signal. A continuous strip of paper passes by the pen tips on a motor-driven set of rollers to record the position of the pen versus time. The devices are dependent on the movement of both the recording pens and the paper.

Two such devices were tested. The exposure included some rise in temperature, as well as the smoke exposure. However, the temperature rises were modest, and the primary damage was attributed to smoke. Particularly, smoke deposited onto the pen and pen guide bar mechanism inhibiting the pen's movement. In the first test, the strip chart recorder was set in the open with the plastic face cover removed. In this test, all three of the recorder pens were damaged and post-fire attempts to clean the recorder and restore function failed. In the second test, the recorder was surface-mounted into a panel (not the one involved in the fire) with the face cover intact. In this test, only one of the three pens failed, and post-fire cleaning restored the function. In neither case was the movement of the paper inhibited. The level of smoke exposure at which degradation of the pen's motion was observed was not specifically measured.

The strip chart recorder tests illustrate that the driving force associated with a device's required movement is a critical factor in determining the damage potential. For the strip chart recorders, the driving forces associated with the paper were much greater than those associated with the pen. Devices where the driving force is substantial appear able to overcome the relatively modest binding force of the smoke, at least in the short term. Hence, movement of the paper was not degraded while movement of the pen was.

T.1.2.3 Dial Meters

In conjunction with the cabinet fire tests, a total of 13 dial indicating meters were tested during four separate tests (two at SNL and two at FMRC) [T.1]. None of the meters was powered during the exposures, but postexposure calibration tests were performed on each to ensure postexposure functionality. Mechanical binding is identified as one of the failure modes specifically anticipated for these devices.

Of the 13 meters tested, only two were observed to fail. Both of these were mounted directly above the fire panel and were destroyed by heat (gross melting of the relay cases was observed). All of the other relays functioned properly after the tests. No damage was observed due to smoke.

It is noted in the test report that “the types of meters tested are all reasonably well sealed from the outside environment. No evidence of particulate or corrosive vapor penetration into the meters was noted in any case except for the destroyed meters. Any type of meter or gauge which is not reasonably sealed could behave considerably different.” That is to say, in this case, the survival of the meters was attributed to their well-sealed nature meters with openings that might expose the mechanical movement parts to smoke would likely see some performance degradation, if not outright failure. Unfortunately, no tests are available to corroborate this supposition.

T.1.2.4 Hard Disk Drive Units

In a very recent series of U.S. NRC-sponsored tests, a number of computer HDD units were exposed to smoke and monitored for performance [T.4]. The HDD units are relatively self-contained devices. Within an external housing is a set of magnetic storage disk plates that are spun by a small electric motor. Data is written to or read from the disk via a read/write head that moves in and out along a radius of the disks. The devices depend on precise movement and speed control of both the spinning disks and the moving read/write heads.

In testing, there were no observed failures of any of the tested HDD units due to smoke exposure. The fine mechanical movement of these devices was not inhibited in any way. This is attributed to the fact that the HDD units are factory-sealed to ensure that the interior of the unit remains clean. The sealing system of the tested units includes neoprene or silicone rubber O-ring seals and metallic tape. This was found to be typical of such units. The factory seal was found to be quite robust when exposed to smoke, and upon posttest examination, no evidence of any smoke penetration into the devices was observed.

These tests illustrate that isolation of a mechanical device within a well-sealed shell can effectively prevent smoke penetration into the device. This, in turn, can prevent smoke from inhibiting the fine mechanical movements. In this case, the device tests were dependent on close control of those movements, and hence would nominally be very sensitive to any smoke intrusion.

T.1.2.5 Summary of Insights for Binding Mechanical Movement

The available tests illustrate the potential for deposited smoke to prevent or impede fine mechanical movements. However, they also illustrate that only sensitive devices with a small motive or driving force and with an open pathway to exposure of the moving elements are vulnerable to this failure mode. Encapsulation of a mechanical device was found to effectively prevent this damage mechanism from manifesting.

Devices potentially subject to this damage mechanism would include any device whose function relies on the movement of small mechanical elements, and in particular, such devices where the driving forces are small. As demonstrated by the available tests, this includes strip chart recorders. However, other devices may also be subject to such problems, including, in particular, various types of electrical dial indicators (that is, indicators that rely on the movement of a small needle or pointer). Again, a pathway for exposure of the moving components to smoke deposits is also required.

Devices that would not be subject to failure from this damage mode would include any device that lacks moving mechanical elements (i.e., fully electronic devices and passive mechanical elements). Devices that are contained within a well-sealed shell would also be invulnerable to such damage, provided that the shell is not breached due, for example, to heat exposure and warping (at which point smoke exposure is likely moot due to the thermal damage).

Devices that rely on mechanical movement but where the driving forces are substantial (such as relays, solenoids, breakers, and switchgear) would also be invulnerable to this damage mode. Relay testing has shown that the binding force of the smoke is relatively modest, and that sufficient force acting to initiate the movement can overcome that binding force. For devices with a substantial driving force, mechanical binding might occur from a combination of smoke deposition and direct chemical/corrosive attack (for example, chemical attack and soot binding on pivot- or axle-type structures within a device), but substantial degradation would be required before the binding force would impede movement. Because some additional chemical/corrosive degradation would be required, the potential for failure would likely be manifested only well after a fire event actually occurs (i.e., days or even months later). Hence, such failure would not be considered fire risk-significant. Proper management of postfire recovery activities consistent with current accepted practices would mitigate the potential for postfire problems being observed (i.e., inspection, cleaning, and/or replacement of all smoke-exposed components).

Factors that would mitigate the potential damage from mechanical binding include any measure that limits the smoke deposition onto the vulnerable mechanical parts. For example, of the two strip chart recorders tested by SNL, one had no face cover and one had an intact face cover. Neither device was specifically sealed against smoke intrusion, and both suffered some degree of functional damage. However, the device without the face cover clearly suffered more severe and irrecoverable damage than the device with the face cover intact. For the HDD units tested, no damage was observed from smoke intrusion into the interior of the factory-sealed outer shell. The high quality of the typical factory environmental seals was attributed with preventing any smoke damage to the device internals. If a device is fully enclosed and does not include cooling or ventilation fans or open ventilation grills, smoke deposition would be sharply reduced. In the case of electrical dial indicators, for example, these devices are typically well encased and self-contained devices. Hence, the actual potential for smoke intrusion is likely small. In some cases, however, the fine mechanical movement may be exposed on the back side of the device, and/or the devices may not be well sealed so that some smoke intrusion is possible. For this mechanism to be realized, the smoke should come into actual contact with the vulnerable mechanical elements. Any measure that prevents this would also prevent the damage.

In terms of recovery of damage devices, in general, smoke deposits may be removed by a thorough cleaning of the device, and operation may be restored. However, this process will generally require removing the device from service, and thorough cleaning (the most common techniques used currently rely on the use of water-based detergents so that removal from service would be required). In some cases, there may be a concurrent chemical/corrosive attack that will prevent restoration of service. This, for example, appears to be the case for the first of the two SNL strip chart recorder tests. In any case, it is unreasonable to assume that reliable operation might be restored by intervention during or shortly after a fire event. For the purposes of risk assessment, it would appear prudent to assume that devices found vulnerable to this failure mechanism would fail unrecoverably.

T.1.2.6 Risk Implications of Mechanical Binding Damage Mode

Overall, smoke-induced binding of mechanical motion will be of little risk significance. The primary concern for this mode of failure are for devices dependent on fine mechanical movement where the driving forces are relatively small and where the encapsulation of the device is absent or incomplete. This would imply indication devices (e.g., meters and strip chart recorders) rather than control or power devices (relays, switches, motors, valves, etc.). The protective covers commonly associated with indication devices provided significant protection from this damage mode.

Given the concentration of indication devices in the MCR, one might nominally expect that damage to those devices in the event of an MCR fire might be risk-significant. However, even in the MCR, the risk significance of smoke damage to indication devices will likely be very small. This is because a fire that introduces significant quantities of smoke into the MCR would also be assumed, in a Fire PRA, to lead to MCR abandonment. Once abandonment takes place, the MCR indication devices are of no further use to operators. The exception might be analyses that attempt to credit MCR reentry following fire suppression, but this is not typically credited in current Fire PRAs. Furthermore, the failure of an indicator due to binding would not generally impede system function. Hence, it is unlikely that any fire risk scenarios could be developed where smoke-induced damage to indication devices was a significant factor.

T.2 Summary of Findings

T.2.1 Failure Modes and Component Vulnerability

Based on current testing, four modes of smoke damage have been identified. Of these four failure modes, only one, circuit bridging, has the potential to introduce new risk-significant fire scenarios. The four failure modes identified, the types of equipment potentially vulnerable to each failure mode, and the risk implications of such failures are summarized as follows.

T.2.1.1 Circuit Bridging

T.2.1.1.1 Damage Mechanism

Smoke is an electrically conductive media. Hence, smoke deposited on surfaces may cause short circuits. Airborne smoke may also act as a conductive media, increasing the circuit bridging potential. Finally, smoke may act as an ionizing gas that contributes to arcing faults in higher voltage power distribution components. Synergistic effects with moisture/humidity are highly important to this damage mode (higher humidity appears to sharply increase the damage potential).

T.2.1.1.2 Vulnerable Components

This mode of failure may impact two classes of equipment; namely, printed circuit based components (including digital control and instrumentation circuits), and high-voltage power distribution devices (such as switchgear, MCCs, transformers, and breakers).

For high-voltage equipment, the actual vulnerability appears dominated by airborne smoke but remains indeterminate. Some fire experience and limited test results appear to bear out the potential for concern.

For electronic equipment, circuit bridging faults are caused by a combination of deposited and airborne smoke. Based on the testing performed to date, it is concluded that minor smoke exposures (equivalent to less than 10 g/m³ of fuel burned per unit of involved air volume) are not a hazard to most electronic components. Rather, it would take a substantial smoke exposure to cause damage (i.e., at the least greater than 10 g/m³ of fuel burned per unit of involved air volume).

T.2.1.1.3 Risk Implications

While a range of electronic and high-voltage equipment may be lost to this mode of failure, it appears that substantial smoke exposure densities are required to induce this faulting mode. For example, the general density of smoke given a moderate fire in a large room may not approach damaging exposure levels. However, a small fire within a more confined space, such as a single electrical panel or a bank of commonly connected electrical panels, might cause damage.

For high-voltage power distribution components, the types of circuit faults anticipated include initial arcing faults, tripping of circuit protection features causing loss of power to systems and equipment, and secondary fires.

For the electronic instrument and control components, the impact of component failures on plant circuits and systems may be very difficult to assess. This is because electrical shorting may occur between any two adjacent circuit traces and multiple trace pairs may short concurrently. The impact on the operation of the integrated circuit device may be very difficult to predict. Circuit fault modes may well include loss of function, loss of indication, loss of control, spurious operation (SO) of systems and components, or concurrent combinations of these faults. Faults may also be continuous or intermittent, depending on the severity and duration of the exposure.

T.2.1.1.4 Potential Risk Significance

This mode of component failure may be risk-significant.

T.2.1.2 Contact Fouling

T.2.1.2.1 Damage Mechanism

Smoke deposited onto open electrical contacts can increase electrical resistance upon closure of the contacts.

T.2.1.2.2 Vulnerable Components

Any component that contains open and unprotected contact pairs is nominally vulnerable to this mode of failure.

T.2.1.2.3 Risk Implications

There is some potential that control switches or open and unprotected relays might fail to establish sufficient contact to actuate control devices upon initial closure if a significant smoke deposition is realized prior to closure. However, testing has demonstrated that, while some degradation (on the order of a 100 ohm initial contact resistance) of the electrical connection may be noted on initial closing, cycling the contacts or applying a modest voltage potential (as low as 15 V) was found to effectively clear the contacts restoring full operability. Hence, a complete loss of function due to this mode of smoke damage appears implausible.

T.2.1.2.4 Overall Risk Significance

This mode of failure is found to have little or no risk significance.

T.2.1.3 Binding of Mechanical Movement

T.2.1.3.1 Damage Mechanism

Smoke deposited on surfaces can inhibit fine mechanical motions.

T.2.1.3.2 Vulnerable Components

Components that are dependent on fine mechanical movement involving small driving forces are vulnerable to this mode of failure. This may include, in particular, indication components such as strip chart recorders, dial indicators, and meters. (This failure mode would not impact other devices where the motive force is more substantial. This would include, for example, relays, breakers, switchgear, MCCs, and similar devices.) Encapsulation of such devices so that smoke cannot penetrate to the moving parts effectively mitigates the damage potential.

T.2.1.3.3 Potential Risk Implications

The failure of an indication component would not generally result in the direct loss of any risk-important system functions. In the specific case of Control Room fires, where multiple indication devices might be impacted, the risk implications are still minimal. This is because abandonment would be assumed in a Fire PRA if smoke became sufficiently dense to cause such damage. This would render the loss of Control Room indications irrelevant to the subsequent scenario development.

T.2.1.3.4 Overall Risk Significance

This mode of component failure is found to have little or no risk significance.

T.2.1.4 Direct Chemical/Corrosive Attack

T.2.1.4.1 Damage Mechanism

Smoke deposits are typically highly acidic, and may also contain galvanic salts. These materials may lead to substantial corrosion. Synergistic effects with increasing moisture/humidity sharply increase the potential damage caused by chemical/corrosive attack.

T.2.1.4.2 Vulnerable Components

Most electrical and some mechanical components will be vulnerable to this mode of failure.

T.2.1.4.3 Risk Implications

Postfire corrosion damage has often been cited as significant in incident reports. However, corrosion damage sufficient to cause immediate failure of an electrical or electronic device requires a time scale ranging from days to months. Risk-significant fire scenarios are generally resolved within a time scale of minutes to hours. Hence, chemical/corrosive attack is not expected to play a significant role in fire risk. Proper postfire management strategies can effectively eliminate any significant risk contribution from longer-term component failures.

T.2.1.4.4 Overall Risk Significance

This mode of failure is found to have minimal risk significance.

T.2.2 Findings Associated with PRA Modeling of Smoke Damage

Only one mode of component failure was found in this review to be of potential risk significance; namely, circuit bridging. This failure mode may be realized as a result of simple airborne smoke particulate concentrations reaching threshold levels (in particular for higher voltage components) and/or due to deposition of smoke particulate onto vulnerable components.

Current fire models and data are insufficient at this time to directly assess the risk contribution of circuit bridging faults. Screening or bounding assessments can be made but, given current knowledge, would be dependent on the application of expert judgment and would retain considerable uncertainty.

To incorporate a direct assessment of circuit bridging faults into Fire PRA, it will be necessary to (1) better quantify the smoke damage criteria and thresholds for the components of interest, (2) incorporate smoke generation and transport models into the fire models used in Fire PRA, and (3) validate the analytical link between fire modeling and predictions of component damage. In the near term, such assessments can reasonably be based on the airborne smoke exposure concentration and, perhaps, the exposure duration. Hence, models that can predict the airborne smoke concentration would be sufficient to suit short-term analysis needs.

In the longer term, it would be desirable to develop models that could estimate the deposition behavior of smoke, as well and specifically correlate the combination of deposited and airborne smoke to component damage. In more specific terms, the PRA needs can be more clearly established by considering two classes of potentially vulnerable components; namely, high-voltage power distribution equipment and lower-voltage instrument and control system components.

T.2.2.1 High Voltage Components

T.2.2.1.1 Damage Thresholds

For high-voltage components, the most critical need is to establish a method (and supporting data) for estimating the smoke damage threshold of a given component or application (for example, how much smoke does it take to cause a failure in a particular 4.6 kV switchgear?). Initial test results indicate that relatively simple relationships between voltage, separation distances between voltage potentials, and the smoke exposure severity may be sufficient to establish a component's potential vulnerability to smoke damage.

T.2.2.1.2 Screening Analyses

Current screening methods applied to Fire PRAs commonly assume that most any fire will lead to total loss of the impacted room's contents. This inherently includes damage caused by smoke. For high-voltage components, an additional level of analysis may be appropriate to reduce the level of conservatism associated with screening. For example, relatively limited data on component vulnerability (the voltage, separation distance, smoke damage relationship) would be sufficient to screen components without any significant need for fire modeling tools. That is, if a method can be established by which a device's potential smoke vulnerability could be assessed based only on the device voltage and contact separation distances, an initial screening of in-plant components as either vulnerable or invulnerable is possible.

T.2.2.1.3 Risk Quantification

A more refined estimate of fire risk would require that methods be established to estimate the threshold smoke exposure damage levels for specific components. It would also require the ability to predict airborne smoke concentrations through fire modeling, including the smoke concentrations that might occur within a subsection of a room, such as a bank of interconnected breaker or switchgear panels. Deposition is likely not a significant factor in high-voltage equipment faults; hence, deposition modeling may not be necessary. The explicit capability to assess smoke generation and transport behavior does not exist in any of the currently popular NPP fire risk models. However, nominal capabilities do exist in other fire models. Hence, the capability could be added to the risk assessment models with relatively modest effort. In particular, fire models that currently track toxic gas production and concentrations should be readily adaptable to smoke modeling at this level (airborne concentration estimates). Some additional data on smoke production yields for the fuels of interest (cable insulation and liquid fuels primarily) may also be needed to support the modeling activities.

T.2.2.2 Lower-Voltage Instrumentation and Control Devices

T.2.2.2.1 Damage Thresholds

As noted above, the circuit bridging failures are a function of both airborne and deposited smoke. Moisture and humidity also play a significant synergistic role in increasing the damage potential. However, these behaviors are not currently well characterized. There is currently very limited information available to characterize smoke damage thresholds for specific components. The synergistic behavior of moisture also is poorly understood. Supplementing this data would substantially reduce uncertainties in risk estimates and ensure that excessive conservatism is avoided.

T.2.2.2.2 Screening Analyses

For the purposes of a fire screening analysis, it is reasonable to assume that any substantial fire might result in widespread smoke damage to exposed electronic devices. This is, in fact, not substantially different from current PRA area screening methods. The typical practice in screening is to assume that most any fire will result in total loss of a room's contents. If fully implemented, this inherently captures damage due to smoke, as well.

T.2.2.2.3 Risk Quantification

In order to more accurately estimate the contribution to fire risk, the analyst will need access to fire models that can predict the smoke generation and transport behavior associated with specific fire scenarios. The models currently applied to NPP Fire PRA do not provide this capability. One would also need to establish a link between the model predictions and the damage behavior of specific components of interest. For example, an integrated assessment of smoke exposure severity and time of exposure could likely be used to predict the onset of component damage. Again, these tools do not currently exist.

T.3 A PRA Framework for Smoke Damage

T.3.1 Practices Supported by the Current State of the Art

The current state of knowledge cannot support detailed quantitative assessments of smoke damage as a part of a Fire PRA. As described above, information relating to smoke damage thresholds remains lacking, and the current fire modeling tools as applied in Fire PRA do not provide the necessary analytical capabilities.

Given these limitations, it is recommended that fire scenario analysis should include qualitatively (or judgment-) based assessments of smoke-induced damage. Such qualitative assessments can be factored into a quantitative Fire PRA analysis as component failures assumed in addition to thermally-induced damage. For medium and high-voltage electrical equipment, creepage distances and use of insulation on conductors should be considered. For example, most medium voltage switchgear bus bars are coated with a plastic insulating material to reduce the likelihood of phase-to-ground or phase-to-phase arcing faults. This insulation would be expected to greatly reduce the possibility of arcing in the presence of heavy smoke, because the smoke will not be in direct contact with the conductors.

The following assumptions should be included in the PRA assessment.

- The following types of components are potentially vulnerable to smoke damage:
 - Medium voltage electrical switching equipment (1,000 V to 15 kV), including switchgear, circuit breakers, surge arrestors, switches, etc.
 - High-voltage electrical power transmission equipment (above 15 kV), including transformers, switches, circuit breakers, overhead power lines, lightning arrestors, bus bars, etc.
 - Devices that rely on fine mechanical motion (e.g., strip chart recorders and dial indicators) where the moving parts are exposed to smoke deposition.
 - Unprotected printed circuit cards and electronic components.
- Short-term smoke damage will only result from a severe smoke exposure condition.
 - For general compartment scenarios: Smoke exposures arising from a general compartment fire (e.g., general smoke spread within the room of fire origin or in an adjacent compartment) will not lead to short-term smoke damage, even for potentially vulnerable components.
 - For components housed in an individual electrical panel: Smoke damage will likely be limited to components colocated in the same electrical panel as the fire ignition source itself. Assume that, given a substantial fire in an individual electrical panel, all potentially vulnerable components within that panel will be damaged by smoke unless a specific installation feature precludes such damage (see below). Thermal damage for such components should also be considered.

- For components located in an interconnected bank of electrical panels: Given a substantive fire, it is reasonable to assume that dense smoke will spread, at the very least, into directly adjoining panel sections. Given a substantial fire in one section of an interconnected bank of panels, assume that potentially vulnerable components in the immediately adjoining panels will be damaged due to smoke exposure.
- For very high-voltage electrical transmission equipment: Assume that exposure to substantial quantities of smoke (e.g., from a large forest fire or from a large oil fire) will cause high-voltage transmission equipment to trip off-line.
- For components in an open main control board-type configuration: smoke exposure conditions are not expected to reach levels sufficient to cause component failures.
- The following features are assumed to preclude short-term smoke damage:
 - Use of a conformal coating on a printed circuit card;
 - Hermetic encapsulation of electronic, solid state, or electromechanical devices (e.g., as is typical of a solid state relay or computer HDD unit);
 - Housing of control and indication components in a well-sealed manufacturers' housing (e.g., typical of a dial indicator, strip chart recorder with all covers in place and intact, electromechanical relays with a tight-fitting cover);
 - Housing potentially vulnerable components within an electrical chassis, so long as the chassis is reasonably well sealed, ventilation inlets into the chassis are filtered, and the fire itself remains outside the chassis;
 - Housing components in a sealed panel with a filtered local ventilation system (so long as the fire remains outside the panel); and
 - Housing components in a well-sealed and unventilated electrical panel so long as the fire remains outside the panel.

T.4 References

- T.1 Jacobus, M.J., Screening Tests of Representative Nuclear Power Plant Components Exposed to Secondary Fire Environments, SAND86-0394, NUREG/CR-4596, U.S. NRC, June 1986.
- T.2 Tanaka, T.J., S.P. Nowlen and D.J. Anderson, Circuit Bridging of Components by Smoke, SAND96-2633, NUREG/CR-6476, U.S. NRC, October 1996.
- T.3 Chavez, J.M., An Experimental Investigation of Internally Ignited Fires in Nuclear Power Plant Control Cabinets, Part I - Cabinet Effects Tests, NUREG/CR-4527/V1, SNL/USNRC, April 1987; and: Chavez, J.M. and S.P. Nowlen, An Experimental Investigation of Internally Ignited Fires in Nuclear Power Plant Cabinets, Part II - Room Effects Tests, NUREG/CR-4527/V2, U.S. NRC, October 1988.
- T.4 Tanaka, T.J. and S.P. Nowlen, Results and Insights on the Impact of Smoke on Digital Instrumentation and Controls, SAND99-1320, NUREG/CR-6597, U.S. NRC, January 2001.

Appendix U

**Appendix for Chapter 15, Uncertainty
Analysis–Technical Bases**

U

APPENDIX FOR CHAPTER 15, UNCERTAINTY ANALYSIS—TECHNICAL BASES

The Task 15 procedure is used for identifying uncertainties in the Fire PRA and performing uncertainty and sensitivity analyses useful to analysts and future applications of the PRA. Analysts using this procedure should understand the importance of including uncertainties in the results, the basic types of uncertainties, and typical handling of uncertainties in PRAs. The information below provides the technical theory and principles upon which this procedure is based. Analysts using this procedure should have a basic understanding of the concepts presented below.

U.1 Background

Below are some basic assertions that provide the foundation for subsequent discussion.

- There are physical variables that are, in principle, observable. Examples include the time to failure of a particular component when exposed to a particular fire event, the time at which an operator takes a particular action at a given point in an accident sequence, or the amount and type of combustible in a given location. The values of such a set of variables need to be predicted as part of the Fire PRA.
- Because of limitations in resources, lack of knowledge, or both, some of these variables are treated as the result of random processes. In other words, if a thought experiment is employed involving a number of repeatable trials, a distribution of values (e.g., an empirical histogram) for the variable of interest can be envisioned. The prediction, therefore, will be in terms of a probability distribution.
- The remaining variables may be treated as being deterministic. Again, if a thought experiment involving a number of repeatable trials is employed, a single value for the variable of interest (or, at least, a range of variability that is sufficiently small for the practical application) will be observed. The prediction, therefore, will be in terms of a point value, at least in principle.

Note that because choice is involved, there is no fundamental principle as to when a variable should be modeled as random or deterministic; the analyst needs to decide if the notion of repeatable trials makes sense for the problem being addressed. In PRAs, such things as pump failures and operator actions are modeled as being random, pumps and operators are treated as coming from populations of pumps and operators, and there is no attempt to model individual pumps or individual operators. (One can argue that, even in the case of individual pumps and operators, the notion of random variability still makes sense due to processes like environmental variation and renewal).

Also note that, in current PRAs, core damage events and large early release events are modeled as the possible results of a set of interacting random processes, namely, those involving a fire that causes a plant transient, the response of mitigating systems to the transient including fire effects, and the associated actions of human operators. The occurrences of core damage and large early release events are also, therefore, treated as random events.

For random events occurring over time, PRAs typically use a Poisson distribution to model event occurrence. This means that the probability of observing N events in a time period T is given by:

$$P\{N \text{ events in time } T \mid \lambda\} = \frac{(\lambda \cdot T)^N}{N!} \cdot e^{-\lambda T},$$

where λ , a “frequency,” is simply a parameter characterizing the process. As λ increases, the likelihood of events also increases. It can be shown that the average number of events occurring in time period T is equal to λT .

It turns out that for a Poisson process, if T_1 is the time to the first event, the distribution of T_1 is exponential, i.e.,

$$P\{T_1 < t \mid \lambda\} = 1 - e^{-\lambda t}.$$

As λ increases, the probability of observing the first event by a specified time also increases. It can be shown that the average time to the first event is equal to $1/\lambda$. It can also be shown that

$$P\{T_1 < t \mid \lambda\} \approx \lambda \cdot T \quad \text{when} \quad \lambda \cdot T < 0.1.$$

CDF and LERF are the frequencies of core damage events and large early release events, respectively. Thus, they are simply parameters of Poisson distributions. Of course, the values of CDF and LERF are not necessarily known with a high degree of certainty.

U.2 Types of Uncertainties: Aleatory and Epistemic

The preceding discussion addresses uncertainties due to “inherent randomness.” In earlier literature, they are often called “random uncertainties” or “stochastic uncertainties.” Currently, they are often called “aleatory uncertainties.”³¹ Their principal characteristic is that they are (or are modeled as being) irreducible; i.e., they are defined by the form of the probability distribution (e.g., the Poisson distribution) and the value of the distribution parameters (e.g., λ).

Note that in the examples given earlier, the variability in the uncertain variable (e.g., N or T_1) is observable, at least in principle. In other words, repeated observations of the variable will result in an empirical distribution of values. This provides a way to think about aleatory uncertainties; if repeated trials of an idealized thought experiment (where the conditions are kept constant from trial to trial) will, assuming no measurement error, lead to a distribution of outcomes for the variable, this distribution is a measure of the aleatory uncertainties in the variable.

³¹ According to Webster’s, *aleatory* (adj.) comes from *alia* (a dice game); relevant definitions are: (1) depending on an uncertain event; (2) relating to good or bad luck.

Another type of uncertainty addressed in PRAs is “epistemic uncertainty,”³² which has been called “state of knowledge uncertainty” in earlier papers because it is due to weaknesses in the assessor’s current state of knowledge. Uncertainties in a deterministic variable whose true value is unknown are epistemic. Repeated trials of a thought experiment involving the variable will, in principle, result in a single outcome, the true value of the variable. Similar to aleatory uncertainty, the epistemic uncertainties are also quantified using probability distributions. However, it is important not to confuse the two. Epistemic deals with the uncertainty in the parameter values of the aleatory uncertainty. For example, the uncertainties in the failure rate, λ , of a pump are considered epistemic uncertainty. The probability of experiencing at least one pump failure within time period T is the aleatory uncertainty associated with that pump.

Unlike aleatory uncertainty, epistemic uncertainty is reducible with the collection of additional information. In PRAs, for example, it is typically assumed that the Poisson model is a good representation for the failure of equipment while running. Therefore, it is assumed that there is a particular failure rate for each component. Initially, there may not be much failure data for a component, and (epistemic) uncertainty in the value of the failure rate will be large. After collecting a large enough sample of failure data, a very good estimate of the failure rate can be obtained; i.e., the epistemic uncertainty in the value of the failure rate will be small. Formally, the estimation procedure involves the application of Bayes’ Theorem.

U.3 Uncertainty Analysis in PRA

Current PRAs typically use two kinds of models to address aleatory uncertainties. The first model is applied to events occurring over time (e.g., failures of already-operating pumps), and is the Poisson distribution that has already been discussed. The second model is applied to events occurring as the immediate consequence of a challenge (e.g., failures of standby pumps to start on demand), and is the binomial distribution. This distribution quantifies the likelihood of outcomes resulting from a Bernoulli (or “coin flip”) process. It is given by:

$$P\{R \text{ failures in } N \text{ demands} \mid \phi\} = \frac{N!}{R!(N-R)!} \phi^R (1-\phi)^{N-R},$$

where ϕ is the probability of failure for a single demand. It can be seen that, mathematically, ϕ plays the same role as λ ; it is just a parameter characterizing a distribution. As the number of trials gets very large, the relative frequency of failures, R/N , approaches ϕ . Thus, ϕ can be interpreted as the fraction of times failures will occur in the long run.

Using the various λ s and ϕ s corresponding to the different variables included in the Fire PRA Model, the CDFs and LERFs associated with various fire event sequences can be computed. Symbolically,

³² According to Webster’s, *epistemic* (adj.) comes from *epistemikos* (capable of knowledge); relevant definitions are (1) of, having the character of, or relating to intellectually certain knowledge; (2) purely intellectual or cognitive; (3) subjective.

$$\text{CDF} = f_1(\lambda, \phi)$$

$$\text{LERF} = f_2(\lambda, \phi).$$

To quantify the epistemic uncertainties in CDF and LERF as a result of fire events, the epistemic uncertainties in the λ s and ϕ s are propagated through f_1 and f_2 . This is currently done on a routine basis using sampling schemes (e.g., Monte Carlo sampling).

The quantification of the uncertainties in the λ s and ϕ s involves the collection and interpretation of a variety of forms of evidence (e.g., model predictions, expert opinion, empirical data), and the application of an appropriate estimation procedure that uses this evidence.

U.4 Uncertainties in the Integrated Fire Analysis

To develop estimates of CDF and LERF associated with fire events, fire scenario uncertainties, including fire-modeling uncertainties (e.g., initiation, growth, effects, suppression), should be addressed in an integrated PRA framework.

Using conventional PRA tools (e.g., event trees and fault trees), the accident sequences resulting from fire challenges can be identified and their frequencies estimated. These estimated frequencies characterize the parameters of aleatory uncertainties associated with the occurrence of fire-induced accident sequences. Conventional PRA tools (e.g., Monte Carlo or Latin hypercube sampling) can also be used to propagate distributions quantifying the epistemic uncertainties in these estimated frequencies. Put another way, the estimated frequency for a given modeled accident sequence is perhaps best interpreted as the fraction of times fire-induced core damage will be observed, given a large number of challenges of the type defined by that accident sequence. What accident sequence will occur is modeled as a random process in the Fire PRA, with the corresponding accident sequence frequencies characterizing the aleatory uncertainties in fire-induced CDF and LERF. The uncertainty in each estimated accident sequence frequency is described by a distribution quantifying the epistemic uncertainties in each estimated frequency.

In modeling possible fire events and the resulting CDFs and LERFs, variability in the plant response should be expected. This variability certainly arises because of the manner in which the PRA defines the fire challenge events. It also arises due to modeling each fire in the analysis (e.g., growth potential, extent of equipment damage), as well as treating operator responses during the event.

Consider first the issue of accident sequence definition. The fire challenging scenarios identified by conventional PRAs are defined in terms of initiating events (e.g., fire initiated in a particular location with a given type/quantity of combustible and a particular effect) and successes or failures of mitigating equipment and actions (including effects due to the fire). These are, in turn, affected, in part, by modeling the fire in the plant. This fire modeling also has aleatory and epistemic uncertainties. For example, for an area with multiple initiator sources, which source is the start of the fire is best represented by a random event. Thus, the modeling process will likely include possible fires as initiators (an expression of the aleatory uncertainty with regard to fires

that can initiate in the area). The frequency of each fire may have both aleatory and epistemic uncertainties. For example, if the ignition source and/or combustibles are of a transient nature, their existence will likely be considered random and characterized as an aleatory uncertainty associated with the fire initiator frequency. Once the fire is assumed to start, its subsequent growth and the targets (i.e., cables, components) affected by the fire are uncertain. This is largely due to a lack of understanding of the complex physics actually involved in fire growth, hot gas layer generation, how and when a target will actually fail, among other phenomena. Hence there is an epistemic uncertainty associated with the probabilities of targets being affected by the fire. Often, conservative assumptions are made to address these uncertainties (e.g., it is assumed certain targets will be affected with a probability of 1.0). However, later in the circuit analysis for an affected cable, a probability distribution may be assigned to reflect the uncertainty that the target failure mode of interest actually occurs. These and other uncertainties throughout the Fire PRA result in uncertainties in the estimated CDFs and LERFs.

In order to make most effective use of analysis results, it is important that the user understand the fundamental modeling assumptions underlying the analysis. In the case of a PRA, it is particularly important to understand how the analysis deals with uncertainties that arise because of issues not explicitly modeled and those because of imperfect knowledge concerning the issues that are modeled. This understanding will affect how the user perceives and uses the analysis results in subsequent decision-making activities.

Where there are aleatory and epistemic contributions to uncertainty, these contributions need to be separated, to the extent possible, for the reasons mentioned above. The aleatory contribution is dealt with primarily in the Fire PRA event tree (i.e., as “conditional split fractions”). The epistemic uncertainty is treated when epistemic uncertainties are propagated through the model.

U.5 References

- U.1 Apostolakis, G., “The concept of probability in safety assessments of technological systems.” *Science*, 250, 1359-1364 (1990).
- U.2 Apostolakis, G., “A commentary on model uncertainty, in Model Uncertainty: Its Characterization and Quantification,” A. Mosleh., N. Siu, C. Smidths, and C. Liu, Center for Reliability Engineering, University of Maryland, College Park, MD., pp. 13-22 (1995).
- U.3 Parry, G., and P.W. Winter, “Characterization and Evaluation of Uncertainty in Probabilistic Risk Analysis,” *Nuclear Safety*, 22, 28-42 (1981).

Appendix V

**Appendix for Chapter 15, Discussion of
Individual Task Uncertainties**

V

APPENDIX FOR CHAPTER 15, DISCUSSION OF INDIVIDUAL TASK UNCERTAINTIES

This appendix provides a summary discussion of each task's identified uncertainties and recommended practical strategies for their treatment. The expected role of sensitivity analyses, which could apply to some tasks, is also covered.

It is noted that many of the issues mentioned here are not typically treated in a traditional PRA uncertainty analysis since they represent technical quality (i.e., accuracy and completeness) issues that if treated properly, should not impact the uncertainty in the final results of the Fire PRA. Nevertheless, they are addressed here (separately under each task) as a reminder that the results are dependent on satisfactory assurance of the quality of the PRA. Proper treatment of technical quality issues ensures that the results can be used without regard to any significant uncertainty associated with the "correctness" of the results.

V.1 Summary of Task Uncertainties and Suggested Treatment

V.1.1 Task 1—Plant Boundary Definition and Partitioning

V.1.1.1 Uncertainty Issues

This task is not explicitly considered as a source of uncertainty. No modeling or data uncertainties from this task are expected which will significantly affect the overall Fire PRA results. This is a deterministic (not probabilistic) process. By virtue of both single and multi-compartment analyses being performed, the Fire PRA results should be reasonably insensitive to any variability in plant partitioning (i.e., modeled from a location point of view). No formal quantification of the uncertainty associated with partitioning decisions is anticipated.

V.1.1.2 Accuracy Issues

The partitioning decisions introduce an indeterminate level of modeling uncertainty associated primarily with the potential that single compartment and multi-compartment fire scenarios are not analyzed with complete consistency. Partitioning decisions will also impact the presentation and interpretation of the analysis results given the presentation of risk contributions in the context of single and multicompartment scenario contributions. However, the Fire PRA should reach an identical conclusion regarding numerical estimates of fire risk, regardless of how the partitioning decisions are made.

To address this issue, the partitioning should be reviewed to ensure the appropriateness and consistency of the partitioning. Further, it is recommended that the partitioning task be performed so that the potential for a multi-compartment fire impact is of very low likelihood. This will allow the analysis to focus primarily on single compartment fire scenarios, which can then be analyzed in a consistent manner.

V.1.2 Task 2–Fire PRA Components Selection

V.1.2.1 Uncertainty Issues

No modeling or data uncertainties from this task are expected to be defined. A deterministic (not probabilistic) process is used at arriving at the appropriate list of components that should be included in the Fire PRA. Since the list is based on the best available information and judgment, no uncertainty from this task needs to be included in the Fire PRA results. Hence no treatment of uncertainty for this task is necessary.

At most, if a component’s inclusion on the list is questionable and no clear cut decision is possible, a sensitivity analysis could be performed with and without the component in the Fire PRA Model.

V.1.2.2 Accuracy and Completeness Issues

It could be an issue as to whether the component list, and hence the model, contains all the necessary equipment to consider in the Fire PRA. An inappropriate components list can improperly attribute the fire risk to the wrong areas. Of particular concern is the possibility that important fire risk contributors could be missed, e.g. potential spurious operations of equipment is not included. Concerns about the accuracy of the list are related to the completeness of the Fire PRA model with respect to PRA equipment and sequences including fire-induced initiators. (e.g., is it appropriate to eliminate fire-LOCA sequences?; are new sequences missing?; are the necessary instrumentation items and their failure modes included that could affect operator performance?).

The issue of the component list accuracy is best addressed through the use of a quality review to ensure the list is sufficiently complete so as to not miss potentially significant fire risk contributors.

V.1.3 Task 3–Fire PRA Cable Selection

V.1.3.1 Uncertainty Issues

No modeling or data uncertainties from this task are expected to be defined. A deterministic (not probabilistic) process is used to identify the appropriate cables (and their locations) that should be included in the Fire PRA. Once the list of cables is defined, based on the best available information and judgment, there is no uncertainty from this task that needs to be included in the Fire PRA results. Hence no treatment of uncertainty based on this task is necessary.

At most, if a cable's inclusion on the list or its location is questionable and no clear cut decision is possible, a sensitivity analysis could be performed with and without the cable defined in a specific location in the Fire PRA Model to ascertain the sensitivity of the results to this issue.

V.1.3.2 Accuracy and Completeness Issues

The selection of cables and designation of their locations may be subject to judgment or inaccuracies if not addressed properly. For instance:

- Discrepancies between the plant partitioning boundary designations and the identified cable/raceway locations can affect the accuracy of the overall results of the Fire PRA (because the location information does not match).
- Use of rules that are set up in Task 3 inherently control what types of circuits and corresponding cables will or will not be included in the analysis. Flawed rules or improper implementation of the rules could lead to inaccurate or incomplete cable selections.
- Accuracy of the cable and raceway routing information used to identify the plant locations (partition areas) through which PRA cables are routed could be a source of potential inaccuracy. The reasons for this may result from using incorrect/out-of-date cable and raceway system data, mismatches between the plant partitioning boundary designations developed in Task 1 to the cable/raceway location relationships in the cable and raceway database, ambiguity in data, etc.

The issue of the cable selection accuracy is best addressed through the use of a quality review and task analyst training, as well as confirmatory walkdowns, where necessary.

V.1.4 Task 4—Qualitative Screening

V.1.4.1 Uncertainty Issues

No modeling or data uncertainties from this task are expected to be defined. A deterministic (not probabilistic) process is used to decide which compartments can be screened out from the Fire PRA. This screening is based on perceived lack of impacts on the operational status of the plant (i.e., lack of a plant trip, no known PRA components affected). Once these determinations are made based on the best available information and judgment, there is no uncertainty from this task that needs to be included in the Fire PRA results. Hence no treatment of uncertainty based on this task, is necessary.

At most, if a compartment's exclusion from the Fire PRA is uncertain (for instance, whether an automatic or manual plant trip will occur may not be known with certainty), that compartment should be retained for further detailed analysis to better determine its contribution, if any, to the overall fire risk.

V.1.4.2 Accuracy Issues

The primary issue of concern is the premature or inappropriate screening out of potentially important compartments from further analysis in the Fire PRA. This is best addressed through a quality review. If there is doubt about the appropriateness of screening out a compartment, that compartment should not be screened out, but instead, analyzed further per the other Fire PRA procedures.

V.1.5 Task 5–Fire-Induced Risk Model

V.1.5.1 Uncertainty Issues

The model structure itself and the associated accident sequences and their frequencies represent the randomness assumed in the modeling of fire-induced accident sequences (i.e., the aleatory uncertainty). This randomness manifests itself in variations in the ways that fire-induced core damage or a large early release may occur. To the extent the Fire PRA Model includes the modeling and data uncertainties from all other tasks, it provides a collective expression of the uncertainties in the Fire PRA results. Note that one potentially important uncertainty not likely to be quantified is the assumption that all non-modeled equipment fails (probability = 1.0). This is not necessarily the case in most or even all fire situations and may lead to a conservative fire risk result.

V.1.5.2 Accuracy and Completeness Issues

Technical quality issues associated with producing the Fire PRA Model include, for instance:

- Whether all the relevant fire ignition events and sequences are included in the model, including whether any new events to address fire situations (e.g., spurious opening of a valve due to fire effects) have been appropriately mapped to the PRA model; and
- Whether the model appropriately contains all the relevant modeling of equipment failures and human actions, including the potential effects of spurious operation or failure of equipment.

These issues should be addressed through a quality review to ensure the model appropriately reflects the results of the other tasks and that the PRA logic development is as accurate and complete as practicable.

V.1.6 Task 6–Fire-Ignition Frequency

V.1.6.1 Uncertainty Issues

This task provides probabilistic products in the form of updated fire frequencies based on generic data and plant-specific considerations for each fire scenario postulated to occur and modeled in the Fire PRA. Particularly for each important fire based on the significance to the final Fire PRA

results, the frequency can be provided not as just a single best-estimate value, but as a distribution capturing the uncertainty in the frequency estimate. These distributions, based on Bayesian statistical analysis of available data, attempt to capture variability among plants and the different fire reporting requirements used in the various data sources. These updated frequency distributions should be propagated through the Fire PRA Model quantification using Monte Carlo or similar sampling techniques.

V.1.6.2 Accuracy Issues

Accuracy in deriving the fire frequencies can be, for instance, affected by:

- Whether the mapping of plant-specific locations to generic locations (important, since the fire frequencies will be based on generic frequency information for generic locations) has been applied correctly;
- Whether the equipment count, which plays a part in partitioning fire initiator frequencies among multiple ignition sources, has been performed correctly;
- Whether location-weighting factors used to translate generic fire frequencies for a location to specific compartments within that location have been properly determined. The weighting factors account for the relative amount of ignition sources in a specific plant compared to the “average” plant;
- Whether the ignition source weighting factors to also account for plant-specific vs. average plant differences have been properly determined;
- Whether plant-specific fire experience has been properly identified, categorized, and analyzed as to how it should modify the generic frequency information;

These concerns should be dealt with by a quality review of all the above steps including confirmatory walkdowns, where appropriate.

V.1.7 Task 7–Quantitative Screening

V.1.7.1 Uncertainty Issues

No modeling or data uncertainties from this task are expected to be defined. A deterministic (not probabilistic) process is used to decide which fire scenarios or compartments can be screened out from the Fire PRA. Once these determinations are made based on the best available information and judgment, there is no uncertainty from this task that needs to be included in the Fire PRA results. Hence no treatment of uncertainty based on this task is necessary. However, as discussed in the task procedure, it is expected that screened-out fires/compartments will be retained to compare the potential residual CDF/LERF contributions from these screened out fires/compartments to the unscreened Fire PRA results.

V.1.7.2 Accuracy Issues

The key issue of concern is inappropriate screening out of potentially important fires or compartments from further analysis in the Fire PRA. This is best addressed through a quality review of the process followed and any judgments made during the quantitative screening evaluations.

V.1.8 Task 8–Scoping Fire Modeling

V.1.8.1 Uncertainty Issues

This task involves performing some bounding fire effects analyses to determine if certain fire ignition sources and/or fire compartments can be screened out from more detailed modeling and analysis, as well as to define fire severity factors for the unscreened fire sources. As with Task 4, no modeling or data uncertainties from this task are expected to be defined. A deterministic (not probabilistic) process is used (although consideration of likelihood may be part of the process such as whether target damage is possible) at deciding which compartments can be screened out from the Fire PRA. Once these determinations are made based on the best available information and generally conservative assessments, there is no uncertainty from this task that needs to be included in the Fire PRA results. Hence no treatment of uncertainty based on this task, is necessary.

At most, if the exclusion of a particular fire scenario or compartment from the Fire PRA is uncertain, that fire scenario or compartment should be retained for further detailed analysis to better determine its contribution, if any, to the overall fire risk.

V.1.8.2 Accuracy Issues

The primary issue of concern is the premature or inappropriate screening out of potentially important fires or compartments from further analysis in the Fire PRA as well as the appropriate assigning of severity factors for the unscreened fires. Choosing such parameters as the severity of the fire, heat release rates, damage criteria used, and the accuracy and completeness of the walkdown information to assess worse-case fire conditions and target failure is subject to some judgment. Proper evaluations are best addressed through a quality review including confirmatory walkdowns as necessary. If there is doubt about the appropriateness of screening out a compartment, that compartment should not be screened out, but instead, analyzed further per the other Fire PRA procedures. Similarly, severity factors for the unscreened fire sources using available fire modeling tools should err on the side of conservatism, subject to more detailed analysis if necessary in Task 11 or in other iterations of the Fire PRA process.

V.1.9 Task 9–Detailed Circuit Failure Analysis

V.1.9.1 Uncertainty Issues

No modeling or data uncertainties from this task are expected to be defined. A deterministic (not probabilistic) process is used at performing the detailed circuit analyses using an established rule set. No uncertainty from this task needs to be included in the Fire PRA results. Hence no treatment of uncertainty based on this task is likely to be necessary.

V.1.9.2 Accuracy Issues

The detailed circuit analyses may be subject to judgment or inaccuracies if not addressed properly using the established rule set. For instance:

- There is the possible use of inadequate, ambiguous, or inappropriate plant-specific rules used for the analysis of critical circuits. For example, when developing a set of plant-specific circuit analysis rules, it may be generally assumed that circuits performing an apparently innocuous function (e.g., operational status indication) will not cause the component to fail, and thus need not be analyzed for their respective response. As a result, some circuits that might indeed have the capability to impair the function of their components due to fire damage may be inappropriately screened out. These circuits would also not be included in the set of circuits necessitating circuit failure likelihood analysis under Task 10.
- Improper implementation of the rules could occur.

Potential inaccuracies are best addressed by review of the rules and analyses, and use of trained, experienced analysts in performing the circuit analyses.

V.1.10 Task 10–Circuit Failure Mode Likelihood Analysis

V.1.10.1 Uncertainty Issues

This task provides probabilistic products in the form of likelihoods of circuit failure modes for circuits that could not be previously screened out as unimportant. For the more significant results to the Fire PRA, best-estimate probabilities are assigned to the circuit failure modes of interest with corresponding probability distributions representing the uncertainty in each best estimate. These probability distributions, derived primarily from test data, should be propagated through the Fire PRA Model quantification using Monte Carlo or similar sampling techniques. In particular, the following are recommended to represent a high confidence range for the failure mode probabilities (suggest treating with a flat, uninformed distribution whose limits are the following):

Cables with 15 or less conductors: $\pm 20\%$

Cables with more than 15 conductors: $\pm 50\%$.

V.1.10.2 Accuracy Issues

The circuit failure mode likelihood analyses may be subject to the following examples of sources for inaccuracy:

- Whether the approach used to analyze the circuits is appropriate for the actual situation, and the applicability of the test data used;
- Whether the specific rules to apply the approach are appropriate;
- Whether the actual analysis, including the use of weighting factors, proper characterization of the circuits, etc., have been performed properly; and

These process-related issues are best addressed by properly trained analysts and by performing technical quality reviews of the work.

V.1.11 Task 11–Detailed Fire Modeling

V.1.11.1 Uncertainty Issues

This task provides probabilistic products in the form of target failure probabilities. For the more significant fire events to the Fire PRA results, the parameters associated with the calculated target failure probability, such as the heat release rates and target thermophysical properties, should be expressed, to the extent possible, with uncertainty distributions, so that they can be propagated through the analysis to arrive at a distribution for each target failure probability. These distributions should be based on the variation of experimental results, as well as analyst judgment about interpreting the data including the effects of actual fire events.

Additionally, to the extent that different fire models to assess target damage may be appropriate (based on different interpretations of experiments or other judgments), more than one “model” can be used. Probabilities can be assigned to each model representing the degree of belief that each model is the “correct” one. This multi-modeling approach can become an integral part of the overall Fire PRA Model to express part of the uncertainty with regard to the prediction of target damage.

V.1.11.2 Accuracy Issues

Example sources for possible inaccuracies in the assigned target failure probabilities (some of which could be reflected in the multi-modeling approach mentioned above) include:

- Whether the proper modeling objectives have been identified. Does the analyst need to address the level of toxic gases, as well as the room temperature? Should the analyst model the fire growth based primarily on oxygen levels in the immediate flame area, or by some other characteristic?
- Whether the fire scenarios to be modeled sufficiently represent the fire risk profile of a compartment;

- Whether there is a proper technical representation of a compartment's characteristics (e.g., size, locations of doors and vents, etc.);
- Whether heat release rate profiles are appropriate based on limited empirical evidence and judgment;
- Whether target locations and the targets' thermo-physical properties are appropriately defined;
- Whether the modeling tools selected for the analysis are the best for analyzing the fires and scenarios of interest.

These should be addressed using technical reviews, including walkdowns, where necessary.

V.1.12 Task 12—Post-Fire Human Reliability Analysis

V.1.12.1 Uncertainty Issues

This task provides probabilistic products in the form of human error probabilities. For the more significant results to the Fire PRA, best-estimate human error probabilities are assigned with corresponding probability distributions (based primarily on the HRA method/tool being used but with additional considerations as discussed in this task) representing the uncertainty in each best estimate. These probability distributions should be propagated through the Fire PRA Model quantification using Monte Carlo or similar sampling techniques.

V.1.12.2 Accuracy and Completeness Issues

This task has the same technical issues associated with any HRA such as:

- Whether the modeling of the human failure events are sufficiently complete and appropriate for the fire scenarios modeled in the Fire PRA;
- Whether the screening rules and associated screening HEPs are reasonable and will not allow inadvertent screening out of potentially important HFEs and associated scenarios; and
- Whether the detailed HRAs and subsequent HEPs have properly considered the important performance-shaping factors, especially considering the unique characteristics of fire-type scenarios, and used tools to adequately consider these factors.

These issues are best addressed using technical review as well as trial-and-error with regard to whether the use of screening HFEs seems reasonable.

V.1.13 Task 13–Seismic-Fire Interactions

V.1.13.1 Uncertainty Issues

Since this is a qualitative evaluation, there are no quantitative assessments for which uncertainty analyses need to be performed. Any uncertainties as to the possible effects of these interactions should be qualitatively discussed as part of this task's documentation.

V.1.13.2 Accuracy and Completeness Issues

The primary technical quality issues associated with this task involve the proper identification and evaluation of the possible seismic-fire interactions that could contribute to fire risk. These are best addressed by technical review of the evaluation and use of confirmatory walkdowns, if necessary.

V.1.14 Task 14–Fire Risk Quantification

Since this is just the finalization of what has already been performed during previous screening steps, but with the addition of the inputs from the later tasks (e.g., circuit failure analysis), it has the same uncertainties/issues as Tasks 5 and 7, reflecting the additional uncertainties introduced by task inputs from the later tasks. Propagation of the various frequency and probability distributions from previous tasks is expected to produce uncertainty distributions in the CDFs/LERFs that are calculated.

V.1.15 Task 15–Uncertainty and Sensitivity Analyses

This task does not introduce any new uncertainties to the fire risk. It simply provides suggestions on how uncertainties in the other tasks should be treated.

V.1.16 Task 16–Fire PRA Documentation

This task does not introduce any new uncertainties to the fire risk. It does address the fact that documentation of which uncertainties have or have not been addressed, and how, should be part of the overall documentation effort.

V.2 Role of Sensitivity Analyses

When the tasks are being conducted, it is expected that sensitivity analyses may prove useful in determining what uncertainties should be addressed and how. For instance, if the location of a set of cables cannot be definitively determined, perhaps due to ambiguous plant documentation coupled with the inability to easily obtain access to the plant area and resolve the issue, it may be possible to perform preliminary analyses with the Fire PRA Model assuming the cables are or are not present in the location. Depending on the perceived change in the fire risk, the

importance of definitively determining the location can be ascertained. If not important, this uncertainty might not be addressed at all, and simply the worst-case assumption be used. If it is important, the uncertainty should be addressed in some quantitative or qualitative fashion (e.g., the results are “x” if the cables are not there; the results are “y” if the cables are there).

Sensitivity analyses could be used in *any* of the above tasks; i.e., sensitivity analyses are expected to be part of the analysis arsenal of tools used to determine which uncertainties are worthy of being addressed, as well as to provide insights as to how the uncertainty should be addressed (e.g., picking the worse-case model, applying two models each assigned a likelihood of being the correct model, using the worse-case value for a parameter estimate, etc.). To the extent the sensitivity analyses performed and the effects on the results of the Fire PRA are considered important to the proper use of the Fire PRA by decision-makers and future PRA analysts, it is important that these sensitivity analyses be part of the Fire PRA documentation. This is because they are further reflections as to the uncertainties in the analysis (be they modeling or parameter uncertainties), and hence it is important they be communicated as part of the results.

Appendix W

**Appendix for Chapter 18, Sample Fire PRA
Database Structure**

W

APPENDIX FOR CHAPTER 18, SAMPLE FIRE PRA DATABASE STRUCTURE

This appendix provides a sample database structure for a standalone Fire PRA Database. The sample establishes one possible database structure that supports the functional criteria established in Support Task B (Chapter 18). Included in the data structure are requisite data fields and relationships, data entry constraints, and data integrity logical checks (parent-child data relationships). The sample structure also ensures that data fields map to an input source, such as another task or plant database.

W.1 Database Structure and Relationships

The basic elements and functional criteria of the database include:

- Database structure (tables and table relationships),
- Essential fields for data tables,
- Data relationships and constraints, and
- Logical constraints for data integrity.

The Fire PRA Database will consist of a set of interrelated tables. The tables should be grouped into two categories:

1. **Analysis Tables**—These tables are populated by the analyst as part of conducting Tasks 1, 2, 3, and 9. The primary tables contain information about boundaries and partitions, Fire PRA equipment, and Fire PRA cables. The database might also contain information about other fire protection systems and structural attributes, depending on the extent to which the database will capture these features. These tables are an output of analytical work to identify fire compartments, components, and cables of interest in the Fire PRA.
2. **Source Data Tables**—The Source Data Tables contain plant information and selection options that are used to expedite population of the Analysis Tables and generate sorts and queries.

Figures W-1 and W-2 show a recommended Fire PRA Database structure, including Analysis Tables, Source Data Tables (i.e., lookup tables), and data relationships. Establishing the correct data structure and relationships ensures that the database system contains the necessary functionality for constructing queries able to cascade fire-induced cable failures to equipment failures based on location.

The bolded data fields in Figures W-1 and W-2 represent the data needed to complete Tasks 1, 2, and 3. The remaining data fields support follow-on tasks and may be populated as appropriate based on the desired functionality of the database system. Note that descriptive information for the equipment and cable tables will be necessary to support detailed circuit failure analysis under Task 9. The solid lines in Figures W-1 and W-2 represent constrained relationships for data, generally one-to-many relationships. The dotted lines depict lookup list options.

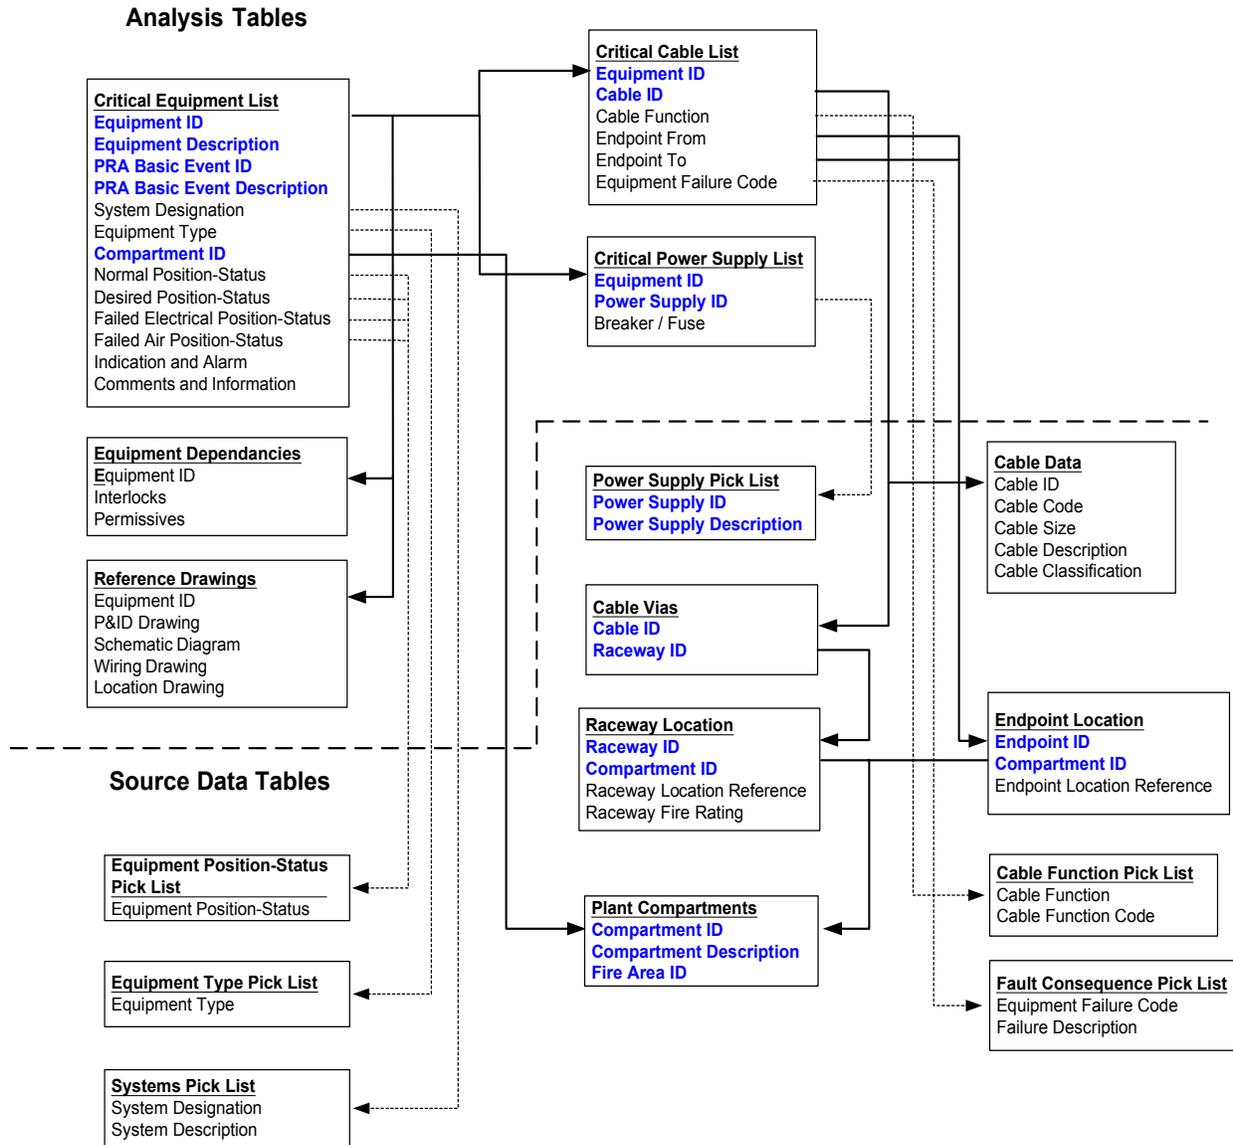


Figure W-1
Fire PRA Database Structure—Equipment and Cables

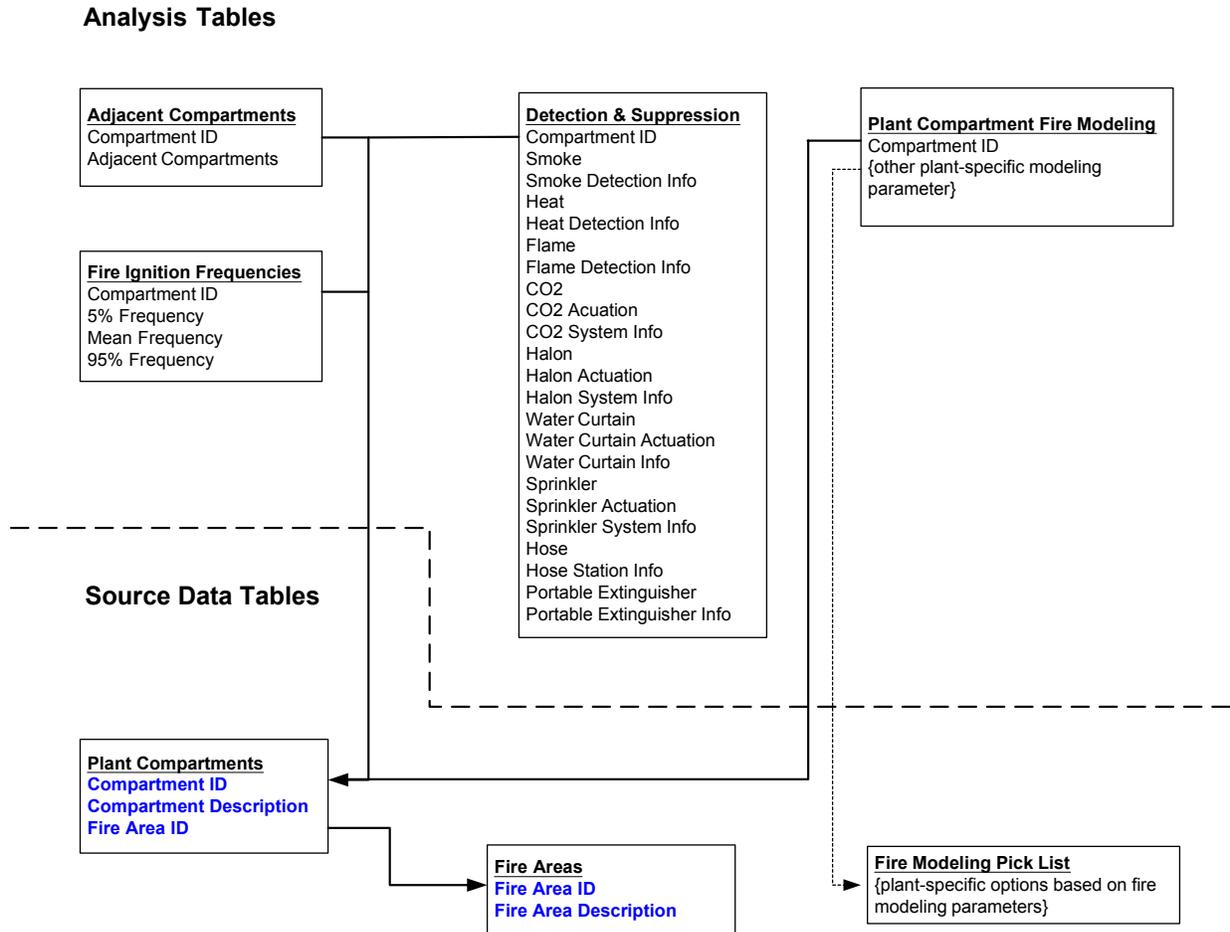


Figure W-2
Fire PRA Database Structure—Compartment, Areas, and Fire Protection

W.2 Source Data Table Constraints and Data Integrity Logical Requirements

Selection options for the source data lookup tables should be established. Data lookup tables are used to expedite data entry and force consistency in sortable fields. Consistency and preciseness of data entry terms are important elements in assuring the database produces accurate and complete results for queries and sorts. For example, it might be desirable to identify all valves in an area that could spuriously reposition. If the database does not capture this failure mode for all valves using identical terminology, it is possible that some valves might not be flagged as a spurious operation (SO) concern. In summary, consistency in format for sortable fields is important to ensuring data queries do not overlook a record because of inconsistent data entry.

Typical lookup table options are provided in Table W-1. These options should be modified and adjusted to suit the plant-specific analysis.

**Table W-1
Fire-PRA Database Lookup Table Options**

Table Name	Table Field	Options
Equipment Positions-Status Pick List	Equipment Position-Status	On Off Open Closed Throttled Cycle Available Energized Deenergized Running Stopped
Equipment Type Pick List	Equipment Type	Motor operated valve Air operated valve Solenoid valve Manual valve Hydraulic valve Check valve Air-operated damper Motor-operated damper Manual damper Pump Instrument Heater Fan Switchgear Load center Motor Control Center Distribution Panel Generator Battery Battery charger Inverter Cooler Chiller AC unit Tank Compressor
Systems Pick List	System Designation System Description	Plant-specific designations Plant-specific designations
Power Supply Pick List	Power Supply ID Power Supply Description	Plant-specific designations Plant-specific designations

**Table W-1
Fire-PRA Database Lookup Table Options (Continued)**

Table Name	Table Field	Options
Plant Compartments	Compartment ID Compartment Description Fire Area ID	Task 1 input Task 1 input Task 1 input
Fire Areas	Fire Area ID Fire Area Description	Task 1 input Task 1 input
Cable Function Pick List	Cable Function Cable Function Code	Power Control Instrument Auxiliary Spare P C I A S
Fault Consequence Pick List	Equipment Failure Code Failure Description	FO FC LOP LOC LOI-H LOI-L EI NC SO Fail Open Fail Closed Loss of Power Loss of Control Loss of Indication – Fail High Loss of Indication – Fail Low Erroneous Indication No Consequence Spurious Operation
Fire Modeling Pick List	Plant specific parameters	Plant-specific parameters

W.3 Data Integrity Rules and Logical Constraints

Maintaining data integrity is critical to the long-term viability of the Fire PRA Database. Over time, data quality and consistency will degrade if proper rules and constraints are not established for data entry and storage. The following rules and constraints are suggested:

- The Fire PRA Equipment List table fields should only contain options from the appropriate lookup table.
- The Fire PRA Cable List table should be capable of accommodating multiple entries of a single cable so that a cable can be associated with more than one component when appropriate.
- The Fire PRA Cable List table fields containing lookup menus should only contain options from the appropriate pick list table.
- The Plant Compartments and Fire Area Table options should be limited to selections identified by Task 1.
- The Cable Vias Table should only reference raceways listed in the Raceway Location Table.
- The Raceway Location Table should only reference plant compartments listed in the Plant Compartments Table.
- The Plant Compartments Table should only reference Fire Areas listed in the Fire Areas Table.
- Database parent-child relations should be maintained so that flow-down deletes are active.

W.4 Mapping Data Fields to Task Activities

Source data should be mapped to the data fields in the database to ensure efficient and complete data collection. Task activities pertaining to data collection and entry should be aligned with the database to accomplish this goal. The following checks should be accomplished to ensure efficient and complete mapping of source data to the database:

- Confirm that implementing procedures for Tasks 1, 2, 3, and 9 include adequate methods for collecting, controlling, and inputting the necessary data into the appropriate data tables.
- Compare data structure and formats of source and destination data tables in preparation for uploading essential cable-to-raceway information into the cable vias table. This activity is simple in concept, but may demand a significant effort, depending on the form and compatibility of the source data.
- Determine the form of source data for uploading raceway-to-compartment information into the Raceway Location Table. This step may involve a data transfer from another database or manual input, depending on the availability of data.
- Confirm appropriate options for lookup tables.

BIBLIOGRAPHIC DATA SHEET

(See instructions on the reverse)

1. REPORT NUMBER
(Assigned by NRC, Add Vol., Supp., Rev.,
and Addendum Numbers, if any.)

NUREG/CR-6850
Vol. 2

2. TITLE AND SUBTITLE

EPRI/NRC-RES Fire PRA Methodology for Nuclear Power Facilities

Volume 2: Detailed Methodology

3. DATE REPORT PUBLISHED

MONTH	YEAR
September	2005

4. FIN OR GRANT NUMBER

N6107

5. AUTHOR(S)

S. P. Nowlen, B. Najafi, F. J. Wyant, J. Forester, M. Kazarians, A. Kolaczowski, F. Joglar, D. Funk, G. Hannaman, R. Anoba

6. TYPE OF REPORT

Technical

7. PERIOD COVERED (Inclusive Dates)

8. PERFORMING ORGANIZATION - NAME AND ADDRESS (If NRC, provide Division, Office or Region, U.S. Nuclear Regulatory Commission, and mailing address; if contractor, provide name and mailing address.)

Sandia National Laboratory
P.O. Box 5800
Albuquerque, NM 87185-0744

Science Applications International Corporation
4920 El Camino Real
Los Altos, CA 94022

9. SPONSORING ORGANIZATION - NAME AND ADDRESS (If NRC, type "Same as above"; if contractor, provide NRC Division, Office or Region, U.S. Nuclear Regulatory Commission, and mailing address.)

Division of Risk Analysis and Applications
Office of Nuclear Regulatory Research
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Electric Power Research Institute
3420 Hillview Avenue
Palo Alto, CA 94303

10. SUPPLEMENTARY NOTES

NRC Project Manager, J.S. Hyslop

EPRI Project Manager, Robert P. Kassawara

11. ABSTRACT (200 words or less)

This report documents state-of-art methods, tools, and data for the conduct of a fire Probabilistic Risk Assessment (PRA) for a commercial nuclear power (NPP) application. This report is intended to serve the needs of a fire risk analysis team by providing a structured framework for conduct of the overall analysis, as well as specific practices to address each key aspect of the analysis. The methods have been developed under the Fire Risk Requantification Study. This study was conducted as a joint activity between the Electric Power Research Institute (EPRI) and the U.S. Nuclear Regulatory Commission (NRC) Office of Nuclear Regulatory Research (RES) under the terms of an NRC/EPRI Memorandum of Understanding on Cooperative Nuclear Safety Research and an accompanying Fire Risk Addendum. Participants from the U.S. nuclear power industry supported demonstration analyses and provided peer review of this methodology. Methodological issues raised in past fire risk analyses, including the Individual Plant Examination of External Events (IPEEE) fire analyses, have been addressed to the extent allowed by the current state-of-art and the overall project scope. While the primary objective of the project was to consolidate existing state-of-art methods, the newly documented methods represent a significant advancement over previously documented methods in many areas.

12. KEY WORDS/DESCRIPTORS (List words or phrases that will assist researchers in locating the report.)

Fire, Fire Risk, Risk Analysis, Probabilistic Risk Assessment, PRA, Probabilistic Safety Assessment, PSA, Risk-Informed Regulation, Performance-Based, Fire Protection, Fire Safety

13. AVAILABILITY STATEMENT

unlimited

14. SECURITY CLASSIFICATION

(This Page)


unclassified

(This Report)

unclassified

15. NUMBER OF PAGES

16. PRICE



Federal Recycling Program

Export Control Restrictions

Access to and use of this report is granted with the specific understanding and requirement that responsibility for ensuring full compliance with all applicable U.S. and foreign export laws and regulations is being undertaken by you and your company. This includes an obligation to ensure that any individual receiving access hereunder who is not a U.S. citizen or permanent U.S. resident is permitted access under applicable U.S. and foreign export laws and regulations. In the event you are uncertain whether you or your company may lawfully obtain access to this report, you acknowledge that it is your obligation to consult with your company's legal counsel to determine whether this access is lawful. Although EPRI may make available on a case-by-case basis an informal assessment of the applicable U.S. export classification for specific report, you and your company acknowledge that this assessment is solely for informational purposes and not for reliance purposes. You and your company acknowledge that it is still the obligation of you and your company to make your own assessment of the applicable U.S. export classification and ensure compliance accordingly. You and your company understand and acknowledge your obligations to make a prompt report to EPRI and the appropriate authorities regarding any access to or use of this report hereunder that may be in violation of applicable U.S. or foreign export laws or regulations.

Electric Power Research Institute and EPRI are registered service marks of the Electric Power Research Institute, Inc.

 Printed on recycled paper in the United States of America

EPRI 1011989

The Electric Power Research Institute (EPRI)

The Electric Power Research Institute (EPRI), with major locations in Palo Alto, California, and Charlotte, North Carolina, was established in 1973 as an independent, nonprofit center for public interest energy and environmental research. EPRI brings together members, participants, the Institute's scientists and engineers, and other leading experts to work collaboratively on solutions to the challenges of electric power. These solutions span nearly every area of electricity generation, delivery, and use, including health, safety, and environment. EPRI's members represent over 90% of the electricity generated in the United States. International participation represents nearly 15% of EPRI's total research, development, and demonstration program.

Together...Shaping the Future of Electricity

United States Nuclear Regulatory Commission
Washington, D.C.

NUREG/CR-6850

ELECTRIC POWER RESEARCH INSTITUTE

3420 Hillview Avenue, Palo Alto, California 94304-1395 • PO Box 10412, Palo Alto, California 94303-0813 USA
800.313.3774 • 650.855.2121 • askepri@epri.com • www.epri.com

