

REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8002060441 DOC. DATE: 80/01/31 NOTARIZED: NO DOCKET #
 FACIL: 50-269 Oconee Nuclear Station, Unit 1, Duke Power Co. 05000269
 50-270 Oconee Nuclear Station, Unit 2, Duke Power Co. 05000270
 50-287 Oconee Nuclear Station, Unit 3, Duke Power Co. 05000287

AUTH. NAME: PARKER, W.O. AUTHOR AFFILIATION: Duke Power Co.
 RECIP. NAME: DENTON, H.R. RECIPIENT AFFILIATION: Office of Nuclear Reactor Regulation

SUBJECT: Forwards response to NRC 791212 questions & 800111 telcon re degraded grid voltage.

DISTRIBUTION CODE: A0155 COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 6
 TITLE: Onsite Emergency Power Systems

NOTES: ~~M. CUNNINGHAM - ALL AMENDS TO FSAR & CHANGES TO~~

	RECIPIENT ID CODE/NAME	COPIES		RECIPIENT ID CODE/NAME	COPIES		TECH SPECS.
		LTR	ENCL		LTR	ENCL	
ACTION:	05 BC ORB #4	7	7	LA ORB #4	1	0	
INTERNAL:	1 REG FILE	1	1	02 NRC PDR	1	1	
	12 TA/EDO	1	1	13 I&E	2	2	
	15 OELD	1	1	16 MPA	1	1	
	17 AUXIL SYS BR	1	1	18 I&C SYS BR	1	1	
	20 ENGR BR	1	1	21 REAC SFTY BR	1	1	
	22 PLANT SYS BR	1	1	23 ADV REAC BR	1	1	
	24 PWR SYS BR	1	1	25 WAMBACH T	1	1	
	26 TONDI, D	1	1	27 MCDONALD, D	1	1	
	30 EEB	1	1	S HANAUER	1	1	
	STS GROUP LEADR	1	1				
EXTERNAL:	03 LPDR	1	1	04 NSIC	1	1	
	31 ACRS	16	16				

FEB 7 1980

TOTAL NUMBER OF COPIES REQUIRED: LTR 46 ENCL 45

MA

DUKE POWER COMPANY

POWER BUILDING

422 SOUTH CHURCH STREET, CHARLOTTE, N. C. 28242

WILLIAM O. PARKER, JR.
VICE PRESIDENT
STEAM PRODUCTION

January 31, 1980

TELEPHONE: AREA 704
373-4083

Mr. Harold R. Denton, Director
Office of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555


Attention: Mr. R. W. Reid, Chief
Operating Reactors Branch No. 4

Re: Oconee Nuclear Station
Docket Nos. 50-269, -270, -287

Dear Sir:

As requested by members of the Staff involved in a January 11, 1980 teleconference on degraded grid voltages, please find attached Duke Power Company's response to several questions which were informally provided to Duke on December 12, 1979 or brought up in the teleconference.

Very truly yours,

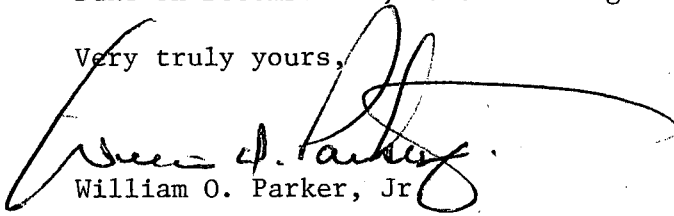
William O. Parker, Jr.

RLG:scs

Attachment

*AOIS
5/11*

8002060 441

OCONEE NUCLEAR STATION

NRC Request for Information
Degraded Grid Voltage

1. What is the maximum and minimum allowable variation from your second level undervoltage setpoint? (Reference DPC letters July 21 and October 7, 1977).

Response

The undervoltage relays used in this particular application have a tolerance of $\pm 3\%$ of setpoint.

Additionally, in our January 11, 1980 telecon with the NRC, the voltage recovery time at the 4 KV level following the transfer of all normally running loads to the startup transformer and the starting of all required ES loads was requested. The dynamic simulation of the distribution system indicates that the 4 KV voltage level recovers to its steady-state condition in less than three seconds following the load transfer and starting requirements stated above. This voltage recovery time is representative of that seen by the undervoltage relays.

2. Do you have documentation to support your statement that the 600 and 208 VAC motor contactors will hold-in with the MCC voltages at 72 and 71% respectively?

Response

Duke Power Company has manufacturer's test documentation that shows that motor contactors of the types used in safety-related applications at Oconee will hold-in at voltages of 72% of nominal 600 V and 71% of nominal 208 V.

3. Do you have documentation to show that all of the safety related motor contactors (starters) will pick up and hold in under the worst case voltages?

Response

Duke Power Company has manufacturer's test documentation that shows that contactors of the types used in safety-related applications at Oconee will pick-up under the worst-case voltages predicted by our analysis. The capability for contactor hold-in is addressed in the response to Question 2.

4. Will the TOL's and/or other protection devices for the MOV's sustain the expected locked-rotor current for 5 to 6 seconds without interrupting the circuit?

Response

Thermal overload devices and molded-case circuit breakers used in safety-related MOV circuits are capable of withstanding the expected locked-rotor current for six seconds without interrupting the circuit.

5. Will all instrument and control equipment connected to the analyzed buses withstand the worst case voltages without degradation and/or loss of their required function? (Blowing fuses, etc.)

Response

Safety-related and non safety-related instrumentation which is used in plant protection and/or which is important in operating the plant and monitoring plant status is powered from battery-backed sources as shown in FSAR Figure 8-5. These battery-backed sources are not affected by degraded grid voltage.

Additionally, motor control center control power fusing has been tested at and below the worst-case voltages identified in our analysis. No interrupting action occurred during repetitious application of the postulated degraded voltage levels.

6. How will your periodic power system test verify the system analysis? When has the latest test been performed and does it verify the analysis results?

Response

The analytical methods used in the distribution system analysis will be verified by a comparison between measured voltage conditions at the station and calculated results of the test conditions. It is expected that the necessary analysis and comparison will be completed by March 15, 1980.

7. Do you have manufacturers documentation to show that the RBCU fan motor will start with the MCC voltage at 70 or 72%?

Response

The manufacturer of the RBCU fan motors has provided speed-torque curves for these motors which are based on actual performance test data. To show that the RBCU fan motor will start with its associated MCC voltage dipping to 72%, the speed-torque curve for the motor was extrapolated to 70% of nominal voltage. The motor speed-torque curve at 70% nominal voltage in conjunction with the motor load curve shows that the RBCU fan motor will start and accelerate to approximately 99% of rated speed. It is important to note that this analysis takes no credit for voltage recovery as the motor is accelerating.

The dynamic simulation of the distribution system indicates that the RBCU fan motor will start with the MCC voltage dipping to 72% of nominal and accelerate to rated speed in approximately five seconds. This reduced voltage start will not result in any degradation or loss of life to the motor since the motor is capable of withstanding rated locked-rotor current for 10 seconds.

8. In the January 11, 1980 telecon between Duke and NRC, the NRC asked that Duke respond to Item 3 of their Guidelines for Voltage Drop Calculations.
3. All actions the electric power system is designed to automatically initiate should be assumed to occur as designed (e.g., automatic bulk or sequential loading or automatic transfers of bulk loads from one transformer to another). Included should be consideration of starting of large non-safety loads (e.g., condensate pumps).

Response

Position 3 of the NRC Guidelines for Voltage Drop Calculations states that the voltage analysis should consider the starting of a large non safety-related motor at a time following the transfer of all normally running loads to the startup transformer and the starting of all required ES loads (i.e., after steady-state conditions have been established on the power distribution system).

An analysis has been performed considering the starting and running of a 2000 HP Condensate Booster Pump under the conditions described above. The analysis shows that the non-safety-related pump will start and that its starting has no adverse effects on the already running loads. Figures 1 and 2 provide the voltage profiles for starting and running the Condensate Booster Pump in addition to the previously analyzed loads.

9. In the January 11, 1980 telecon between Duke and NRC, the NRC asked that Duke respond to Item 2 of their Guidelines for Voltage Drop Calculations.
2. For multi-unit stations a separate analysis should be performed for each unit assuming (1) an accident in the unit being analyzed and simultaneous shutdown of all other units at that station; or (2) an anticipated transient in the unit being analyzed (e.g., unit trip) and simultaneous shutdown of all other units at that station, whichever presents the largest load demand situation.

Response


The power system configuration described in Item 2 of the NRC's Guidelines for Voltage Drop calculations is presently being analyzed. The results of our analysis are expected to be available by March 1, 1980.

10. In the January 11, 1980 telecon between Duke and NRC, the NRC requested that Duke verify that the overvoltage cases presented in Duke's November 15, 1976 response are still applicable.

Response

A review of the overvoltage cases presented in our November 15, 1976 response indicates that the voltage profiles are still applicable.


Figure 1

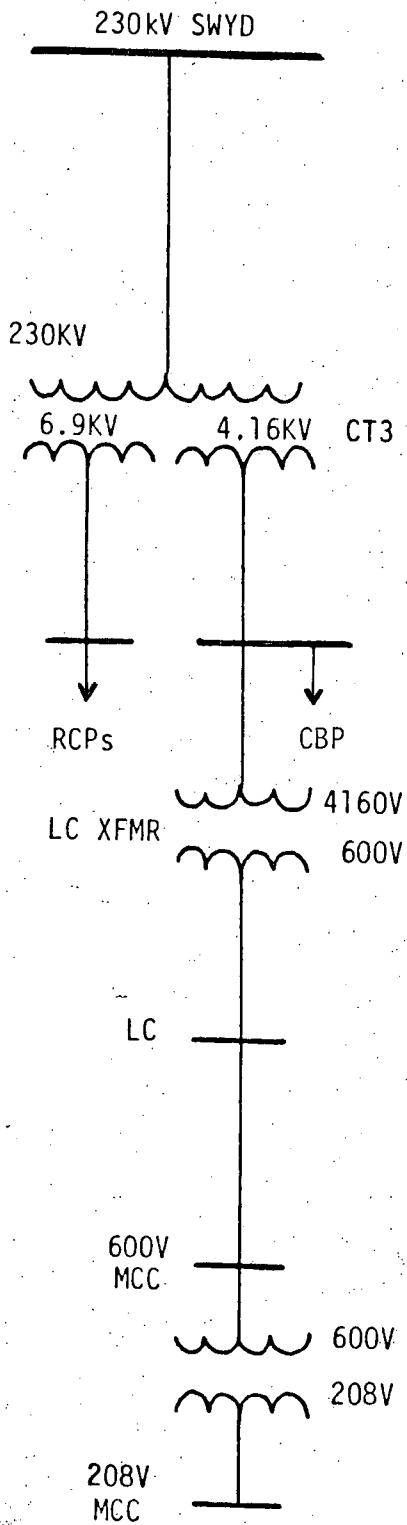

LOCATION	BUS NAME	PER UNIT VOLTAGE NOMINAL BASE	VOLTAGE	PER UNIT VOLTAGE MOTOR BASE
SWYD	230KV SWYD	0.9435	217 KV	NA
6.9KV SWGR	3TA	0.9279	6.40 KV	0.970
	3TB	0.9278	6.40 KV	0.970
4.16KV SWGR	3TC	0.8618	3585 V	0.896
	3TD	0.8613	3583 V	0.896
	3TE	0.8610	3582 V	0.895
600V LC	3X8	0.8559	514 V	0.893
	3X9	0.8544	513 V	0.892
	3X10	0.8381	503 V	0.875
600V MCC	3XS1	0.8558	514 V	0.893
	3XS2	0.8540	512 V	0.891
	3XS3	0.8347	501 V	0.871
208V MCC	3XS1	0.8558	178 V	0.890
	3XS2	0.8540	178 V	0.888
	3XS3	0.8347	174 V	0.868

VOLTAGES UPON STARTING CONDENSATE BOOSTER PUMPS AFTER STEADY STATE RE-ESTABLISHED

Figure 2

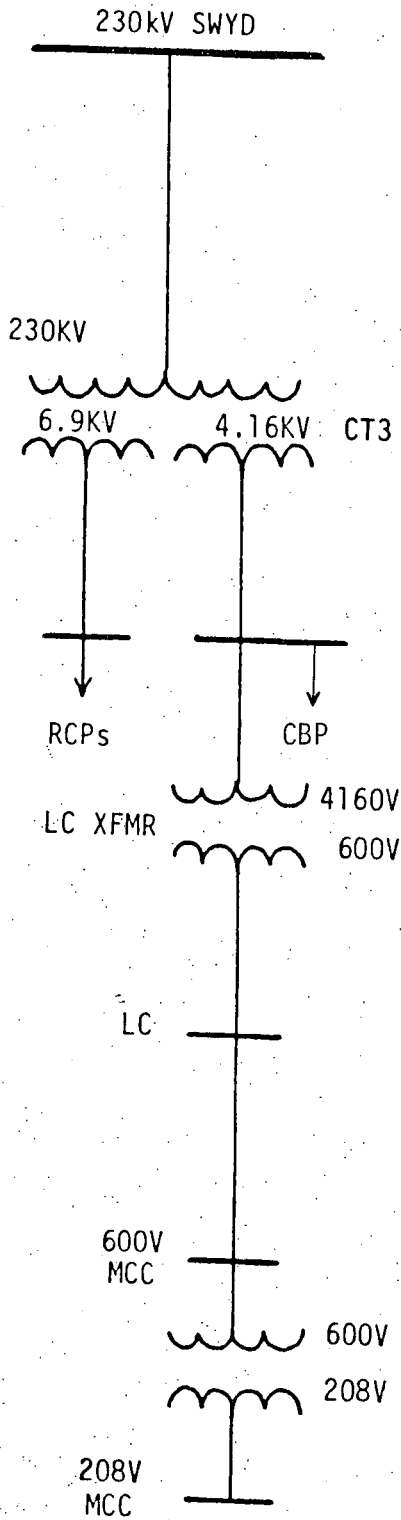

LOCATION	BUS NAME	PER UNIT VOLTAGE NOMINAL BASE	VOLTAGE	PER UNIT VOLTAGE MOTOR BASE
SWYD	230KV SWYD	0.9435	217 KV	NA
6.9KV SWGR	3TA	0.9371	6.47 KV	0.980
	3TB	0.9371	6.47 KV	0.980
4.16KV SWGR	3TC	0.9040	3761 V	0.940
	3TD	0.9037	3759 V	0.940
	3TE	0.9036	3759 V	0.940
600V LC	3X8	0.8984	539 V	0.937
	3X9	0.8971	538 V	0.936
	3X10	0.8818	529 V	0.920
600V MCC	3XS1	0.8982	539 V	0.937
	3XS2	0.8967	538 V	0.936
	3XS3	0.8785	527 V	0.917
208V MCC	3XS1	0.8982	187 V	0.934
	3XS2	0.8967	187 V	0.933
	3XS3	0.8785	183 V	0.914

VOLTAGES AFTER CONDENSATE BOOSTER PUMPS ARE RUNNING